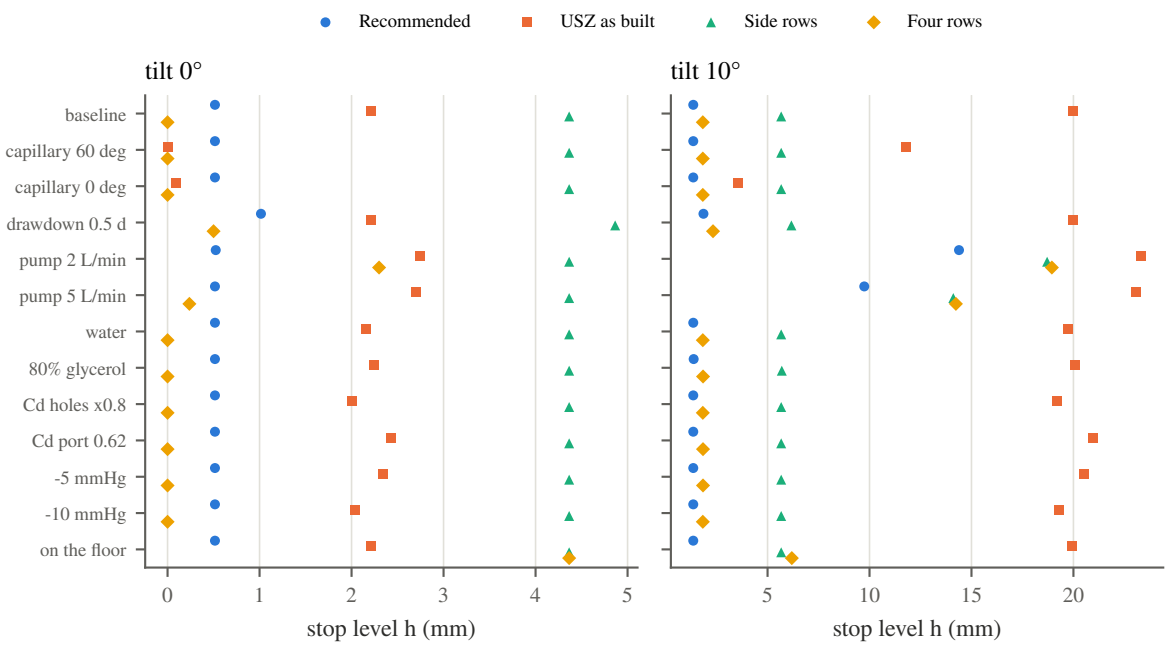
Recommended
USZ as built
Side rows
Four rows
tilt 0°
tilt 10°
baseline
capillary 60 deg
capillary 0 deg
drawdown 0.5 d
pump 2 L/min
pump 5 L/min
water
80% glycerol
Cd holes x0.8
Cd port 0.62
-5 mmHg
-10 mmHg
on the floor
0
1
2
3
4
5
10
15
20
stop level h (mm)
stop level h (mm)