


Ignition Type ▾

Chart for main steam

Average of Main Steam Cond | Average of Main Steam Ph | Average of Main Steam Fe | Sum of Ammonia Kg_Day | Sum of Hydrazine Kg_Day | Sum of...

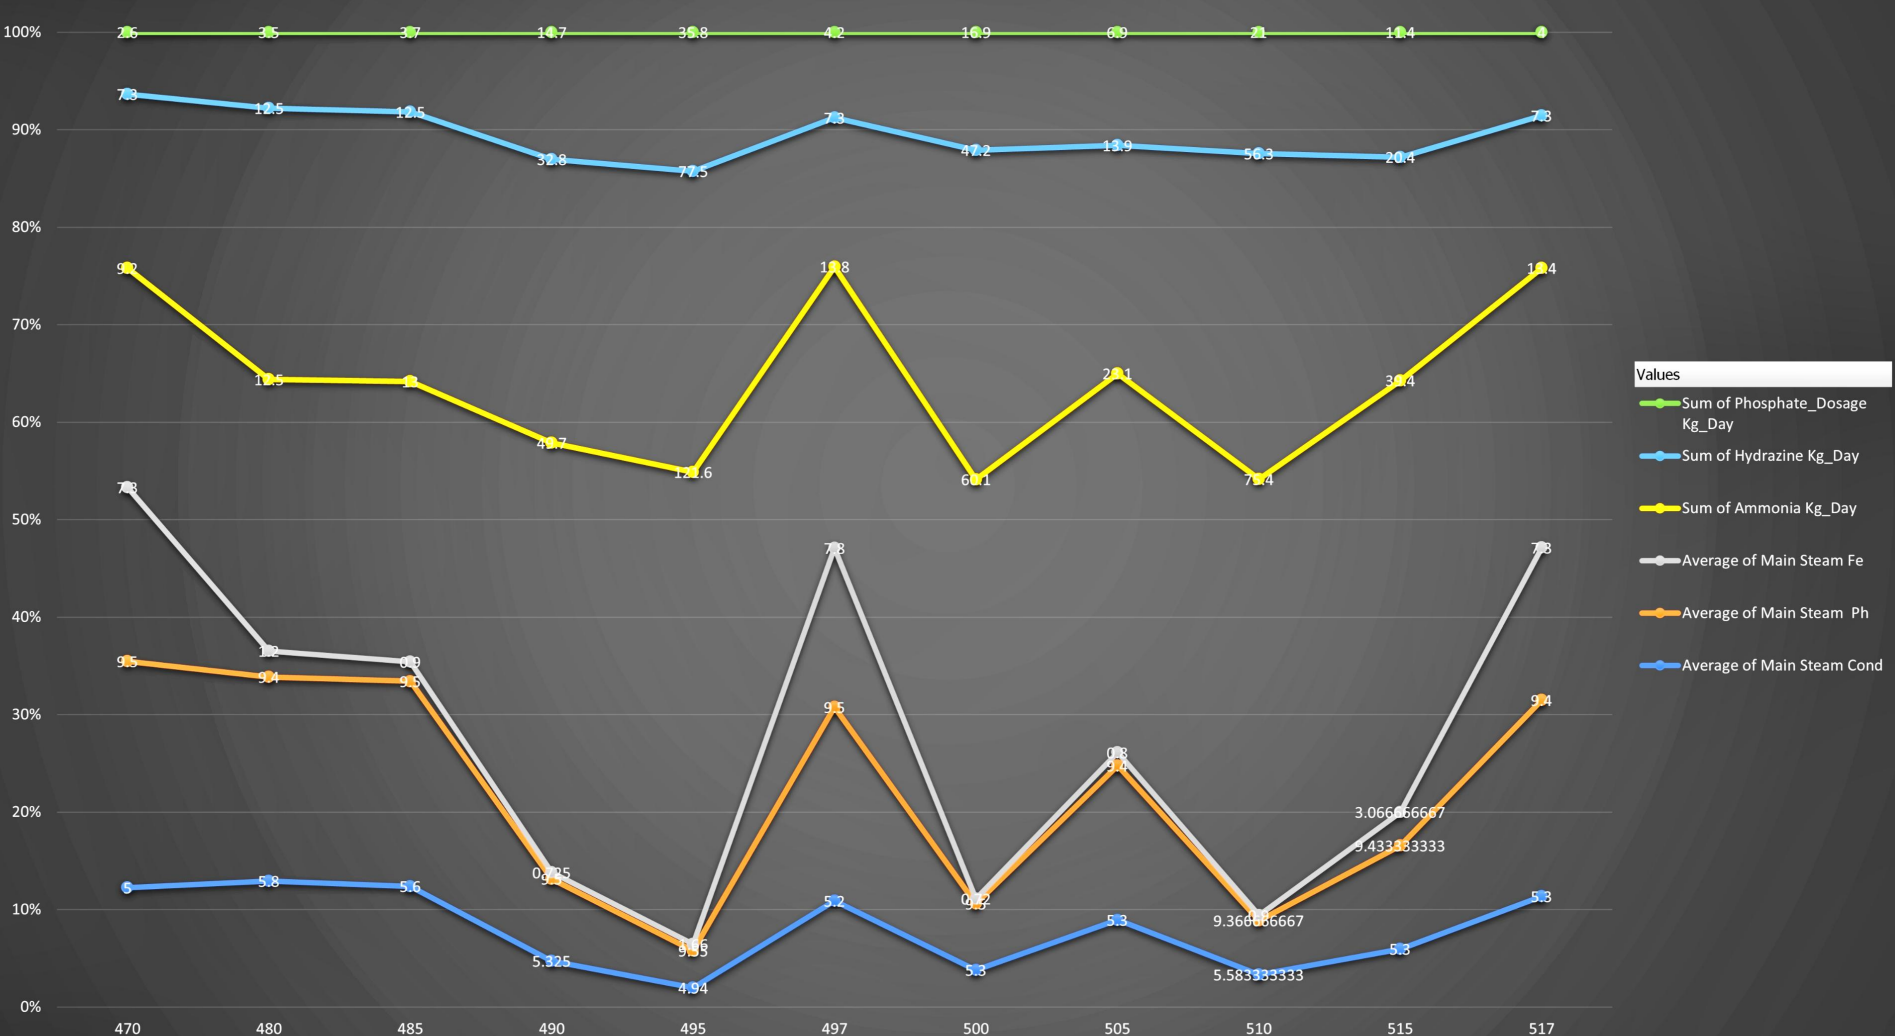


Load_MW Load ▾

Ignition Type

Average of Condensate Ph | Average of Condensate Cond | Average of Condensate Do | Sum of Hydrazine Kg_Day | Sum of Ammonia Kg_Day

Chart for condenser with HYDRAZINE FOR DO

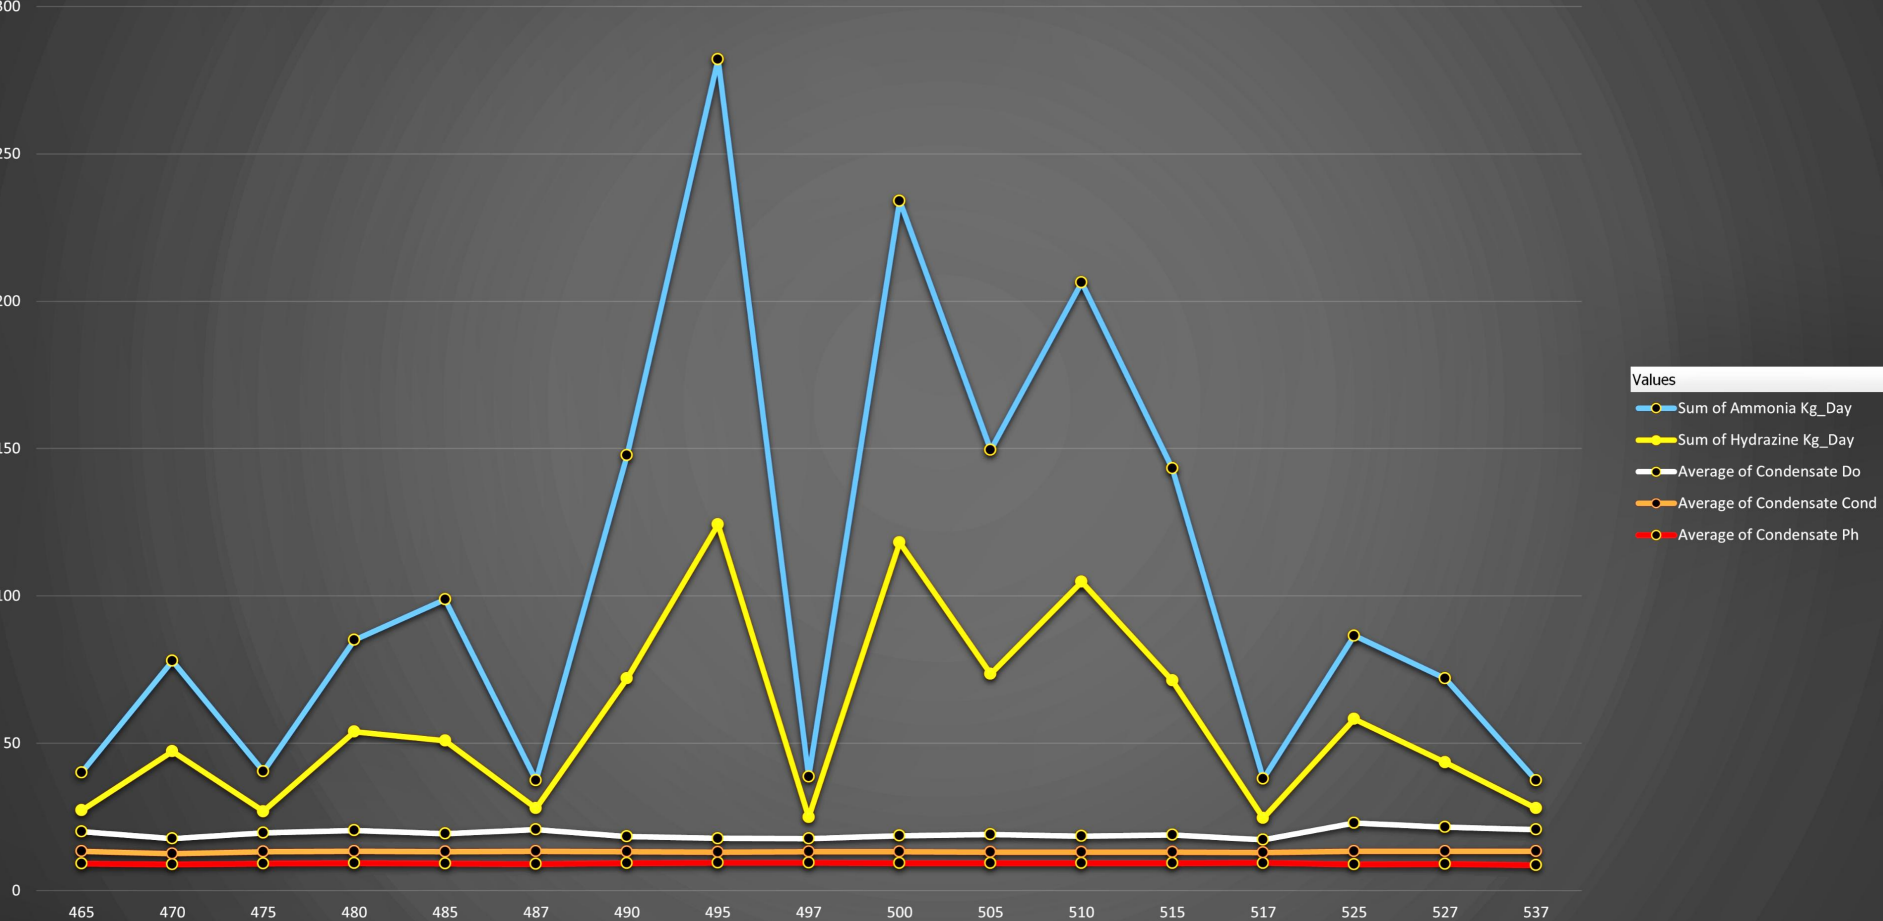


Load_MW Load

Ignition Type

CONDUCTIVITY PH po4 Average of Fe Sum of...

Chart for biler

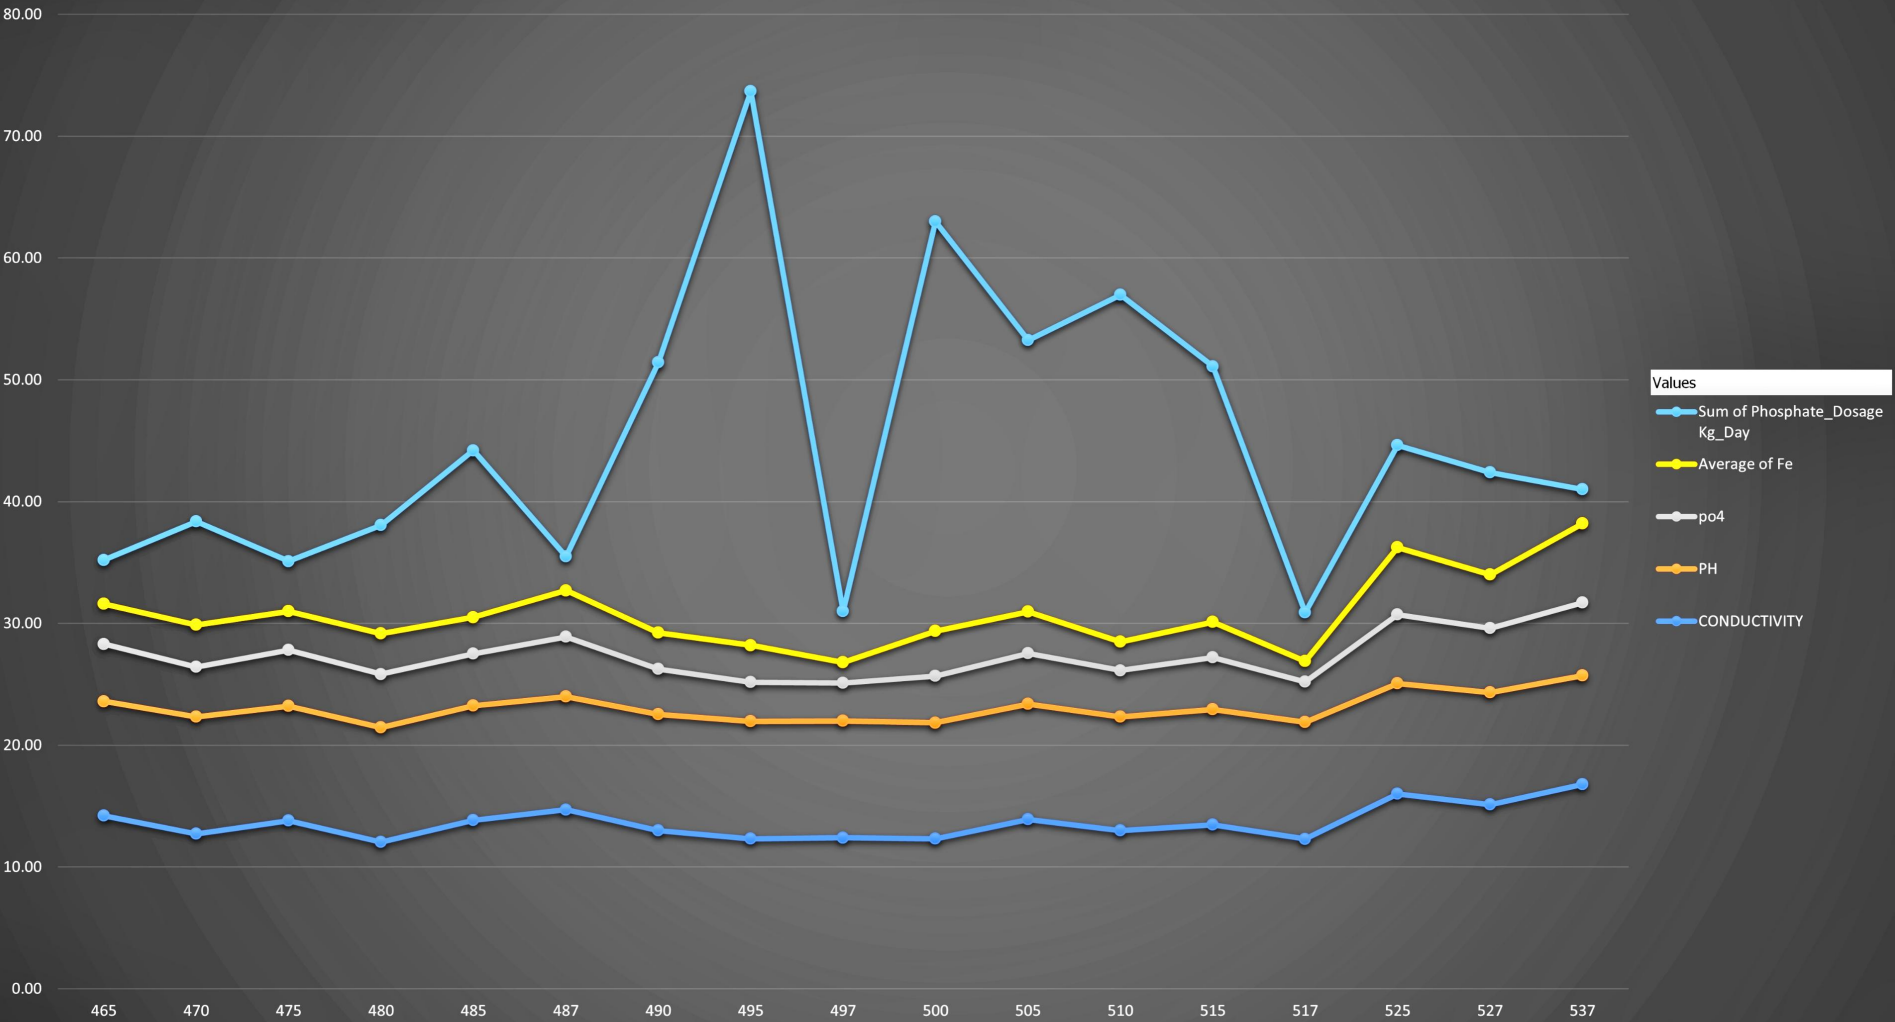


Load_MW Load

Ignition Type

Average of Condensate Ph Average of Condensate Cond Average of Condensate Do Sum of Ammonia Kg_Day Sum of DEHA Kg_Day

Chart for condenser with DEHA FOR DO

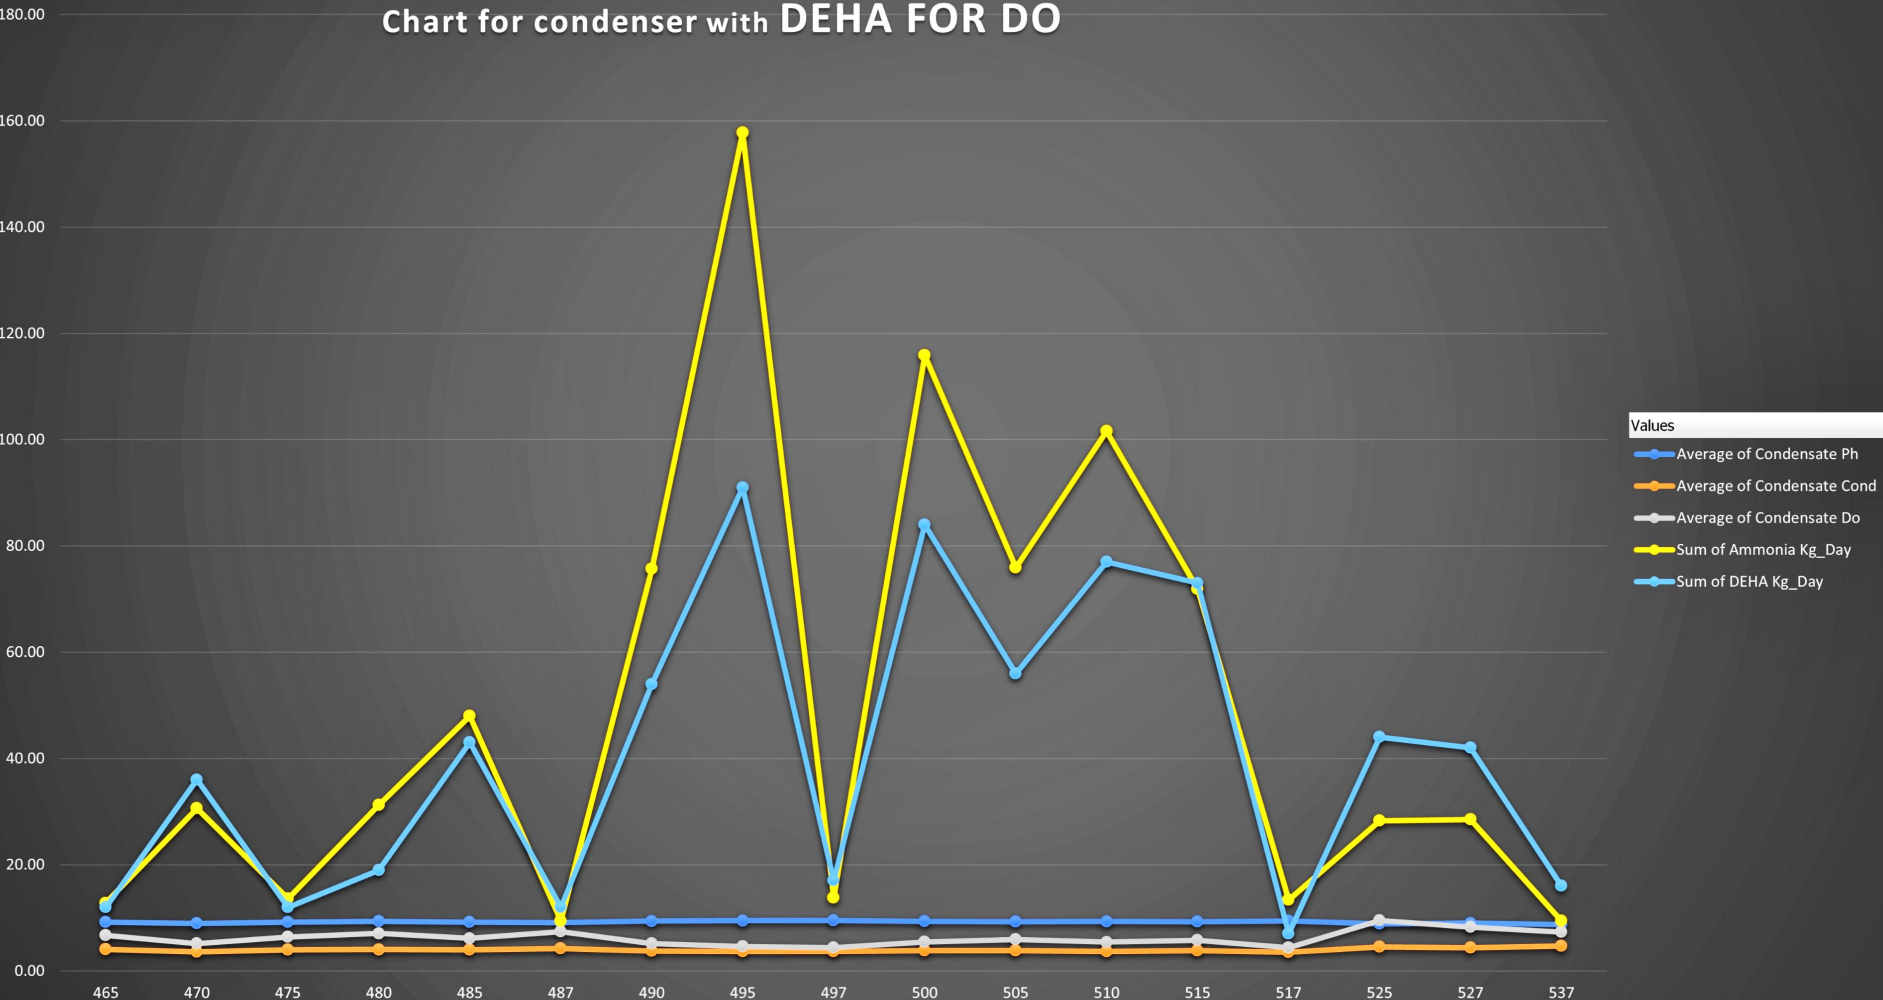

Load_MW Load

Chart Variables







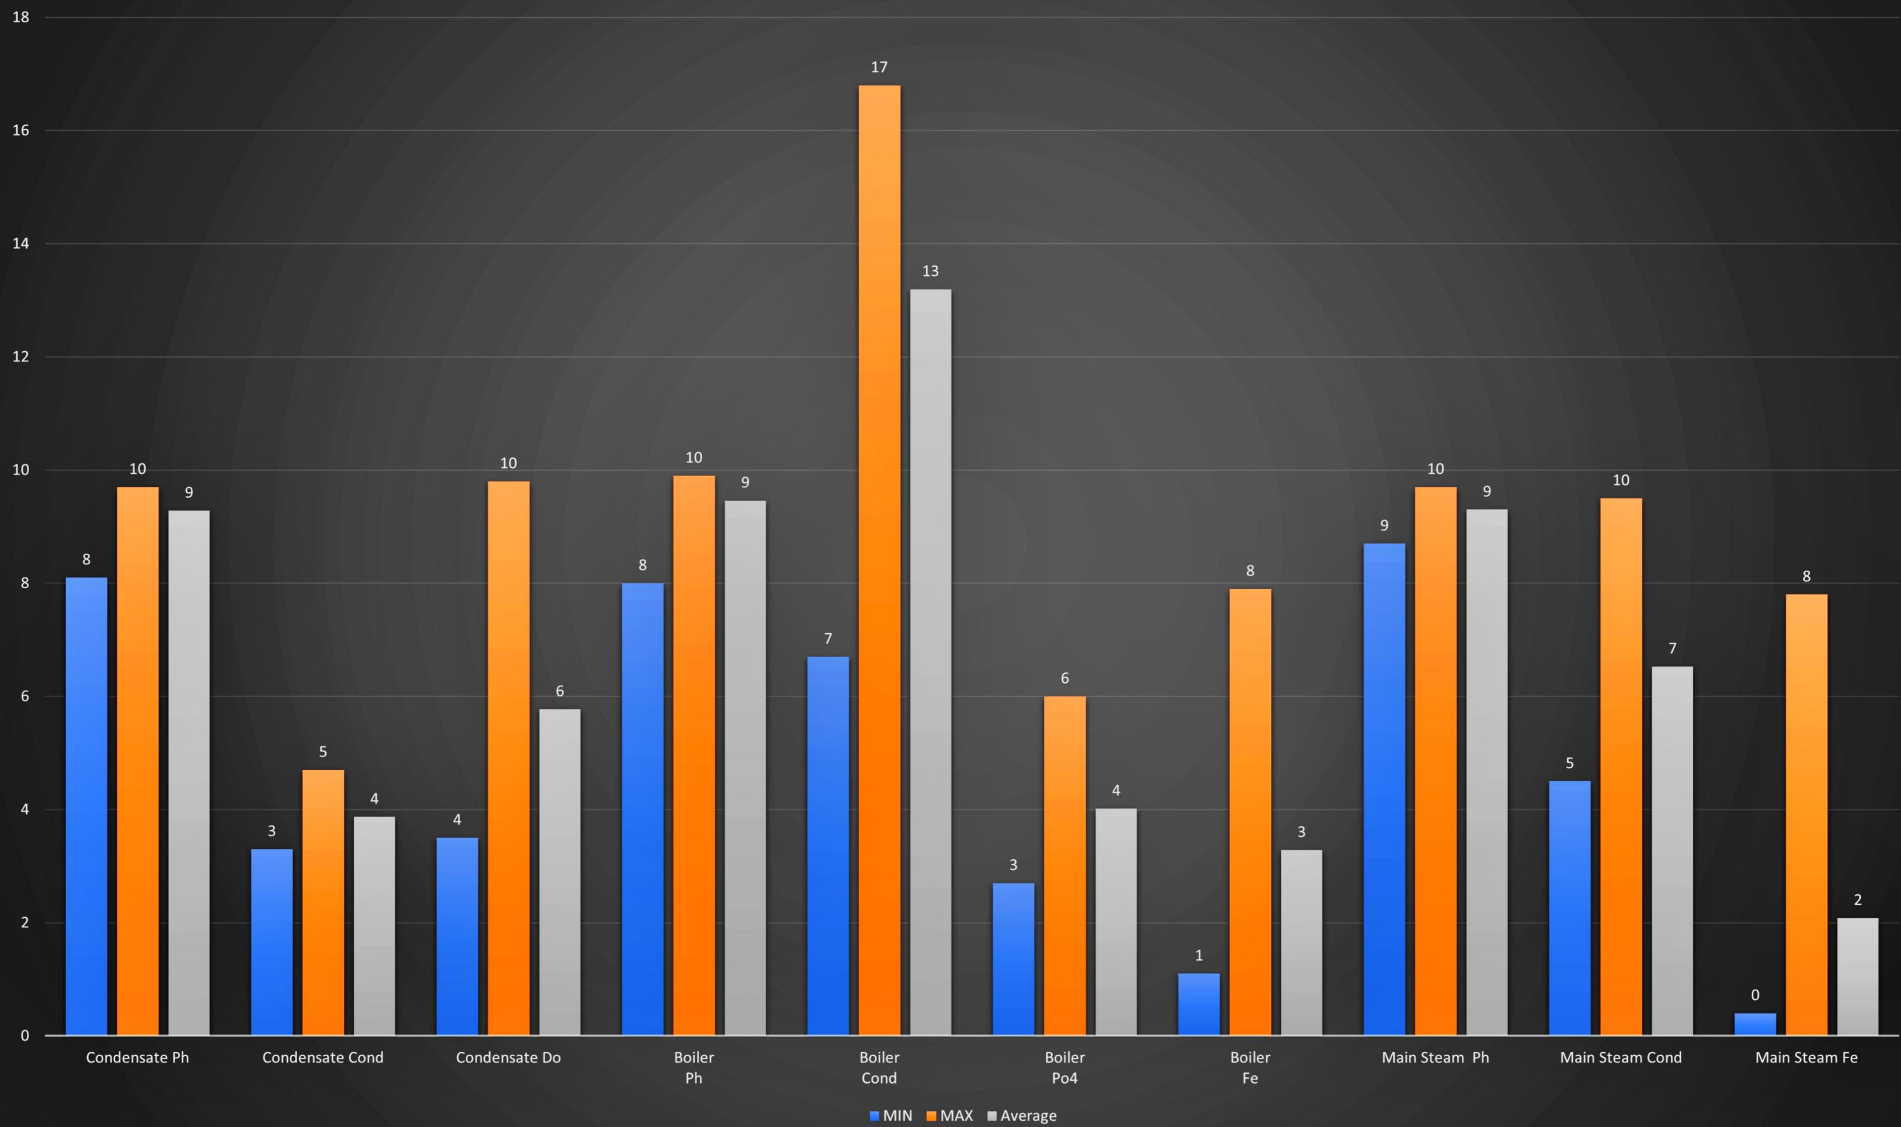


Chart Variables

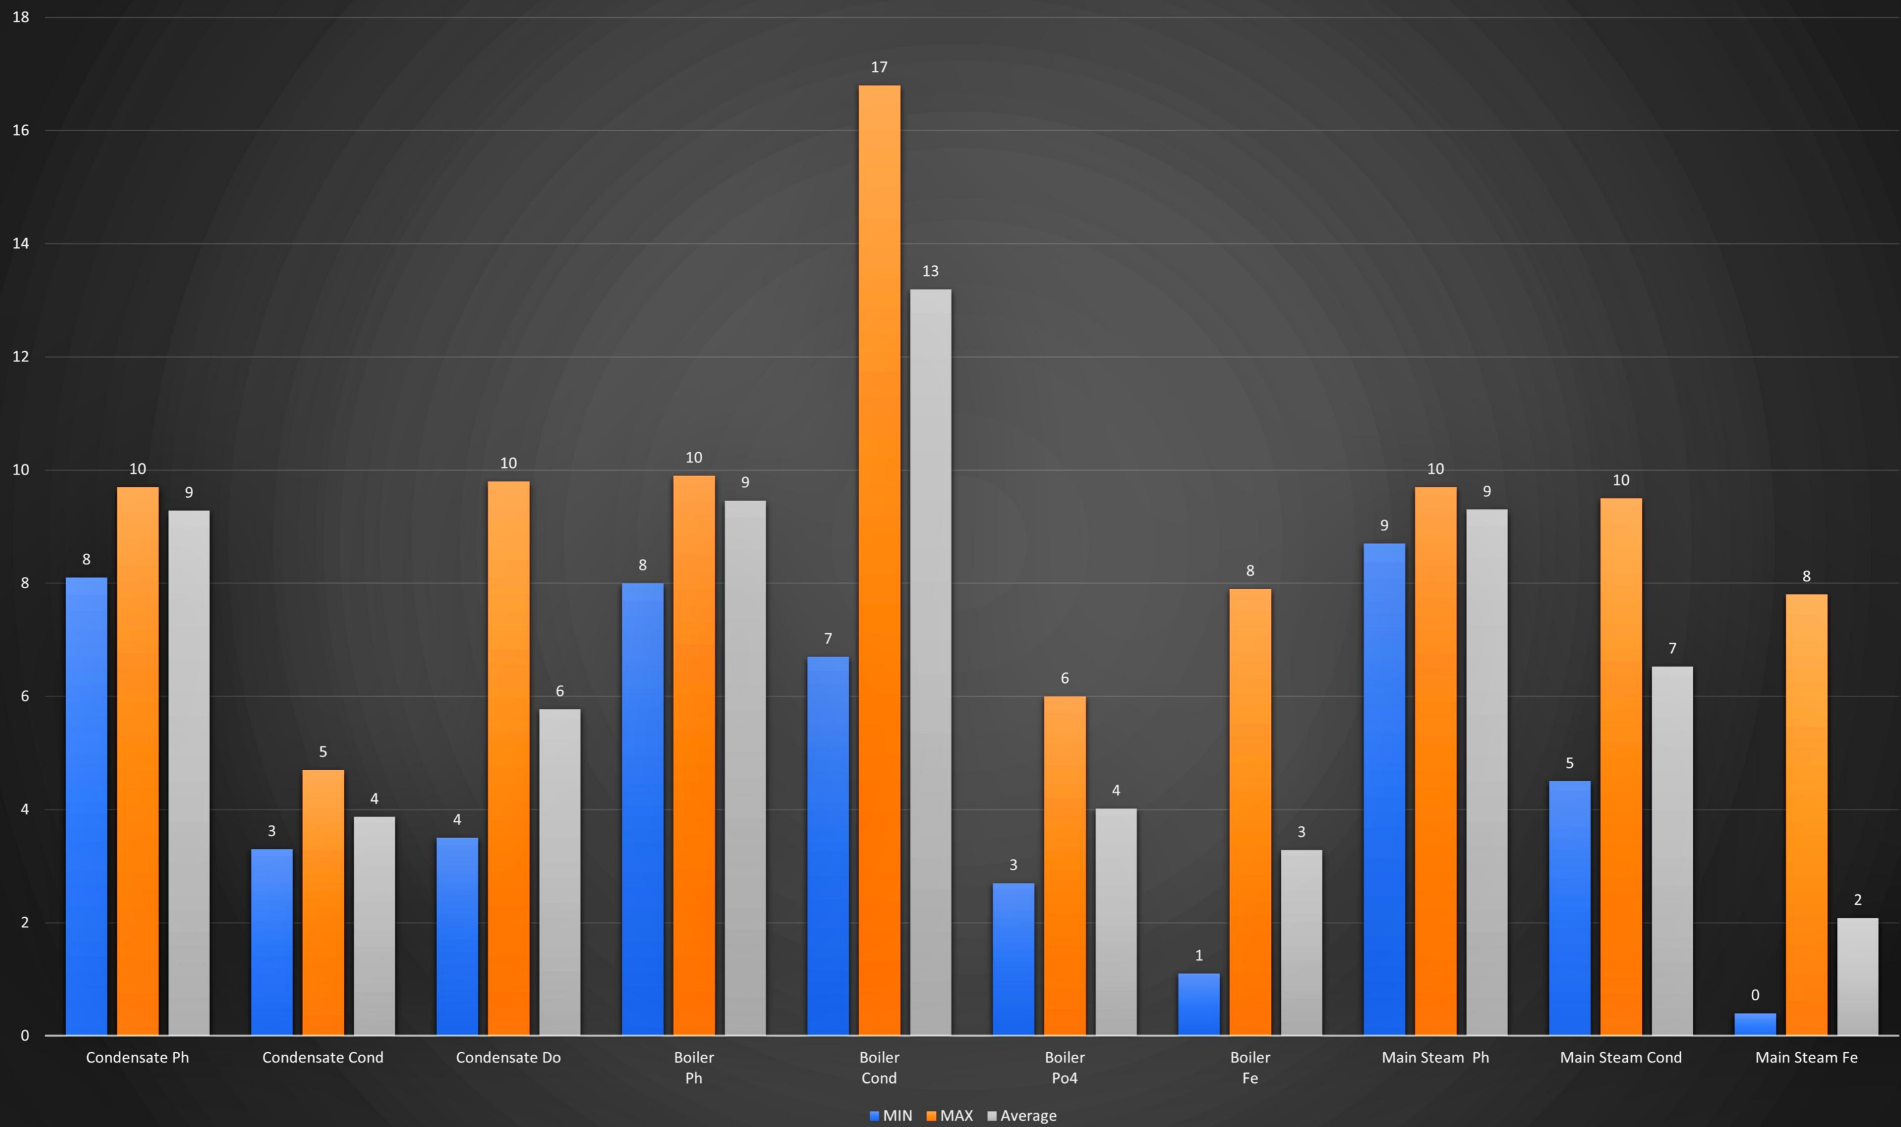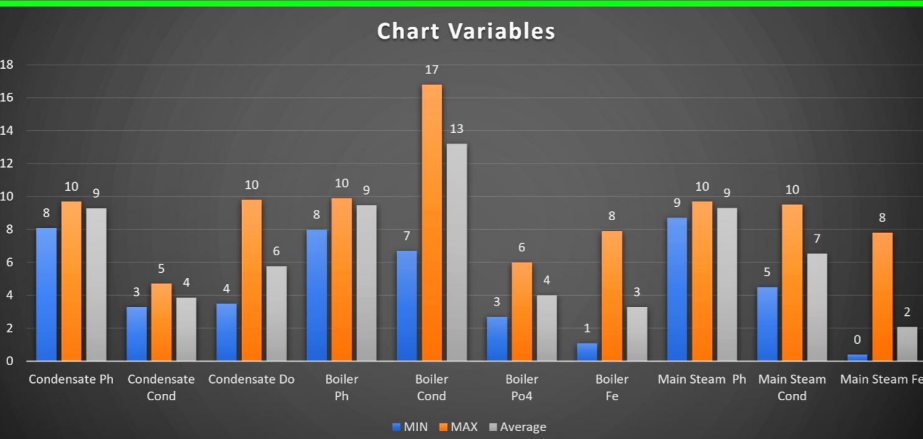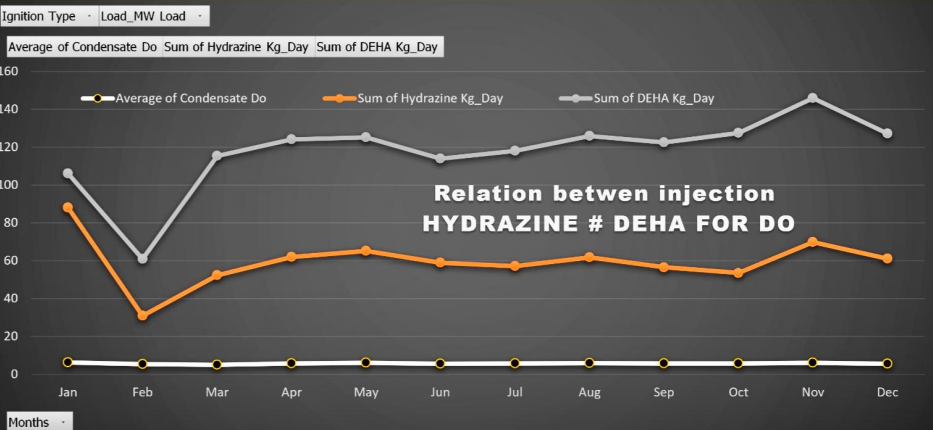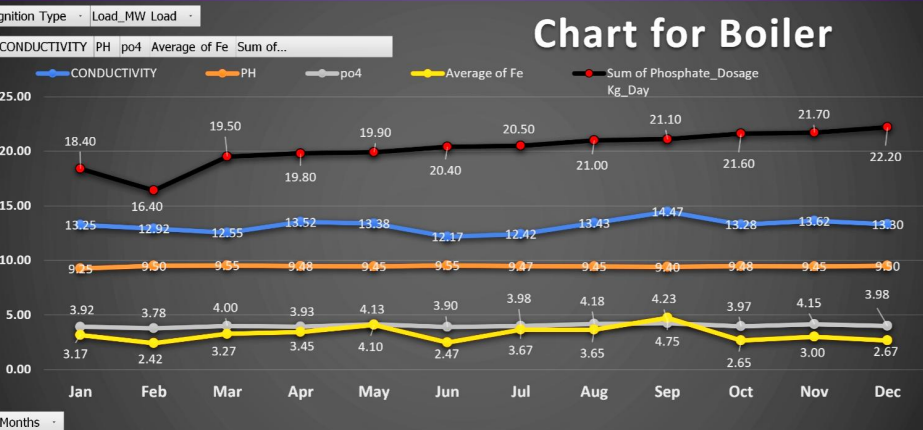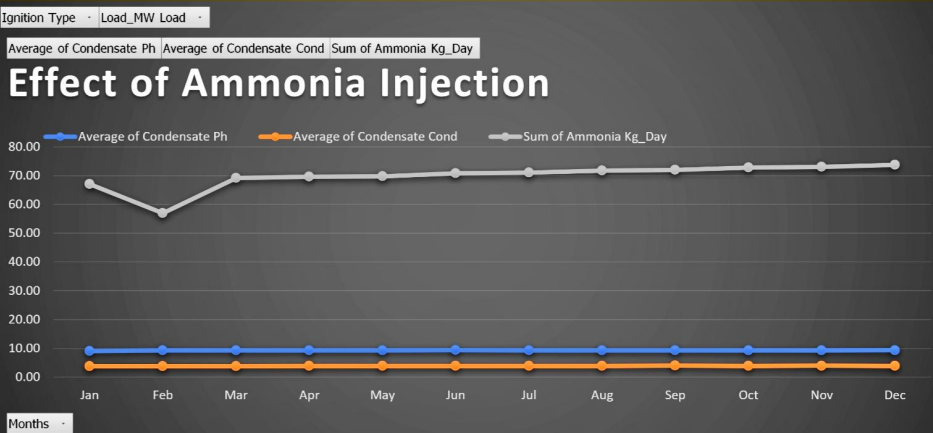


Data Analysis for Chemical Water Treatment for High-Pressure Boilers in Power Plants

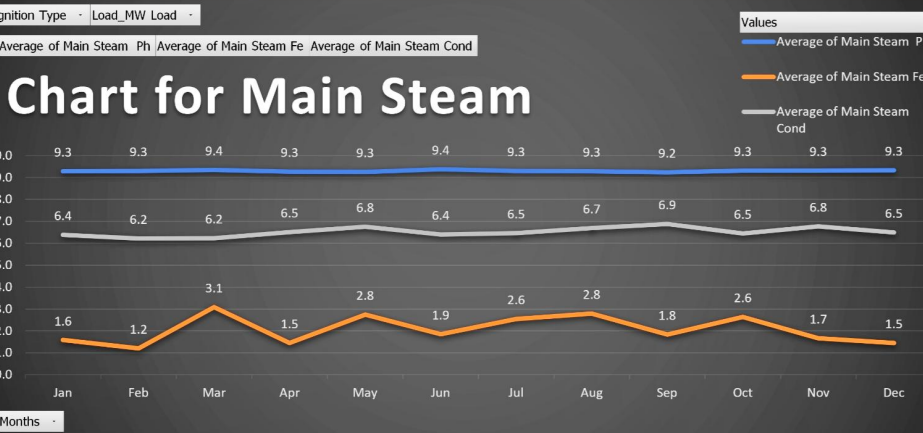


Variables

Ammonia_Dosage_Kg	Boiler Cond	Boiler Fe
Boiler Ph	Boiler Po4	Condensate Cond
Condensate Do	Condensate Ph	DEHA Dosage Kg_Day
Hydrazine_Dosage_Kg	Main Steam Ph	Main Steam Cond
Main Steam Fe	Phosphate_Dosage_Kg	Unit Load MW

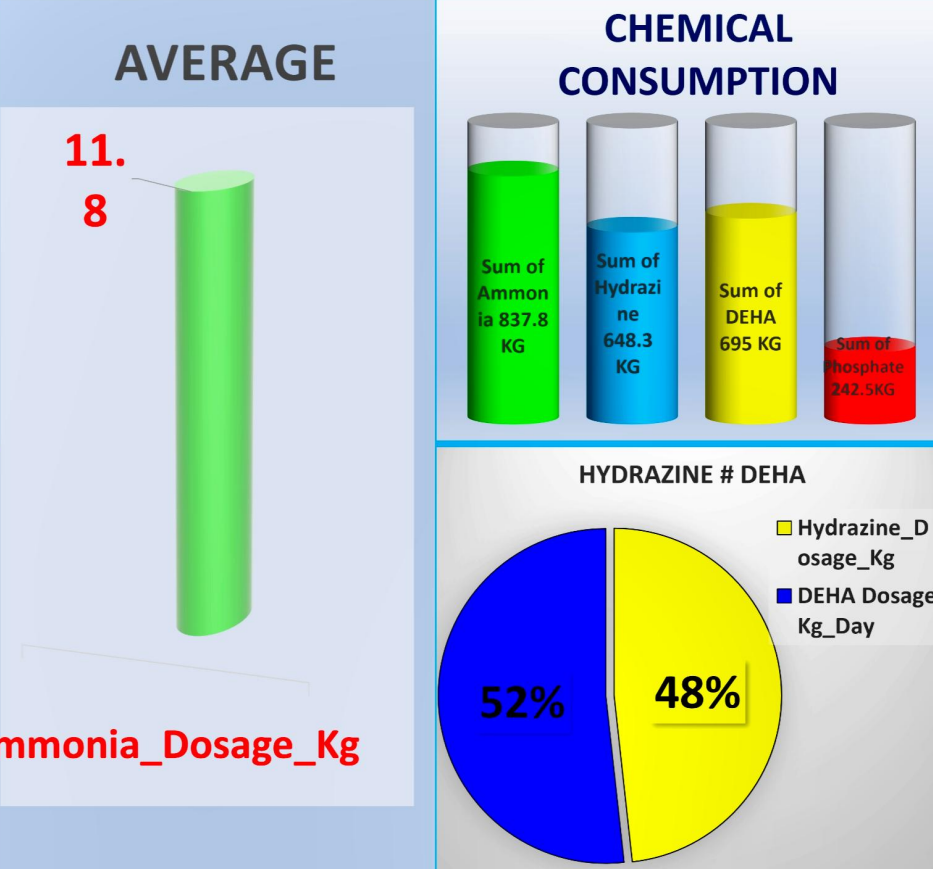

Injection quantity

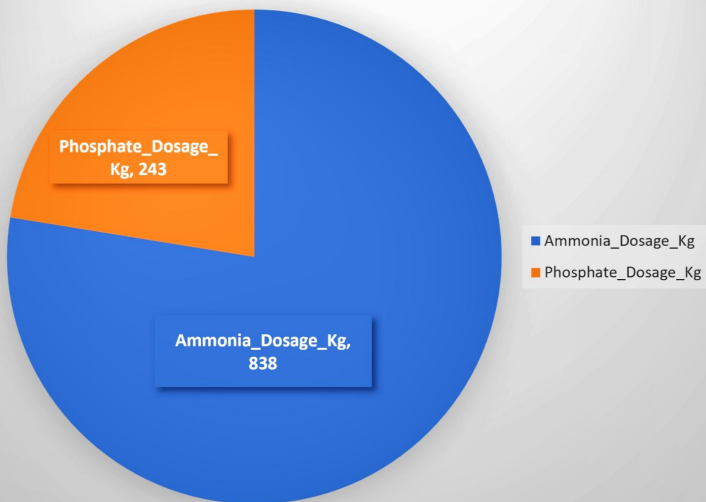

Hydrazine & DEHA


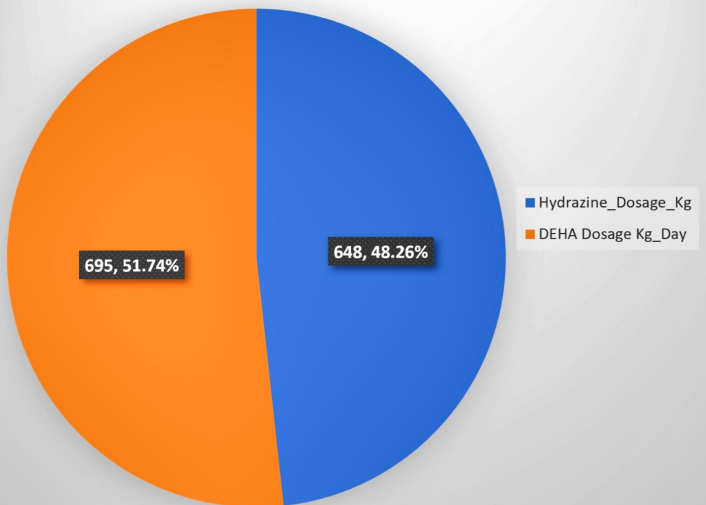


Chart Average for Variables at Average Unit Load 500 MW



CHEMICAL CONSUMPTION

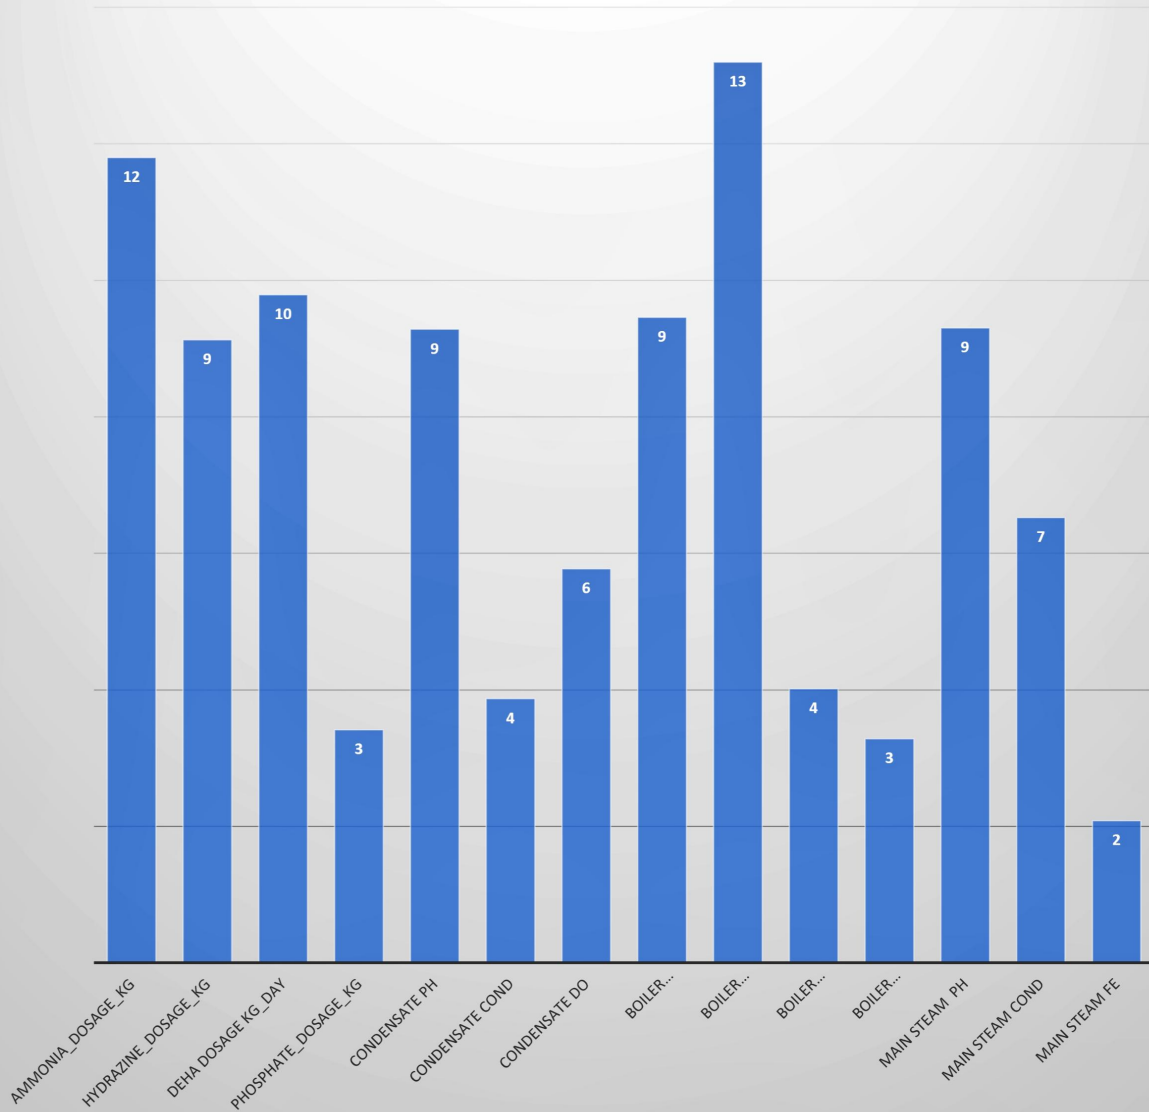