harpoon

FINDINGS REPORT · OT RISK & VISIBILITY INSIGHT

Knowing what you run: an OT risk baseline

Asset discovery, vulnerability assessment and a prioritised remediation roadmap.

PREPARED FOR	ENGAGEMENT	DATE	CLASSIFICATION
Sample Client Ltd	HC-2026-014	October 2026	Confidential

01

Executive summary

Sample Client's OT estate is larger and more connected than its records show. Most risk sits in a small number of flat network segments, which makes it tractable.

Over five weeks we discovered and classified every asset across three production sites, assessed each against known vulnerabilities, and scored the findings by likelihood and operational impact. This report sets out what we found, what it means for the business, and the order in which we recommend acting.

Forty-seven findings were recorded. Eleven are rated major or severe; nine of those trace back to the same root cause: engineering workstations with direct routes into the control network. Segmenting those routes addresses most of the high-impact risk in a single, well-understood piece of work.

1,486

OT assets discovered, against 1,274 in the client's register.

11

Findings rated major or severe impact.

9 of 11

High-impact findings sharing one root cause.

> *"Most of the risk is in a handful of routes. That's good news."*
>
> Lead assessor

Recommendations

01 **Segment engineering access** to the control network within 90 days.

02 **Establish an asset owner** for each of the 212 undocumented devices.

03 **Adopt IEC 62443-3-2 zoning** as the target architecture for all sites.

04 **Re-baseline in twelve months** to measure progress against this report.

Sample content for template demonstration. All client data is illustrative.

03.2

Most findings cluster at moderate impact, possible to likely

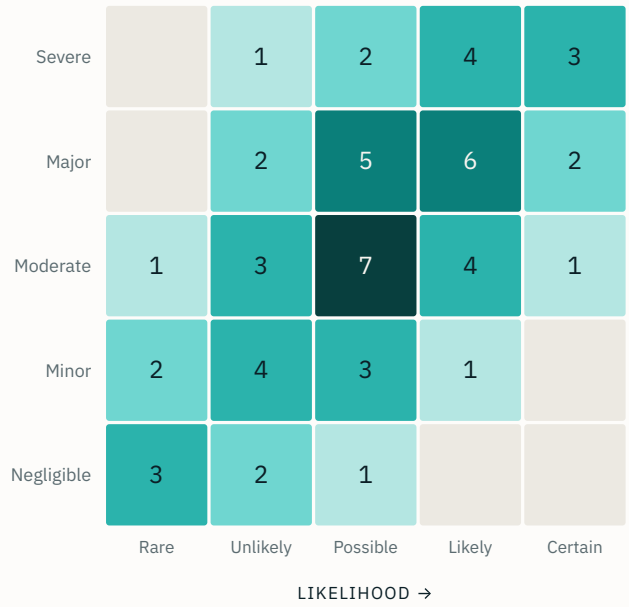


Figure 3. Findings by likelihood and impact, n = 47.

The distribution is typical of an estate that has grown by project rather than by design: few catastrophic exposures, many moderate ones, and a long tail of low-likelihood issues that can be accepted or scheduled.

The eleven findings in the top-right quadrant are listed in Appendix B with owners and target dates.

03.3

System integrity and restricted data flow show the widest gap

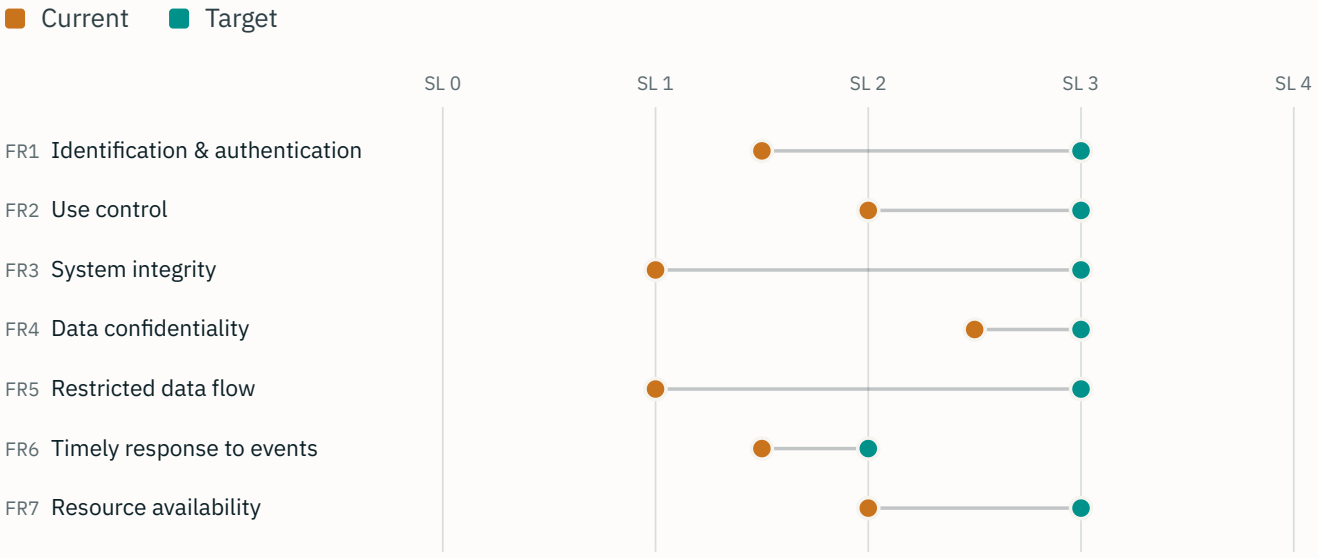


Figure 4. Security level by IEC 62443 foundational requirement, current versus target. Source: Harpoon assessment, 2026.