




COMPUTER NETWORKS

LAB 12


IOT SETTING

IFZA RIZWAN
SAP 64281


Building basic infrastructure:

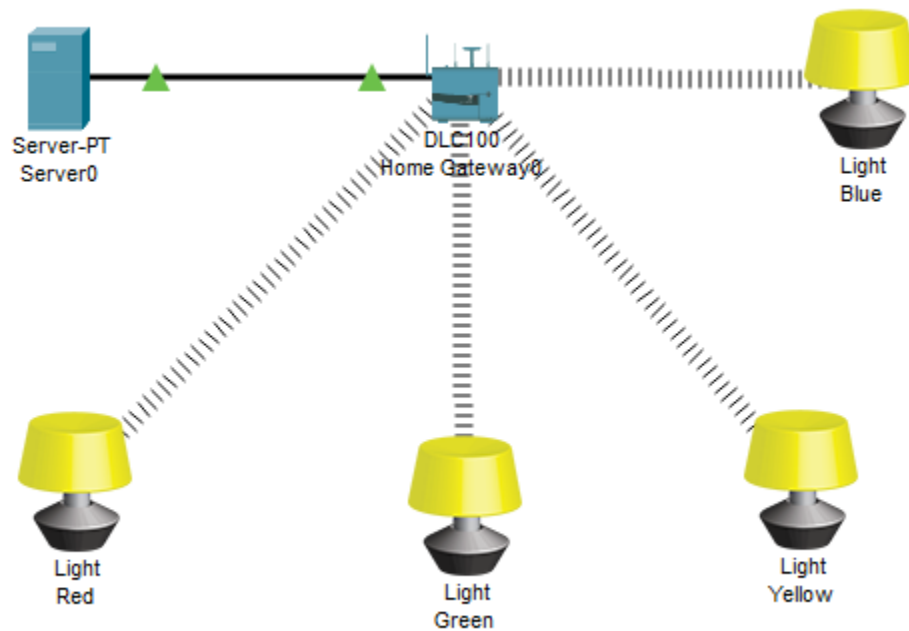


Configuration of Server and Network:

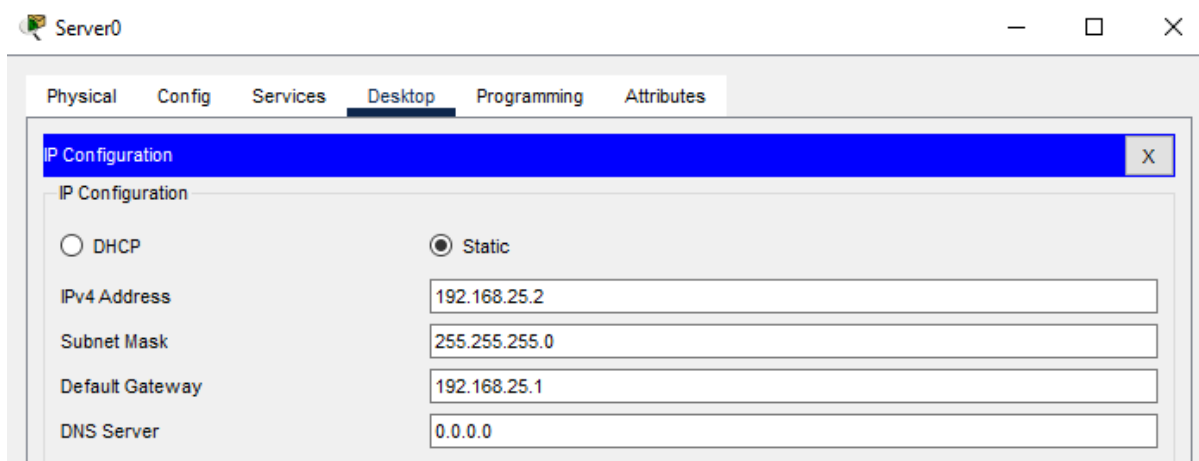

Ensuring the IoT Server is enabled

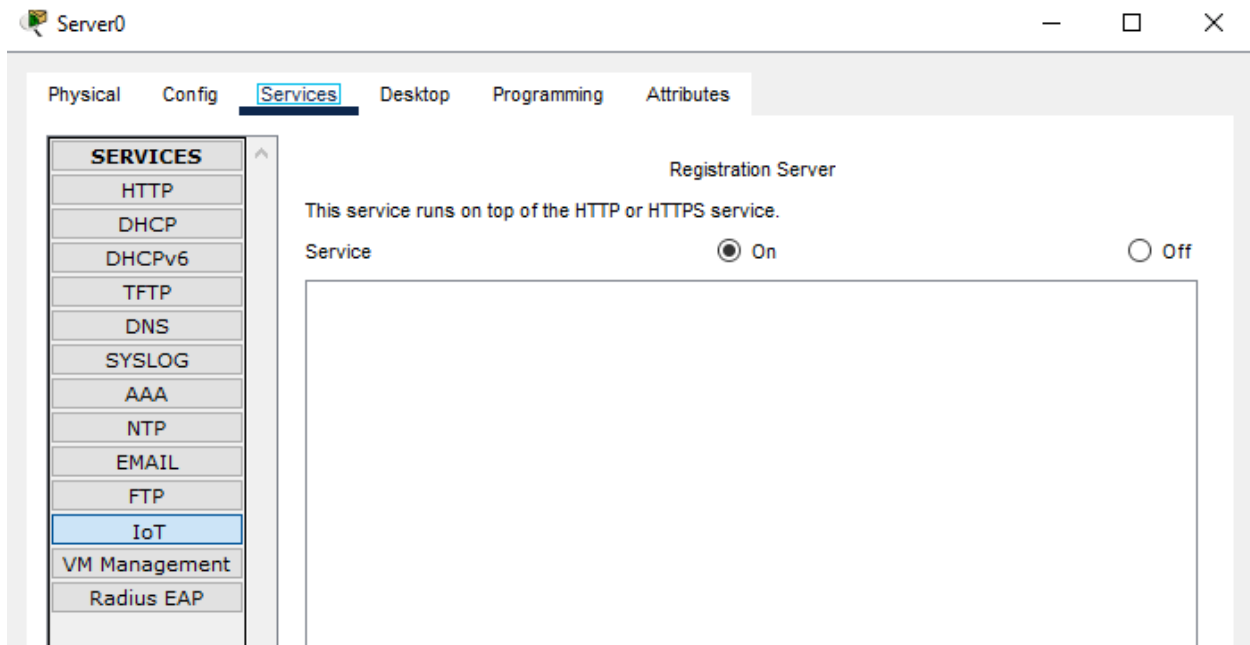


We set password and login:

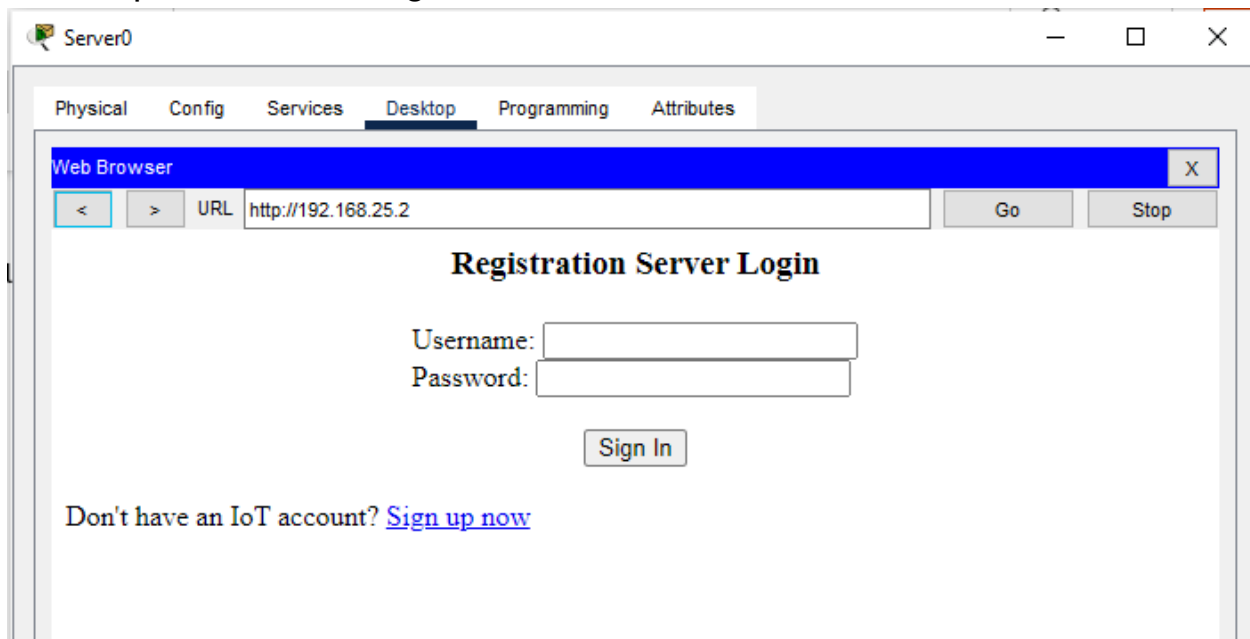

Username: abc

password: 123

Set the lights IoT Server to remote server and set the username and password same as we set above. Do this for the rest of the devices too

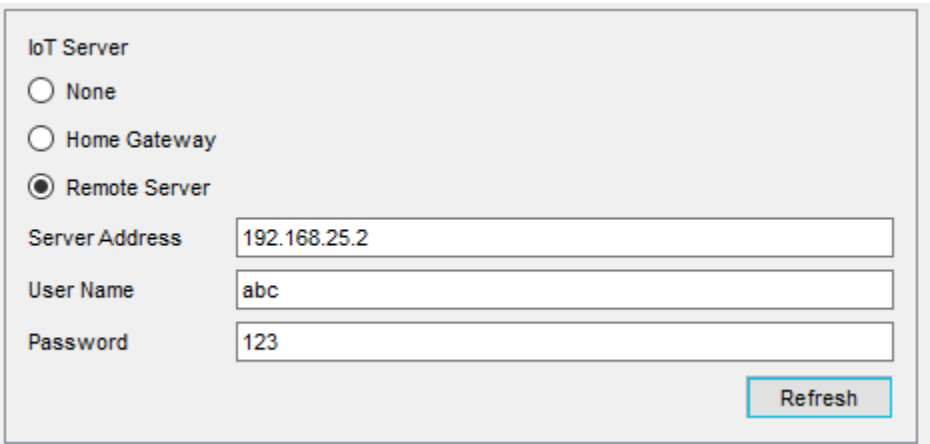

IoT Server

☐ None


☐ Home Gateway

☒ Remote Server



Server Address

User Name

Password

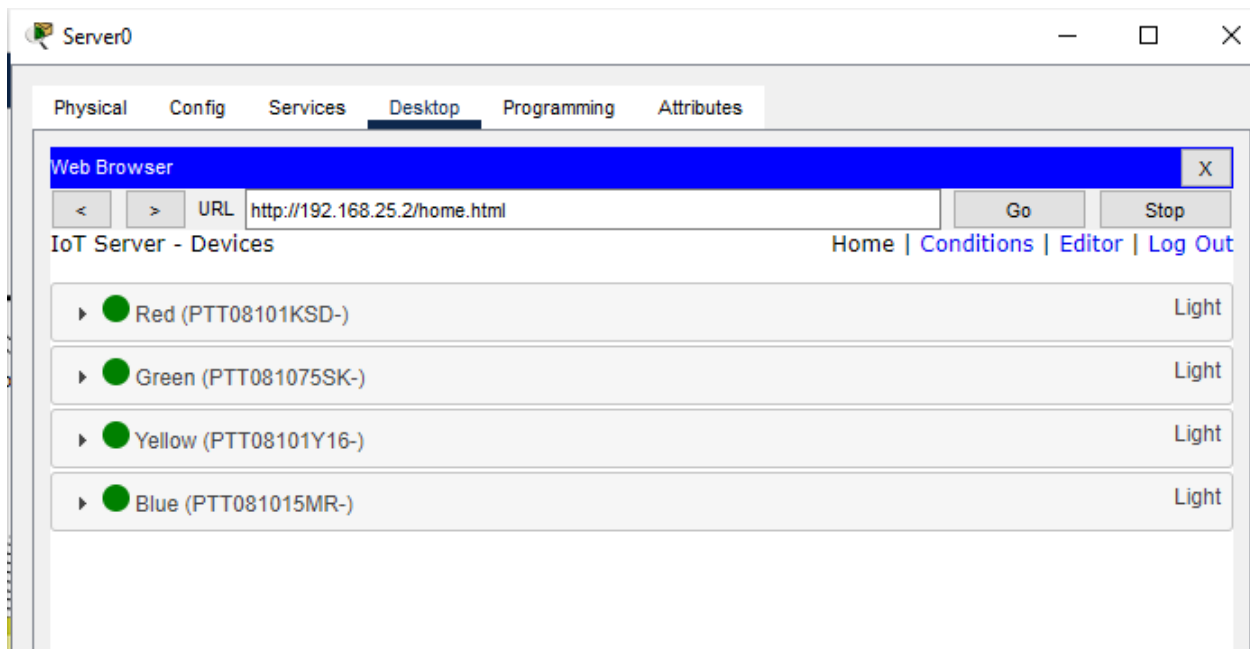


When red light is dimmed from here:

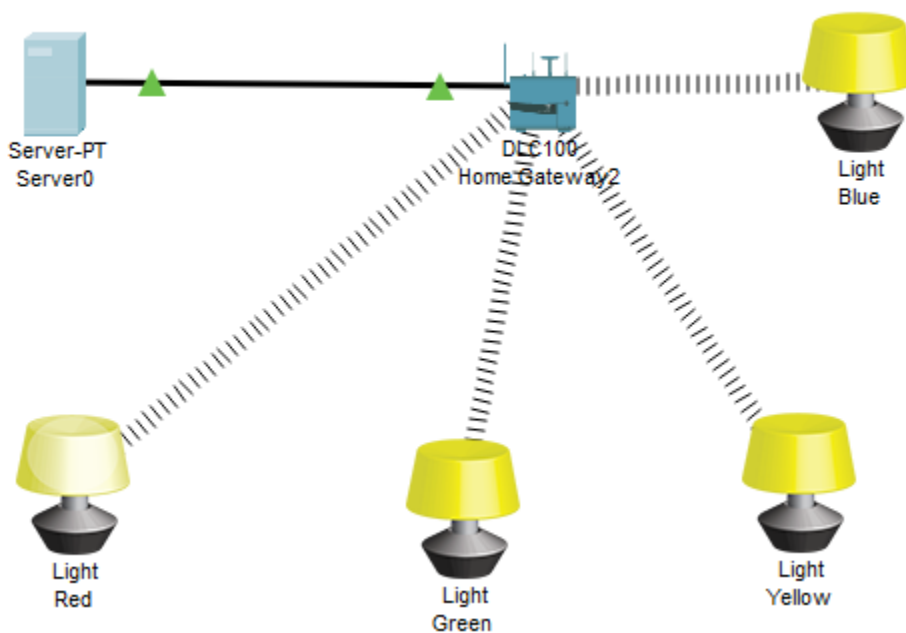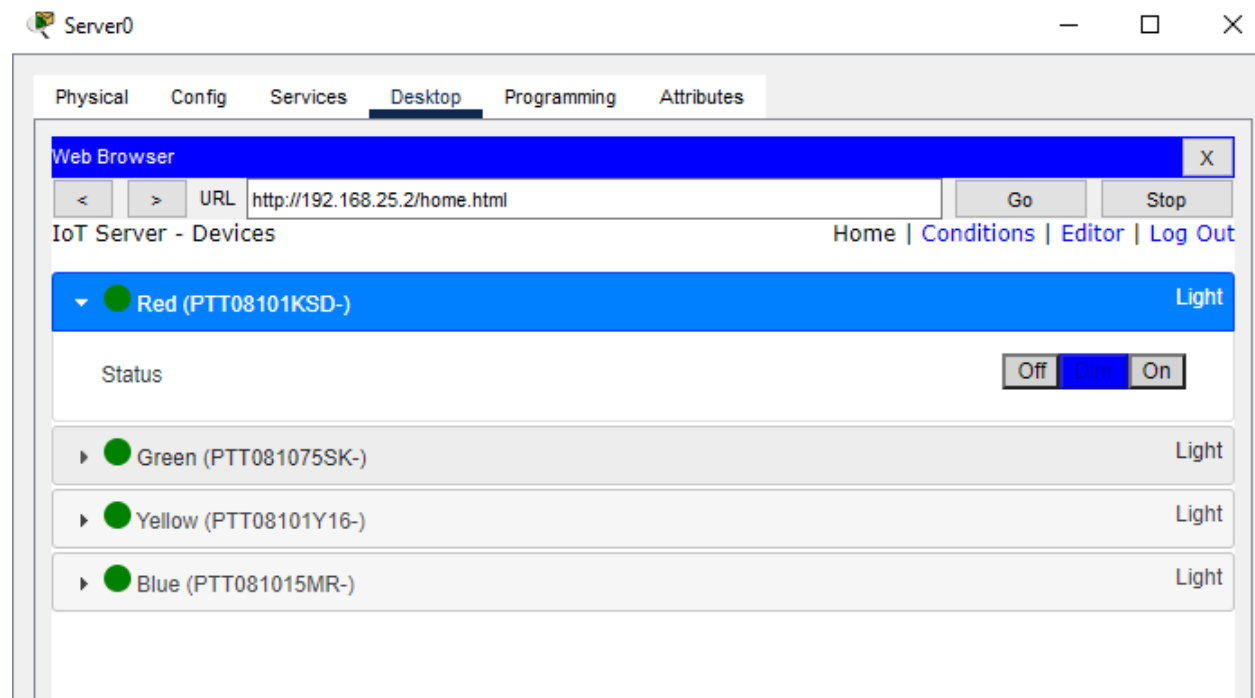


we can see red is dimmed


When we turn on green light:

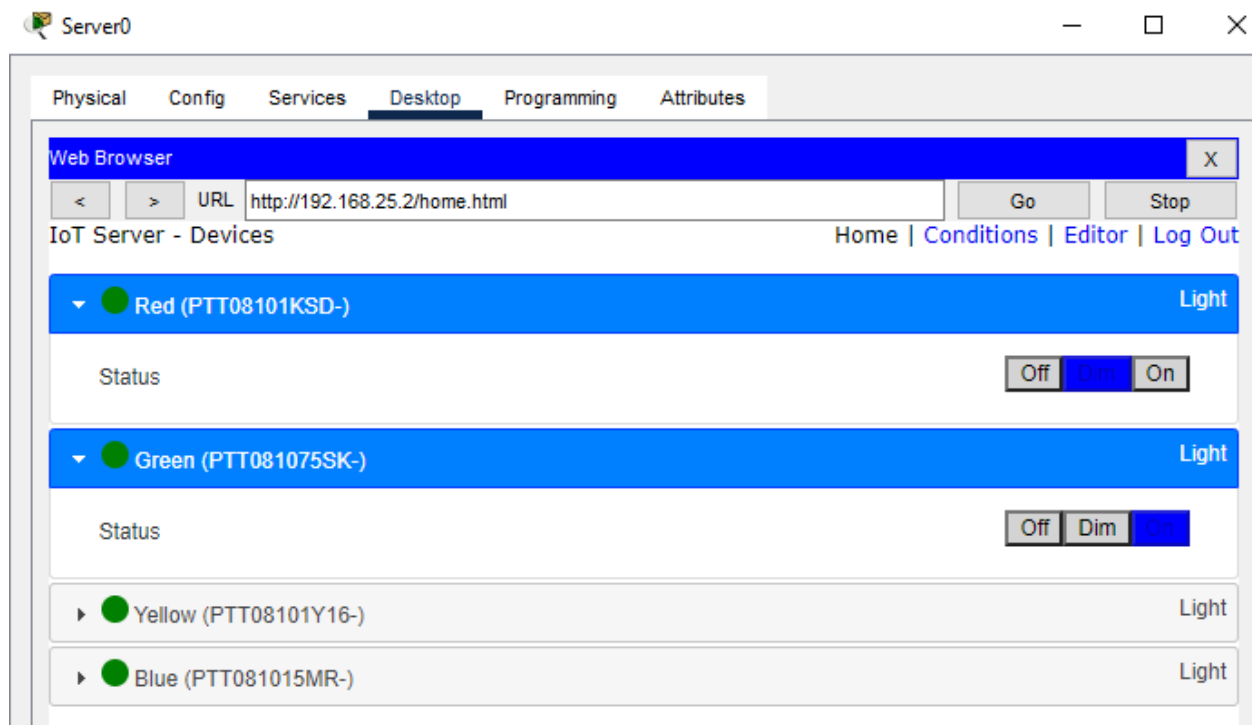


We can see that the green light is turned on

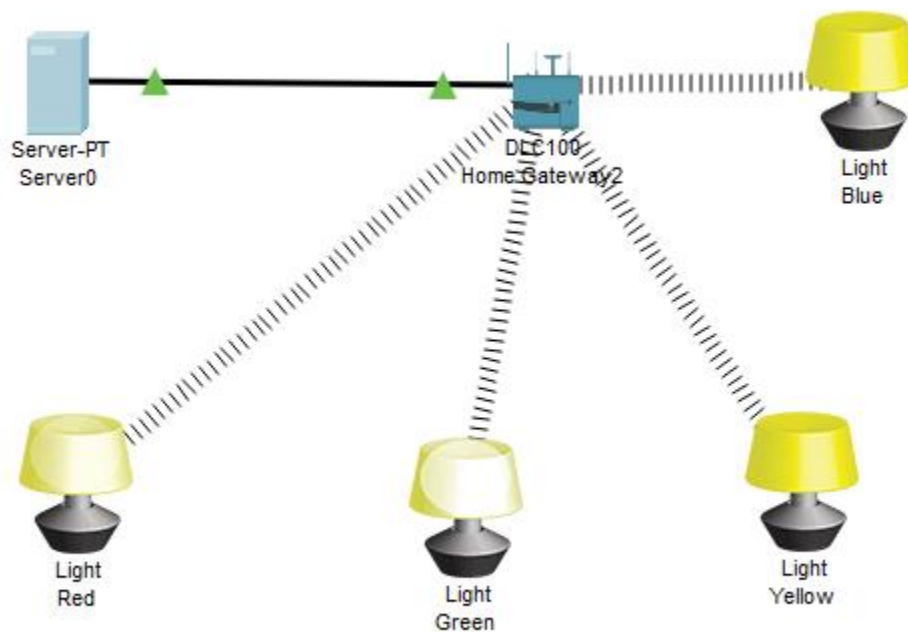


Now we're going to move forward and set the conditions:

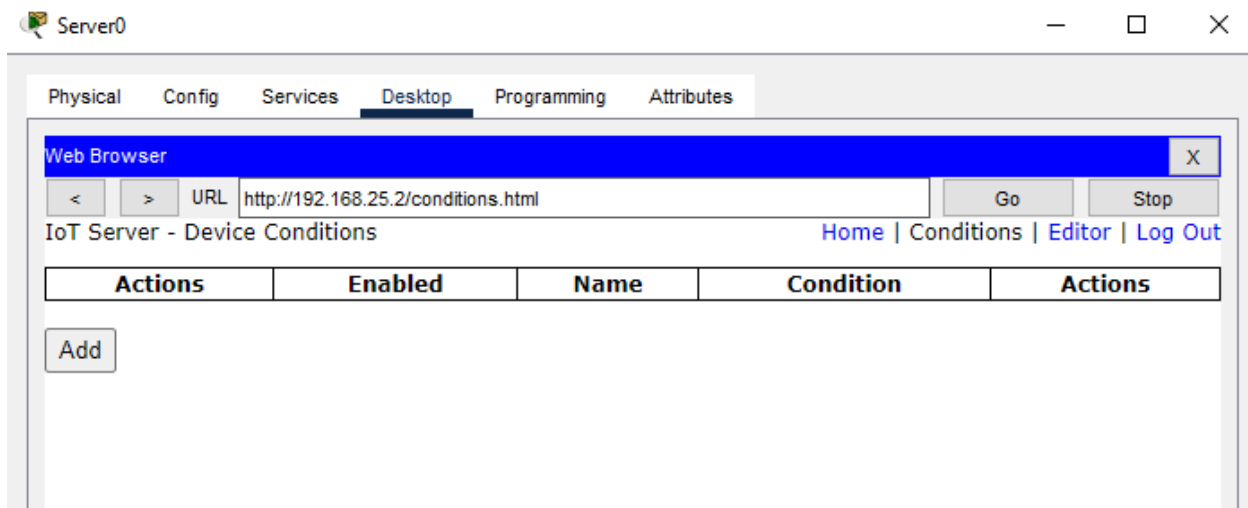


To create a firework, when one is on the rest are off so we'll set the rules:

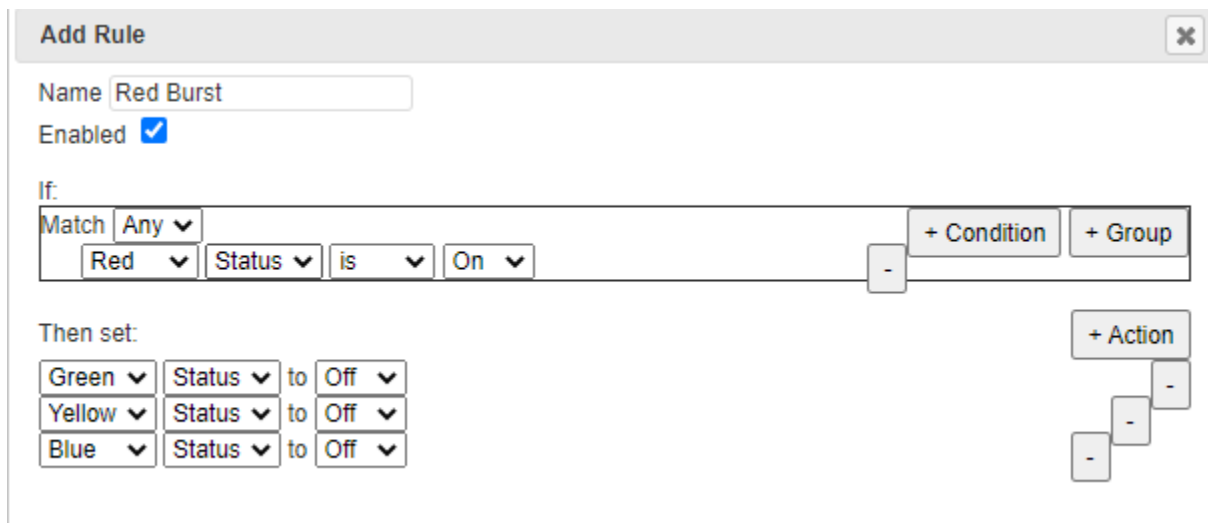

Now we can see that its been saved:

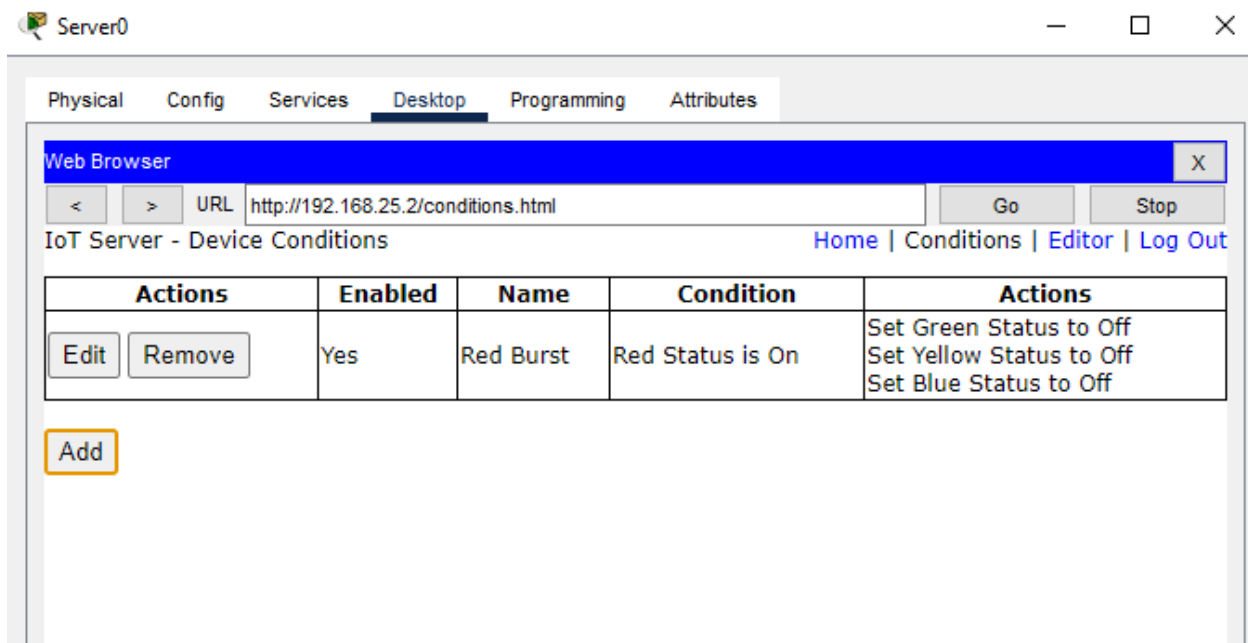

We'll do the same for the rest too:

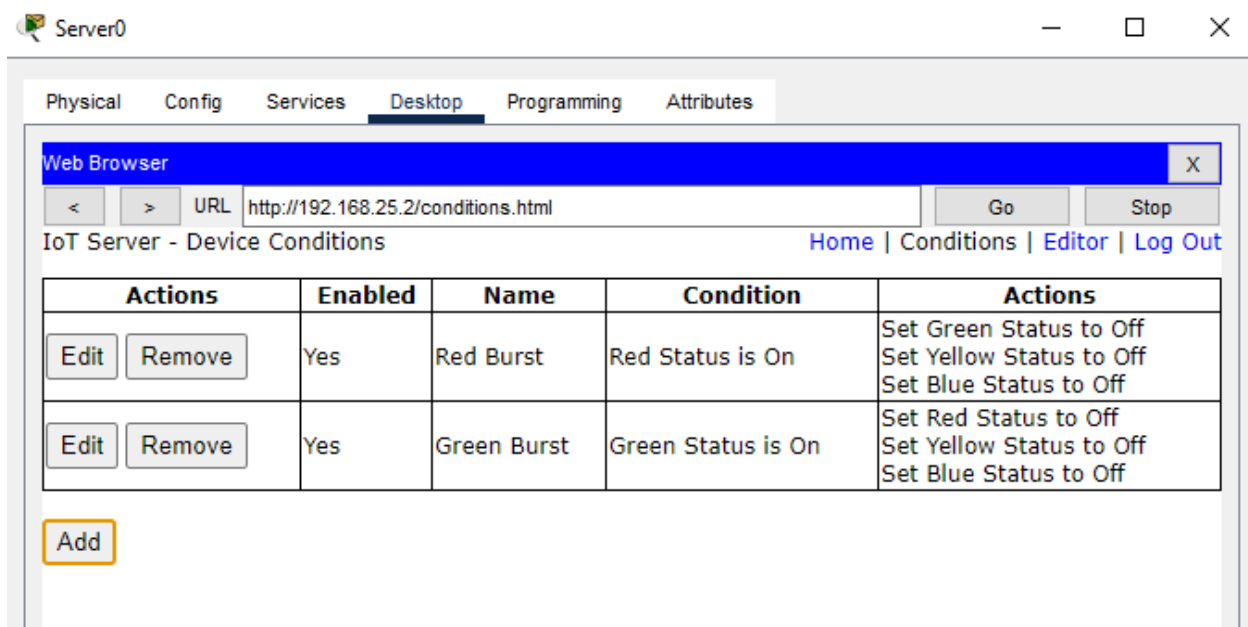

Server0

Physical Config Services **Desktop** Programming Attributes

Web Browser X

< > URL Go Stop

IoT Server - Device Conditions [Home](#) | [Conditions](#) | [Editor](#) | [Log Out](#)

Actions	Enabled	Name	Condition	Actions
Edit Remove	Yes	Red Burst	Red Status is On	Set Green Status to Off Set Yellow Status to Off Set Blue Status to Off
Edit Remove	Yes	Green Burst	Green Status is On	Set Red Status to Off Set Yellow Status to Off Set Blue Status to Off
Edit Remove	Yes	Yellow Burst	Yellow Status is On	Set Red Status to Off Set Green Status to Off Set Blue Status to Off

Finally we can see that all the conditions and triggers have been set in the device conditions of the IoT devices:

Server0

Physical Config Services **Desktop** Programming Attributes

Web Browser X


< > URL Go Stop

IoT Server - Device Conditions [Home](#) | [Conditions](#) | [Editor](#) | [Log Out](#)



Actions	Enabled	Name	Condition	Actions
Edit Remove	Yes	Red Burst	Red Status is On	Set Green Status to Off Set Yellow Status to Off Set Blue Status to Off
Edit Remove	Yes	Green Burst	Green Status is On	Set Red Status to Off Set Yellow Status to Off Set Blue Status to Off
Edit Remove	Yes	Yellow Burst	Yellow Status is On	Set Red Status to Off Set Green Status to Off Set Blue Status to Off
Edit Remove	Yes	Blue Burst	Blue Status is On	Set Red Status to Off Set Green Status to Off Set Yellow Status to Off


They are all enabled too, now we can test it out on the workplace we've created on cisco

when red is on, the rest turn off:

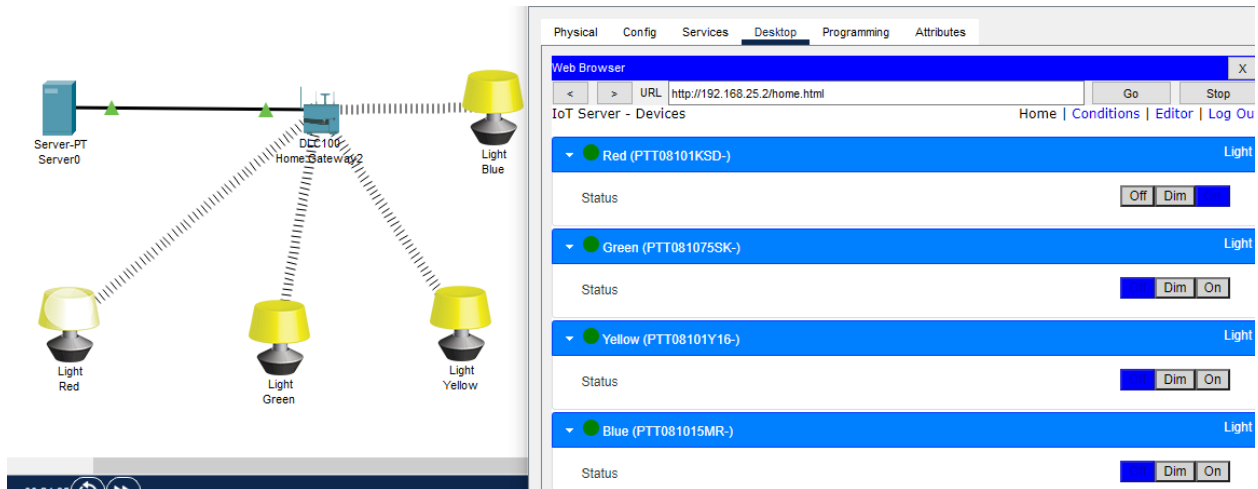

Now its running in sequence:

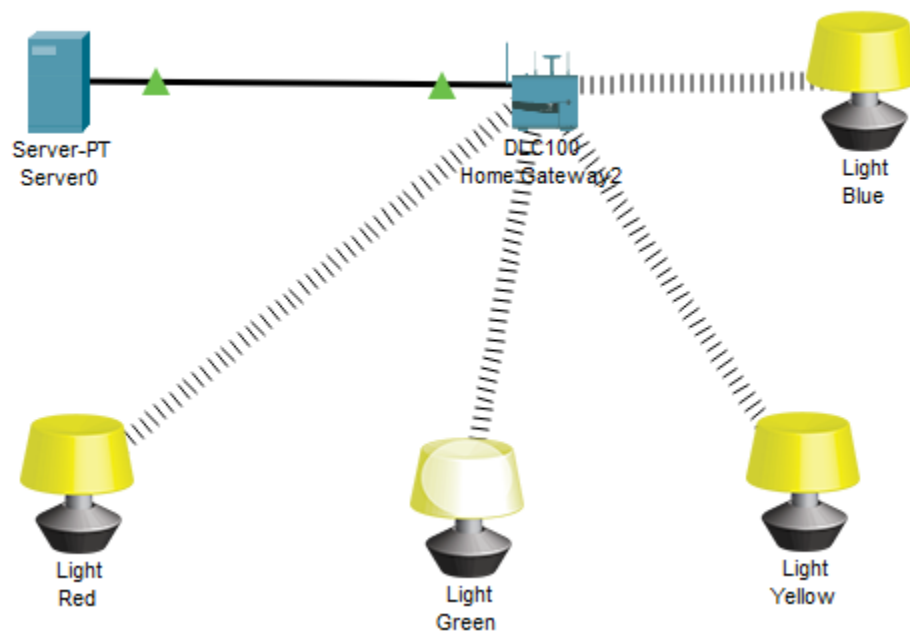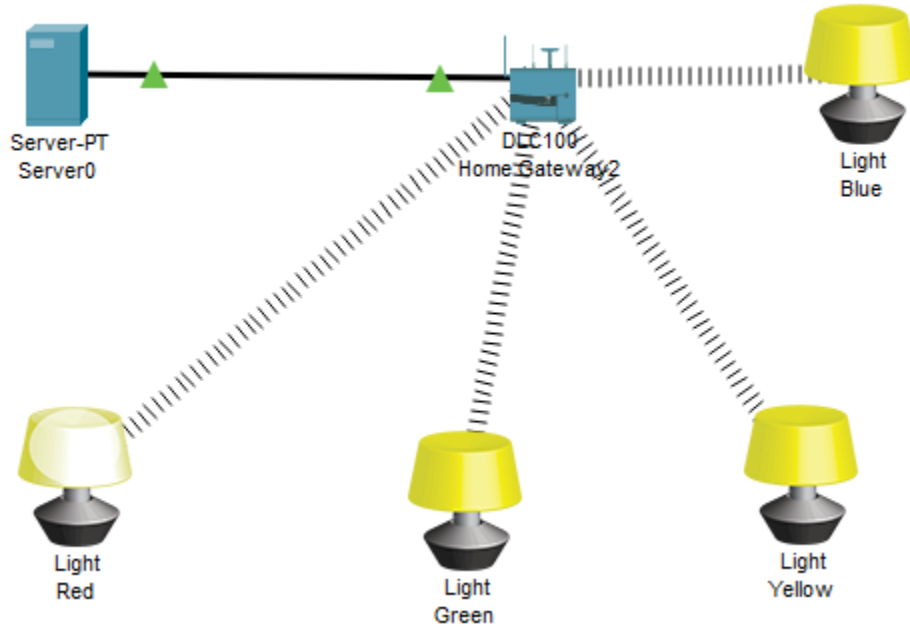

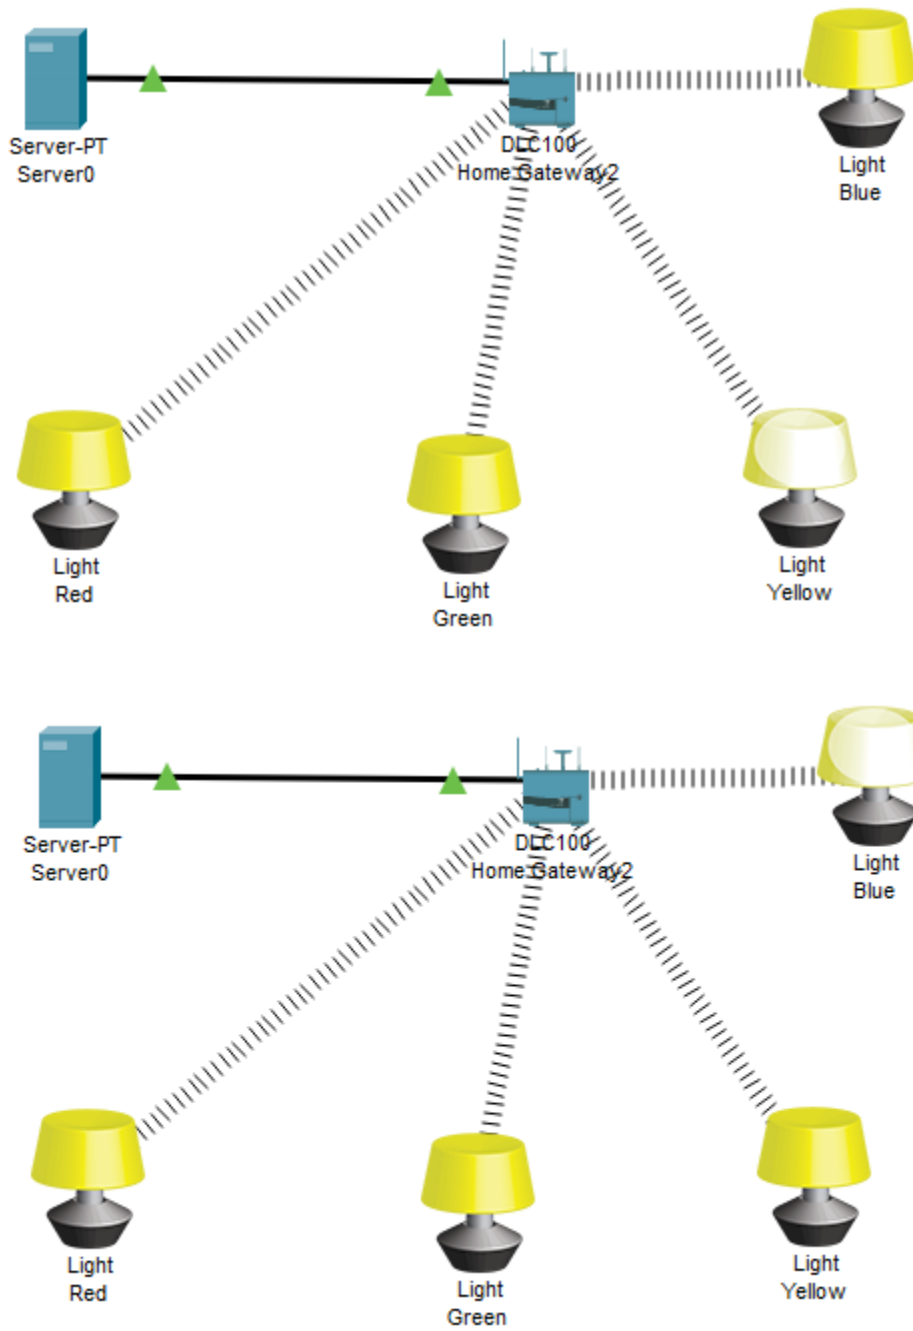

THE END