

UUT Report

Station ID:

Serial Number:

Date:

Time:

Operator:

Execution Time:

Number of Results:

UUT Result:

Serial Number:

Type Designator:

FW Version:

Power Supply:

IT-W-7303101

NONE

giovedì 15 giugno 2023

10:19:48

administrator

489.573806 seconds

8426

Passed

4294967295

B3-D4MB-111A


0.16.1


Zera

Begin Sequence: MainSequence

(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\EQ Meter\New Sequences\Realtime_sampling.seq)

DUT info	
Status:	Done
Serial Number:	4294967295
Type Designator:	B3-D4MB-111A
FW Version:	0.16.1

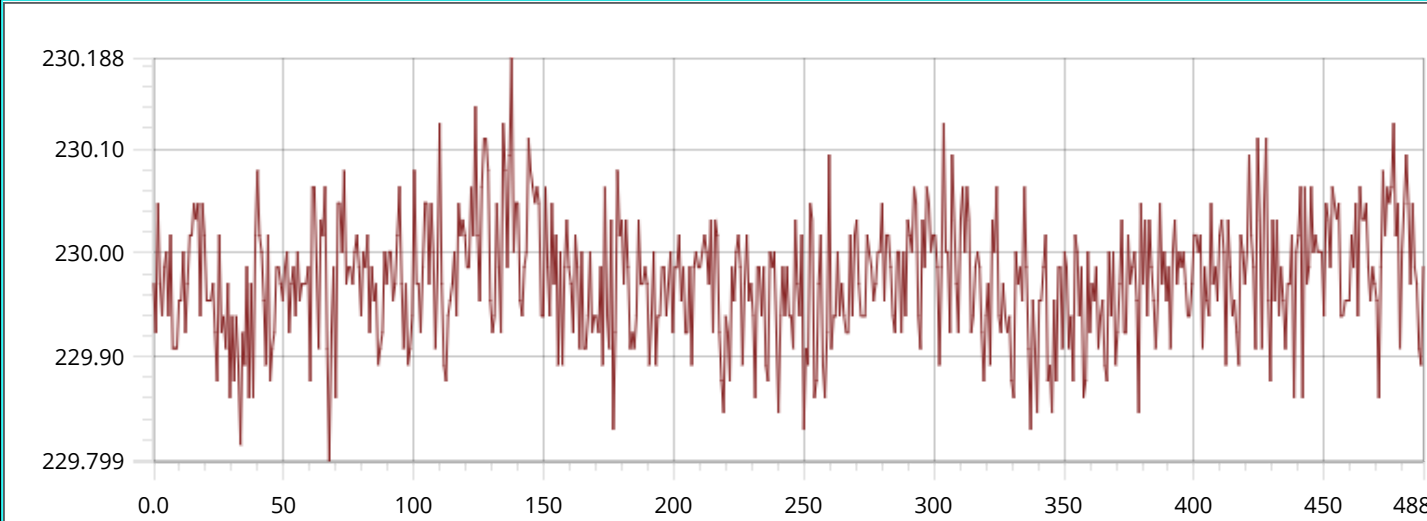
Test Point	
Status:	Done
Current:	0.01
Power Factor:	1
Frequency:	50
Voltage L1 - LOG	
Status:	Done
Accuracy[0..1] [0..599]:	
Voltage L2 - LOG	
Status:	Done
Accuracy[0..1] [0..599]:	

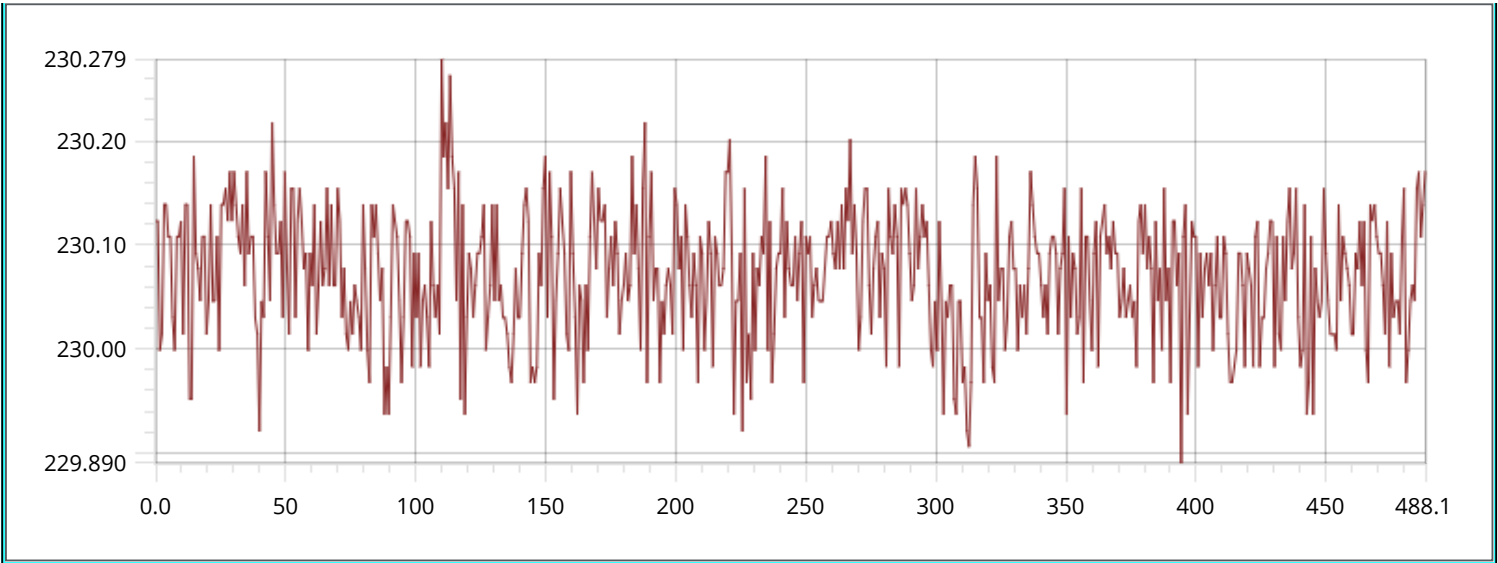

Voltage L3 - LOG

Status: Done


Accuracy[0..1]
[0..599]:

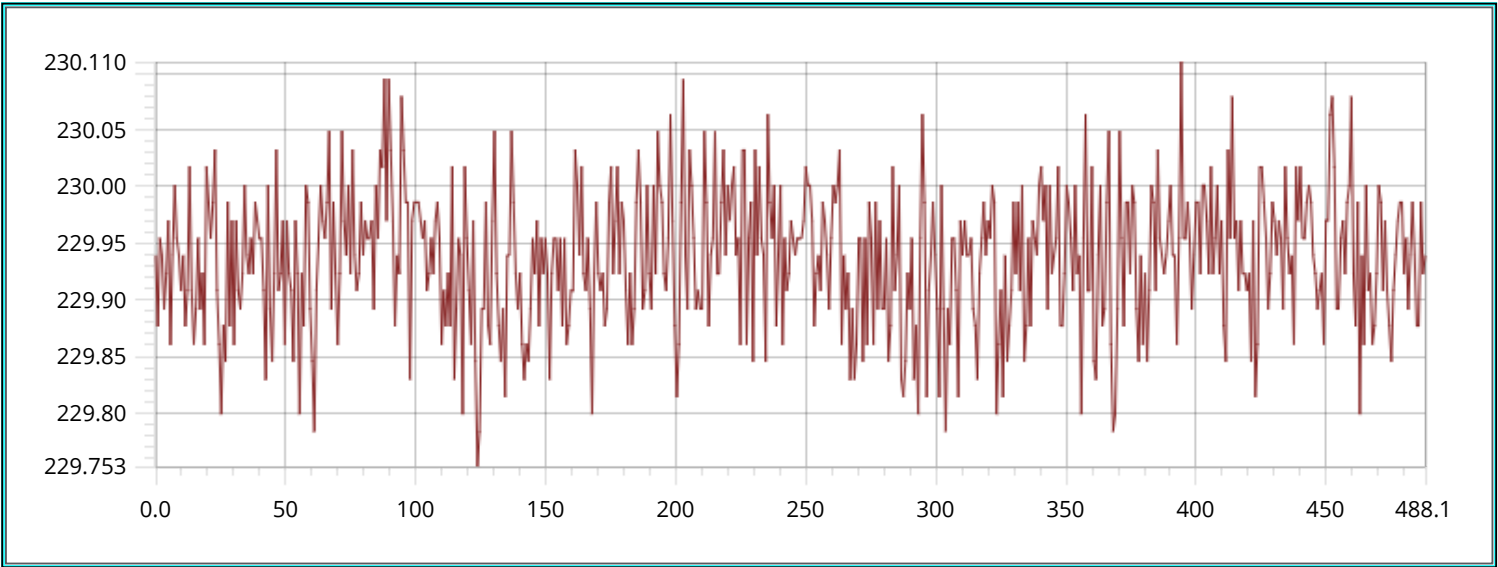

Current L1 - LOG

Status: Done


Accuracy[0..1]
[0..599]:

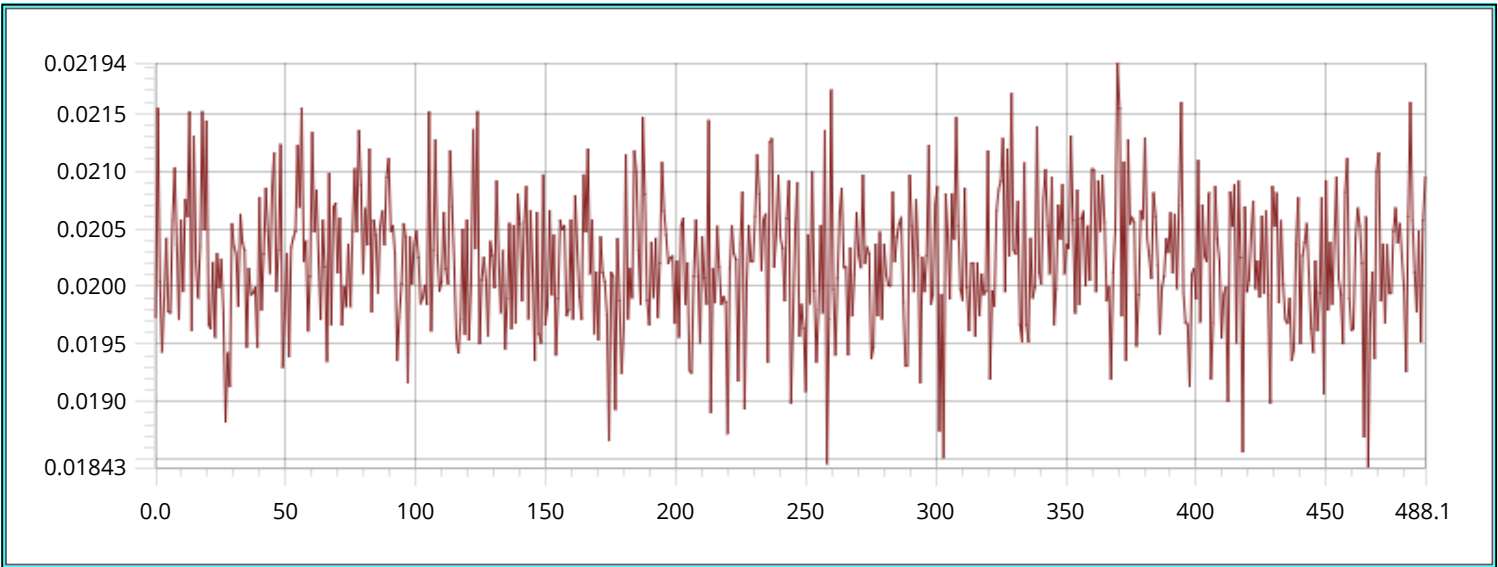


Current L2 - LOG


Status: Done

Accuracy[0..1]
[0..599]:




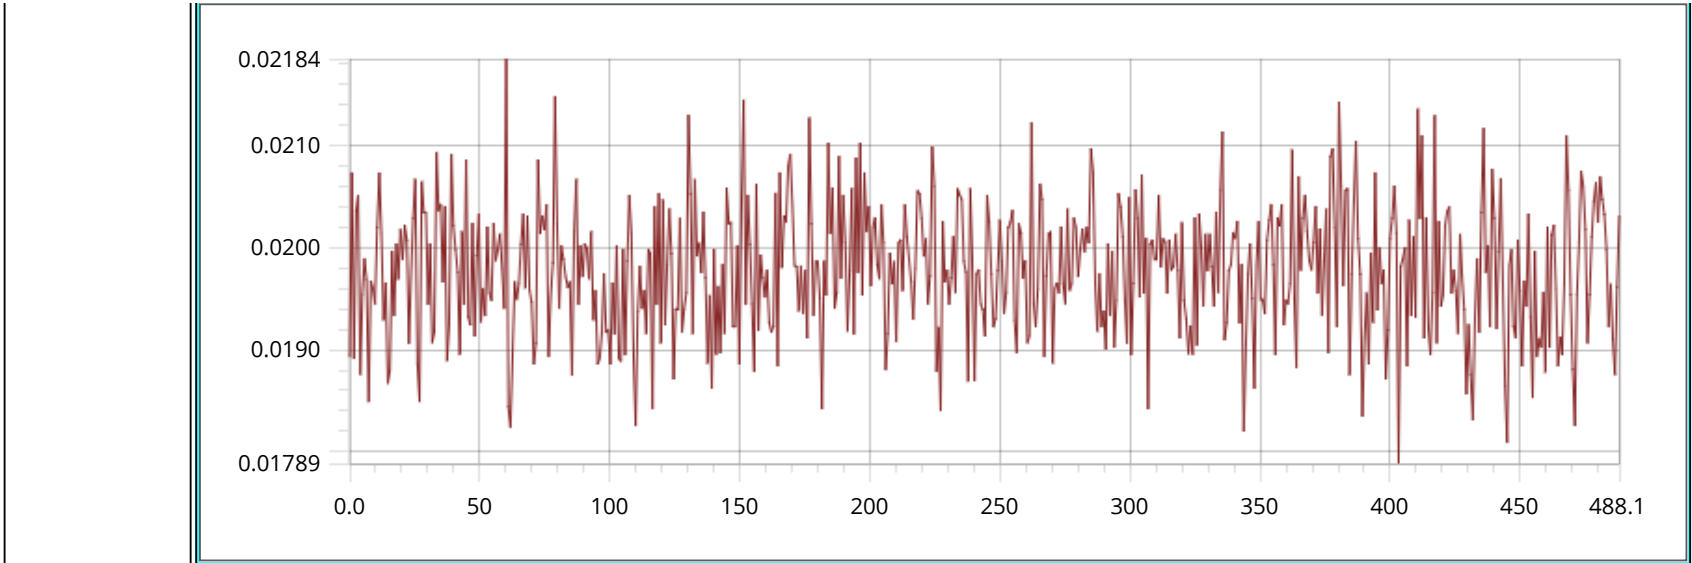

Current L3 - LOG

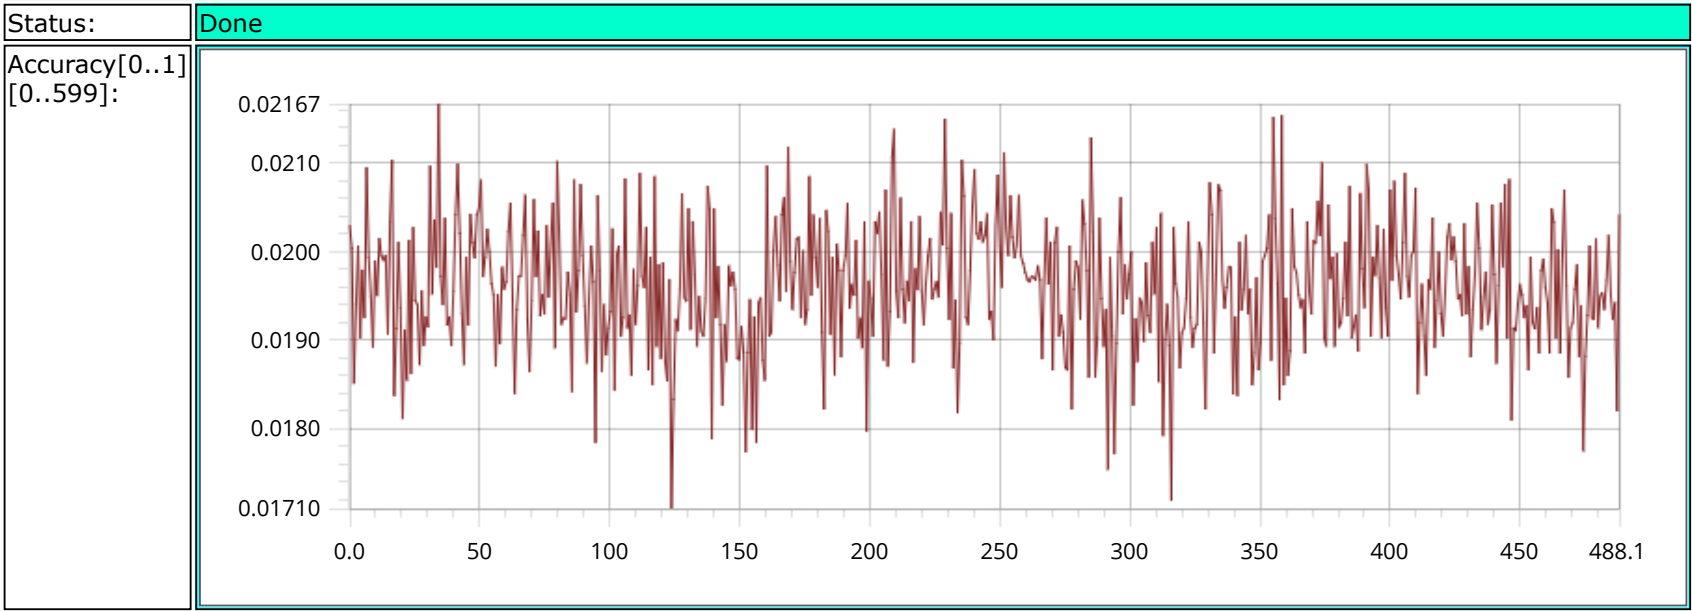


Active power - LOG

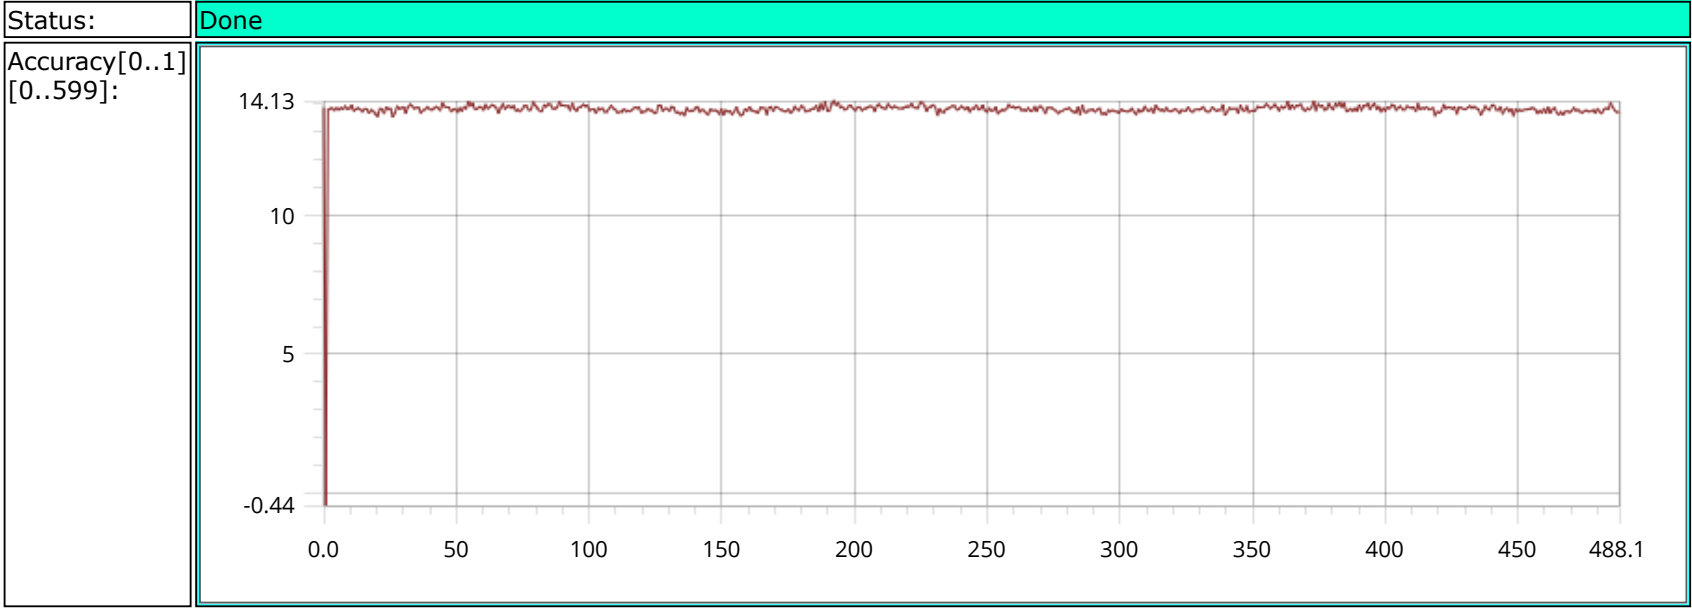


Apparent power - LOG



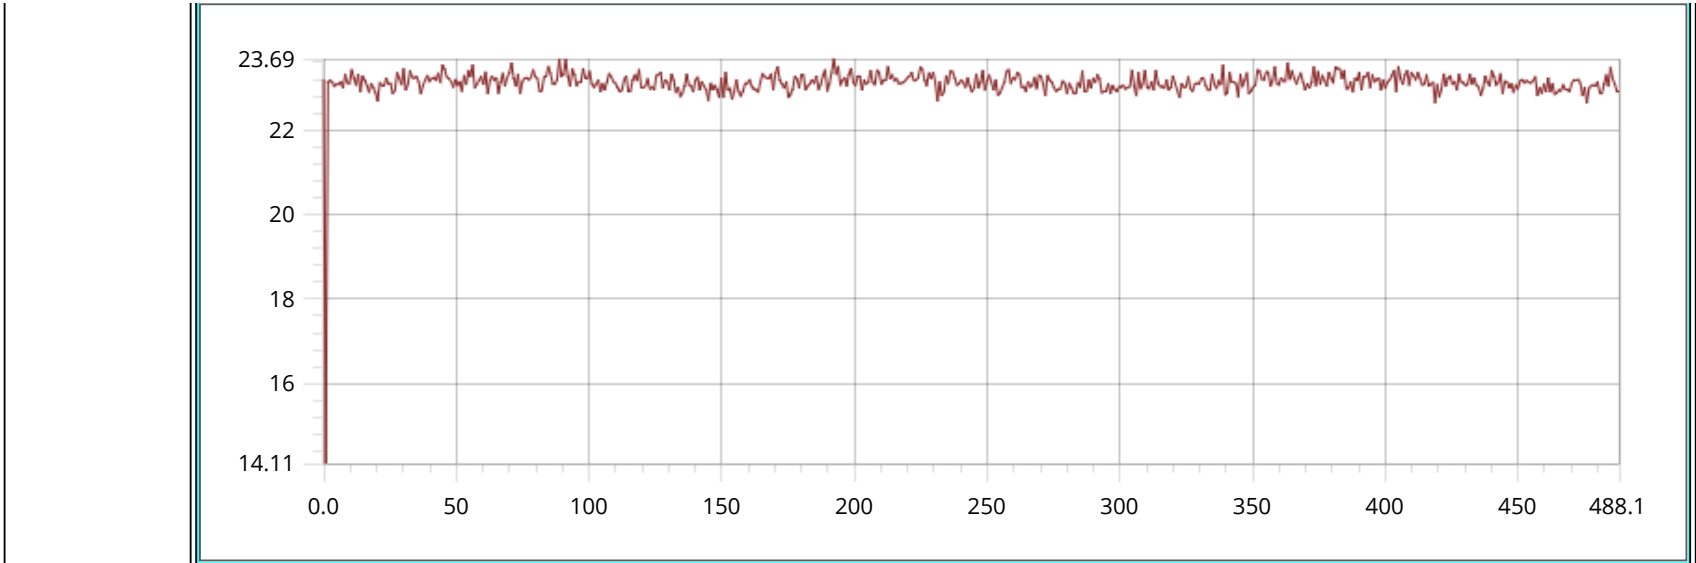

Frequency - LOG

Status: Done

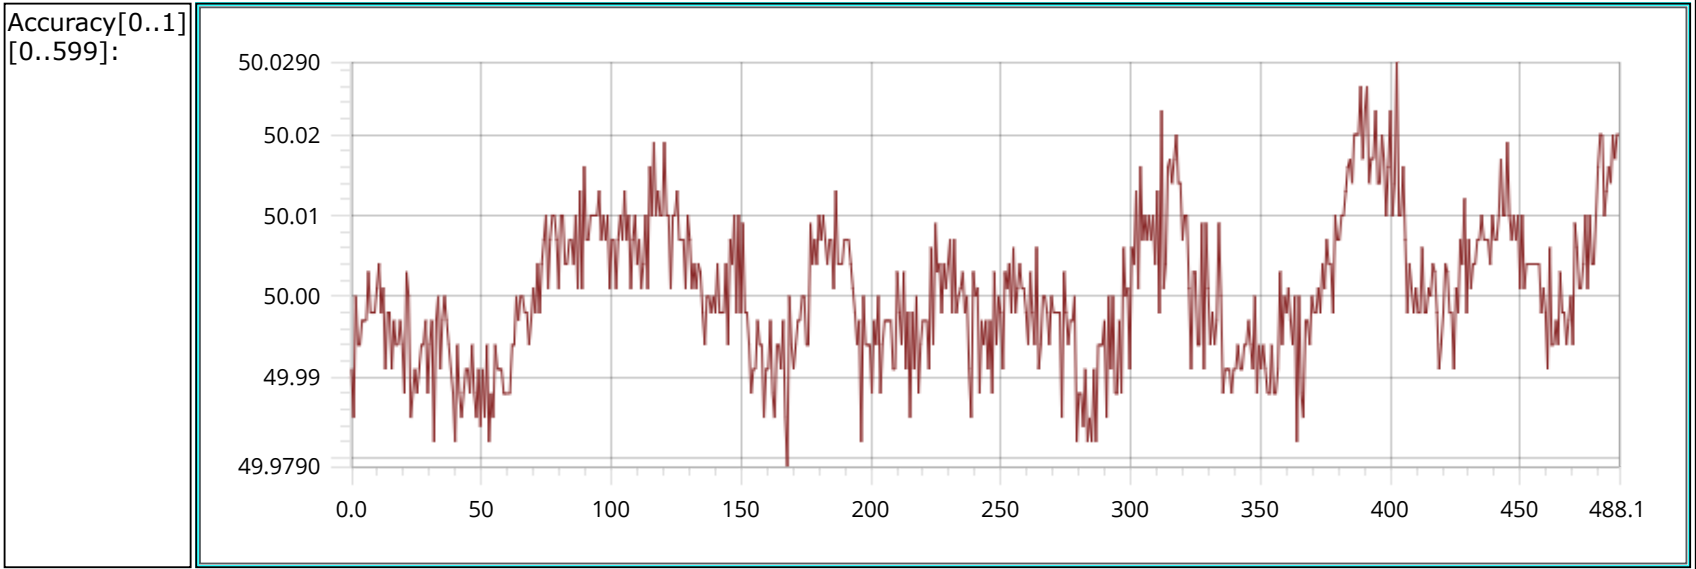

End Sequence: MainSequence

End UUT Report

