

UUT Report

Station ID:

Serial Number:

Date:

Time:

Operator:

Execution Time:

Number of Results:

UUT Result:

Serial Number:

Type Designator:

FW Version:

Power Supply:

IT-W-7303101

NONE

martedì 6 giugno 2023

13:55:42

administrator

1477.6818942 seconds

19262

Passed

4294967295

B1-D3BB-111A


0.16.1


Omicron

Begin Sequence: MainSequence

(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\EQ Meter\New Sequences\Realtime_sampling.seq)


DUT info	
Status:	Done
Serial Number:	4294967295
Type Designator:	B1-D3BB-111A
FW Version:	0.16.1

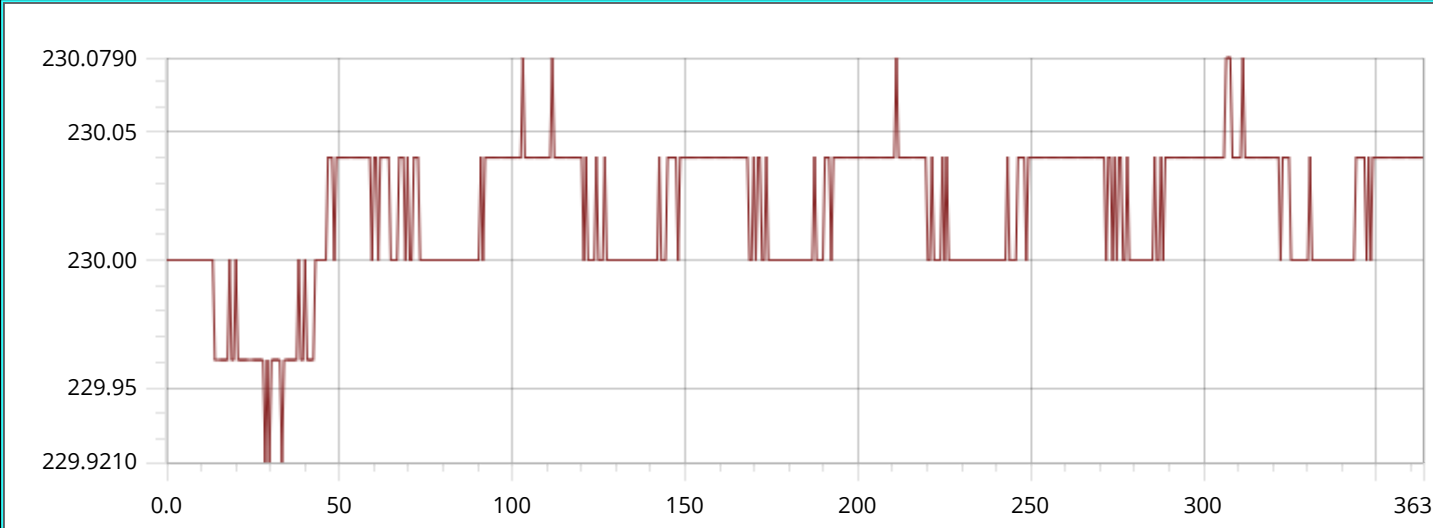Test Point	
Status:	Done
Current:	0.25
Power Factor:	1
Voltage - LOG	
Status:	Done
Accuracy[0..1] [0..599]:	
Current - LOG	
Status:	Done
Accuracy[0..1] [0..599]:	

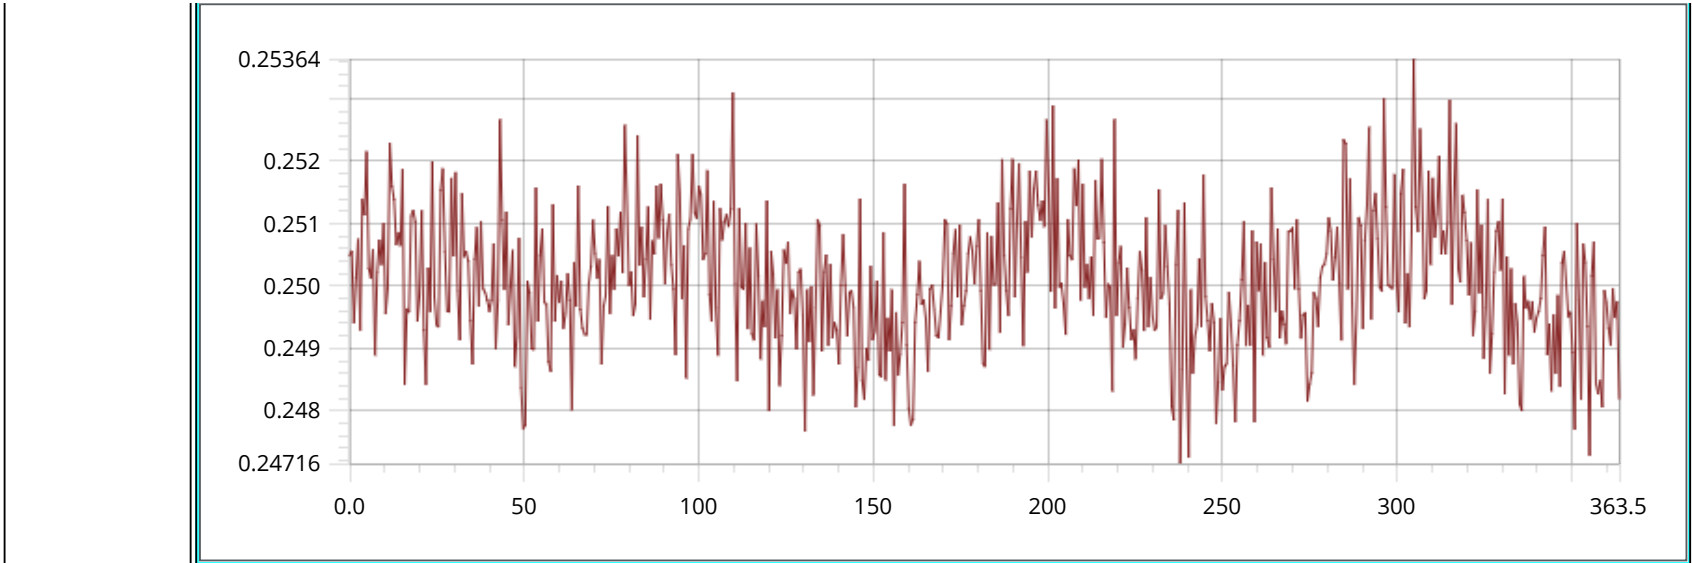

Active power - LOG

Status: Done

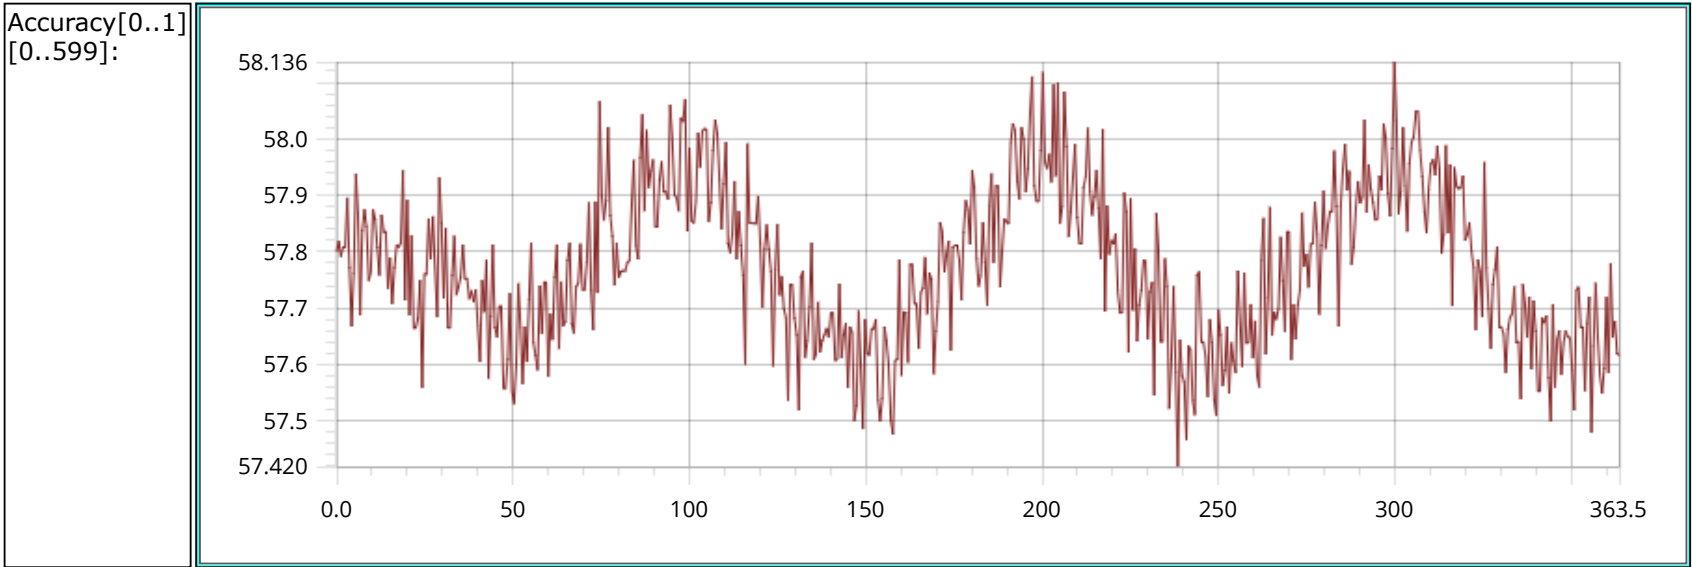

Test Point


Status: Done

Current: 1



Power Factor: 1

Voltage - LOG


Status: Done


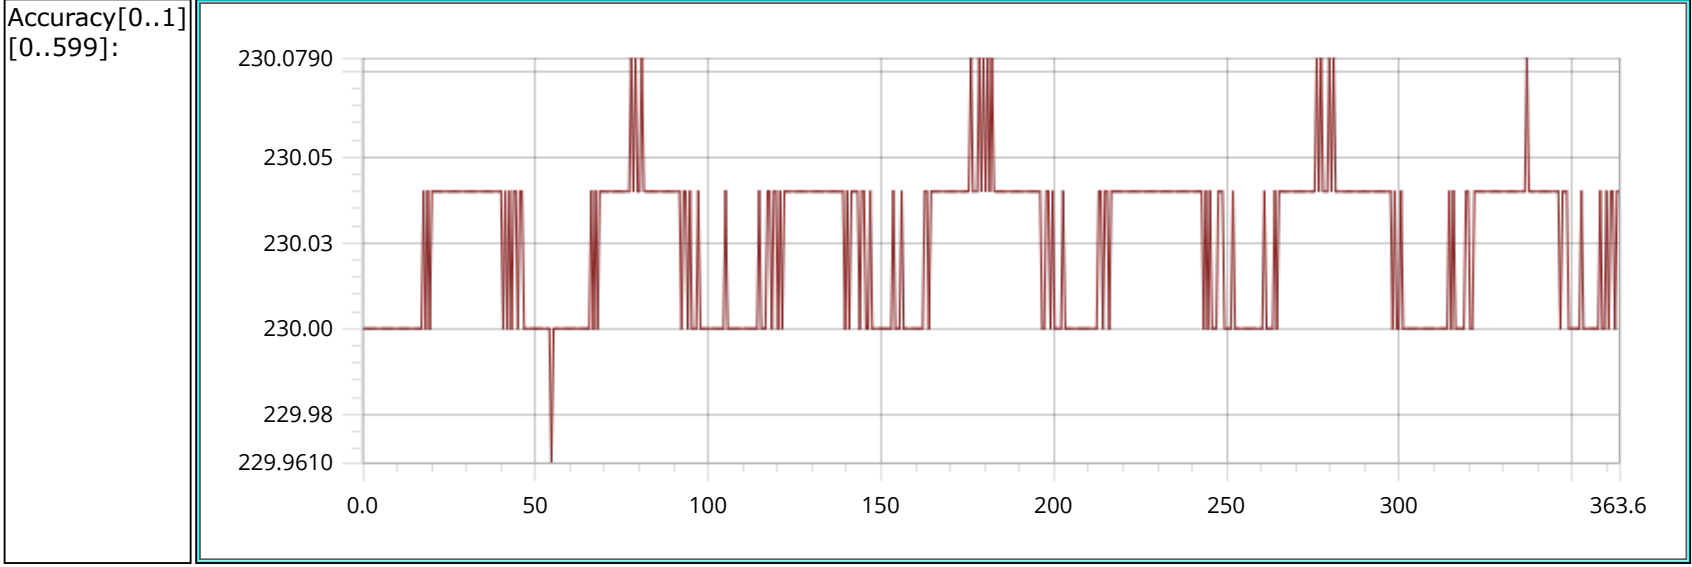


Current - LOG

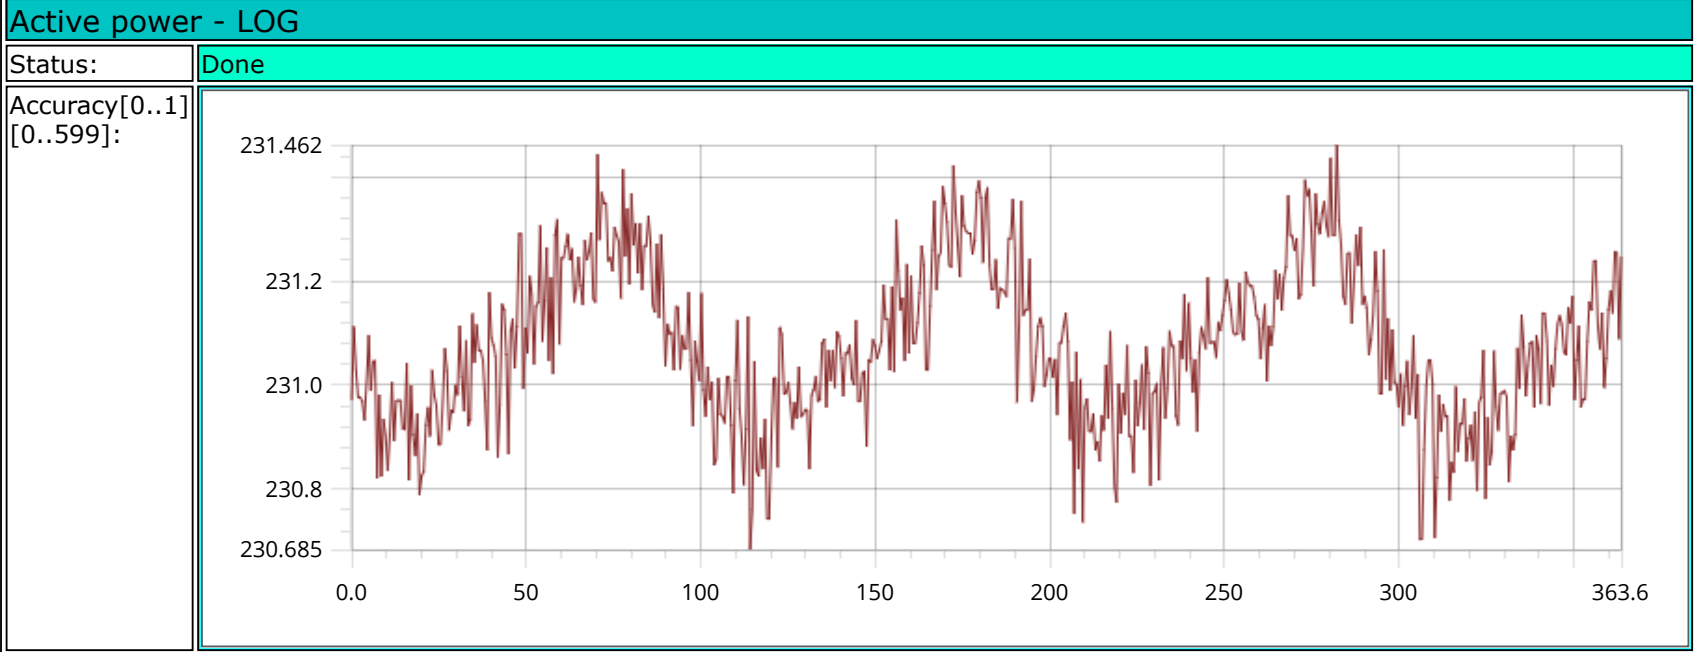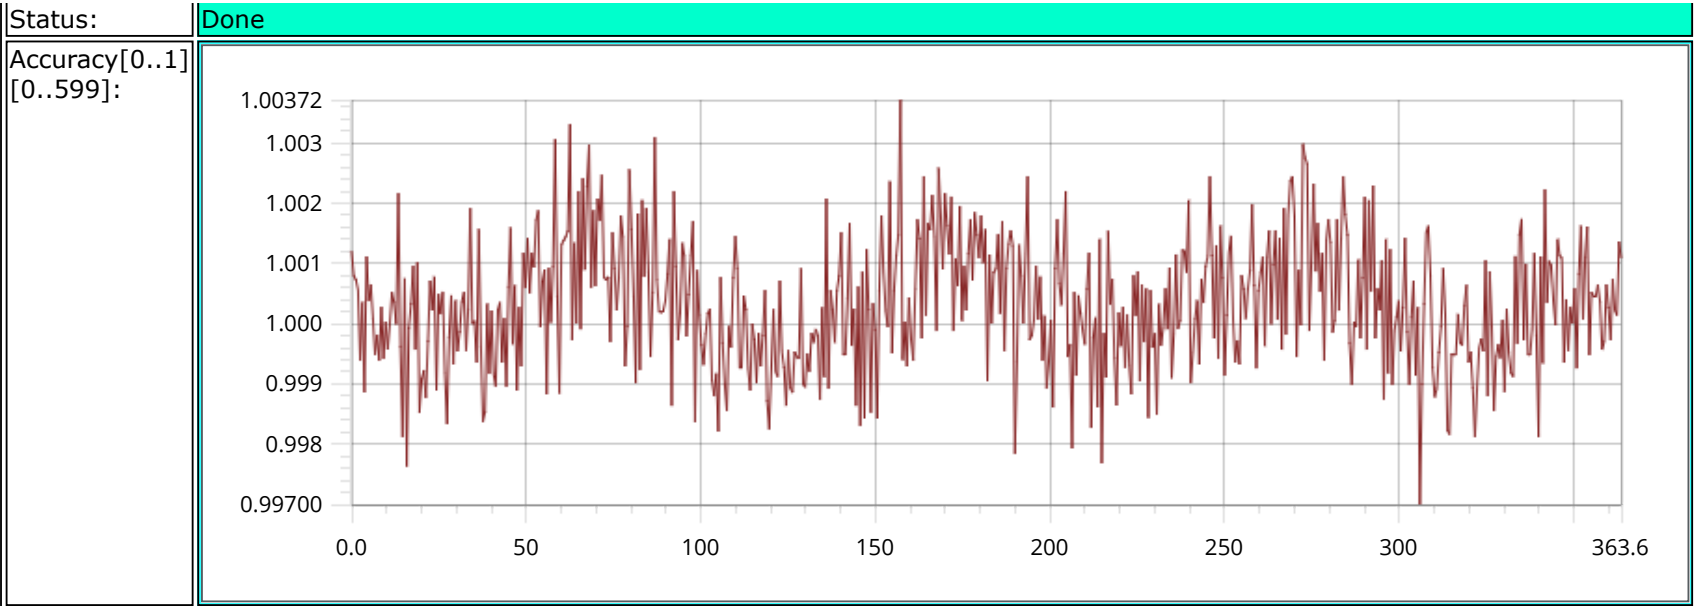


Test Point	
Status:	Done
Current:	1
Power Factor:	0.5

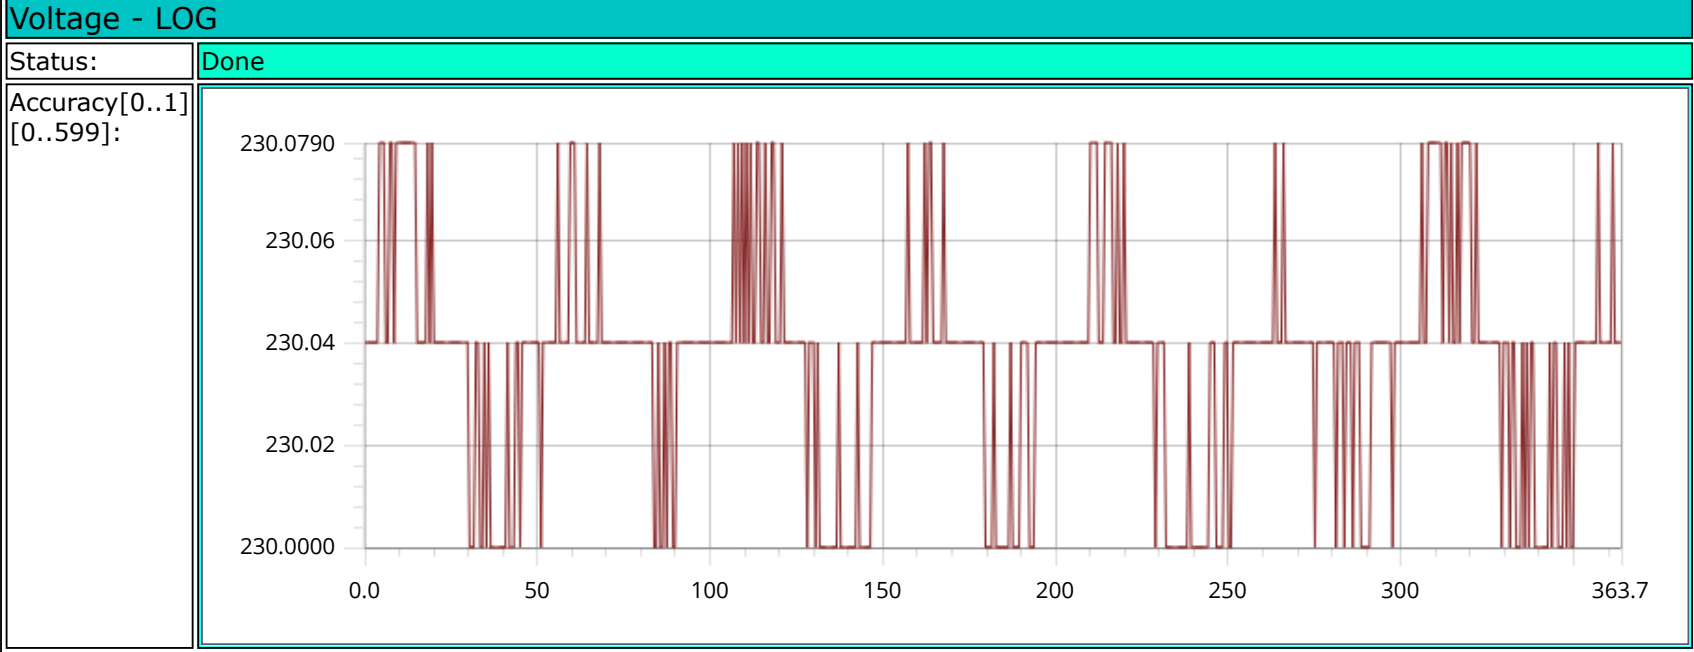

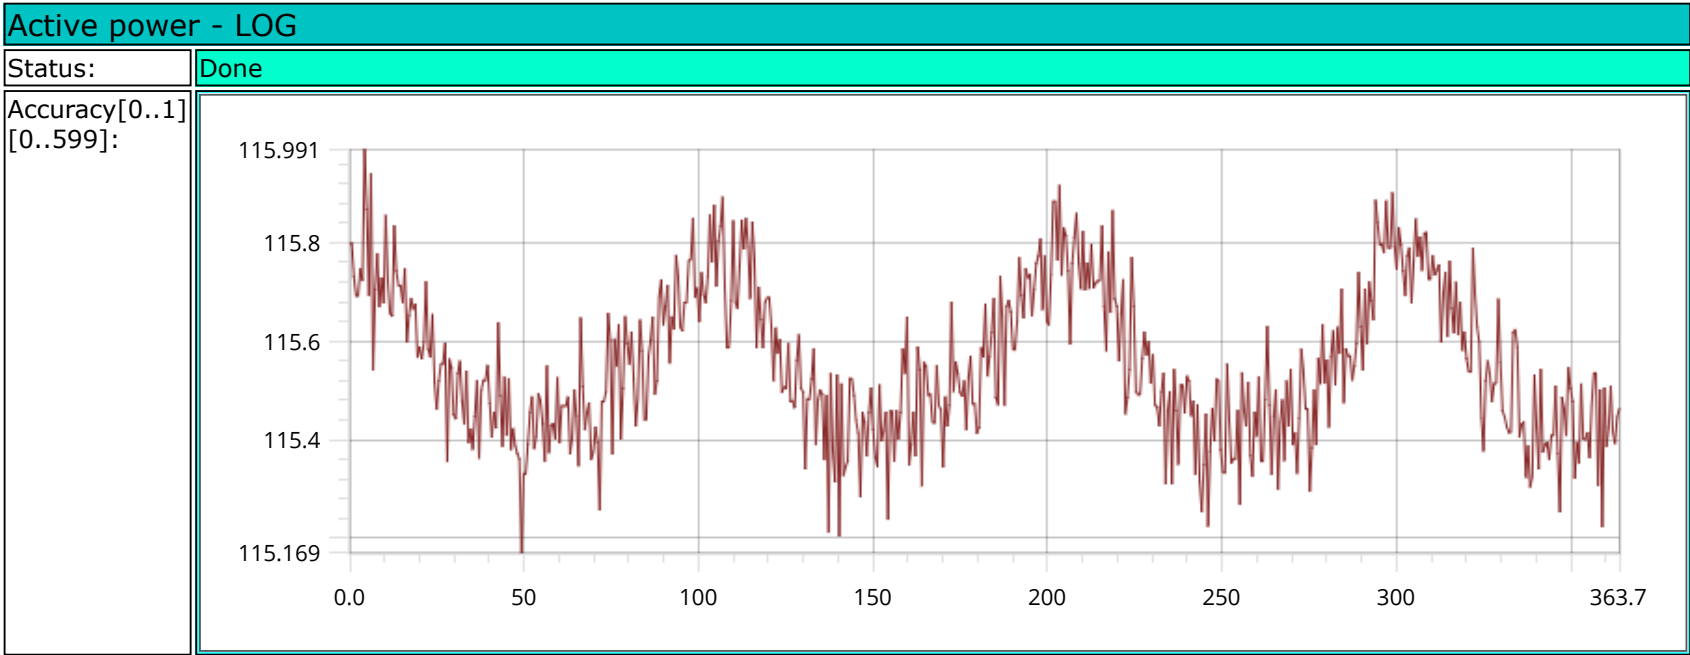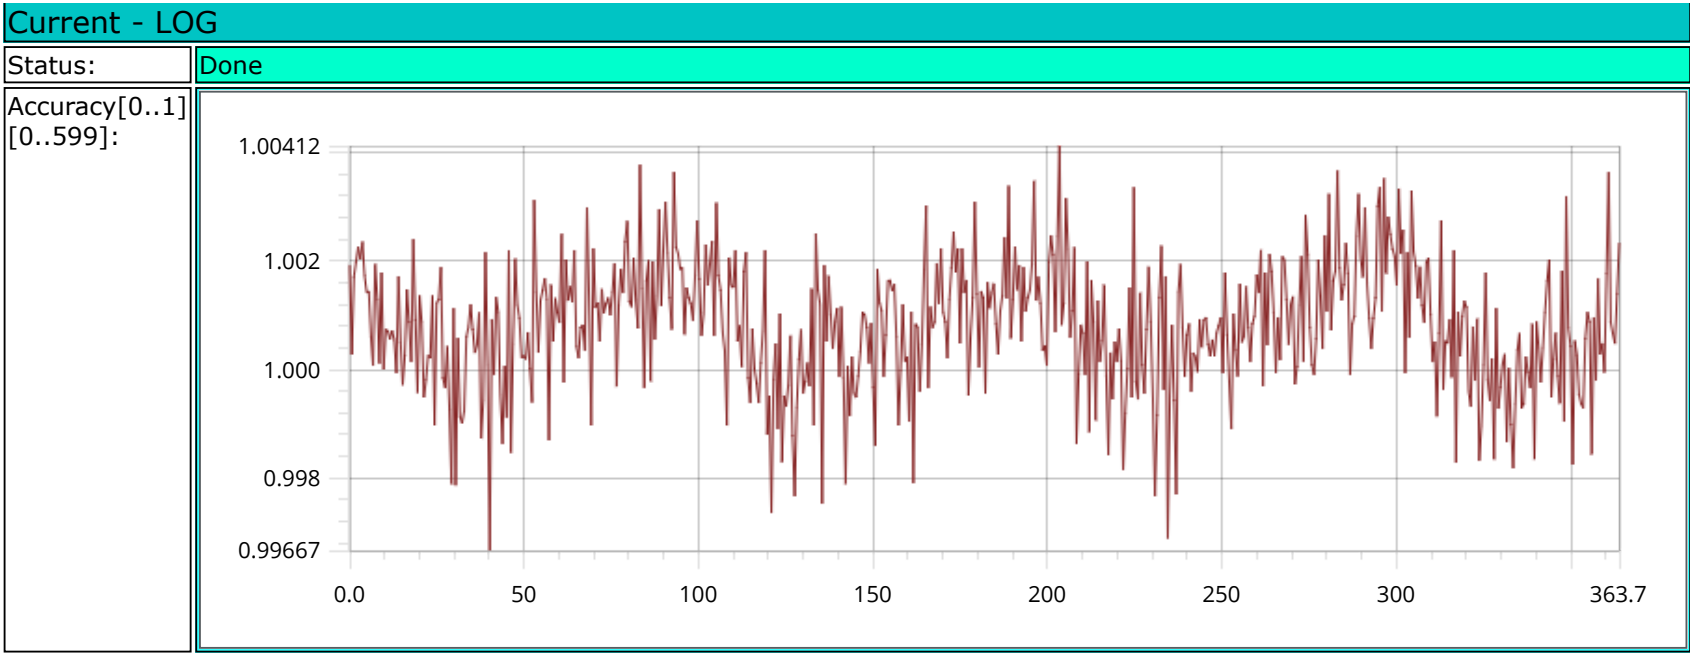


Test Point	
Status:	Done
Current:	1
Power Factor:	0.7986355100473



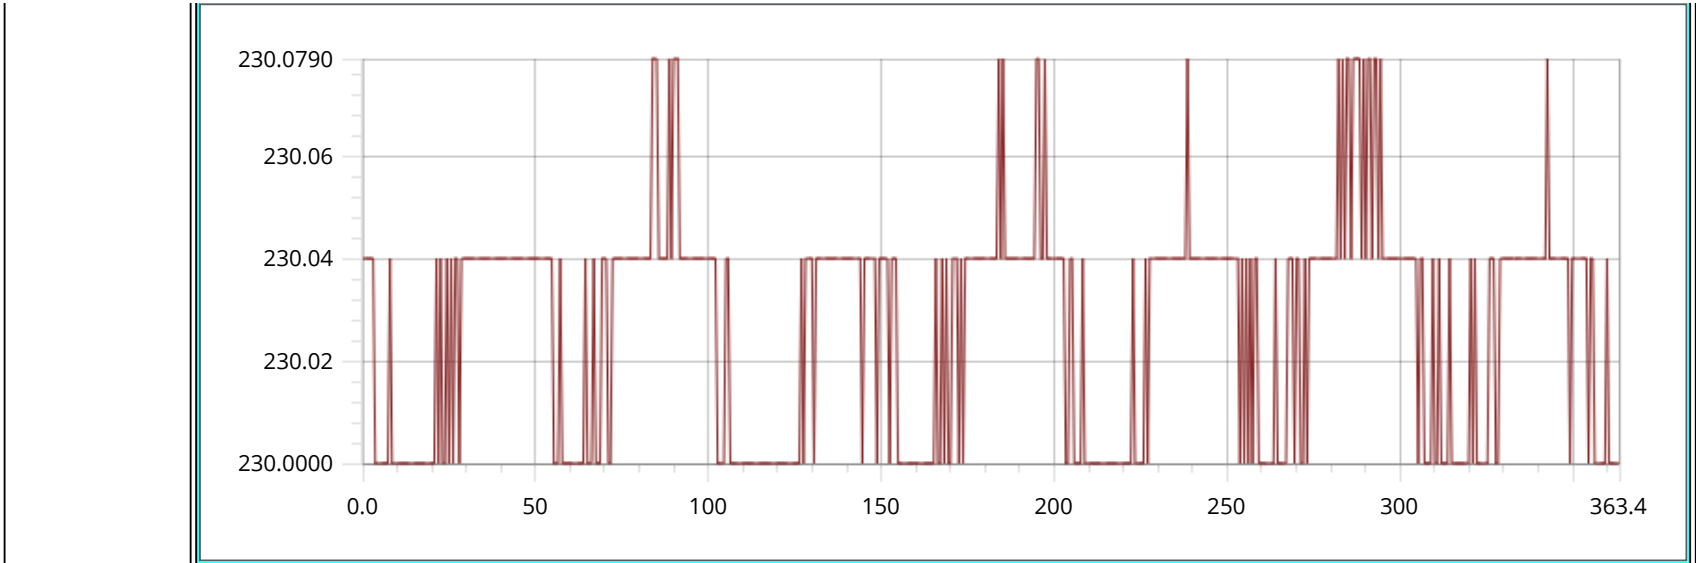


Current - LOG

Status: Done

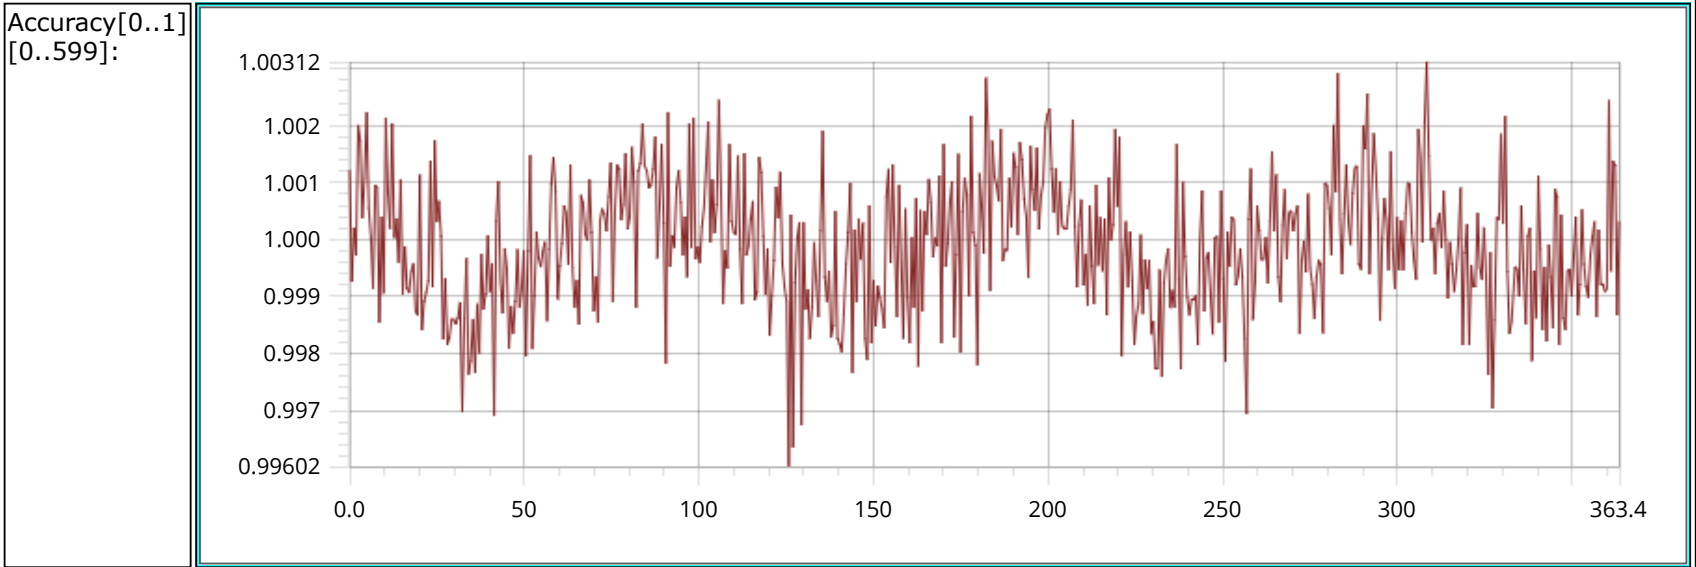

Active power - LOG

Status: Done

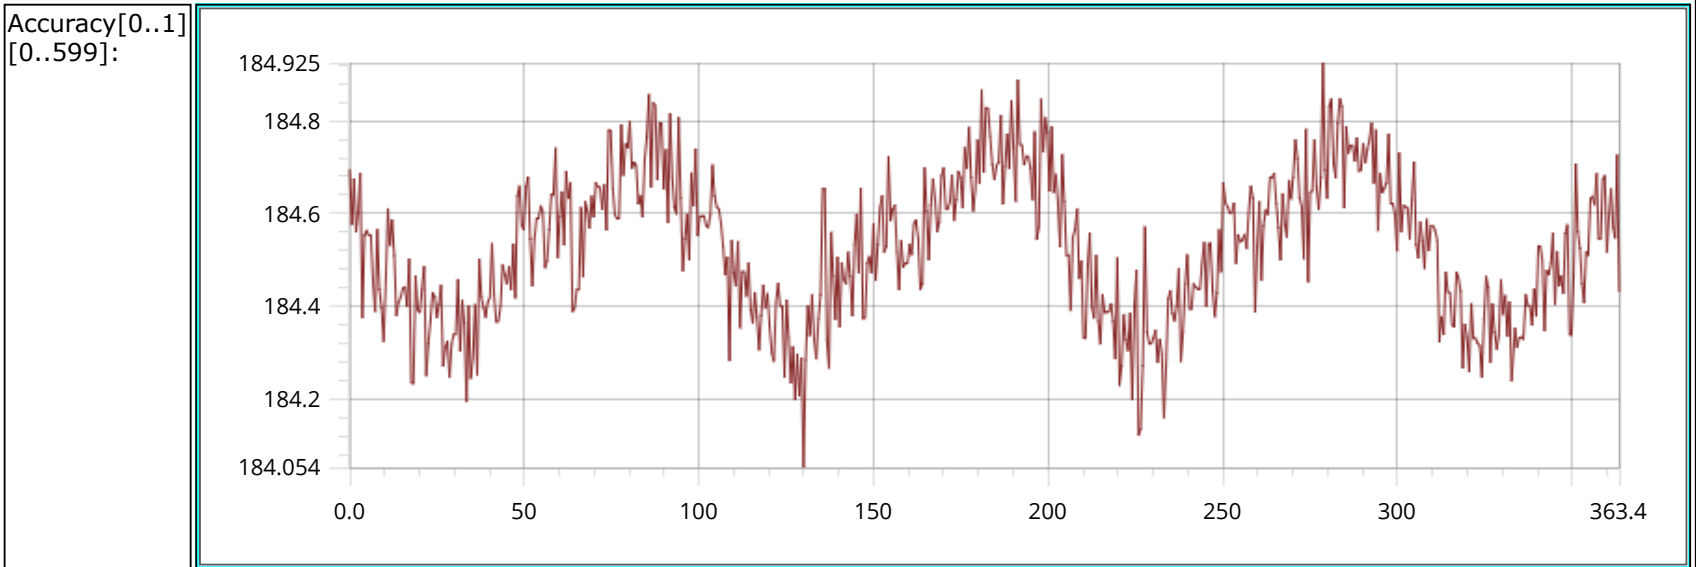

End Sequence: MainSequence

End UUT Report



