

UUT Report

Station ID:

Serial Number:

Date:

Time:

Operator:

Execution Time:

Number of Results:

UUT Result:

Serial Number:

Type Designator:

FW Version:

Power Supply:

Energy Measurement:

IT-W-7303101

NONE

lunedì 19 giugno 2023

11:36:05

administrator

48.8453994 seconds

23

Passed

4294967295

B3-D4MB-111A


0.16.1

Zera

REACTIVE\_ENERGY

Begin Sequence: MainSequence

(C:\Users\itlavit1\OneDrive - ABB\LabRnD\_Shared\TestStand\Sequences\EQ Meter\New Sequences\Energy Accuracy.seq)

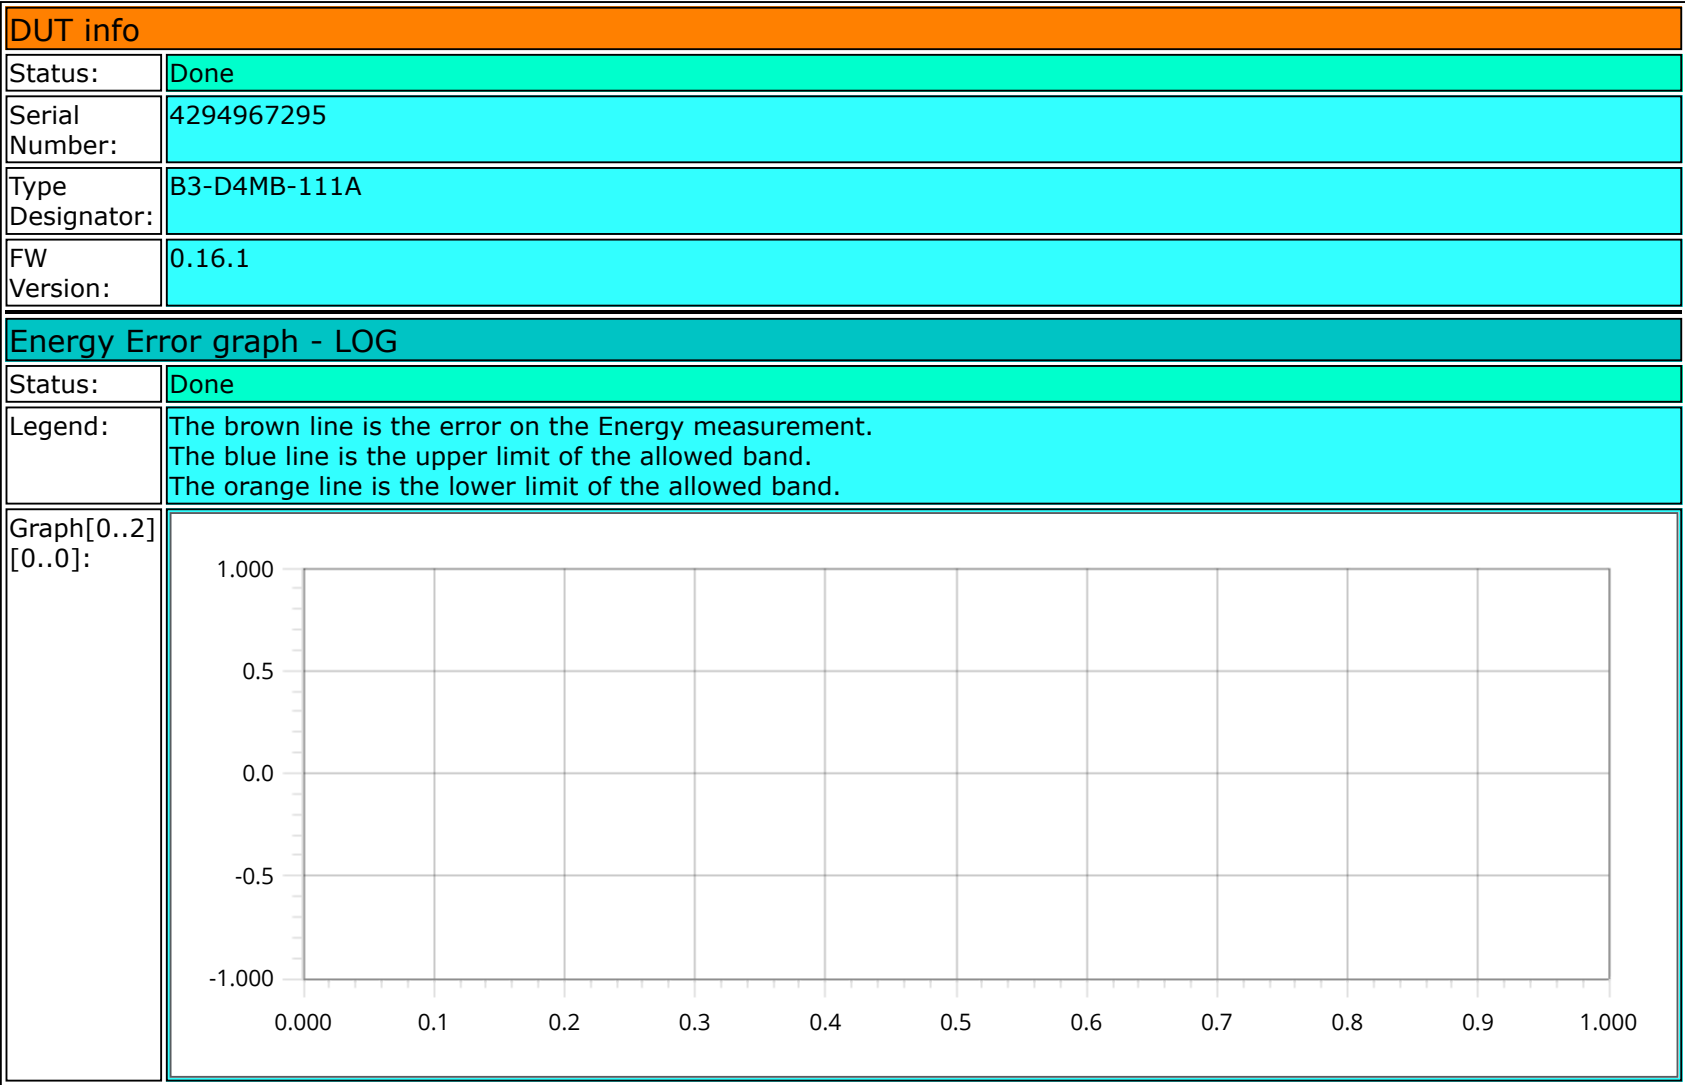

End Sequence: MainSequence

