

UUT Report

Station ID:

Serial Number:

Date:

Time:

Operator:

Execution Time:

Number of Results:

UUT Result:

Serial Number:

Type Designator:

FW Version:

Power Supply:

IT-W-7303101

NONE

martedì 6 giugno 2023

15:37:26

administrator

500.9681815 seconds

3221

Passed

4294967295

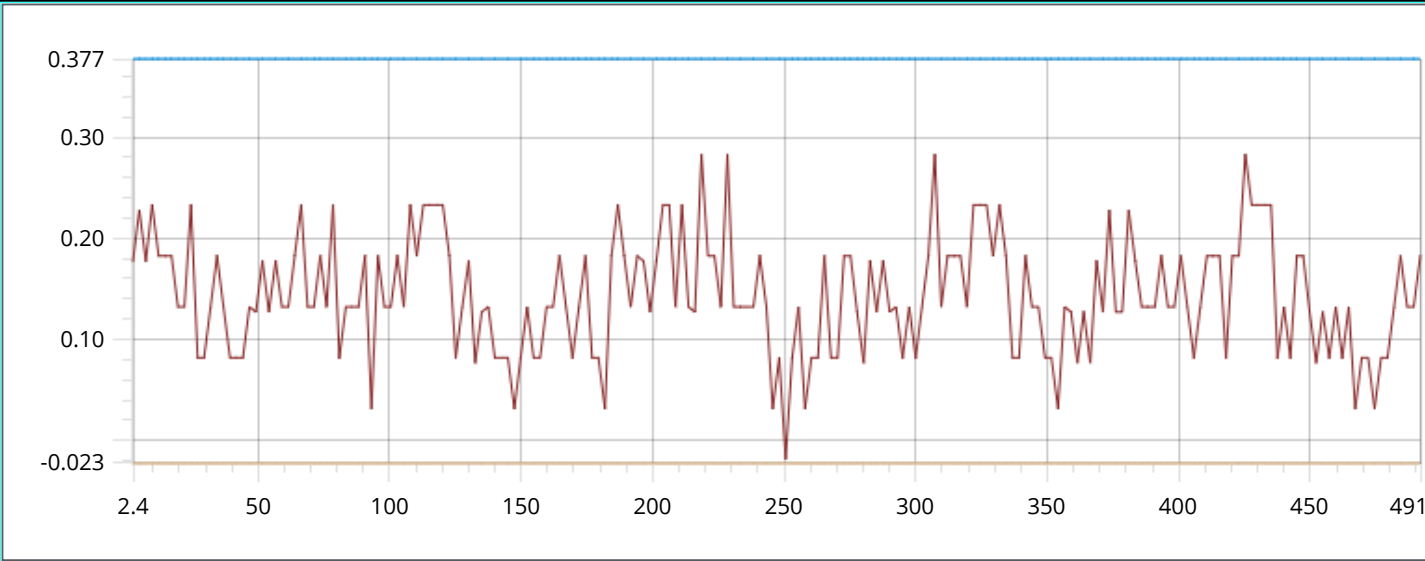
B1-D3MB-111A

0.16.1

Omicron

Begin Sequence: MainSequence  
(C:\Users\itlavit1\OneDrive - ABB\LabRnD\_Shared\TestStand\Sequences\EQ Meter\New Sequences\Repeatability\_new.seq)

DUT info	
Status:	Done
Serial Number:	4294967295
Type Designator:	B1-D3MB-111A
FW Version:	0.16.1

Test Result	
Status:	Done
Repeatability cycle result:	Failed
Current:	1
Power Factor:	0.7986355100473
Graph in report - LOG	
Status:	Done
Accuracy[0..3] [0..199]:	<div></div>
Current:	1
Power Factor:	0.7986355100473
Max difference	

Status:	Done
MAX Difference:	0.3019217265369
Minimum value:	-0.0186202573094
Maximum value:	0.2833014692275

End Sequence: MainSequence

End UUT Report

