


UUT Report

Station ID: IT-W-7303101
Serial Number: NONE
Date: venerdì 21 aprile 2023
Time: 16:20:15
Operator: ITLAVIT1
Execution Time: 00:06:28.005
Number of Results: 1115
UUT Result: **Failed**

Begin Sequence: MainSequence
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\M4M\M4M
Omicron Accuracy.seq)

Omicron Accuracy	
Status:	Passed
Module Time:	30.7382
Omicron Accuracy	
Status:	Passed
Module Time:	31.8038
Omicron Accuracy	
Status:	Passed
Module Time:	31.7134
Omicron Accuracy	
Status:	Passed
Module Time:	31.7282
Omicron Accuracy	
Status:	Passed
Module Time:	31.6934
Omicron Accuracy	
Status:	Passed
Module Time:	31.7595
Omicron Accuracy	
Status:	Passed
Module Time:	31.7303
Omicron Accuracy	
Status:	Passed
Module Time:	31.6655
Omicron Accuracy	
Status:	Passed
Module Time:	31.7271
Omicron Accuracy	
Status:	Passed
Module Time:	31.7119
Omicron Accuracy	
Status:	Passed
Module Time:	31.7082

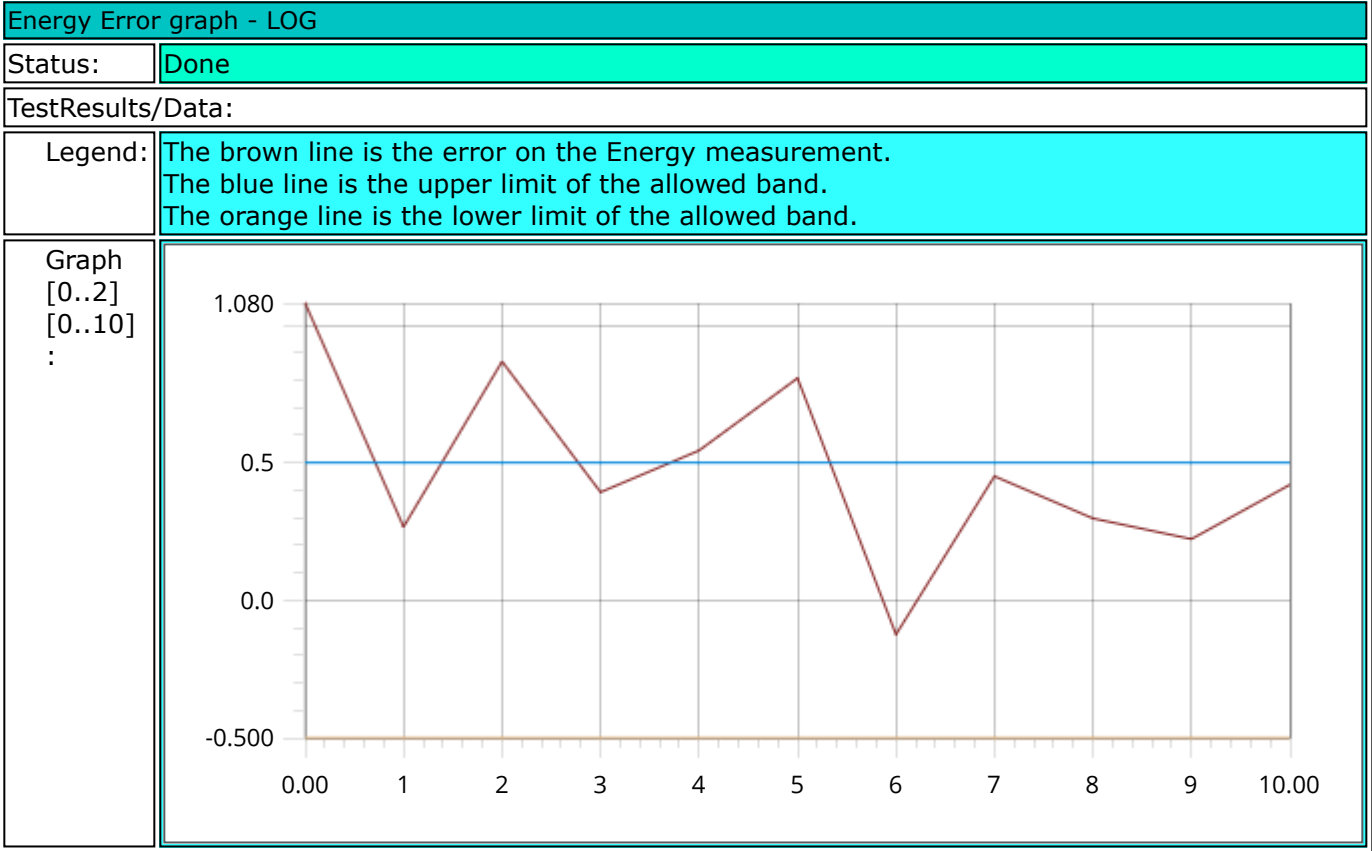

End Sequence: MainSequence

End UUT Report

