UUT Report

Station ID:	**IT-W-7303101**
Serial Number:	**NONE**
Date:	**venerdì 9 giugno 2023**
Time:	**14:26:17**
Operator:	**administrator**
Execution Time:	**353.8146345 seconds**
Number of Results:	**341**
UUT Result:	**Passed**
Serial Number:	**4294967295**
Type Designator:	**B1-D3NB-111A**
FW Version:	**0.16.1**
Power Supply:	**Omicron**

Begin Sequence: MainSequence
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\EQ Meter\New Sequences\Repeatability_new.seq)

DUT info	
Status:	Done
Serial Number:	4294967295
Type Designator:	B1-D3NB-111A
FW Version:	0.16.1

Test Result	
Status:	Done
Repeatability cycle result:	Failed
Current:	5
Power Factor:	1

Graph in report - LOG	
Status:	Done
Accuracy[0..3][0..19]:	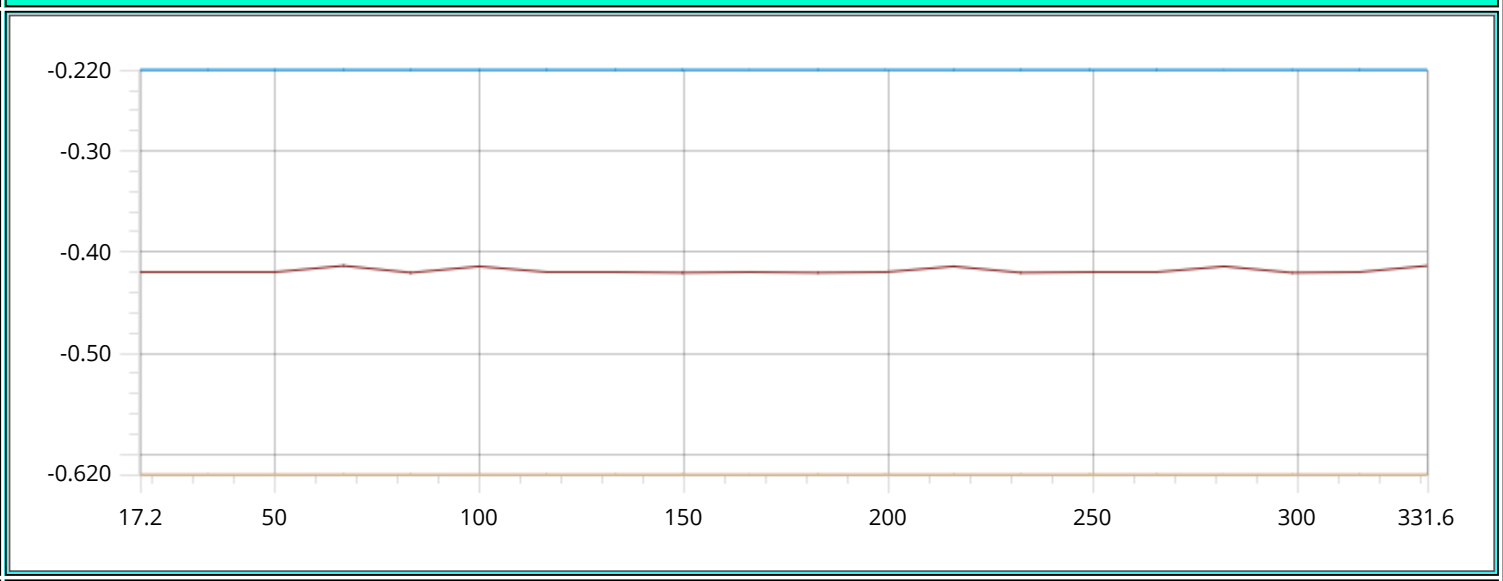
Current:	5
Power Factor:	1

Max difference	

Status:	Done
MAX Difference:	0.00683265362123
Minimum value:	-0.4202849737139
Maximum value:	-0.4134523200926

End Sequence: MainSequence

End UUT Report