

UUT Report

Station ID:

Serial Number:

Date:

Time:

Operator:

Execution Time:

Number of Results:

UUT Result:

Serial Number:

Type Designator:

FW Version:

Power Supply:

IT-W-7303101

NONE

venerdì 9 giugno 2023

15:44:42

administrator

486.4844524 seconds

7825

Passed

4294967295


B3-D4MB-111A


0.16.1

Zera

Begin Sequence: MainSequence
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\EQ Meter\New Sequences\Realtime_sampling.seq)


DUT info	
Status:	Done
Serial Number:	4294967295
Type Designator:	B3-D4MB-111A
FW Version:	0.16.1

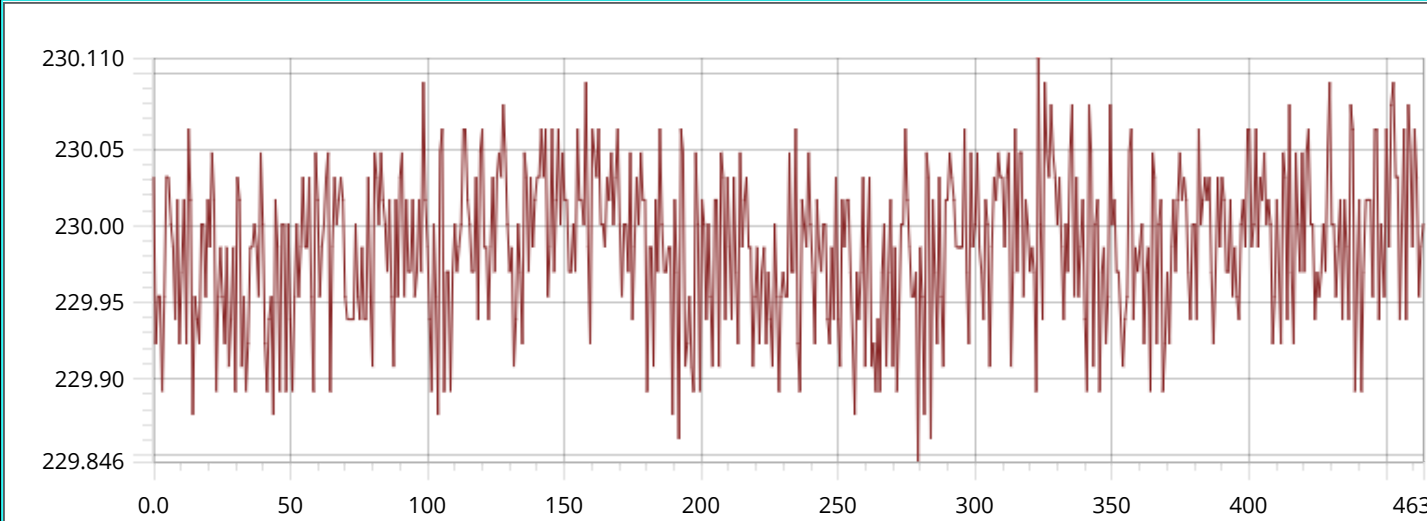Test Point	
Status:	Done
Current:	0.2
Power Factor:	1
Frequency:	50
Voltage L1 - LOG	
Status:	Done
Accuracy[0..1] [0..599]:	
Voltage L2 - LOG	
Status:	Done
Accuracy[0..1] [0..599]:	

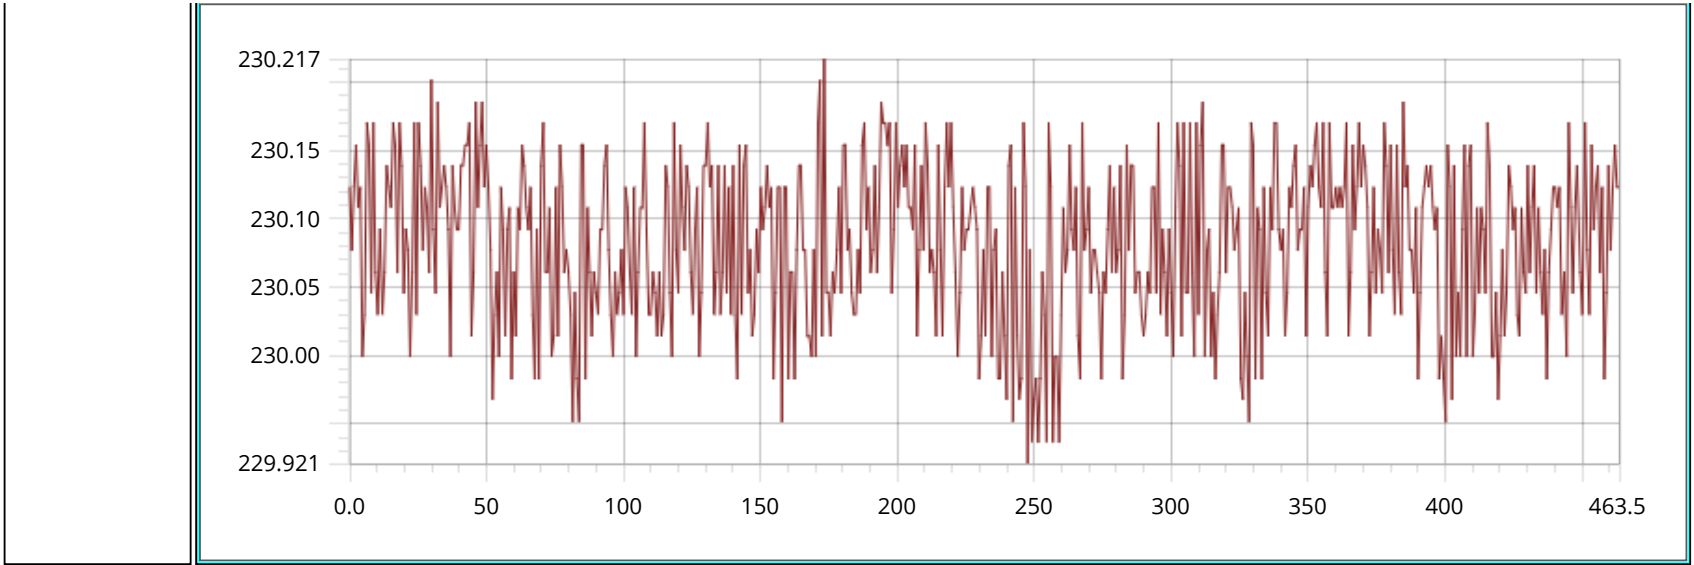


Voltage L3 - LOG	
------------------	--

Status:	Done
---------	------

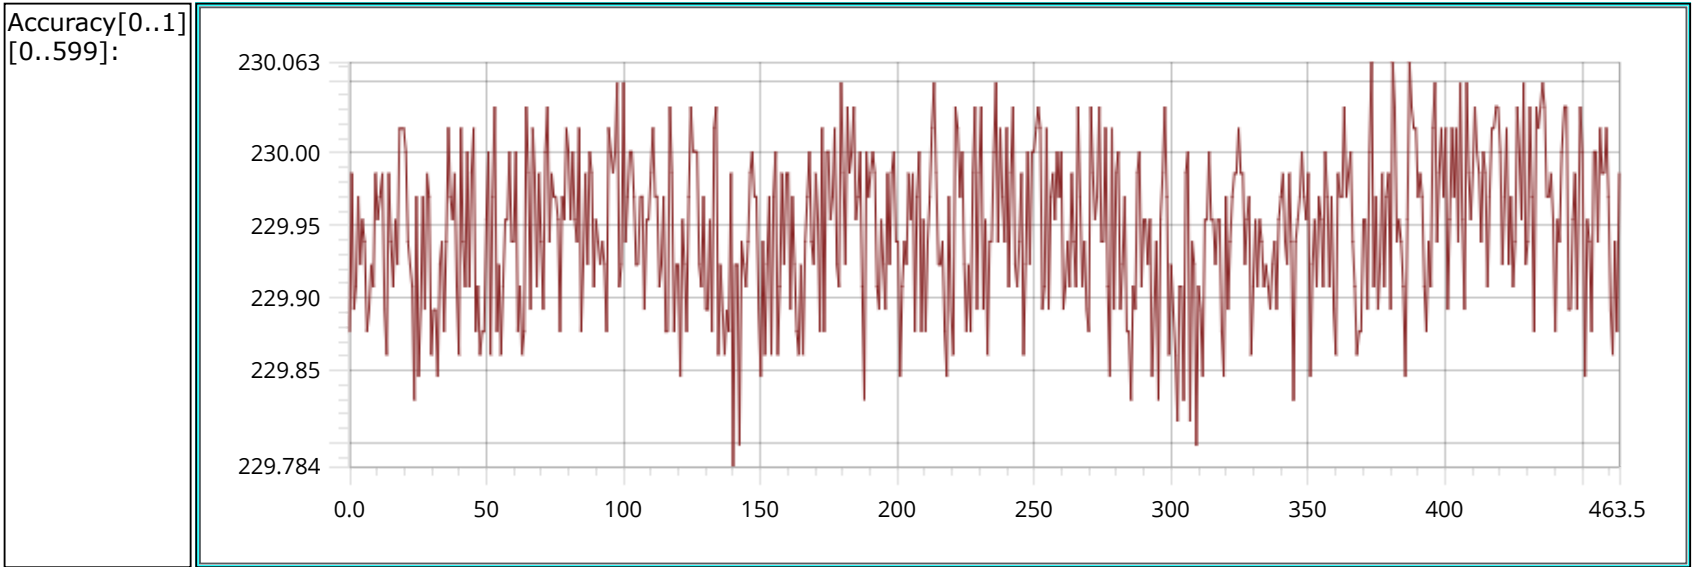

Current L1 - LOG	
------------------	--


Status:	Done
---------	------

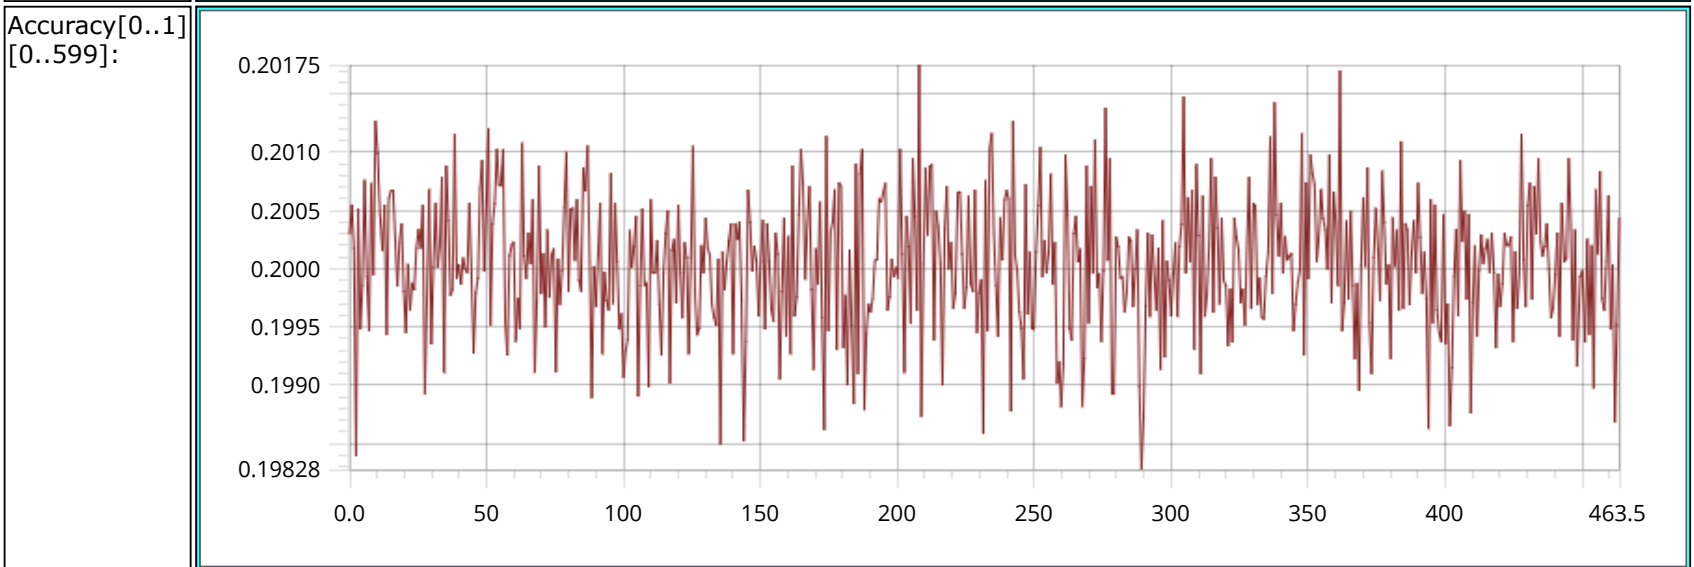


Current L2 - LOG	
------------------	--

Status:	Done
---------	------




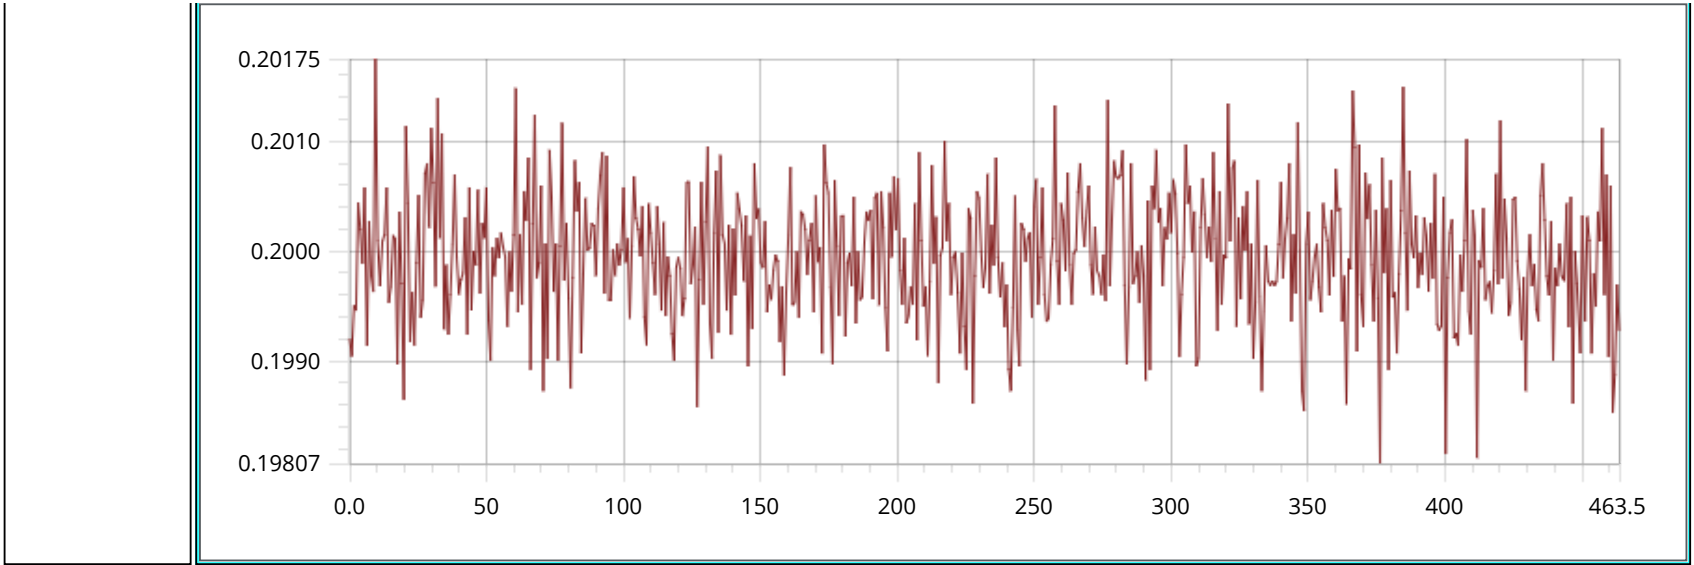

Current L3 - LOG	
------------------	--

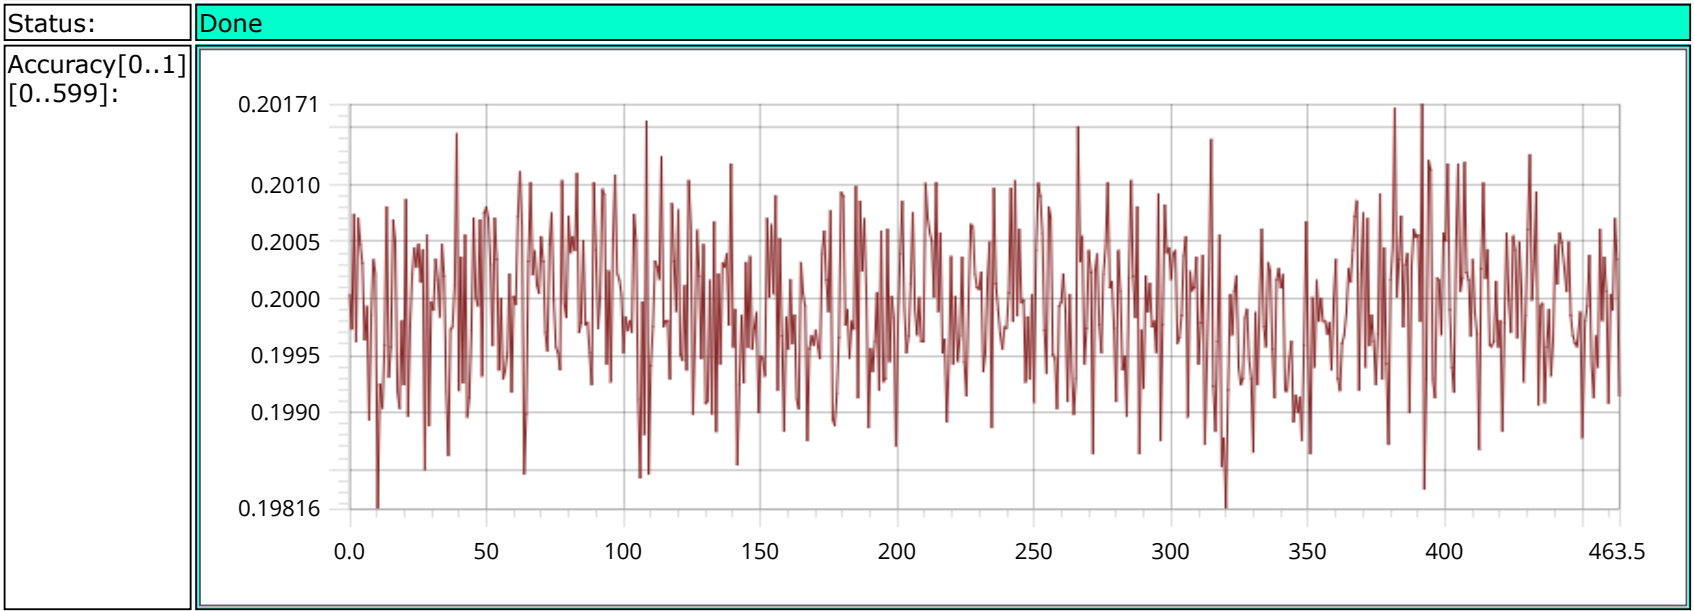


Active power - LOG	
--------------------	--

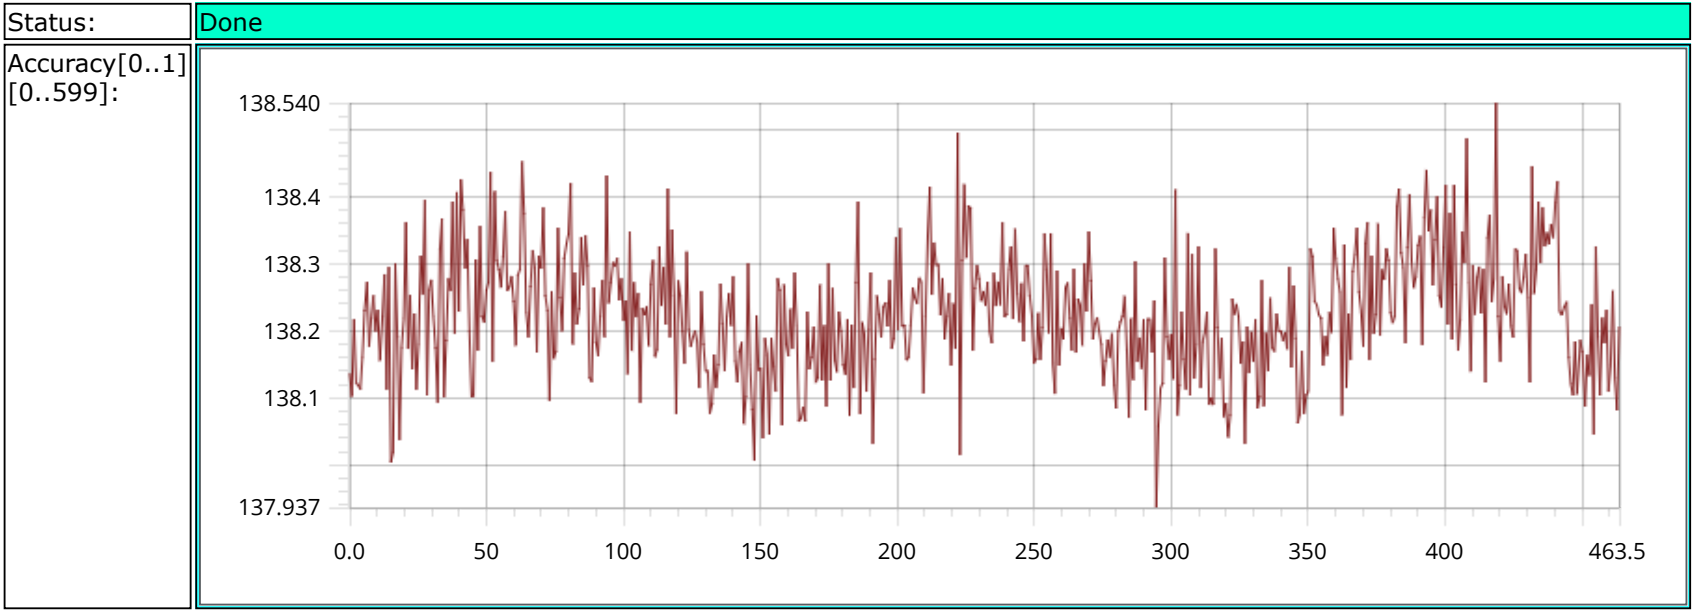

Frequency - LOG	
-----------------	--



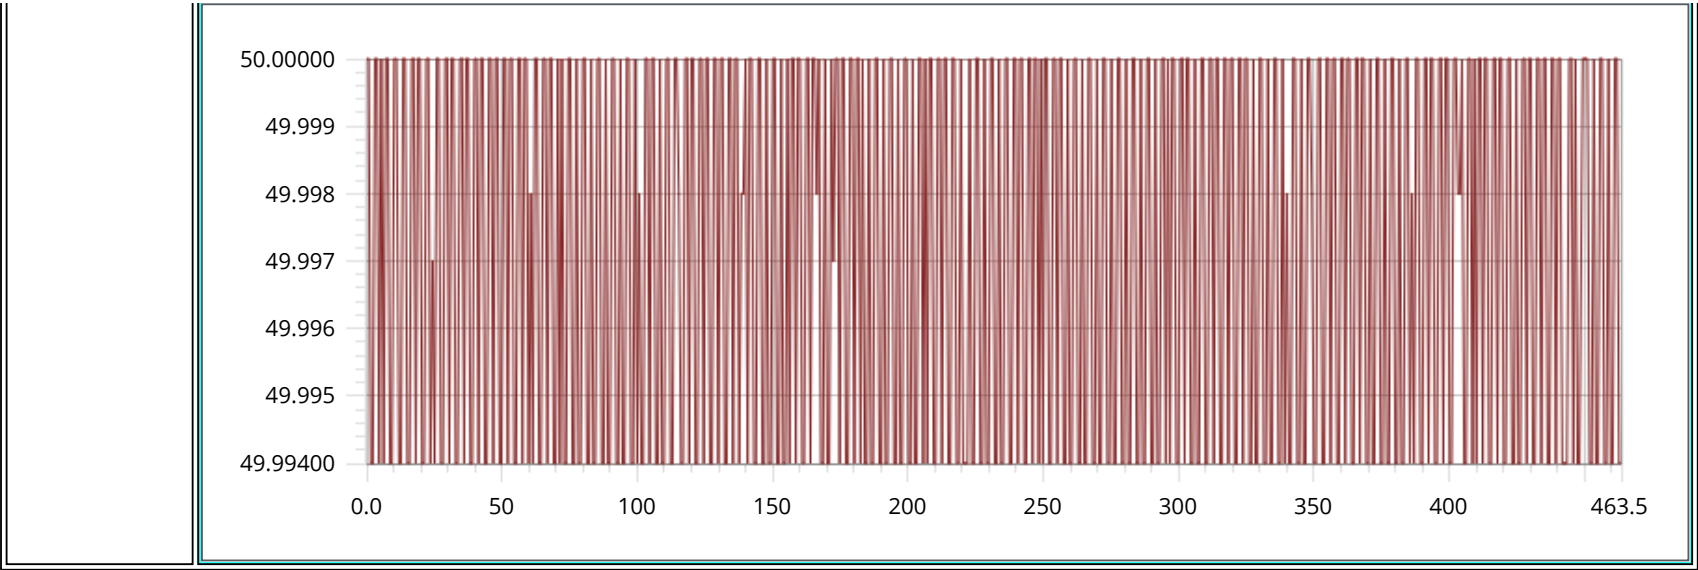

End Sequence: MainSequence

End UUT Report

