

UUT Report

Station ID:

Serial Number:

Date:

Time:

Operator:

Execution Time:

Number of Results:

UUT Result:

Serial Number:

Type Designator:

FW Version:

Power Supply:

IT-W-7303101

NONE

lunedì 5 giugno 2023

08:41:37

administrator

6905.1508362 seconds

7275

Terminated

4294967295

B1-D3BB-111A

0.16.1

Omicron

Begin Sequence: MainSequence
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\EQ Meter\New Sequences\Repeatability.seq)

DUT info	
Status:	Done
Serial Number:	4294967295
Type Designator:	B1-D3BB-111A
FW Version:	0.16.1

Power_ON_generator	
Status:	Passed
Module Time:	5.0887321

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0855294

Omicron Accuracy	
Status:	Passed
Module Time:	31.6512586

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0971388

Omicron Accuracy	
Status:	Passed
Module Time:	31.5800672

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0866181

Omicron Accuracy	
Status:	Passed
Module Time:	31.537405

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0978539

Omicron Accuracy	
Status:	Passed
Module Time:	31.6292668

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0961068

Omicron Accuracy	
Status:	Passed
Module Time:	31.5463958

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.1027439

Omicron Accuracy	
Status:	Passed
Module Time:	31.6769368

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0954412

Omicron Accuracy	
Status:	Passed
Module Time:	31.5798019

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0905802

Omicron Accuracy	
Status:	Passed
Module Time:	31.5778406

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0912846

Omicron Accuracy	
Status:	Passed
Module Time:	31.6012834

End Sequence: Energy_Accuracy


Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0950398

Omicron Accuracy	
Status:	Passed
Module Time:	31.5853692

End Sequence: Energy_Accuracy

Test Result	

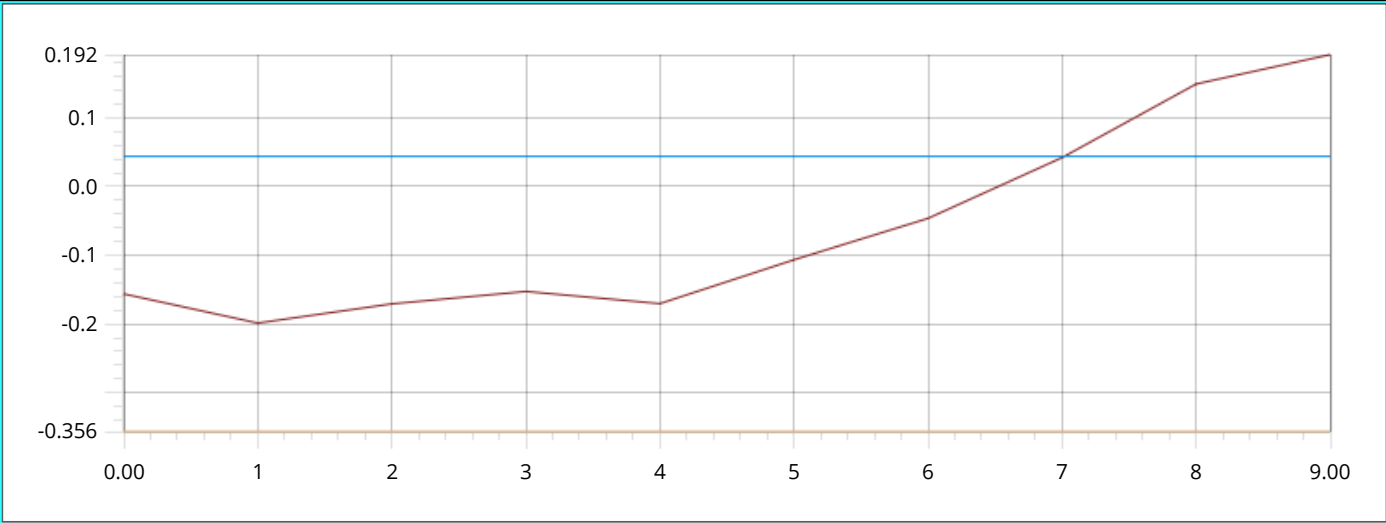Status:	Done
Repeatability cycle result:	Failed
Current:	0.25
Power Factor:	1
Graph in report - LOG	
Status:	Done
Errors_array[0..2][0..9]:	
Current:	0.25
Power Factor:	1
Power_ON_generator	
Status:	Passed
Module Time:	5.1169541

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.089308
Omicron Accuracy	
Status:	Passed
Module Time:	31.5291843

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0927435
Omicron Accuracy	
Status:	Passed
Module Time:	31.6593414

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0916058

Omicron Accuracy	
Status:	Passed
Module Time:	32.6037047

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.1026182

Omicron Accuracy	
Status:	Passed
Module Time:	32.5708182

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0916333

Omicron Accuracy	
Status:	Passed
Module Time:	31.6039654

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0902803

Omicron Accuracy	
Status:	Passed
Module Time:	31.5737211

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.1001917

Omicron Accuracy	
Status:	Passed
Module Time:	31.602384

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0907586

Omicron Accuracy	
Status:	Passed
Module Time:	32.5971861

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.1020715

Omicron Accuracy	
Status:	Passed
Module Time:	32.592715

End Sequence: Energy_Accuracy


Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0907892

Omicron Accuracy	
Status:	Passed
Module Time:	31.6254319

End Sequence: Energy_Accuracy

Test Result	
Status:	Done
Repeatability cycle result:	Failed

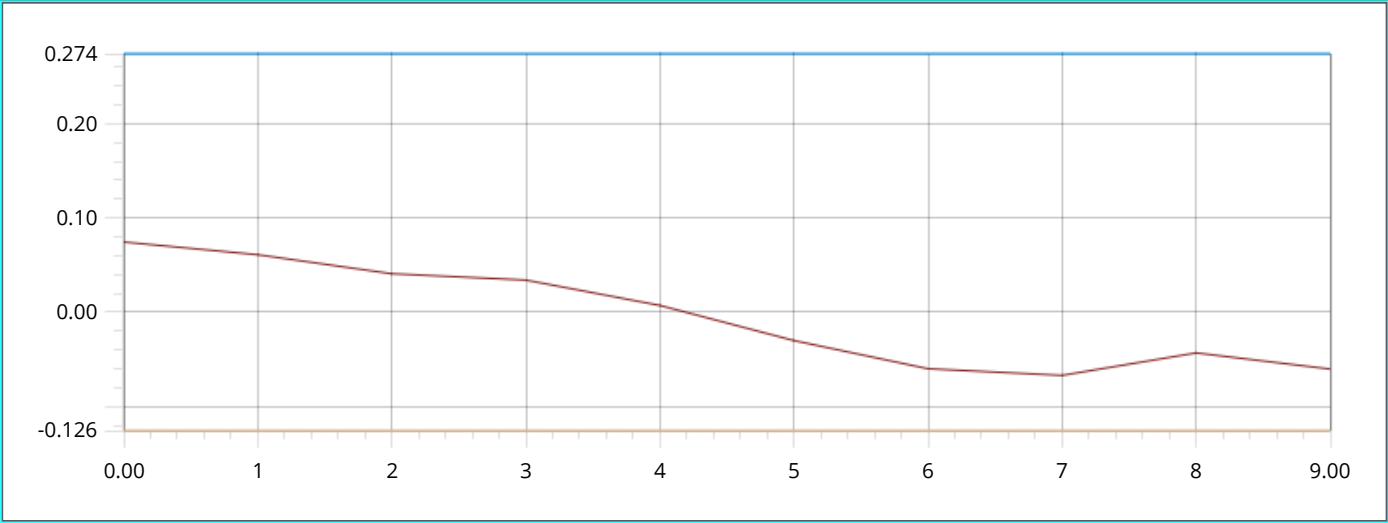Current:	0.5
Power Factor:	1
Graph in report - LOG	
Status:	Done
Errors_array[0..2] [0..9]:	
Current:	0.5
Power Factor:	1
Power_ON_generator	
Status:	Passed
Module Time:	5.0985171

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0948321

Omicron Accuracy	
Status:	Passed
Module Time:	32.6134807

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0921419

Omicron Accuracy	
Status:	Passed
Module Time:	31.5600398

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
----------	--

Status:	Passed
Module Time:	5.0955788

Omicron Accuracy	
Status:	Passed
Module Time:	31.6221992

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0888049

Omicron Accuracy	
Status:	Passed
Module Time:	31.5240439

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0946905

Omicron Accuracy	
Status:	Passed
Module Time:	32.5725586

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0923273

Omicron Accuracy	
Status:	Passed
Module Time:	31.6224456

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed

Module Time:	5.0877945
--------------	-----------

Omicron Accuracy	
Status:	Passed
Module Time:	31.5485862

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0946535

Omicron Accuracy	
Status:	Passed
Module Time:	31.6398397

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.1081614

Omicron Accuracy	
Status:	Passed
Module Time:	31.549259

End Sequence: Energy_Accuracy


Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.1089536

Omicron Accuracy	
Status:	Passed
Module Time:	31.6073516

End Sequence: Energy_Accuracy

Test Result	
Status:	Done
Repeatability cycle result:	Failed
Current:	0.5
Power Factor:	-0.9524129804152

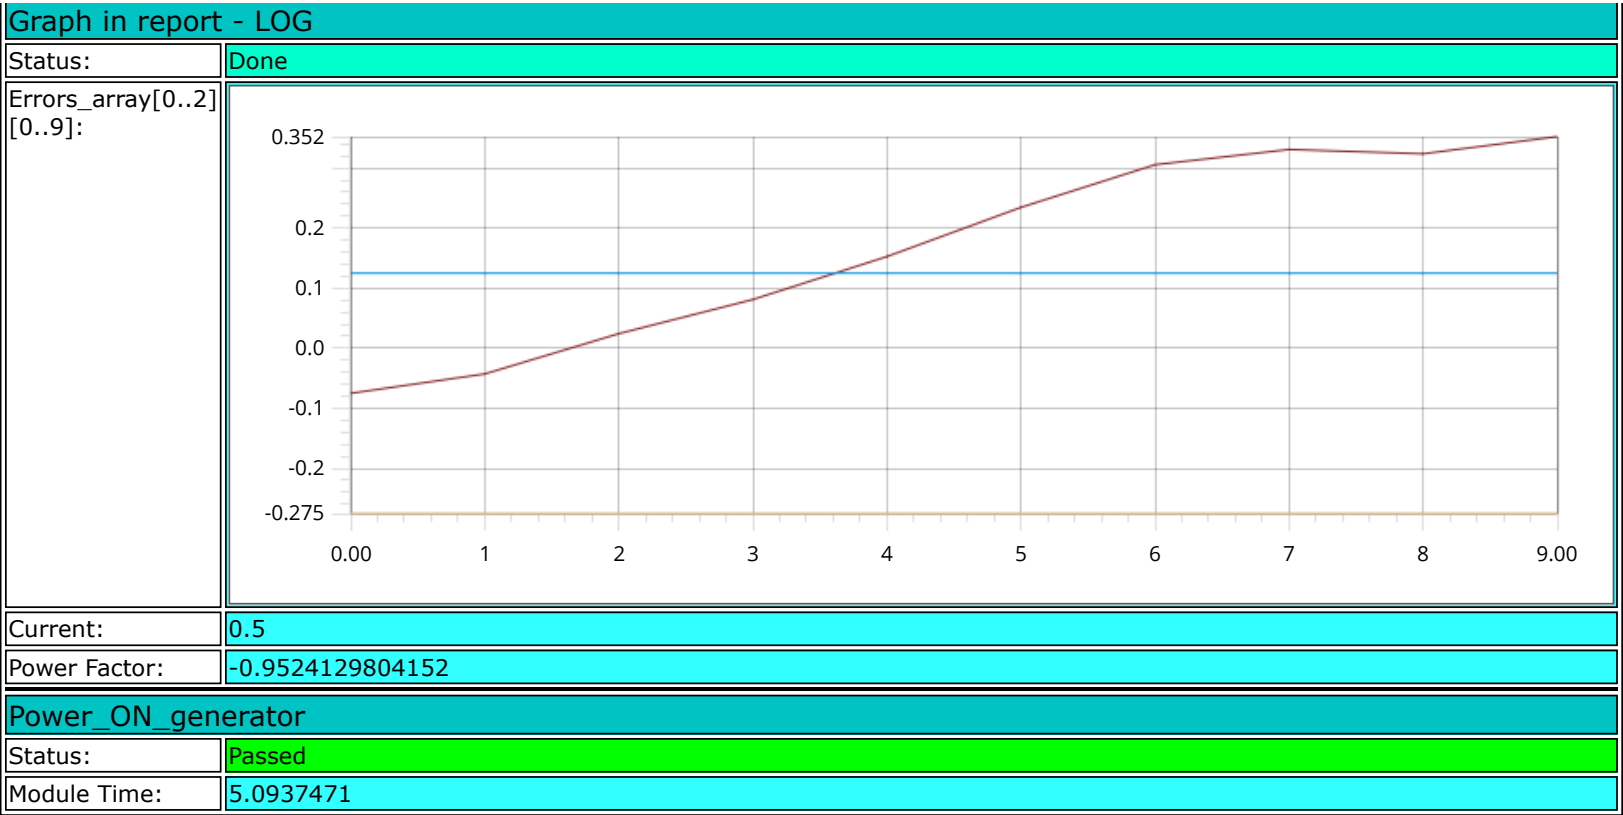

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0924301

Omicron Accuracy	
Status:	Passed
Module Time:	30.5969895

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0912061

Omicron Accuracy	
Status:	Passed
Module Time:	30.5506703

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.1015362

Omicron Accuracy	
Status:	Passed
Module Time:	30.5540938

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.1040852

Omicron Accuracy	
Status:	Passed
Module Time:	32.5840243

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0912627

Omicron Accuracy	
Status:	Passed
Module Time:	31.5587099

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0873503

Omicron Accuracy	
Status:	Passed
Module Time:	30.6145036

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0909934

--	--

Omicron Accuracy	
Status:	Passed
Module Time:	30.5495611

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0947084

Omicron Accuracy	
Status:	Passed
Module Time:	32.5579991

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0932607

Omicron Accuracy	
Status:	Passed
Module Time:	31.6210785

End Sequence: Energy_Accuracy


Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0922132

Omicron Accuracy	
Status:	Passed
Module Time:	30.5275678

End Sequence: Energy_Accuracy

Test Result	
Status:	Done
Repeatability cycle result:	Failed
Current:	0.5
Power Factor:	0.1542514498876
Graph in report - LOG	
Status:	Done

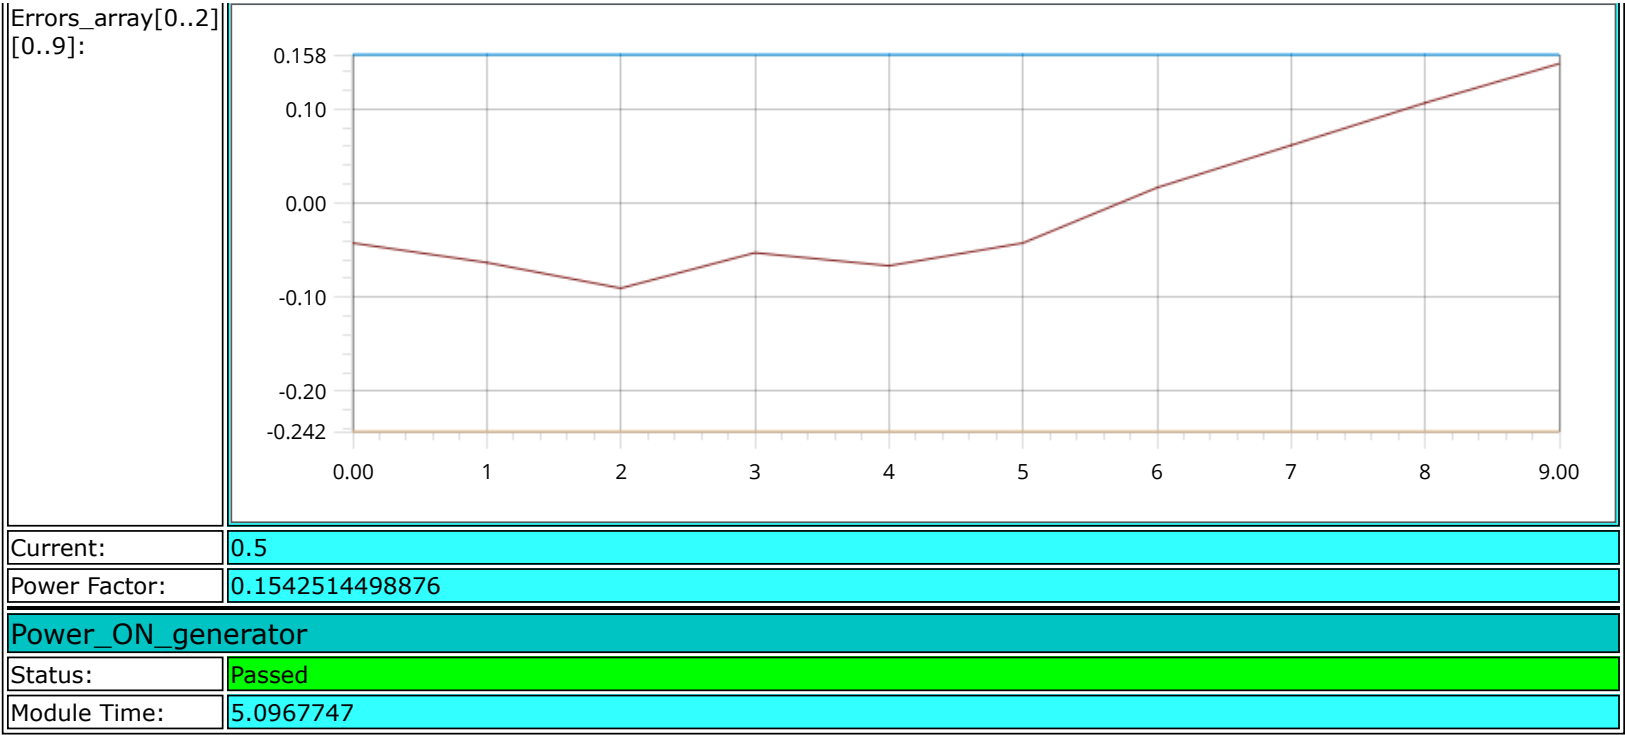

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.1056981

Omicron Accuracy	
Status:	Passed
Module Time:	31.5414768

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0889803

Omicron Accuracy	
Status:	Passed
Module Time:	31.5479824

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.1008661

Omicron Accuracy	
------------------	--

Status:	Passed
Module Time:	31.565583

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0906025

Omicron Accuracy	
Status:	Passed
Module Time:	31.6578753

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0939522

Omicron Accuracy	
Status:	Passed
Module Time:	31.6296551

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.092416

Omicron Accuracy	
Status:	Passed
Module Time:	31.5724306

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0987019

Omicron Accuracy	
Status:	Passed
Module Time:	31.6119957

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0881822

Omicron Accuracy	
Status:	Passed
Module Time:	31.5721206

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.1003485

Omicron Accuracy	
Status:	Passed
Module Time:	31.676579

End Sequence: Energy_Accuracy


Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0907649

Omicron Accuracy	
Status:	Passed
Module Time:	31.5715394

End Sequence: Energy_Accuracy

Test Result	
Status:	Done
Repeatability cycle result:	Passed
Current:	1
Power Factor:	1
Graph in report - LOG	
Status:	Done
Errors_array[0..2][0..9]:	

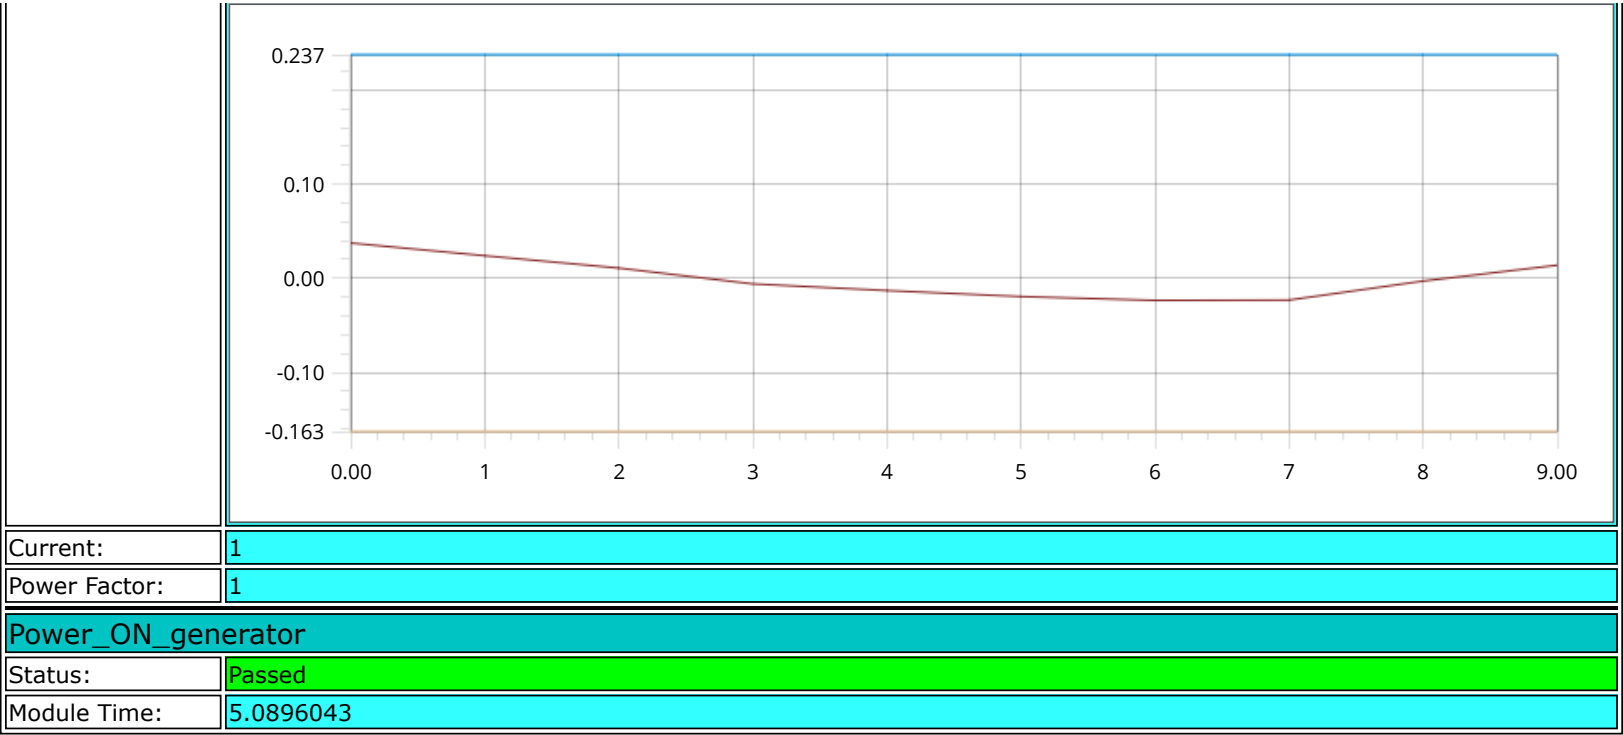

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0917699

Omicron Accuracy	
Status:	Passed
Module Time:	31.5761746

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.089492

Omicron Accuracy	
Status:	Passed
Module Time:	31.6211556

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.101506

Omicron Accuracy	
------------------	--

Status:	Passed
Module Time:	31.5400291

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.1020618

Omicron Accuracy	
Status:	Passed
Module Time:	32.5729015

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0935724

Omicron Accuracy	
Status:	Passed
Module Time:	32.6822112

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.1203304

Omicron Accuracy	
Status:	Passed
Module Time:	31.5703361

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0918212

Omicron Accuracy	
Status:	Passed

Module Time:	31.6133983
--------------	------------

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0917959

Omicron Accuracy	
Status:	Passed
Module Time:	31.6069264

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0959641

Omicron Accuracy	
Status:	Passed
Module Time:	31.5482824

End Sequence: Energy_Accuracy


Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0914526

Omicron Accuracy	
Status:	Passed
Module Time:	31.6408635

End Sequence: Energy_Accuracy

Test Result	
Status:	Done
Repeatability cycle result:	Failed
Current:	1
Power Factor:	-0.9524129804152
Graph in report - LOG	
Status:	Done
Errors_array[0..2][0..9]:	

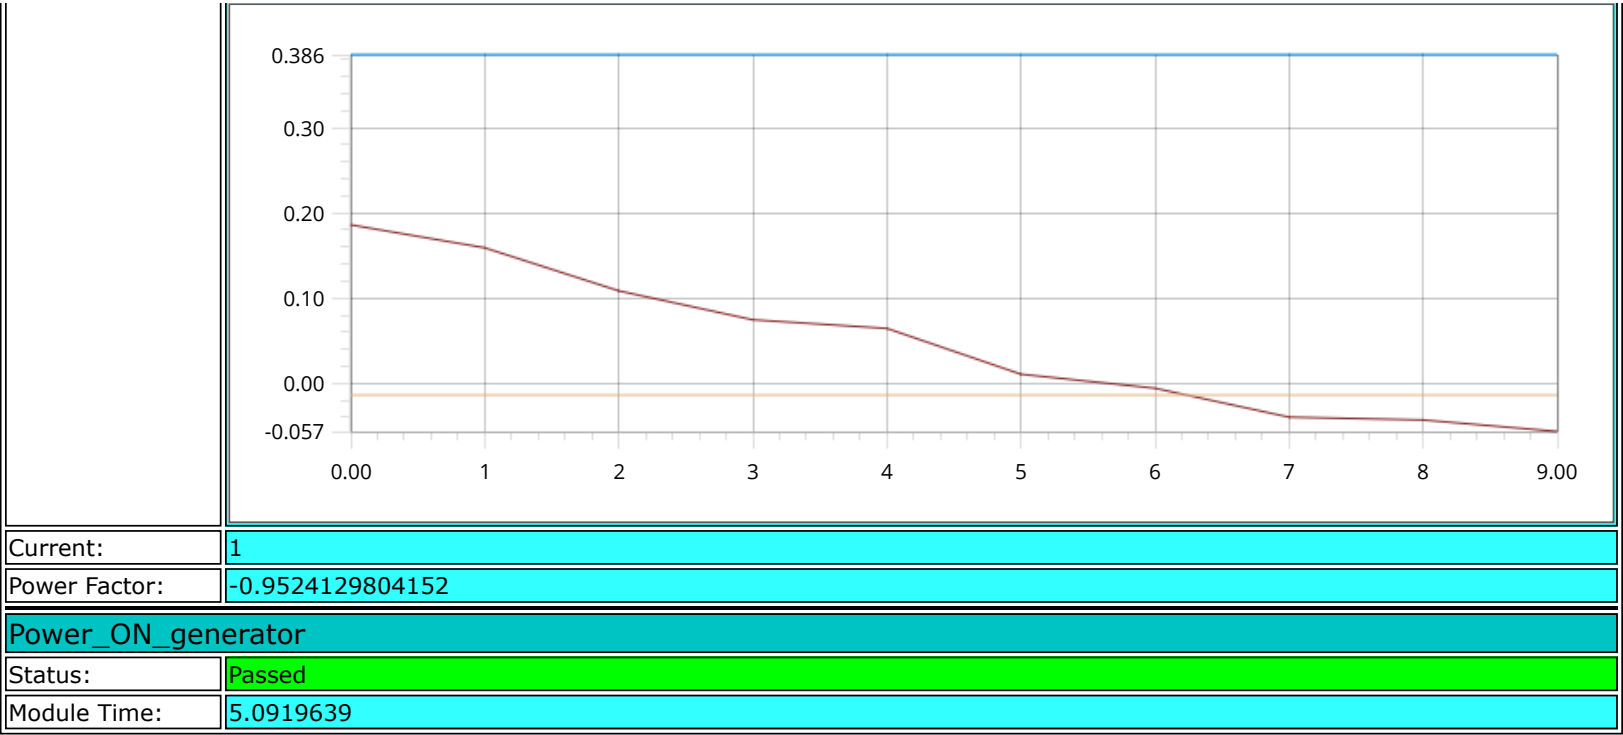

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0944382

Omicron Accuracy	
Status:	Passed
Module Time:	32.5804518

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.1040504

Omicron Accuracy	
Status:	Passed
Module Time:	31.5507081

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.10471

Omicron Accuracy	
------------------	--

Status:	Passed
Module Time:	31.6337506

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0988448

Omicron Accuracy	
Status:	Passed
Module Time:	32.5940257

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.1064374

Omicron Accuracy	
Status:	Passed
Module Time:	31.5453274

End Sequence: Energy_Accuracy

Begin Sequence: Energy_Accuracy
(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\Utilities\CommonUtilitySequencesEqRed.seq)

Power ON	
Status:	Passed
Module Time:	5.0913712

Omicron Accuracy	
Status:	Passed
Module Time:	31.6153299

End Sequence: Energy_Accuracy

End Sequence: MainSequence

End UUT Report
