

UUT Report

Station ID:

Serial Number:

Date:

Time:

Operator:

Execution Time:

Number of Results:

UUT Result:

Serial Number:

Type Designator:

FW Version:

Power Supply:

IT-W-7303101

NONE

giovedì 8 giugno 2023

09:45:41

administrator

1389.258977 seconds

6436

Failed

"

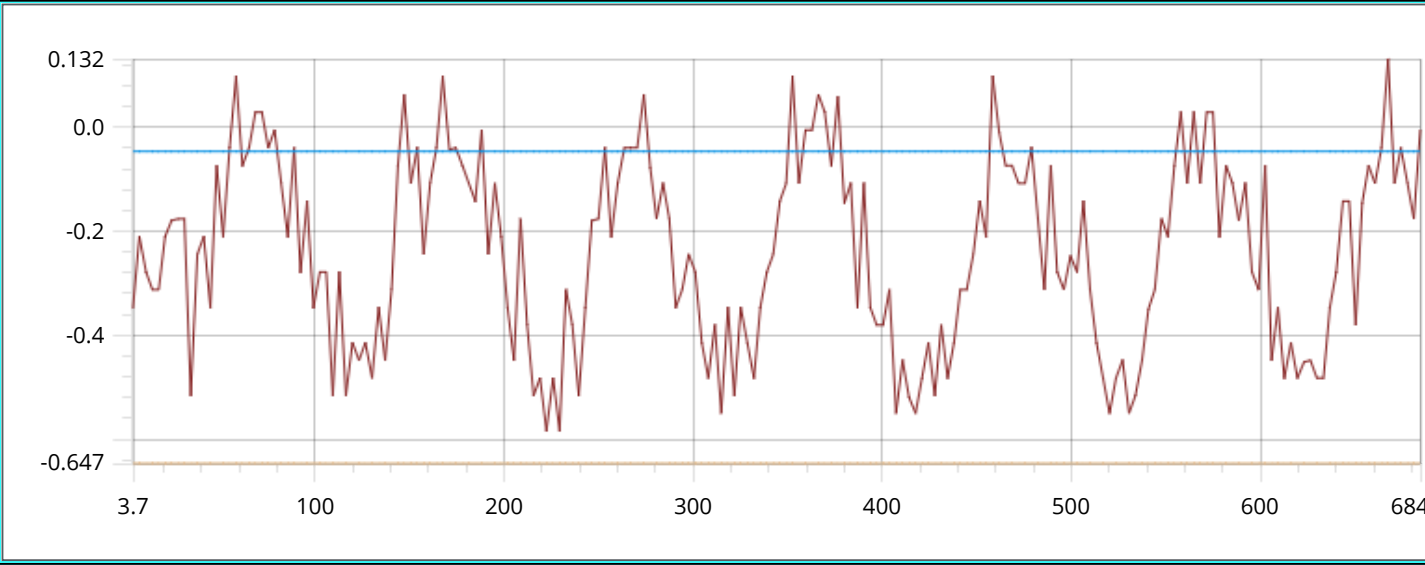
B1-D3MB-111A

0.16.1

Omicron

Begin Sequence: MainSequence  
(C:\Users\itlavit1\OneDrive - ABB\LabRnD\_Shared\TestStand\Sequences\EQ Meter\New Sequences\Repeatability\_new.seq)

DUT info	
Status:	Done
Serial Number:	"
Type Designator:	B1-D3MB-111A
FW Version:	0.16.1

Test Result	
Status:	Done
Repeatability cycle result:	Failed
Current:	0.25
Power Factor:	6.123233995737e-17
Graph in report - LOG	
Status:	Done
Accuracy[0..3] [0..199]:	<div></div>
Current:	0.25
Power Factor:	6.123233995737e-17
Max difference	

Status:	Done
MAX Difference:	0.7154932136365
Minimum value:	-0.5839215204743
Maximum value:	0.1315716931623
Test Result	
Status:	Done
Repeatability cycle result:	Failed
Current:	1
Power Factor:	6.123233995737e-17
Graph in report - LOG	
Status:	Done
Accuracy[0..3] [0..199]:	
Current:	1
Power Factor:	6.123233995737e-17
Max difference	
Status:	Done
MAX Difference:	0.2384964501355
Minimum value:	-0.1707605411796
Maximum value:	0.06773590895591

End Sequence: MainSequence

End UUT Report

---