UUT Report

Station ID: IT-W-7303101

Serial Number: NONE

Date: mercoledì 7 giugno 2023

Time: 15:57:44

Operator: administrator

Execution Time: 1463.7474738 seconds

Number of Results: 19262 UUT Result: Passed

Serial Number: "


Type Designator: B1-D3MB-111A


FW Version: 0.16.1 Power Supply: Omicron

Begin Sequence: MainSequence

(C:\Users\itlavit1\OneDrive - ABB\LabRnD_Shared\TestStand\Sequences\EQ Meter\New Sequences\Realtime_sampling.seq)

DUT info				
Status:	Done			
Serial Number:	II .			
Type Designator:	B1-D3MB-111A			
FW Version:	0.16.1			

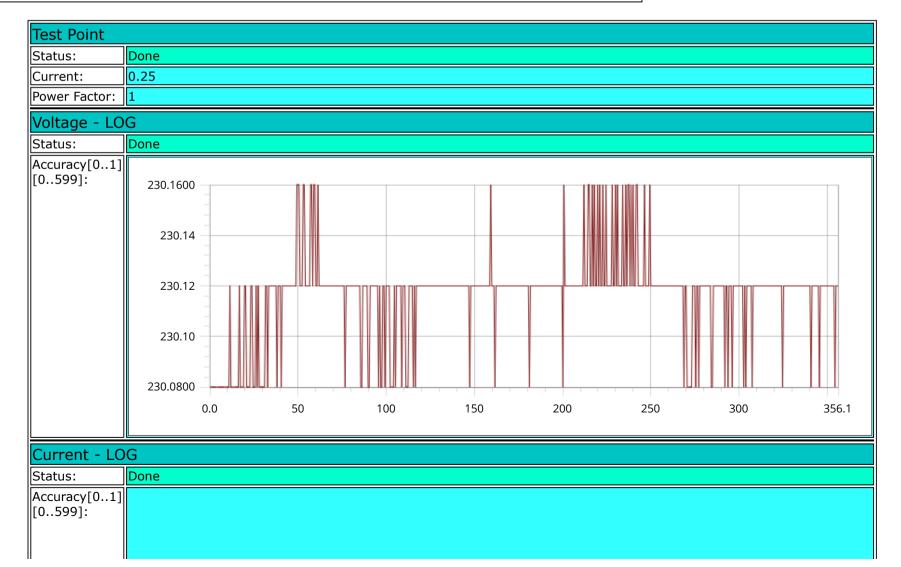

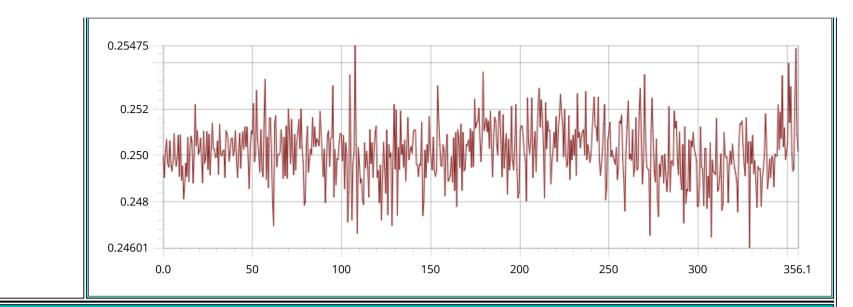

Active power - LOG

Done Status: Accuracy[0..1] [0..599]: 58.207 58.0 57.8 57.6 57.373 0.0 50 100 150 200 250 300 356.1

Test Point

Status: Done


Current: 1

Power Factor:


Voltage - LOG


Status: Do


Accuracy[0..1] [0..599]:

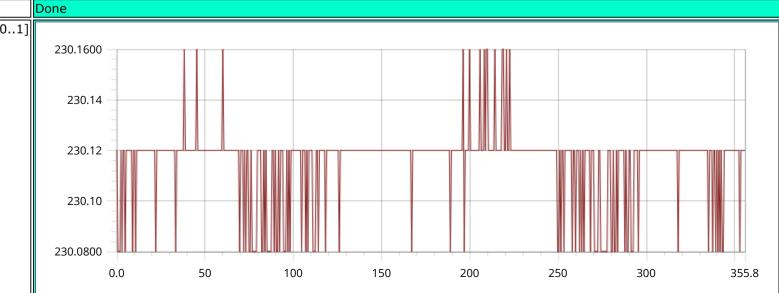

Current - LOG

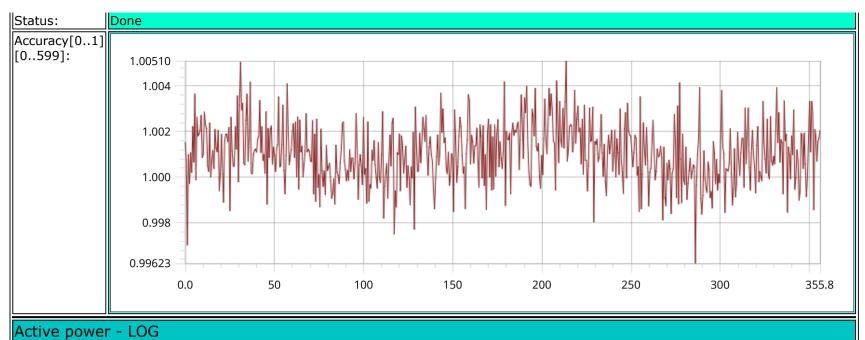

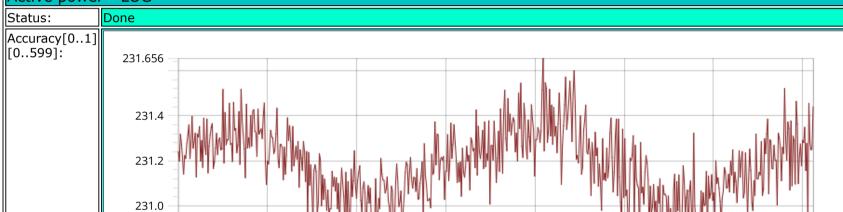






355.8

230.758

0.0

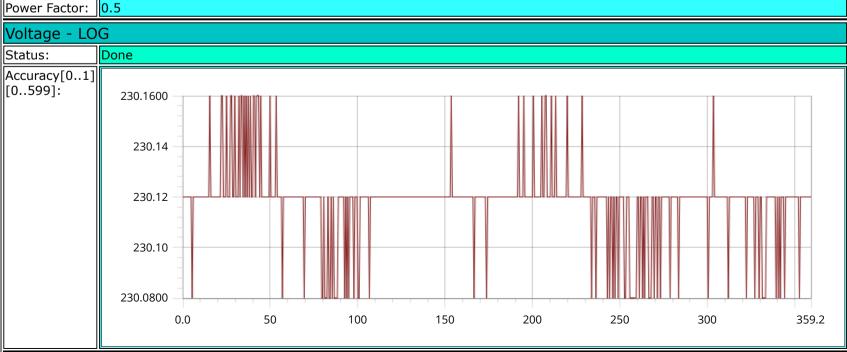

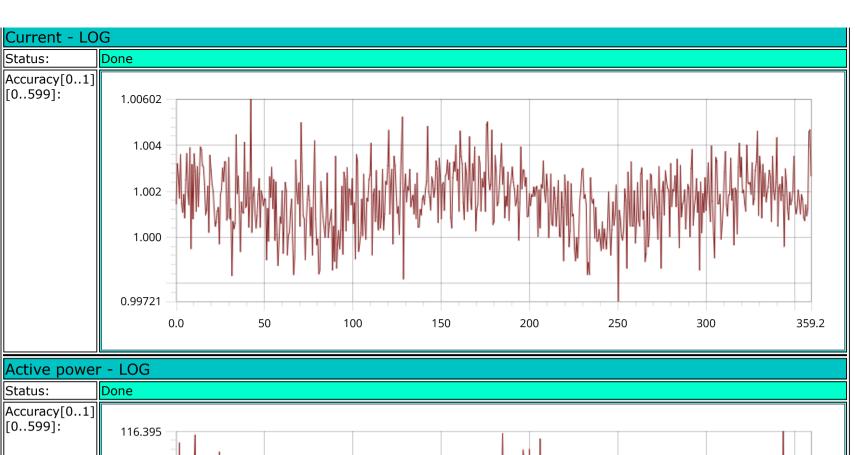

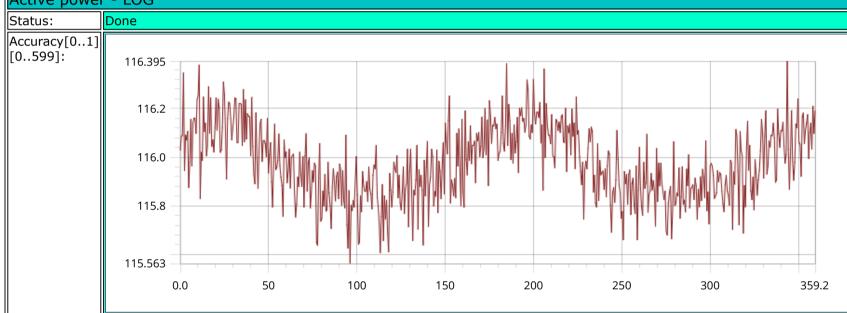


lest Point			
Status:	Done		
Current:	1		
Power Factor:	0.7986355100473		

Voltage - LOG

Status: Done

Accuracy[0..1] [0..599]:

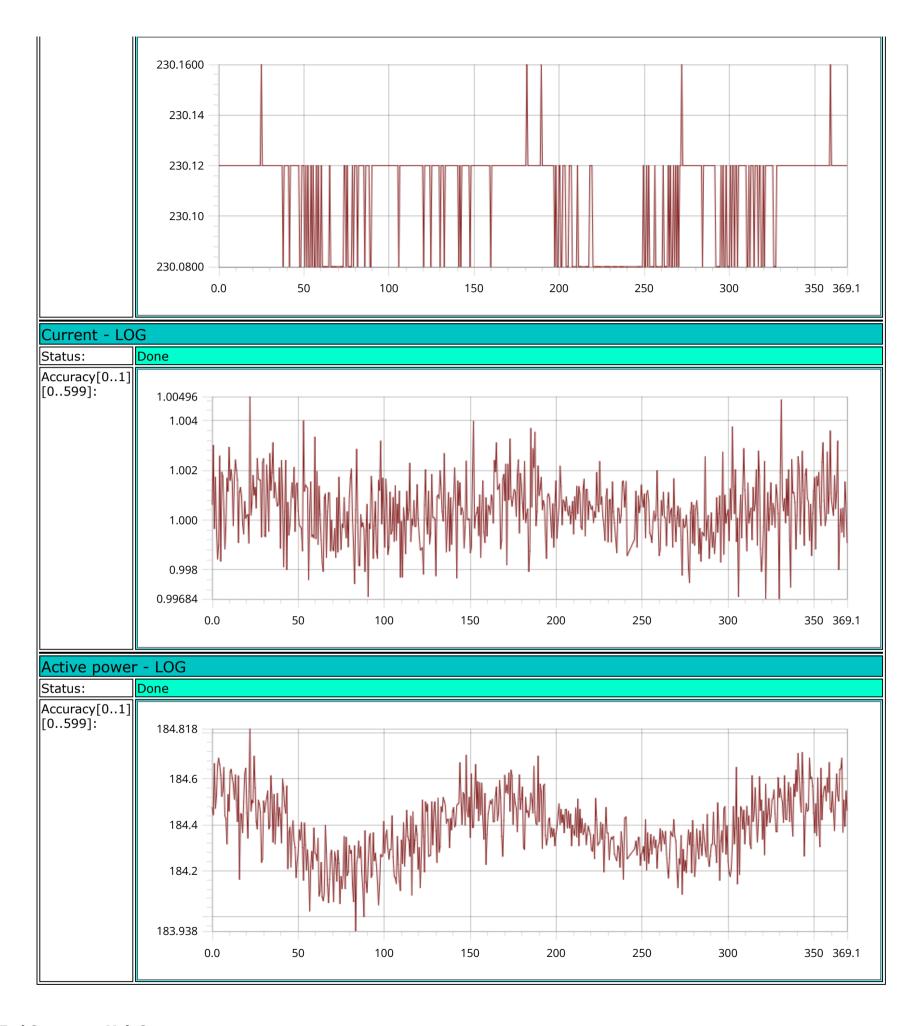

End Sequence: MainSequence