


NOTES:
1. DO NOT SCALE THE DRAWING.
2. ALL DIMENSIONS ARE IN METER.
3. ALL MEASUREMENTS ARE TO BE CHECKED AND VERIFIED ON THE SITE.
4. ANY DISCREPANCIES IN DRAWINGS MUST BE CLARIFIED WITH THE CONSULTANT PRIOR TO EXECUTION.

LEGEND:-

-  TERRACE BOOSTER PUMP 900 LPM
-  100Ø FIRE DOWNCOMER
-  BALL VALVE
-  FIRST AID HOSE REEL WITH DRUM
-  2WAY FIRE BRIGADE
-  FA CABLE-2C X 1.5 SM
-  HOOTER / MANUAL CALL POINT
-  FIRE ALARM CONTROL PANEL
-  BFV- BUTTERFLY VALVE
-  G.I. PIPE
-  FIRE PUMP PANEL
-  Co2 TYPE FIRE EXTINGUISHER (4.5 KG)
-  ABC TYPE FIRE EXTINGUISHER (6 KG)

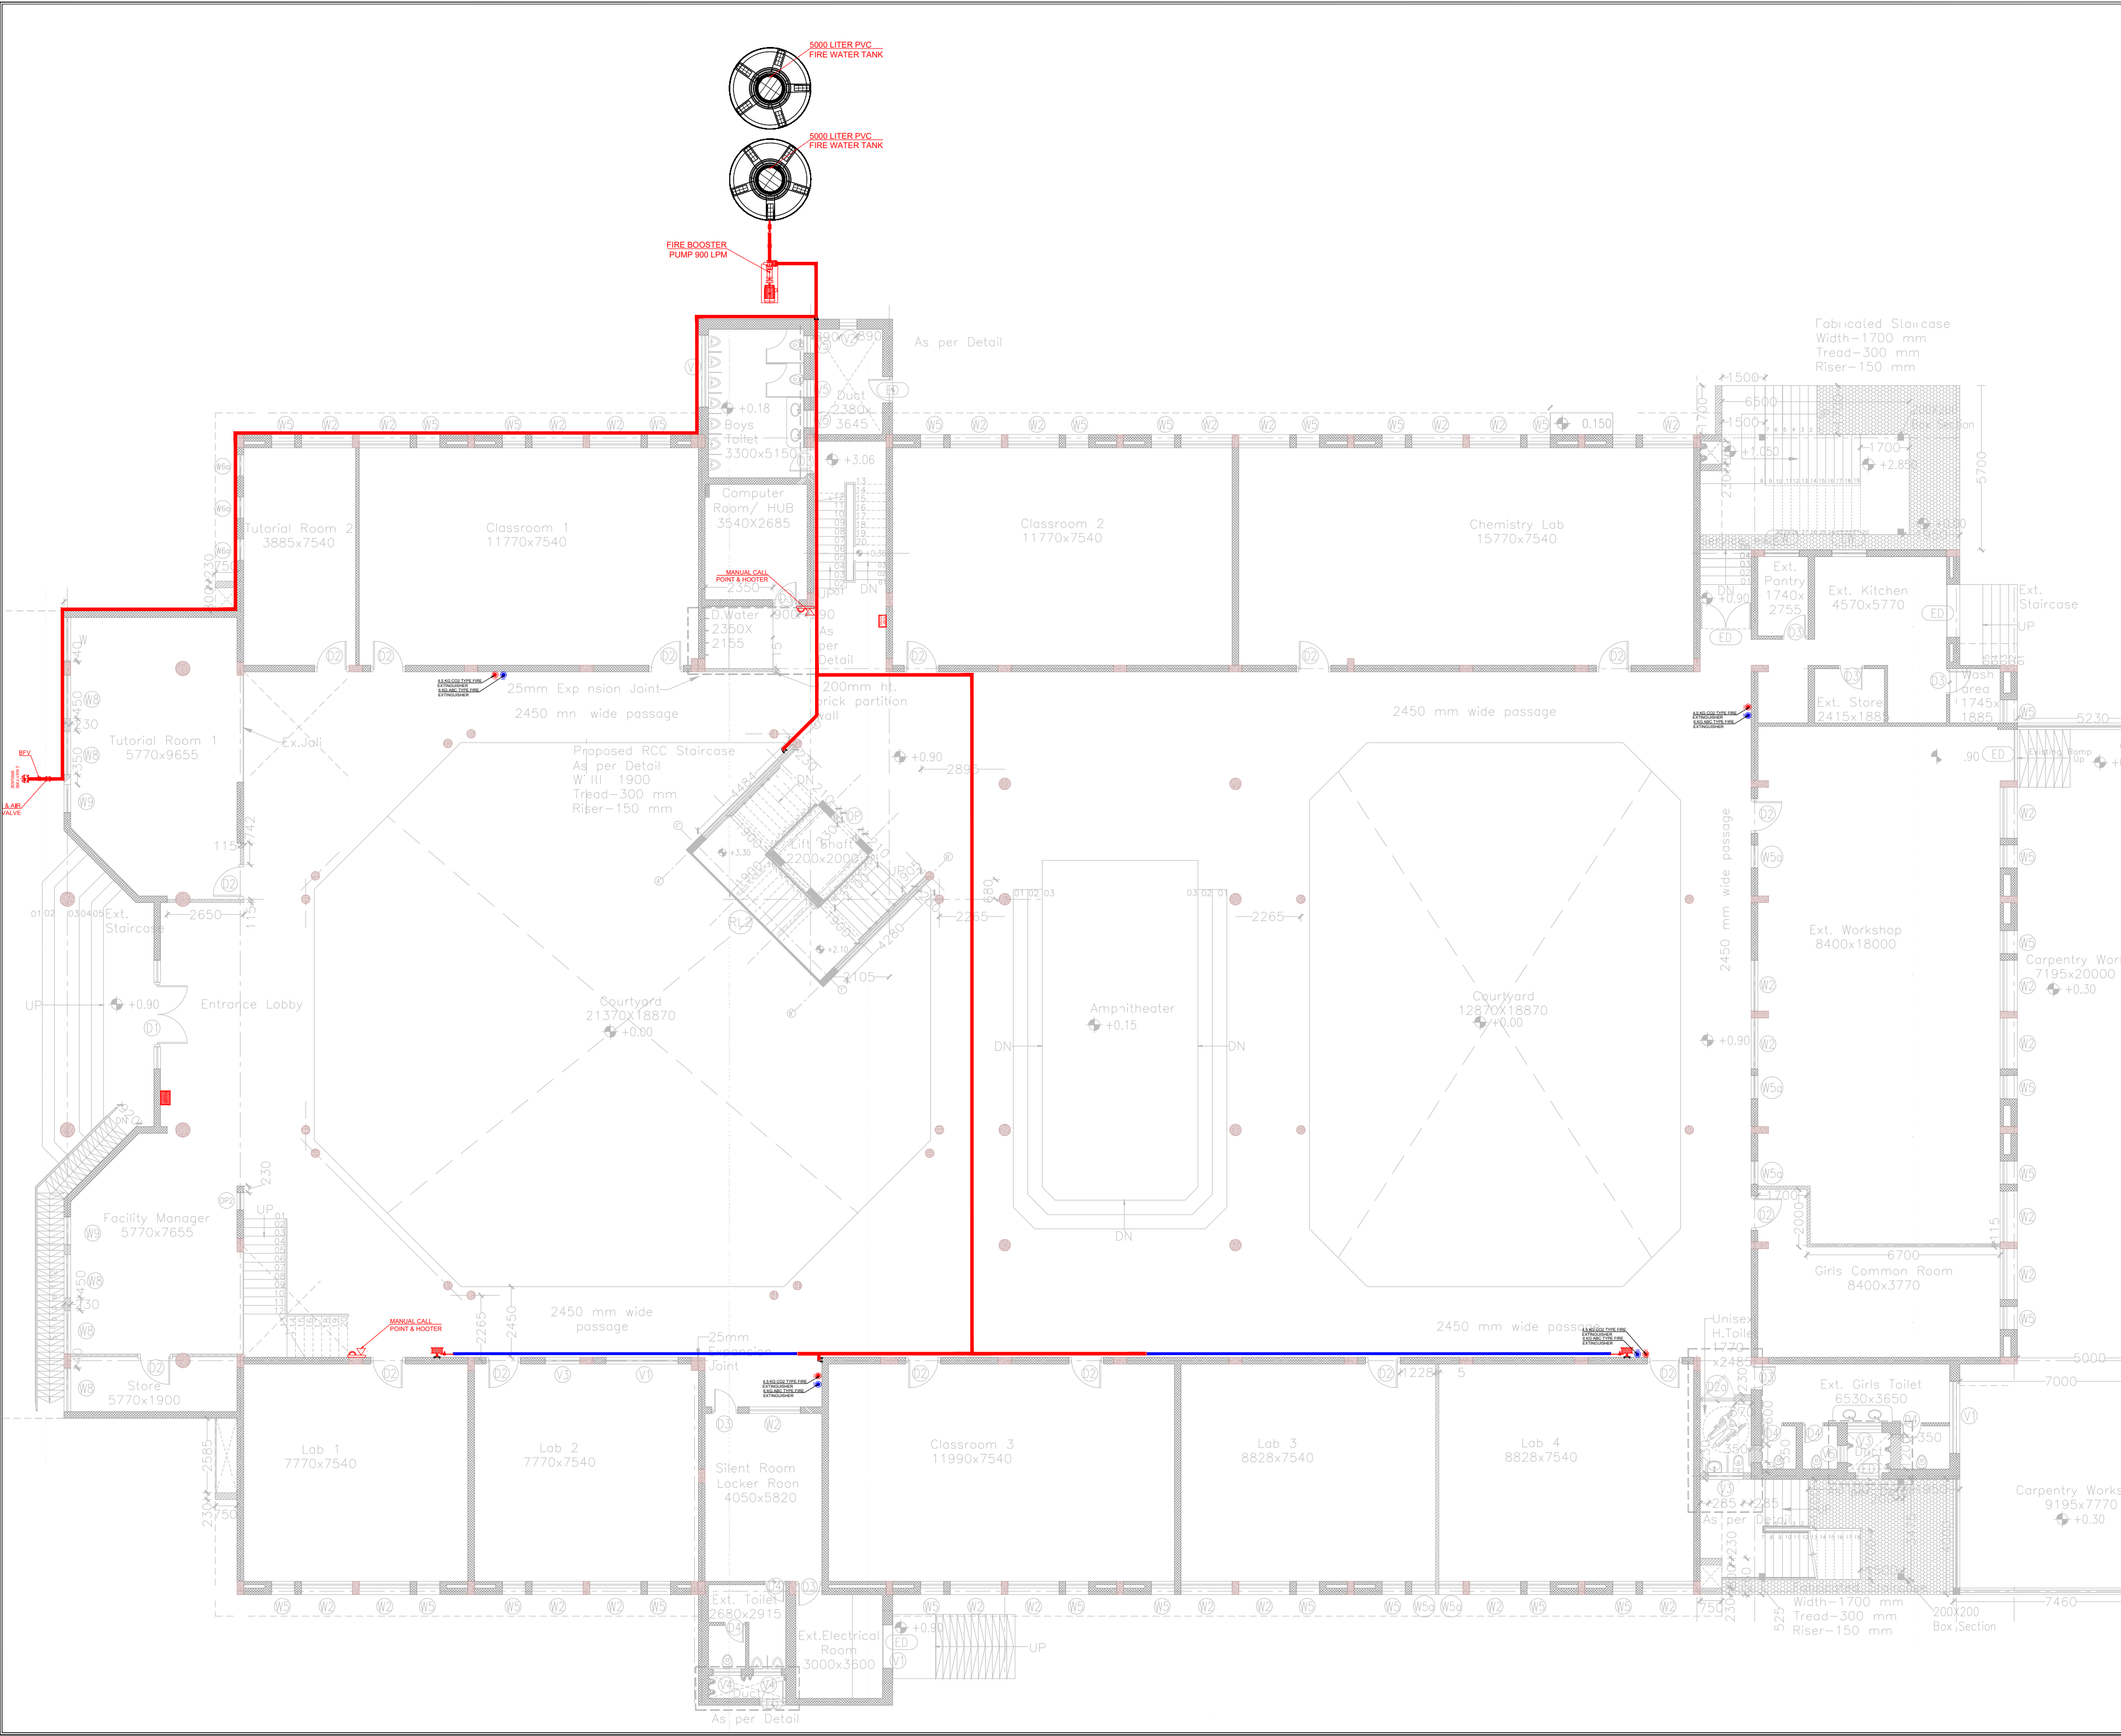

CLIENT:-
GSFC LTD BARODA

PROJECT ARCHITECT:-

VIJAY MATAI & ASSOCIATES

B-5 BOMBAY SHOPPING CENTRE R. C. DUTT ROAD, ALKAPURI,
VADODARA-390005. Ph : (0265) 2344785

CONSULTANT:




REGD. OFFICE
52, MANGALJYOT SOCIETY NR. JYOTI PARK
SOCIETY KARELBAUG VADODARA-18
HEAD OFFICE
219-C, 2ND FLOOR LOTUS AURA 2, BESIDES
IOCL PETROL PUMP, SAMI SAVLI ROAD,
VADODARA
CONTACT: +91 9898024352
EMAIL: aequintegratedsolutions@gmail.com

DRAWING TITLE:-
STUDENT HOSTEL
GROUND FLOOR
FIRE SAFETY & ALARM SYSTEM LAYOUT

DRAWING NO:-
AIS_GSFC_FF_01

SHEET NO:-
SHEET-1 OF 3

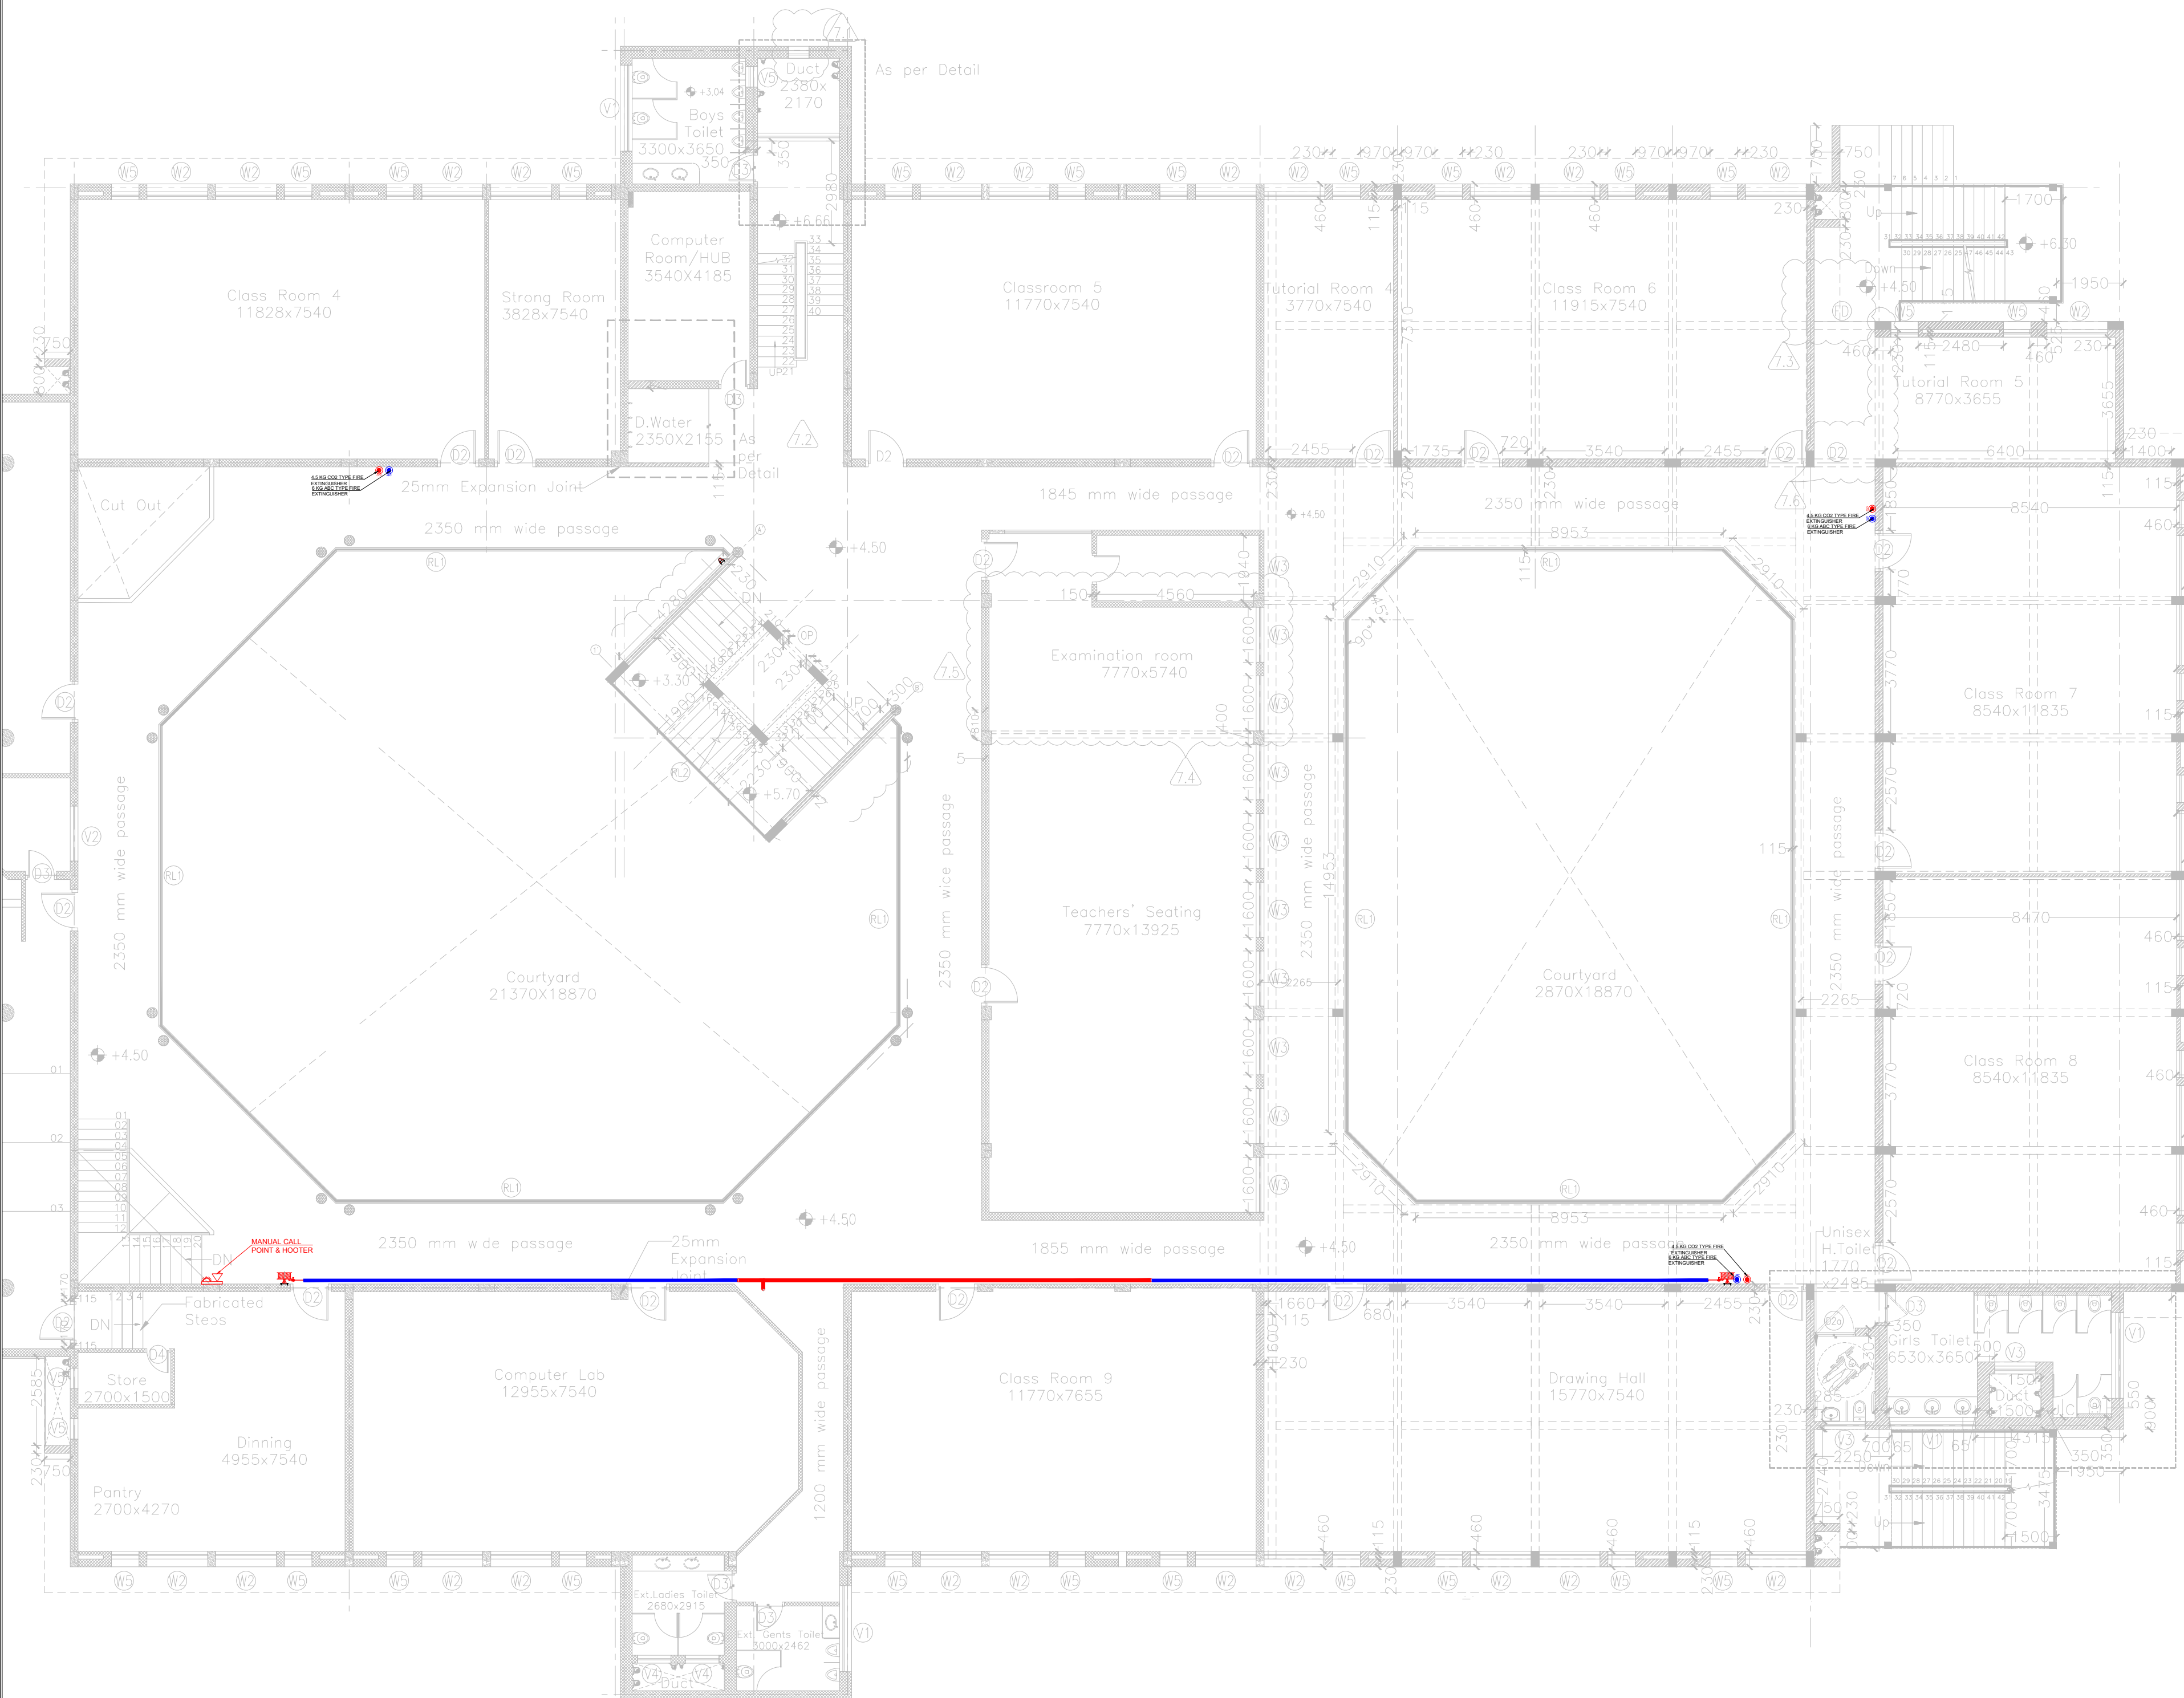

NOTES:

1. DO NOT SCALE THE DRAWING.
2. ALL DIMENSIONS ARE IN METER.
3. ALL MEASUREMENTS ARE TO BE CHECKED AND VERIFIED ON THE SITE.
4. ANY DISCREPANCIES IN DRAWINGS MUST BE CLARIFIED WITH THE CONSULTANT PRIOR TO EXECUTION.

LEGEND:-

	TERRACE BOOSTER PUMP 900 LPM
	100Ø FIRE DOWNCOMER
	BALL VALVE
	FIRST AID HOSE REEL WITH DRUM
	2WAY FIRE BRIGADE
	FA CABLE-2C X 1.5 SM
	HOOTER / MANUAL CALL POINT
	FIRE ALARM CONTROL PANEL
	BFV- BUTTERFLY VALVE
	C.I. PIPE
	FIRE PUMP PANEL
	Co2 TYPE FIRE EXTINGUISHER (4.5 KG)
	ABC TYPE FIRE EXTINGUISHER (6 KG)

CLIENT:-

GSFC LTD BARODA

PROJECT ARCHITECT:-

VIJAY MATAI & ASSOCIATES

B-5 BOMBAY SHOPPING CENTRE R. C. DUTT ROAD, ALKAPURI ,
VADODARA-390005. Ph : (0265) 2344785

CONSULTANT:

REGD. OFFICE
52, MANGALYOT SOCIETY NR. JYOTI PARK
SOCIETY KARELBAUG VADODARA-18
HEAD OFFICE
219-C, 2ND FLOOR LOTUS AURA 2, BESIDES
KOCL PETROL PUMP, SAMA SAVLI ROAD,
VADODARA
CONTACT: +91 9898024352
EMAIL: aquaintegratedsolutions@gmail.com

DRAWING TITLE:- STUDENT HOSTEL
FIRST FLOOR
FIRE SAFETY SYSTEM LAYOUT

DRAWING NO:-


AIS_GSFC_FF_02

SHEET NO:-

SHEET-2 OF 3

NORTH:-



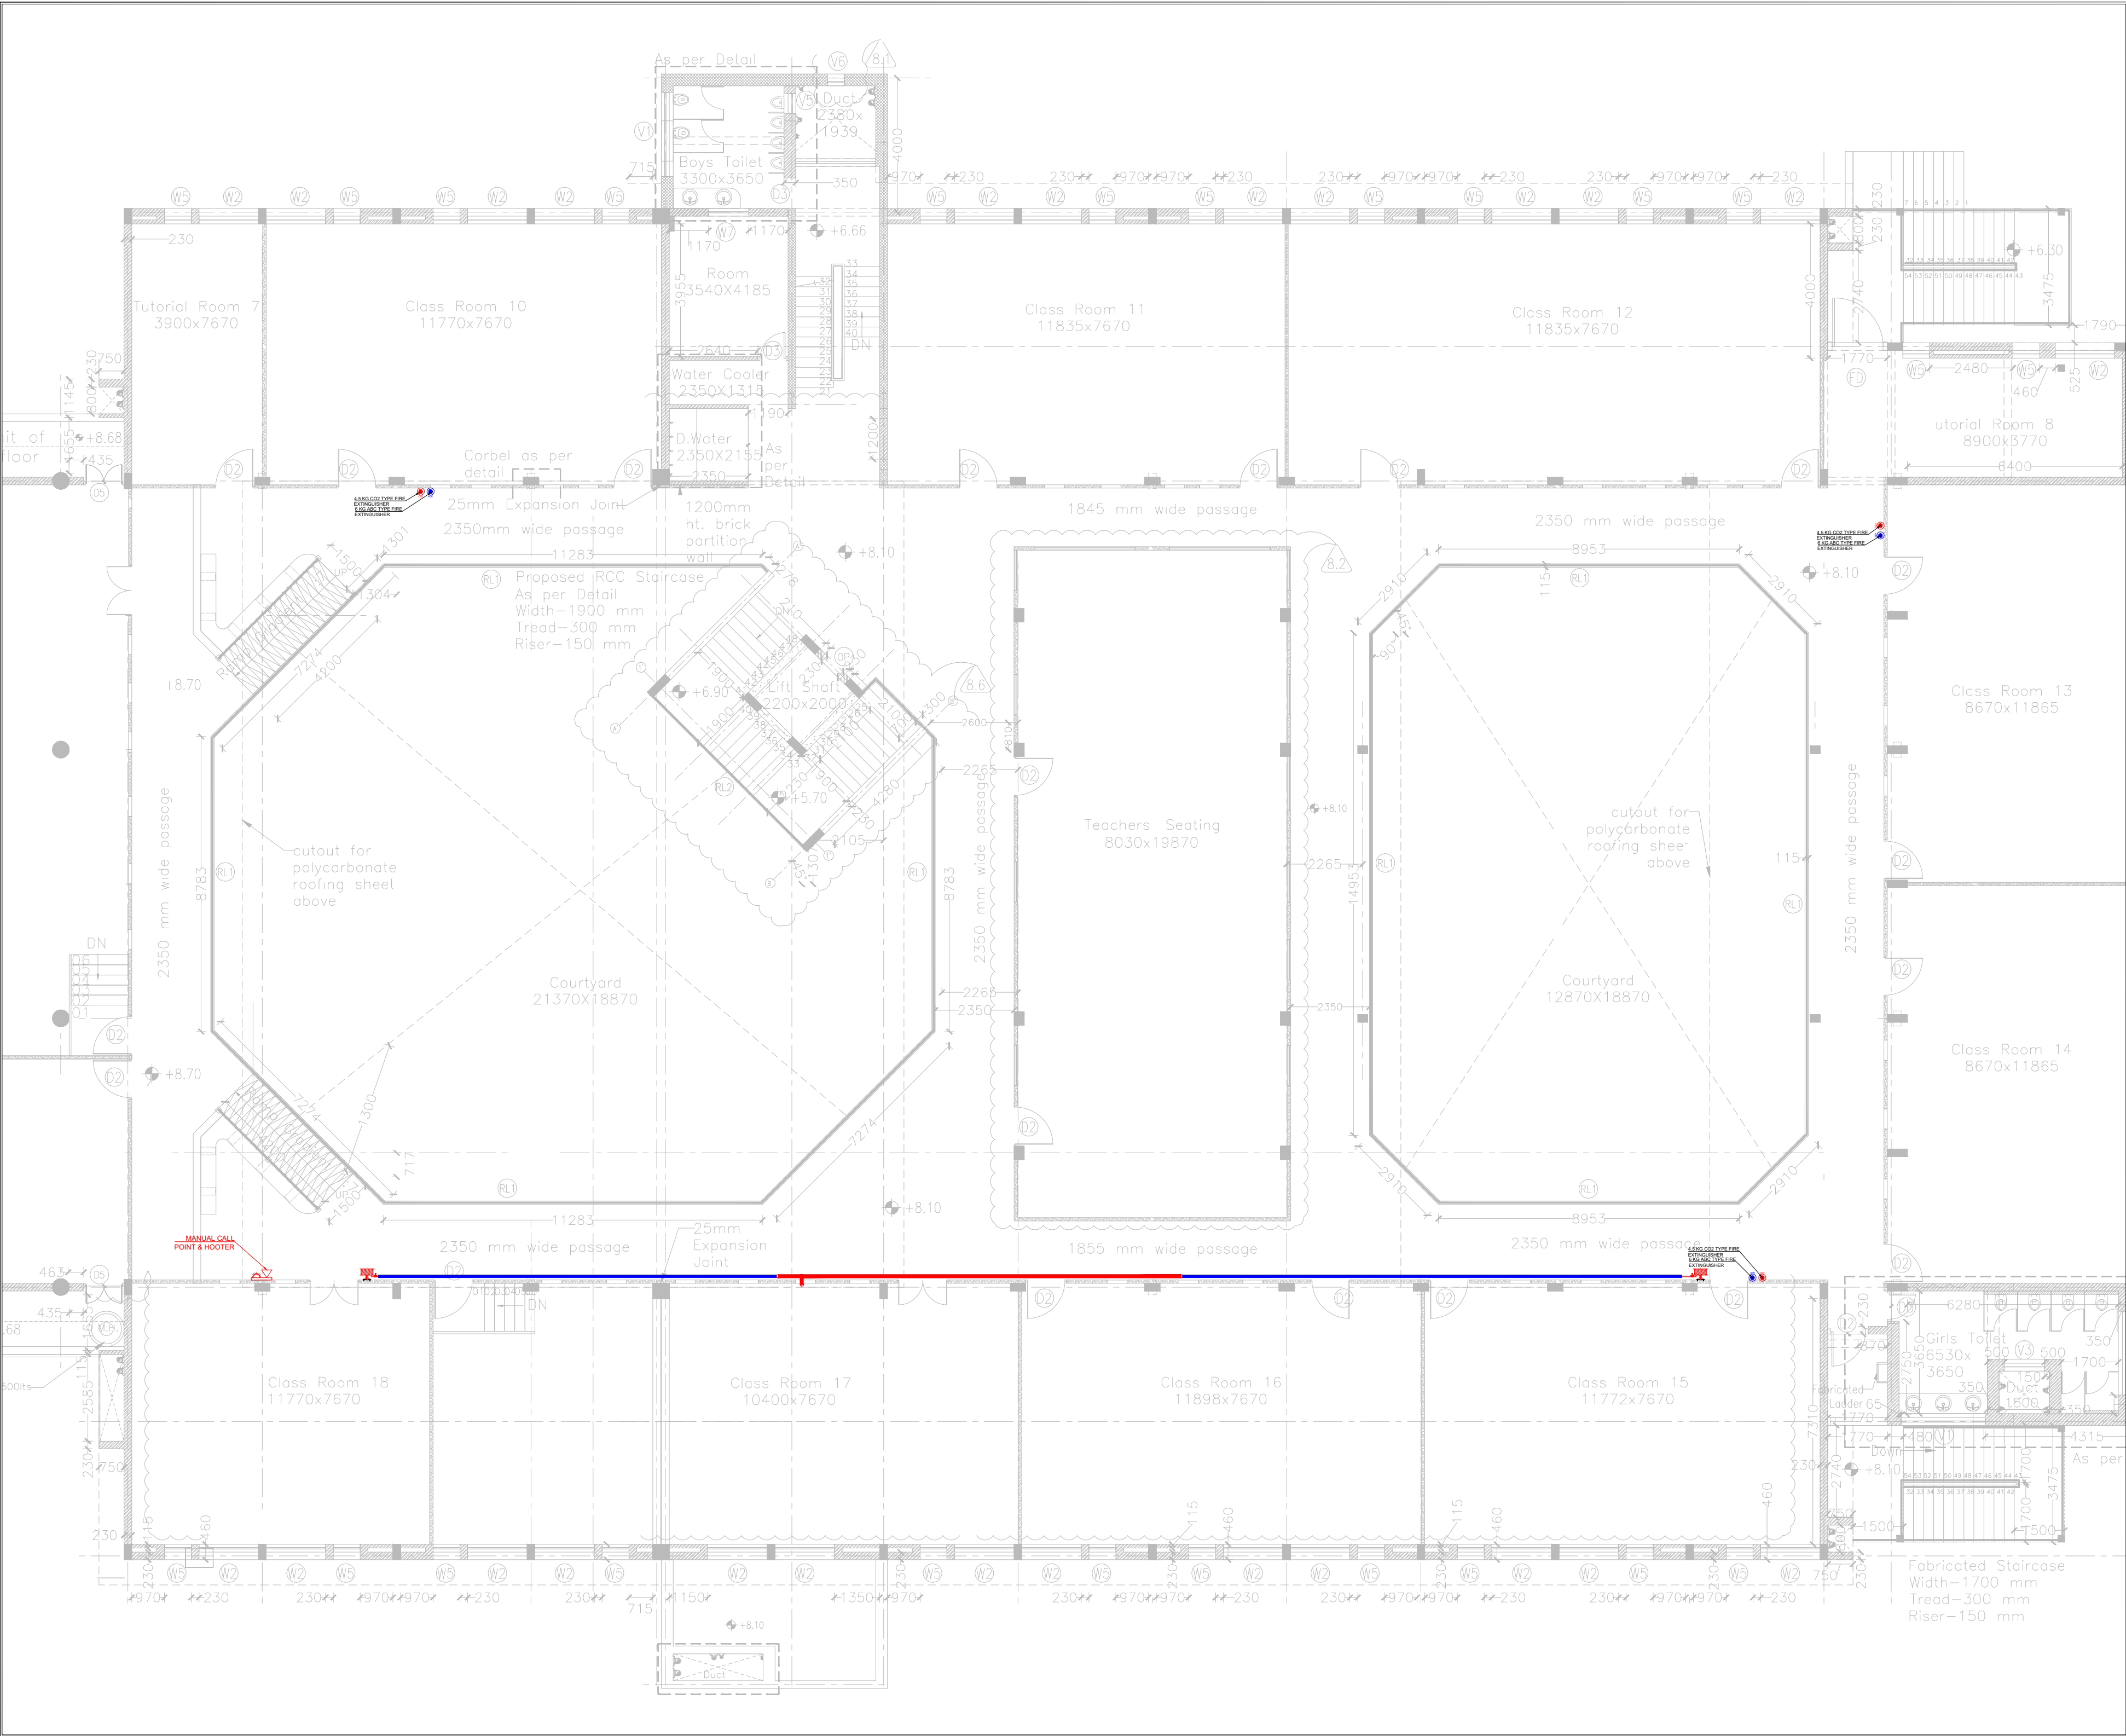

KEY PLAN

NOTES:
1. DO NOT SCALE THE DRAWING.
2. ALL DIMENSIONS ARE IN METER.
3. ALL MEASUREMENTS ARE TO BE CHECKED AND VERIFIED ON THE SITE.
4. ANY DISCREPANCIES IN DRAWINGS MUST BE CLARIFIED WITH THE CONSULTANT PRIOR TO EXECUTION.

LEGEND:-
TERRACE BOOSTER PUMP 900 LPM
100Ø FIRE DOWNCOMER
BALL VALVE
FIRST AID HOSE REEL WITH DRUM
2WAY FIRE BRIGADE
FA CABLE-2C X 1.5 SM
HOOTER / MANUAL CALL POINT
FIRE ALARM CONTROL PANEL
BFV- BUTTERFLY VALVE
G.I. PIPE
FIRE PUMP PANEL
Co2 TYPE FIRE EXTINGUISHER (4.5 KG)
ABC TYPE FIRE EXTINGUISHER (6 KG)

CLIENT:-
GSFC LTD BARODA

PROJECT ARCHITECT:-
VIJAY MATAI & ASSOCIATES
B-5 BOMBAY SHOPPING CENTRE R. C. DUTT ROAD, ALKAPURI ,
VADODARA-390005. Ph : (0265) 2344785

CONSULTANT:
REGD. OFFICE
52, MANGALYOT SOCIETY NR. JYOTI PARK
SOCIETY KARELIBAUG VADODARA-18
HEAD OFFICE
219-C, 2ND FLOOR LOTUS AURA 2, BESIDES
KOCL PETROL PUMP, SAMA SAVLI ROAD,
VADODARA
CONTACT: +91 9898024352
EMAIL: aequintegratedsolutions@gmail.com

DRAWING TITLE:-
STUDENT HOSTEL
SECOND FLOOR
FIRE SAFETY SYSTEM LAYOUT

DRAWING NO:-
AIS_GSFC_FF_03

SHEET NO:-
SHEET-3 OF 3

NORTH:-
N