
Interior local minimizers: n = 100 to 1000

Gaussian samples; M = 1000 per n; local minima restricted to (0.01, 2)

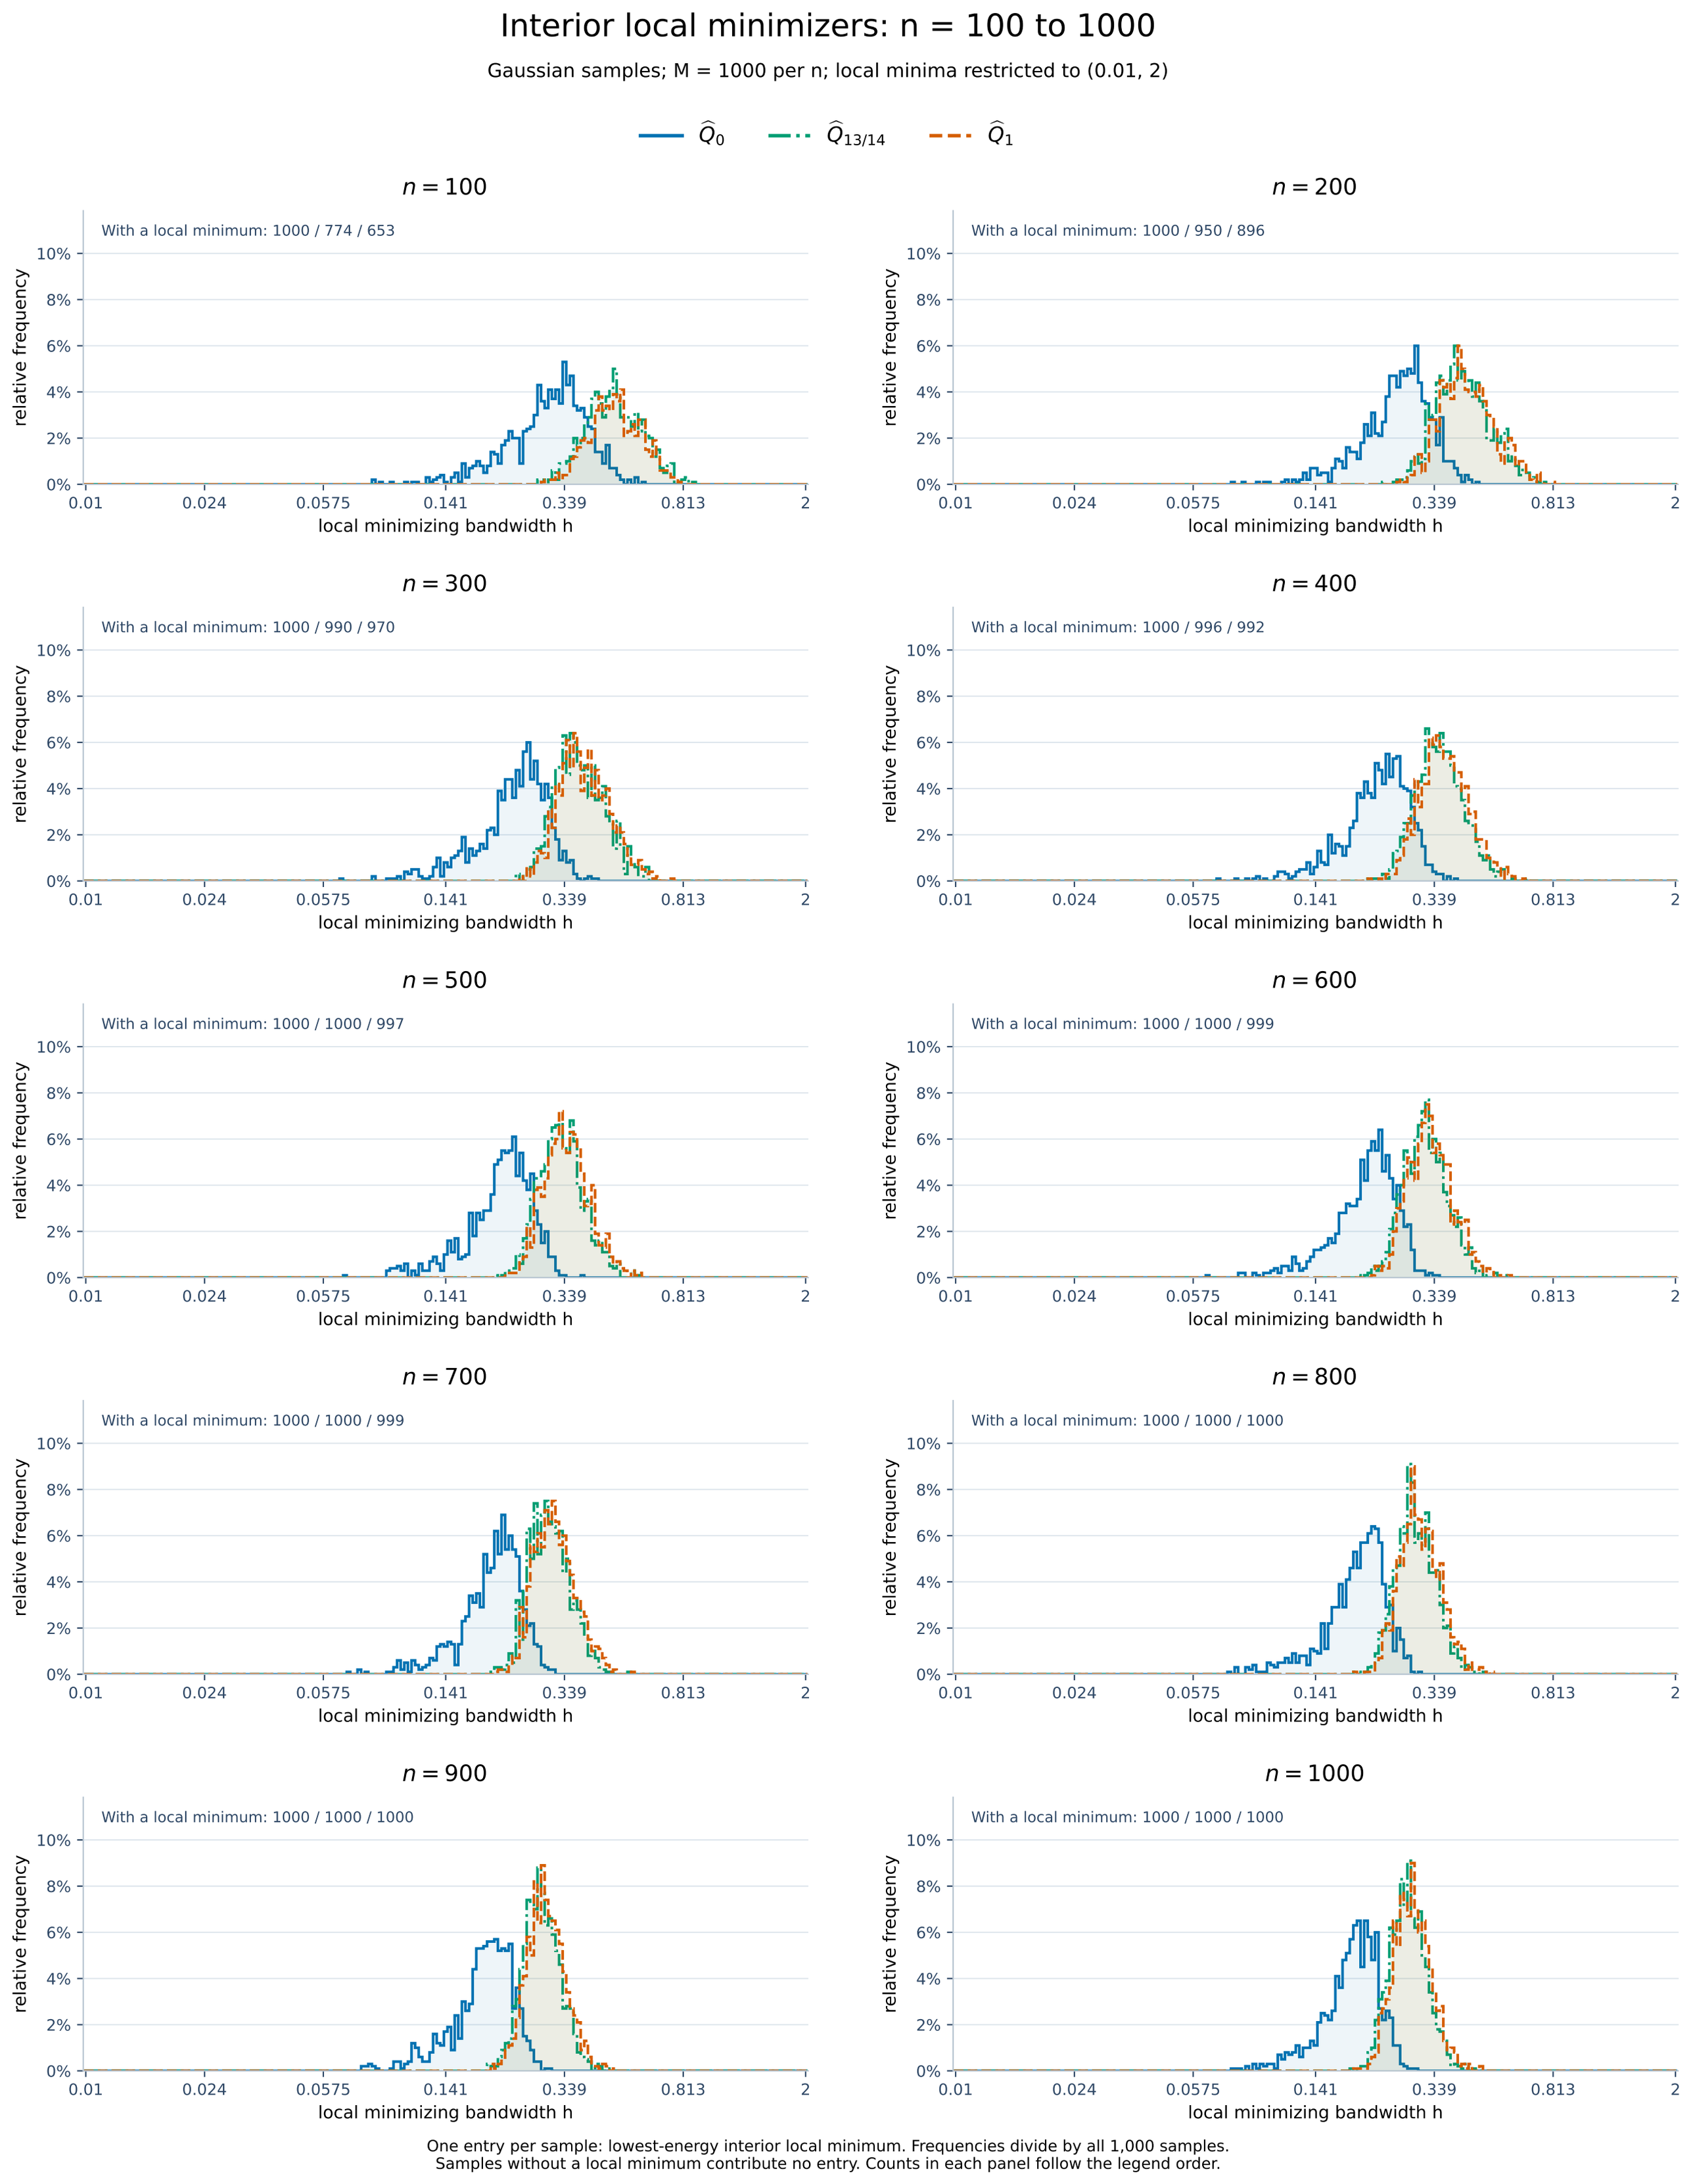

One entry per sample: lowest-energy interior local minimum. Frequencies divide by all 1,000 samples.
Samples without a local minimum contribute no entry. Counts in each panel follow the legend order.