


A Construction pipeline: PMC Open Access full text to a licence-stamped release



B Representative quality-control rejections

Extracted text as harvested

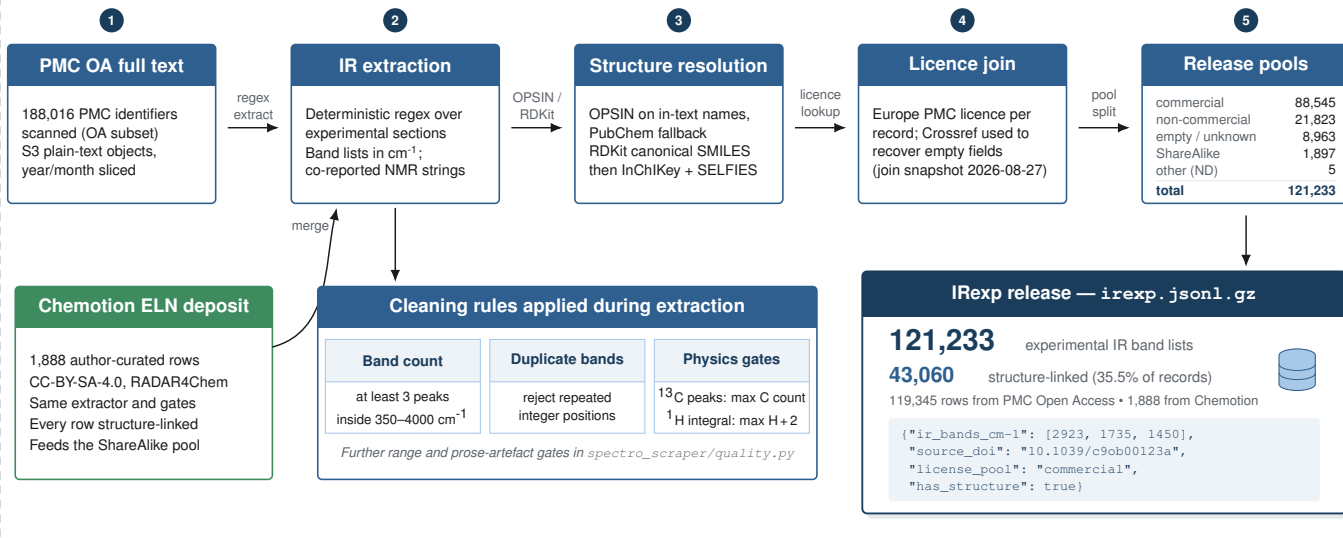

IR (KBr): 1735, 1602 cm^{-1}
 ^1H NMR (400 MHz, CDCl_3): 7.25 (2H, d), 6.80 (2H, d)



IR (neat): 3200, 2950, 4100, 1680, 1520 cm^{-1}
 ^{13}C NMR: 171.2, 133.5, 128.1, 115.4



IR (film): 3050, 2920, 1650, 1450 cm^{-1}
 ^1H NMR: 8.10 (5H), 7.45 (5H), 6.20 (10H)
Formula $\text{C}_6\text{H}_5\text{NO}_2$ (5 H)

Gate that fired

Band-count gate

Two bands inside $350\text{--}4000\text{ cm}^{-1}$; the extractor requires at least three.
Record dropped before structure resolution.

Wavenumber window

4100 cm^{-1} sits outside the $350\text{--}4000\text{ cm}^{-1}$ window — a scan-range artefact.
Record dropped; no curve digitisation is attempted.

Structure physics

Integrals sum to 20 H, above the formula limit of H + 2 for $\text{C}_6\text{H}_5\text{NO}_2$ (5 H).
Listed in the diagnostic quarantine file; release files unchanged.