

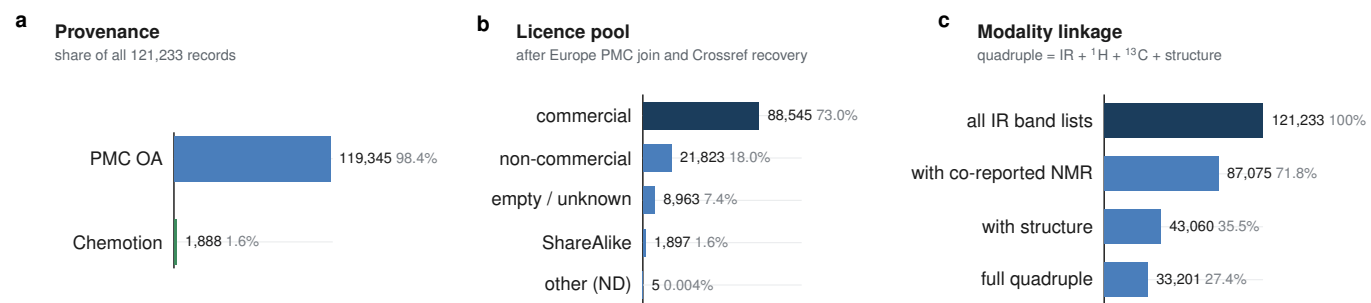


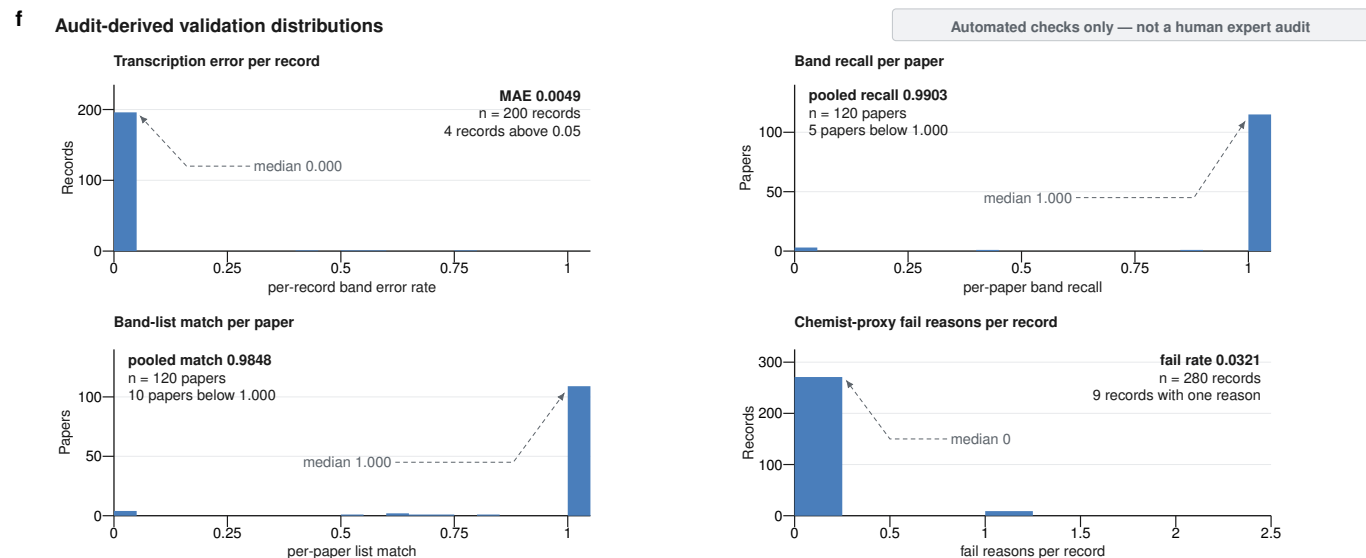

Panels a–c share one field width, so bar lengths are directly comparable across the three panels.

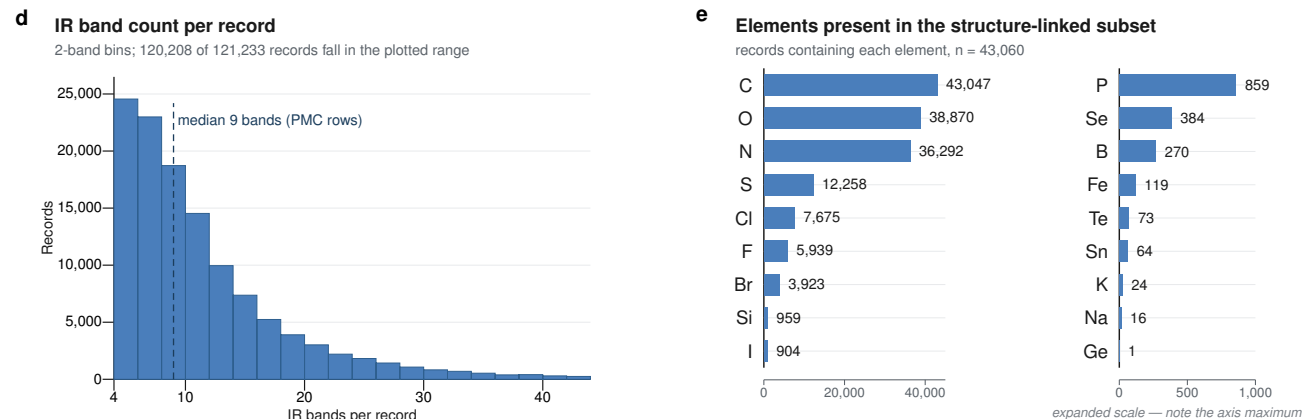

Panel f: dashed elbows mark the median of each distribution; pooled aggregate rates are printed inside each sub-panel.

All panel-f checks are automated — no human expert audit was performed. Records are IR *band lists* (cm^{-1} peak positions), not absorbance traces.