



Stage-6 Kill-Gate 3 -- collapse robustness under noisy / imperfect WM (perturbation sweep)


(a) Severity -- WM accuracy

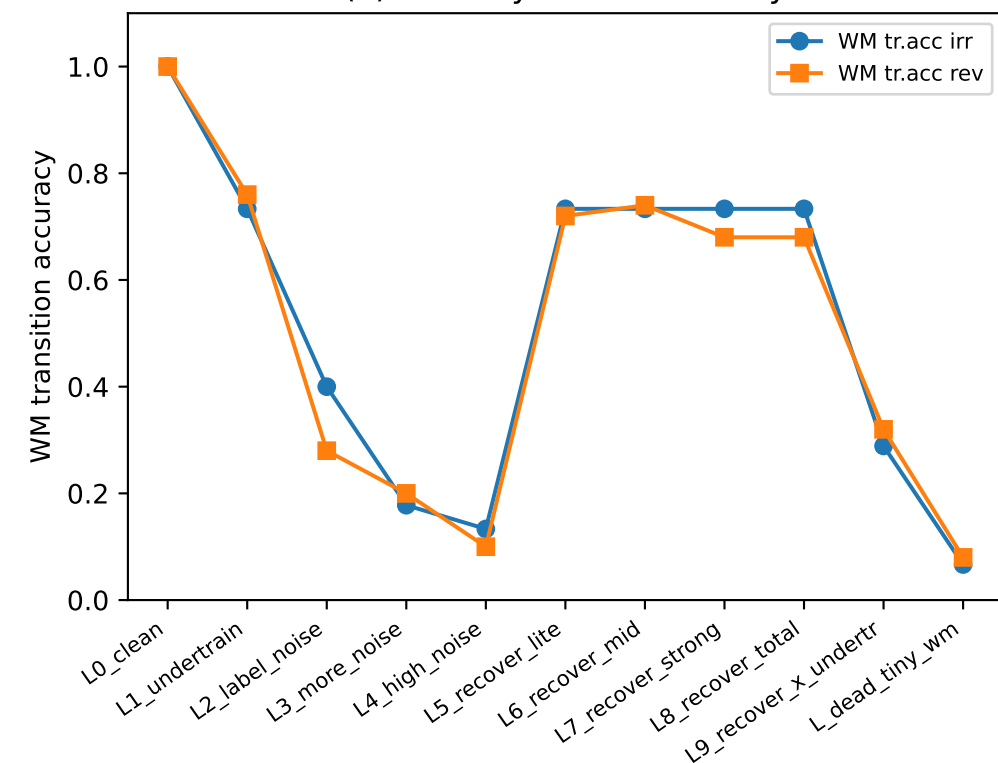


(b) Severity -- D_w _hat at s_0

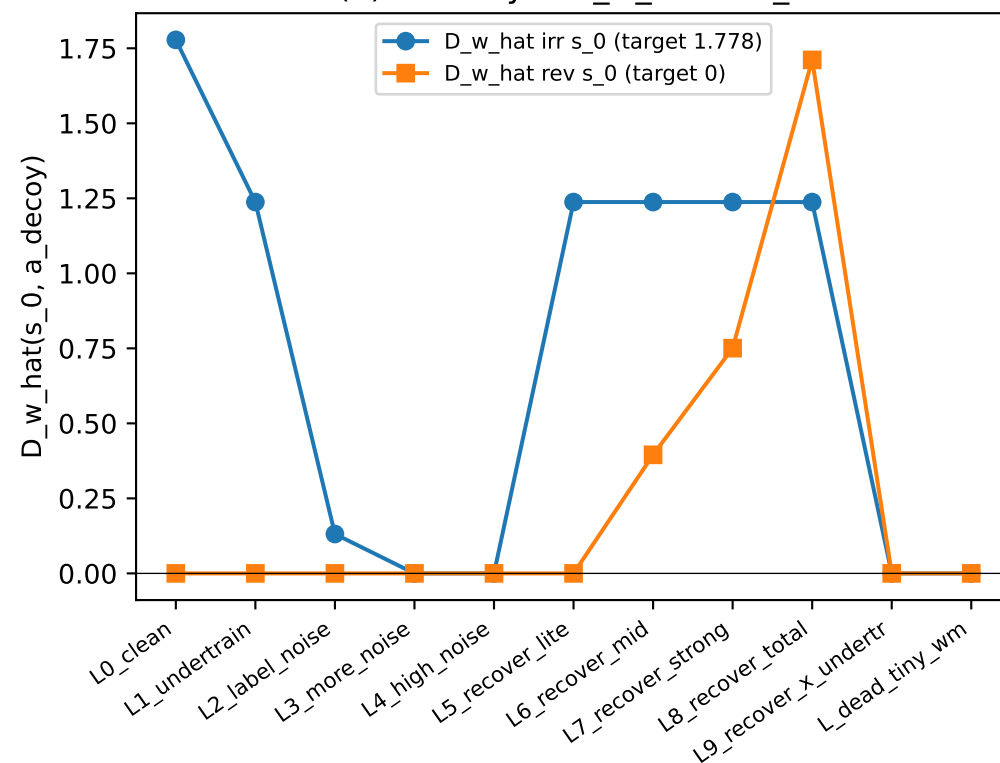


(c) Severity -- asymmetric error: s_0 vs anywhere

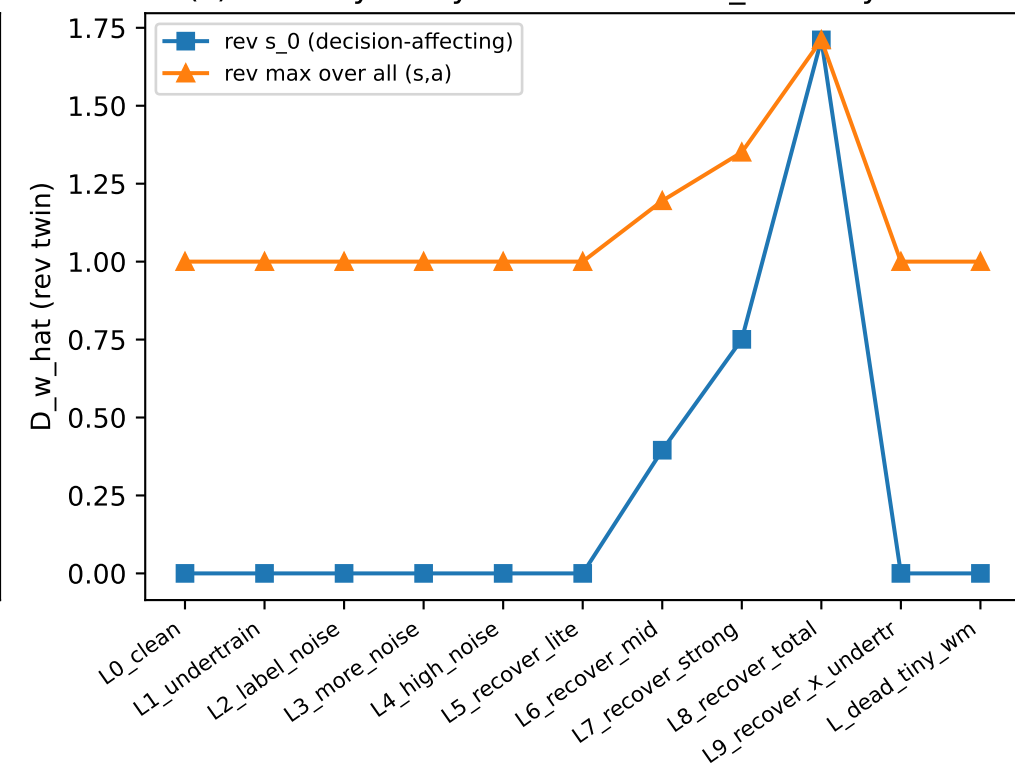


(d) Severity -- collapse (red= s_0 trig, orange=global)

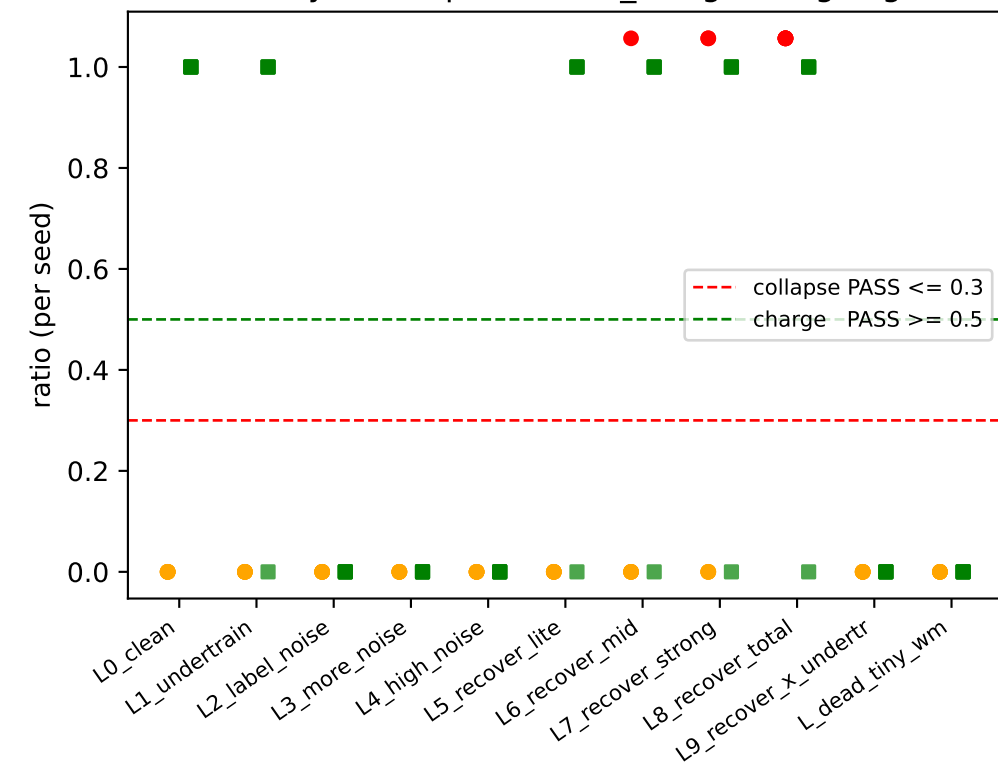


(e) Ablation -- label noise

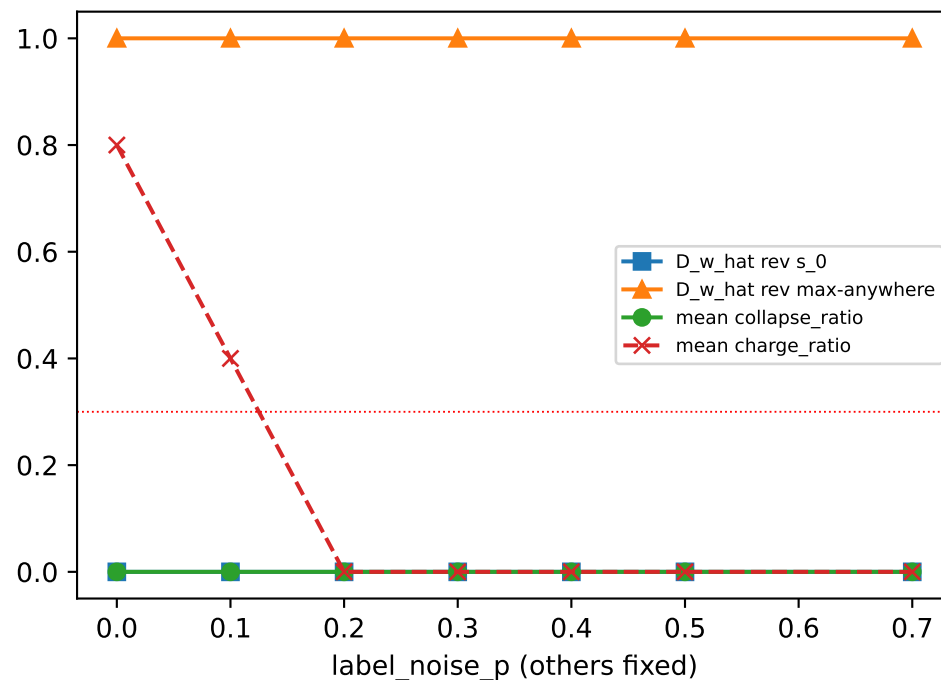


(f) Ablation -- obs noise

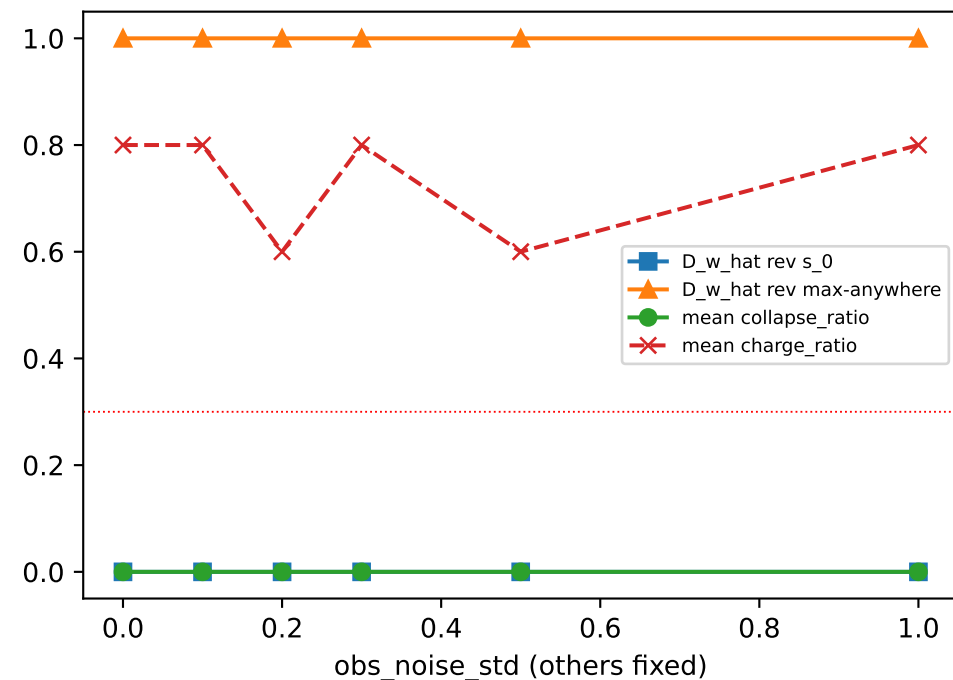

(g) Ablation -- training budget

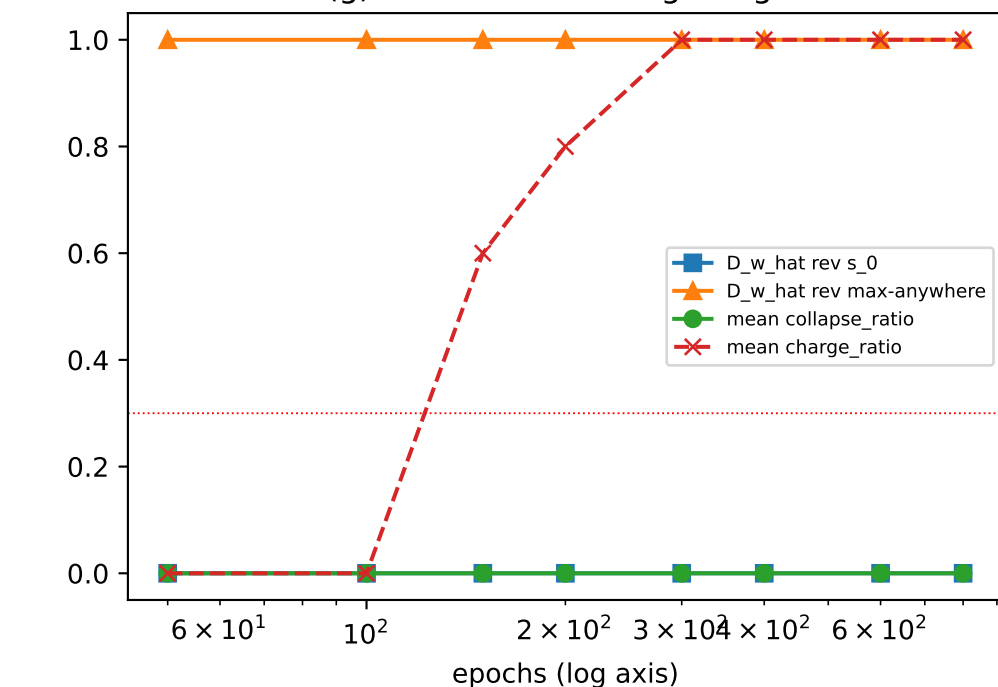

(h) Ablation -- capacity

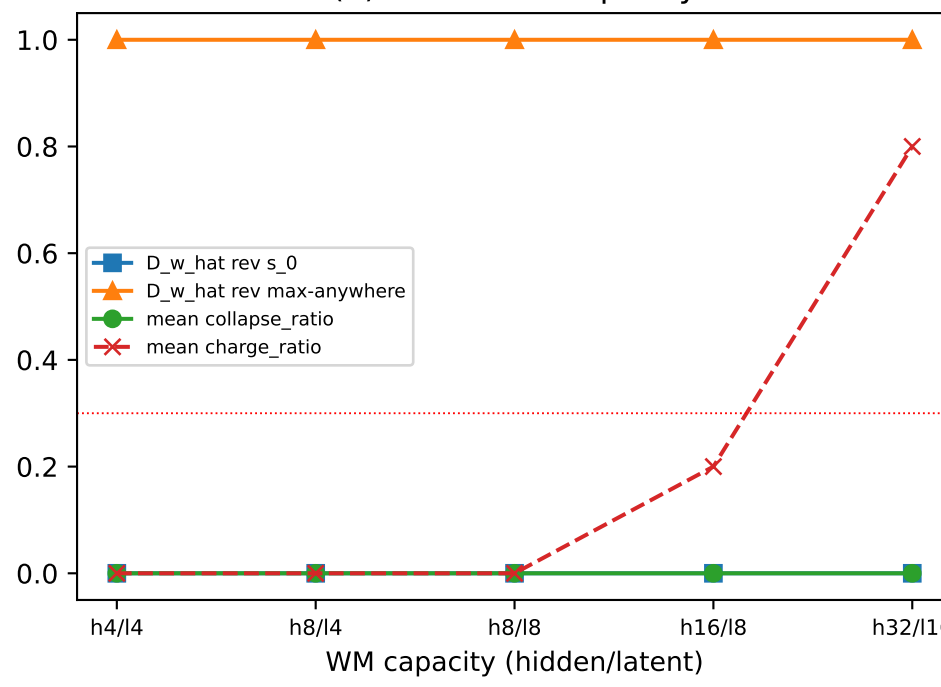

(i) Ablation -- surgical recover corruption

