

Project Galaxy Submittal Compliance Certification for Mechanical, Electrical, Plumbing, Controls and Fire Protection

- ✓ This submittal compliance certification for each submittal states that the submission meets all requirements of the specification. Vendor shall be required to submit a Comply, Deviate, Exclude (C/D/E) form of each submittal that confirms C, D, or E, next to each line item with the spec section, schedule and all relevant drawings associated with the submittal. This C/D/E review shall be submitted in the same package as each submittal and shall proactively indicate all elements of the submission that do not comply with the design requirements. Any noncompliance not proactively noted in this submittal compliance certification shall be corrected in the field to comply with the specification requirements in the field by this Vendor at no additional cost or time.

Submittal should clearly state that either:

- ✓ **“C”** - The submittal is in direct conformance with the Specification, FM Global Guidelines, Galaxy Guidelines, and any other design and contract documents, or that
- ☐ This submittal deviates from the above... Please include:
 - ☐ Fully detailed side by side comparison of the submitted product vs the specified product
 - ☐ Within the submittal, provide mark ups in the margins showing the deviations or exceptions:
 - ☐ **“D”** - Comply with deviations. For each deviation, provide a numbered footnote with reasons for the proposed deviation and how the intent of the specification can be satisfied.
 - ☐ **“E”** - Exception do not comply. For each exception, provide a numbered footnote and possible alternatives.
 - ☐ Justification for substitution i.e., Cost savings to Owner, Schedule savings to Owner and Other benefits to Owner
 - ☐ Confirm substitution results in no additional cost to Owner and no schedule impact
 - ☐ Please include responses to previous submittal comments.
- ☐ Unless a deviation or exception is specifically noted in the submittal compliance certification, it is assumed that the submission is in complete compliance with the Contract Documents. Deviations or exceptions taken in cover letters, subsidiary documents, by omission, or by contradiction do not release this contractor from being in complete compliance, unless the exception or deviation has been specifically noted.
- ☐ Submittal is **not** to contain a list or catalog of everything a supplier is able to provide. Only list and include and highlight/identify those that are seeking approval and are part of the project. Project name, building name, item name should be prominently indicated on the submittal. This should be submitted as one submittal, not piecemealed. Submittal shall include a table of contents. Need to highlight the actual equipment model numbers in full detail. Need to highlight all options and features that are being selected.

LETTER OF TRANSMITTAL / REQUEST



Date: 8/4/2023	Job Number: NC22N5230
Attention: Enrico Martino	
To: Structure Tone	
330 W 34th St	
New York, NY 10001	
Reference:	

☐ WE ARE REQUESTING:

☒ WE ARE SENDING YOU:

☐ Attached ☐ Under Separate Cover Via: _____

THE FOLLOWING ITEMS:

☐ Parts / Material
 ☒ Shop Drawings
 ☐ Prints
 ☐ Plans
☐ Samples
 ☐ Specifications
 ☐ Copy of Letter
 ☐ Change Order
☐ Other _____

Qty.	SE PO or Document #	Description
1	SE-009 Package 2 - Security Shop Drawings - Revision 4	Rev4 Security Shop Drawing Submittal for Project Galaxy Fitout Package 2 (Levels 3, 4 and 5)

TRANSMITTED:

☒ For approval
 ☐ For your use
 ☐ As requested
 ☐ For your record
☐ For review and comment
 ☐ Approved as submitted
 ☐ Approved as noted
 ☐ Returned for corrections
☐ Resubmit _____ copies for approval
 ☐ Prints returned after loan to us
☐ Submit _____ copies for distribution
 ☐ **Schneider Electric Reviewed**
☐ For Bids Due _____
 ☐ (other) _____

REMARKS _____

SCHNEIDER ELECTRIC

SIGNED _____ RECEIVED BY _____

COPY TO _____ WAREHOUSE _____

PAGE _____ OF _____ DATE _____

Project Galaxy – Fitout
Package 2 – Levels 3, 4, and 5

310 Hudson Street

New York, NY 10013

Submittal Number: SE-009 Rev 4
Security System Design
8/4/2023

Project Number: NC22N5230

Reflects changes up to RFI-1567



NY/NJ
160 Chubb Ave
Suite 201
Lyndhurst, NJ 07071
Main: 201-348-9240
Service: 1-877-822-2601



These drawings and designs are the property of Schneider Electric. Their use or reproduction without prior consent of the company is strictly prohibited.

Systems Description		Project Galaxy - Fitout		Package 2		Submitted	
Job Number	NC22N5230	310 Hudson Street New York, NY 10013		Levels 3, 4, 5		REVISION	APP
Drawing Number	SEC-A01-P2	Title Page				#	BY
Drawing Size						DATE	TN
Drawing Scale						DESCRIPTION	TN
						0	MF
						1	KW
						2	TNG
						3	TNG
						4	TN

Symbols

	Card Reader	
	Barcode Reader	
	Push Button	T: P-Panic; R- Door Release; X- Request-To-Exit, LD- Lockdown
	Electronic Lock	T: M-Magnetic; LR-Latch Retraction EM-Electrified Mortise Lock; ET-Electrified Trim; S-Electric Strike
	Door Position Switch	
	Fixed Camera	T: 180°; 360°
	PTZ Dome Camera	
	Camera w/Panner and Zoom Lens	
	Motion Detector	
	Long Range Motion Detector	
	Glass Break Detector	
	Security Strobe Light	
	Loudspeaker	
	Intercom	T1: A-Audio; V-Video & Audio T2: M-Master Station; S-Substation
	Junction Box	
	Power Supply	
	Camera Power Supply	
	Uninterruptible Power Supply	
	Turnstiles Control Panel	
	Access Control Panel	
	Intrusion Detection System Keypad	
	CCTV System Keyboard	
	Access Control System Server	
	Intrusion Detection System Server	
	Intercom System Server	
	Network Video Recorder	
	Network Video Recording Server	
	Video Storage Server	
	Workstation	T: A-Access Control; C-CCTV/Video Surveillance; B-Badge; V-Visitor Management (For multiple use "/>
	Equipment Rack	
	Network Hub/Switch/Router	
	Video Monitor	
	Media Converter	T: R-Receiver; T-Transmitter; TR-Transceiver
	Keyboard/Video/Mouse Console	
	Patch Panel	T: C5-CAT5/CAT5e; C6-CAT6; F-Fiber Optic; C-Coaxial
	Resistor	
	Relay Coil	
	Normally Closed Dry Contact	
	Normally Open Dry Contact	

Symbols (continued)

	Terminal Block	T: # - Terminal Block Number
	Terminal Blocks (connected)	
	Circuit Breaker	
	AC/DC Power Supply	
	Transformer	

Abbreviations

ACAMS	Access Control Alarm Monitoring System
ACT	Actuator (for Automatic Door Operator)
ADO	Automatic Door Operator
CR	Card Reader
DC	Door Contact (Door Position Switch)
DEL	Delayed Egress
EML	Electrified Mortise Lock
ESL	Electric Strike Lock
FACP	Fire Alarm Control Panel
GND	Earth Ground
HGR	Hand Geometry Reader
LAN	Local Area Network
EMAG	Electromagnetic Lock
NC	Normally Closed Contact
NCSerPar	Normally Closed Series Parallel
NO	Normally Open Contact
NOSerPar	Normally Open Series Parallel
PIR	Passive Infrared Detector
REX	Request to Exit
Rx	Receiver
TRx	Transceiver
TS	Turnstile
Tx	Transmitter
UPS	Uninterrupted Power Supply
VSS	Video Surveillance System
WAN	Wide Area Network

For other abbreviations see Symbols

Cable Types

Type	Description	Applications	Installation	Manufacturer	Part No.
A1	23AWG – 4P	Ethernet, Data (CAT 6A), See Note 1	Plenum, Indoor		
D1	18AWG – 4C	Audio, Discreet Wiring	Plenum, Indoor	Belden	6302UE
E1	22AWG – 2C	Audio, Discreet Wiring	Plenum, Indoor	Belden	6500FE
F1	18AWG – 2C	Low Voltage Power, Discreet Wiring	Plenum, Indoor	Belden	6300UE
G1	22AWG – 1P	RS-485/422 Data, Audio	Plenum, Indoor	Belden	82761
L	L1, L2, L3, L4	Access Control Card Reader Door	Plenum, Indoor		
L1	22AWG – 2P	Card Reader, See Note 2	Plenum, Indoor	Windy City Wire	415110-OSDP
L2	22AWG – 2C	Request to Exit	Plenum, Indoor	Belden	6500FE
L3	22AWG – 2C	Door Contact	Plenum, Indoor	Belden	6500FE
L4	16AWG – 2C	Door Lock (<250ft), See Note 3	Plenum, Indoor	Belden	6200UE
	14AWG – 2C	Door Lock (>250ft), See Note 3	Plenum, Indoor	Belden	6100UE
M	L1, L2, L3, (2)L4	Access Control Card Reader Door with 2 Locks	Plenum, Indoor		
L1	22AWG – 2P	Card Reader, See Note 2	Plenum, Indoor	Windy City Wire	415110-OSDP
L2	22AWG – 2C	Request to Exit	Plenum, Indoor	Belden	6500FE
L3	22AWG – 2C	Door Contact	Plenum, Indoor	Belden	6500FE
L4	16AWG – 2C	Door Lock (<250ft), See Note 3	Plenum, Indoor	Belden	6200UE
	14AWG – 2C	Door Lock (>250ft), See Note 3	Plenum, Indoor	Belden	6100UE
N	L1, L2, L3, L4, F1	Access Control Card Reader Door with Request to Exit PIR	Plenum, Indoor		
L1	22AWG – 2P	Card Reader, See Note 2	Plenum, Indoor	Windy City Wire	415110-OSDP
L2	22AWG – 2C	Request to Exit	Plenum, Indoor	Belden	6500FE
L3	22AWG – 2C	Door Contact	Plenum, Indoor	Belden	6500FE
L4	16AWG – 2C	Door Lock (<250ft), See Note 3	Plenum, Indoor	Belden	6200UE
	14AWG – 2C	Door Lock (>250ft), See Note 3	Plenum, Indoor	Belden	6100UE
F1	18AWG – 2C	Low Voltage Power, Discreet Wiring	Plenum, Indoor	Belden	6300UE
ICZZ	O	L1, L3	Access Control Card Reader Door		
L1	22AWG – 2P	Card Reader, See Note 2	Plenum, Indoor	Windy City Wire	415110-OSDP
L3	22AWG – 2C	Door Contact	Plenum, Indoor	Belden	6500FE
P	L1, L2, L3, (2) L4, (3) D1	Access Control Card Reader Door with Auto Operator	Plenum, Indoor		
L1	22AWG – 2P	Card Reader, See Note 2	Plenum, Indoor	Windy City Wire	415110-OSDP
L2	22AWG – 2C	Request to Exit	Plenum, Indoor	Belden	6500FE
L3	22AWG – 2C	Door Contact	Plenum, Indoor	Belden	6500FE
L4	16AWG – 2C	Door Lock (<250ft), See Note 3	Plenum, Indoor	Belden	6200UE
	14AWG – 2C	Door Lock (>250ft), See Note 3	Plenum, Indoor	Belden	6100UE
D1	18AWG – 4C	Audio, Discreet Wiring	Plenum, Indoor	Belden	6302UE


Note 1: All network cables, including patch cords, are to be provided by others.

Note 2: Windy City Wire (415110-OSDP) Card Reader Cable is approved.


Note 3: Proper lock cable to be selected based on field conditions.

Device Labeling

Access Control System Device Labeling

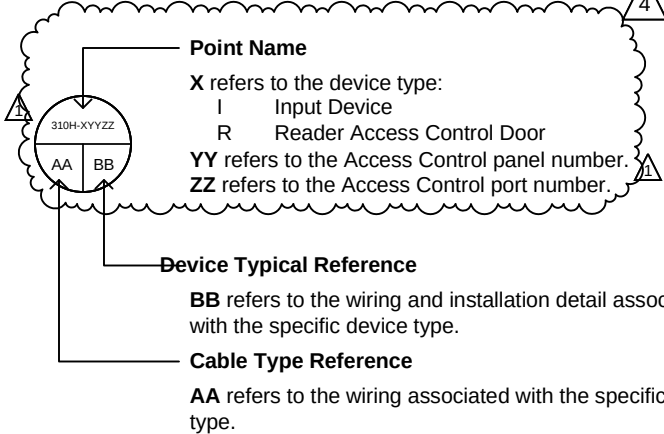

Video Surveillance and Intercom System Device Labeling

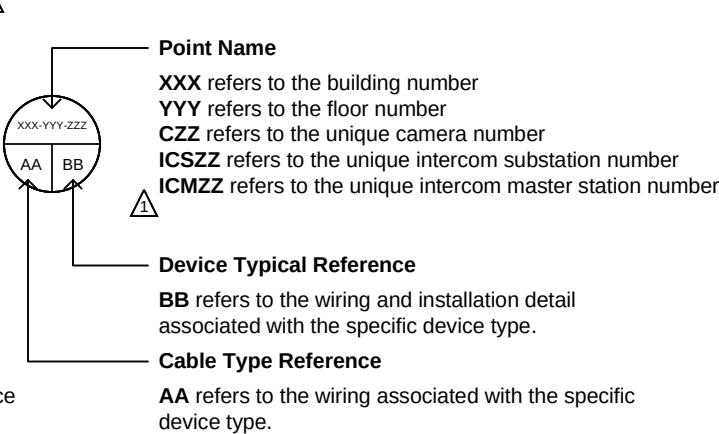

Device Labels are updated with GST naming scheme.

REVISION	#	DATE	DESCRIPTION	BY	APP
Submitted	0	7/18/2022	Submittal	MF	TN
	1	11/4/2022	Revision 1	KW	TN
	2	1/25/2023	Revision 2	TNG	TN
	3	3/15/2023	Revision 3	TNG	TN
	4	8/4/2023	Revision 4	TNG	TN

Package 2
Levels 3, 4, 5

Project Galaxy - Fitout

310 Hudson Street

New York, NY 10013

Legend Page

Systems Description
Security Systems

Job Number
NC22N5230


Drawing Number
SEC-A02-P2

Drawing Size
ANSI B

Drawing Scale
None

Drawing Number	Drawing Title	Submittal	Revision 1	Revision 2	Revision 3	Revision 4
SEC-A01-P2	Title Page	X	X	X	X	X
SEC-A02-P2	Legend Page	X	X	X	X	X
SEC-A03-P2	Table of Contents	X	X	X	X	X
SEC-B01W-P2	Level 3 - West Security Device Layout	X	X	X	X	X
SEC-B01E-P2	Level 3 - East Security Device Layout	X	X	X	X	X
SEC-B02W-P2	Level 4 - West Security Device Layout	X	X	X	X	X
SEC-B02E-P2	Level 4 - East Security Device Layout	X	X	X	X	X
SEC-B03W-P2	Level 5 - West Security Device Layout	X	X	X	X	X
SEC-B03E-P2	Level 5 - East Security Device Layout	X	X	X	X	X
SEC-C01-P2	Security System Riser	X	X	X	X	X
SEC-G01-P2	Security Wallfield Layouts	X	X	X	X	X
SEC-G02-P2	Security Wallfield Layouts	X	X	X	X	X
SEC-G03-P2	Security Wallfield Layouts	X	X	X	X	X
SEC-H01-P2	Security Enclosure Layouts		X	X	X	X
SEC-H02-P2	Security Enclosure Layouts		X	X	X	X
SEC-H03-P2	Security Enclosure Layouts		X	X	X	X
SEC-H04-P2	Security Enclosure Layouts		X	X	X	X
SEC-H05-P2	Security Enclosure Layouts		X	X	X	X
SEC-H06-P2	Security Enclosure Layouts		X	X	X	X
SEC-H07-P2	Security Enclosure Layouts			X	X	X
SEC-H08-P2	Security Enclosure Layouts				X	X
SEC-I01-P2	ACS Schedules		X	X	X	X
SEC-I02-P2	ACS Schedules		X	X	X	X
SEC-I03-P2	ACS Schedules		X	X	X	X
SEC-I04-P2	ACS Schedules		X	X	X	X
SEC-I05-P2	ACS Schedules		X	X	X	X
SEC-I06-P2	ACS Schedules		X	X	X	X
SEC-K01-P2	Intercom Schedules		X	X	X	X
SEC-K02-P2	Intercom Details		X	X	X	X
SEC-N01-P2	Camera Schedule		X	X	X	X
SEC-N02-P2	Camera Schedule		X	X	X	X
SEC-N03-P2	Camera Schedule		X	X	X	X
SEC-N04-P2	Camera Schedule		X	X	X	X
SEC-N05-P2	Camera Schedule		X	X	X	X

Systems Description Security Systems		Project Galaxy - Fitout 310 Hudson Street New York, NY 10013 Table of Contents		Package 2 Levels 3, 4, 5		REVISION		Submitted		BY		APP	
						#	DATE	DESCRIPTION					
						0	7/18/2022	Submittal			MF	TN	
						1	11/4/2022	Revision 1			KW	TN	
						2	1/25/2023	Revision 2			TNG	TN	
Job Number NC22N5230		Drawing Size ANSI B		Drawing Number SEC-A03-P2		3	3/15/2023	Revision 3			TNG	TN	
		Drawing Scale None				4	8/4/2023	Revision 4			TNG	TN	

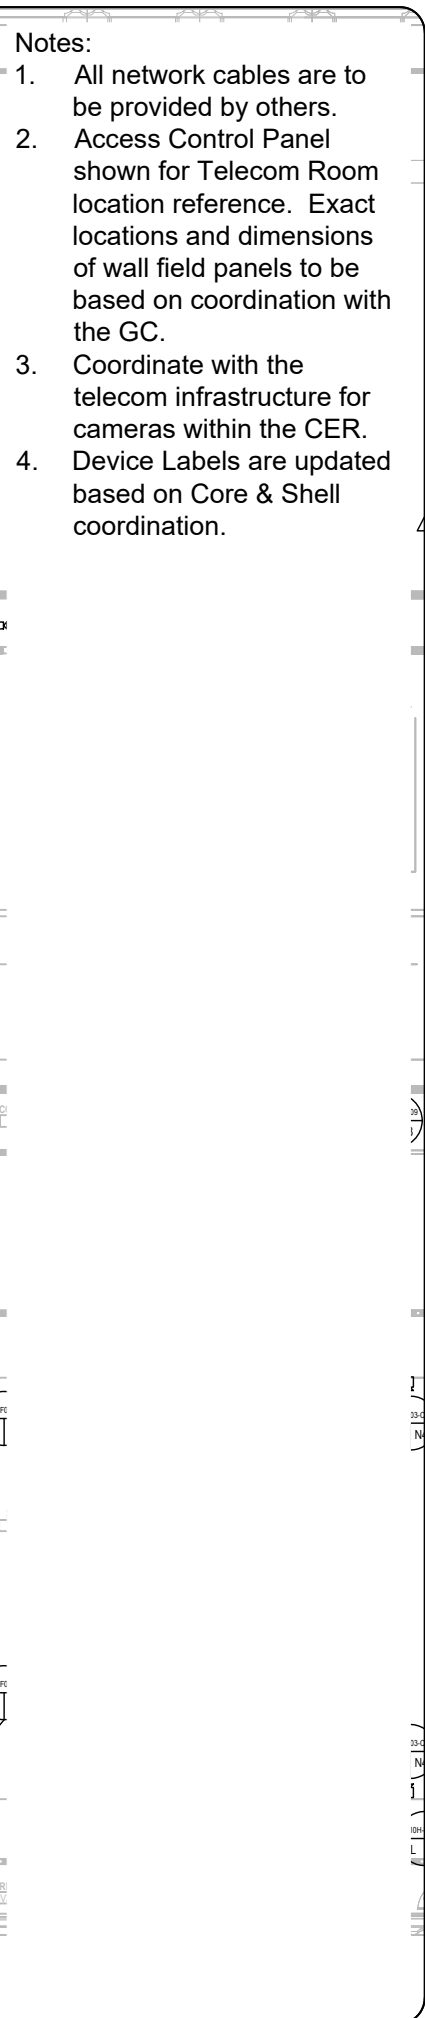

Schneider Electric


These drawings and designs are the property of Schneider Electric. Their use or reproduction without prior consent of the company is strictly forbidden.

REVISION		Submitted	
#	DATE	DESCRIPTION	BY APP
0	7/18/2022	Submittal	MF TN
1	11/14/2022	Revision 1	KW TN
2	1/25/2023	Revision 2	TNG TN
3	3/15/2023	Revision 3	TNG TN
4	8/4/2023	Revision 4	TNG TN

Package 2

Levels 3, 4, 5

Systems Description Security Systems		Project Galaxy - Fitout
Job Number	Drawing Size	310 Hudson Street
NC22N5230	ANSI B	New York, NY 10013
Drawing Number	Drawing Scale	Level 3 - West
SEC-B01W-P2	3/64"=1'-0"	Security Device Layout

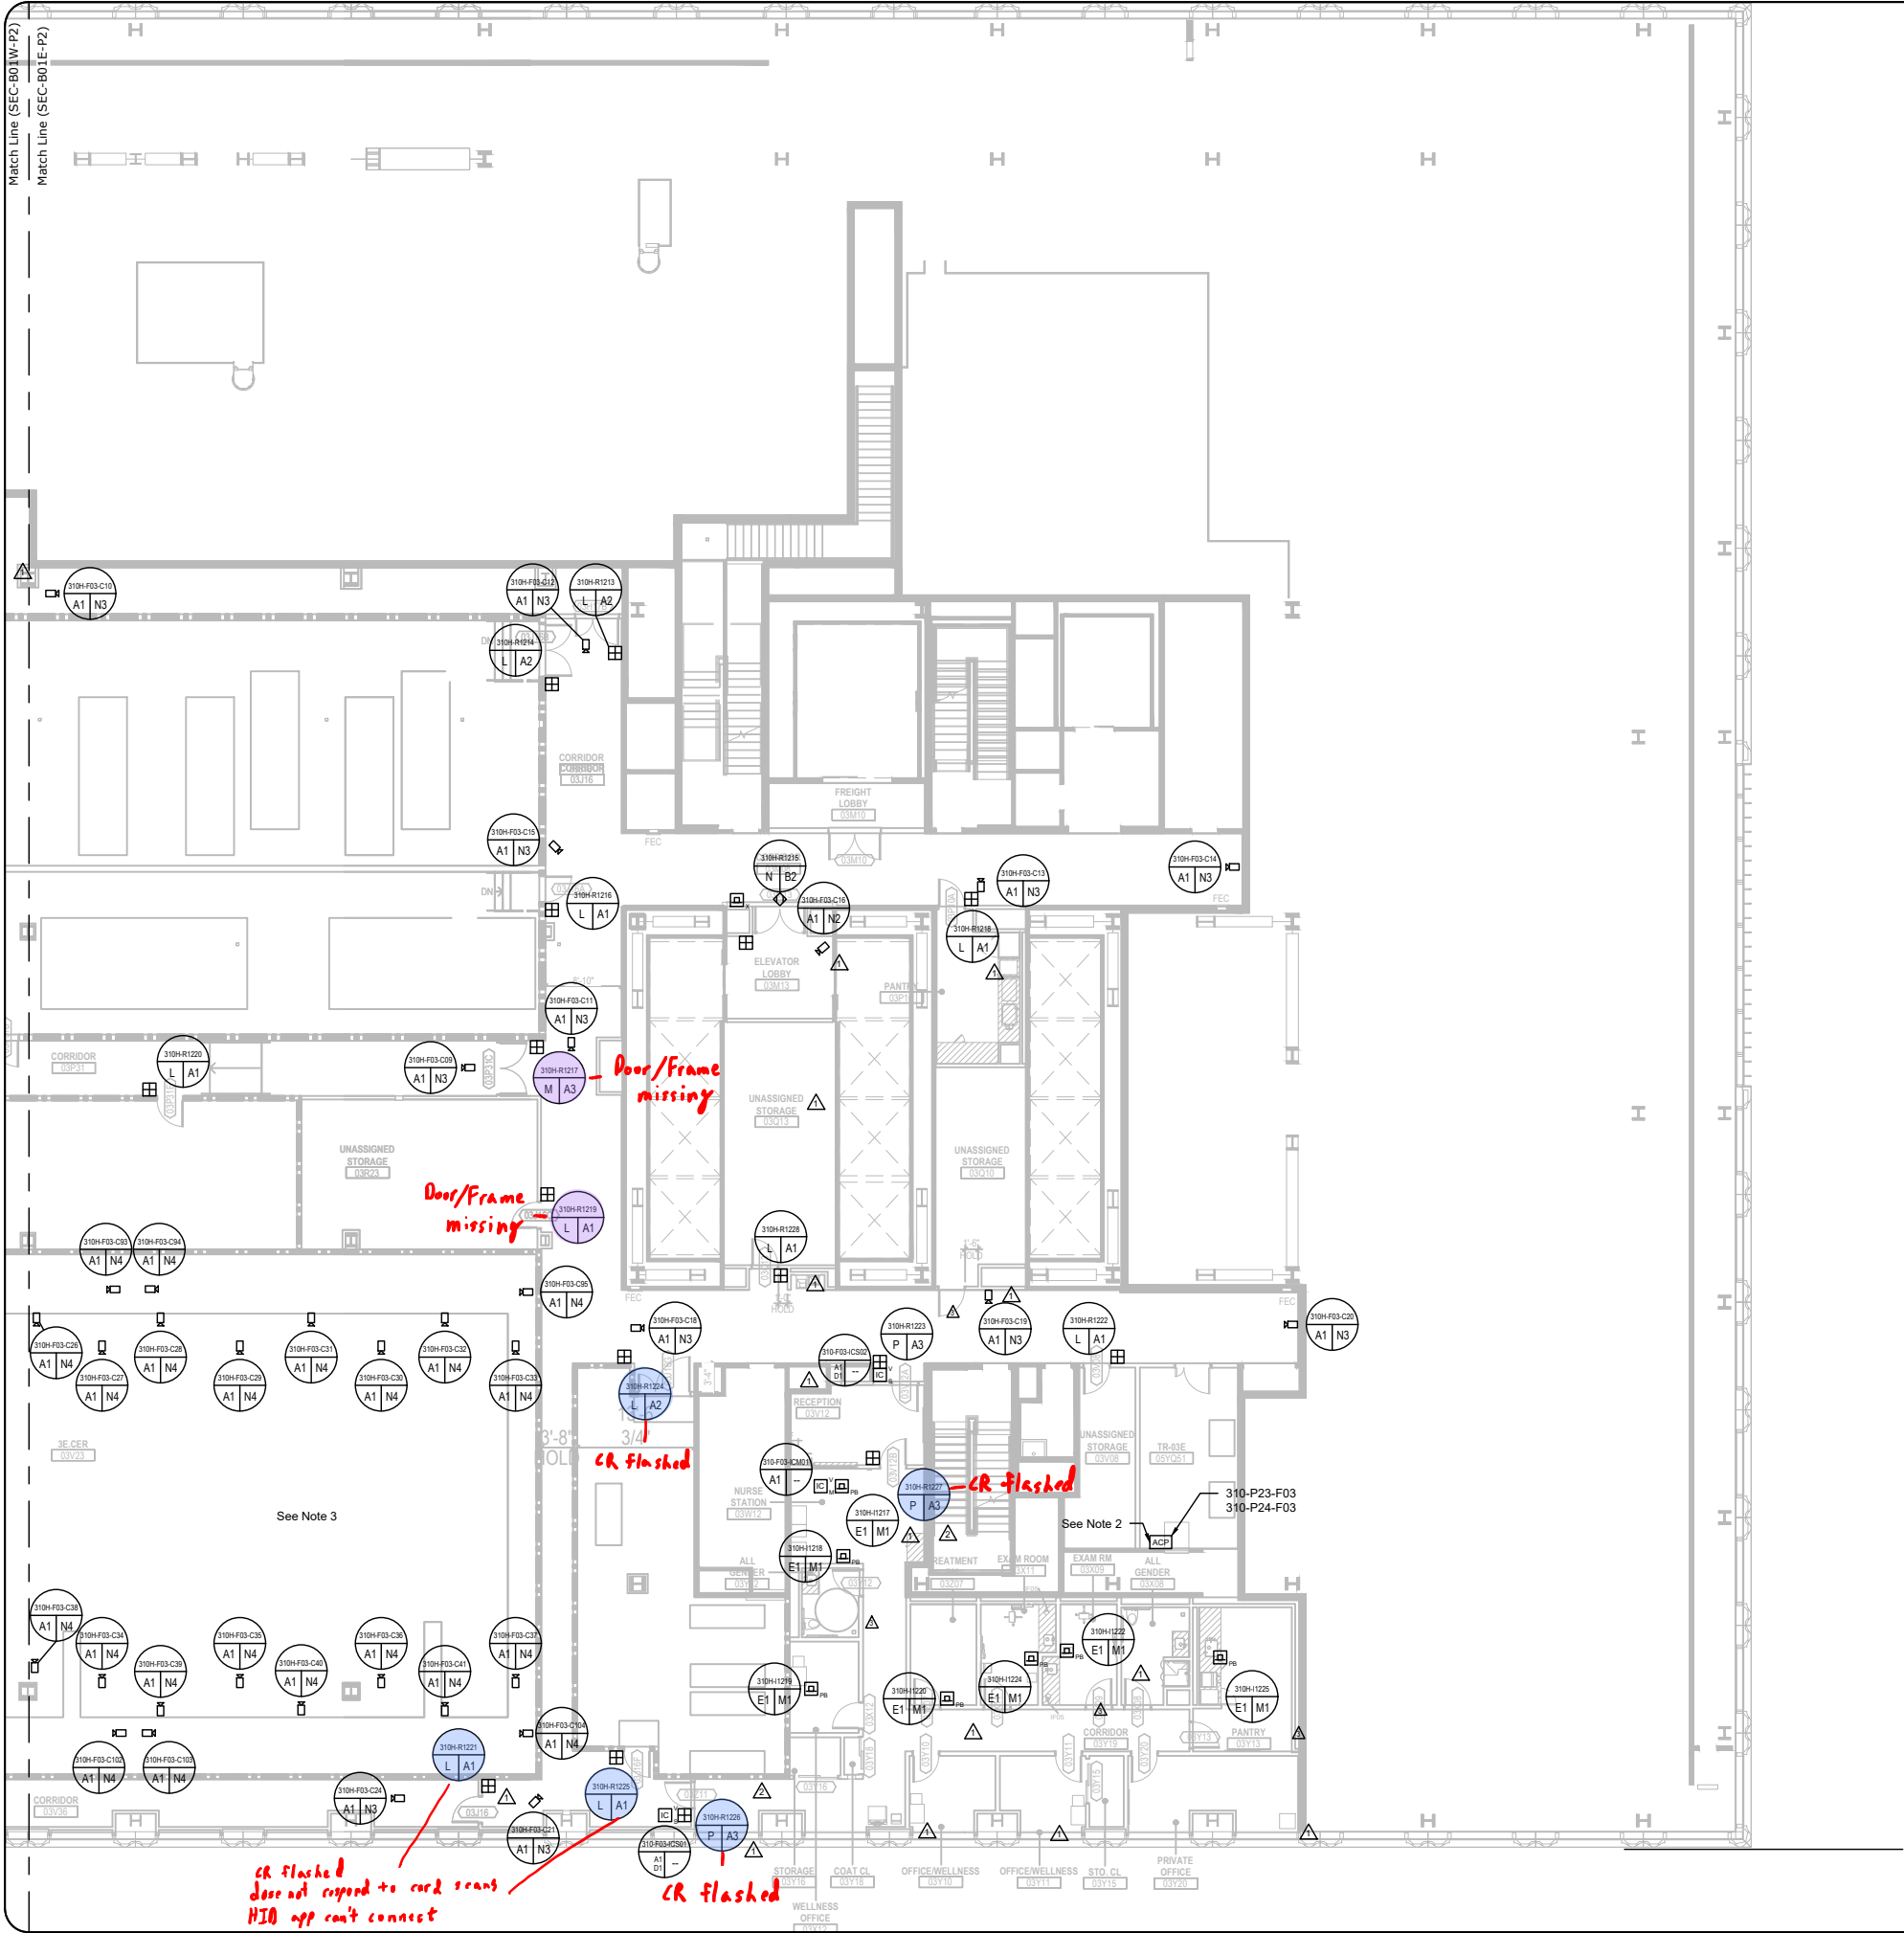

- Notes:
1. All network cables are to be provided by others.
 2. Access Control Panel shown for Telecom Room location reference. Exact locations and dimensions of wall field panels to be based on coordination with the GC.
 3. Coordinate with the telecom infrastructure for cameras within the CER.
 4. Device Labels are updated based on Core & Shell coordination.



Systems Description

Security Systems

Job Number

NC22N5230

Drawing Size

ANSI B

Drawing Number

SEC-B01E-P2

Project Galaxy - Fitout

310 Hudson Street
New York, NY 10013

Level 3 - East

Security Device Layout

Package 2

Levels 3, 4, 5

REVISION	DATE	DESCRIPTION	BY	APP
0	7/18/2022	Submittal	MF	TN
1	11/4/2022	Revision 1	KW	TN
2	1/25/2023	Revision 2	TNG	TN
3	3/15/2023	Revision 3	TNG	TN
4	8/4/2023	Revision 4	TNG	TN

Schneider Electric

These drawings and designs are the property of Schneider Electric. Their use or reproduction without prior consent of the company is strictly forbidden.



Notes:

1. All network cables are to be provided by others.
2. Access Control Panel shown for Telecom Room location reference. Exact locations and dimensions of wall field panels to be based on coordination with the GC.
3. Provide 20ft of coiled cable slack for field coordinated camera mounting flexibility. Camera is to be mounted to light grid with clamps.
4. Camera is to be terminated in the telecom room on the floor above (5W.TR).
5. Device Labels are updated based on Core & Shell coordination.

REVISION	#	DATE	DESCRIPTION	BY	APP
Submitted	0	7/18/2022	Submittal	MF	TN
	1	11/4/2022	Revision 1	KW	TN
	2	1/25/2023	Revision 2	TNG	TN
	3	3/15/2023	Revision 3	TNG	TN
	4	8/4/2023	Revision 4	TNG	TN

Package 2
Levels 3, 4, 5

Project Galaxy - Fitout

310 Hudson Street

New York, NY 10013

Level 4 - West

Security Device Layout

Systems Description

Security Systems

Job Number

NC22N5230

Drawing Number


SEC-B02W-P2

Drawing Size

ANSI B

Drawing Scale

3/64"=1'-0"

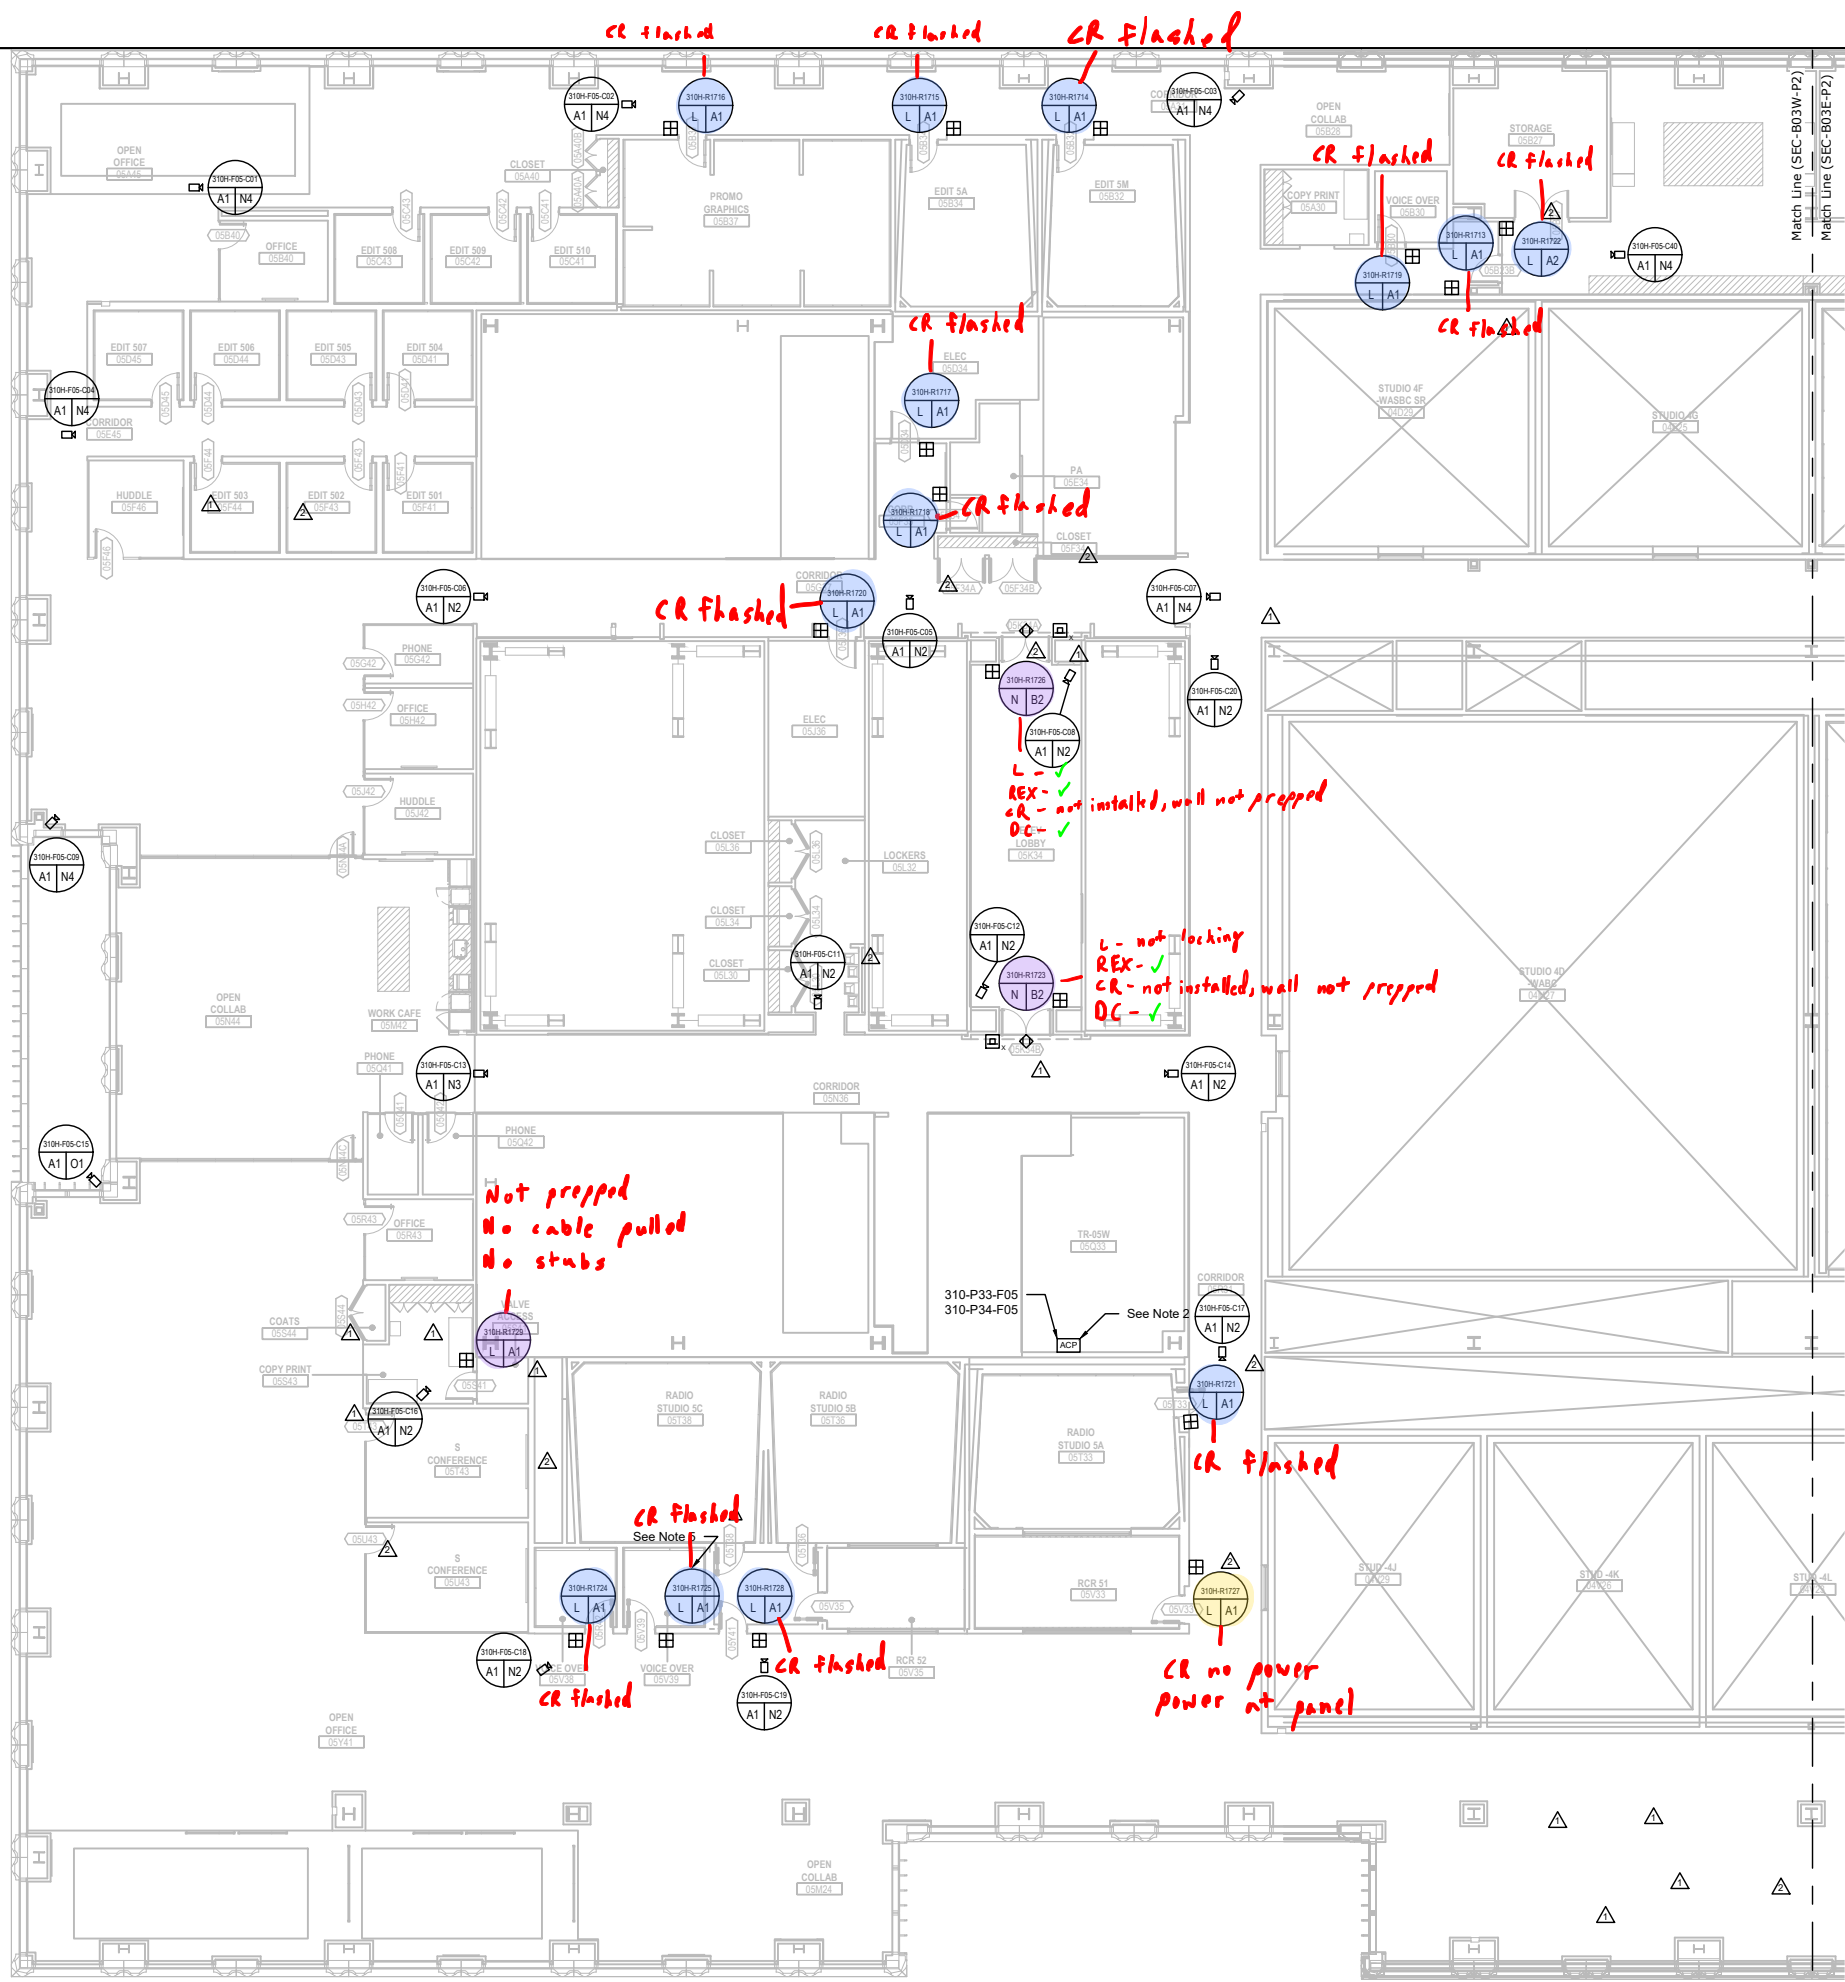

- Notes:
1. All network cables are to be provided by others.
 2. Access Control Panel shown for Telecom Room location reference. Exact locations and dimensions of wall field panels to be based on coordination with the GC.
 3. Device Labels are updated based on Core & Shell coordination.
 5. Final door hardware type is TBD. Coordinate with SE and G.C. for stub-up and cabling requirements.

REVISION	#	DATE	DESCRIPTION	BY	APP
Submitted	0	7/18/2022	Submittal	MF	TN
	1	11/4/2022	Revision 1	KW	TN
	2	1/25/2023	Revision 2	TNG	TN
	3	3/15/2023	Revision 3	TNG	TN
	4	8/4/2023	Revision 4	TNG	TN

Package 2

Levels 3, 4, 5


Project Galaxy - Fitout

310 Hudson Street
New York, NY 10013

Level 5 - West

Security Device Layout

Systems Description		Security Systems	
Job Number	NC22N5230	Drawing Size	ANSI B
Drawing Number	SEC-B03W-P2	Drawing Scale	3/64"=1'-0"

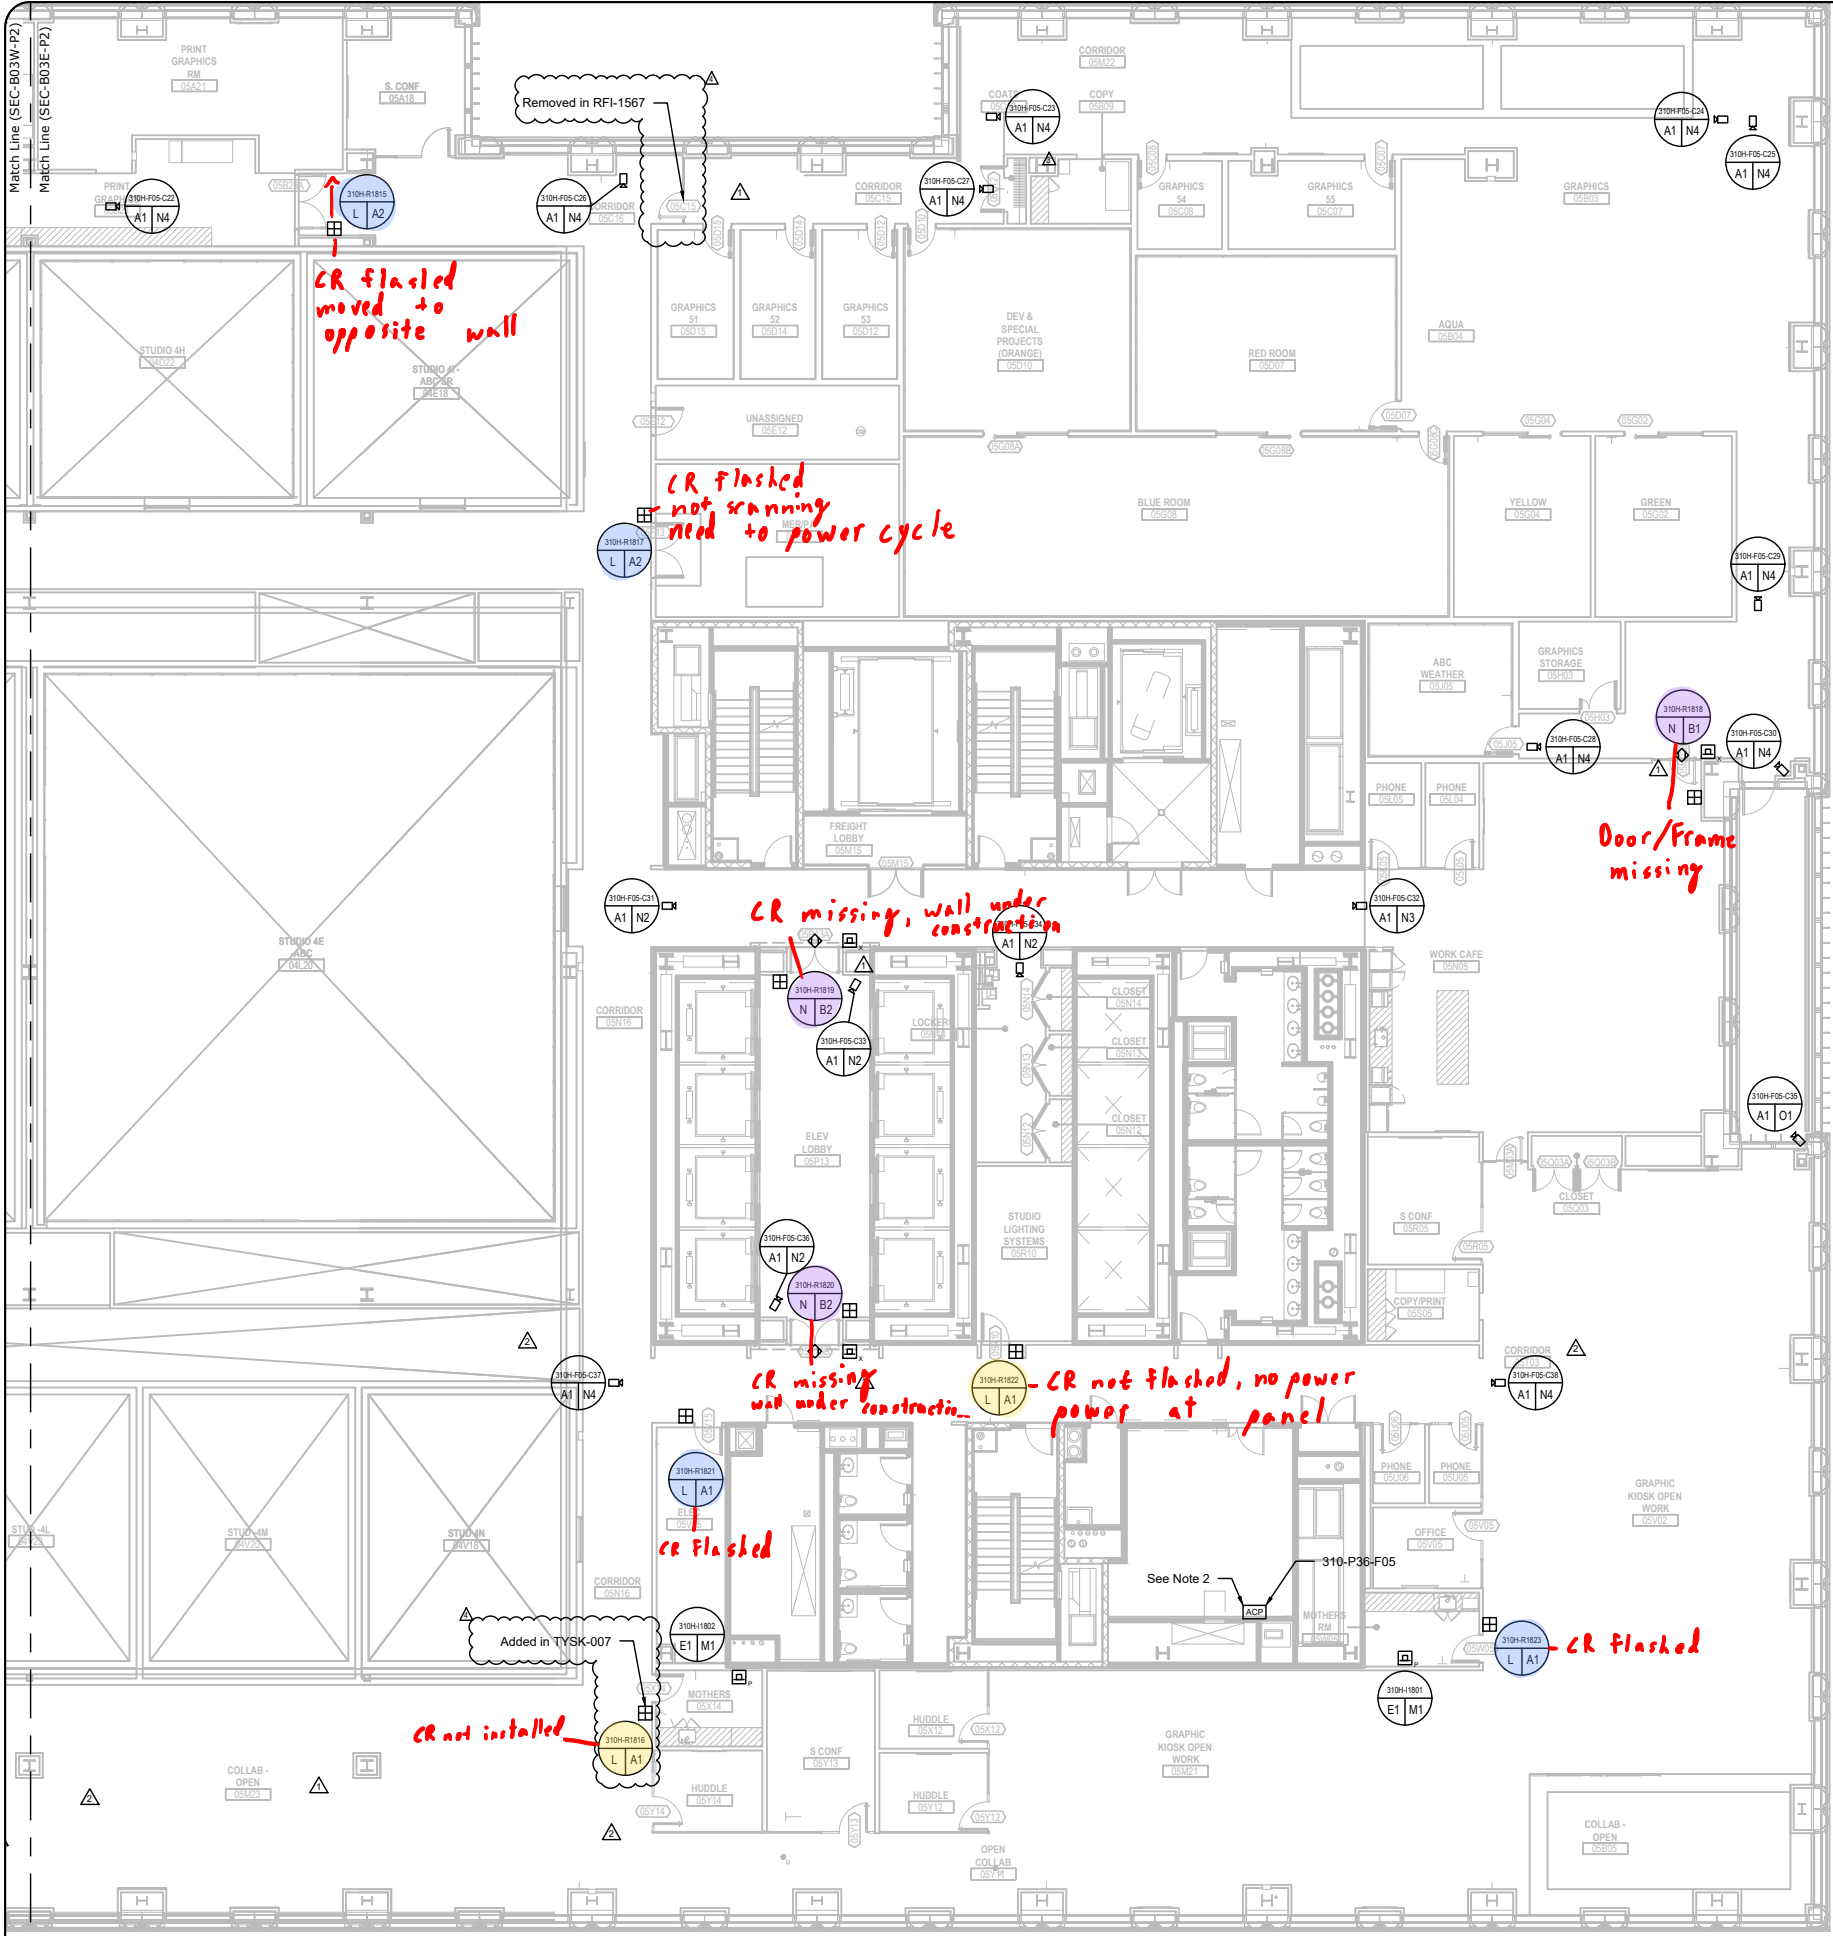

- Notes:
1. All network cables are to be provided by others.
 2. Access Control Panel shown for Telecom Room location reference. Exact locations and dimensions of wall field panels to be based on coordination with the GC.
 3. Device Labels are updated based on Core & Shell coordination.

Systems Description

Security Systems

Job Number

NC22N5230

Drawing Size

ANSI B

Project Galaxy - Fitout

310 Hudson Street
New York, NY 10013

Level 5 - East

Security Device Layout

Package 2


Levels 3, 4, 5

REVISION	Summittaed	DATE	DESCRIPTION	BY	APP
#	0	7/18/2022	Submittal	MF	TN
1	11/4/2022	Revision 1		KW	TN
2	1/25/2023	Revision 2		TNG	TN
3	3/15/2023	Revision 3		TNG	TN
4	8/4/2023	Revision 4		TNG	TN


Schneider Electric

These drawings and designs are the property of Schneider Electric. Their use or reproduction without prior consent of the company is strictly forbidden.


Notes:
1. All network cables and patch cords are to be provided by others.

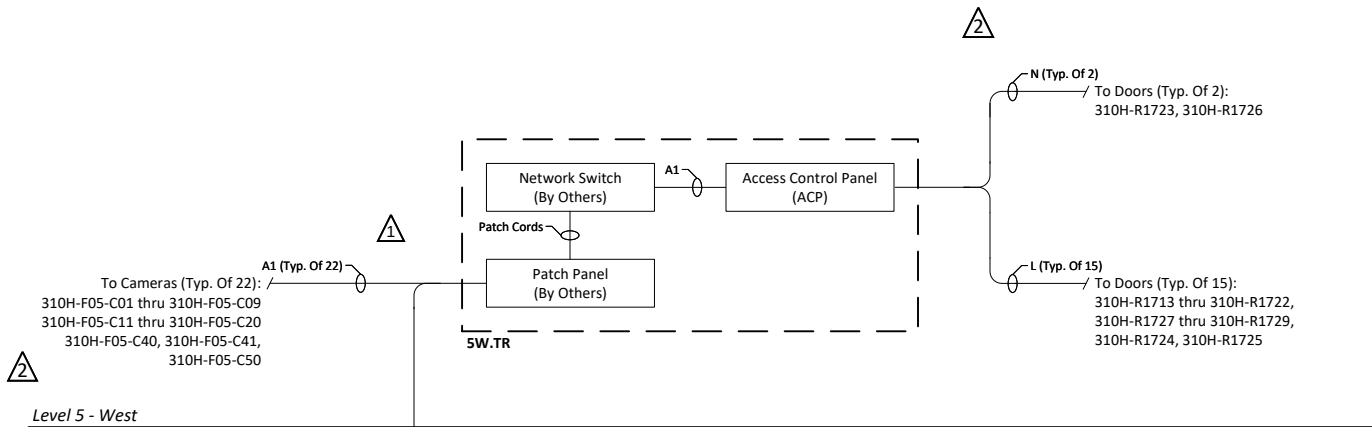


Level 5 - West

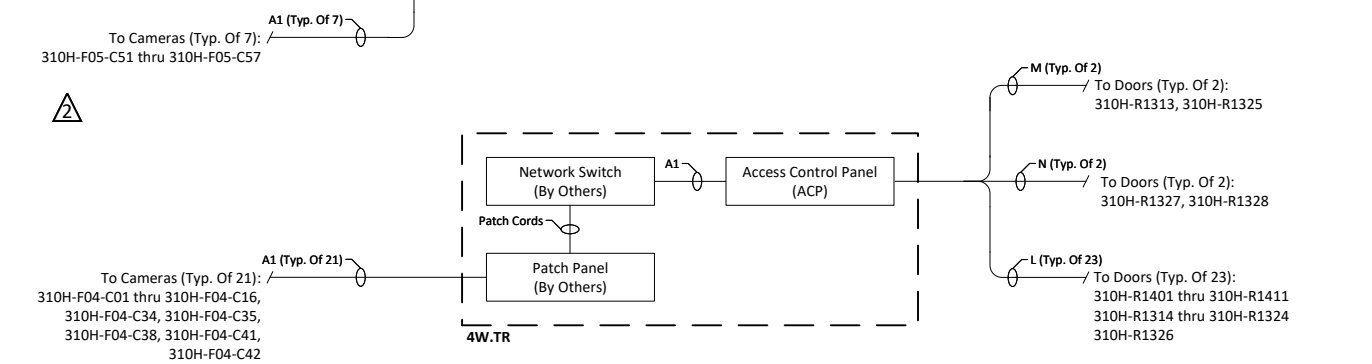


Level 4 - West

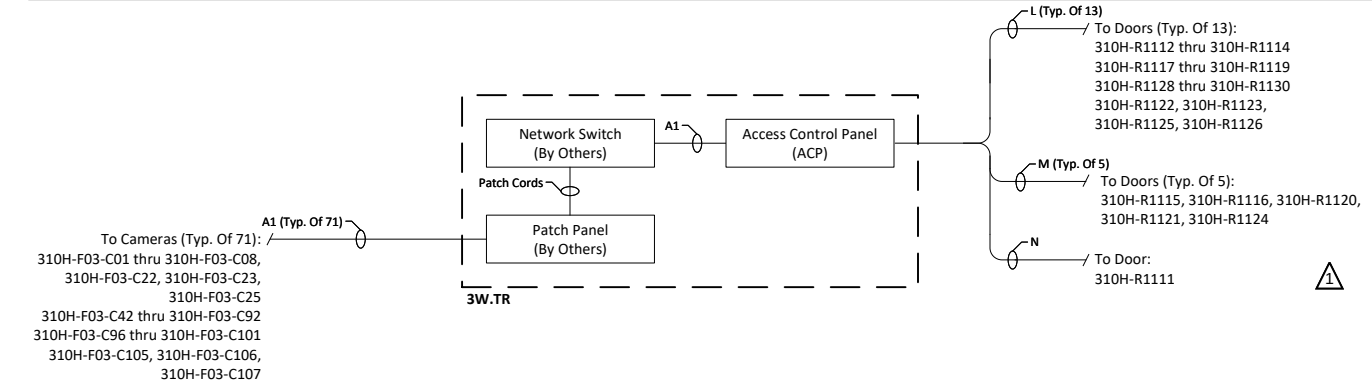


Level 3 - West

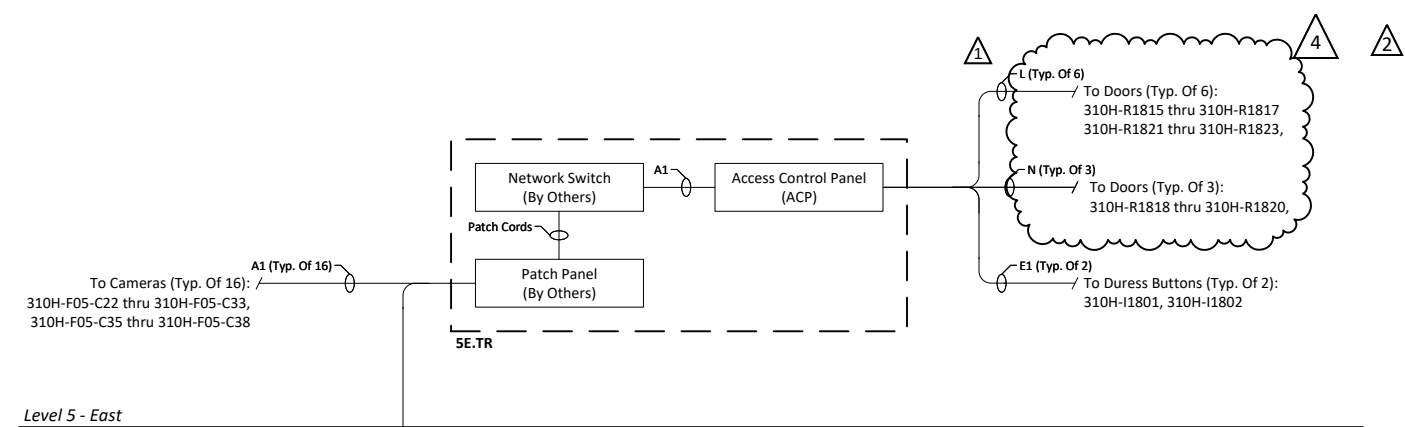

Level 5 - East

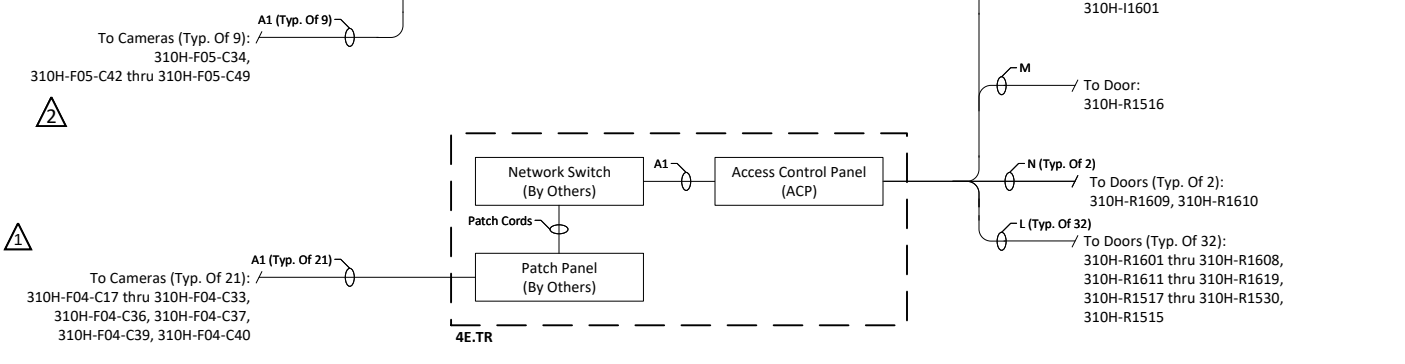

Level 4 - East

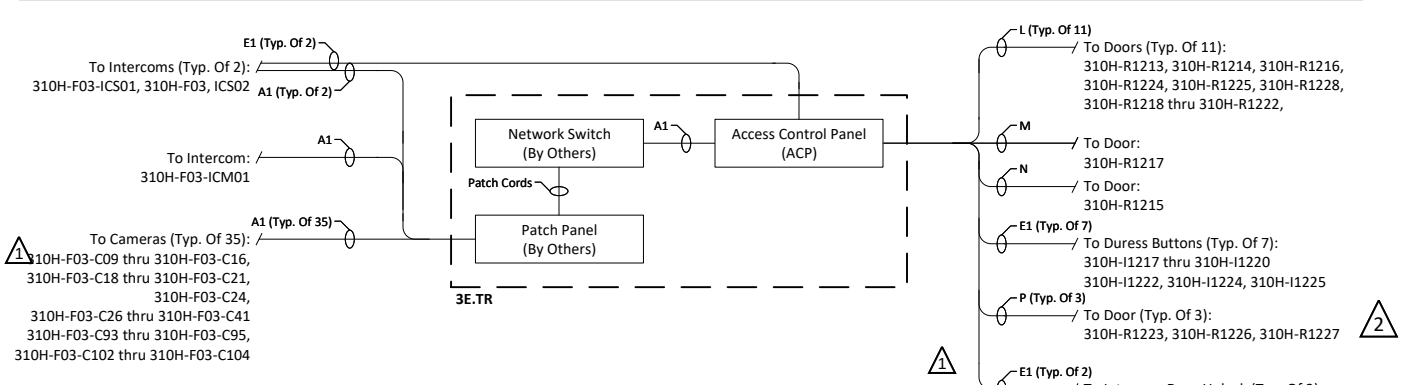

Level 3 - East


REVISION	#	DATE	DESCRIPTION	BY	APP
Submitted	0	7/18/2022	Submittal	MF	TN
	1	11/4/2022	Revision 1	KW	TN
	2	1/25/2023	Revision 2	TNG	TN
	3	3/15/2023	Revision 3	TNG	TN
Submitted	4	8/4/2023	Revision 4	TNG	TN

Package 2

Levels 3, 4, 5

Project Galaxy - Fitout
310 Hudson Street
New York, NY 10013
Security System Riser


Systems Description	Security Systems	Drawing Size	Drawing Scale
Job Number	NC22N5230	ANSI B	
Drawing Number	SEC-C01-P2		None

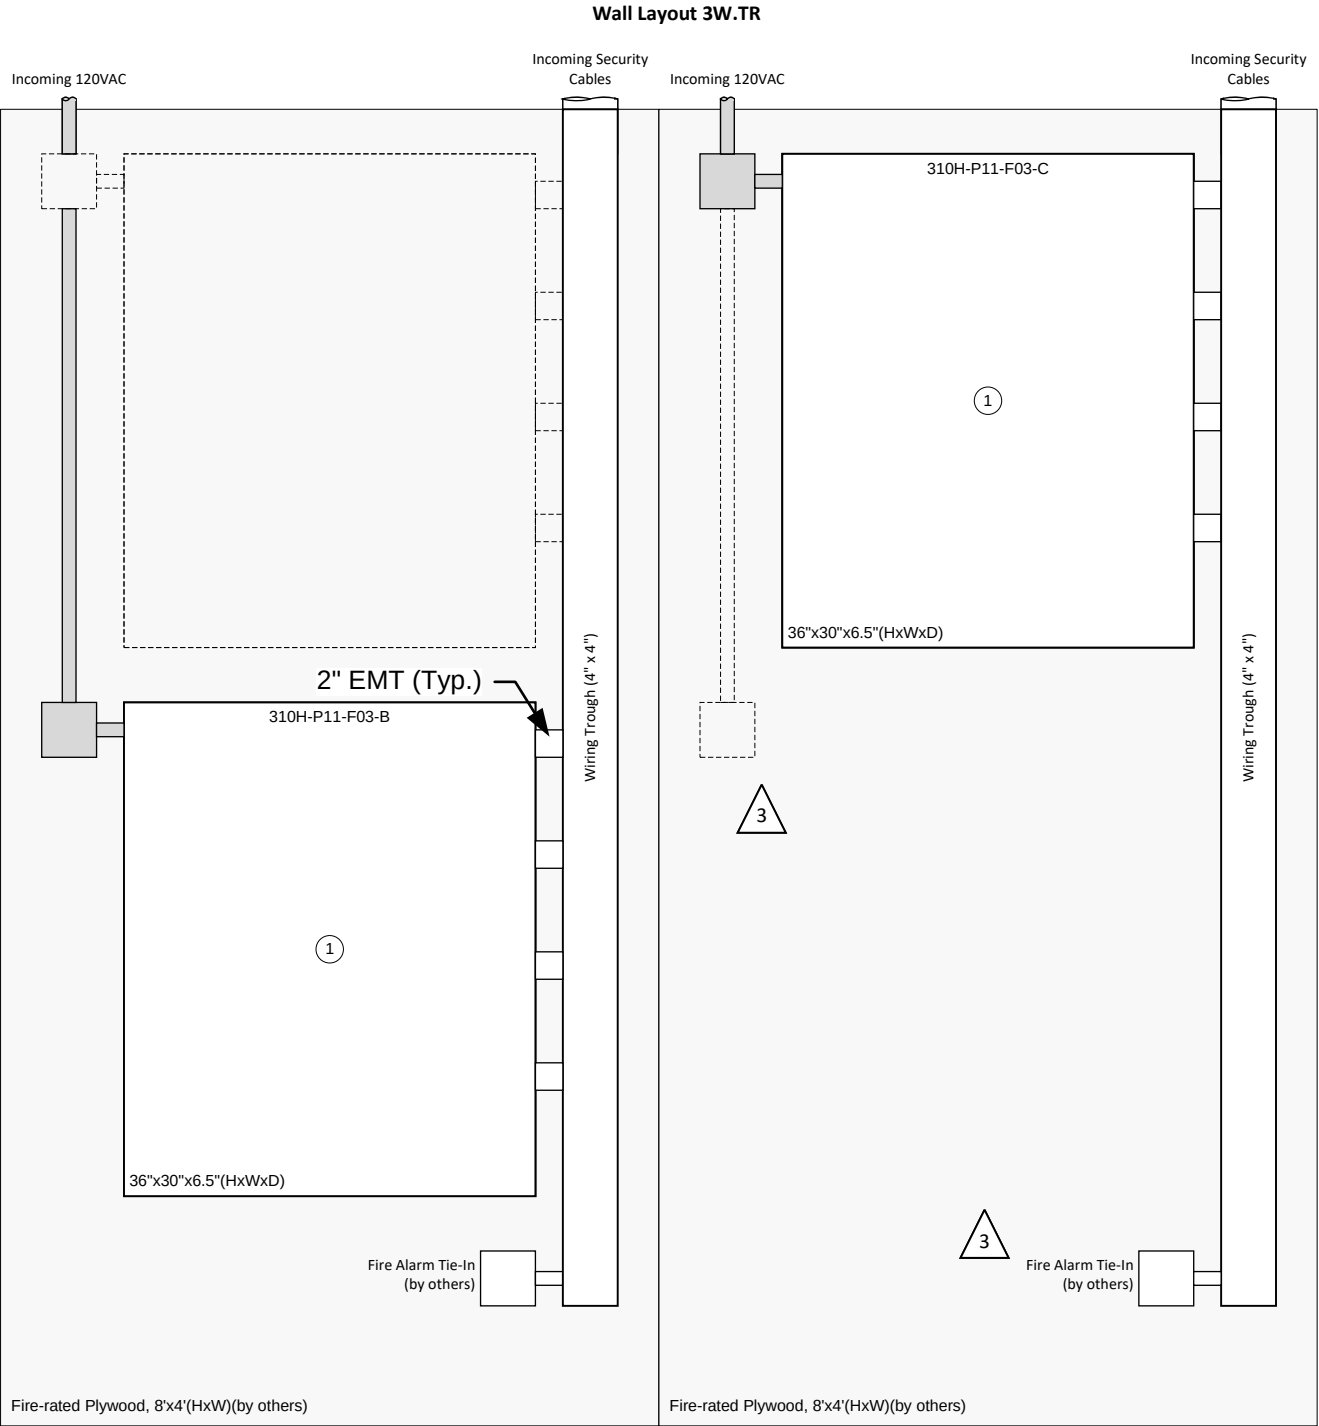

① LifeSafety Power, Unified Enclosure, FPO150/250-2M82M8PNLXE8M3-WP-DSNY02

- Notes:
- Dotted lines represent space needed for Core & Shell enclosures.
 - Layout shown for equipment panel requirements only. Exact location of equipment shall be based on coordination with the GC.

Equipment	Current(A)
310H-P11-F03-B	5.7
310H-P11-F03-C	5.7
Total	11.4

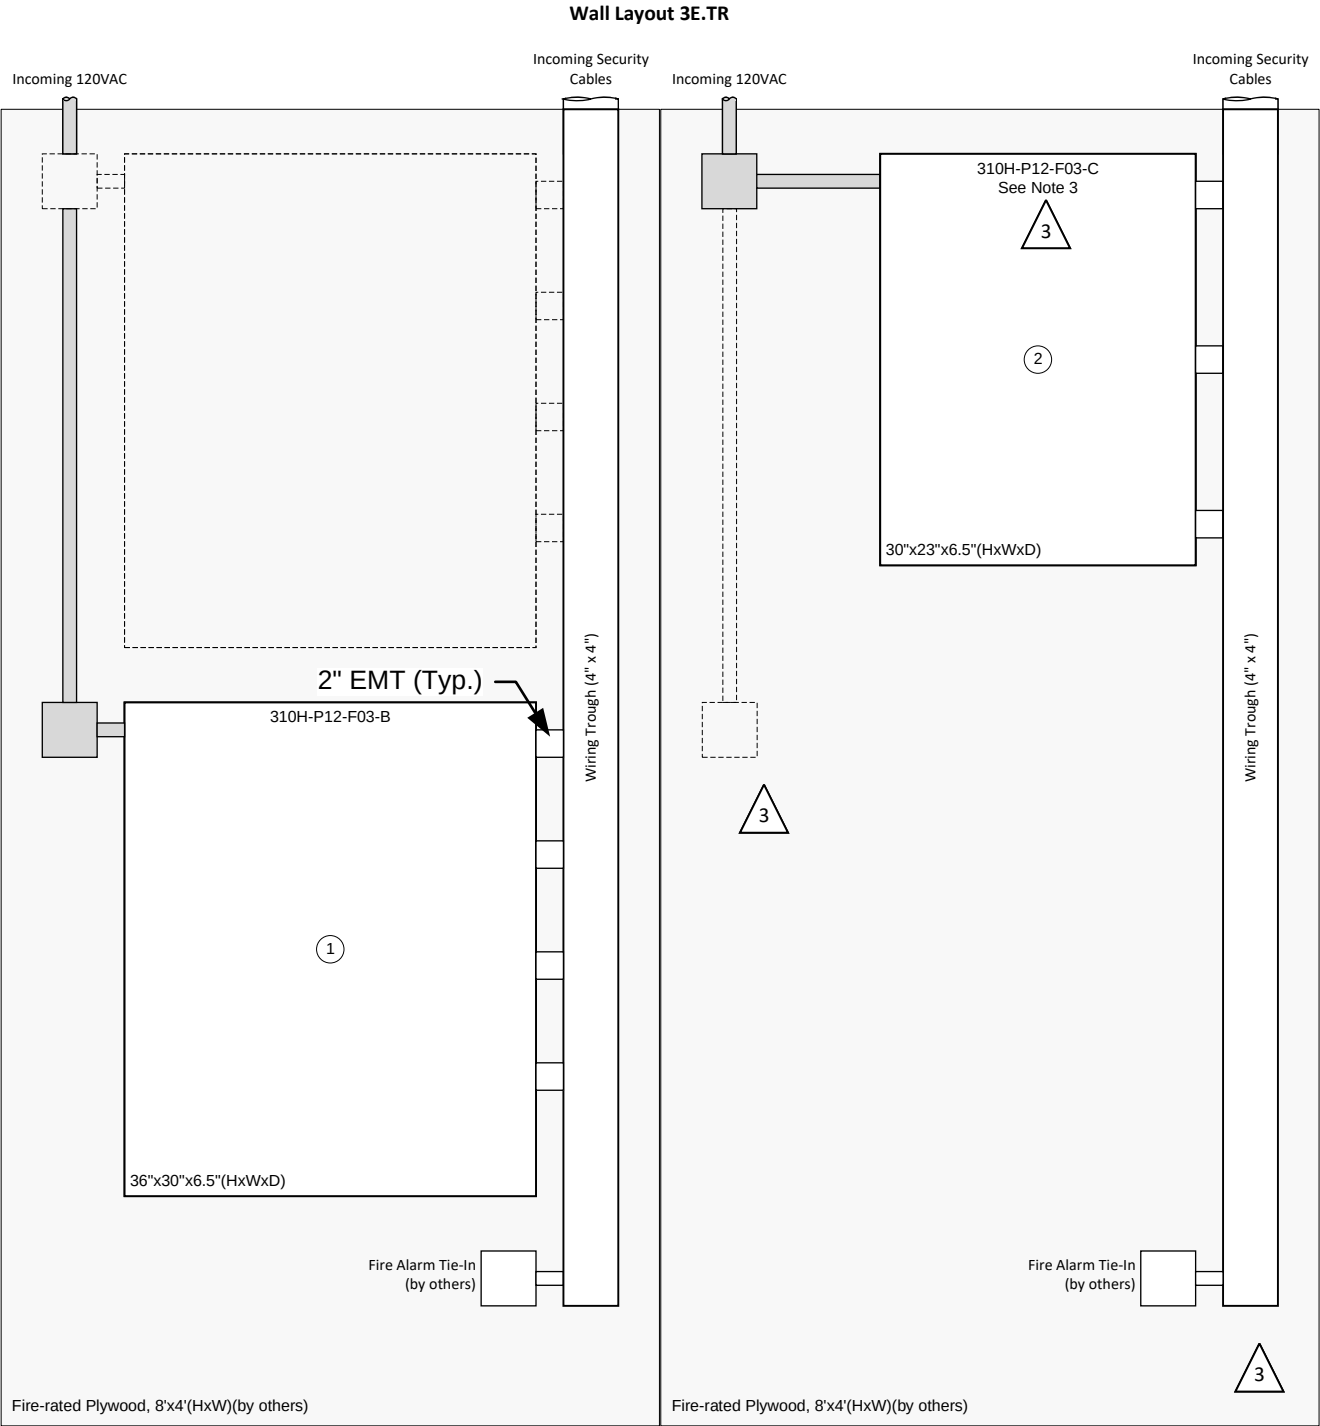

- ① LifeSafety Power, Unified Enclosure, FPO150/250-2M82M8PNLXE8M3-WP-DSNY02
- ② LifeSafety Power, Unified Enclosure, FPO250-B100M8M8PNL4E6M1-WP-DSNY01

- Notes:
- Dotted lines represent space needed for Core & Shell enclosures.
 - Layout shown for equipment panel requirements only. Exact location of equipment shall be based on coordination with the GC.
 - Potential upgrade to "Large" Enclosure (Part# FPO150/250-2M82M8PNLXE8M3-WP-DSNY02). Pending CO approval.

Equipment	Current(A)
310H-P12-F03-B	5.7
310H-P12-F03-C	3.2
Total	8.9

REVISION		Submitted		APP	
#	DATE	DESCRIPTION	BY	TN	TN
0	7/18/2022	Submittal	MF	TN	TN
1	11/4/2022	Revision 1	KW	TN	TN
2	1/25/2023	Revision 2	TNG	TN	TN
3	3/15/2023	Revision 3	TNG	TN	TN
4	8/4/2023	Revision 4	TNG	TN	TN

Package 2


Levels 3, 4, 5

Project Galaxy - Fitout

310 Hudson Street
New York, NY 10013

Security Wallfield Layouts


Systems Description		Drawing Size	
Security Systems	Job Number	ANSI B	
	Drawing Number	None	
SEC-G01-P2			

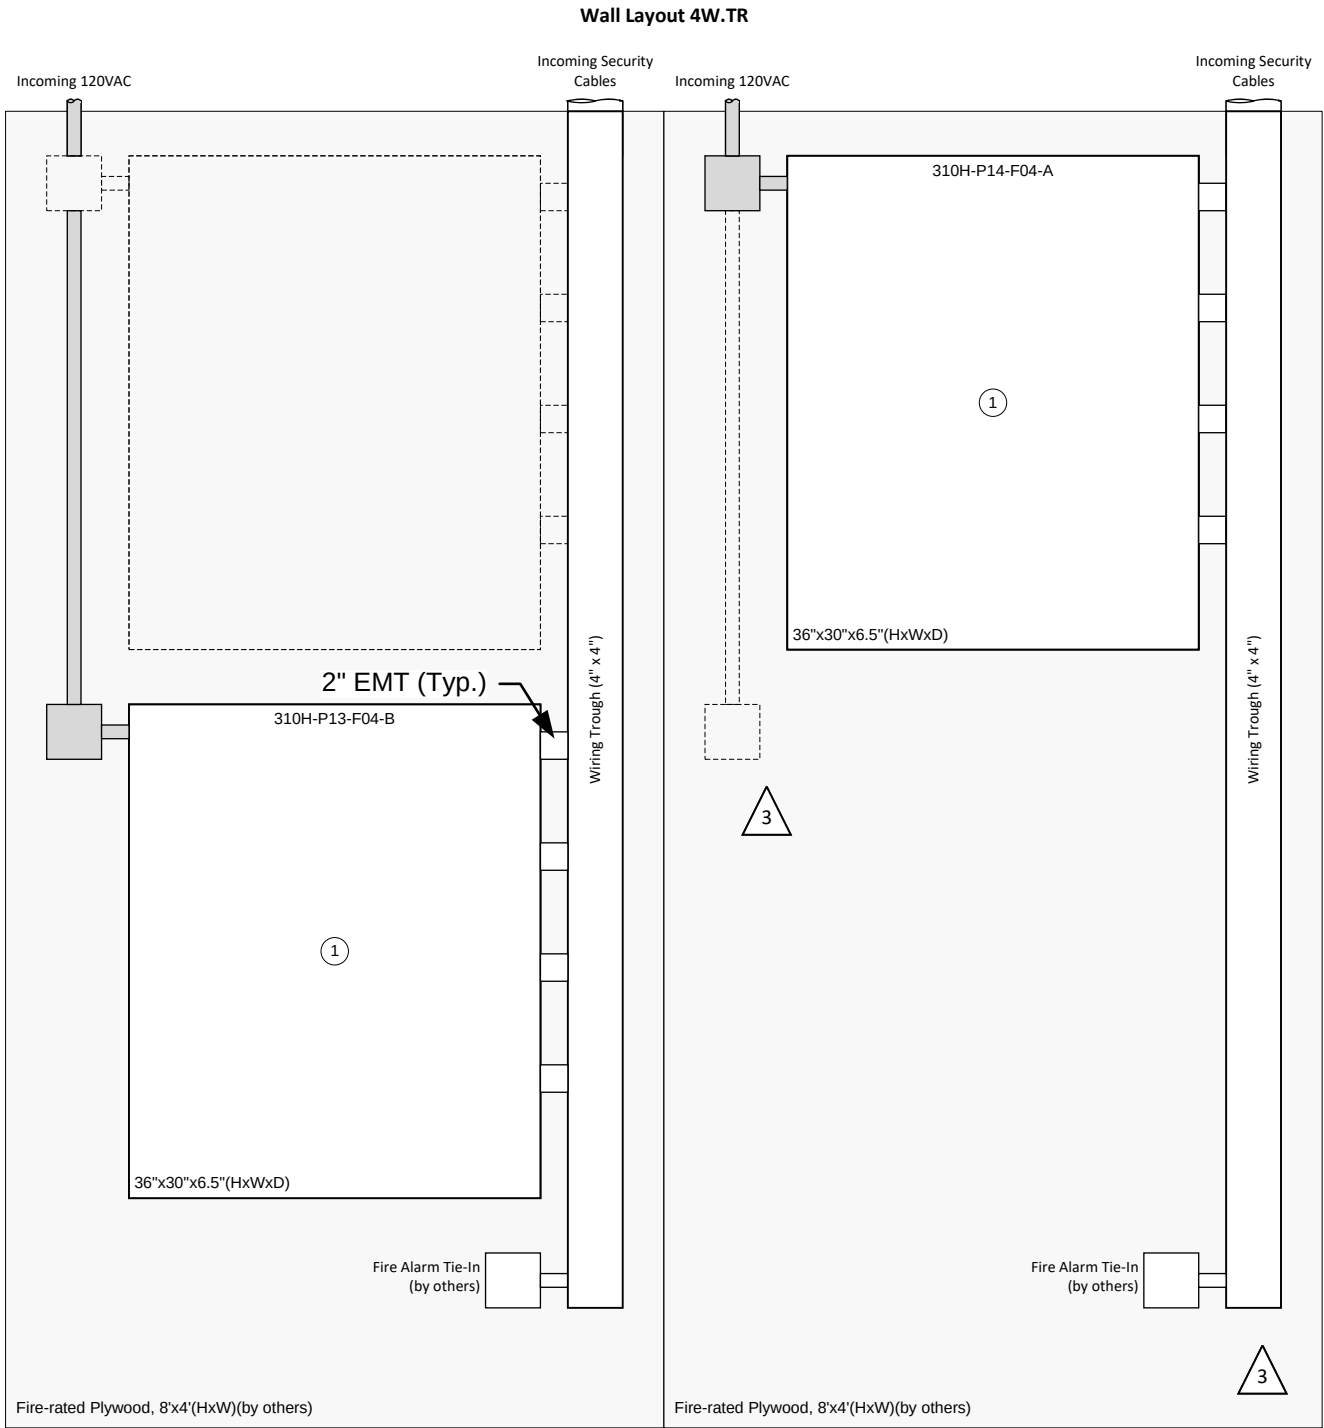

① LifeSafety Power, Unified Enclosure, FPO150/250-2M82M8PNLXE8M3-WP-DSNY02

- Notes:
- Dotted lines represent space needed for Core & Shell enclosures.
 - Layout shown for equipment panel requirements only. Exact location of equipment shall be based on coordination with the GC.

Equipment	Current(A)
310H-P13-F04-B	5.7
310H-P14-F04-A	5.7
Total	11.4

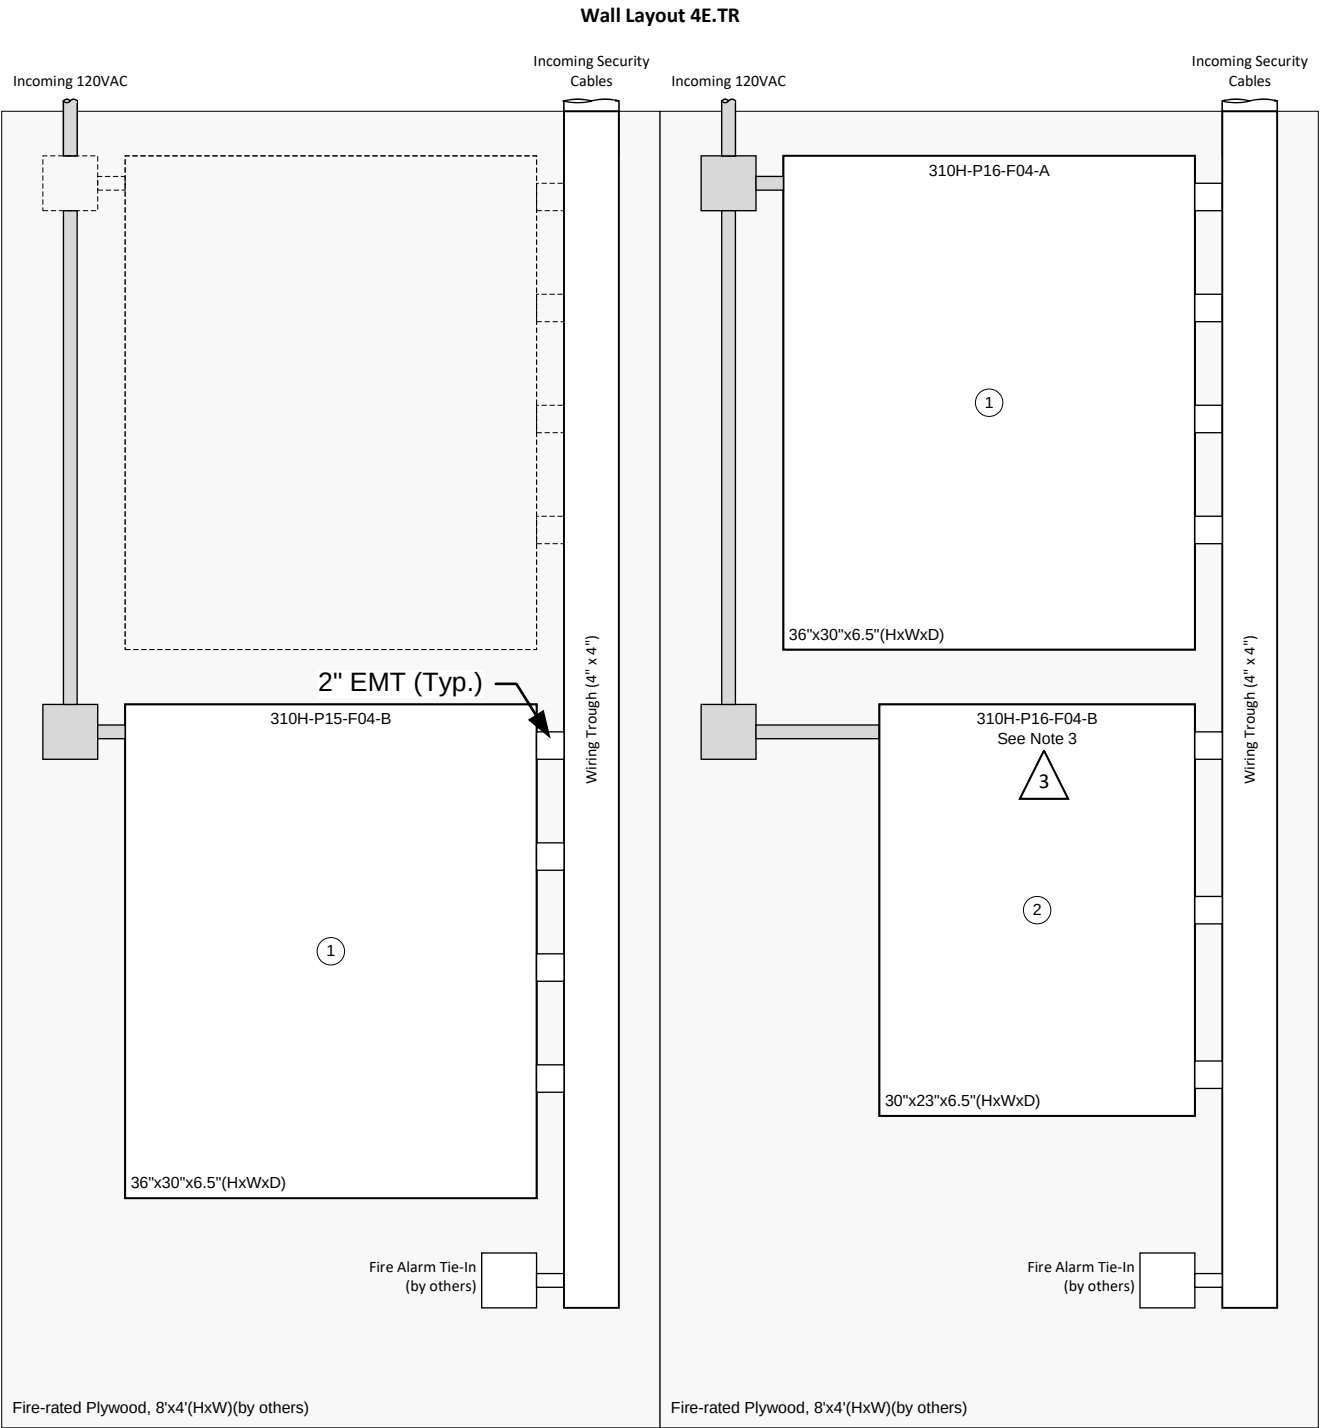

① LifeSafety Power, Unified Enclosure, FPO150/250-2M82M8PNLXE8M3-WP-DSNY02

② LifeSafety Power, Unified Enclosure, FPO250-B100M8M8PNL4E6M1-WP-DSNY01

- Notes:
- Dotted lines represent space needed for Core & Shell enclosures.
 - Layout shown for equipment panel requirements only. Exact location of equipment shall be based on coordination with the GC.
 - Potential upgrade to "Large" Enclosure (Part# FPO150/250-2M82M8PNLXE8M3-WP-DSNY02). Pending CO approval.

Equipment	Current(A)
310H-P15-F04-B	5.7
310H-P16-F04-A	5.7
310H-P16-F04-B	3.2
Total	14.6




REVISION		Submitted		APP	
#	DATE	DESCRIPTION	BY	TN	TN
0	7/18/2022	Submittal	MF	TN	TN
1	11/4/2022	Revision 1	KW	TN	TN
2	1/25/2023	Revision 2	TNG	TN	TN
3	3/15/2023	Revision 3	TNG	TN	TN
4	8/4/2023	Revision 4	TNG	TN	TN

Package 2
Levels 3, 4, 5

Project Galaxy - Fitout
310 Hudson Street
New York, NY 10013
Security Wallfield Layouts


Systems Description		Security Systems	
Job Number	NC22N5230	Drawing Size	ANSI B
Drawing Number	SEC-G02-P2	Drawing Scale	None

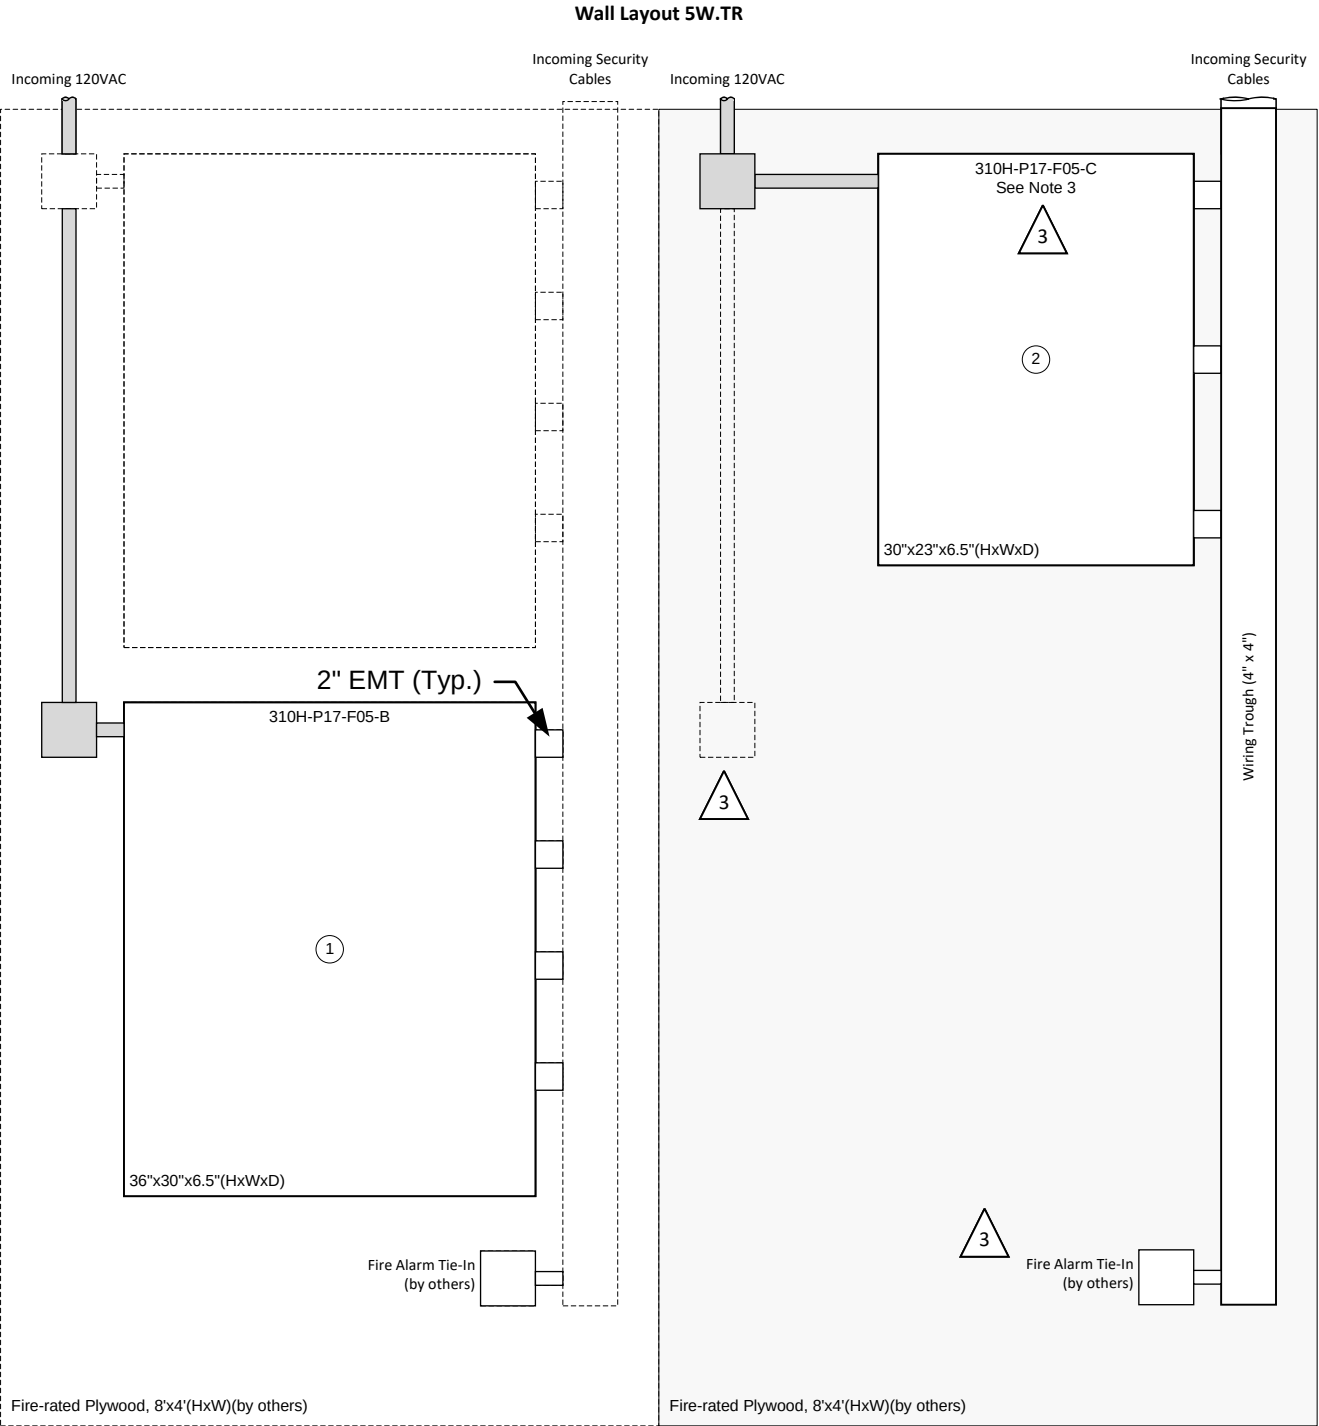

- ① LifeSafety Power, Unified Enclosure, FPO150/250-2M82M8PNLXE8M3-WP-DSNY02
② LifeSafety Power, Unified Enclosure, FPO250-B100M8M8PNL4E6M1-WP-DSNY01

Notes:
1. Dotted lines represent space needed for Core & Shell enclosures.
2. Layout shown for equipment panel requirements only. Exact location of equipment shall be based on coordination with the GC.
3. Potential upgrade to "Large" Enclosure (Part# FPO150/250-2M82M8PNLXE8M3-WP-DSNY02). Pending CO approval.

Equipment	Current(A)
310H-P17-F05-B	5.7
310H-P17-F05-C	3.2
Total	8.9

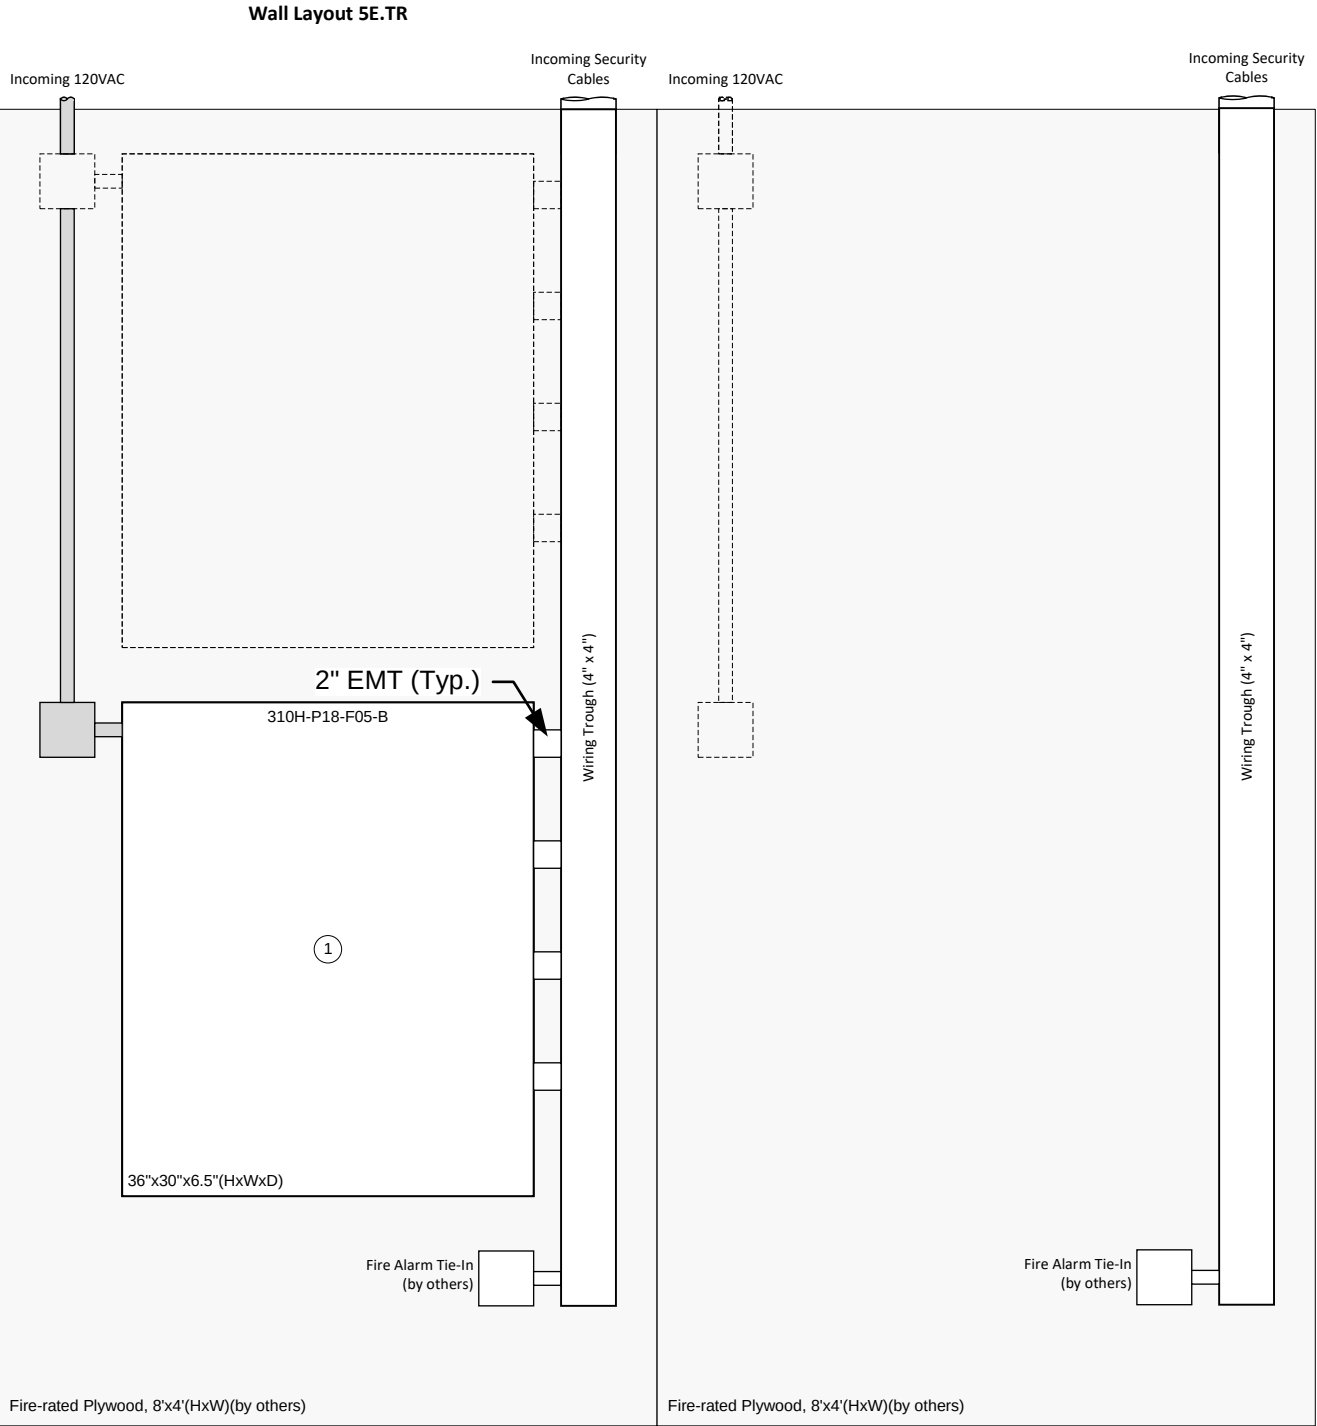

- ① LifeSafety Power, Unified Enclosure, FPO150/250-2M82M8PNLXE8M3-WP-DSNY02

Notes:
1. Dotted lines represent space needed for Core & Shell enclosures.
2. Layout shown for equipment panel requirements only. Exact location of equipment shall be based on coordination with the GC.

Equipment	Current(A)
310H-P18-F05-B	5.7
Total	5.7

REVISION		Submitted		APP	
#	DATE	DESCRIPTION	BY	TN	TN
0	7/18/2022	Submittal	MF	TN	TN
1	11/4/2022	Revision 1	KW	TN	TN
2	1/25/2023	Revision 2	TNG	TN	TN
3	3/15/2023	Revision 3	TNG	TN	TN
4	8/4/2023	Revision 4	TNG	TN	TN


Package 2
Levels 3, 4, 5

Project Galaxy - Fitout
310 Hudson Street
New York, NY 10013
Security Wallfield Layouts

Systems Description		Drawing Size	
Security Systems	Job Number	ANSI B	
	NC22N5230	Drawing Scale	
SEC-G03-P2		None	

Panel Type A – Layout Details (310H-PYY-ZZZ-B)

Panel Layout

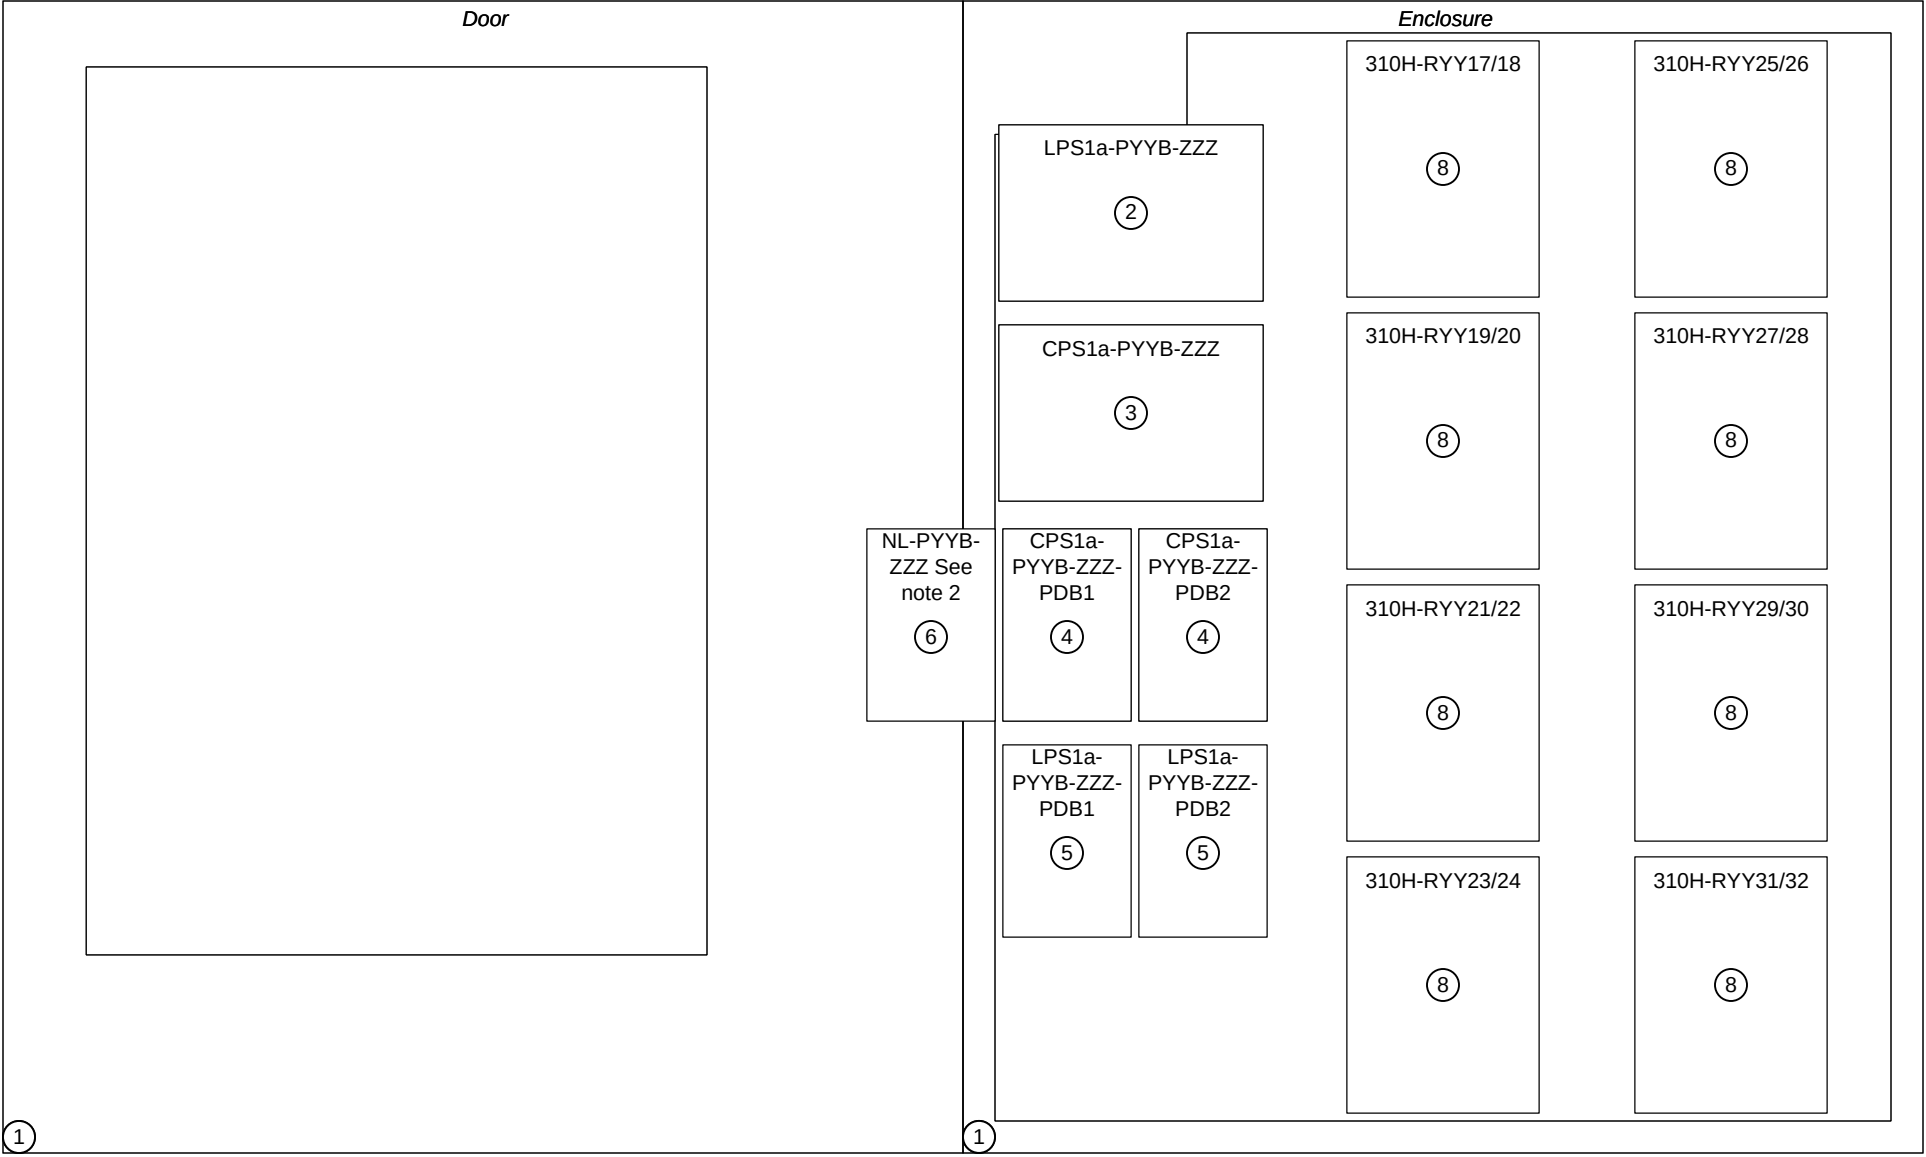

Components

- ① LifeSafety Power, Unified Enclosure w/door backplate, FPO150/250-2M82M8PNLXE8M3-WP-DSNY02 includes
 - ① LifeSafety Power, Unified Enclosure, E8M3
 - ② LifeSafety Power, Power Supply, FPO150
 - ③ LifeSafety Power, Power Supply, FPO250
 - ④ LifeSafety Power, Distribution Module, M8P
 - ⑤ LifeSafety Power, Distribution Module, M8
 - ⑥ LifeSafety Power, Network Module, NLX
- ⑧ Lenel, Dual Reader Interface Module, LNL-1320-S3

Note:

- YY represents 2 digit panel number, ZZZ represents the floor number.
- Network Module NLX mounted underneath the Distribution Module M8 (CPS1a-PYYB-ZZZ-PDB1).
- This typical panel layout applies to the following Access Control Panels: 310H-P11-F03-B, 310H-P12-F03-B, 310H-P13-F04-B, 310H-P15-F04-B, 310H-P17-F05-B.



These drawings and designs are the property of Schneider Electric. Their use or reproduction without prior consent of the company is strictly forbidden.


REVISION		Submitted			
#	DATE	DESCRIPTION	BY	APP	
0	7/18/2022	Submittal	MF	TN	
1	11/4/2022	Revision 1	KW	TN	
2	1/25/2023	Revision 2	TNG	TN	
3	3/15/2023	Revision 3	TNG	TN	
4	8/4/2023	Revision 4	TNG	TN	

Package 2
Levels 3, 4, 5

Systems Description		Project Galaxy - Fitout	
Security Systems		310 Hudson Street New York, NY 10013	
Job Number	Drawing Size	Security Enclosure Layouts	
NC22N5230	ANSI B		
Drawing Number	Drawing Scale		
SEC-H01-P2	None		

Panel Type B – Layout Details (310H-P18-F05-B)

Panel Layout

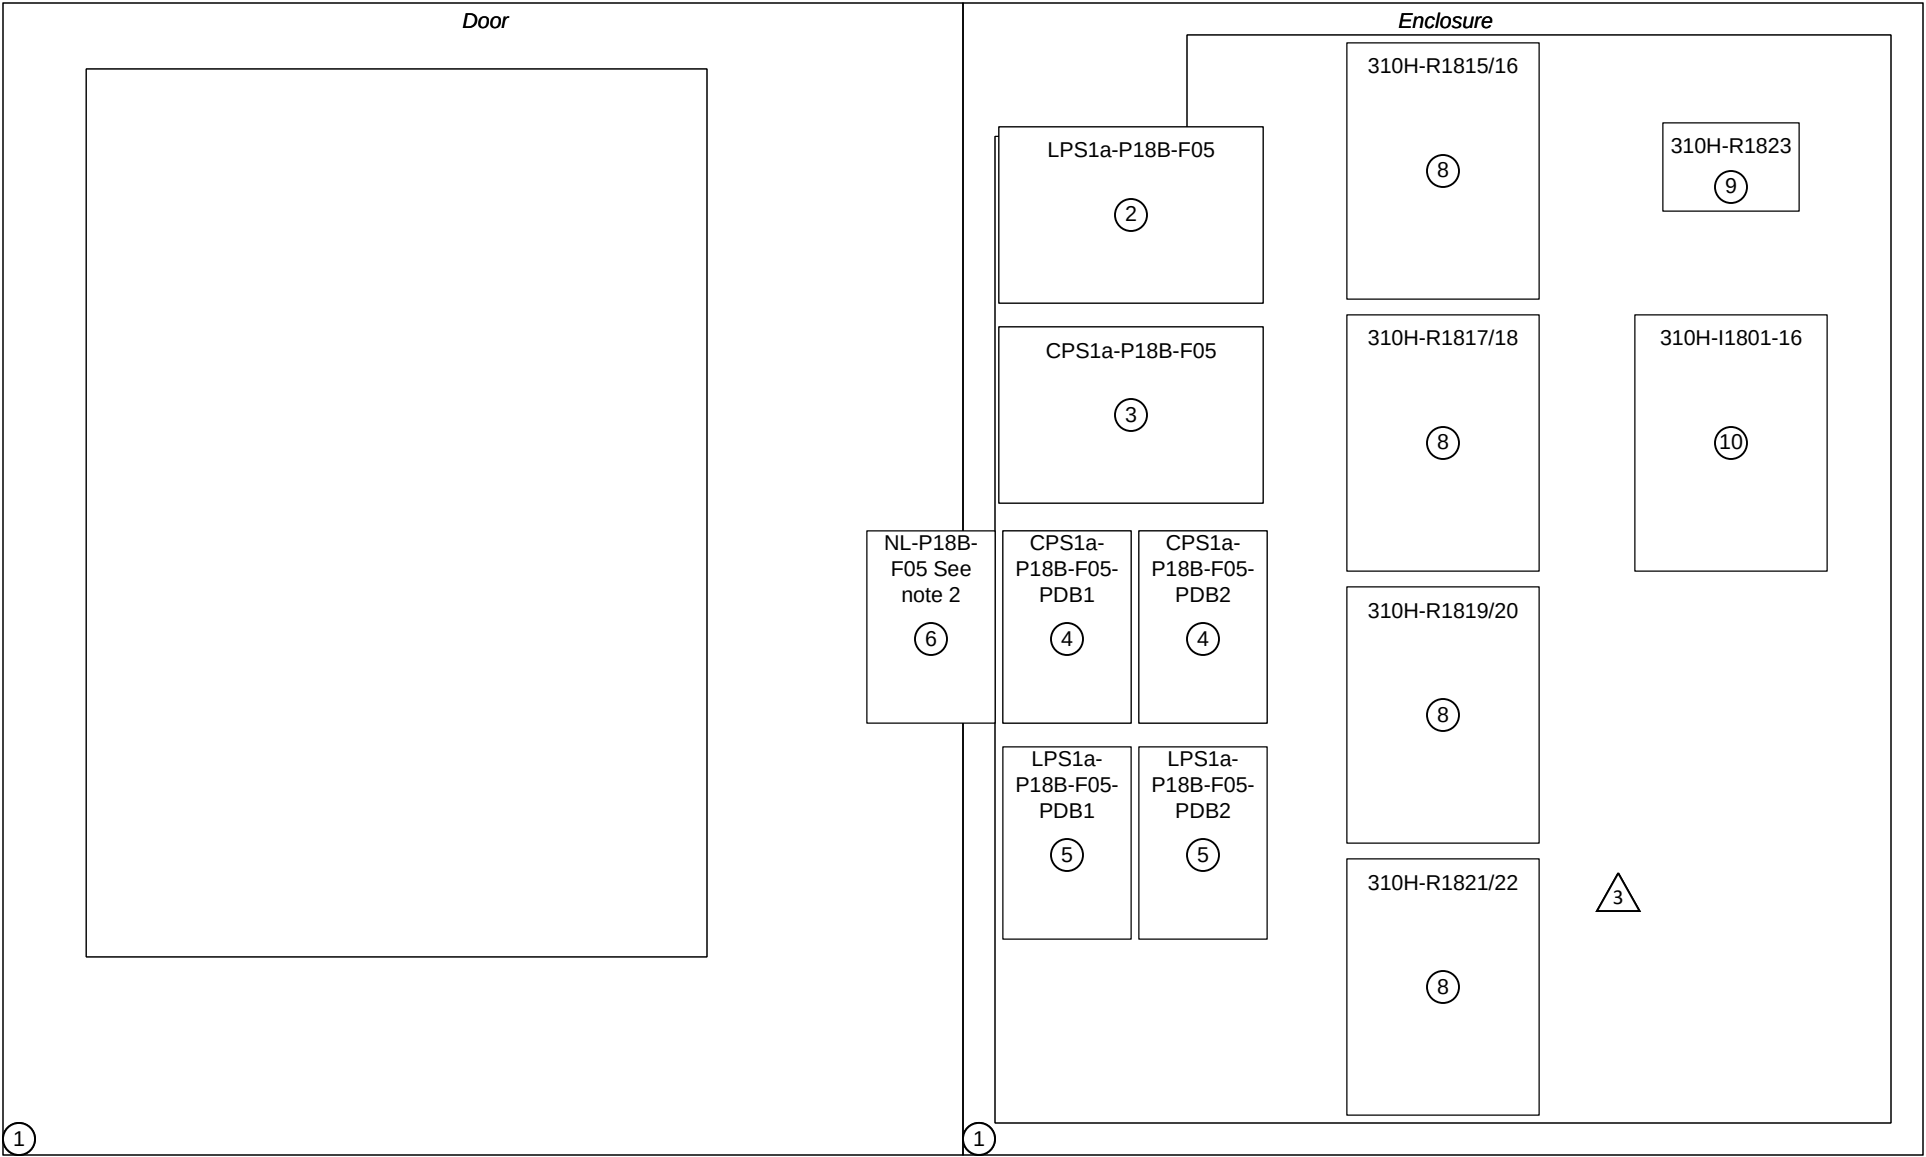

Components

- ① LifeSafety Power, Unified Enclosure w/door backplate, FPO150/250-2M82M8PNLXE8M3-WP-DSNY02 includes
- ① LifeSafety Power, Unified Enclosure, E8M3
 - ② LifeSafety Power, Power Supply, FPO150
 - ③ LifeSafety Power, Power Supply, FPO250
 - ④ LifeSafety Power, Distribution Module, M8P
 - ⑤ LifeSafety Power, Distribution Module, M8
 - ⑥ LifeSafety Power, Network Module, NLX
- ⑧ Lenel, Dual Reader Interface Module, LNL-1320-S3
- ⑨ Lenel, Single Reader Interface Module, LNL-1300-S3
- ⑩ Lenel, Input Control Module, LNL-1100-S3

Note:

1. Network Module NLX mounted underneath the Distribution Module M8 (CPS1a-P18B-F05-PDB1).



These drawings and designs are the property of Schneider Electric. Their use or reproduction without prior consent of the company is strictly forbidden.


REVISION		Submitted			
#	DATE	DESCRIPTION	BY	APP	
0	7/18/2022	Submittal	MF	TN	TN
1	11/4/2022	Revision 1	KW	TN	TN
2	1/25/2023	Revision 2	TNG	TN	TN
3	3/15/2023	Revision 3	TNG	TN	TN
4	8/4/2023	Revision 4	TNG	TN	TN

Package 2
Levels 3, 4, 5

Systems Description		Project Galaxy - Fitout	
Security Systems		310 Hudson Street New York, NY 10013	
Job Number	Drawing Size	Security Enclosure Layouts	
NC22N5230	ANSI B		
Drawing Number	Drawing Scale		
SEC-H02-P2	None		

Panel Type C – Layout Details (310H-P14-F04-A)

Panel Layout

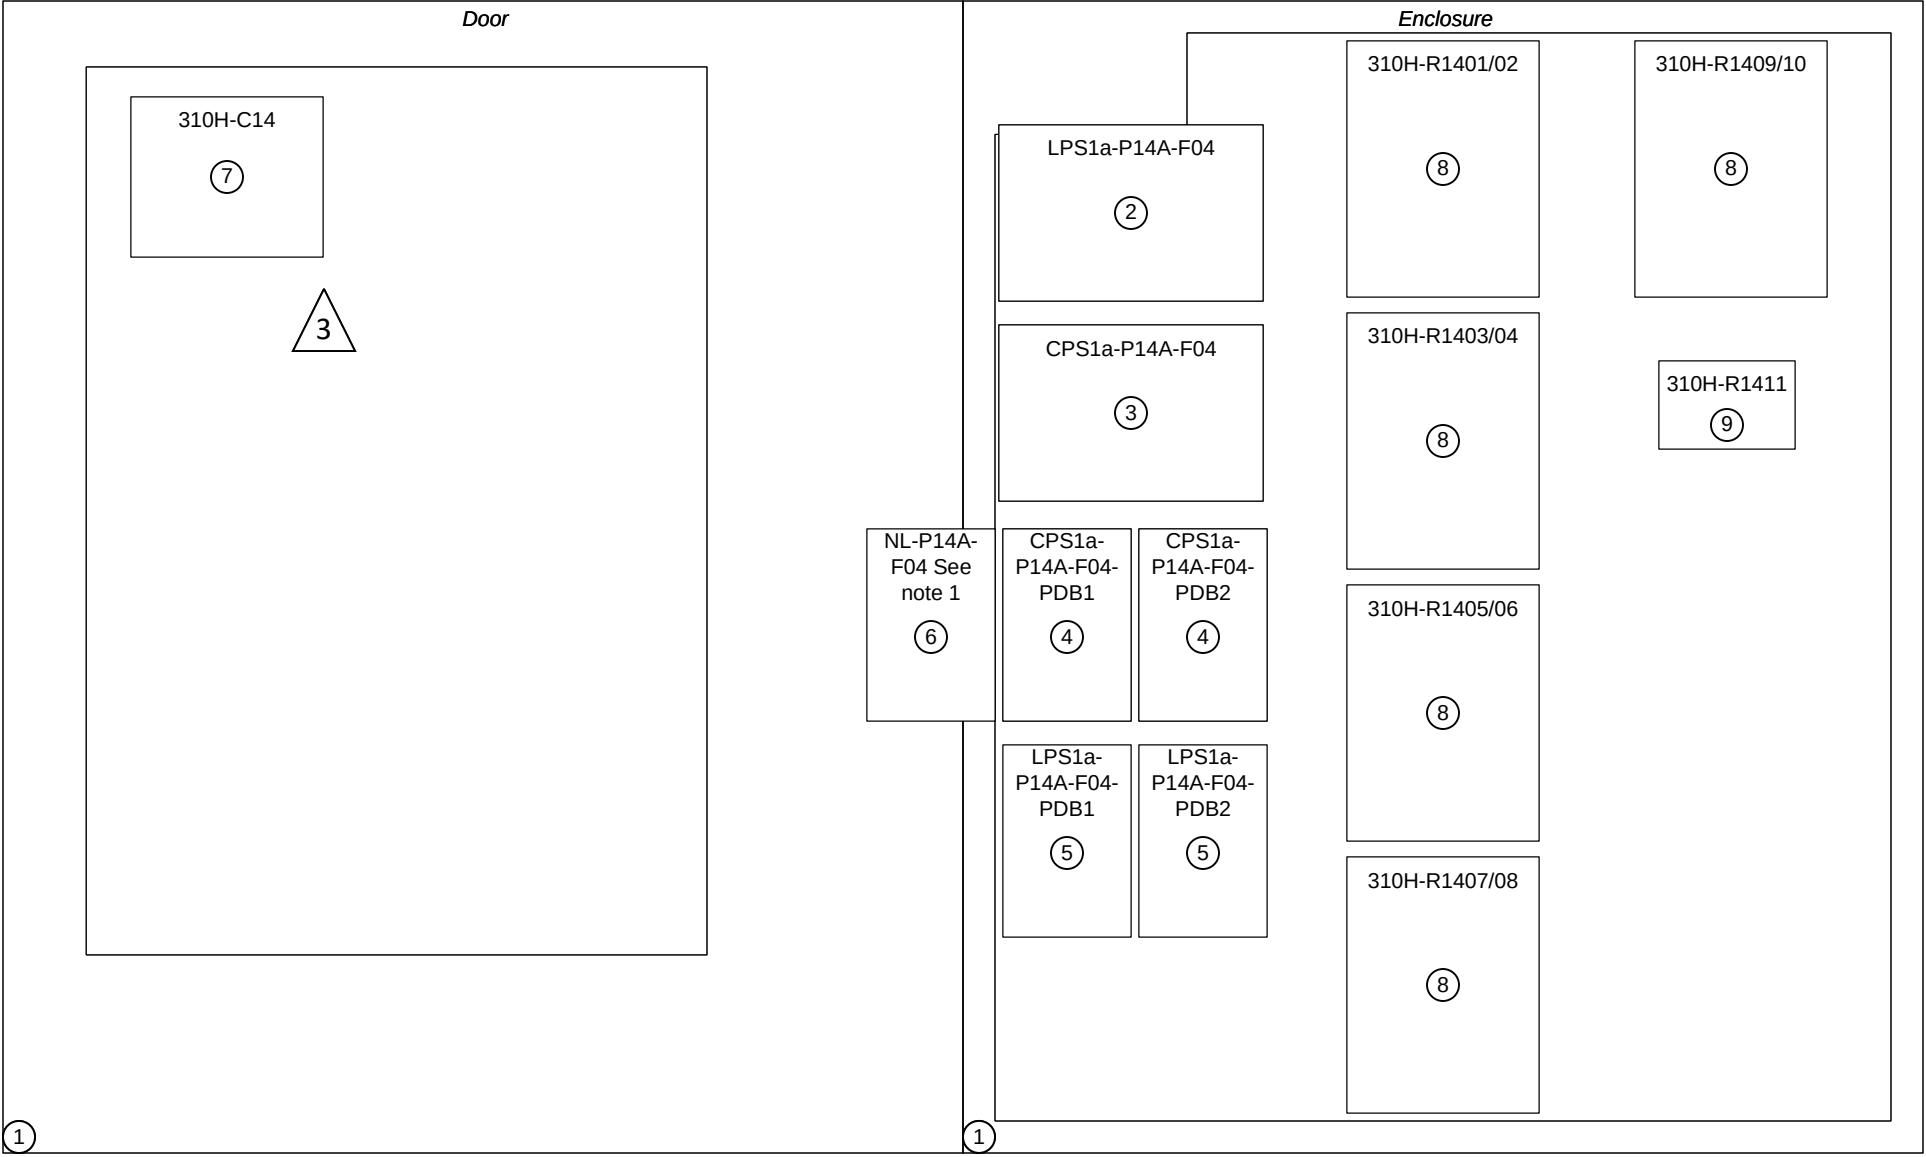

Components

- ① LifeSafety Power, Unified Enclosure w/door backplate, FPO150/250-2M82M8PNLXE8M3-WP-DSNY02 includes
 - ① LifeSafety Power, Unified Enclosure, E8M3
 - ② LifeSafety Power, Power Supply, FPO150
 - ③ LifeSafety Power, Power Supply, FPO250
 - ④ LifeSafety Power, Distribution Module, M8P
 - ⑤ LifeSafety Power, Distribution Module, M8
 - ⑥ LifeSafety Power, Network Module, NLX
- ⑦ Lenel, Intelligent System Controller, LNL-X3300
- ⑧ Lenel, Dual Reader Interface Module, LNL-1320-S3
- ⑨ Lenel, Single Reader Interface Module, LNL-1300-S3

Note:

- 1. Network Module NLX mounted underneath the Distribution Module M8 (CPS1a-P14A-F04-PDB1).


REVISION		Submitted			
#	DATE	DESCRIPTION	BY	APP	
0	7/18/2022	Submittal	MF	TN	
1	11/4/2022	Revision 1	KW	TN	
2	1/25/2023	Revision 2	TNG	TN	
3	3/15/2023	Revision 3	TNG	TN	
4	8/4/2023	Revision 4	TNG	TN	

Project Galaxy - Fitout		Security Enclosure Layouts
310 Hudson Street		
New York, NY 10013		

Systems Description		Drawing Size	Drawing Scale
Security Systems			
Job Number	NC22N5230	ANSI B	
Drawing Number	SEC-H03-P2		None

Panel Type D – Layout Details (310H-P11-F03-C)

Panel Layout

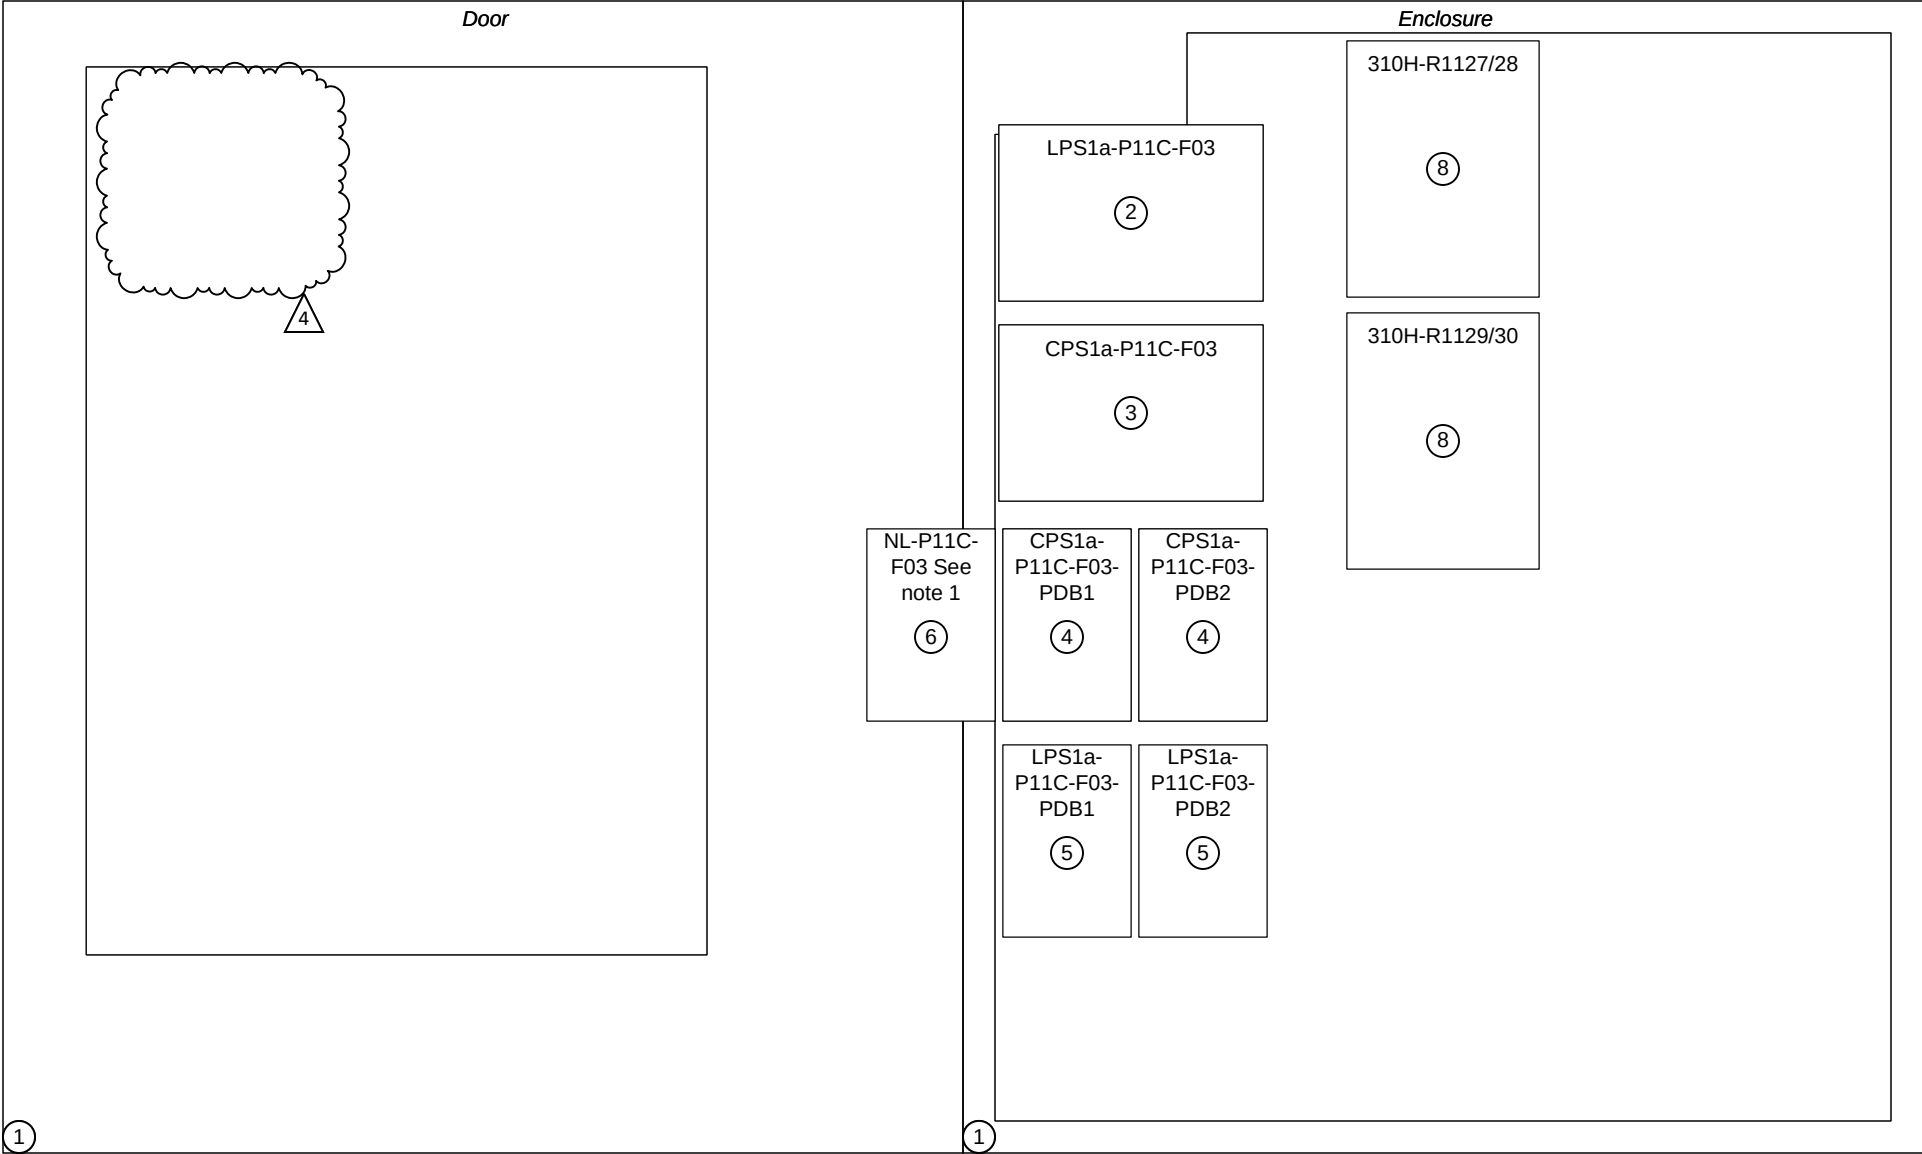

Components

- ① LifeSafety Power, Unified Enclosure w/door backplate, FPO150/250-2M82M8PNLXE8M3-WP-DSNY02 includes
 - ① LifeSafety Power, Unified Enclosure, E8M3
 - ② LifeSafety Power, Power Supply, FPO150
 - ③ LifeSafety Power, Power Supply, FPO250
 - ④ LifeSafety Power, Distribution Module, M8P
 - ⑤ LifeSafety Power, Distribution Module, M8
 - ⑥ LifeSafety Power, Network Module, NLX
- ⑧ Lenel, Dual Reader Interface Module, LNL-1320-S3

Note:

- 1. Network Module NLX mounted underneath the Distribution Module M8 (CPS1a-P11C-F03-PDB1).



These drawings and designs are the property of Schneider Electric. Their use or reproduction without prior consent of the company is strictly forbidden.


REVISION		Submitted		BY		APP	
#	DATE	DESCRIPTION		MF	TN	TN	TN
0	7/18/2022	Submittal					
1	11/4/2022	Revision 1		KW	TN	TN	TN
2	1/25/2023	Revision 2		TNG	TN	TN	TN
3	3/15/2023	Revision 3		TNG	TN	TN	TN
4	8/4/2023	Revision 4		TNG	TN	TN	TN

Package 2
Levels 3, 4, 5

Systems Description		Project Galaxy - Fitout	
Security Systems		310 Hudson Street New York, NY 10013	
Job Number	Drawing Size	Security Enclosure Layouts	
NC22N5230	ANSI B		
Drawing Number	Drawing Scale		
SEC-H04-P2	None		

Panel Type E – Layout Details (310H-P16-F04-B)

Panel Layout

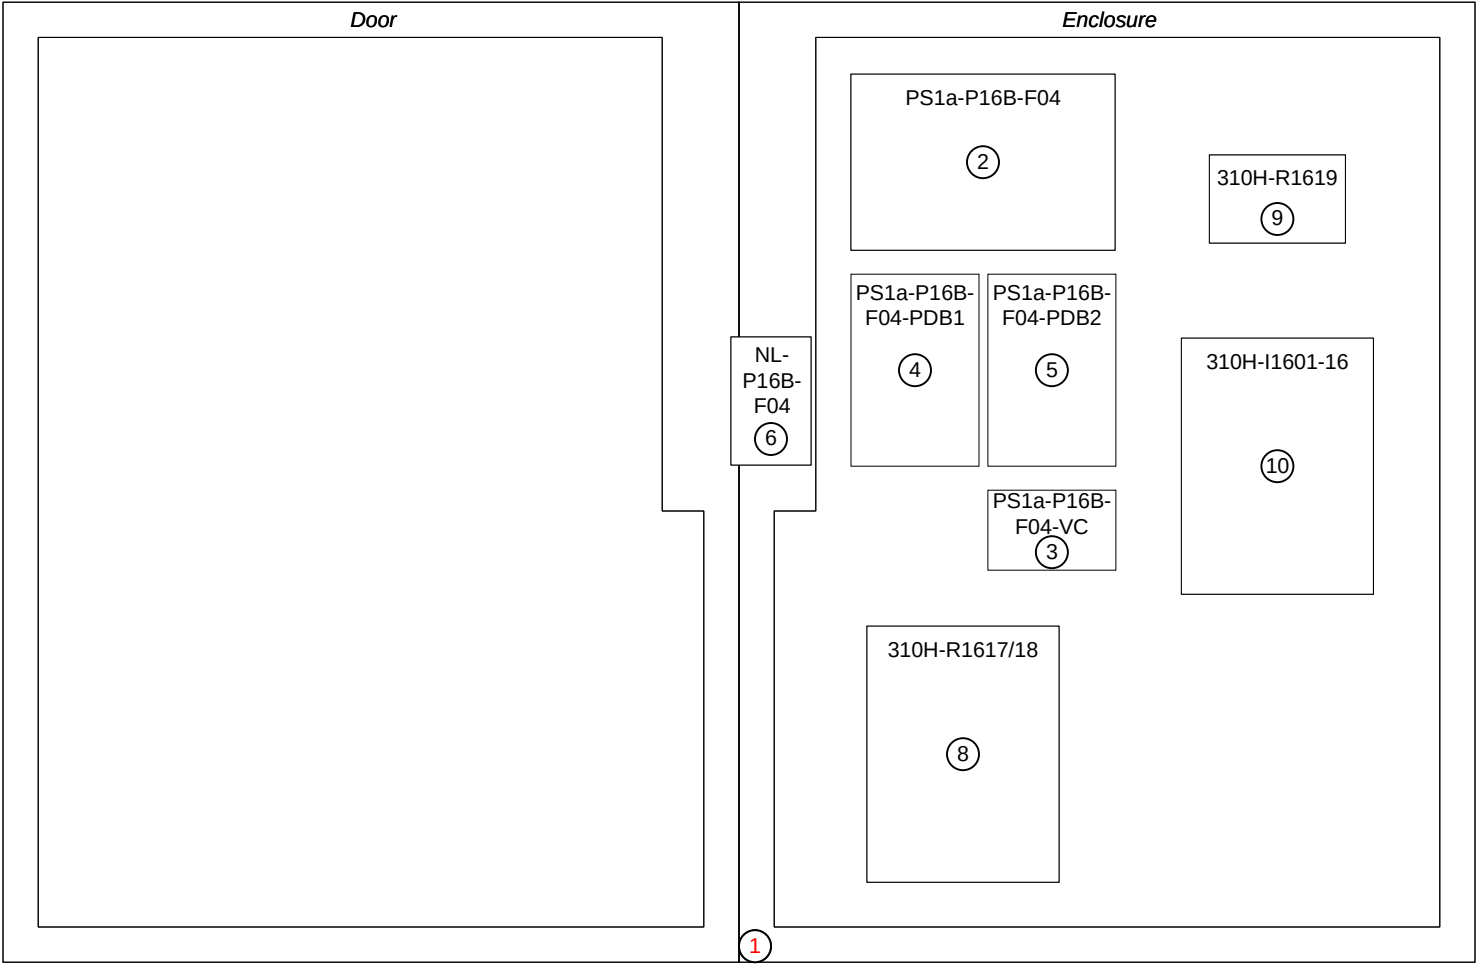

Components

- ① LifeSafety Power, Unified Enclosure, FPO250-B100M8M8PNL4E6M1-WP-DSNY01 includes:
- ① LifeSafety Power, Enclosure w/door backplate, E6M1
 - ② LifeSafety Power, Power Supply, FPO250
 - ③ LifeSafety Power, DC to DC Converter Module, B100
 - ④ LifeSafety Power, Distribution Module, M8P
 - ⑤ LifeSafety Power, Distribution Module, M8
 - ⑥ LifeSafety Power, Network Module, NL4
- ⑧ Lenel, Dual Reader Interface Module, LNL-1320-S3
- ⑨ Lenel, Single Reader Interface Module, LNL-1300-S3
- ⑩ Lenel, Input Control Module, LNL-1100-S3

Note:

1. Potential upgrade to "Large" Enclosure (Part# FPO150/250-2M82M8PNLXE8M3-WP-DSNY02). Pending CO approval.

REVISION		Submitted			
#	DATE	DESCRIPTION	BY	APP	
0	7/18/2022	Submittal	MF	TN	TN
1	11/4/2022	Revision 1	KW	TN	TN
2	1/25/2023	Revision 2	TNG	TN	TN
3	3/15/2023	Revision 3	TNG	TN	TN
4	8/4/2023	Revision 4	TNG	TN	TN


Package 2	
Levels 3, 4, 5	

Project Galaxy - Fitout	
310 Hudson Street	
New York, NY 10013	
Security Enclosure Layouts	

Systems Description	
Security Systems	
Job Number	Drawing Size
NC22N5230	ANSI B
Drawing Number	Drawing Scale
SEC-H05-P2	None

Panel Type E – Layout Details (310H-P12-F03-C)

Panel Layout

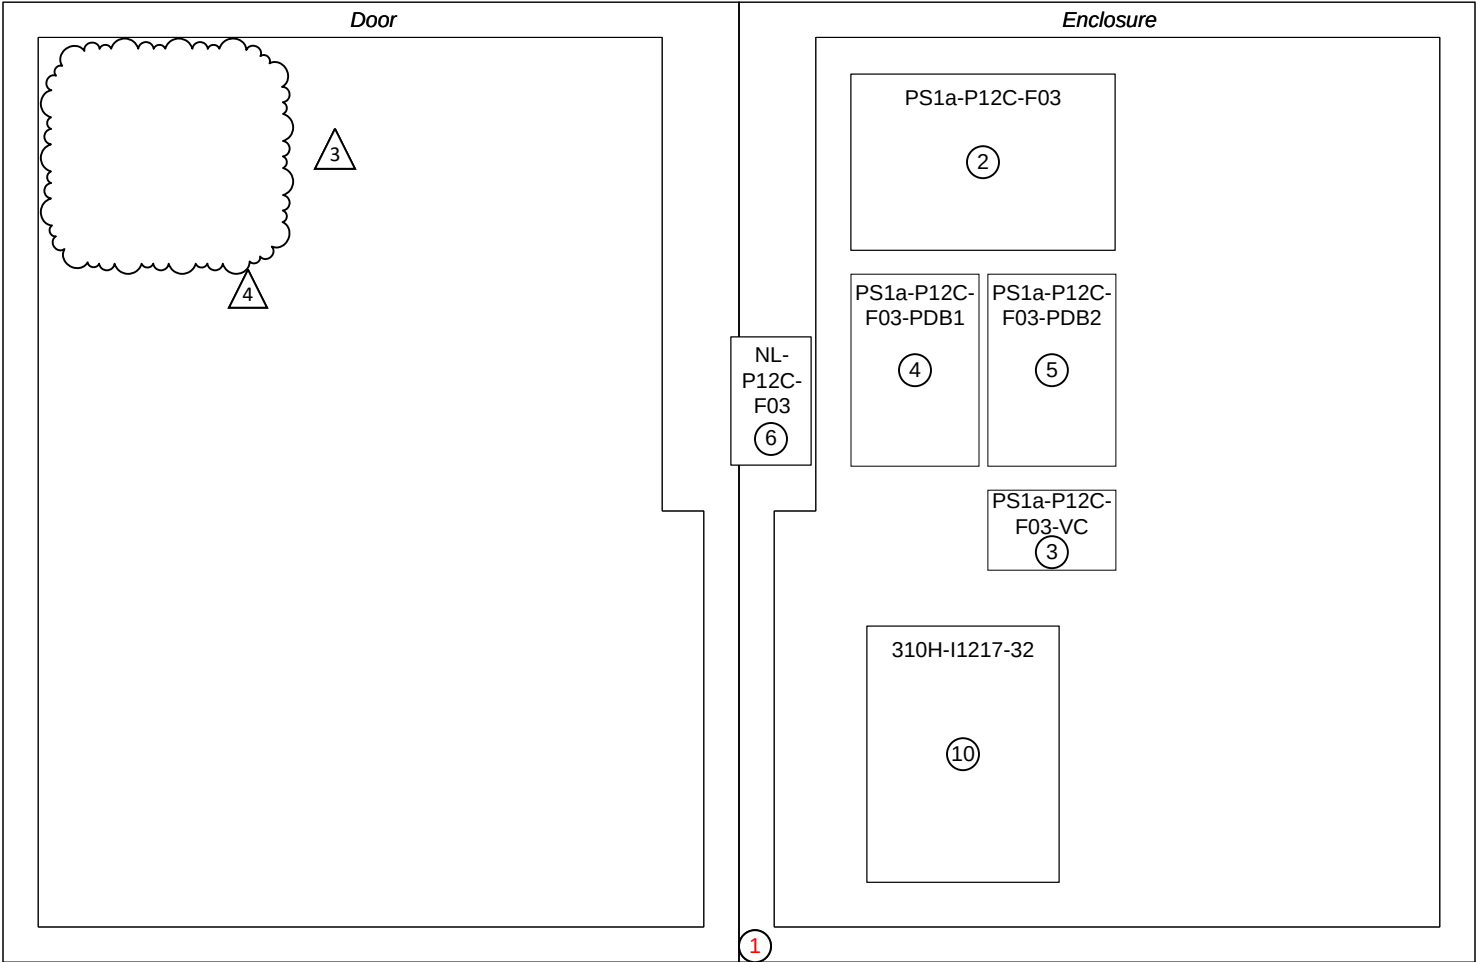

Components

- ① LifeSafety Power, Unified Enclosure, FPO250-B100M8M8PNL4E6M1-WP-DSNY01 includes:
- ① LifeSafety Power, Enclosure w/door backplate, E6M1
 - ② LifeSafety Power, Power Supply, FPO250
 - ③ LifeSafety Power, DC to DC Converter Module, B100
 - ④ LifeSafety Power, Distribution Module, M8P
 - ⑤ LifeSafety Power, Distribution Module, M8
 - ⑥ LifeSafety Power, Network Module, NL4
- ⑩ Lenel, Input Control Module, LNL-1100-S3

Note:

2. Potential upgrade to “Large” Enclosure (Part# FPO150/250-2M82M8PNLXE8M3-WP-DSNY02). Pending CO approval.



These drawings and designs are the property of Schneider Electric. Their use or reproduction without prior consent of the company is strictly forbidden.


REVISION		Submitted		BY		APP	
#	DATE	DESCRIPTION		MF	TN	TN	TN
0	7/18/2022	Submittal					
1	11/4/2022	Revision 1		KW	TN	TN	TN
2	1/25/2023	Revision 2		TNG	TN	TN	TN
3	3/15/2023	Revision 3		TNG	TN	TN	TN
4	8/4/2023	Revision 4		TNG	TN	TN	TN

Package 2
Levels 3, 4, 5

Systems Description		Project Galaxy - Fitout	
Security Systems		310 Hudson Street New York, NY 10013	
Job Number	Drawing Size	Security Enclosure Layouts	
NC22N5230	ANSI B		
Drawing Number	Drawing Scale		
SEC-H06-P2	None		

Panel Type F – Layout Details (310H-P17-F05-C)

Panel Layout

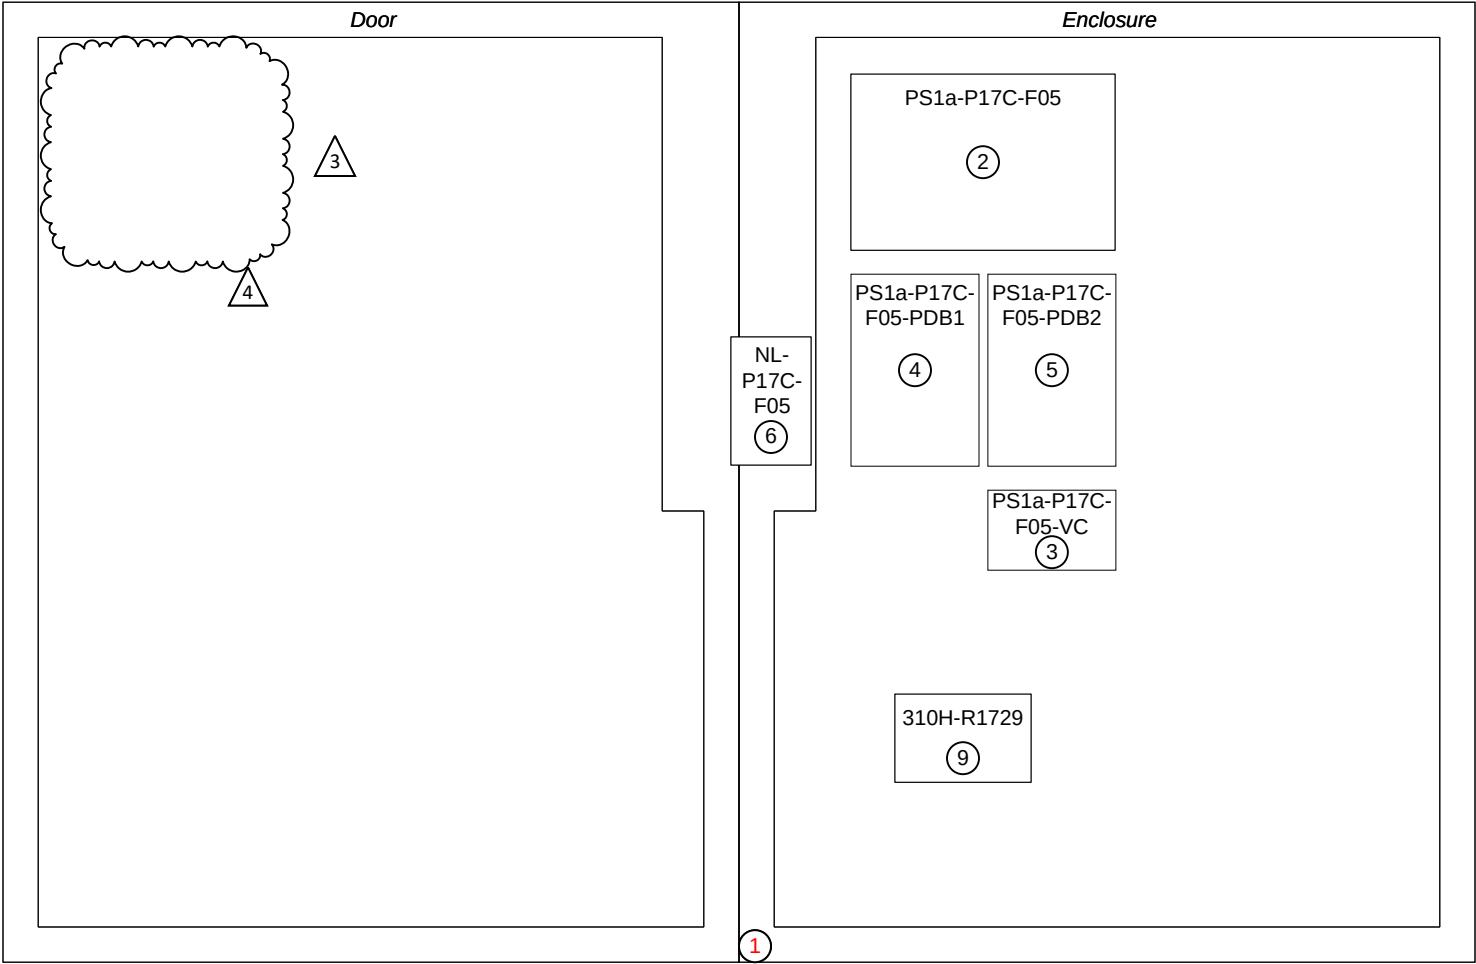

Components

- ① LifeSafety Power, Unified Enclosure, FPO250-B100M8M8PNL4E6M1-WP-DSNY01 includes:
- ① LifeSafety Power, Enclosure w/door backplate, E6M1
 - ② LifeSafety Power, Power Supply, FPO250
 - ③ LifeSafety Power, DC to DC Converter Module, B100
 - ④ LifeSafety Power, Distribution Module, M8P
 - ⑤ LifeSafety Power, Distribution Module, M8
 - ⑥ LifeSafety Power, Network Module, NL4
- ⑨ Lenel, Single Reader Interface Module, LNL-1300-S3

Note:

2. Potential upgrade to "Large" Enclosure (Part# FPO150/250-2M82M8PNLXE8M3-WP-DSNY02). Pending CO approval.


REVISION		Submitted		BY		APP	
#	DATE	DESCRIPTION		MF	TN	TN	TN
0	7/18/2022	Submittal					
1	11/4/2022	Revision 1		KW	TN	TN	TN
2	1/25/2023	Revision 2		TNG	TN	TN	TN
3	3/15/2023	Revision 3		TNG	TN	TN	TN
4	8/4/2023	Revision 4		TNG	TN	TN	TN

Package 2
Levels 3, 4, 5

Systems Description		Project Galaxy - Fitout	
Security Systems		310 Hudson Street New York, NY 10013	
Job Number	Drawing Size	Security Enclosure Layouts	
NC22N5230	ANSI B		
Drawing Number	Drawing Scale		
SEC-H07-P2	None		

Panel Type G – Layout Details (310H-P16-F04-A)

Panel Layout

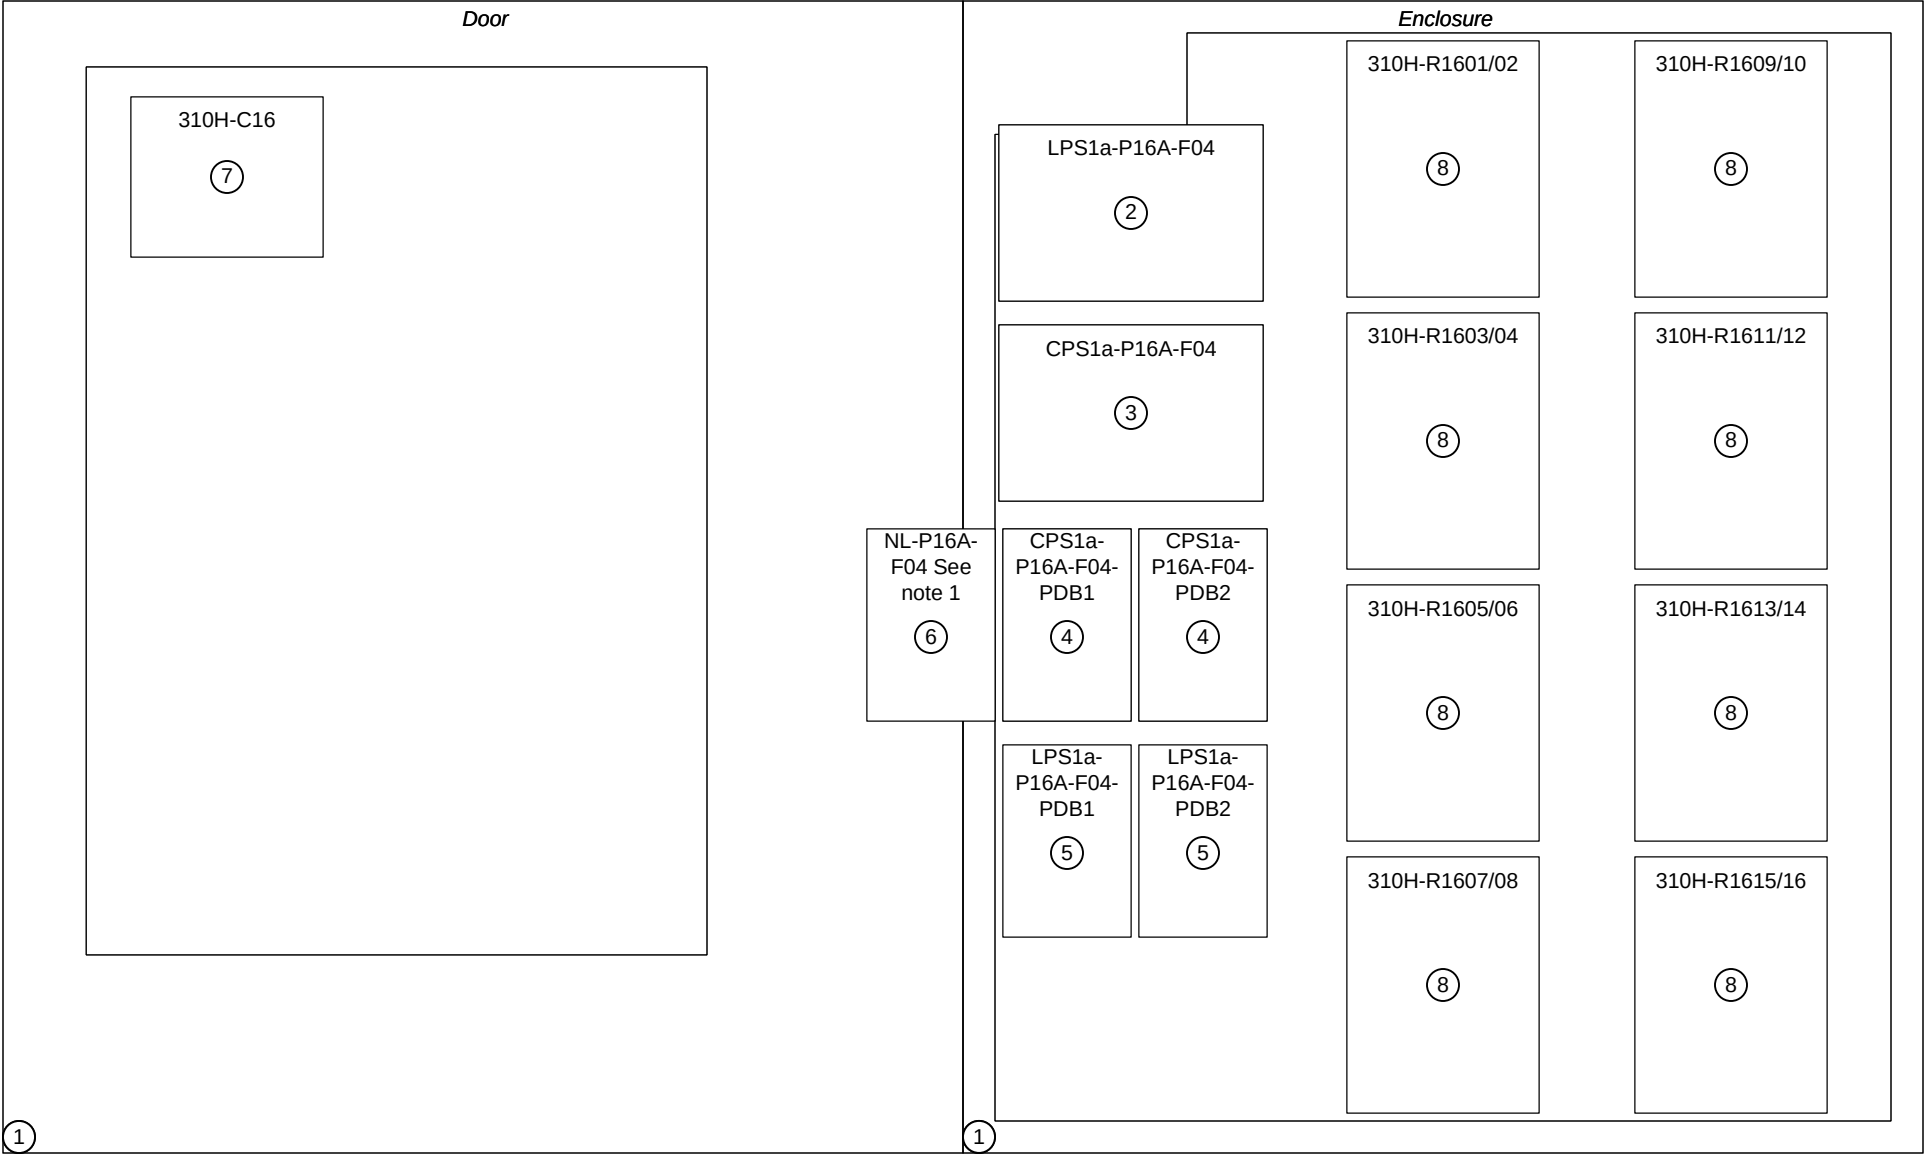

Components

- ① LifeSafety Power, Unified Enclosure w/door backplate, FPO150/250-2M82M8PNLXE8M3-WP-DSNY02 includes
 - ① LifeSafety Power, Unified Enclosure, E8M3
 - ② LifeSafety Power, Power Supply, FPO150
 - ③ LifeSafety Power, Power Supply, FPO250
 - ④ LifeSafety Power, Distribution Module, M8P
 - ⑤ LifeSafety Power, Distribution Module, M8
 - ⑥ LifeSafety Power, Network Module, NLX
- ⑦ Lenel, Intelligent System Controller, LNL-X3300
- ⑧ Lenel, Dual Reader Interface Module, LNL-1320-S3

Note:

- 1. Network Module NLX mounted underneath the Distribution Module M8 (CPS1a-P30-F03-PDB1).



REVISION		Submitted		BY		APP	
#	DATE	DESCRIPTION		MF	TN	TN	TN
0	7/18/2022	Submittal					
1	11/4/2022	Revision 1		KW	TN		
2	1/25/2023	Revision 2		TNG	TN		
3	3/15/2023	Revision 3		TNG	TN		
4	8/4/2023	Revision 4		TNG	TN		

Package 2
Levels 3, 4, 5

Project Galaxy - Fitout
310 Hudson Street
New York, NY 10013
Security Enclosure Layouts

Systems Description		Security Systems	
Job Number	NC22N5230	Drawing Size	ANSI B
Drawing Number	SEC-H08-P2	Drawing Scale	None

Hardware Legend		
Hardware Type ID	Hardware Category	Hardware Subcategory
ACT(T1)	ADO Actuator	Interior
ADO(T1)	ADO Operator	Interior
CR(T1)	Card Reader	Standard
DA(T1)	Duress Button	Standard
DC(T1)	Door Contact	Recessed
DC(T2)	Door Contact	Other
ICU(T1)	Intercom Unlock	Standard
IN(T1)	Aux. Input	Other
L(T1)	Lock Hardware	Electrified Mortise
L(T2)	Lock Hardware	Electromagnetic
L(T3)	Lock Hardware	Electric Strike
REX(T1)	Request-to-exit Device	Built-in Switch
REX(T2)	Request-to-exit Device	Motion Sensor
REX(T3)	Request-to-exit Device	Push Button

Access Control Board Terminations Legend			
ACS Board Termination Point	Description	Example	Example Description
C#	Card Reader Port #	CR-C1	Wire card reader to card reader port 1 on the assigned ACS Board
IN#	Input Port #	DC-IN1	Wire door contact to input port 1 on the assigned ACS Board
OUT#	Output Port #	L-OUT1	Wire lock power supply trigger to output 1 on the assigned ACS Board
TMP	Dedicated Tamper Switch Input	TSW-TMP	Wire tamper switch to dedicated Tamper Input on the assigned ACS Board
ACF	Dedicated AC Fail Alarm Input Port	ACF-ACF	Wire AC fail alarm to dedicated AC Fail Alarm Input on the assigned ACS Board



These drawings and designs are the property of Schneider Electric. Their use or reproduction without prior consent of the company is strictly forbidden.

Systems Description

Security Systems

Job Number
NC22N5230

Drawing Number
SEC-I01-P2

Drawing Size
ANSI B

Drawing Scale
None

Project Galaxy - Fitout

310 Hudson Street
New York, NY 10013

ACS Schedules

Package 2

Levels 3, 4, 5

REVISION

Submitted

#	DATE	DESCRIPTION	BY	APP
0	7/18/2022	Submittal	MF	TN
1	11/4/2022	Revision 1	KW	TN
2	1/25/2023	Revision 2	TNG	TN
3	3/15/2023	Revision 3	TNG	TN
4	8/4/2023	Revision 4	TNG	TN

Access Control System Point Schedule																
Termination Location	Termination Enclosure Name	Access Control Board Name	Floor (Const.)	Door Tag (Arch.)	Point Name	Point Description	Access Control Board Terminations	Lock Power From	Lock Power Channel	Device Power From	Device Power Channel	Typical Detail	Detail Drawing Reference	Cables	Lock Type (Fail Saf/Sec)	Notes
3W.TR	310H-P 11-F03-B	310H-R 1111/12	3	03H34	310H-R 1111	Elevator Lobby 03H34	CR-C1,DC-IN1,REX-IN2,L-OUT1	LPS1a-P 11B-F03-PDB1	1	CPS1a-P 11B-F03-PDB2	1	B2	SEC-L02	N	FSaf	
			3	03M 34	310H-R 1112	Badging 03M 34	CR-C2,DC-IN5,REX-IN6,L-OUT4		2			A1	SEC-L01	L	FSaf	
		310H-R 1113/14	3	03P 31B	310H-R 1113	Corridor 03P 31	CR-C1,DC-IN1,REX-IN2,L-OUT1		3			A1	SEC-L01	L	FSaf	
			3	03P 31A	310H-R 1114	Corridor 03P 31	CR-C2,DC-IN5,REX-IN6,L-OUT4		4			A2	SEC-L01	L	FSaf	
		310H-R 1115/16	3	03P 31D	310H-R 1115	Corridor 03P 31	CR-C1,DC-IN1,REX-IN2,L-OUT1		5			A3	SEC-L01	M	FSaf	
			3	03P 32	310H-R 1116	Corridor 03P 31	CR-C2,DC-IN5,REX-IN6,L-OUT4		6			A3	SEC-L01	M	FSaf	
		310H-R 1117/18	3	03P 31F	310H-R 1117	3C.TR 03R24	CR-C1,DC-IN1,REX-IN2,L-OUT1		7			A2	SEC-L01	L	FSaf	
			3	03R28	310H-R 1118	Unassigned 03R28	CR-C2,DC-IN5,REX-IN6,L-OUT4	LPS1a-P 11B-F03-PDB2	8			A1	SEC-L01	L	FSaf	
		310H-R 1119/20	3	03P 31G	310H-R 1119	PA 03R30	CR-C1,DC-IN1,REX-IN2,L-OUT1		1			A1	SEC-L01	L	FSaf	
			3	03V36A	310H-R 1120	3W.CER 03V38	CR-C2,DC-IN5,REX-IN6,L-OUT4		2			A3	SEC-L01	M	FSaf	
		310H-R 1121/22	3	03V36B	310H-R 1121	3E.CER 03V23	CR-C1,DC-IN1,REX-IN2,L-OUT1		3			A3	SEC-L01	M	FSaf	
			3	03R45A	310H-R 1122	PDU A 03R45	CR-C2,DC-IN5,REX-IN6,L-OUT4		4			A2	SEC-L01	L	FSaf	
		310H-R 1123/24	3	03R45B	310H-R 1123	PDU A 03R45	CR-C1,DC-IN1,REX-IN2,L-OUT1		5			A1	SEC-L01	L	FSaf	
			3	03V36C	310H-R 1124	3W.CER 03V38	CR-C2,DC-IN5,REX-IN6,L-OUT4		6			A3	SEC-L01	M	FSaf	
	310H-P 11-F03-C	310H-R 1125/26	3	03Q32	310H-R 1125	3W.CER 03V38	CR-C1,DC-IN1,REX-IN2,L-OUT1	LPS1a-P 11C-F03-PDB1	7			A1	SEC-L01	L	FSaf	
			3	03R24	310H-R 1126	3E.CER 03V23	CR-C2,DC-IN5,REX-IN6,L-OUT4		8			A1	SEC-L01	L	FSaf	
		310H-R 1111/12	3		TSW-310H-P 11-F03-B	Tamper Switch	TSW-TMP					-		E1	N/A	
			3		ACF-310H-P 11-F03-B	Panel Sys/AC Fault	ACF-ACF					-		E1	N/A	
		310H-R 1127/28	3	03N44A	310H-R 1128	Unassigned 03N44	CR-C2,DC-IN5,REX-IN6,L-OUT4		2			A1	SEC-L01	L	FSaf	
			3	03P 10C	310H-R 1129	Unassigned 03N44	CR-C1,DC-IN1,REX-IN2,L-OUT1		3			A1	SEC-L01	L	Pending	
		310H-R 1129/30	3	03G28	310H-R 1130	Mail Incoming Sorting 03G27	CR-C2,DC-IN5,REX-IN6,L-OUT4		4			A1	SEC-L01	L	FSaf	
			3		TSW-310H-P 11-F03-C	Tamper Switch	TSW-TMP					-		E1	N/A	
		310H-R 1127/28	3		ACF-310H-P 11-F03-C	Panel Sys/AC Fault	ACF-ACF					-		E1	N/A	
3E.TR	310H-P 12-F03-B	310H-R 1213/14	3	03H17B	310H-R 1213	CER Consumables 03H17	CR-C1,DC-IN1,REX-IN2,L-OUT1	LPS1a-P 12B-F03-PDB1	1	CPS1a-P 12B-F03-PDB2	1	A2	SEC-L01	L	FSaf	
			3	03J16B	310H-R 1214	Corridor 03J16	CR-C2,DC-IN5,REX-IN6,L-OUT4		2			A2	SEC-L01	L	FSaf	
		310H-R 1215/16	3	03M 13	310H-R 1215	Elevator Lobby 03M 13	CR-C1,DC-IN1,REX-IN2,L-OUT1		3			B2	SEC-L02	N	FSaf	
			3	03J16A	310H-R 1216	Corridor 03J16	CR-C2,DC-IN5,REX-IN6,L-OUT4		4			A1	SEC-L01	L	FSaf	
		310H-R 1217/18	3	03P 31C	310H-R 1217	Corridor 03P 31	CR-C1,DC-IN1,REX-IN2,L-OUT1		5			A3	SEC-L01	M	FSaf	
			3	03P 10C	310H-R 1218	Unassigned 03P 10	CR-C2,DC-IN5,REX-IN6,L-OUT4	LPS1a-P 12B-F03-PDB2	6			A1	SEC-L01	L	FSaf	
		310H-R 1219/20	3	03J16C	310H-R 1219	Corridor 03J16	CR-C1,DC-IN1,REX-IN2,L-OUT1		7			A1	SEC-L01	L	FSaf	
			3	03P 31E	310H-R 1220	Corridor 03P 31	CR-C2,DC-IN5,REX-IN6,L-OUT4		8			A1	SEC-L01	L	FSaf	
		310H-R 1221/22	3	03J16	310H-R 1221	Corridor 03J16	CR-C1,DC-IN1,REX-IN2,L-OUT1		1			A1	SEC-L01	L	FSaf	
			3	03V08	310H-R 1222	EUC/HP 03V08	CR-C2,DC-IN5,REX-IN6,L-OUT4		2			A1	SEC-L01	L	FSaf	
		310H-R 1223/24	3	03V12A	310H-R 1223	Reception 03V12	CR-C1,DC-IN1,REX-IN2,L-OUT1,ACT-IN3,ADO-OUT2,ACT-OUT3&IN4		3			A4	SEC-L03	P	FSaf	
			3	03J16G	310H-R 1224	PDU B 03X15	CR-C2,DC-IN5,REX-IN6,L-OUT4,		4			A2	SEC-L01	L	FSaf	
		310H-R 1225/26	3	03J16F	310H-R 1225	PDU B 03X15	CR-C1,DC-IN1,REX-IN2,L-OUT1		5			A1	SEC-L01	L	FSaf	
			3	03Z11	310H-R 1226	Corridor East 03-303	CR-C2,DC-IN5,REX-IN6,L-OUT4,ACT-IN7,ADO-OUT5,ACT-OUT6&IN8		6			A4	SEC-L03	P	FSaf	
		310H-R 1227/28	3	03V12B	310H-R 1227	Reception 03V12	CR-C1,DC-IN1,REX-IN2,L-OUT1,ACT-IN3,ADO-OUT2,ACT-OUT3&IN4		7			A4	SEC-L03	P	FSaf	
			3	03Q13	310H-R 1228	Unassigned 03Q13	CR-C2,DC-IN5,REX-IN6,L-OUT4		8			A1	SEC-L01	L	FSaf	
	310H-P 12-F03-C	310H-R 1213/14	3		TSW-310H-P 12-F03-B	Tamper Switch	TSW-TMP					-		E1	N/A	
			3		ACF-310H-P 12-F03-B	Panel Sys/AC Fault	ACF-ACF					-		E1	N/A	
		310H-11217-32	3	-	310H-11217	Nurse Station 03W12	DB-IN1					M1	SEC-M01	E1	N/A	
			3	-	310H-11218	Nurse Station 03W12	DB-IN2					M1	SEC-M01	E1	N/A	
			3	-	310H-11219	Wellness Office 03X12	DB-IN3					M1	SEC-M01	E1	N/A	
			3	-	310H-11220	Treatment Rm 03Z07	DB-IN4					M1	SEC-M01	E1	N/A	
			3	-	310H-11222	Exam Room 03X11	DB-IN6					M1	SEC-M01	E1	N/A	
			3	-	310H-11224	Exam Rm 03X09	DB-IN8					M1	SEC-M01	E1	N/A	
			3	-	310H-11225	Office 03Y13	DB-IN9					M1	SEC-M01	E1	N/A	
			3	-	ICU-310H-R 1227	Intercom Door Unlock 03V12A	ICU-IN10					-		E1	N/A	
			3	-	ICU-310H-R 1226	Intercom Door Unlock 03Z11	ICU-IN11					-		E1	N/A	
			3		TSW-310H-P 12-F03-C	Tamper Switch	TSW-TMP					-		E1	N/A	
			3		ACF-310H-P 12-F03-C	Panel Sys/AC Fault	ACF-ACF					-		E1	N/A	

Systems Description

Security Systems

Job Number

NC22N5230

Drawing Number

SEC-102-P2

Drawing Size

ANSI B

Drawing Scale

None

Project Galaxy - Fitout

310 Hudson Street

New York, NY 10013

ACS Schedules

Package 2

Levels 3, 4, 5

REVISION

Submitted

#	DATE	DESCRIPTION	BY	APP
0	7/18/2022	Submittal	MF	TN
1	11/4/2022	Revision 1	KW	TN
2	1/25/2023	Revision 2	TNG	TN
3	3/15/2023	Revision 3	TNG	TN
4	8/4/2023	Revision 4	TNG	TN

Schneider Electric

These drawings and designs are the property of Schneider Electric. Their use or reproduction without prior consent of the company is strictly prohibited.

Access Control System Point Schedule																
Termination Location	Termination Enclosure Name	Access Control Board Name	Floor (Const.)	Door Tag (Arch.)	Point Name	Point Description	Access Control Board Terminations	Lock Power From	Lock Power Channel	Device Power From	Device Power Channel	Typical Detail	Detail Drawing Reference	Cables	Lock Type (Fail Saf/Sec)	Notes
4W.TR	310H-P13-F04-B	310H-R1313/14	4	04A38	310H-R1313	Corridor 04A38	CR-C1, DC-IN1, REX-IN2, L-OUT1	LPS1a-P13A-F04-PDB1	1			A3	SEC-L01	M	FSaf	
			4	04S24A	310H-R1314	Riser Closet 04S24	CR-C2, DC-IN5, REX-IN6, L-OUT4		2			A2	SEC-L01	L	FSec	
		310H-R1315/16	4	04B35B	310H-R1315	Tech Storage 04B35	CR-C1, DC-IN1, REX-IN2, L-OUT1		3			A2	SEC-L01	L	FSec	
			4	04B41	310H-R1316	Tech Lab 04B41	CR-C2, DC-IN5, REX-IN6, L-OUT4		4			A2	SEC-L01	L	FSaf	
		310H-R1317/18	4	04B45	310H-R1317	Video Repair 04B45	CR-C1, DC-IN1, REX-IN2, L-OUT1		5			A2	SEC-L01	L	FSaf	
			4	04D29	310H-R1318	Studio 4F - WASBC SR 04D29	CR-C2, DC-IN5, REX-IN6, L-OUT4		6			A2	SEC-L01	L	FSaf	
		310H-R1319/20	4	04D35	310H-R1319	Electrical 04D35	CR-C1, DC-IN1, REX-IN2, L-OUT1		7			A1	SEC-L01	L	FSaf	
			4	04D44	310H-R1320	PCR 48 - WABC SR 04D44	CR-C2, DC-IN5, REX-IN6, L-OUT4	LPS1a-P13A-F04-PDB2	8			A1	SEC-L01	L	FSaf	
		310H-R1321/22	4	04E25	310H-R1321	Studio 4G 04E25	CR-C1, DC-IN1, REX-IN2, L-OUT1		1			A2	SEC-L01	L	FSaf	
			4	04E34	310H-R1322	PA 04E34	CR-C2, DC-IN5, REX-IN6, L-OUT4		2			A1	SEC-L01	L	FSaf	
		310H-R1323/24	4	04E41	310H-R1323	MER 04E41	CR-C1, DC-IN1, REX-IN2, L-OUT1		3			A2	SEC-L01	L	FSaf	
			4	04H36	310H-R1324	Electrical Closet 04H36	CR-C2, DC-IN5, REX-IN6, L-OUT4		4			A1	SEC-L01	L	FSaf	
		310H-R1325/26	4	04J31	310H-R1325	Corridor 04Q30	CR-C1, DC-IN1, REX-IN2, L-OUT1		5			A3	SEC-L01	M	FSaf	
			4	04J43	310H-R1326	TV 47 WABC Main 04J43	CR-C2, DC-IN5, REX-IN6, L-OUT4		6			A1	SEC-L01	L	FSaf	
		310H-R1327/28	4	04K33A	310H-R1327	Elevator Lobby 04K33	CR-C1, DC-IN1, REX-IN2, L-OUT1		7	CPS1a-P13A-F04-PDB2	1	B2	SEC-L02	N	FSaf	
			4	04K33B	310H-R1328	Elevator Lobby 04K33	CR-C2, DC-IN5, REX-IN6, L-OUT4		8		2	B2	SEC-L02	N	FSaf	
	310H-P14-F04-A	310H-R1313/14	4		TMP-310H-P13-F04-B	Tamper Switch	TSW-TMP					-		E1	N/A	
			4		ACF-310H-P13-F04-B	Panel Sys/AC Fault	ACF-ACF					-		E1	N/A	
		310H-R1401/02	4	04M27B	310H-R1401	Studio 4D - WABC 04M27	CR-C1, DC-IN1, REX-IN2, L-OUT1	LPS1a-P14A-F04-PDB1	1			A1	SEC-L01	L	FSaf	
			4	04R24	310H-R1402	Vestibule 04R24	CR-C2, DC-IN5, REX-IN6, L-OUT4		2			A1	SEC-L01	L	FSaf	
		310H-R1403/04	4	04R41	310H-R1403	MER 04R41	CR-C1, DC-IN1, REX-IN2, L-OUT1		3			A2	SEC-L01	L	FSaf	
			4	04T33	310H-R1404	TV-44 04T33	CR-C2, DC-IN5, REX-IN6, L-OUT4		4			A1	SEC-L01	L	FSaf	
		310H-R1405/06	4	04T36	310H-R1405	TV-45 04T36	CR-C1, DC-IN1, REX-IN2, L-OUT1		5			A1	SEC-L01	L	FSaf	
			4	04T39	310H-R1406	TV-46 04T39	CR-C2, DC-IN5, REX-IN6, L-OUT4		6			A1	SEC-L01	L	FSaf	
		310H-R1407/08	4	04V23	310H-R1407	Studio -4L 04V23	CR-C1, DC-IN1, REX-IN2, L-OUT1		7			A2	SEC-L01	L	FSaf	
			4	04V26	310H-R1408	Studio -4K 04V26	CR-C2, DC-IN5, REX-IN6, L-OUT4	LPS1a-P14A-F04-PDB2	8			A2	SEC-L01	L	FSaf	
		310H-R1409/10	4	04V29	310H-R1409	Studio -4J 04V29	CR-C1, DC-IN1, REX-IN2, L-OUT1		1			A2	SEC-L01	L	FSaf	
			4	04Y26	310H-R1410	Studio -4O 04Y26	CR-C2, DC-IN5, REX-IN6, L-OUT4		2			A2	SEC-L01	L	FSaf	
		310H-R1411	4	04S24B	310H-R1411	Riser Closet 04S24	CR-C1, DC-IN1, REX-IN2, L-OUT1		3			A2	SEC-L01	L	FSaf	
		310H-R1401/02	4		TMP-310H-P14-F04-A	Tamper Switch	TSW-TMP					-		E1	N/A	
			4		ACF-310H-P14-F04-A	Panel Sys/AC Fault	ACF-ACF					-		E1	N/A	
4E.TR	310H-P15-F04-B	310H-R1515/16	4	04A08	310H-R1515	VO-04-2 04A08	CR-C1, DC-IN1, REX-IN2, L-OUT1	LPS1a-P15B-F04-PDB1	1			A1	SEC-L01	L	FSaf	
			4	04B25	310H-R1516	Open Office 04B25	CR-C2, DC-IN5, REX-IN6, L-OUT4		2			A3	SEC-L01	M	FSaf	
		310H-R1517/18	4	04C10	310H-R1517	ACR-43 04C10	CR-C1, DC-IN1, REX-IN2, L-OUT1		3			A1	SEC-L01	L	FSaf	
			4	04D03	310H-R1518	TC 42 - ABC News Digital 04D03	CR-C2, DC-IN5, REX-IN6, L-OUT4		4			A1	SEC-L01	L	FSaf	
		310H-R1519/20	4	04D07	310H-R1519	TV 43 - ABC Special Report 04D07	CR-C1, DC-IN1, REX-IN2, L-OUT1		5			A1	SEC-L01	L	FSaf	
			4	04D11	310H-R1520	LCR-F 04D11	CR-C2, DC-IN5, REX-IN6, L-OUT4		6			A1	SEC-L01	L	FSaf	
		310H-R1521/22	4	04D12	310H-R1521	LCR-G 04D12	CR-C1, DC-IN1, REX-IN2, L-OUT1		7			A1	SEC-L01	L	FSaf	
			4	04D14	310H-R1522	LCR-H 04D14	CR-C2, DC-IN5, REX-IN6, L-OUT4	LPS1a-P15B-F04-PDB2	8			A1	SEC-L01	L	FSaf	
		310H-R1523/24	4	04D22	310H-R1523	Studio 4H 04D22	CR-C1, DC-IN1, REX-IN2, L-OUT1		1			A2	SEC-L01	L	FSaf	
			4	04E18	310H-R1524	Studio 4I - ABC SR 04E18	CR-C2, DC-IN5, REX-IN6, L-OUT4		2			A2	SEC-L01	L	FSaf	
		310H-R1525/26	4	04C11	310H-R1525	TV 41 - ABC News 04K03	CR-C1, DC-IN1, REX-IN2, L-OUT1		3			A1	SEC-L01	L	FSaf	
			4	04G04	310H-R1526	Corridor West 04-105	CR-C2, DC-IN5, REX-IN6, L-OUT4		4			A1	SEC-L01	L	FSaf	
		310H-R1527/28	4	04H02	310H-R1527	Corridor West 04-105	CR-C1, DC-IN1, REX-IN2, L-OUT1		5			A1	SEC-L01	L	FSaf	
			4	04L20B	310H-R1528	Studio 4E - ABC 04L20	CR-C2, DC-IN5, REX-IN6, L-OUT4		6			A1	SEC-L01	L	FSaf	
		310H-R1529/30	4	04R23	310H-R1529	Vestibule 04R23	CR-C1, DC-IN1, REX-IN2, L-OUT1		7			A1	SEC-L01	L	FSaf	
			4	04S22B	310H-R1530	Riser Closet 04S22	CR-C2, DC-IN5, REX-IN6, L-OUT4		8			A2	SEC-L01	L	FSaf	
	310H-P16-F04-A	310H-R1515/16	4		TSW-310H-P15-F04-B	Tamper Switch	TSW-TMP					-		E1	N/A	
			4		ACF310H-P15-F04-B	Panel Sys/AC Fault	ACF-ACF					-		E1	N/A	
		310H-R1601/02	4	04Y22B	310H-R1601	Studio -4P 04Y22	CR-C1, DC-IN1, REX-IN2, L-OUT1	LPS1a-P16A-F04-PDB1	1			A2	SEC-L01	L	FSaf	
			4	04S01	310H-R1602	Hair & Make Up 04S01	CR-C2, DC-IN5, REX-IN6, L-OUT4		2			A1	SEC-L01	L	FSaf	
		310H-R1603/04	4	04V15	310H-R1603	Electrical 04V15	CR-C1, DC-IN1, REX-IN2, L-OUT1		3			A1	SEC-L01	L	FSaf	
			4	04V17A	310H-R1604	Production Storage 04V17	CR-C2, DC-IN5, REX-IN6, L-OUT4		4			A2	SEC-L01	L	FSaf	
		310H-R1605/06	4	04V17B	310H-R1605	Production Storage 04V17	CR-C1, DC-IN1, REX-IN2, L-OUT1		5			A1	SEC-L01	L	FSaf	
			4	04V18	310H-R1606	Studio 4N 04V18	CR-C2, DC-IN5, REX-IN6, L-OUT4		6			A2	SEC-L01	L	FSaf	
		310H-R1607/08	4	04V20	310H-R1607	Studio -4M 04V20	CR-C1, DC-IN1, REX-IN2, L-OUT1		7			A2	SEC-L01	L	FSaf	
			4	04V21	310H-R1608	MER/PA 04V21	CR-C2, DC-IN5, REX-IN6, L-OUT4	LPS1a-P16A-F04-PDB2	8			A1	SEC-L01	L	FSaf	
		310H-R1609/10	4	04V22A	310H-R1609	Elevator Lobby 04V22	CR-C1, DC-IN1, REX-IN2, L-OUT1		1	CPS1a-P16A-F04-PDB2	1	B2	SEC-L02	N	FSaf	
			4	04V22B	310H-R1610	Elevator Lobby 04V22	CR-C2, DC-IN5, REX-IN6, L-OUT4		2		2	B2	SEC-L02	N	FSaf	
		310H-R1611/12	4	04X15	310H-R1611	Mothers Room 04X15	CR-C1, DC-IN1, REX-IN2, L-OUT1		3			A1	SEC-L01	L	FSaf	
			4	04Y10	310H-R1612	Production Storage 04D09	CR-C2, DC-IN5, REX-IN6, L-OUT4		4			A2	SEC-L01	L	FSaf	
		310H-R1613/14	4	04Y12	310H-R1613	Studio 4S 04D08	CR-C1, DC-IN1, REX-IN2, L-OUT1		5			A2	SEC-L01	L	FSaf	
			4	04Y13	310H-R1614	Studio 4R 04Y13	CR-C2, DC-IN5, REX-IN6, L-OUT4		6			A2	SEC-L01	L	FSaf	
		310H-R1615/16	4	04Y18A	310H-R1615	Studio -4Q 04Y18	CR-C1, DC-IN1, REX-IN2, L-OUT1		7			A2	SEC-L01	L	FSaf	
			4	04V24	310H-R1616	Electrical 04V24	CR-C2, DC-IN5, REX-IN6, L-OUT4		8			A1	SEC-L01	L	FSaf	
		310H-R1601/02	4		TSW-310H-P16-F04-A	Tamper Switch	TSW-TMP					-		E1	N/A	
			4		ACF310H-P16-F04-A	Panel Sys/AC Fault	ACF-ACF					-		E1	N/A	
	310H-P16-F04-B	310H-R1617/18	4	04Y18B	310H-R1617	Studio -4Q 04Y18	CR-C1, DC-IN1, REX-IN2, L-OUT1	PS1a-P16B-F04-PDB2	1			A2	SEC-L01	L	FSaf	
			4	04Y22A	310H-R1618	Studio -4P 04Y22	CR-C2, DC-IN5, REX-IN6, L-OUT4		2			A2	SEC-L01	L	FSaf	
			4	04S22A	310H-R1619	Riser Closet 04S22	CR-C1, DC-IN1, REX-IN2, L-OUT1		3			A2	SEC-L01	L	FSaf	
		310H-I1601-16	4	-	310H-I1601	Mothers Room 04X15	DB-IN1					M1	SEC-M01	E1	N/A	
			4		TSW-310H-P16-F04-B	Tamper Switch	TSW-TMP					-		E1	N/A	
		310H-R1617/18	4		ACF-310H-P16-F04-B	Panel Sys/AC Fault	ACF-ACF					-		E1	N/A	



These drawings and designs are the property of Schneider Electric. Their use or reproduction without prior consent of the company is strictly forbidden.

REVISION

Submitted

#	DATE	DESCRIPTION	BY	APP
0	7/18/2022	Submittal	MF	TN
1	11/4/2022	Revision 1	KW	TN
2	1/25/2023	Revision 2	TNG	TN
3	3/15/2023	Revision 3	TNG	TN
4	8/4/2023	Revision 4	TNG	TN

Project Galaxy - Fitout

310 Hudson Street
New York, NY 10013

ACS Schedules

Systems Description

Security Systems

Job Number
NC22N5230

Drawing Size
ANSI B

Drawing Number
SEC-I03-P2

Drawing Scale
None

Package 2

Levels 3, 4, 5

Access Control System Point Schedule																
Termination Location	Termination Enclosure Name	Access Control Board Name	Floor (Const.)	Door Tag (Arch.)	Point Name	Point Description	Access Control Board Terminations	Lock Power From	Lock Power Channel	Device Power From	Device Power Channel	Typical Detail	Detail Drawing Reference	Cables	Lock Type (Fail Saf/Sec)	Notes
5W.TR	310H-P17-F05-B	310H-R1727/28	5	05V33	310H-R1727	RCR 5105V33	CR-C1,DC-IN1,REX-IN2,L-OUT1	LPS1a-P17B-F05-PDB2	7			A1	SEC-L01	L	FSaf	
			5	05Y41	310H-R1728	Huddle 05Y41	CR-C2,DC-IN5,REX-IN6,L-OUT4		8			A1	SEC-L01	L	FSaf	
		310H-R1713/14	5	05B23B	310H-R1713	Print Graphics 05B23	CR-C1,DC-IN1,REX-IN2,L-OUT1	LPS1a-P17B-F05-PDB1	1			A1	SEC-L01	L	FSaf	
			5	05B32	310H-R1714	Edit 5M 05B32	CR-C2,DC-IN5,REX-IN6,L-OUT4		2			A1	SEC-L01	L	FSaf	
		310H-R1715/16	5	05B34	310H-R1715	Edit 5A 05B34	CR-C1,DC-IN1,REX-IN2,L-OUT1		3			A1	SEC-L01	L	FSaf	
			5	05B37	310H-R1716	Promo Graphics 05B37	CR-C2,DC-IN5,REX-IN6,L-OUT4		4			A1	SEC-L01	L	FSaf	
		310H-R1717/18	5	05D34	310H-R1717	Electrical 05B34	CR-C1,DC-IN1,REX-IN2,L-OUT1		5			A1	SEC-L01	L	FSaf	
			5	05E34	310H-R1718	PA 05E34	CR-C2,DC-IN5,REX-IN6,L-OUT4		6			A1	SEC-L01	L	FSaf	
		310H-R1719/20	5	05B30	310H-R1719	Voice Over 05B30	CR-C1,DC-IN1,REX-IN2,L-OUT1		7			A1	SEC-L01	L	FSaf	
			5	05J36	310H-R1720	Electrical 05J36	CR-C2,DC-IN5,REX-IN6,L-OUT4	LPS1a-P17B-F05-PDB2	8			A1	SEC-L01	L	FSaf	
		310H-R1725/26	5	05K34A	310H-R1726	Elevator Lobby 05K34	CR-C2,DC-IN5,REX-IN6,L-OUT4		6	CPS1a-P17B-F05-PDB2	2	B2	SEC-L02	N	FSaf	
			5	05K34B	310H-R1723	Elevator Lobby 05K34	CR-C1,DC-IN1,REX-IN2,L-OUT1		3		1	B2	SEC-L02	N	FSaf	
		310H-R1723/24	5	05R42	310H-R1724	Voice Over 05V38	CR-C2,DC-IN5,REX-IN6,L-OUT4		4			A1	SEC-L01	L	FSaf	
			5	05T33	310H-R1721	Radio Studio 5A 05T33	CR-C1,DC-IN1,REX-IN2,L-OUT1		1			A1	SEC-L01	L	FSaf	
		310H-R1721/22	5	05B27	310H-R1722	Storage 05B27	CR-C2,DC-IN5,REX-IN6,L-OUT4		2			A2	SEC-L01	L	FSaf	
			5	05V39	310H-R1725	Voice Over 05V39	CR-C1,DC-IN1,REX-IN2,L-OUT1		5			A1	SEC-L01	L	FSaf	
		310H-R1713/14	5		TMP-310H-P17-F05-B	Tamper Switch	TSW-TMP					-		E1	N/A	
			5		ACF-310H-P17-F05-B	Panel Sys/AC Fault	ACF-ACF					-		E1	N/A	
	310H-P17-F05-C	310H-R1729	5	05S41	310H-R1729	Valve Access 05S41	CR-C1,DC-IN1,REX-IN2,L-OUT1	PS1a-P17C-F05-PDB2	1			A1	SEC-L01	L	FSaf	
			5		TMP-310H-P17-F05-C	Tamper Switch	TSW-TMP					-		E1	N/A	
			5		ACF-310H-P17-F05-C	Panel Sys/AC Fault	ACF-ACF					-		E1	N/A	
			5									-				
5E.TR	310H-P18-F05-B	310H-R1815/16	5	05B23	310H-R1815	Print Graphics 05B23	CR-C1,DC-IN1,REX-IN2,L-OUT1	LPS1a-P18B-F05-PDB1	1			A2	SEC-L01	L	FSaf	Door 05C15 is removed in RFI-1567. Door 05X14 is added in TYSK-007.
			5	05X14	310H-R1816	Mothers Room 05X14	CR-C2,DC-IN5,REX-IN6,L-OUT4		2	CPS1a-P18B-F05-PDB2	1	A1	SEC-L01	L	FSaf	
		310H-R1817/18	5	05F13	310H-R1817	MER/PA 05F13	CR-C1,DC-IN1,REX-IN2,L-OUT1		3			A2	SEC-L01	L	FSaf	
			5	05M03B	310H-R1818	Open Collab 05M03	CR-C2,DC-IN5,REX-IN6,L-OUT4		4	CPS1a-P18B-F05-PDB2	2	B1	SEC-L02	N	FSaf	
		310H-R1819/20	5	05P13A	310H-R1819	Elevator C Vestibule 05-301	CR-C1,DC-IN1,REX-IN2,L-OUT1		5		3	B2	SEC-L02	N	FSaf	
			5	05P13B	310H-R1820	Elevator C Vestibule 05-301	CR-C2,DC-IN5,REX-IN6,L-OUT4		6		4	B2	SEC-L02	N	FSaf	
		310H-R1821/22	5	05V15	310H-R1821	Electrical 05V15	CR-C1,DC-IN1,REX-IN2,L-OUT1	LPS1a-P18B-F05-PDB2	7			A1	SEC-L01	L	FSaf	
			5	05R10	310H-R1822	Studio Lighting Systems 05R10	CR-C2,DC-IN5,REX-IN6,L-OUT4		8			A1	SEC-L01	L	FSaf	
		310H-R1823	5	05W05	310H-R1823	Mothers Room 05W05	CR-C1,DC-IN1,REX-IN2,L-OUT1		1			A1	SEC-L01	L	FSaf	
		310H-11801-16	5	-	310H-11801	Wellness 05X14	DB-IN1					M1	SEC-M01	E1	N/A	
			5	-	310H-11802	Mothers Room 05W05	DB-IN2					M1	SEC-M01	E1	N/A	
		310H-R1815/16	5		TMP-310H-P18-F05-B	Tamper Switch	TSW-TMP					-		E1	N/A	
			5		ACF-310H-P18-F05-B	Panel Sys/AC Fault	ACF-ACF					-		E1	N/A	

Systems Description

Security Systems

Job Number

NC22N5230

Drawing Number

SEC-104-P2

Drawing Size

ANSI B

Drawing Scale

None

Project Galaxy - Fitout

310 Hudson Street
New York, NY 10013

ACS Schedules

Package 2

Levels 3, 4, 5

REVISION

Submitted

#	DATE	DESCRIPTION	BY	APP
0	7/18/2022	Submittal	MF	TN
1	11/4/2022	Revision 1	KW	TN
2	1/25/2023	Revision 2	TNG	TN
3	3/15/2023	Revision 3	TNG	TN
4	8/4/2023	Revision 4	TNG	TN

Schneider Electric

These drawings and designs are the property of Schneider Electric. Their use or reproduction without prior consent of the company is strictly forbidden.

Enclosure Schedule			
Location	Enclosure Name	Description	Type
3E.TR	310H-P12-F03-C	DSNY01	Unified
	310H-P12-F03-B	DSNY02	Unified
3W.TR	310H-P11-F03-C	DSNY02	Unified
	310H-P11-F03-B	DSNY02	Unified

Enclosure Schedule			
Location	Enclosure Name	Description	Type
4E.TR	310H-P16-F04-B	DSNY01	Unified
	310H-P16-F04-A	DSNY02	Unified
	310H-P15-F04-B	DSNY02	Unified
4W.TR	310H-P14-F04-A	DSNY02	Unified
	310H-P13-F04-B	DSNY02	Unified

Enclosure Schedule			
Location	Enclosure Name	Description	Type
5E.TR	310H-P18-F05-B	DSNY02	Unified
5W.TR	310H-P17-F05-C	DSNY01	Unified
	310H-P17-F05-B	DSNY02	Unified

Access Control System Board Schedule								
Location	Enclosure Name	Access Control Board Name	Part Number	Term. Detail	Detail Drawing Reference	Board Power From	Power Channel	Board Address
3W.TR	310H-P11-F03-A	C&S LNL-X3300 310H-C11						
	310H-P11-F03-B	310H-R1111/12	LNL-1320-S3	A3	SEC-J02	CPS1a-P11B-F03-PDB1	1	6
		310H-R1113/14	LNL-1320-S3	A3	SEC-J02		2	7
		310H-R1115/16	LNL-1320-S3	A3	SEC-J02		3	8
		310H-R1117/18	LNL-1320-S3	A3	SEC-J02		4	9
		310H-R1119/20	LNL-1320-S3	A3	SEC-J02		5	10
		310H-R1121/22	LNL-1320-S3	A3	SEC-J02		6	11
		310H-R1123/24	LNL-1320-S3	A3	SEC-J02		7	12
		310H-R1125/26	LNL-1320-S3	A3	SEC-J02		8	13
	310H-P11-F03-C	310H-R1127/28	LNL-1320-S3	A3	SEC-J02	CPS1a-P11C-F03-PDB1	2	14
310H-R1129/30		LNL-1320-S3	A3	SEC-J02	3		15	
3E.TR	310H-P12-F03-A	C&S LNL-X3300 310H-C12						
	310H-P12-F03-B	310H-R1213/14	LNL-1320-S3	A3	SEC-J02	CPS1a-P12B-F03-PDB1	1	7
		310H-R1215/16	LNL-1320-S3	A3	SEC-J02		2	8
		310H-R1217/18	LNL-1320-S3	A3	SEC-J02		3	9
		310H-R1219/20	LNL-1320-S3	A3	SEC-J02		4	10
		310H-R1221/22	LNL-1320-S3	A3	SEC-J02		5	11
		310H-R1223/24	LNL-1320-S3	A3	SEC-J02		6	12
		310H-R1225/26	LNL-1320-S3	A3	SEC-J02		7	13
		310H-R1227/28	LNL-1320-S3	A3	SEC-J02		8	14
	310H-P12-F03-C	310H-R1217-32	LNL-1100-S3	A4	SEC-J02	PS1a-P12C-F03-PDB1	2	18
4W.TR	310H-P13-F04-A	C&S LNL-X3300 310H-C13						
	310H-P13-F04-B	310H-R1313/14	LNL-1320-S3	A3	SEC-J02	CPS1a-P13A-F04-PDB1	1	7
		310H-R1315/16	LNL-1320-S3	A3	SEC-J02		2	8
		310H-R1317/18	LNL-1320-S3	A3	SEC-J02		3	9
		310H-R1319/20	LNL-1320-S3	A3	SEC-J02		4	10
		310H-R1321/22	LNL-1320-S3	A3	SEC-J02		5	11
		310H-R1323/24	LNL-1320-S3	A3	SEC-J02		6	12
		310H-R1325/26	LNL-1320-S3	A3	SEC-J02		7	13
		310H-R1327/28	LNL-1320-S3	A3	SEC-J02		8	14
	310H-P14-F04-A	310H-C14	LNL-X3300	A1	SEC-J02	CPS1a-P14A-F04-PDB1	1	N/A
		310H-R1401/02	LNL-1320-S3	A3	SEC-J02		2	1
		310H-R1403/04	LNL-1320-S3	A3	SEC-J02		3	2
		310H-R1405/06	LNL-1320-S3	A3	SEC-J02		4	3
		310H-R1407/08	LNL-1320-S3	A3	SEC-J02		5	4
310H-R1409/10		LNL-1320-S3	A3	SEC-J02	6		5	
310H-R1411		LNL-1300-S3	A2	SEC-J02	7		6	

Access Control System Board Schedule								
Location	Enclosure Name	Access Control Board Name	Part Number	Term. Detail	Detail Drawing Reference	Board Power From	Power Channel	Board Address
4E.TR	310H-P15-F04-A	C&S LNL-X3300 310H-C15						
	310H-P15-F04-B	310H-R1515/16	LNL-1320-S3	A3	SEC-J02	CPS1a-P15B-F04-PDB1	1	8
		310H-R1517/18	LNL-1320-S3	A3	SEC-J02		2	9
		310H-R1519/20	LNL-1320-S3	A3	SEC-J02		3	10
		310H-R1521/22	LNL-1320-S3	A3	SEC-J02		4	11
		310H-R1523/24	LNL-1320-S3	A3	SEC-J02		5	12
		310H-R1525/26	LNL-1320-S3	A3	SEC-J02		6	13
		310H-R1527/28	LNL-1320-S3	A3	SEC-J02		7	14
		310H-R1529/30	LNL-1320-S3	A3	SEC-J02		8	15
	310H-P16-F04-A	310H-C16	LNL-X3300	A1	SEC-J02	CPS1a-P14A-F04-PDB2	1	N/A
		310H-R1601/02	LNL-1320-S3	A3	SEC-J02	CPS1a-P16A-F04-PDB1	1	1
		310H-R1603/04	LNL-1320-S3	A3	SEC-J02		2	2
		310H-R1605/06	LNL-1320-S3	A3	SEC-J02		3	3
		310H-R1607/08	LNL-1320-S3	A3	SEC-J02		4	4
		310H-R1609/10	LNL-1320-S3	A3	SEC-J02		5	5
		310H-R1611/12	LNL-1320-S3	A3	SEC-J02		6	6
		310H-R1613/14	LNL-1320-S3	A3	SEC-J02		7	7
		310H-R1615/16	LNL-1320-S3	A3	SEC-J02		8	8
	310H-P16-F04-B	310H-R1617/18	LNL-1320-S3	A3	SEC-J02	PS1a-P16B-F04-PDB1	1	9
		310H-R1619	LNL-1300-S3	A2	SEC-J02		2	10
310H-I1601-16		LNL-1100-S3	A4	SEC-J02	3		17	
5W.TR	310H-P17-F05-A	C&S LNL-X3300 310H-C17						
	310H-P17-F05-B	310H-R1713/14	LNL-1320-S3	A3	SEC-J02	CPS1a-P17B-F05-PDB1	1	7
		310H-R1715/16	LNL-1320-S3	A3	SEC-J02		2	8
		310H-R1717/18	LNL-1320-S3	A3	SEC-J02		3	9
		310H-R1719/20	LNL-1320-S3	A3	SEC-J02		4	10
		310H-R1721/22	LNL-1320-S3	A3	SEC-J02		5	11
		310H-R1723/24	LNL-1320-S3	A3	SEC-J02		6	12
		310H-R1725/26	LNL-1320-S3	A3	SEC-J02		7	13
		310H-R1727/28	LNL-1320-S3	A3	SEC-J02		8	14
	310H-P17-F05-C	310H-R1729	LNL-1300-S3	A2	SEC-J02	PS1a-P17C-F05-PDB1	2	15
5E.TR	310H-P18-F05-A	C&S LNL-X3300 310H-C18						
	310H-P18-F05-B	310H-R1815/16	LNL-1320-S3	A3	SEC-J02	CPS1a-P18B-F05-PDB1	1	8
		310H-R1817/18	LNL-1320-S3	A3	SEC-J02		2	9
		310H-R1819/20	LNL-1320-S3	A3	SEC-J02		3	10
		310H-R1821/22	LNL-1320-S3	A3	SEC-J02		4	11
		310H-R1823	LNL-1300-S3	A2	SEC-J02		5	12
		310H-I1801-16	LNL-1100-S3	A4	SEC-J02		6	17

REVISION		Submitted		
#	DATE	DESCRIPTION	BY	APP
0	7/18/2022	Submittal	MF	TN
1	11/4/2022	Revision 1	KW	TN
2	1/25/2023	Revision 2	TNG	TN
3	3/15/2023	Revision 3	TNG	TN
4	8/4/2023	Revision 4	TNG	TN

Package 2

Levels 3, 4, 5

Systems Description Security Systems		Project Galaxy - Fitout	
Job Number	NC22N5230	310 Hudson Street New York, NY 10013	
Drawing Number	SEC-105-P2	ACS Schedules	
		Drawing Size	ANSI B
		Drawing Scale	None



These drawings and designs are the property of Schneider Electric. Their use or reproduction without prior consent of the company is strictly forbidden.

Power Supply Board Schedule									
Location	Enclosure Name	Power Supply Board Name	Part Number	Term. Detail	Detail Drawing Reference	Output Voltage	Fire Alarm Tie-In	Dip Switch & Jumper Settings	Notes
3W.TR	310H-P11-F03-B	CPS1a-P11B-F03	FPO150	B1	SEC-J03	12	No		
		LPS1a-P11B-F03	FPO250	B2	SEC-J03	24	No		
	310H-P11-F03-C	CPS1a-P11C-F03	FPO150	B1	SEC-J03	12	No		
		LPS1a-P11C-F03	FPO250	B2	SEC-J03	24	No		
3E.TR	310H-P12-F03-B	CPS1a-P12B-F03	FPO150	B1	SEC-J03	12	No		
		LPS1a-P12B-F03	FPO250	B2	SEC-J03	24	No		
	310H-P12-F03-C	PS1a-P12C-F03	FPO250	B2	SEC-J03	24	No		
4W.TR	310H-P13-F04-B	CPS1a-P13A-F04	FPO150	B1	SEC-J03	12	No		
		LPS1a-P13A-F04	FPO250	B2	SEC-J03	24	No		
	310H-P14-F04-A	CPS1a-P14A-F04	FPO150	B1	SEC-J03	12	No		
		LPS1a-P14A-F04	FPO250	B2	SEC-J03	24	No		
4E.TR	310H-P15-F04-B	CPS1a-P15B-F04	FPO150	B1	SEC-J03	12	No		
		LPS1a-P15B-F04	FPO250	B2	SEC-J03	24	No		
	310H-P16-F04-A	CPS1a-P16A-F04	FPO150	B1	SEC-J03	12	No		
		LPS1a-P16A-F04	FPO250	B2	SEC-J03	24	No		
	310H-P16-F04-B	PS1a-P16B-F04	FPO250	B2	SEC-J03	24	No		
5W.TR	310H-P17-F05-B	CPS1a-P17B-F05	FPO150	B1	SEC-J03	12	No		
		LPS1a-P17B-F05	FPO250	B2	SEC-J03	24	No		
	310H-P17-F05-C	PS1a-P17C-F05	FPO250	B2	SEC-J03	24	No		
5E.TR	310H-P18-F05-B	CPS1a-P18B-F05	FPO150	B1	SEC-J03	12	No		
		LPS1a-P18B-F05	FPO250	B2	SEC-J03	24	No		

Netlink Board Schedule							
Termination Location	Enclosure	Name	Part Number	Term. Detail	Detail Drawing Ref.	Powered By	Powered By Channel
SDF-3-TRW	310H-P11-F03-C	NL-P11C-F03	NLX Network module	D2	SEC-J05	CPS1a-P11C-F03	NL1/NL4 Power
	310H-P11-F03-B	NL-P11B-F03	NLX Network module	D2	SEC-J05	CPS1a-P11B-F03	NL1/NL4 Power
SDF-3-TRE	310H-P12-F03-C	NL-P12C-F03	NL4 Network module	D1	SEC-J05	CPS1a-P12C-F03	NL1/NL4 Power
	310H-P12-F03-B	NL-P12B-F03	NLX Network module	D2	SEC-J05	CPS1a-P12B-F03	NL1/NL4 Power
SDF-4-TRW	310H-P14-F04-A	NL-P14A-F04	NLX Network module	D2	SEC-J05	CPS1a-P14A-F04	NL1/NL4 Power
	310H-P13-F04-B	NL-P13B-F04	NLX Network module	D2	SEC-J05	CPS1a-P13A-F04	NL1/NL4 Power
SDF-4-TRE	310H-P16-F04-B	NL-P16B-F04	NL4 Network module	D1	SEC-J05	CPS1a-P16B-F04	NL1/NL4 Power
	310H-P16-F04-A	NL-P16A-F04	NLX Network module	D2	SEC-J05	CPS1a-P16A-F04	NL1/NL4 Power
	310H-P15-F04-B	NL-P15B-F04	NLX Network module	D2	SEC-J05	CPS1a-P15B-F04	NL1/NL4 Power
SDF-5-TRW	310H-P17-F05-C	NL-P17C-F05	NL4 Network module	D1	SEC-J05	CPS1a-P17C-F05	NL1/NL4 Power
	310H-P17-F05-B	NL-P17B-F05	NLX Network module	D2	SEC-J05	CPS1a-P17B-F05	NL1/NL4 Power
SDF-5-TRE	310H-P18-F05-B	NL-P18B-F05	NLX Network module	D2	SEC-J05	CPS1a-P18B-F05	NL1/NL4 Power

Power Distribution Board Schedule									
Location	Enclosure Name	Power Distribution Board Name	Part Number	Term. Detail	Detail Drawing Reference	Power From	Fire Alarm Tie-In	Dip Switch & Jumper Settings	Notes
3W.TR	310H-P11-F03-B	CPS1a-P11B-F03-PDB1	M8P	C2	SEC-J04	CPS1a-P11B-F03	No		
		CPS1a-P11B-F03-PDB2	M8P	C2	SEC-J04		No		
		LPS1a-P11B-F03-PDB1	M8	C1	SEC-J04	LPS1a-P11B-F03	Yes		
		LPS1a-P11B-F03-PDB2	M8	C1	SEC-J04		Yes		
	310H-P11-F03-C	CPS1a-P11C-F03-PDB1	M8P	C2	SEC-J04	CPS1a-P11C-F03	No		
		CPS1a-P11C-F03-PDB2	M8P	C2	SEC-J04		No		
		LPS1a-P11C-F03-PDB1	M8	C1	SEC-J04	LPS1a-P11C-F03	Yes		
		LPS1a-P11C-F03-PDB2	M8	C1	SEC-J04		Yes		
3E.TR	310H-P12-F03-B	CPS1a-P12B-F03-PDB1	M8P	C2	SEC-J04	CPS1a-P12B-F03	No		
		CPS1a-P12B-F03-PDB2	M8P	C2	SEC-J04		No		
		LPS1a-P12B-F03-PDB1	M8	C1	SEC-J04	LPS1a-P12B-F03	Yes		
		LPS1a-P12B-F03-PDB2	M8	C1	SEC-J04		Yes		
	310H-P12-F03-C	PS1a-P12C-F03-PDB1	M8P	C2	SEC-J04	PS1a-P12C-F03	No		
		PS1a-P12C-F03-PDB2	M8	C1	SEC-J04		Yes		
		PS1a-P12C-F03-VC	B100	B3	SEC-J03		No		
4W.TR	310H-P13-F04-B	CPS1a-P13A-F04-PDB1	M8P	C2	SEC-J04	CPS1a-P13A-F04	No		
		CPS1a-P13A-F04-PDB2	M8P	C2	SEC-J04		No		
		LPS1a-P13A-F04-PDB1	M8	C1	SEC-J04	LPS1a-P13A-F04	Yes		
		LPS1a-P13A-F04-PDB2	M8	C1	SEC-J04		Yes		
	310H-P14-F04-A	CPS1a-P14A-F04-PDB1	M8P	C2	SEC-J04	CPS1a-P14A-F04	No		
		CPS1a-P14A-F04-PDB2	M8P	C2	SEC-J04		No		
		LPS1a-P14A-F04-PDB1	M8	C1	SEC-J04	LPS1a-P14A-F04	Yes		
		LPS1a-P14A-F04-PDB2	M8	C1	SEC-J04		Yes		
4E.TR	310H-P15-F04-B	CPS1a-P15B-F04-PDB1	M8P	C2	SEC-J04	CPS1a-P15B-F04	No		
		CPS1a-P15B-F04-PDB2	M8P	C2	SEC-J04		No		
		LPS1a-P15B-F04-PDB1	M8	C1	SEC-J04	LPS1a-P15B-F04	Yes		
		LPS1a-P15B-F04-PDB2	M8	C1	SEC-J04		Yes		
	310H-P16-F04-A	CPS1a-P16A-F04-PDB1	M8P	C2	SEC-J04	CPS1a-P16A-F04	No		
		CPS1a-P16A-F04-PDB2	M8P	C2	SEC-J04		No		
		LPS1a-P16A-F04-PDB1	M8	C1	SEC-J04	LPS1a-P16A-F04	Yes		
		LPS1a-P16A-F04-PDB2	M8	C1	SEC-J04		Yes		
310H-P16-F04-B	310H-P16-F04-B	PS1a-P16B-F04-PDB1	M8P	C2	SEC-J04	PS1a-P16B-F04	No		
		PS1a-P16B-F04-PDB2	M8	C1	SEC-J04		Yes		
		PS1a-P16B-F04-VC	B100	B3	SEC-J03		No		
	310H-P17-F05-B	CPS1a-P17B-F05-PDB1	M8P	C2	SEC-J04	CPS1a-P17B-F05	No		
		CPS1a-P17B-F05-PDB2	M8P	C2	SEC-J04		No		
		LPS1a-P17B-F05-PDB1	M8	C1	SEC-J04	LPS1a-P17B-F05	Yes		
		LPS1a-P17B-F05-PDB2	M8	C1	SEC-J04		Yes		
5W.TR	310H-P17-F05-C	PS1a-P17C-F05-PDB1	M8P	C2	SEC-J04	PS1a-P17C-F05	No		
		PS1a-P17C-F05-PDB2	M8	C1	SEC-J04		Yes		
		PS1a-P17C-F05-VC	B100	B3	SEC-J03		No		
	310H-P18-F05-B	CPS1a-P18B-F05-PDB1	M8P	C2	SEC-J04	CPS1a-P18B-F05	No		
		CPS1a-P18B-F05-PDB2	M8P	C2	SEC-J04		No		
5E.TR	310H-P18-F05-B	LPS1a-P18B-F05-PDB1	M8	C1	SEC-J04	LPS1a-P18B-F05	Yes		
		LPS1a-P18B-F05-PDB2	M8	C1	SEC-J04		Yes		



These drawings and designs are the property of Schneider Electric. Their use or reproduction without prior consent of the company is strictly forbidden.

REVISION		Submitted	
#	DATE	DESCRIPTION	BY
0	7/18/2022	Submittal	APP
1	11/4/2022	Revision 1	TN
2	1/25/2023	Revision 2	TN
3	3/15/2023	Revision 3	TN
4	8/4/2023	Revision 4	TN

Package 2

Levels 3, 4, 5

Project Galaxy - Fitout

310 Hudson Street
New York, NY 10013

ACS Schedules

Systems Description		Security Systems	
Job Number	NC22N5230	Drawing Size	ANSI B
Drawing Number	SEC-106-P2	Drawing Scale	None

Location	Floor	Device Name (Cerami)	Description	Termination Location	Cable	Type	Intercom Model
Reception (03V12)	3	310H-F03-ICM01	Video Intercom Master Station	SDF-3-TRE	A1	K1	2N TOUCH
Reception (03V12)	3	310H-F03-ICS01	Interior IP Intercom with camera	SDF-3-TRE	A1, E1	K3	2N IP VERSO
Corridor (03Z11)	3	310H-F03-ICS02	Interior IP Intercom with camera	SDF-3-TRE	A1, E1	K3	2N IP VERSO

REVISION		Submitted	
#	DATE	DESCRIPTION	BY
0	7/18/2022	Submittal	MF
1	11/4/2022	Revision 1	KW
2	1/25/2023	Revision 2	TNG
3	3/15/2023	Revision 3	TNG
4	8/4/2023	Revision 4	TNG

Systems Description		Project Galaxy - Fitout	
Security Systems		310 Hudson Street New York, NY 10013	
Job Number	Drawing Size	Intercom Schedule	
NC22N5230	ANSI B		
Drawing Number	Drawing Scale		
SEC-K01-P2	None		




These drawings and designs are the property of Schneider Electric. Their use or reproduction without prior consent of the company is strictly forbidden.


Package 2

Levels 3, 4, 5



Intercom Type K1 Installation and Wiring Detail

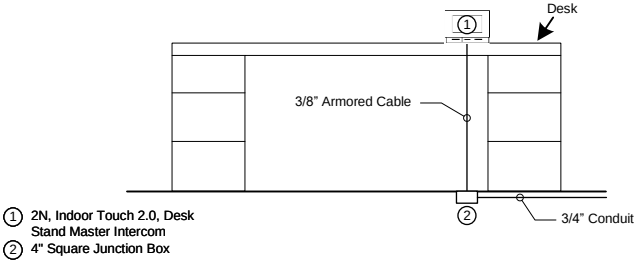

Wiring Details:
Refer to Intercom Schedule (Drawing SEC-K01) for additional termination details.

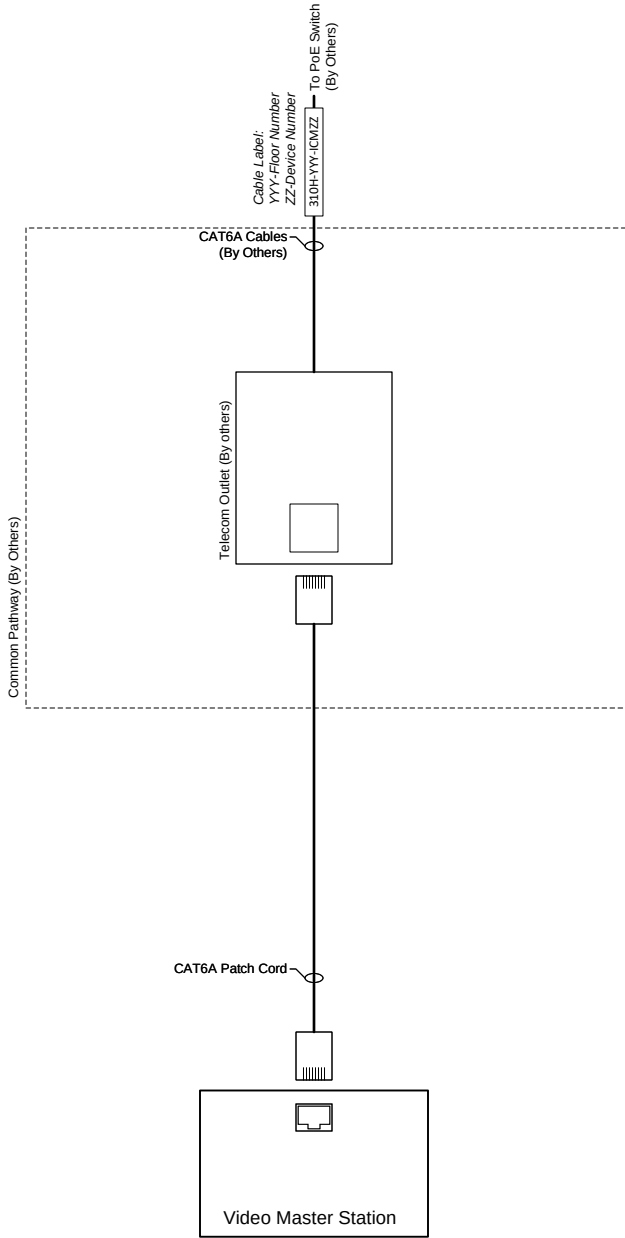

Intercom Type K3 Installation and Wiring Detail

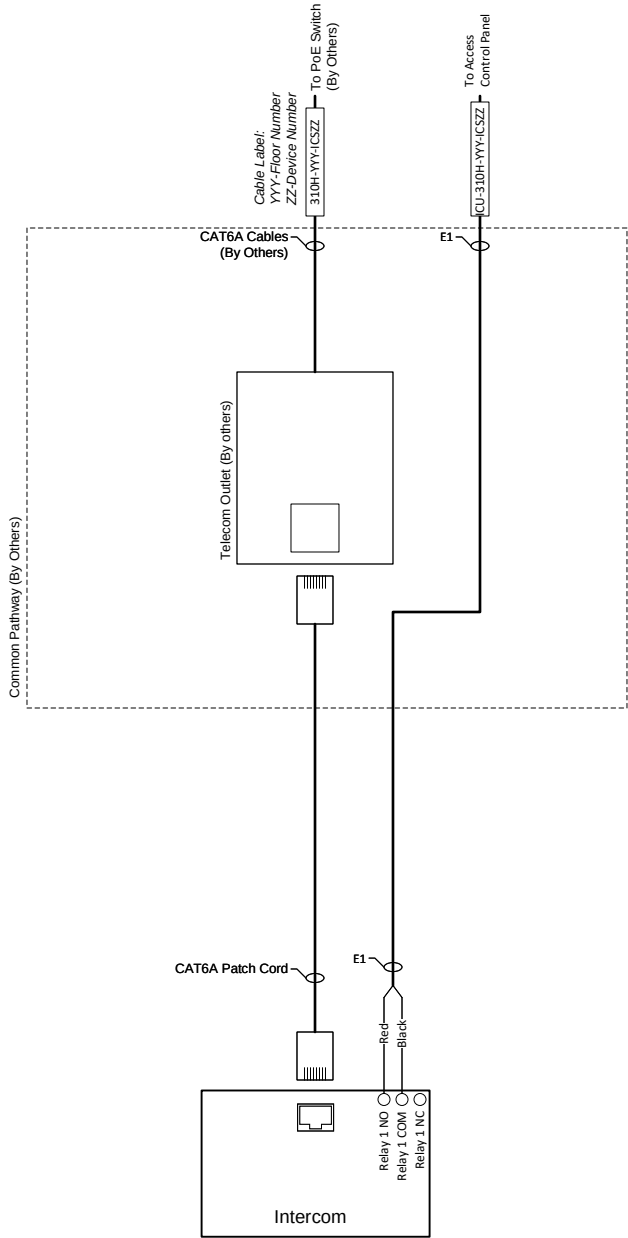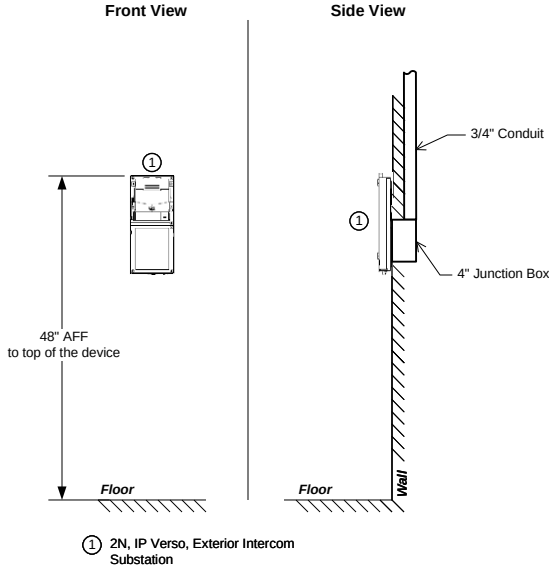

REVISION		Submitted			
#	DATE	DESCRIPTION	BY	APP	
0	7/18/2022	Submittal	MF	TN	
1	11/4/2022	Revision 1	KW	TN	
2	1/25/2023	Revision 2	TNG	TN	
3	3/15/2023	Revision 3	TNG	TN	
4	8/4/2023	Revision 4	TNG	TN	

Systems Description		Project Galaxy - Fitout	
Security Systems		310 Hudson Street New York, NY 10013	
Job Number NC22N5230	Drawing Size ANSI B	Intercom Details	
Drawing Number SEC-K02-P2	Drawing Scale None		
Package 2 Levels 3, 4, 5			

SE Device Name	Floor	Location	Camera Type (Fisheye/Fixed/360)	Environment (Indoor/Outdoor)	Surface (Wall/ Ceiling/Pendant)	Cable	MANUFACTURER	Mount Part Number 1	SE Installation Detail	Termination Location
310H-F03-C01	LEVEL 3	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N3	3W.TR
310H-F03-C02	LEVEL 3	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N3	3W.TR
310H-F03-C03	LEVEL 3	ELEVATOR LOBBY	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N2	3W.TR
310H-F03-C04	LEVEL 3	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N3	3W.TR
310H-F03-C05	LEVEL 3	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N3	3W.TR
310H-F03-C06	LEVEL 3	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N3	3W.TR
310H-F03-C07	LEVEL 3	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N3	3W.TR
310H-F03-C08	LEVEL 3	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N3	3W.TR
310H-F03-C22	LEVEL 3	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N3	3W.TR
310H-F03-C23	LEVEL 3	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N3	3W.TR
310H-F03-C25	LEVEL 3	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N3	3W.TR
310H-F03-C42	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C43	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C44	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C45	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C46	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C47	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C48	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C49	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C50	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C51	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C52	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C53	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C54	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C55	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C56	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C57	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C58	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C59	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C60	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C61	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C62	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C63	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C64	LEVEL 3	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N3	3W.TR
310H-F03-C65	LEVEL 3	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N3	3W.TR
310H-F03-C66	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C67	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C68	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C69	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C70	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C71	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C72	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C73	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C74	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C75	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C76	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR

Systems Description

Security Systems

Job Number

NC22N5230

Drawing Number

SEC-N01-P2

Drawing Size

ANSI B

Drawing Scale

None

Project Galaxy - Fitout

310 Hudson Street
New York, NY 10013

Camera Schedule

Package 2

Levels 3, 4, 5

REVISION

Submitted

#	DATE	DESCRIPTION	BY	APP
0	7/18/2022	Submittal	MF	TN
1	11/4/2022	Revision 1	KW	TN
2	1/25/2023	Revision 2	TNG	TN
3	3/15/2023	Revision 3	TNG	TN
4	8/4/2023	Revision 4	TNG	TN

Schneider Electric

These drawings and designs are the property of Schneider Electric. Their use or reproduction without prior consent of the company is strictly forbidden.

SE Device Name	Floor	Location	Camera Type (Fisheye/Fixed/360)	Environment (Indoor/Outdoor)	Surface (Wall/ Ceiling/Pendant)	Cable	MANUFACTURER	Mount Part Number 1	SE Installation Detail	Termination Location
310H-F03-C77	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C78	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C79	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C80	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C81	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C82	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C83	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C84	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C85	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C86	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C87	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C88	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C89	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C90	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C91	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C92	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C93	LEVEL 3	3E.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3E.TR
310H-F03-C94	LEVEL 3	3E.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3E.TR
310H-F03-C95	LEVEL 3	3E.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3E.TR
310H-F03-C96	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C97	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C98	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C99	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C100	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C101	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C102	LEVEL 3	3E.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3E.TR
310H-F03-C103	LEVEL 3	3E.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3E.TR
310H-F03-C104	LEVEL 3	3E.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3E.TR
310H-F03-C105	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C106	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C107	LEVEL 3	3W.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3W.TR
310H-F03-C09	LEVEL 3	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N3	3E.TR
310H-F03-C10	LEVEL 3	CER CONSUMABLES	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N3	3E.TR
310H-F03-C11	LEVEL 3	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N3	3E.TR
310H-F03-C12	LEVEL 3	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N3	3E.TR
310H-F03-C13	LEVEL 3	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N3	3E.TR
310H-F03-C14	LEVEL 3	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N3	3E.TR
310H-F03-C15	LEVEL 3	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N3	3E.TR
310H-F03-C16	LEVEL 3	ELEVATOR LOBBY	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N2	3E.TR
310H-F03-C18	LEVEL 3	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N3	3E.TR
310H-F03-C19	LEVEL 3	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N3	3E.TR
310H-F03-C20	LEVEL 3	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N3	3E.TR
310H-F03-C21	LEVEL 3	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N3	3E.TR
310H-F03-C24	LEVEL 3	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N3	3E.TR
310H-F03-C26	LEVEL 3	3E.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3E.TR
310H-F03-C27	LEVEL 3	3E.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3E.TR
310H-F03-C28	LEVEL 3	3E.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3E.TR

Systems Description

Security Systems

Job Number

NC22N5230

Drawing Number

SEC-N02-P2

Drawing Size

ANSI B

Drawing Scale

None

Project Galaxy - Fitout

310 Hudson Street
New York, NY 10013

Camera Schedule

Package 2

Levels 3, 4, 5

REVISION

Submitted

#	DATE	DESCRIPTION	BY	APP
0	7/18/2022	Submittal	MF	TN
1	11/4/2022	Revision 1	KW	TN
2	1/25/2023	Revision 2	TNG	TN
3	3/15/2023	Revision 3	TNG	TN
4	8/4/2023	Revision 4	TNG	TN

Schneider Electric

These drawings and designs are the property of Schneider Electric. Their use or reproduction without prior consent of the company is strictly forbidden.

SE Device Name	Floor	Location	Camera Type (Fisheye/Fixed/360)	Environment (Indoor/Outdoor)	Surface (Wall/ Ceiling/Pendant)	Cable	MANUFACTURER	Mount Part Number 1	SE Installation Detail	Termination Location
310H-F03-C29	LEVEL 3	3E.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3E.TR
310H-F03-C30	LEVEL 3	3E.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3E.TR
310H-F03-C31	LEVEL 3	3E.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3E.TR
310H-F03-C32	LEVEL 3	3E.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3E.TR
310H-F03-C33	LEVEL 3	3E.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3E.TR
310H-F03-C34	LEVEL 3	3E.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3E.TR
310H-F03-C35	LEVEL 3	3E.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3E.TR
310H-F03-C36	LEVEL 3	3E.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3E.TR
310H-F03-C37	LEVEL 3	3E.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3E.TR
310H-F03-C38	LEVEL 3	3E.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3E.TR
310H-F03-C39	LEVEL 3	3E.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3E.TR
310H-F03-C40	LEVEL 3	3E.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3E.TR
310H-F03-C41	LEVEL 3	3E.CER	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	3E.TR
310H-F04-C01	LEVEL 4	CORRIDOR	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	4W.TR
310H-F04-C02	LEVEL 4	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N3	4W.TR
310H-F04-C03	LEVEL 4	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N2	4W.TR
310H-F04-C04	LEVEL 4	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N2	4W.TR
310H-F04-C05	LEVEL 4	ELEVATOR LOBBY	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N2	4W.TR
310H-F04-C06	LEVEL 4	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N2	4W.TR
310H-F04-C07	LEVEL 4	OPEN COLLAB	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N2	4W.TR
310H-F04-C08	LEVEL 4	LOCKERS	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N2	4W.TR
310H-F04-C09	LEVEL 4	ELEVATOR LOBBY	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N2	4W.TR
310H-F04-C10	LEVEL 4	CORRIDOR WEST	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N2	4W.TR
310H-F04-C11	LEVEL 4	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N2	4W.TR
310H-F04-C12	LEVEL 4	CORRIDOR	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	4W.TR
310H-F04-C13	LEVEL 4	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N2	4W.TR
310H-F04-C14	LEVEL 4	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N2	4W.TR
310H-F04-C15	LEVEL 4	OPEN COLLAB	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	4W.TR
310H-F04-C16	LEVEL 4	OPEN COLLAB	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	4W.TR
310H-F04-C34	LEVEL 4	CORRIDOR	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	4W.TR
310H-F04-C35	LEVEL 4	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N2	4W.TR
310H-F04-C38	LEVEL 4	EXTERIOR	Fixed	Outdoor	WALL	A1	AXIS	P3247-LVE	O1	4W.TR
310H-F04-C41	LEVEL 4	LOCKERS	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N2	4W.TR
310H-F04-C42	LEVEL 4	LOCKERS	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N2	4W.TR
310H-F04-C17	LEVEL 4	EXTERIOR	Fixed	Outdoor	WALL	A1	AXIS	P3247-LVE	O1	4E.TR
310H-F04-C18	LEVEL 4	CORRIDOR	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	4E.TR
310H-F04-C19	LEVEL 4	CORRIDOR	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	4E.TR
310H-F04-C20	LEVEL 4	CORRIDOR	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	4E.TR
310H-F04-C21	LEVEL 4	PRODUCTION STORAGE	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	4E.TR
310H-F04-C22	LEVEL 4	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N2	4E.TR
310H-F04-C23	LEVEL 4	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N2	4E.TR
310H-F04-C24	LEVEL 4	CORRIDOR	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	4E.TR
310H-F04-C25	LEVEL 4	ELEVATOR LOBBY	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N2	4E.TR
310H-F04-C26	LEVEL 4	ELECTRICAL	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	4E.TR
310H-F04-C27	LEVEL 4	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N2	4E.TR
310H-F04-C28	LEVEL 4	ELEVATOR LOBBY	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N2	4E.TR

Systems Description

Security Systems

Job Number

NC22N5230

Drawing Number

SEC-N03-P2

Drawing Size

ANSI B

Drawing Scale

None

Project Galaxy - Fitout

310 Hudson Street
New York, NY 10013

Camera Schedule

Package 2

Levels 3, 4, 5

REVISION

Submitted

#	DATE	DESCRIPTION	BY	APP
0	7/18/2022	Submittal	MF	TN
1	11/4/2022	Revision 1	KW	TN
2	1/25/2023	Revision 2	TNG	TN
3	3/15/2023	Revision 3	TNG	TN
4	8/4/2023	Revision 4	TNG	TN

Schneider Electric

These drawings and designs are the property of Schneider Electric. Their use or reproduction without prior consent of the company is strictly forbidden.

SE Device Name	Floor	Location	Camera Type (Fisheye/Fixed/360)	Environment (Indoor/Outdoor)	Surface (Wall/ Ceiling/Pendant)	Cable	MANUFACTURER	Mount Part Number 1	SE Installation Detail	Termination Location
310H-F04-C29	LEVEL 4	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N2	4E.TR
310H-F04-C30	LEVEL 4	COPY/PRINT	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	4E.TR
310H-F04-C31	LEVEL 4	CORRIDOR	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	4E.TR
310H-F04-C32	LEVEL 4	OPEN STO.	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	4E.TR
310H-F04-C33	LEVEL 4	CORRIDOR	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	4E.TR
310H-F04-C36	LEVEL 4	CORRIDOR	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	4E.TR
310H-F04-C37	LEVEL 4	CORRIDOR	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	4E.TR
310H-F04-C39	LEVEL 4	CORRIDOR	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	4E.TR
310H-F04-C40	LEVEL 4	LOCKERS	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	4E.TR
310H-F05-C51	LEVEL 4	CORRIDOR	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5W.TR
310H-F05-C52	LEVEL 4	STUDIO 4J	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5W.TR
310H-F05-C53	LEVEL 4	STUDIO 4K	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5W.TR
310H-F05-C54	LEVEL 4	STUDIO 4F - WASBC SR	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5W.TR
310H-F05-C55	LEVEL 4	STUDIO 4G	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5W.TR
310H-F05-C56	LEVEL 4	STUDIO 4D - WABC	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5W.TR
310H-F05-C57	LEVEL 4	STUDIO 4D - WABC	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5W.TR
310H-F05-C01	LEVEL 5	OPEN OFFICE	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5W.TR
310H-F05-C02	LEVEL 5	CORRIDOR	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5W.TR
310H-F05-C03	LEVEL 5	CORRIDOR	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5W.TR
310H-F05-C04	LEVEL 5	CORRIDOR	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5W.TR
310H-F05-C05	LEVEL 5	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N2	5W.TR
310H-F05-C06	LEVEL 5	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N2	5W.TR
310H-F05-C07	LEVEL 5	CORRIDOR	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5W.TR
310H-F05-C08	LEVEL 5	ELEVATOR LOBBY	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N4	5W.TR
310H-F05-C09	LEVEL 5	RADIO GR	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5W.TR
310H-F05-C10	LEVEL 5	CORRIDOR	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5W.TR
310H-F05-C11	LEVEL 5	LOCKERS	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N2	5W.TR
310H-F05-C12	LEVEL 5	ELEVATOR LOBBY	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N2	5W.TR
310H-F05-C13	LEVEL 5	WORK CAFE	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N3	5W.TR
310H-F05-C14	LEVEL 5	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N2	5W.TR
310H-F05-C15	LEVEL 5	EXTERIOR	Fixed	Outdoor	WALL	A1	AXIS	P3247-LVE	O1	5W.TR
310H-F05-C16	LEVEL 5	COPY PRINT	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N2	5W.TR
310H-F05-C17	LEVEL 5	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N2	5W.TR
310H-F05-C18	LEVEL 5	OPEN OFFICE	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N2	5W.TR
310H-F05-C19	LEVEL 5	OPEN OFFICE	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N2	5W.TR
310H-F05-C20	LEVEL 5	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N2	5W.TR
310H-F05-C21	LEVEL 5	CORRIDOR	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5W.TR
310H-F05-C34	LEVEL 5	LOCKERS	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N2	5E.TR
310H-F05-C41	LEVEL 4	CORRIDOR	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5W.TR
310H-F05-C42	LEVEL 4	CORRIDOR	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5E.TR
310H-F05-C43	LEVEL 4	STUDIO 4L	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5E.TR
310H-F05-C44	LEVEL 4	STUDIO 4M	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5E.TR
310H-F05-C45	LEVEL 4	STUDIO 4N	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5E.TR
310H-F05-C46	LEVEL 4	STUDIO 4H	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5E.TR
310H-F05-C47	LEVEL 4	STUDIO 4I - ABC SR	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5E.TR
310H-F05-C48	LEVEL 4	STUDIO 4E - ABC	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5E.TR
310H-F05-C49	LEVEL 4	STUDIO 4E - ABC	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5E.TR

Systems Description

Security Systems

Job Number

NC22N5230

Drawing Number

SEC-N04-P2

Drawing Size

ANSI B

Drawing Scale

None

Project Galaxy - Fitout

310 Hudson Street

New York, NY 10013

Camera Schedule

Package 2

Levels 3, 4, 5

REVISION

Submitted

#	DATE	DESCRIPTION	BY	APP
0	7/18/2022	Submittal	MF	TN
1	11/4/2022	Revision 1	KW	TN
2	1/25/2023	Revision 2	TNG	TN
3	3/15/2023	Revision 3	TNG	TN
4	8/4/2023	Revision 4	TNG	TN

Schneider Electric

These drawings and designs are the property of Schneider Electric. Their use or reproduction without prior consent of the company is strictly forbidden.

SE Device Name	Floor	Location	Camera Type (Fisheye/Fixed/360)	Environment (Indoor/Outdoor)	Surface (Wall/ Ceiling/Pendant)	Cable	MANUFACTURER	Mount Part Number 1	SE Installation Detail	Termination Location
310H-F05-C50	LEVEL 4	CORRIDOR	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5W.TR
310H-F05-C22	LEVEL 5	PRINT GRAPHICS	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5E.TR
310H-F05-C23	LEVEL 5	CORRIDOR	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5E.TR
310H-F05-C24	LEVEL 5	GRAPHICS	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5E.TR
310H-F05-C25	LEVEL 5	GRAPHICS	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5E.TR
310H-F05-C26	LEVEL 5	CORRIDOR	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5E.TR
310H-F05-C27	LEVEL 5	CORRIDOR	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5E.TR
310H-F05-C28	LEVEL 5	GRAPHICS	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5E.TR
310H-F05-C29	LEVEL 5	GRAPHICS	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5E.TR
310H-F05-C30	LEVEL 5	GRAPHICS	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5E.TR
310H-F05-C31	LEVEL 5	CORRIDOR	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N2	5E.TR
310H-F05-C32	LEVEL 5	WORK CAFÉ	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N3	5E.TR
310H-F05-C33	LEVEL 5	ELEVATOR C VESTIBULE	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N2	5E.TR
310H-F05-C35	LEVEL 5	EXTERIOR	Fixed	Outdoor	WALL	A1	AXIS	P3247-LVE	O1	5E.TR
310H-F05-C36	LEVEL 5	ELEVATOR C VESTIBULE	Fixed	Indoor	CEILING	A1	AXIS	P3245-LV	N2	5E.TR
310H-F05-C37	LEVEL 5	CORRIDOR	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5E.TR
310H-F05-C38	LEVEL 5	CORRIDOR	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5E.TR
310H-F05-C39	LEVEL 5	COLLAB OPEN	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5E.TR
310H-F05-C40	LEVEL 5	PRINT GRAPHICS	Fixed	Indoor	PENDANT	A1	AXIS	P3245-LV	N4	5W.TR

Systems Description

Security Systems

Job Number

NC22N5230

Drawing Number

SEC-N05-P2

Drawing Size

ANSI B

Drawing Scale

None

Project Galaxy - Fitout

310 Hudson Street

New York, NY 10013

Camera Schedule

Package 2

Levels 3, 4, 5

REVISION

Submitted

#	DATE	DESCRIPTION	BY	APP
0	7/18/2022	Submittal	MF	TN
1	11/4/2022	Revision 1	KW	TN
2	1/25/2023	Revision 2	TNG	TN
3	3/15/2023	Revision 3	TNG	TN
4	8/4/2023	Revision 4	TNG	TN

Schneider Electric

These drawings and designs are the property of Schneider Electric. Their use or reproduction without prior consent of the company is strictly forbidden.