


AD vs Control — In_PVALB

Up: 501 | Down: 422

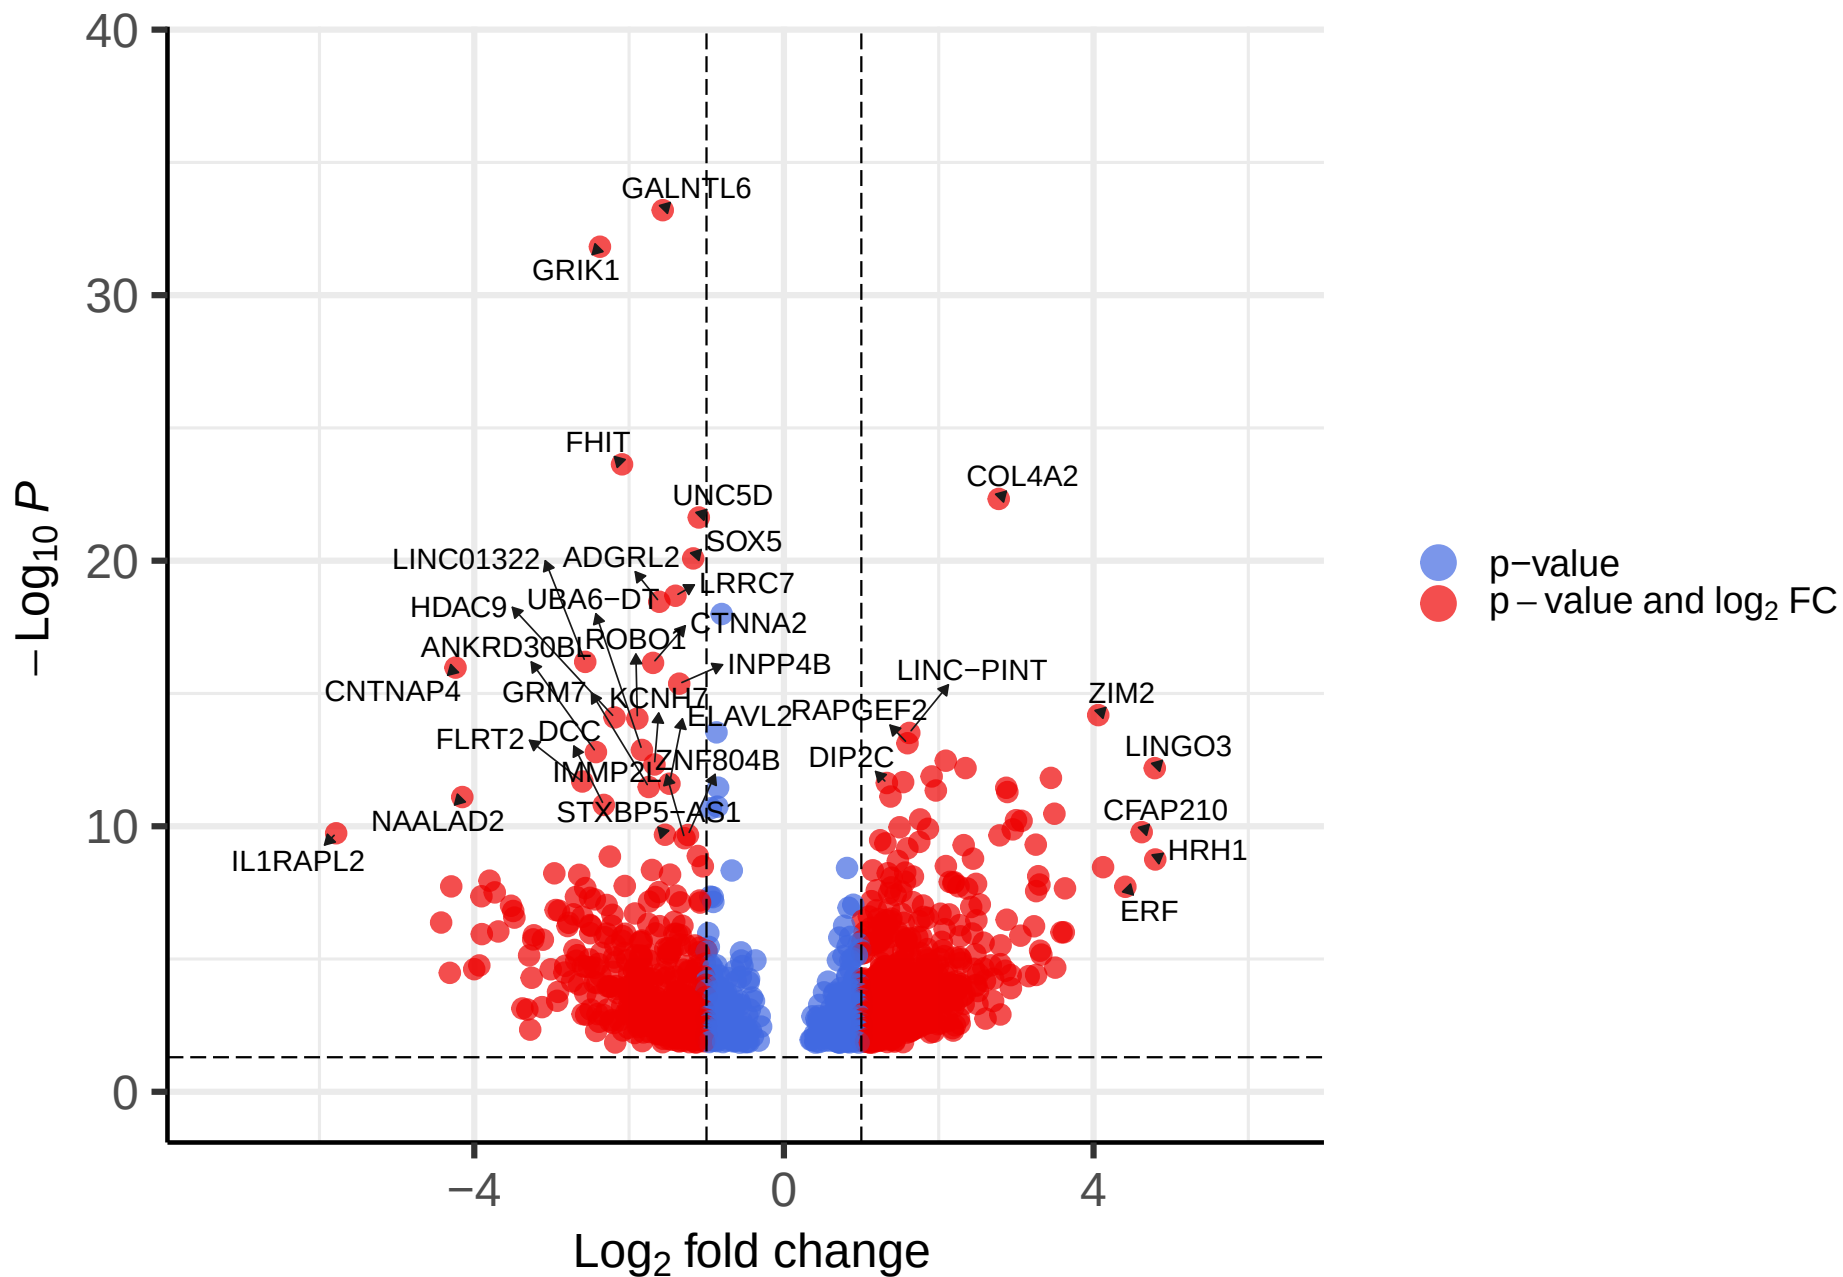

total = 1303 variables