Technical Site Visit Report

Prepared for: Shaurya Sirohi - 179

PROJECT INFORMATION

Report Number	ESV-2026-0104
Project ID	1E3D3EB4
Project Name	Shaurya Sirohi
Building Name	179
Billing Name	Shaurya Sirohi
Project Sector	Residential
Project Type	With Subsidy
Sales Lead	Govindaraju JS
Site Address	#179, Nambiar Ellengenza Muthanallur Road Gopasandra Bangalore 560099.
GPS Coordinates	12.8459795, 77.7336118
Google Maps	https://www.google.com/maps?q=12.8459795,77.7336118
Visit Date	2026-05-06
Visited By	K Naveen
Revision	Rev 3

CLIENT INFORMATION

Client Name	Shaurya Sirohi
Contact	8123776234

PROJECT DETAILS

Solar Rooftop System Type	On-Grid
System Capacity (kWp)	6.20
Sanction Load (kW)	7
Module Make & Capacity	Adani DCR bifacial 620 Wp

Module Length (mm)	2382
Module Width (mm)	1133
Number of Panels	10
Inverter Type	Micro
Inverter Brand	Enphase IQ8P
Number of Inverters	10
Mounting Structure Type	Elevated

SITE INSPECTION CHECKLIST

General

#	Question	Answer	Notes
1	Can the delivery van/truck reach the material unloading point?	Yes	-
2	Are there any obstacles at the site that could hinder material lifting?	**No**	-
3	Where will the Inverter, DCDB, ACDB, Battery, etc. be located?	N/A	-
4	Is a canopy required for protecting the Inverters/ACDB/DCDB?	N/A	-
5	Did you discuss the location of the earth pits with the customer?	The earth pits are located near the south west corner	-
6	Where is the Internet Router located?	First floor	-
7	What's the Wi-Fi strength of the router near to the String inverter/Envoy?	3 bars	-
8	Did you pin the site location in your WhatsApp when you were at the site?	Yes	-

Roof Details

#	Question	Answer	Notes
1	What type of roof is present at the site?	RCC Flat Roof	*RCC Flat roof with laid of tiles*
2	Are there any obstructions on the roof that could affect the solar installation?	details: Solar water heater are the obstructions	-
3	What is the angle of the panels? (in degrees)	10	-
4	In case of sloped roof, what is the slope angle of the roof? (in degrees)	N/A	-
5	On how many roofs at the site are we installing solar?	1	-
6	If it is a Tiled roof, what is underneath the tiles?	N/A	-
7	If it is a Tiled roof with MS or Wooden rafters, is it Single-tiled or Double-tiled?	N/A	-
8	What type of mounting structure is planned?	Elevated	*SolrFit X-Series-Elevated HDGI with ballast and Adhesive*

#	Question	Answer	Notes
9	What is the orientation of the solar panels?	["South"]	-
10	How can the roof be accessed?	Staircase	-
11	Is the building currently under construction?	**No**	-
12	In an under-construction building, are existing conduit pipes available for AC, DC cables, and earthing?	Yes	*Not Under construction building but existing conduit pipe is available to drop the AC cable till the meter location.*
13	What is the height of the building and how many floors does it have?	The Height of the building is G+1+Headroom is approximately 12 meters.	-
14	Is the site photo matching with the building description?	Yes	-
15	Is there an overhead HT line passing within a 10-meter radius of the site?	**No**	-

Residential / Electrical

#	Question	Answer	Notes
1	What type of energy meter is currently installed?	Phase: Three Phase, Type: Digital, If 3-phase: N/A	-
2	Is the Meter cubicle photo matching with the previous answer?	Yes	-
3	Has the termination point in the Main meter panel been identified?	Yes	-
4	Is the Termination Point easily visible or sealed?	Visible	-
5	Is a Lightning Arrestor (LA) already available at the site?	**No**	-
6	Is space available for CT within Energy meter panel?	**No**	-
7	In case of an Enphase system, is the distance between the farthest micro-inverter and IQ Gateway > 50m?	Less than 50m	-
8	Provide details of the existing CT ratings (if applicable).	N/A	-
9	In Main meter panel, is empty space available for solar meter?	**No**	*Not Available*
10	In Main meter panel, is empty space available to house the Enphase accessories or ACDB components?	**No**	*Not Available*
11	Is there space available to dig DC, AC and LA earth pits?	Yes	-
12	In case of elevated structures, is an LA extension provided at the far end?	Yes	-
13	In case of elevated structures, is it with or without grouting?	Not Applicable	*SolrFit X-Series-Elevated HDGI with ballast and Adhesive*
14	Are there any challenges with respect to Installation and Maintenance activities?	**No**	-
15	Are there any safety risks associated with accessing the roof for installation?	**No**	-
16	Is space present in rooftop to store the panels?	Horizontally sleeping	-
17	In case of sloped roof MS structure, provide the dimension of rafter to rafter, purlin to purlin.	N/A	-
18	Is ventilation available in the battery location?	N/A	-

#	Question	Answer	Notes
19	Should the Inverters/ACDB/DCDB be installed on a metal grill or wall mount?	N/A	-
20	Provide the dimensions for solar meter cubicle placement (L x W of wall).	length: 1300, width: 1200	-
21	Provide the dimension for earth pits location (L x W of available space).	length: 1000, width: 1000	-
22	Is LAN cable under customer scope?	**No**	-
23	Is there any shadow that affects the solar installation?	N/A	-
24	Is there any trench work to be done to carry the AC cable to the meter location?	N/A	-

PHOTO DOCUMENTATION

Cable Routing Legend

Legend	Description
■	Proposed PV Module Array
■	Main Meter Location
■	Solar Meter
■	Battery
■	Inverter
■	Other Equipment
—	DC Cable
—	AC Cable
—	Material Shifting
—	DC Earthing Cable
—	AC Earthing Cable
—	LA Cable
■	DC Earth Pit
■	AC Earth Pit
■	LA Pit
●	LA

Material Delivery Route

This route (using lifting) will be followed to carry large items (like Panels).

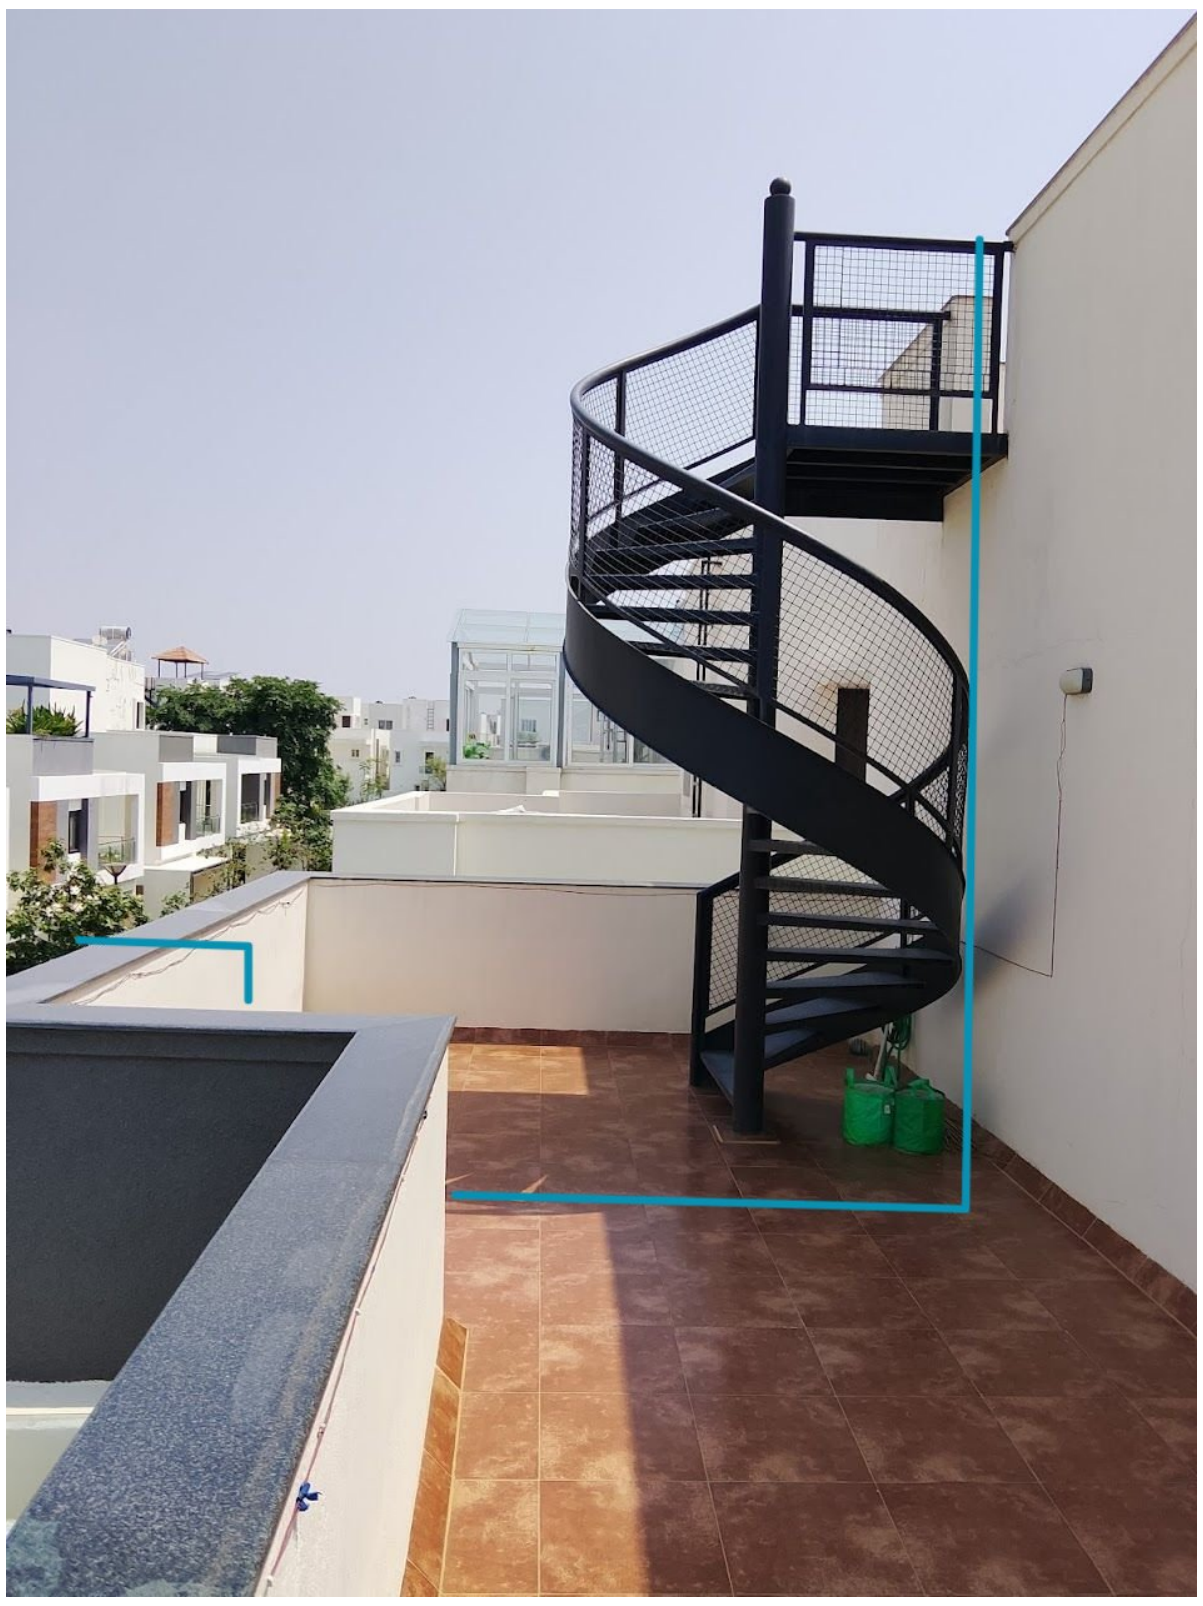

This route (using Staircase) will be followed to carry Small items

Staircase Details

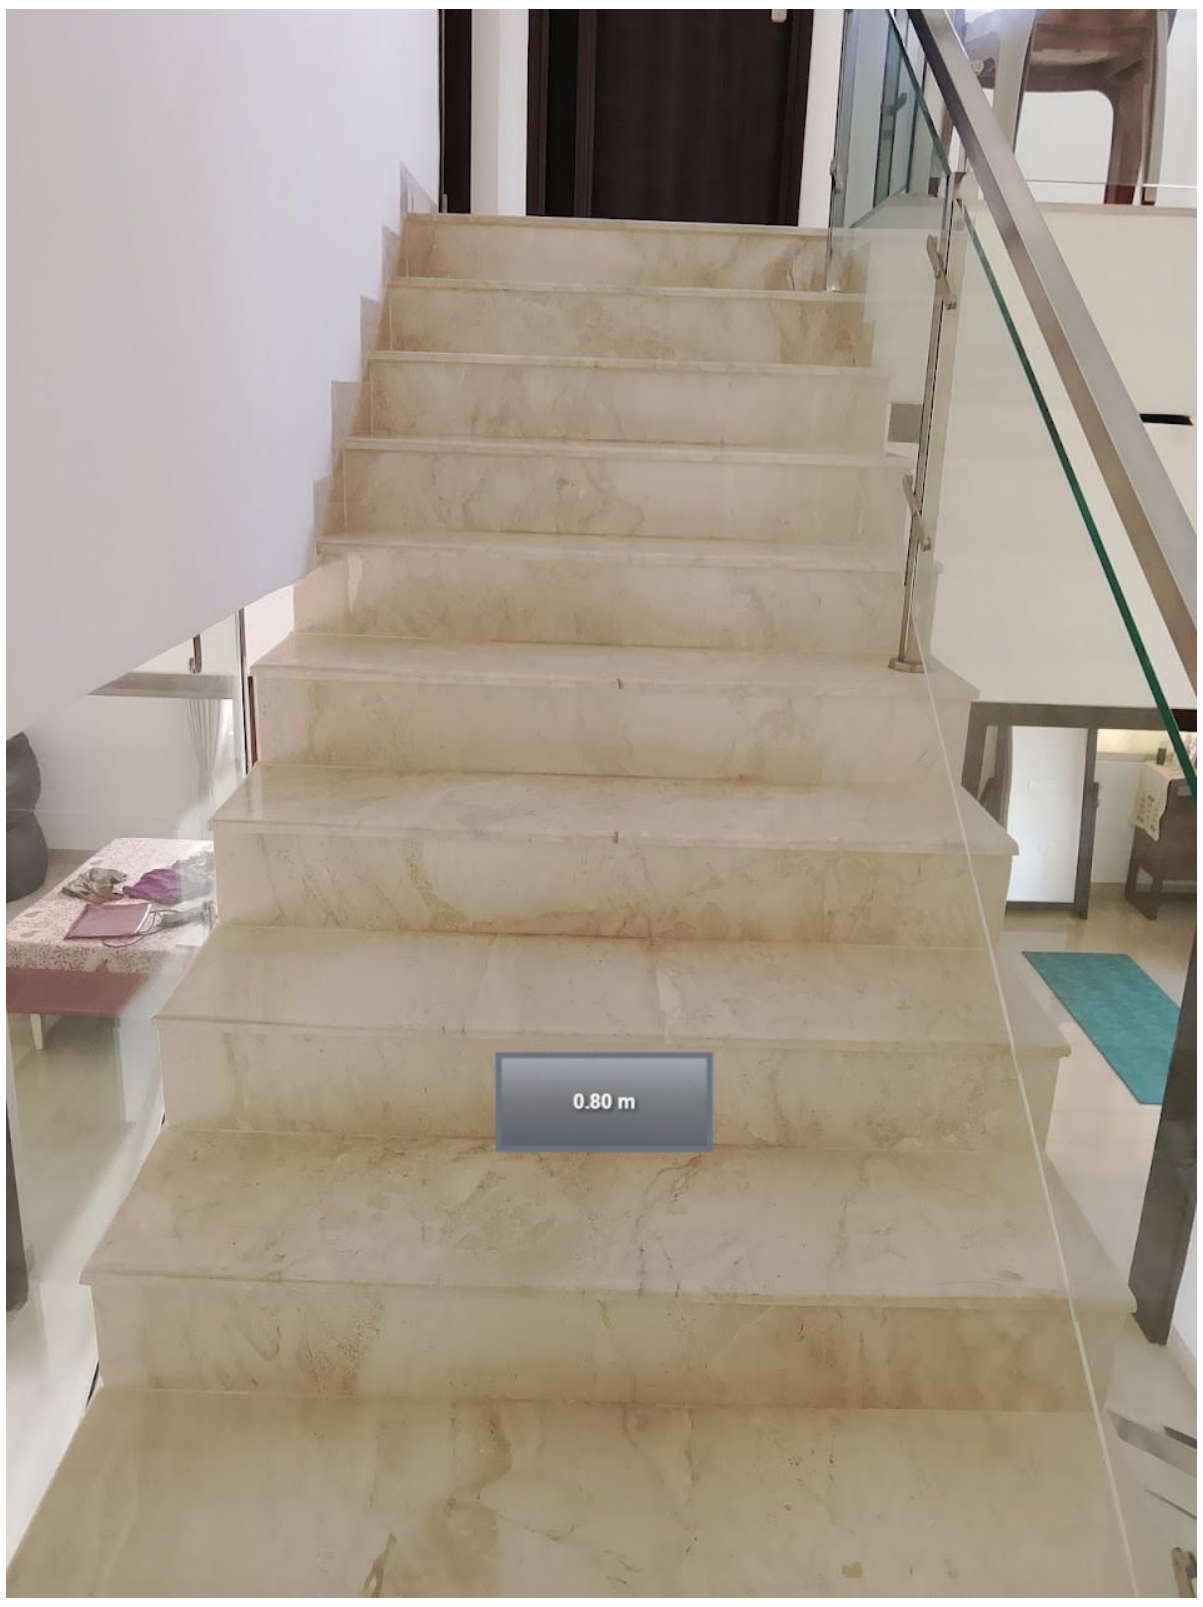

Meter Box

Material Storage

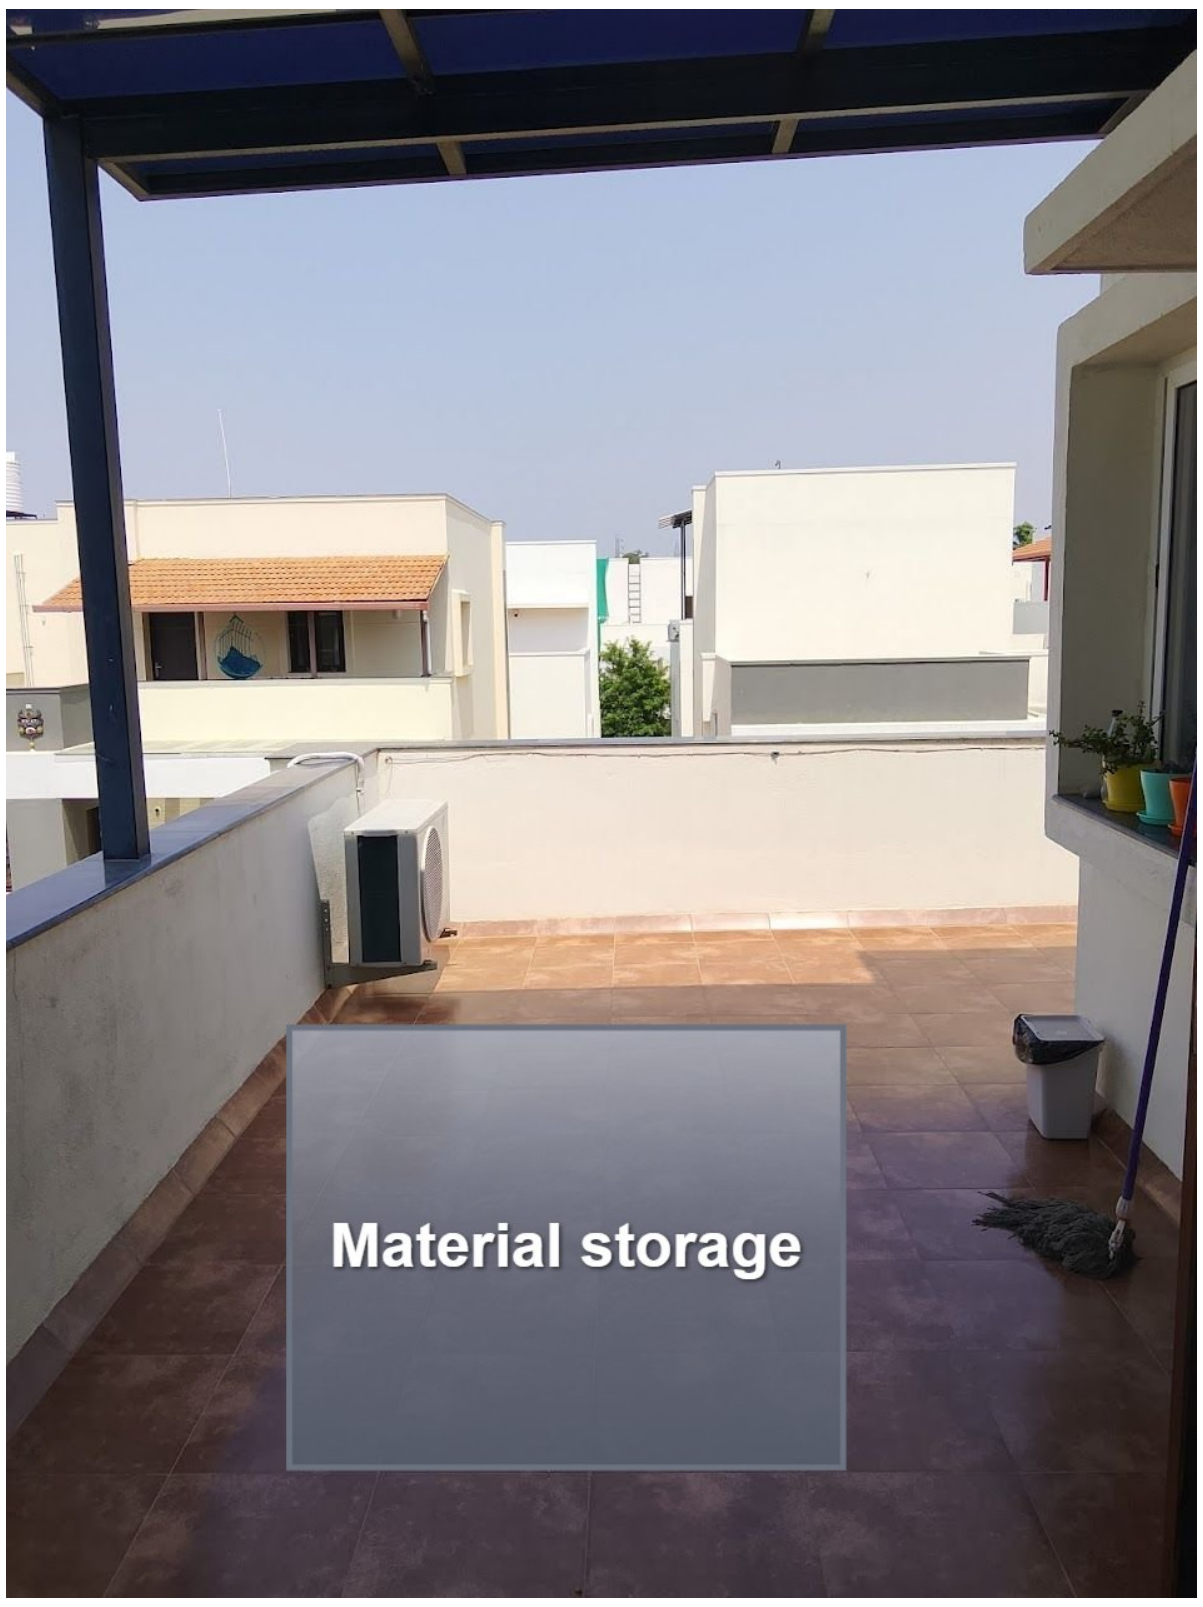

Proposed PV Area

Cable Routing

1 Inch conduit pipe

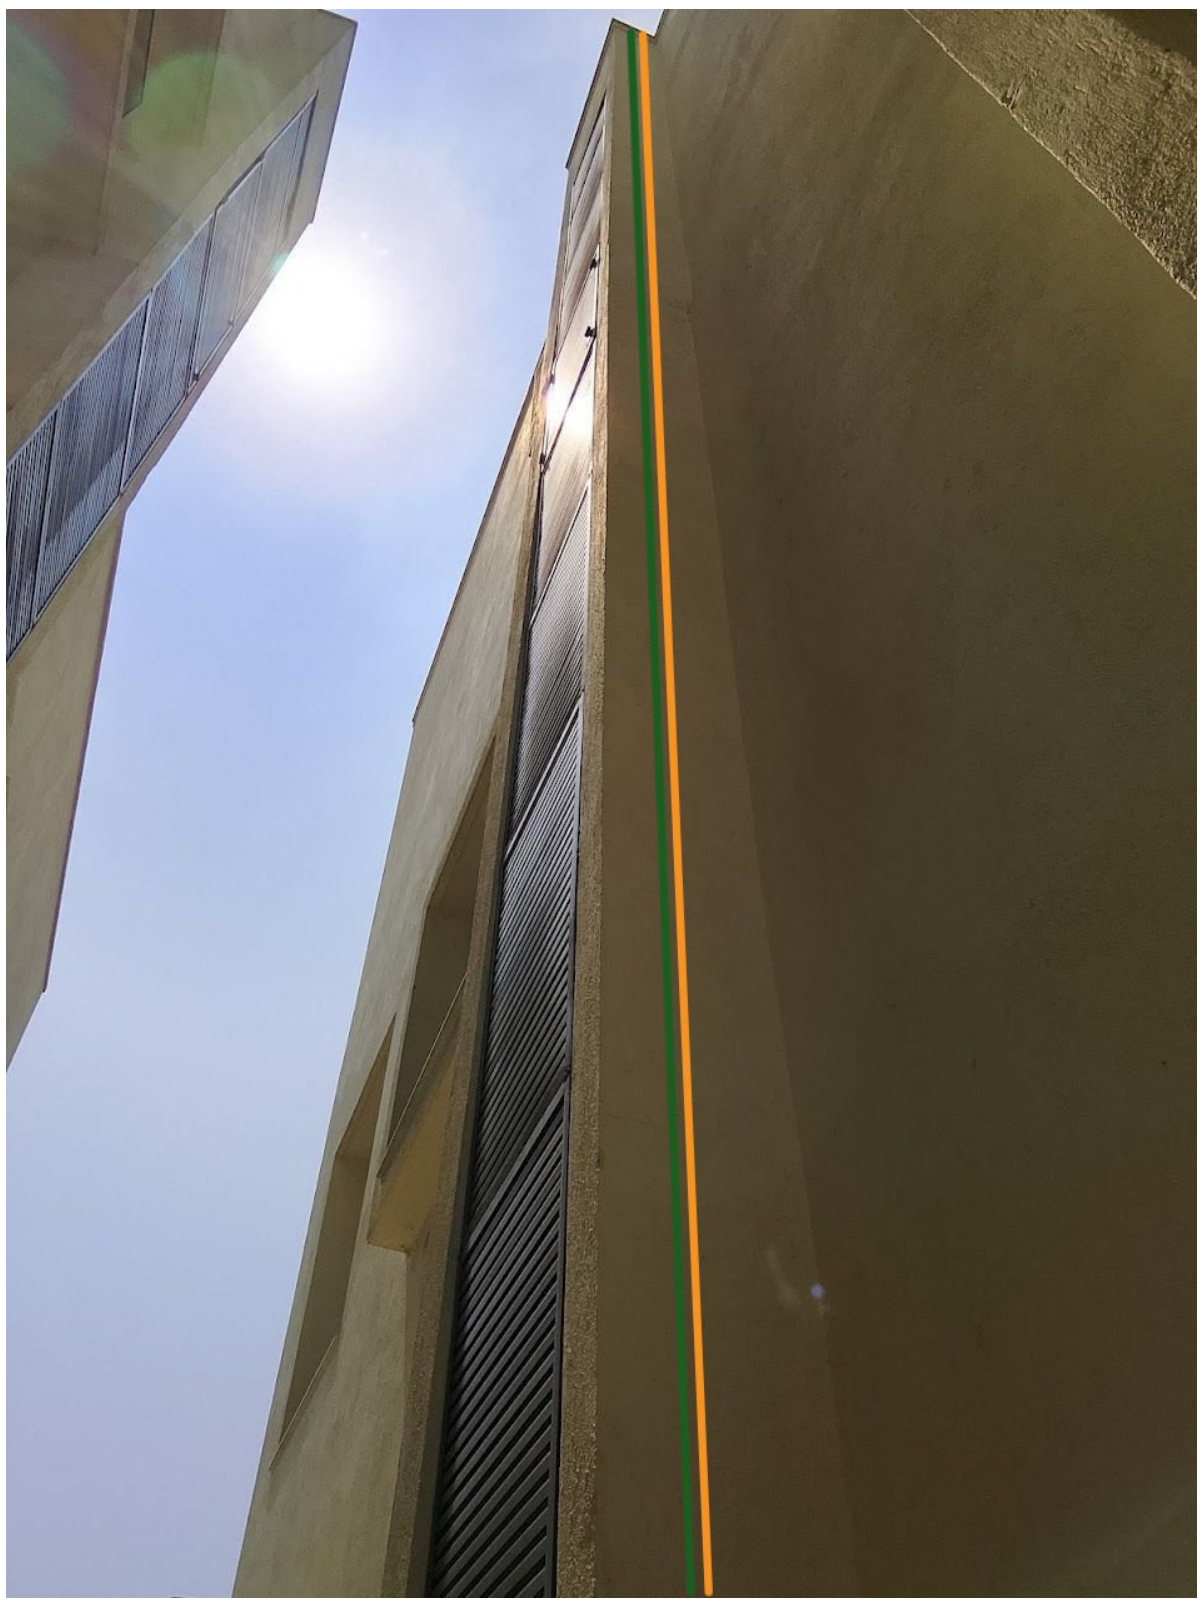

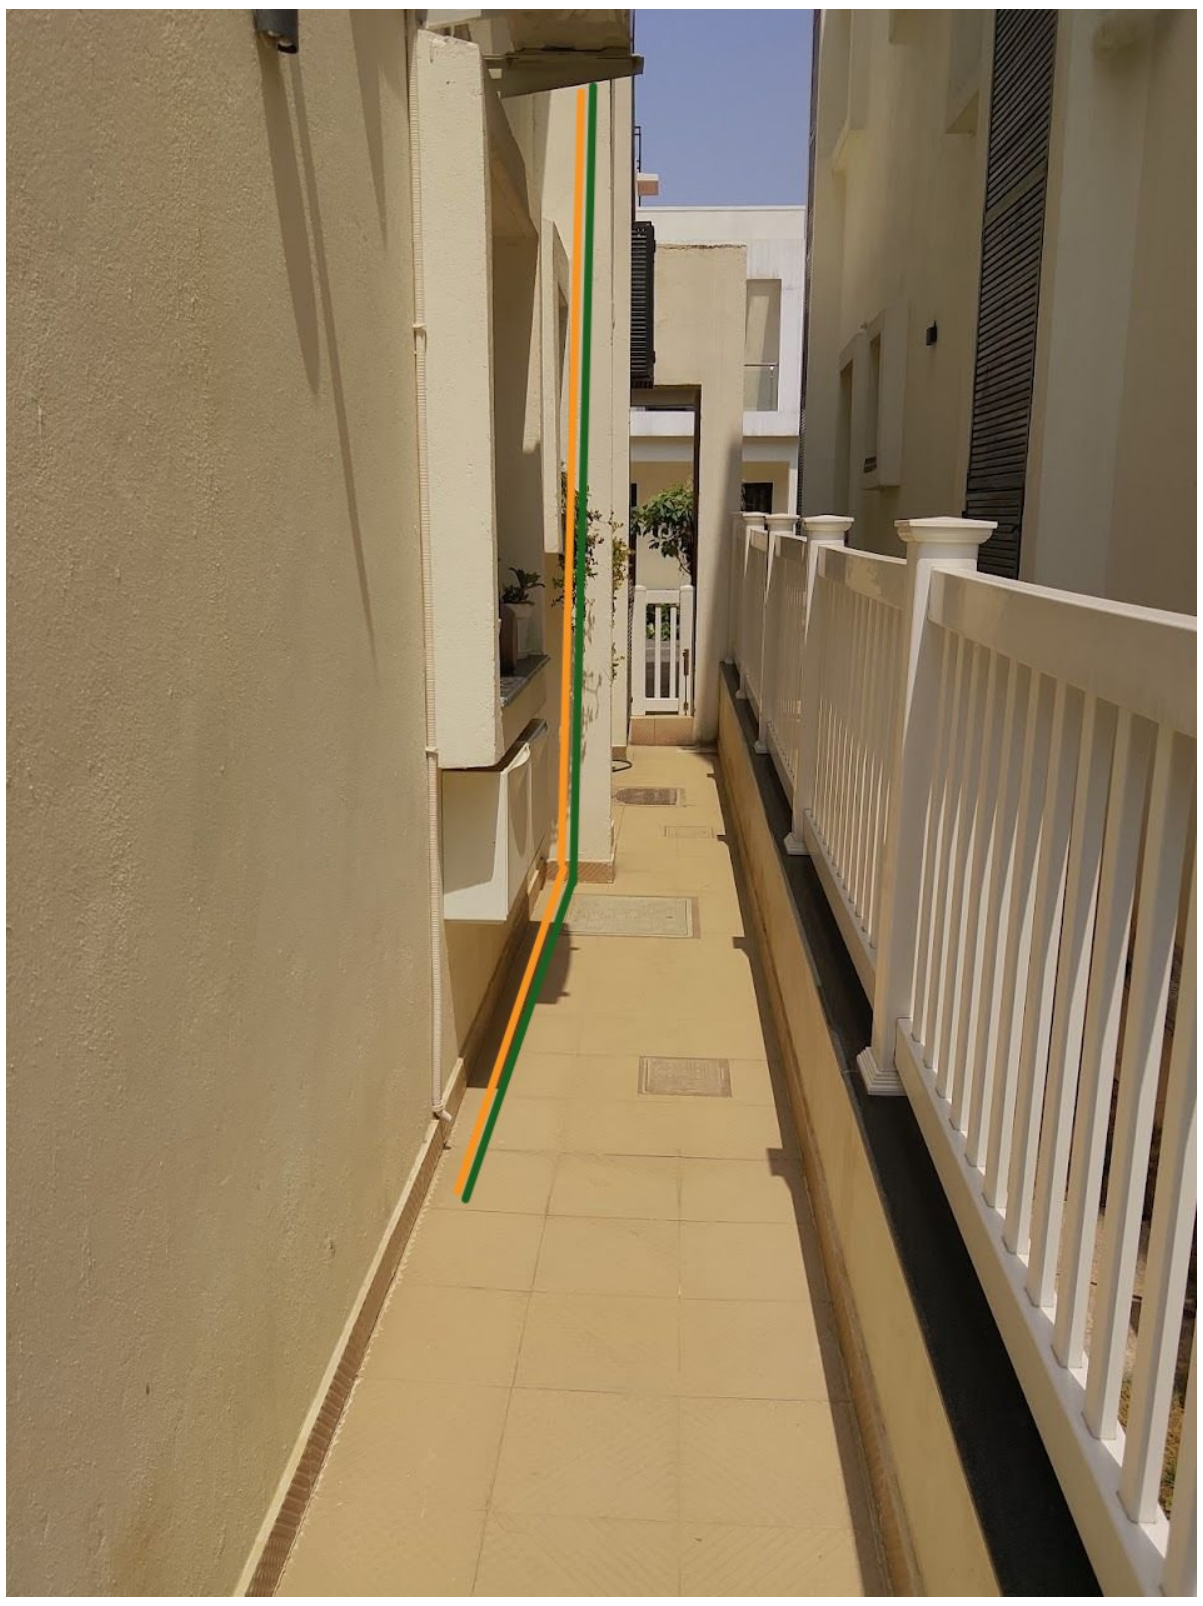

Equipment Location

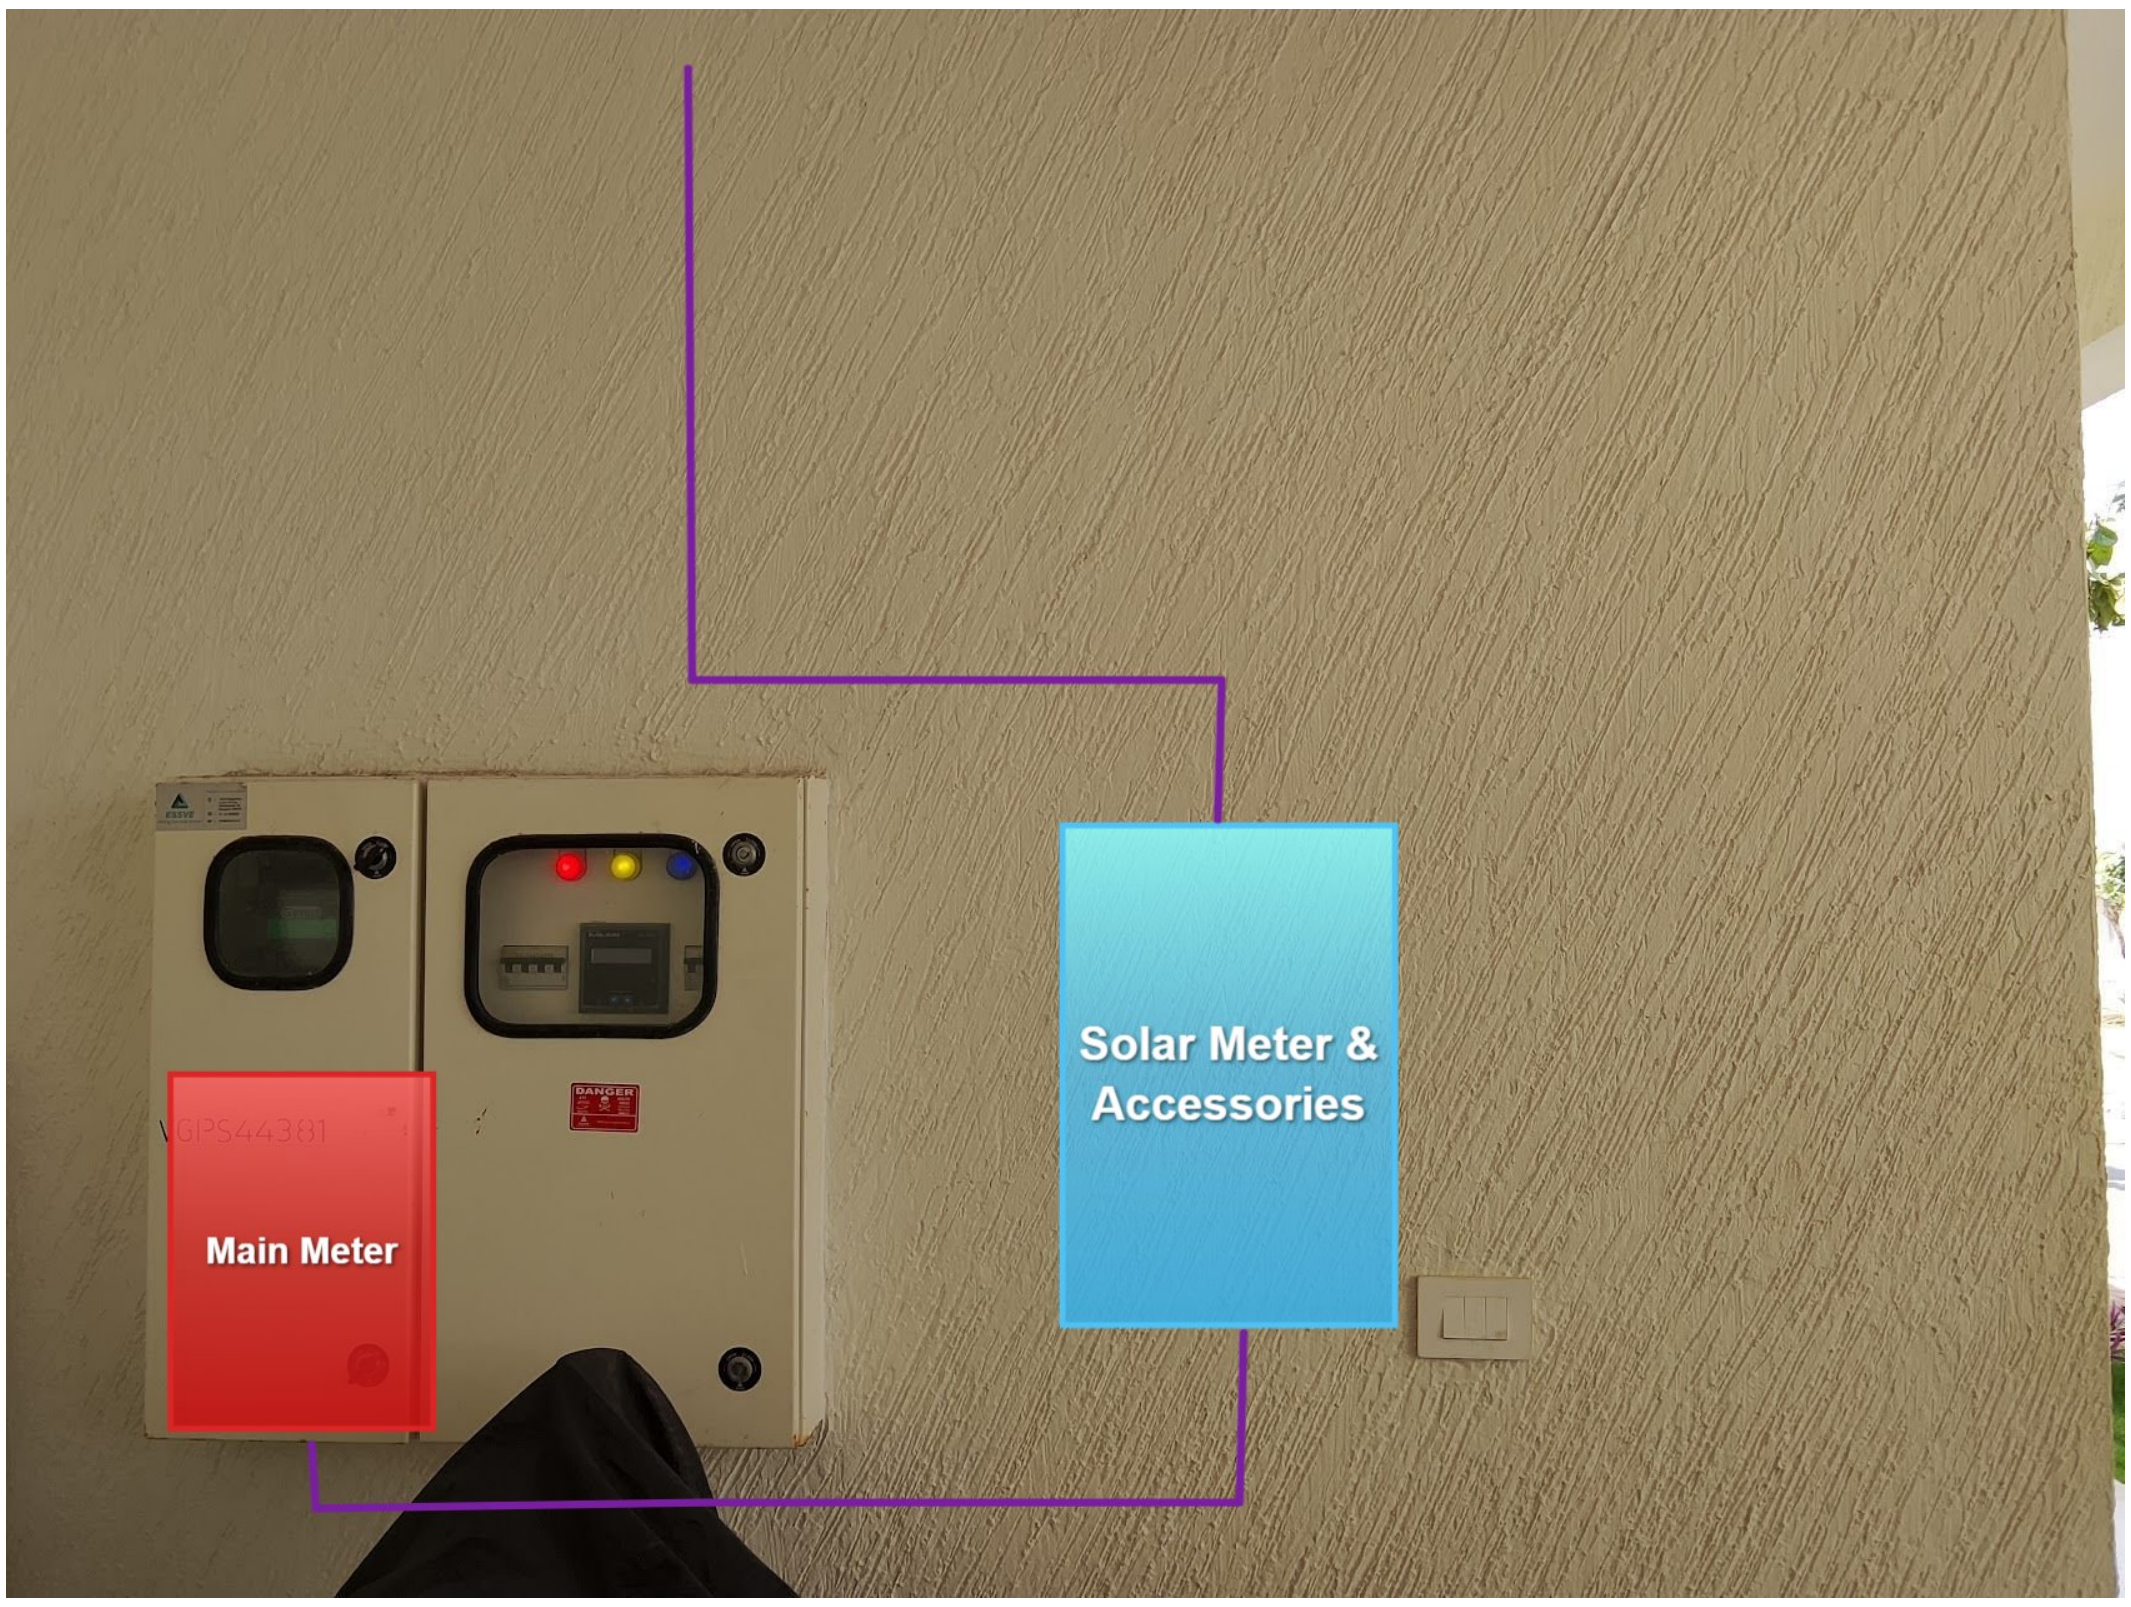

Earth Pit Location

Site Layout - Top View

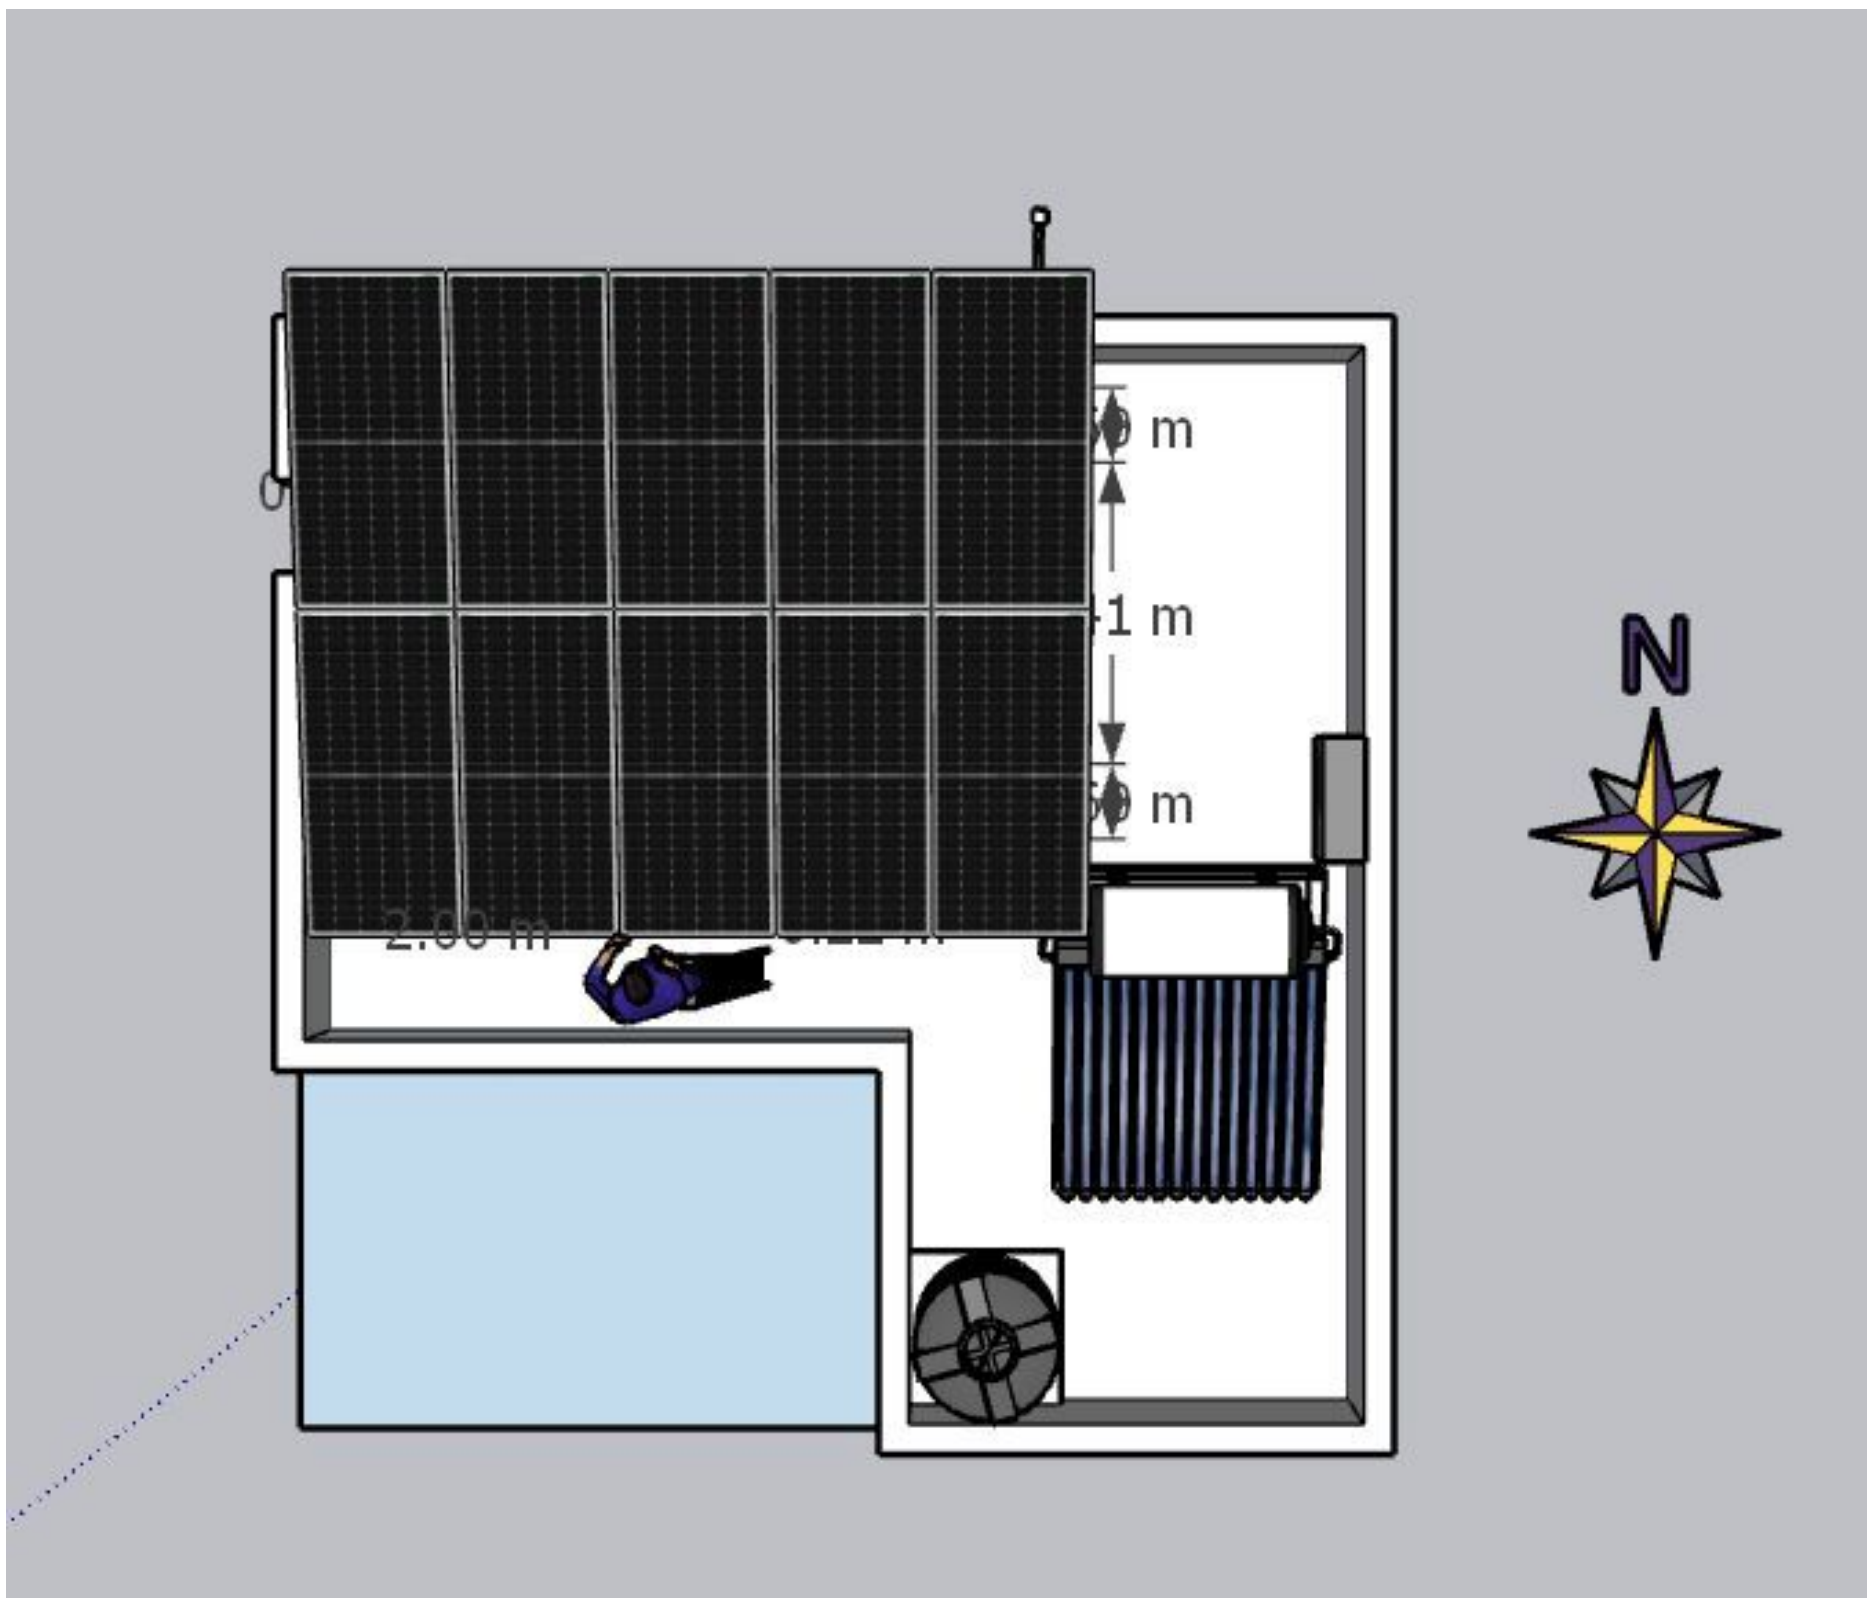

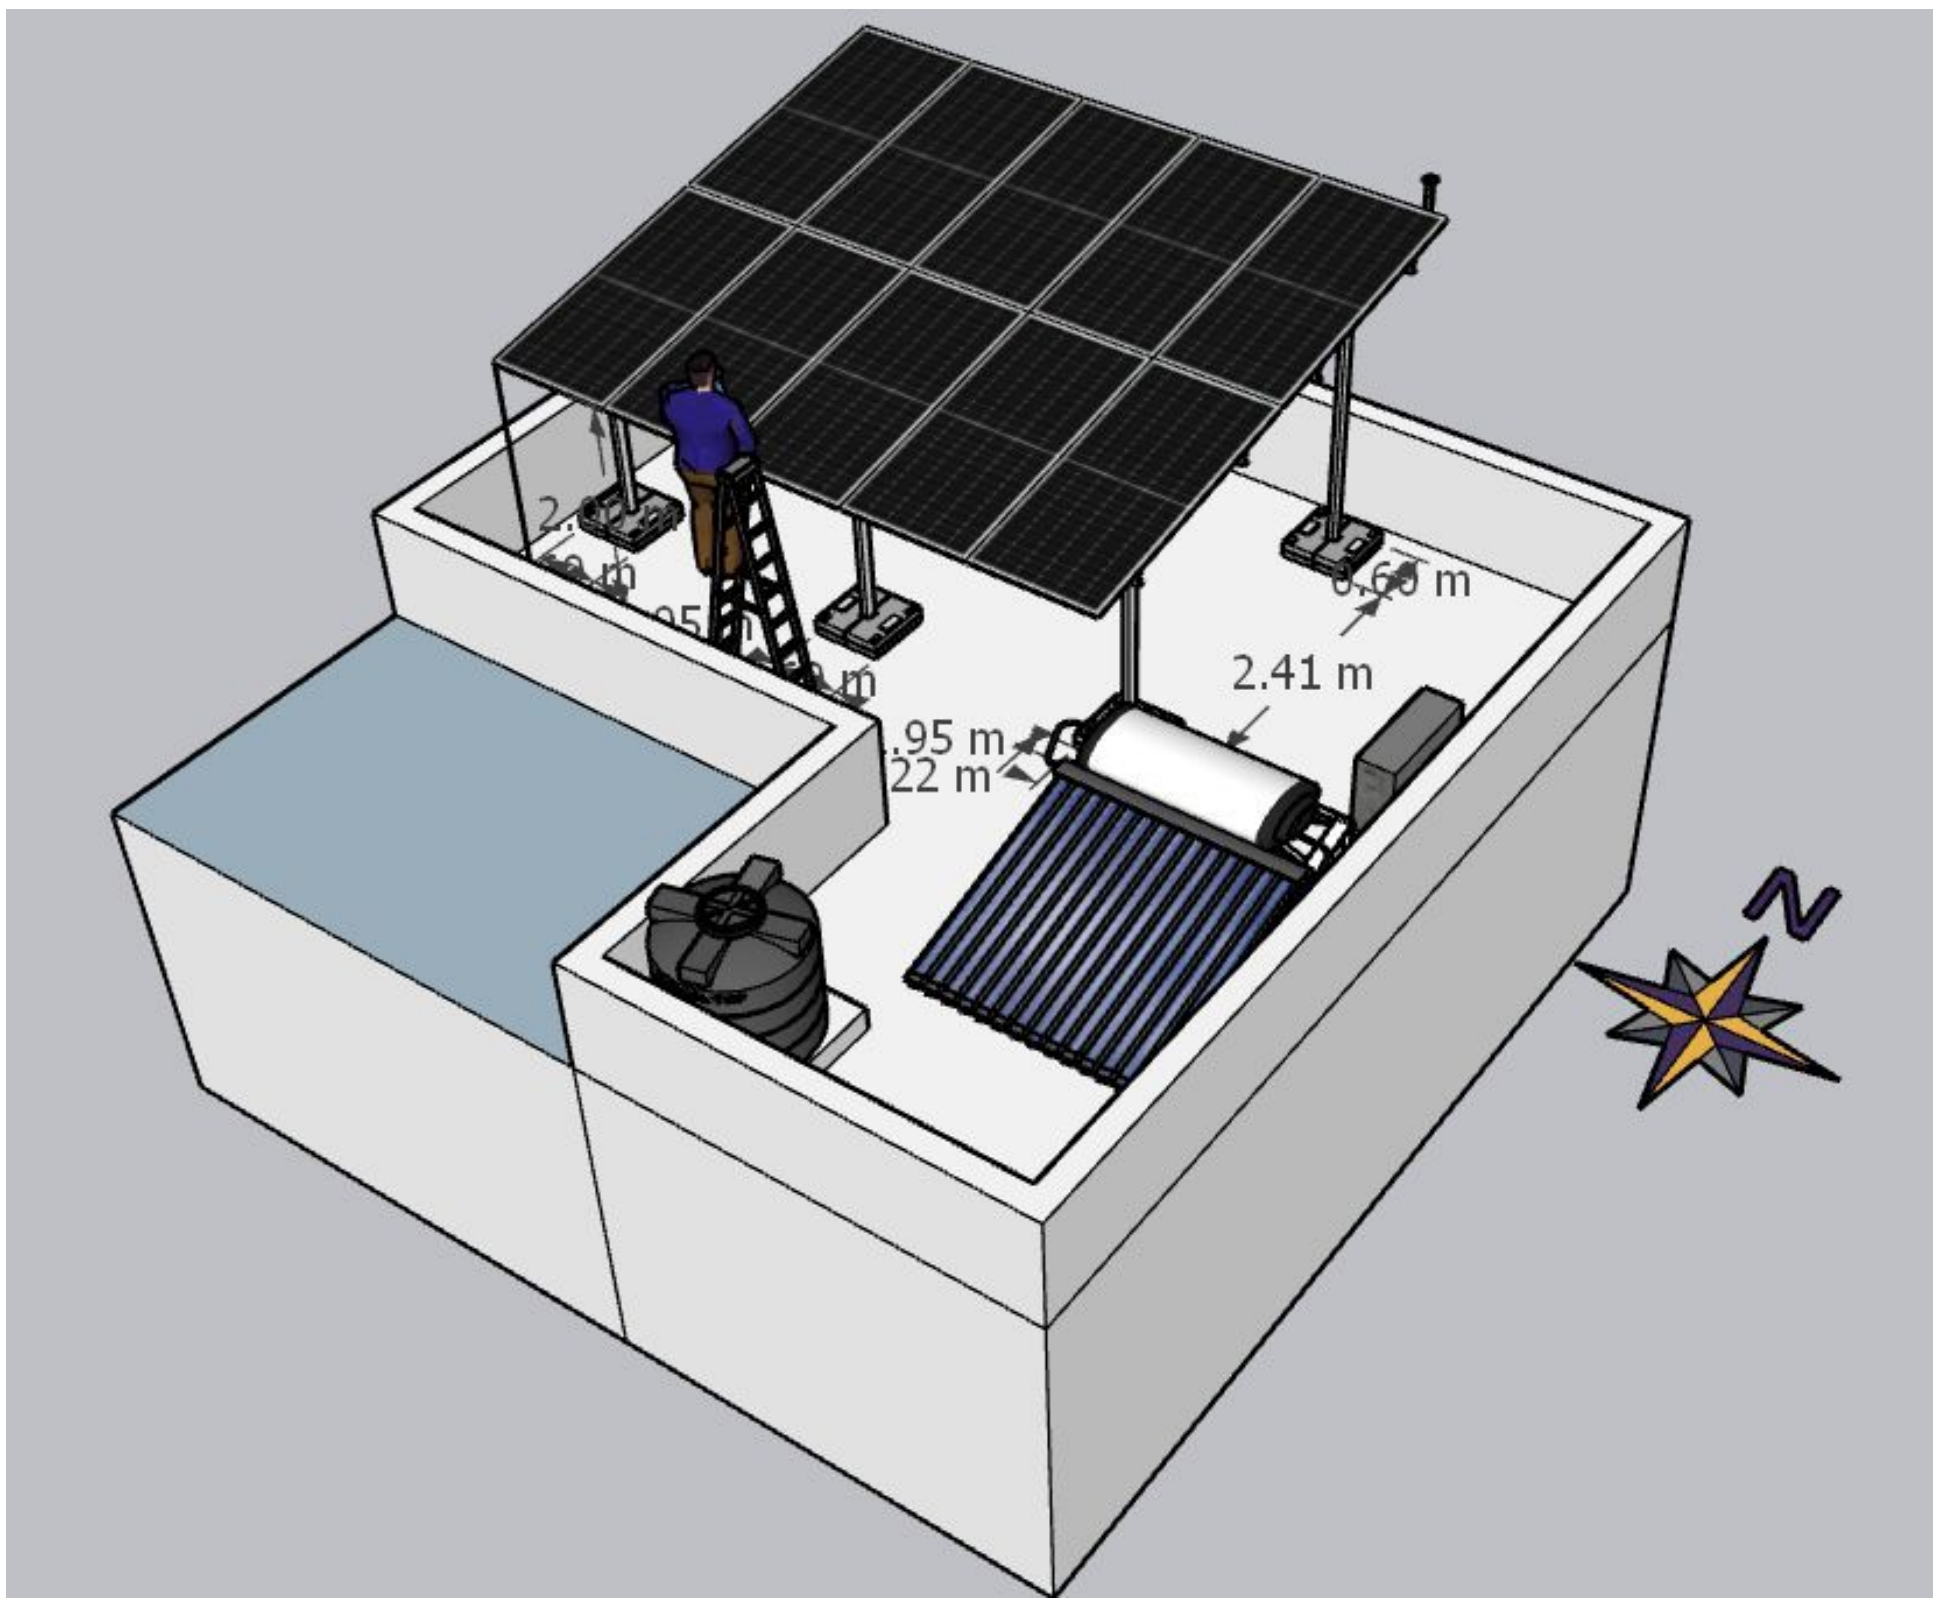

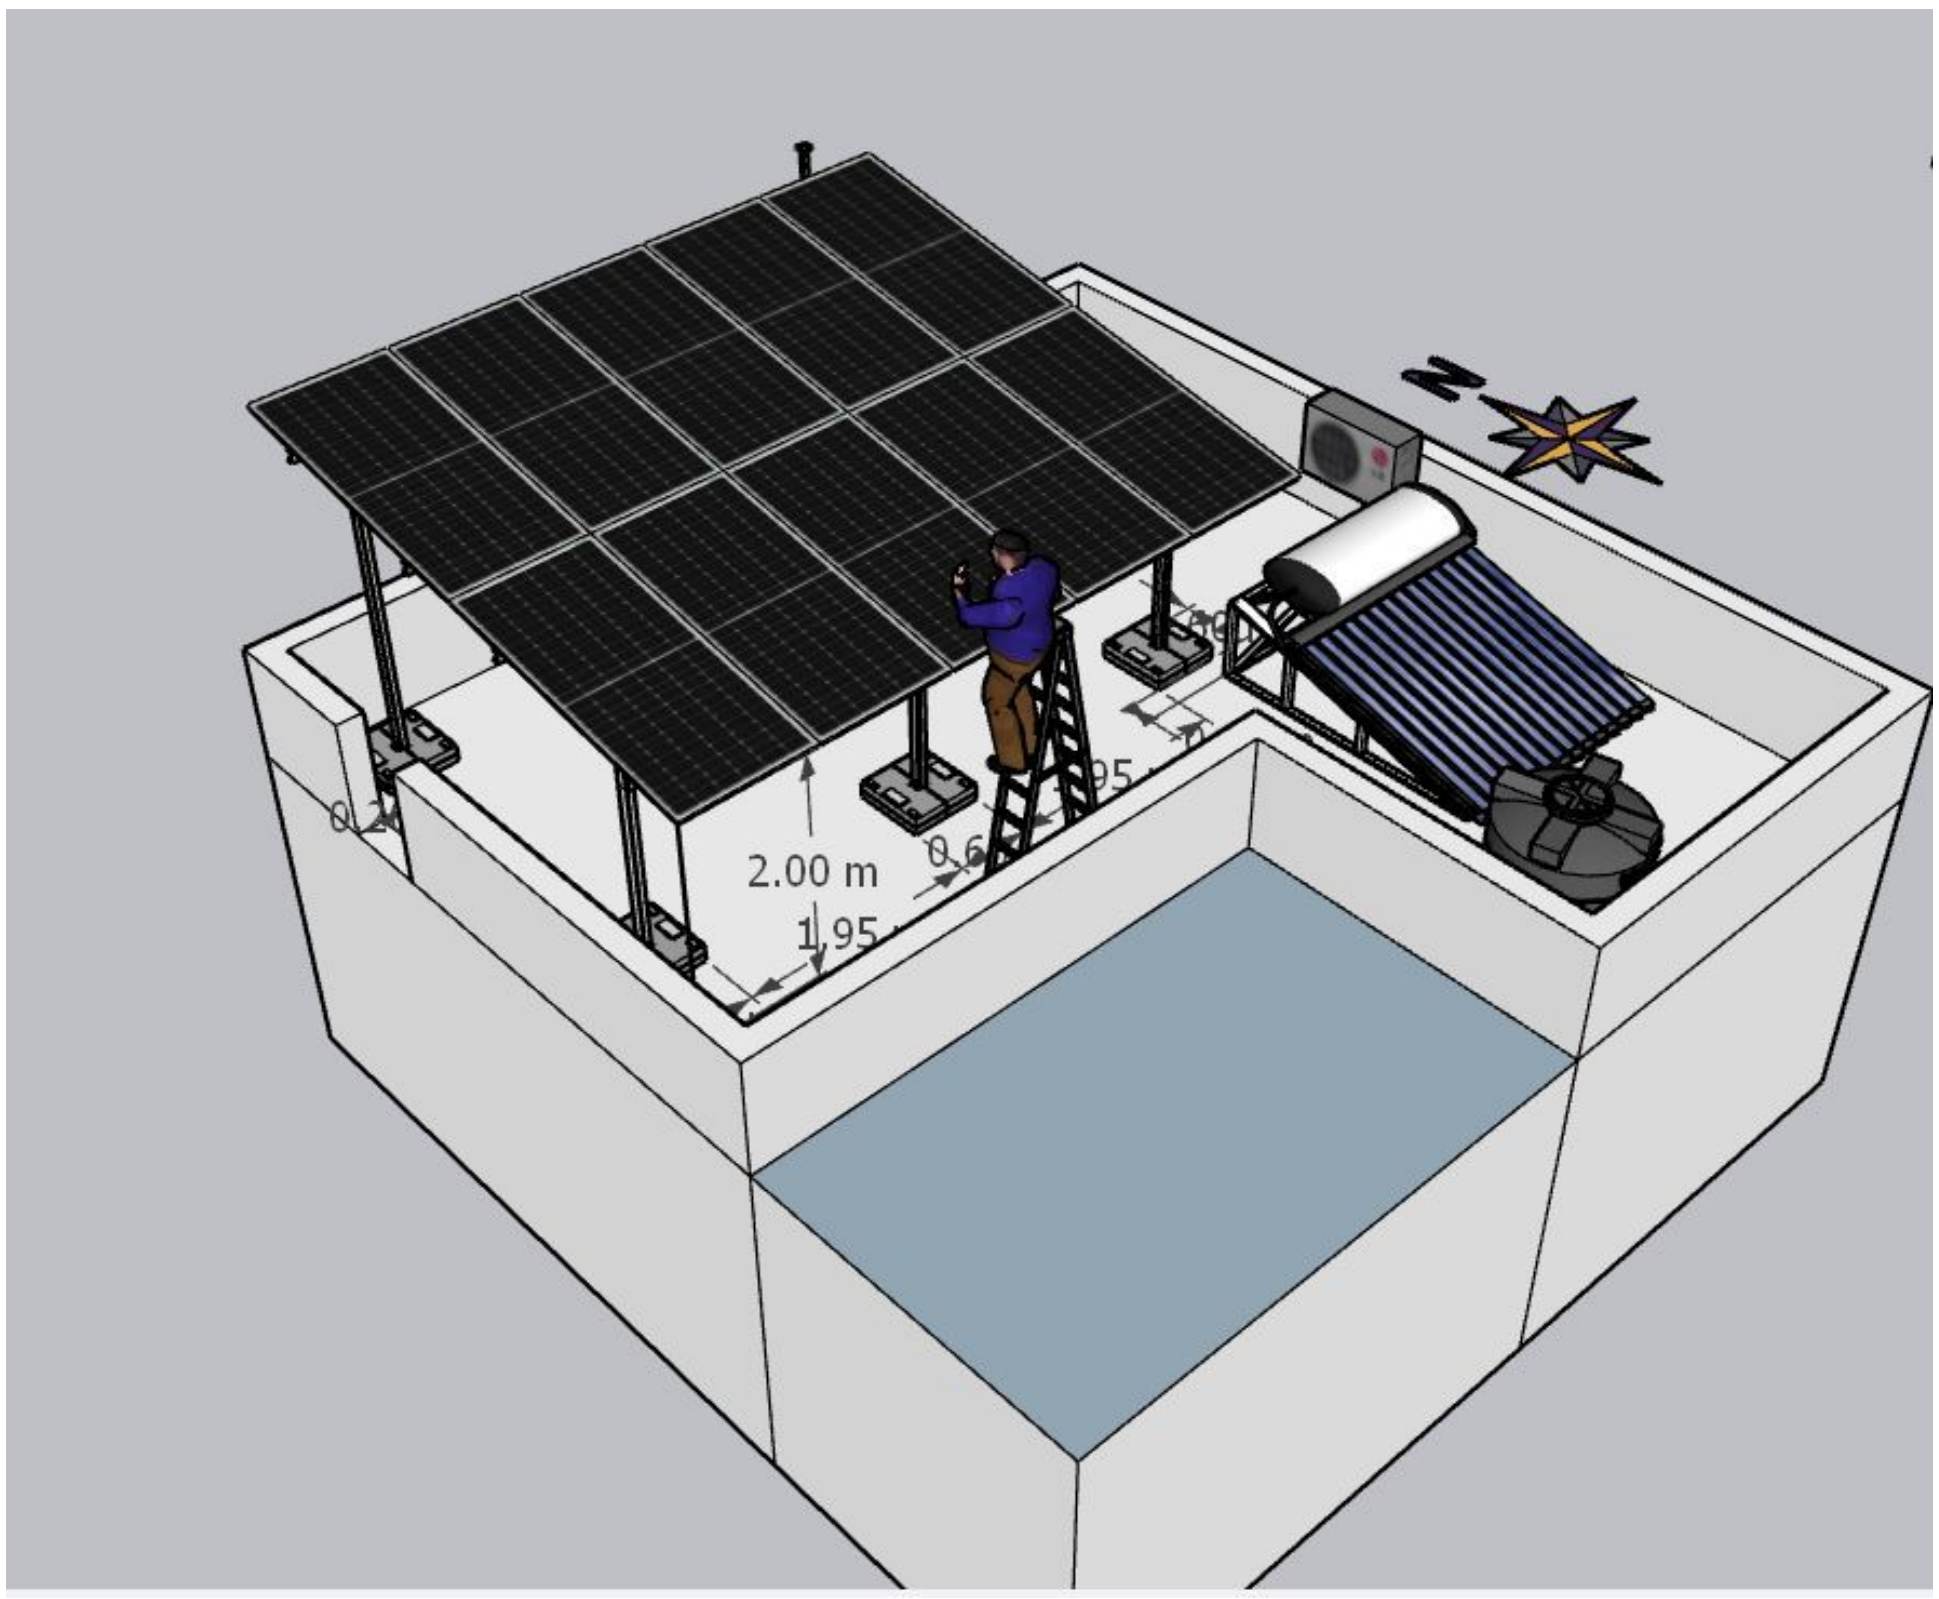

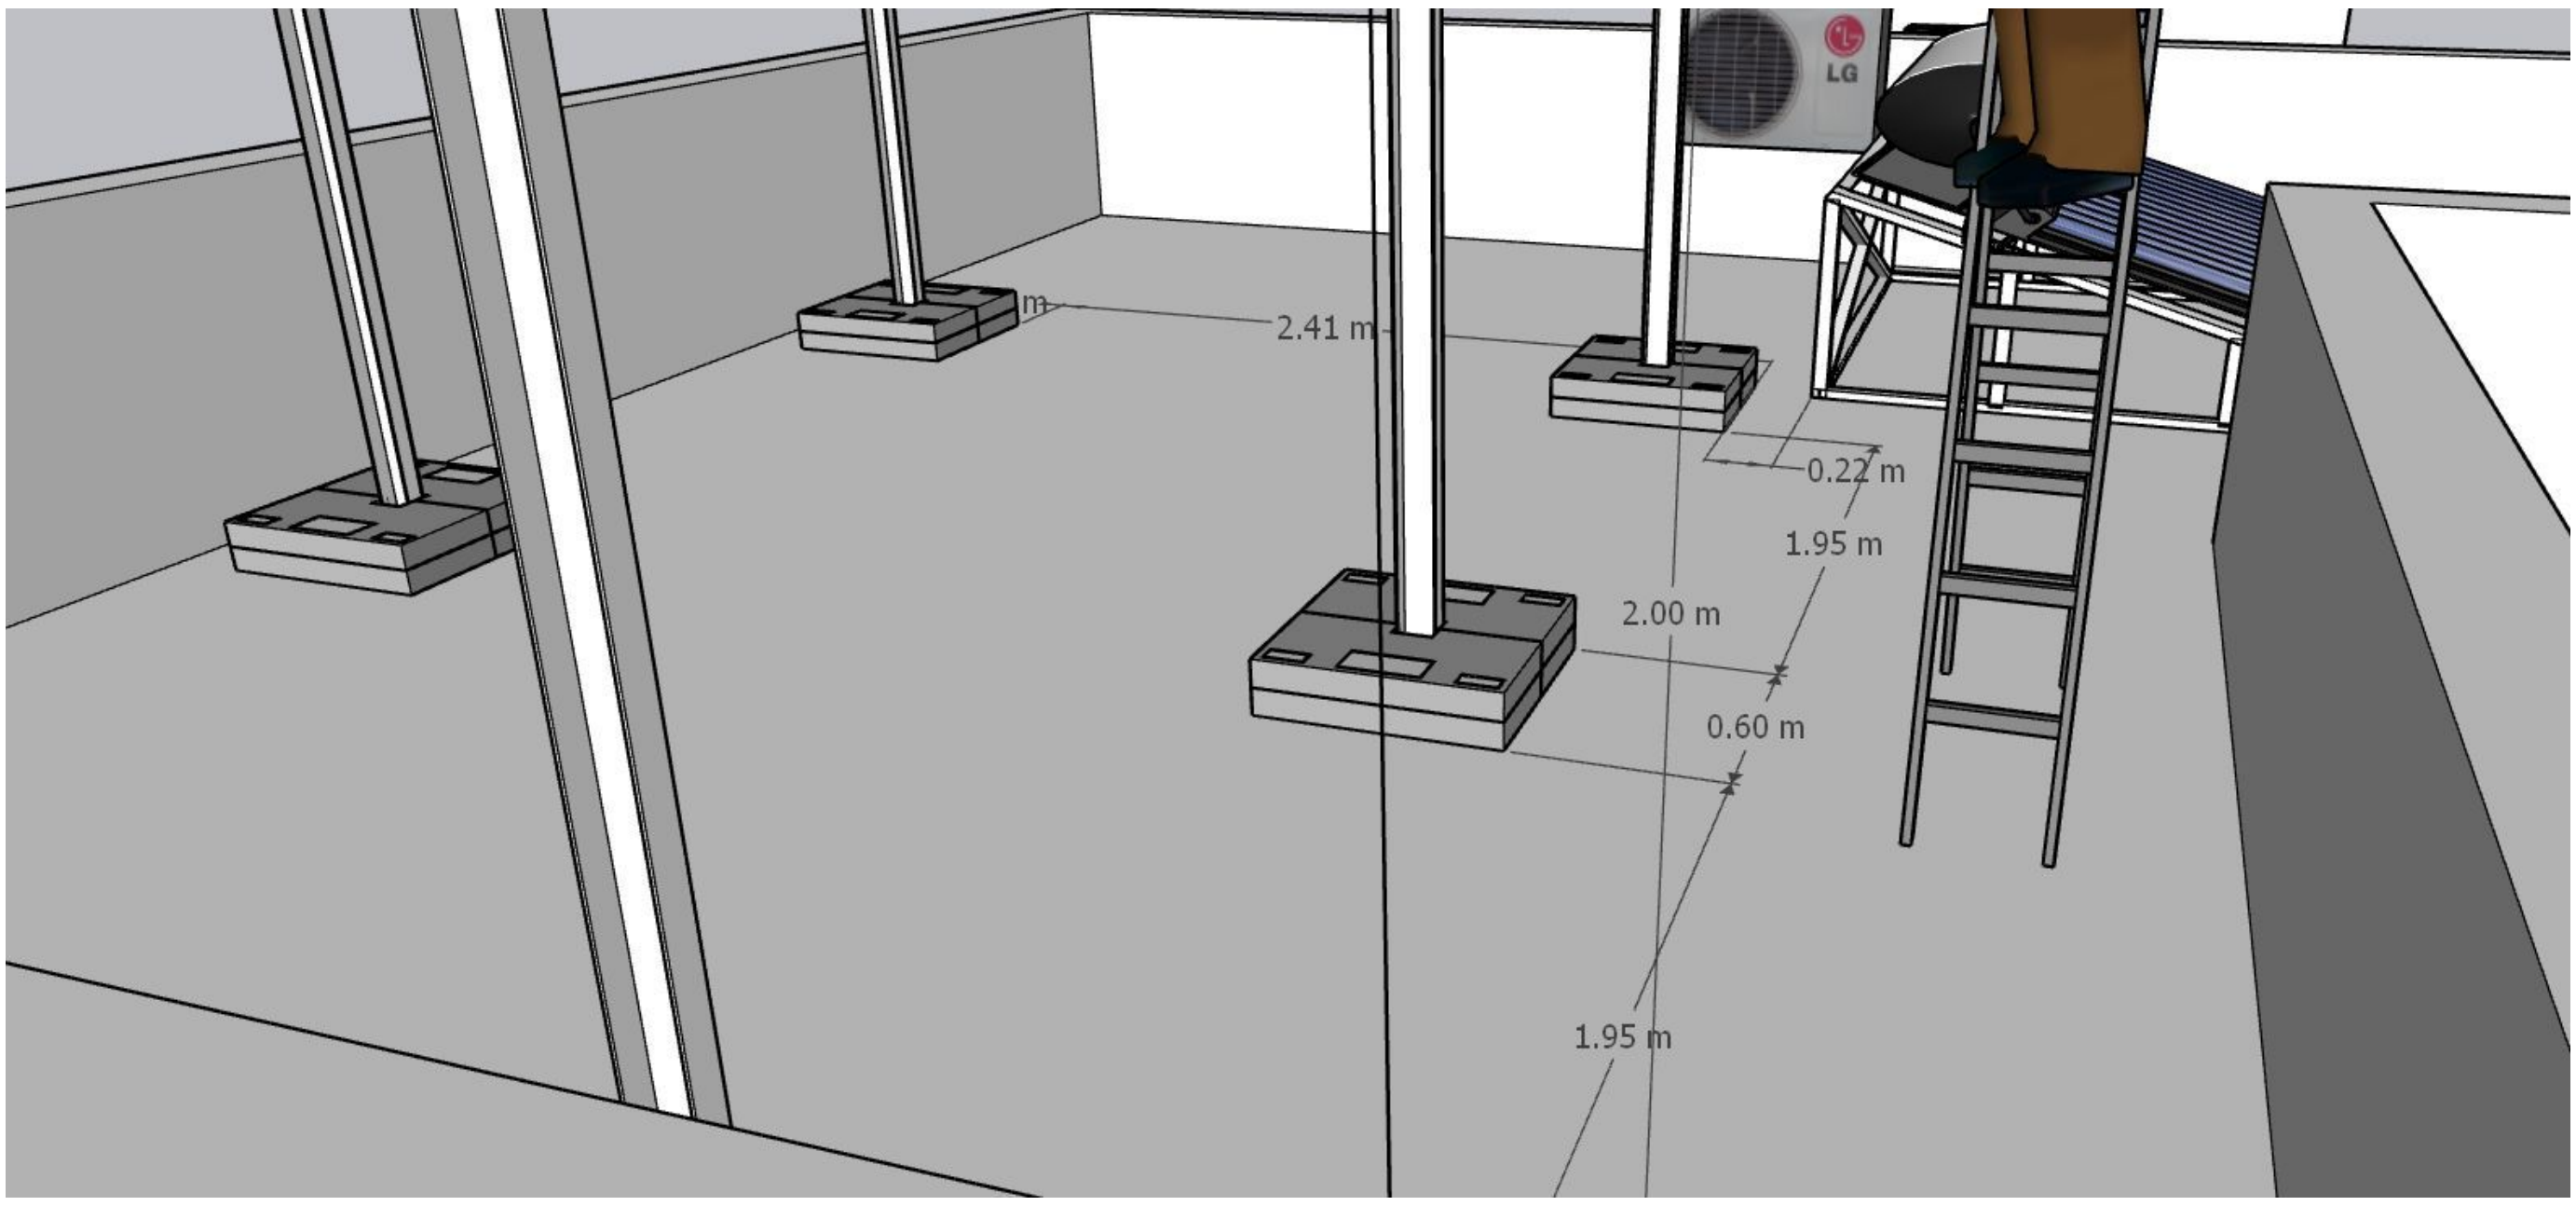

Building Exterior

OBSERVATIONS & RECOMMENDATIONS

Customer Scope

#	Observation
1	Wi-Fi up to the solar meter location is under customer scope.
2	As per the customer suggestions only the design layout and above cable routing and earthing location has been considered.
3	The AC cable has to be run in the existing conduit pipe till the meter location

THANK YOU

Dear Shaurya Sirohi,

Thank you for choosing EcoSoch Solar for your solar installation. We appreciate your trust in us and your commitment to sustainable energy. Our team is dedicated to ensuring a seamless installation experience and long-term performance of your solar system.

Should you have any questions or require further assistance, please do not hesitate to reach out to us.

Warm Regards,
Team EcoSoch

& Did You Know?

The Sun burns 600 million tonnes of hydrogen per second — and your panels get a share.

EcoSoch Solar Pvt. Ltd.

#940, Sha Arcade, 2nd Phase, NTI Layout, Kodigehalli, Bengaluru 560097

www.ecosoch.com | info@ecosoch.com