# Technical Site Visit Report

Prepared for: BISINEER PROJECT - MAHATHI SENTHIL_Ecocity by SPA Group_9.8kWp_Hybrid

## PROJECT INFORMATION

| | |
|---|---|
| Report Number | ESV-2026-0105 |
| Project ID | 3CF859FC |
| Project Name | BISINEER PROJECT - MAHATHI SENTHIL_Ecocity by SPA Group_9.8kWp_Hybrid |
| Project Sector | Residential |
| Project Type | Without Subsidy |
| Sales Lead | John D |
| Site Address | NO. 6, 29/1-B, GROUND FLOOR KONANKUNTE INDUSTRIAL AREA AMRUTHNAGAR MAIN ROAD HARINAGAR CROSS, BANGALORE - 560062 |
| GPS Coordinates | 12.816386, 77.819732 |
| Google Maps | https://www.google.com/maps?q=12.816386,77.819732 |
| Visit Date | 2026-05-04 |
| Visited By | ABILASH N K |
| Revision | Rev 1 |

## CLIENT INFORMATION

| | |
|---|---|
| Client Name | BISINEER PROJECT - MAHATHI SENTHIL |
| Contact | 8867910252 |

## PROJECT DETAILS

| | |
|---|---|
| Solar Rooftop System Type | Hybrid |
| System Capacity (kWp) | 9.8 |
| Sanction Load (kW) | 14 |
| Module Make & Capacity | Waaree Non DCR Topcon, 700 Wp |
| Module Length (mm) | 2384 |

| | |
|---|---|
| **Module Width (mm)** | 1303 |
| **Number of Panels** | 14 |
| **Inverter Type** | Hybrid (String) |
| **Inverter Brand** | Deye: 8KW - 48V - LV - Three Phase |
| **Number of Inverters** | 1 |
| **Battery** | Needed |
| **Number of Batteries** | 4 |
| **Capacity of each Battery (kWh)** | 5.12 |
| **Battery Model No.** | Deye SE-F5plus |
| **Mounting Structure Type** | Elevated |

## SITE INSPECTION CHECKLIST

### General

| # | Question | Answer | Notes |
|---|---|---|---|
| 1 | Can the delivery van/truck reach the material unloading point? | Yes | - |
| 2 | Are there any obstacles at the site that could hinder material lifting? | **No** | - |
| 3 | Where will the Inverter, DCDB, ACDB, Battery, etc. be located? | In the second floor, the inverter and other accessories can be fixed on the wall, just below the headroom. | - |
| 4 | Is a canopy required for protecting the Inverters/ACDB/DCDB? | **No** | - |
| 5 | Did you discuss the location of the earth pits with the customer? | In discussion. | - |
| 6 | Where is the Internet Router located? | Building is under construction | - |
| 7 | What's the Wi-Fi strength of the router near to the String inverter/Envoy? | Not Available / Under Construction | - |
| 8 | Did you pin the site location in your WhatsApp when you were at the site? | Yes | - |

### Roof Details

| # | Question | Answer | Notes |
|---|---|---|---|
| 1 | What type of roof is present at the site? | RCC Flat Roof | - |
| 2 | Are there any obstructions on the roof that could affect the solar installation? | details: Lift head room, a skylight, a water tank | - |

| # | Question | Answer | Notes |
|---|---|---|---|
| | | tower, etc. are present on the roof. | |
| 3 | What is the angle of the panels? (in degrees) | 10 | - |
| 4 | In case of sloped roof, what is the slope angle of the roof? (in degrees) | N/A | - |
| 5 | On how many roofs at the site are we installing solar? | 1 | - |
| 6 | If it is a Tiled roof, what is underneath the tiles? | N/A | - |
| 7 | If it is a Tiled roof with MS or Wooden rafters, is it Single-tiled or Double-tiled? | N/A | - |
| 8 | What type of mounting structure is planned? | Elevated | *HDGI elevated structure with 2M front height.* |
| 9 | What is the orientation of the solar panels? | ["South"] | - |
| 10 | How can the roof be accessed? | Staircase | - |
| 11 | Is the building currently under construction? | Yes | - |
| 12 | In an under-construction building, are existing conduit pipes available for AC, DC cables, and earthing? | **No** | *No electrical DBs, earth pits or cable routing existed at the site at the time of the site survey.* |
| 13 | What is the height of the building and how many floors does it have? | 15 metres (G + 2 + head room) | - |
| 14 | Is the site photo matching with the building description? | Yes | - |
| 15 | Is there an overhead HT line passing within a 10-meter radius of the site? | **No** | - |

## Residential / Electrical

| # | Question | Answer | Notes |
|---|---|---|---|
| 1 | What type of energy meter is currently installed? | No Meter | *A temporary construction-purpose meter is available at the site.* |
| 2 | Is the Meter cubicle photo matching with the previous answer? | N/A | - |
| 3 | Has the termination point in the Main meter panel been identified? | N/A | - |
| 4 | Is the Termination Point easily visible or sealed? | N/A | - |
| 5 | Is a Lightning Arrestor (LA) already available at the site? | **No** | - |
| 6 | Is space available for CT within Energy meter panel? | N/A | - |
| 7 | In case of an Enphase system, is the distance between the farthest micro-inverter and IQ Gateway > 50m? | N/A | - |
| 8 | Provide details of the existing CT ratings (if applicable). | N/A | - |
| 9 | In Main meter panel, is empty space available for solar meter? | N/A | - |
| 10 | In Main meter panel, is empty space available to house the Enphase accessories or ACDB components? | N/A | - |
| 11 | Is there space available to dig DC, AC and LA earth pits? | **No** | *In discussion. For now, we have planned the earthing location near the existing meter location.* |
| 12 | In case of elevated structures, is an LA extension provided at the far end? | Yes | - |

| # | Question | Answer | Notes |
|---|---|---|---|
| 13 | In case of elevated structures, is it with or without grouting? | Without Grouting | *Customer prefer without grouting.* |
| 14 | Are there any challenges with respect to Installation and Maintenance activities? | **No** | - |
| 15 | Are there any safety risks associated with accessing the roof for installation? | **No** | - |
| 16 | Is space present in rooftop to store the panels? | Vertically leaning against the wall | - |
| 17 | In case of sloped roof MS structure, provide the dimension of rafter to rafter, purlin to purlin. | N/A | - |
| 18 | Is ventilation available in the battery location? | Yes | - |
| 19 | Should the Inverters/ACDB/DCDB be installed on a metal grill or wall mount? | Wall mounted. | - |
| 20 | Provide the dimensions for solar meter cubicle placement (L x W of wall). | length: 2000, width: 3000 | - |
| 21 | Provide the dimension for earth pits location (L x W of available space). | length: 3000, width: 3000 | *The area available near the existing EB meter is considered for digging the earth pits as of now.* |
| 22 | Is LAN cable under customer scope? | Yes | - |
| 23 | Is there any shadow that affects the solar installation? | **No** | - |
| 24 | Is there any trench work to be done to carry the AC cable to the meter location? | N/A | - |

## PHOTO DOCUMENTATION

### Cable Routing Legend

| Legend | Description |
|---|---|
| | Proposed PV Module Array |
| | Main Meter Location |
| | Solar Meter |
| | Battery |
| | Inverter |
| | Other Equipment |
| | DC Cable |
| | AC Cable |
| | Material Shifting |
| | DC Earthing Cable |
| | AC Earthing Cable |
| | LA Cable |
| | DC Earth Pit |
| | AC Earth Pit |
| | LA Pit |
| | LA |

## Site Layout - Top View

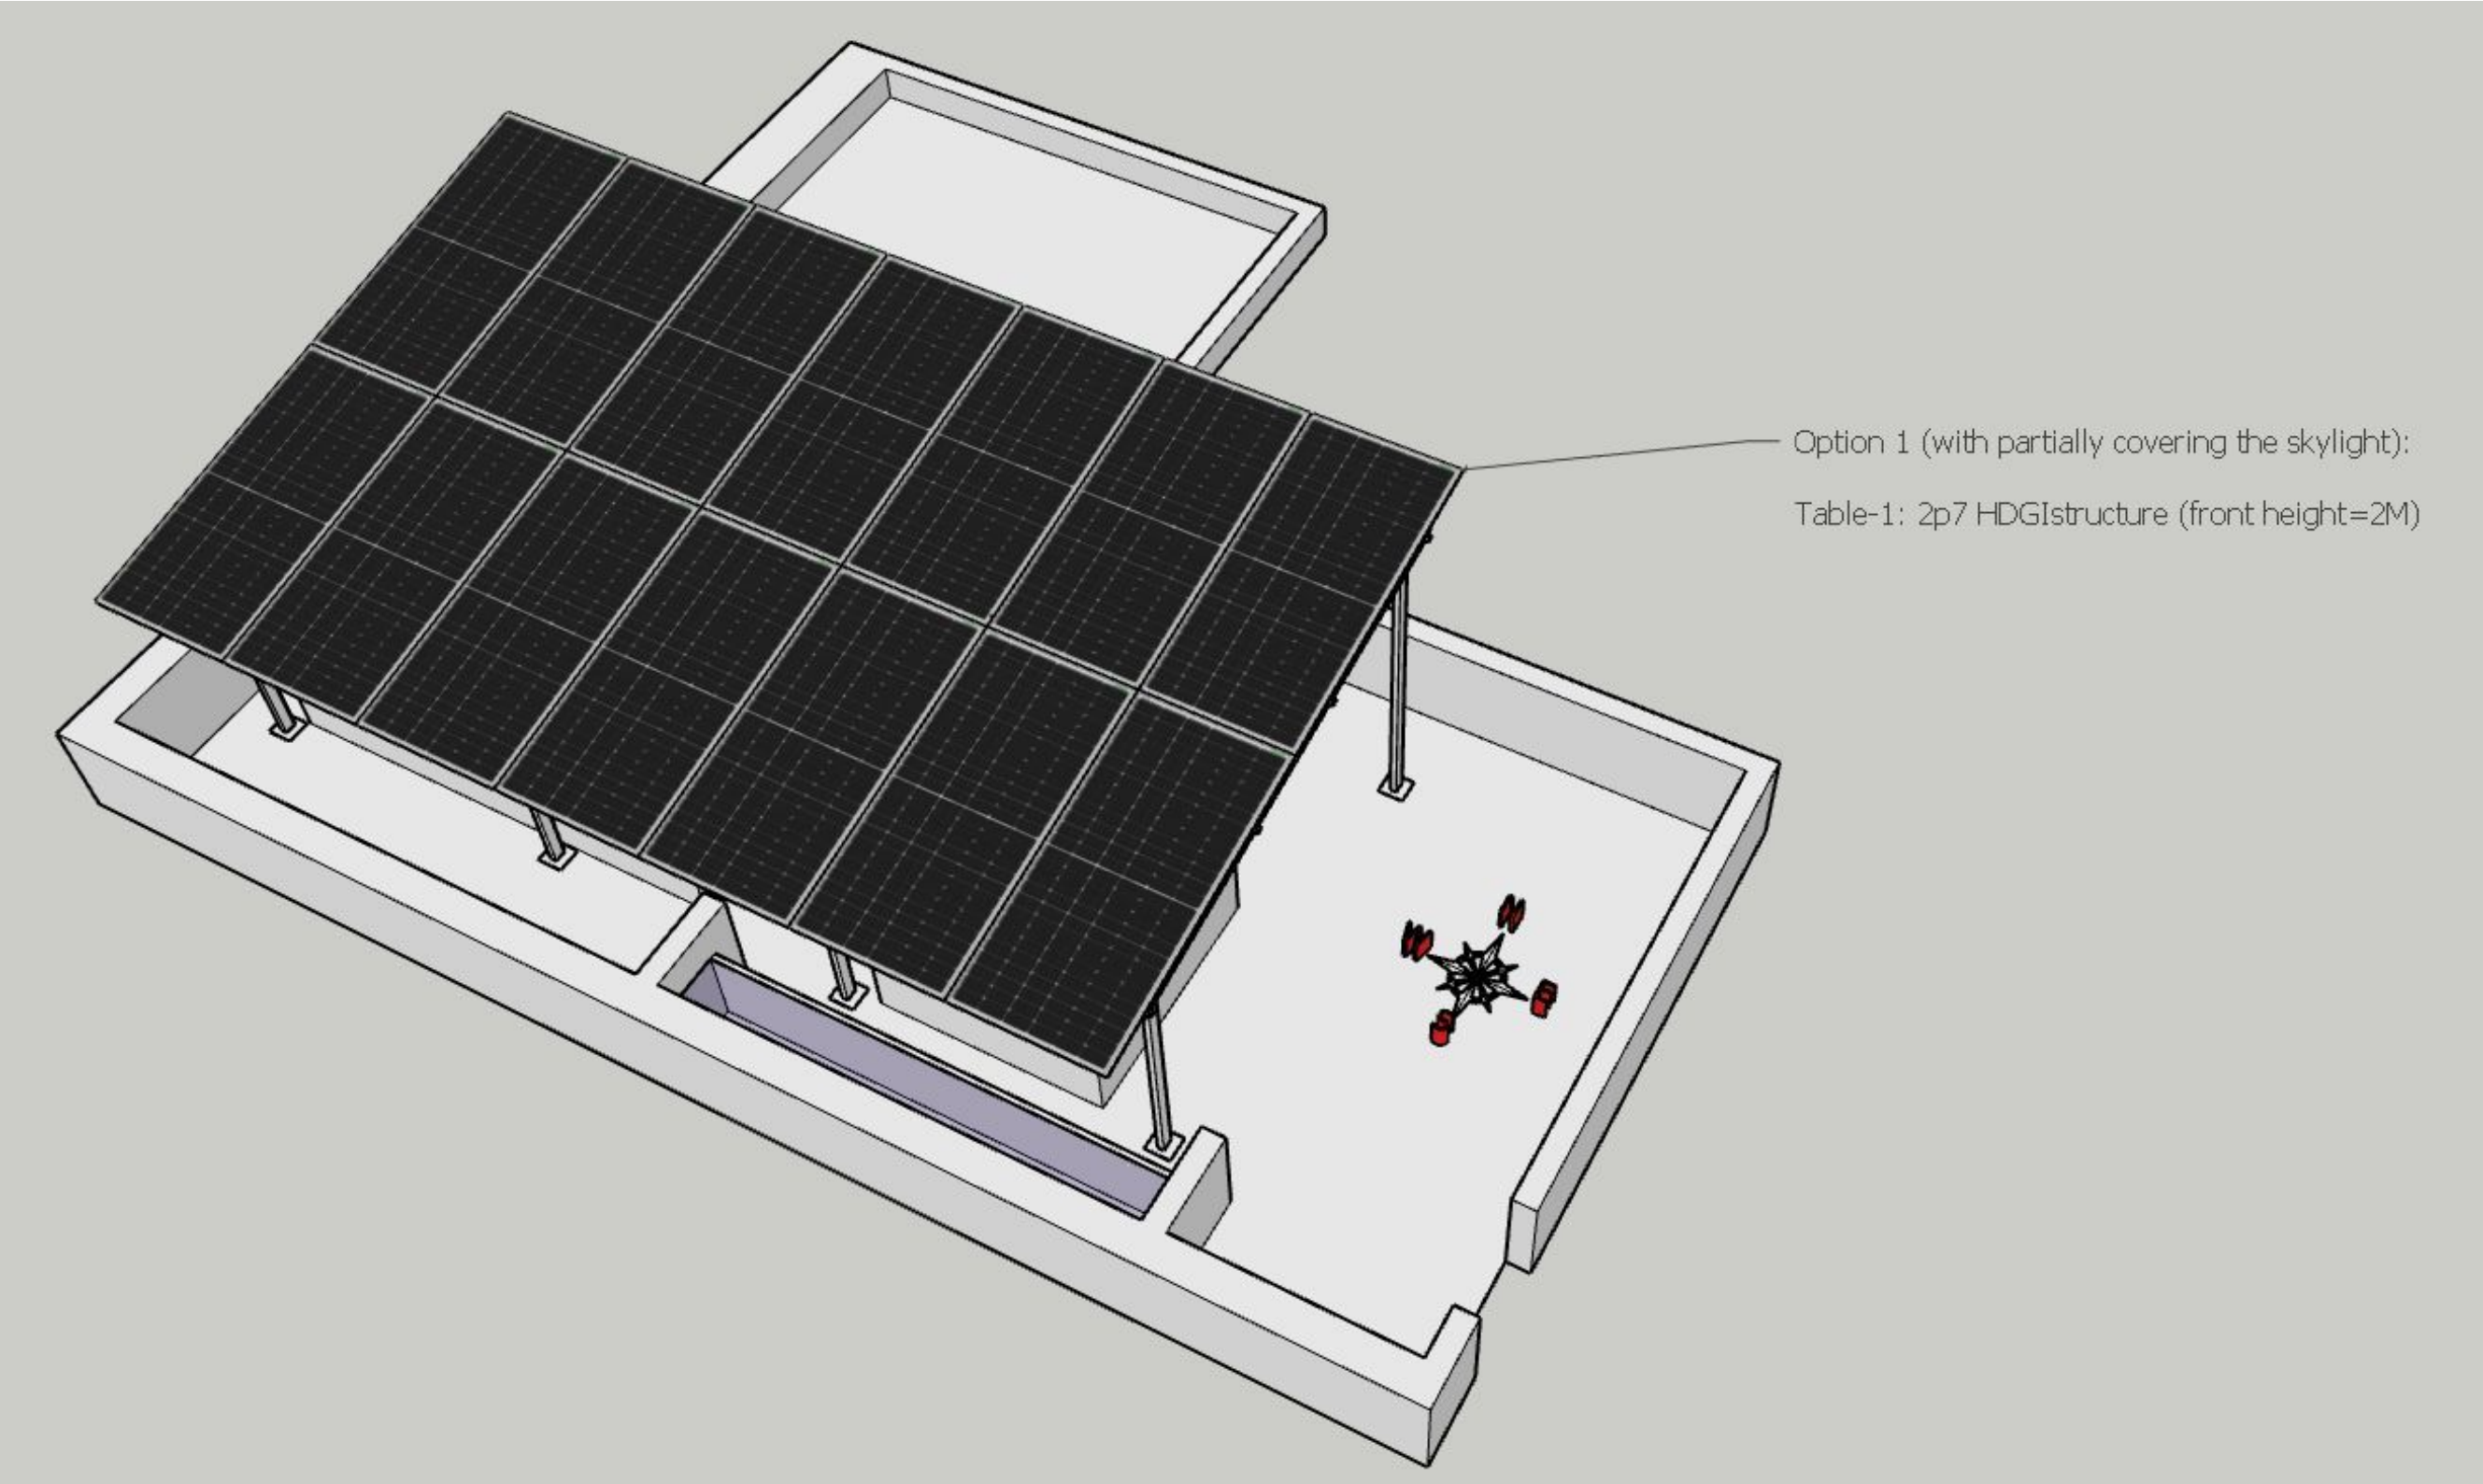


*Option-1 (Single table, HDGI structure with 2M front height). But partially hiding the SKYLIGHT.*

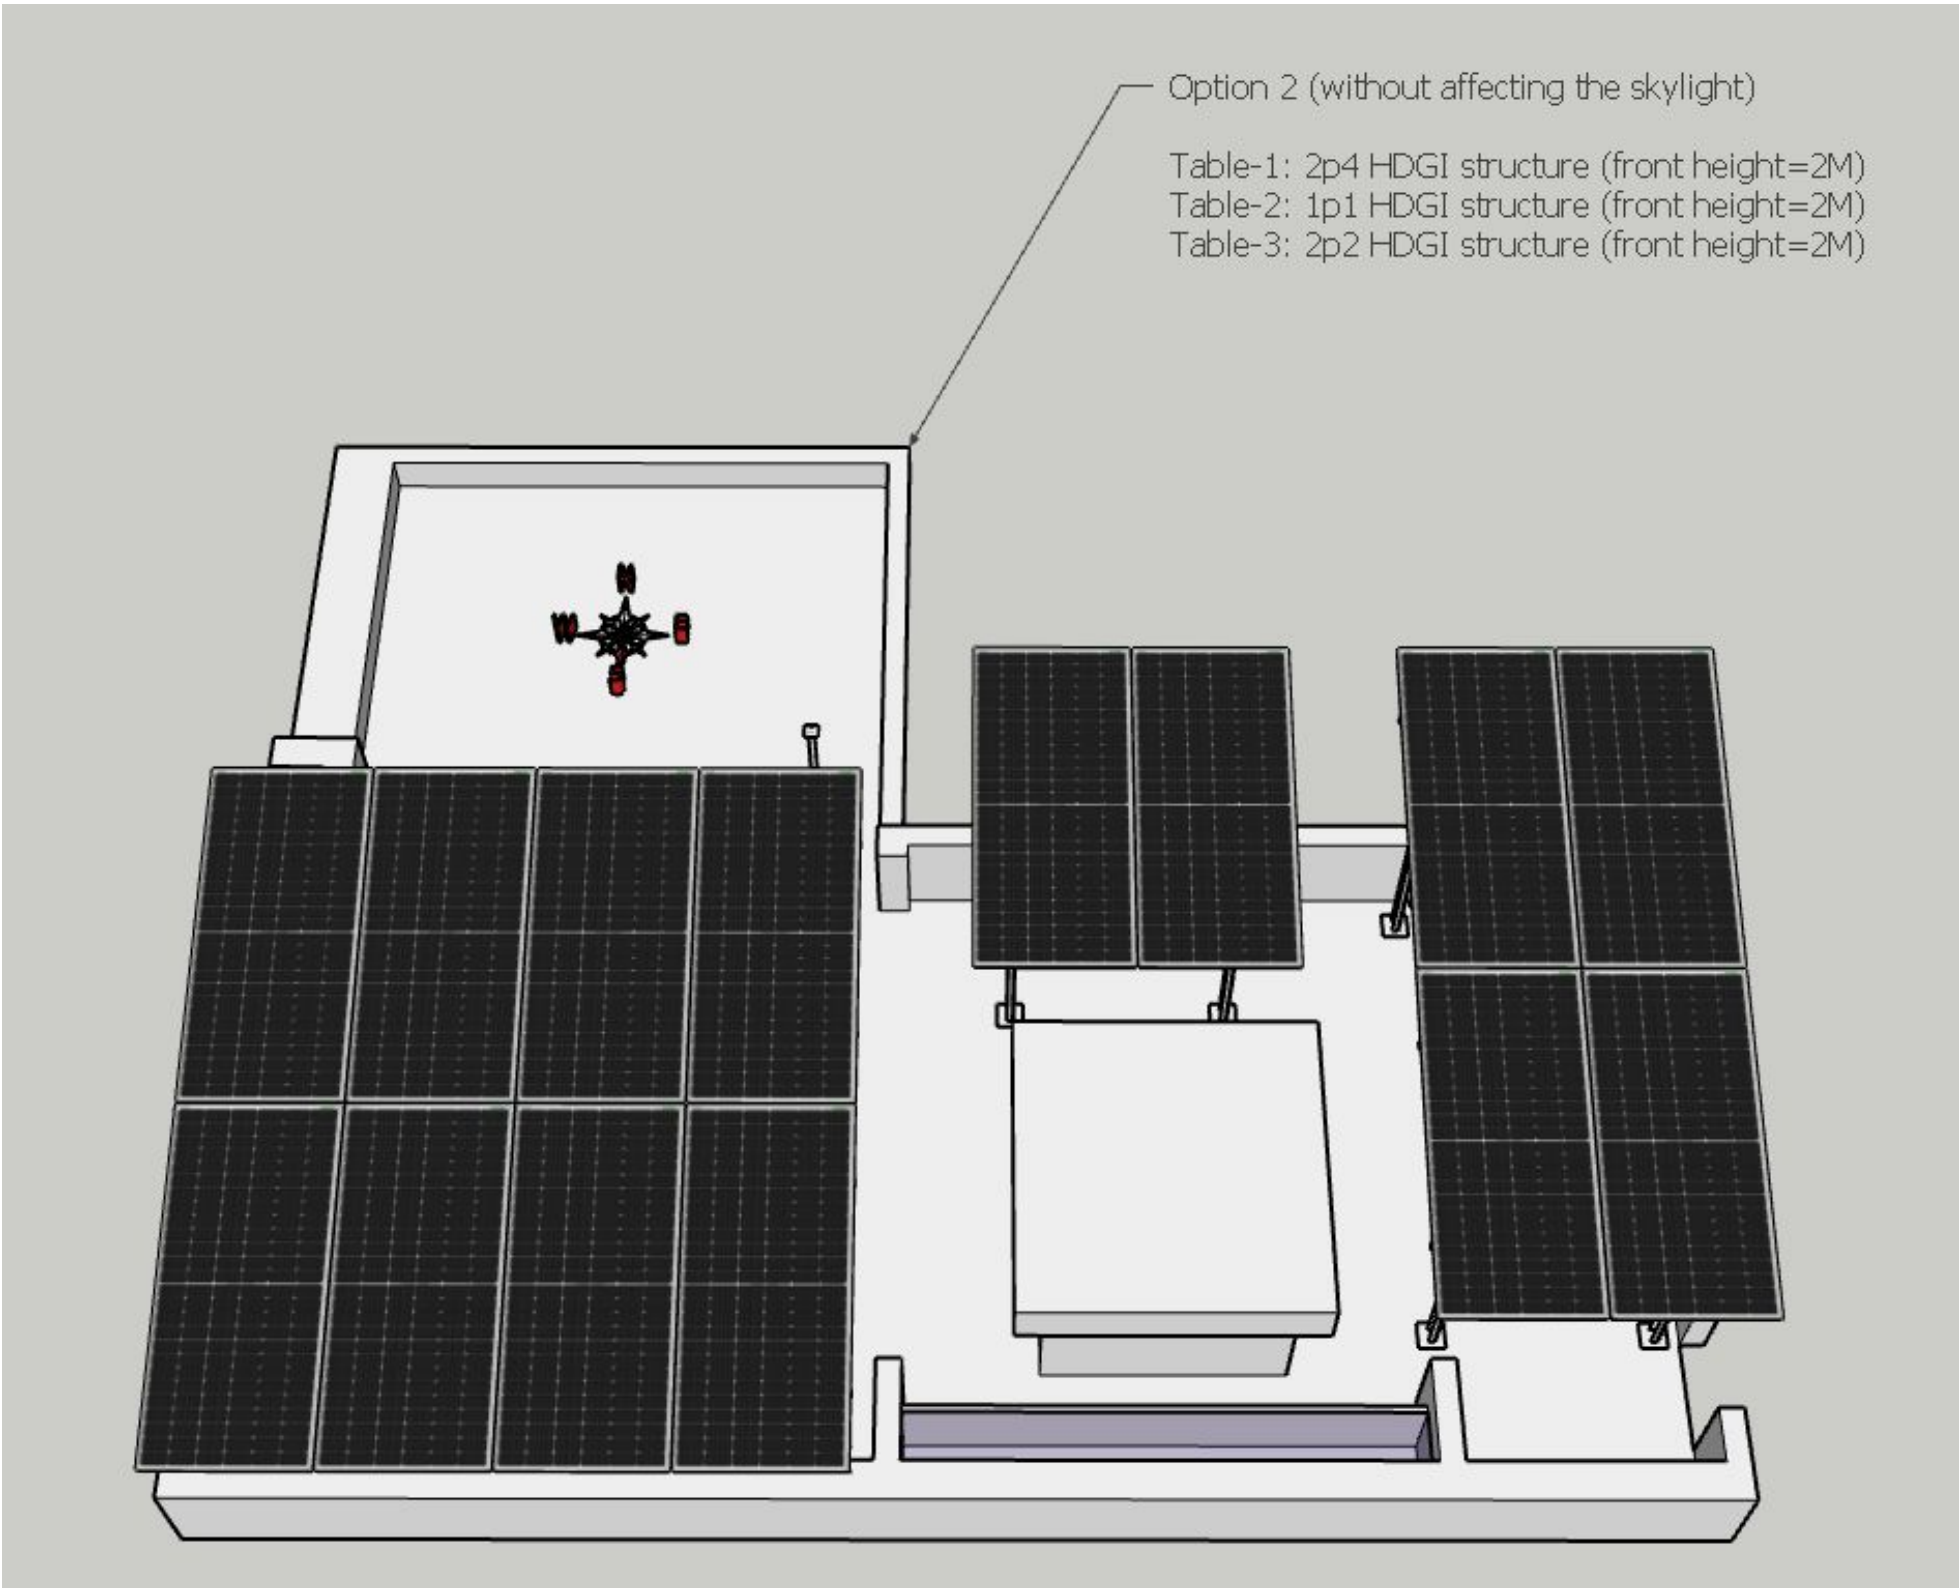


*Option-2 (Three Tables, Each HDGI structure with 2M front height). But not hiding the SKYLIGHT.*

## Building Exterior

## Material Delivery Route

## Staircase Details


Staircase width: 1000 mm


Staircase width: 1000 mm

## Proposed PV Area


## Material Storage

## Cable Routing


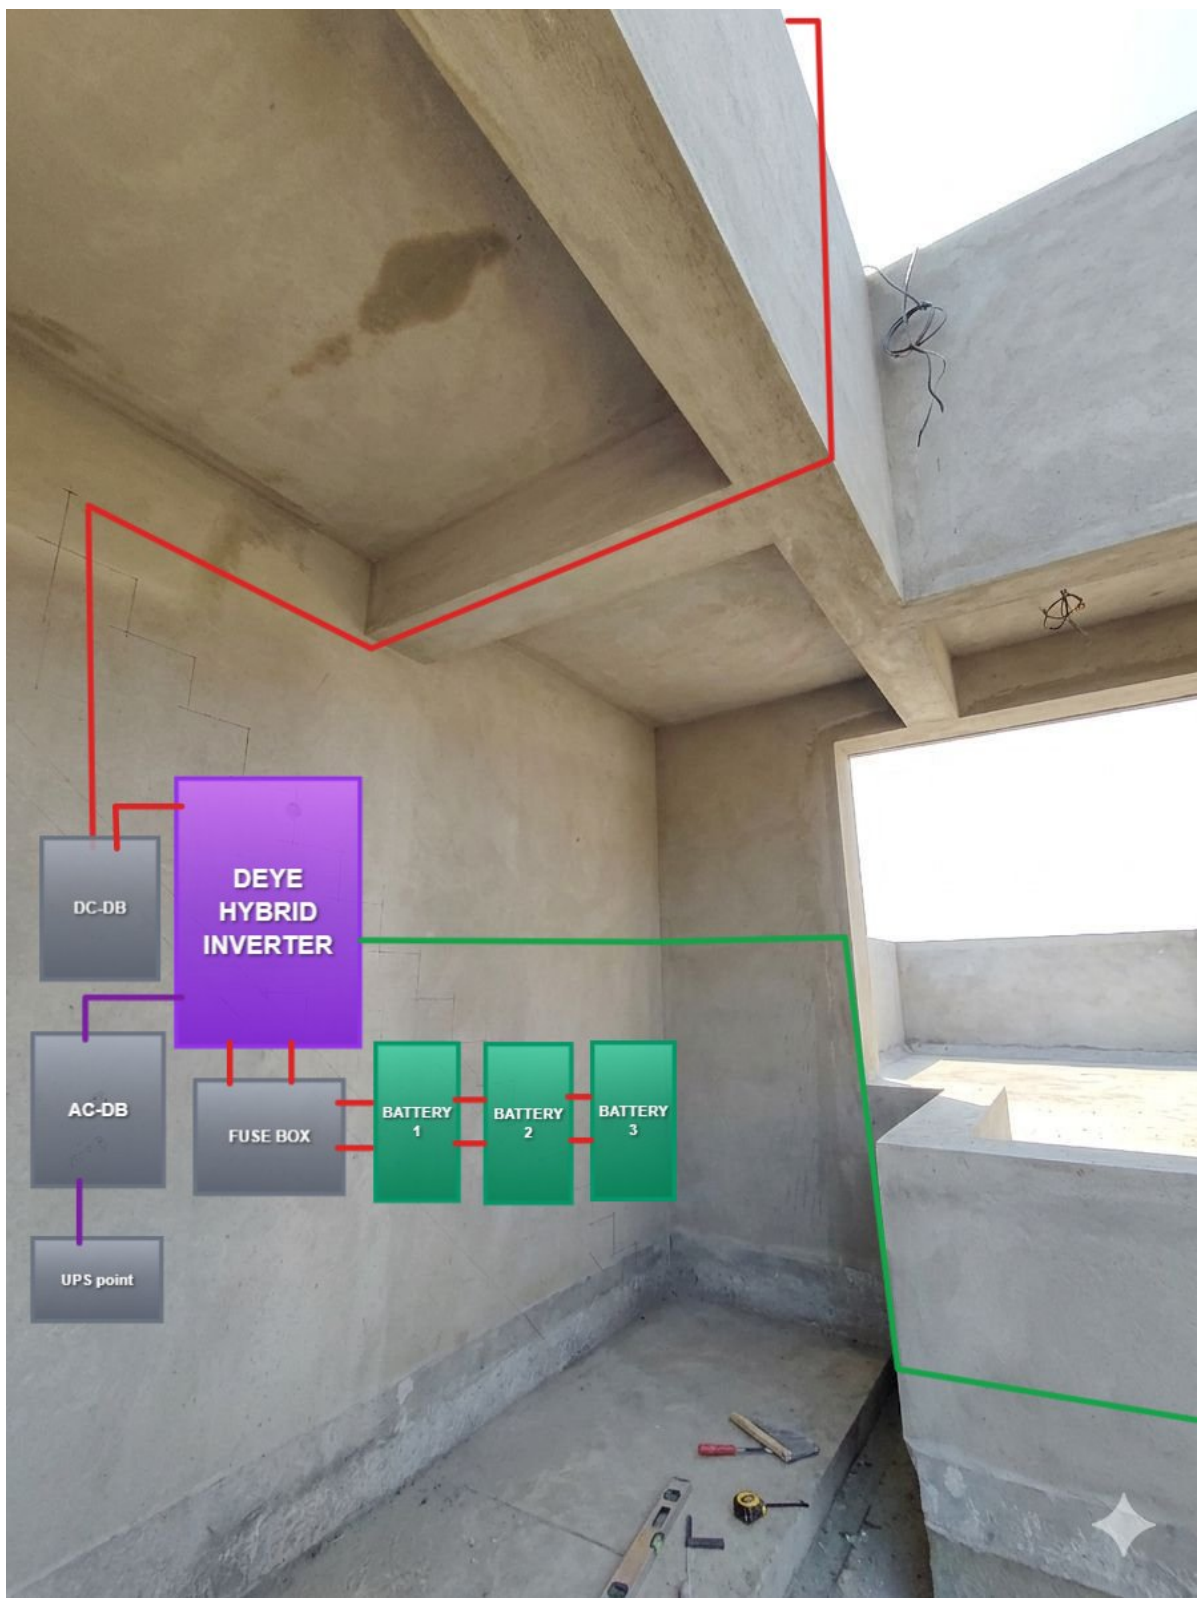

*Earthing cables from DUCT to the earth pits at the front side near EB meter location has to be laid under ground.*

*Continuing the cable under ground towards the front side earth pit location.*


*Earth pit location is planned near the  EB meter area. The earthing cables has to be pulled till the earth pit under ground.*

# Meter Box

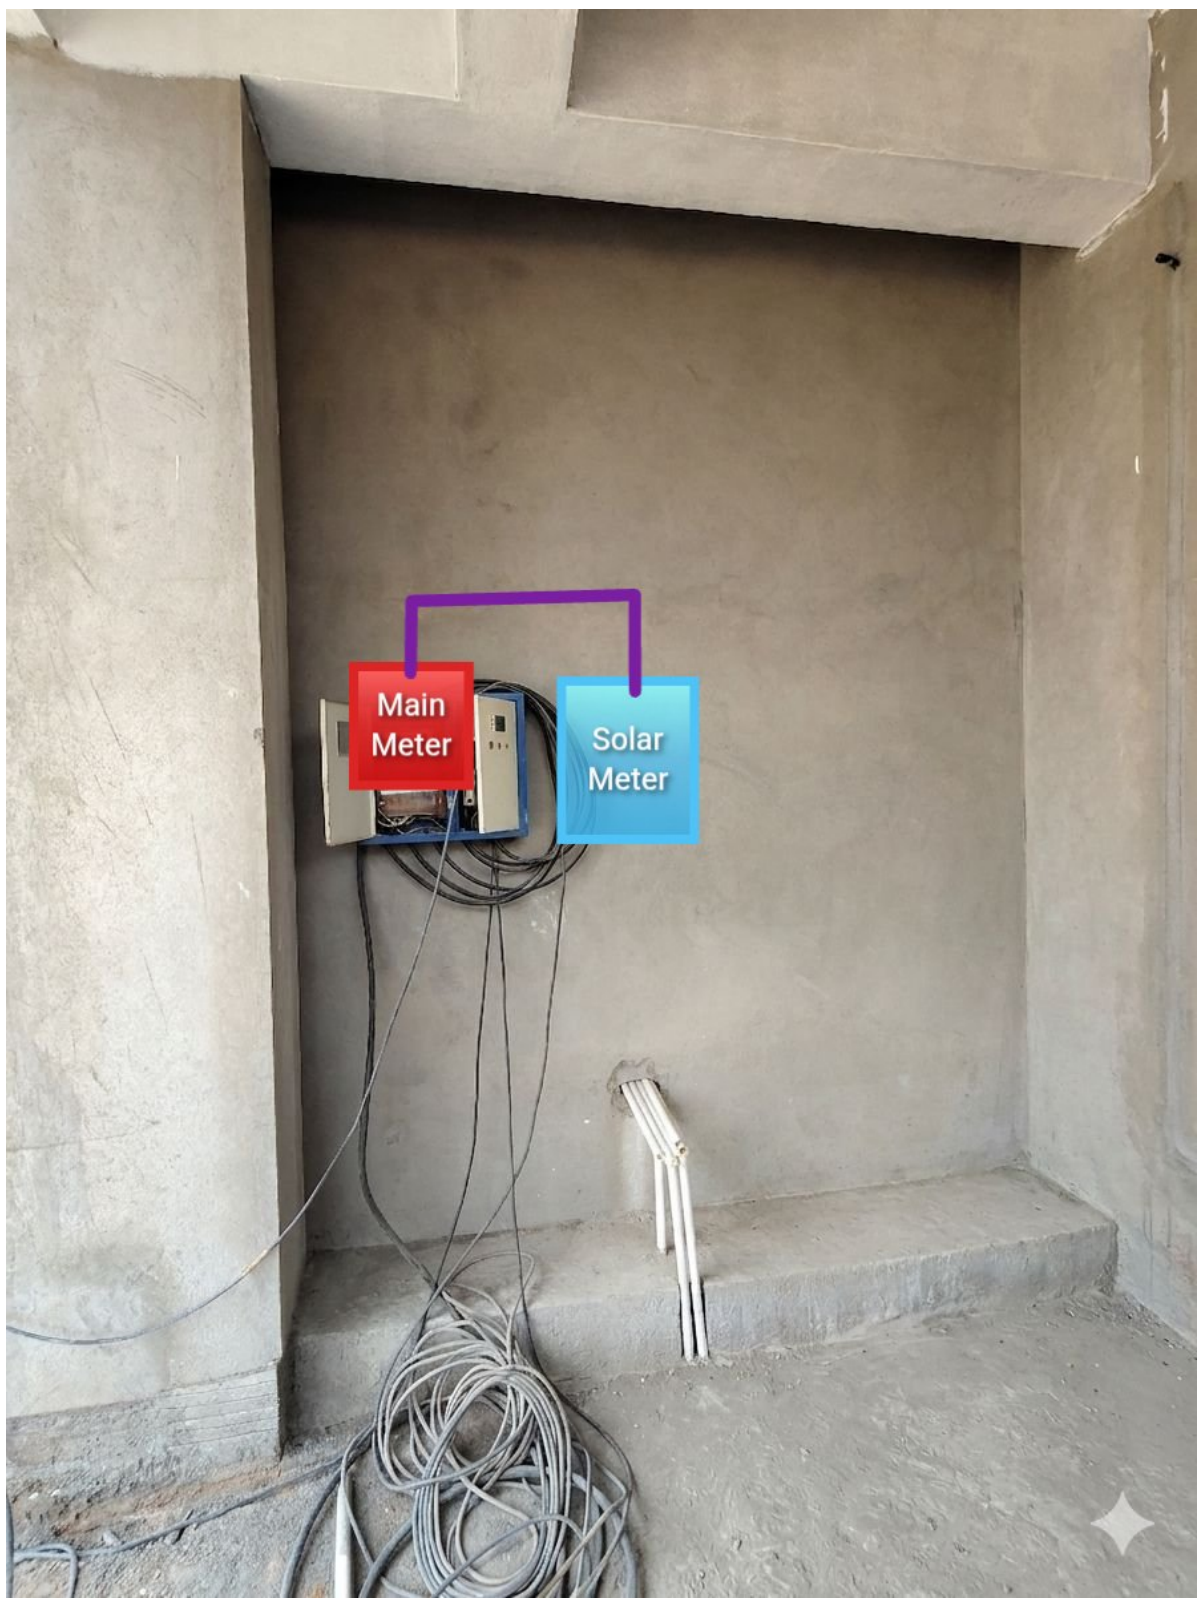


# OBSERVATIONS & RECOMMENDATIONS

## EcoSoch Scope

| # | Observation |
|---|---|
| 1 | Installation and commissioning of 9.8 kWp, Hybrid solar power plant at the proposed premises. |

## Customer Scope

| # | Observation |
|---|---|
| 1 | Providing an active Wi-Fi or LAN cable connection up to the inverter location. |
| 2 | Providing conduits under ground from Electrical duct to the earth pit location. |
| 3 | Providing UPS point near the Inverter and battery location. |

## THANK YOU

Dear BISINEER PROJECT - MAHATHI SENTHIL,

Thank you for choosing EcoSoch Solar for your solar installation. We appreciate your trust in us and your commitment to sustainable energy. Our team is dedicated to ensuring a seamless installation experience and long-term performance of your solar system.

Should you have any questions or require further assistance, please do not hesitate to reach out to us.

Warm Regards,
**Team EcoSoch**

### & Did You Know?

The Sun burns 600 million tonnes of hydrogen per second — and your panels get a share.

**EcoSoch Solar Pvt. Ltd.**

#940, Sha Arcade, 2nd Phase, NTI Layout, Kodigehalli, Bengaluru 560097

www.ecosoch.com | info@ecosoch.com