Technical Site Visit Report

Prepared for: Bomman Sreekumar - Bomman Sreekumar

PROJECT INFORMATION

Report Number	ESV-2026-0125
Project ID	B9488A2F
Project Name	Bomman Sreekumar
Building Name	Bomman Sreekumar
Billing Name	Bomman Sreekumar
Project Sector	Residential
Project Type	With Subsidy
Sales Lead	Govindaraju
Site Address	#5, Krishna kuteer villas, phase 2, 5th cross, Hoodi.Bangalore 560048
GPS Coordinates	12.99637841168389, 77.71472821635273
Google Maps	https://www.google.com/maps?q=12.996378411683889,77.71472821635273
Visit Date	2026-05-30
Visited By	K Naveen
Revision	Rev 2

CLIENT INFORMATION

Client Name	Bomman Sreekumar
Contact	9886297437

PROJECT DETAILS

Solar Rooftop System Type	On-Grid
System Capacity (kWp)	4.305
Sanction Load (kW)	4.4

Module Make & Capacity	Adani DCR bifacial 615 Wp
Module Length (mm)	2382
Module Width (mm)	1133
Number of Panels	7
Inverter Type	String
Inverter Brand	Deye 4 kW 1phase String
Number of Inverters	1
Mounting Structure Type	Elevated

SITE INSPECTION CHECKLIST

General

#	Question	Answer	Notes
1	Can the delivery van/truck reach the material unloading point?	Yes	-
2	Are there any obstacles at the site that could hinder material lifting?	details: Flower pots are the obstacles that will hinder material lifting	-
3	Where will the Inverter, DCDB, ACDB, Battery, etc. be located?	As per the customer concern the inverter,DCD B,ACDB, will beinstalled below the inside hearoom.	-
4	Is a canopy required for protecting the Inverters/ACDB/DCDB?	**No**	-
5	Did you discuss the location of the earth pits with the customer?	The earth pits are located rear side of the house which is near the washing area.	-
6	Where is the Internet Router located?	The inernet router is located in first floor	-
7	What's the Wi-Fi strength of the router near to the String inverter/Envoy?	2 bars	-
8	Did you pin the site location in your WhatsApp when you were at the site?	Yes	-

Roof Details

#	Question	Answer	Notes
1	What type of roof is present at the site?	RCC Flat Roof	-
2	Are there any obstructions on the roof that could affect the solar installation?	details: The manglore tiles are	-

#	Question	Answer	Notes
		the obstructions on the roof that could affect the solar installation.	
3	What is the angle of the panels? (in degrees)	10	-
4	In case of sloped roof, what is the slope angle of the roof? (in degrees)	N/A	-
5	On how many roofs at the site are we installing solar?	0	-
6	If it is a Tiled roof, what is underneath the tiles?	N/A	-
7	If it is a Tiled roof with MS or Wooden rafters, is it Single-tiled or Double-tiled?	N/A	-
8	What type of mounting structure is planned?	Elevated	*Elevated HDGI with grouting*
9	What is the orientation of the solar panels?	["South"]	-
10	How can the roof be accessed?	Ladder	-
11	Is the building currently under construction?	**No**	-
12	In an under-construction building, are existing conduit pipes available for AC, DC cables, and earthing?	Not Applicable	-
13	What is the height of the building and how many floors does it have?	The height of the building is G+1+Headroom is approximately 15meters	-
14	Is the site photo matching with the building description?	Yes	-
15	Is there an overhead HT line passing within a 10-meter radius of the site?	**No**	-

Residential / Electrical

#	Question	Answer	Notes
1	What type of energy meter is currently installed?	Phase: Single, Type: Digital, If 3-phase: N/A	-
2	Is the Meter cubicle photo matching with the previous answer?	Yes	-
3	Has the termination point in the Main meter panel been identified?	Yes	-
4	Is the Termination Point easily visible or sealed?	Visible	-
5	Is a Lightning Arrestor (LA) already available at the site?	**No**	-
6	Is space available for CT within Energy meter panel?	**No**	-
7	In case of an Enphase system, is the distance between the farthest micro-inverter and IQ Gateway > 50m?	N/A	-
8	Provide details of the existing CT ratings (if applicable).	N/A	-
9	In Main meter panel, is empty space available for solar meter?	**No**	*Not Available*
10	In Main meter panel, is empty space available to house the Enphase accessories or ACDB components?	N/A	-
11	Is there space available to dig DC, AC and LA earth pits?	Yes	-
12	In case of elevated structures, is an LA extension provided at the far end?	Yes	-

#	Question	Answer	Notes
13	In case of elevated structures, is it with or without grouting?	With Grouting	-
14	Are there any challenges with respect to Installation and Maintenance activities?	**No**	-
15	Are there any safety risks associated with accessing the roof for installation?	**No**	-
16	Is space present in rooftop to store the panels?	Horizontally sleeping	-
17	In case of sloped roof MS structure, provide the dimension of rafter to rafter, purlin to purlin.	N/A	-
18	Is ventilation available in the battery location?	N/A	-
19	Should the Inverters/ACDB/DCDB be installed on a metal grill or wall mount?	Wall Mount	-
20	Provide the dimensions for solar meter cubicle placement (L x W of wall).	length: 1500, width: 1500	-
21	Provide the dimension for earth pits location (L x W of available space).	length: 2500, width: 600	-
22	Is LAN cable under customer scope?	**No**	-
23	Is there any shadow that affects the solar installation?	Yes	*The existing water tank shadow will fall on the panels during the month of May to september between 3.30 PM to 4.00 PM.*
24	Is there any trench work to be done to carry the AC cable to the meter location?	**No**	-

PHOTO DOCUMENTATION

Cable Routing Legend

Legend	Description
	Proposed PV Module Array
	Main Meter Location
	Solar Meter
	Battery
	Inverter
	Other Equipment
	DC Cable
	AC Cable
	Material Shifting
	DC Earthing Cable
	AC Earthing Cable
	LA Cable
	DC Earth Pit
	AC Earth Pit
	LA Pit
	LA

Material Delivery Route

This route (using lifting) will be followed to carry large items (like Panels).

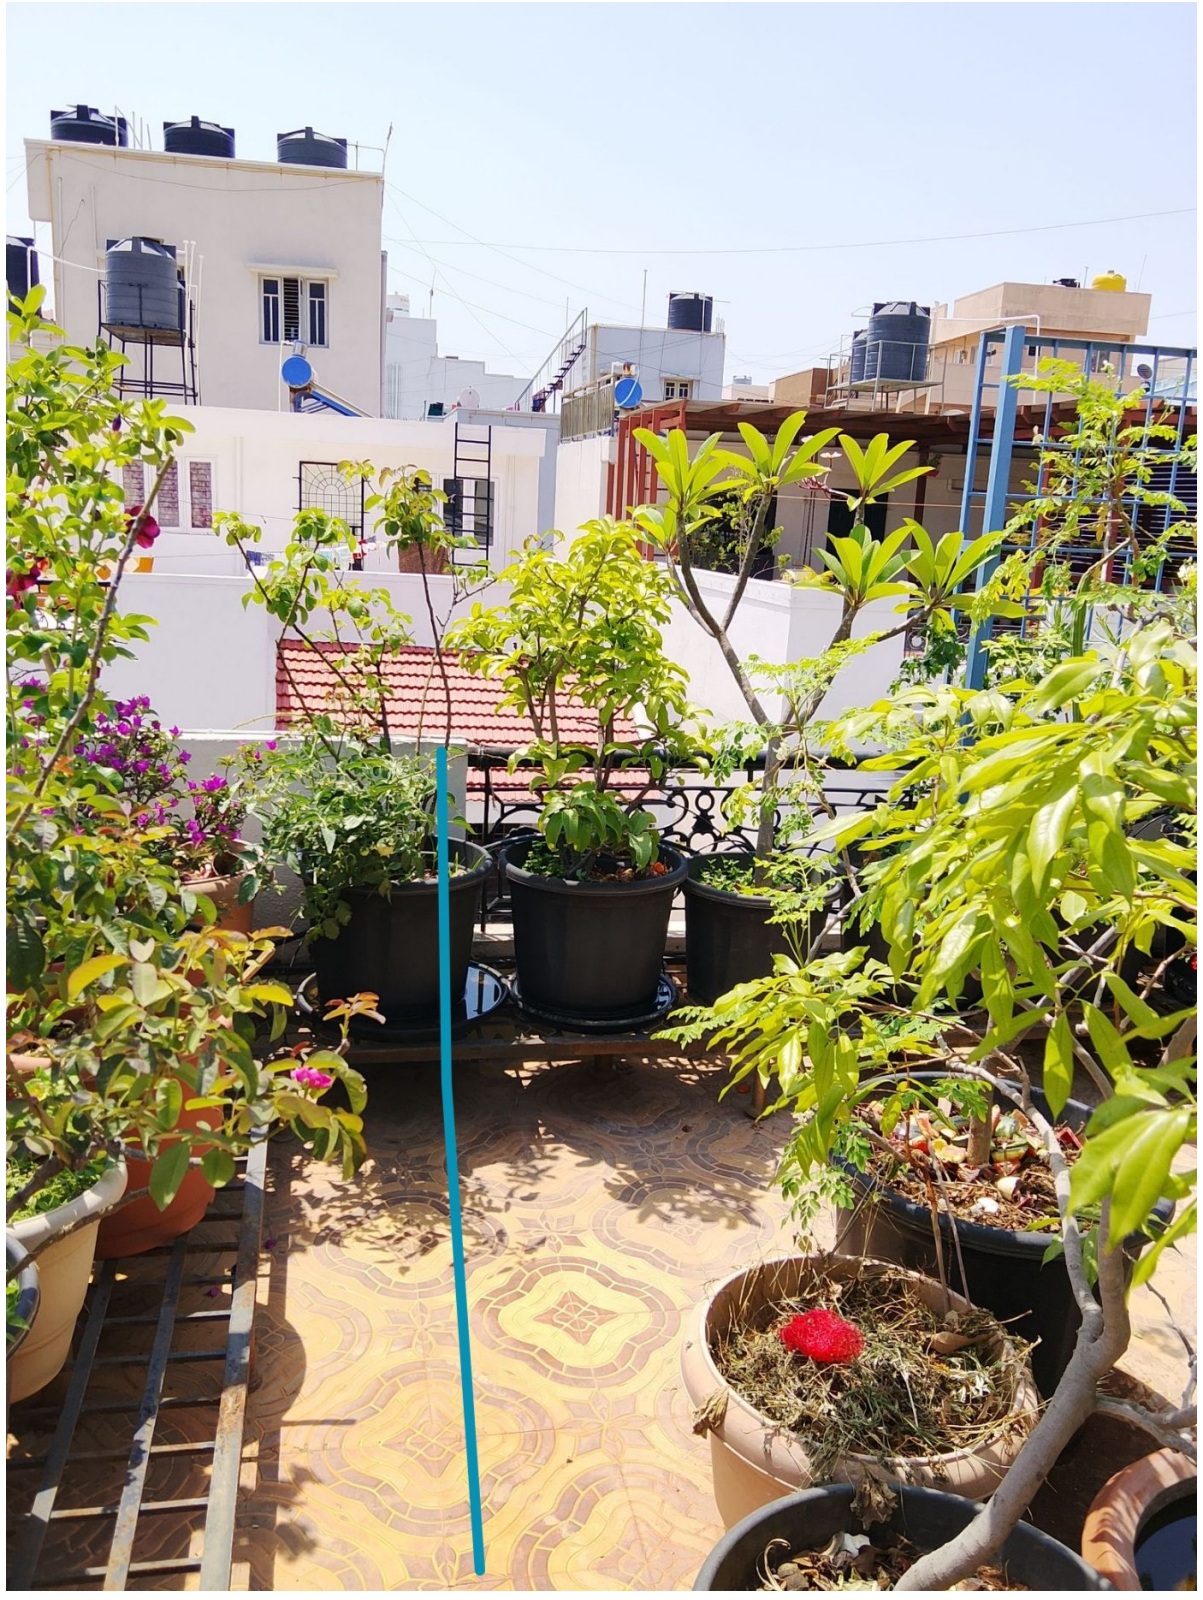

At the time of installation removing solar water is under customer scope

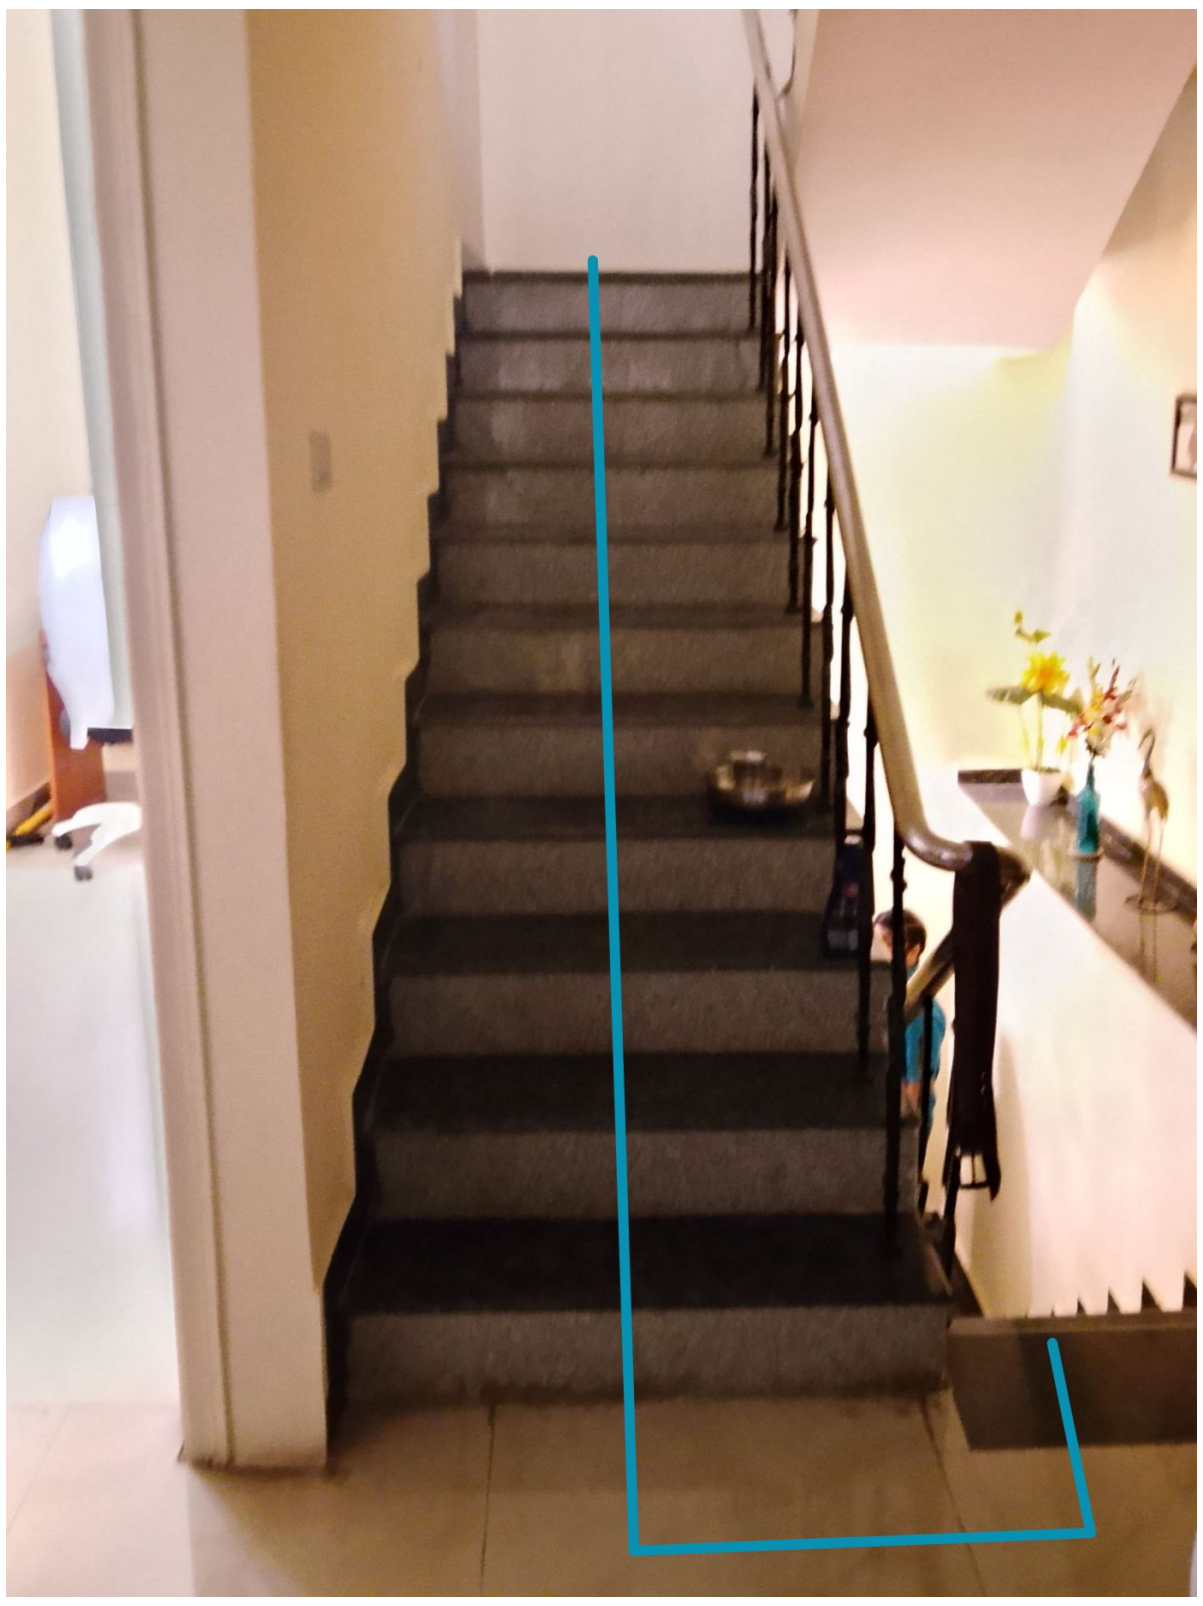

This route (using Staircase) will be followed to carry Small items.

Staircase Details

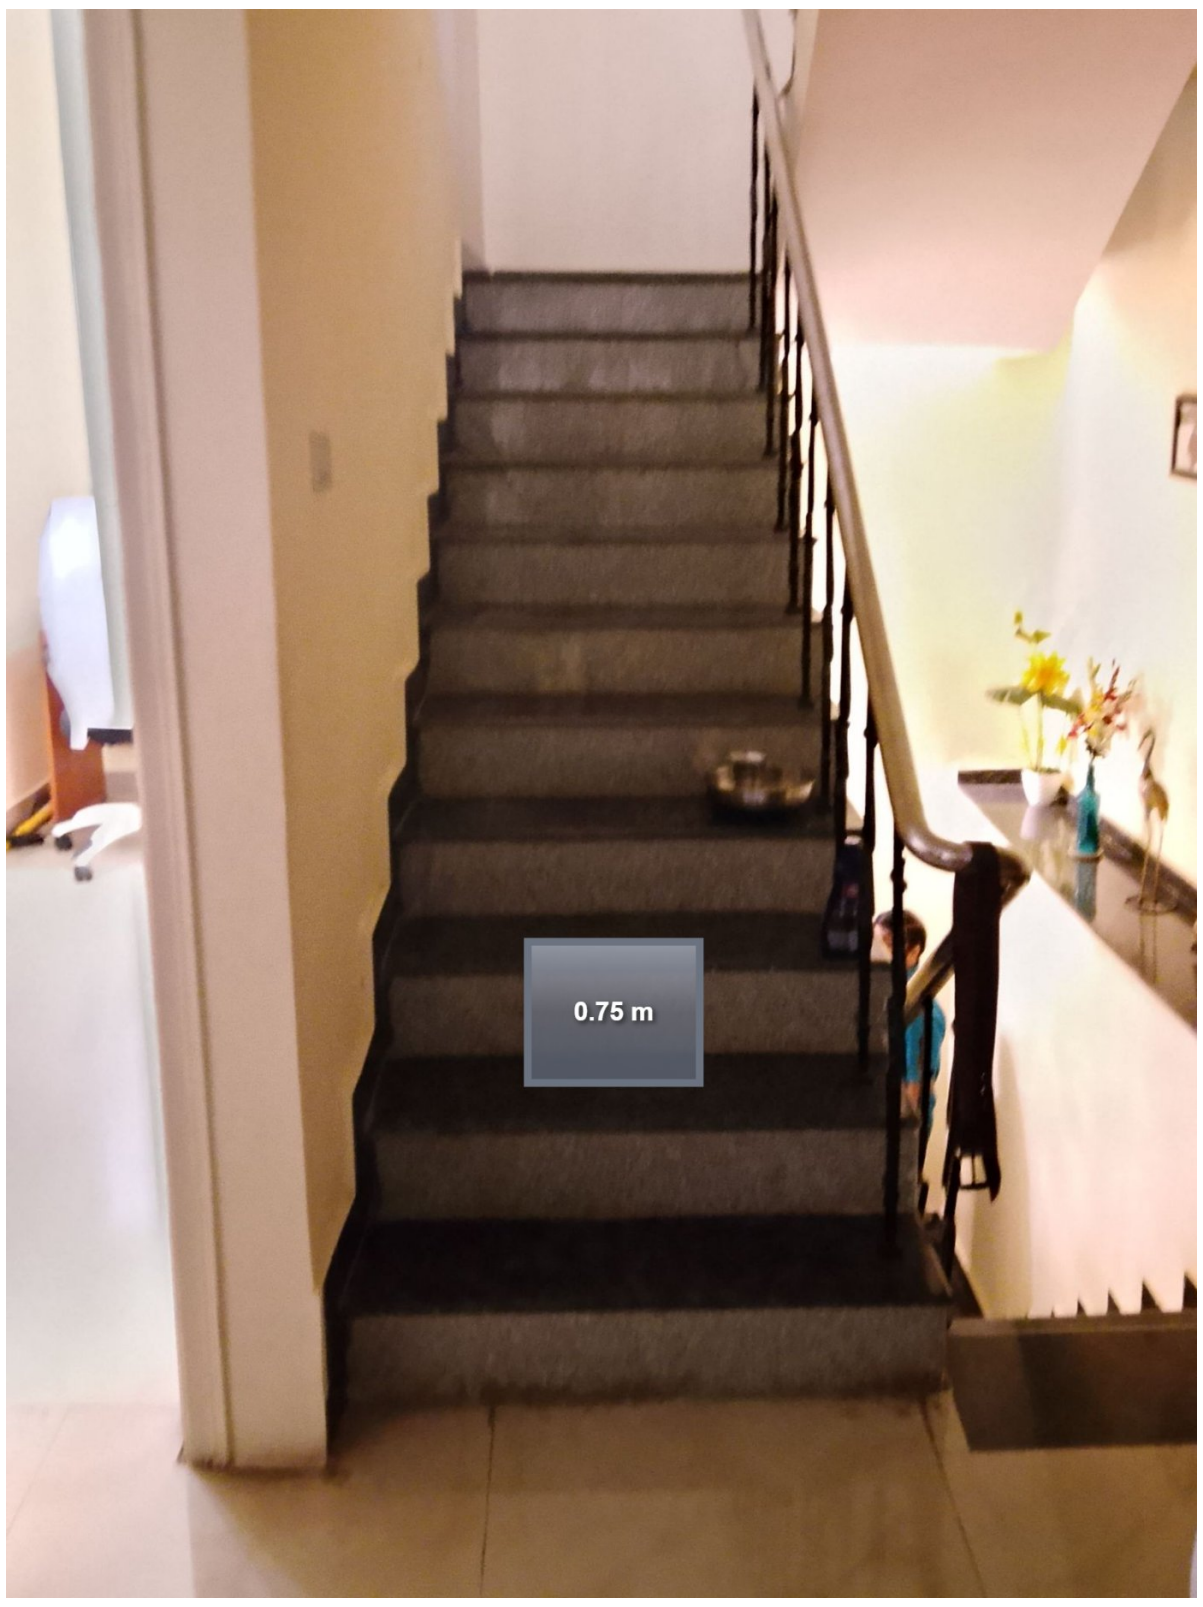

Meter Box

Material Storage

Proposed PV Area

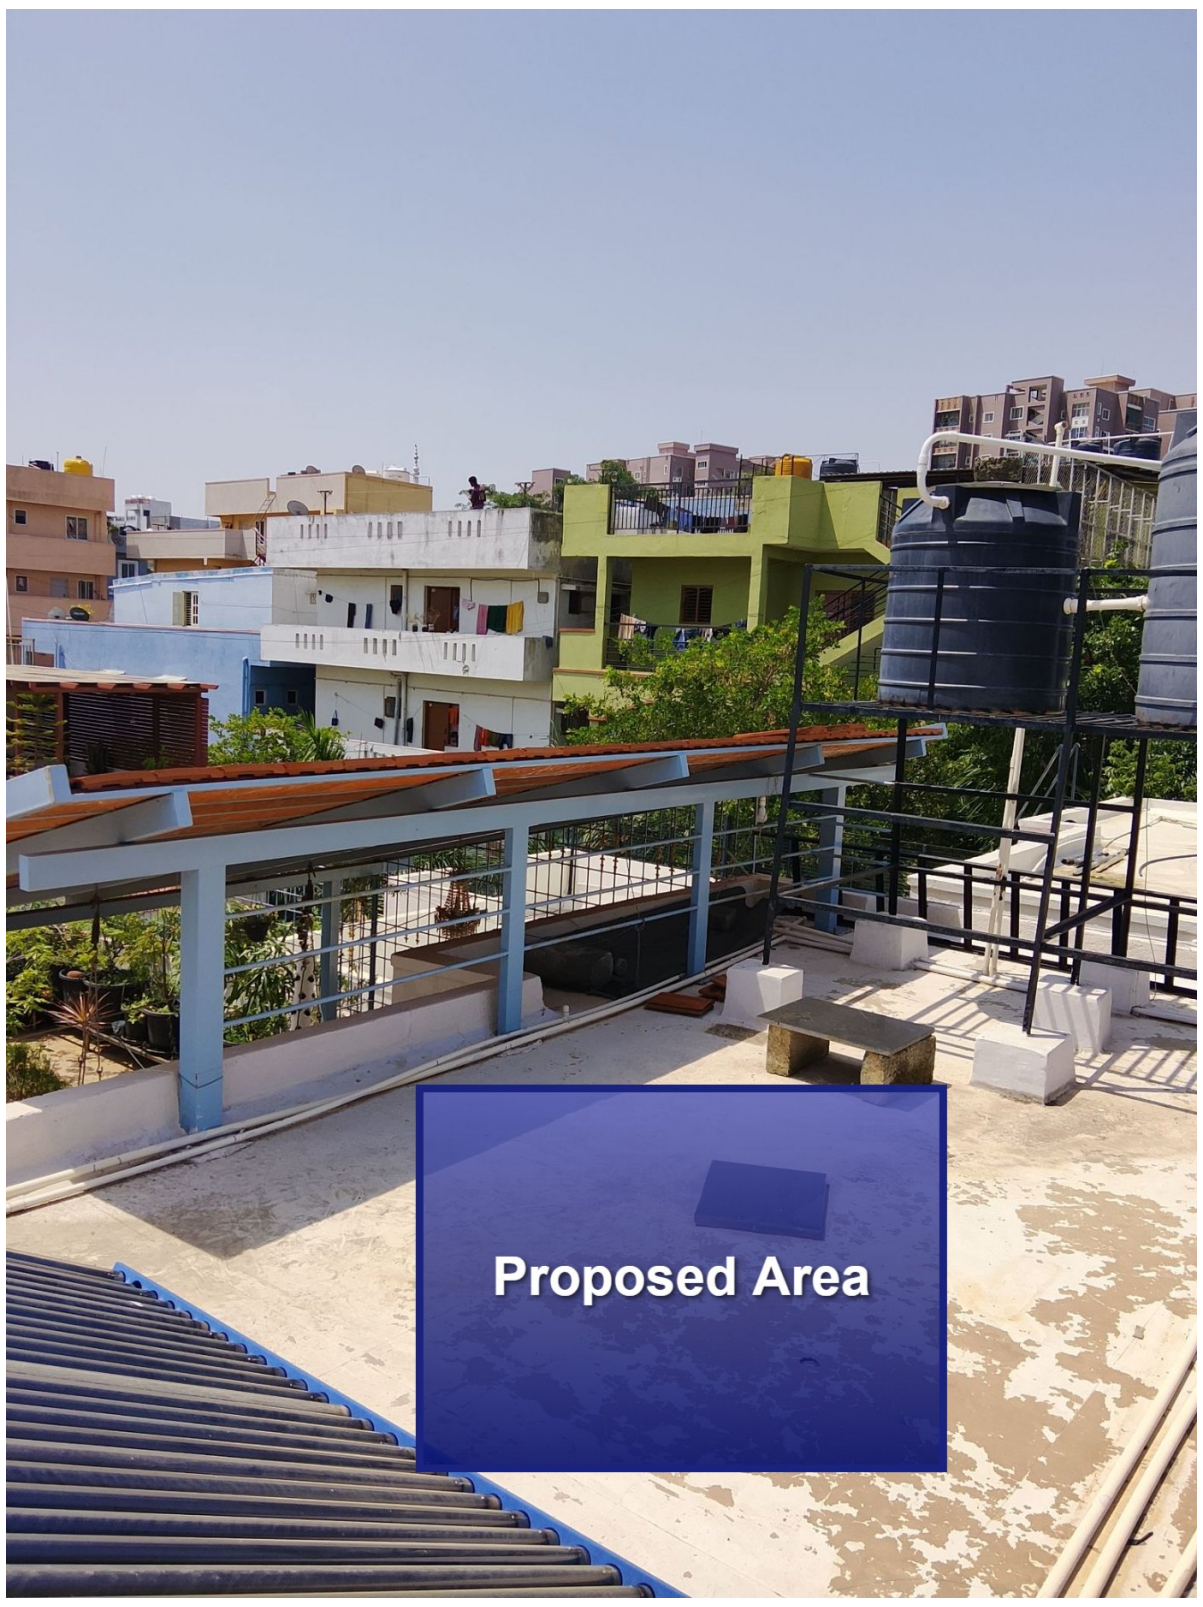

Cable Routing

Make a hole to run the DC Cable inside the solar meter location

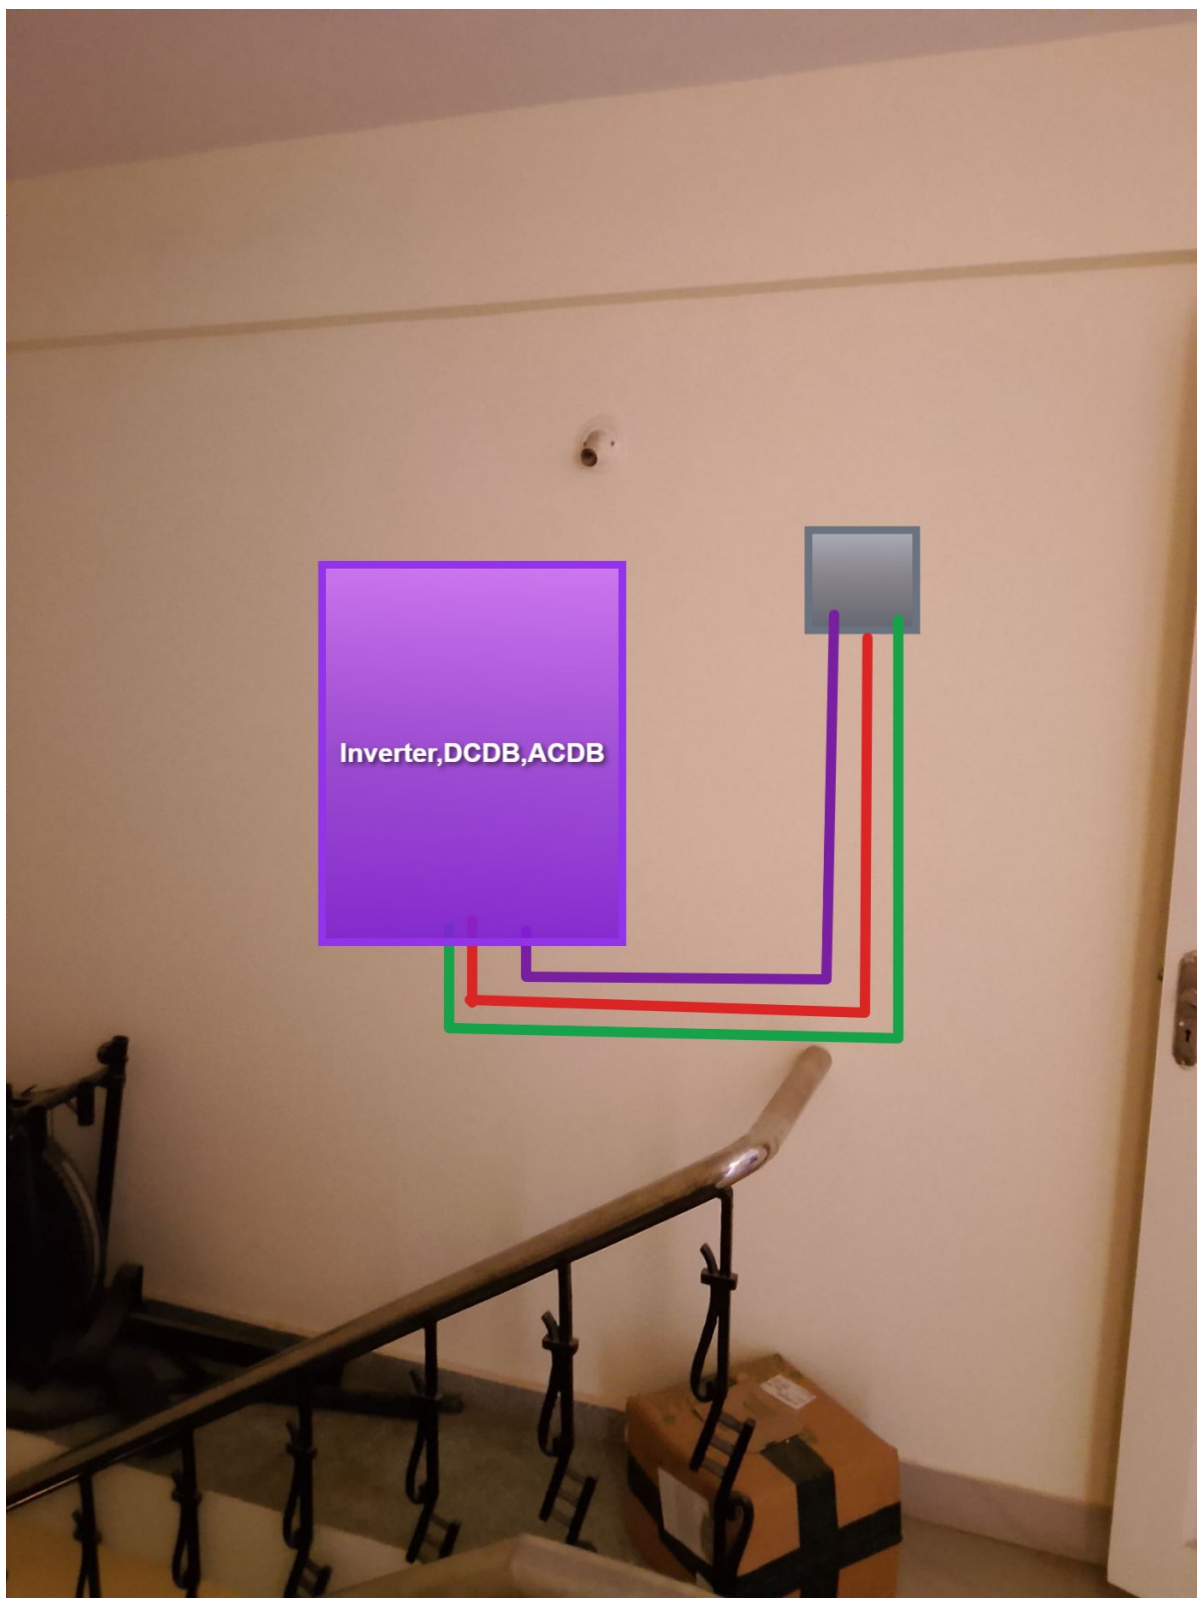

In same hole to run the AC cable and Ac earthing Cable

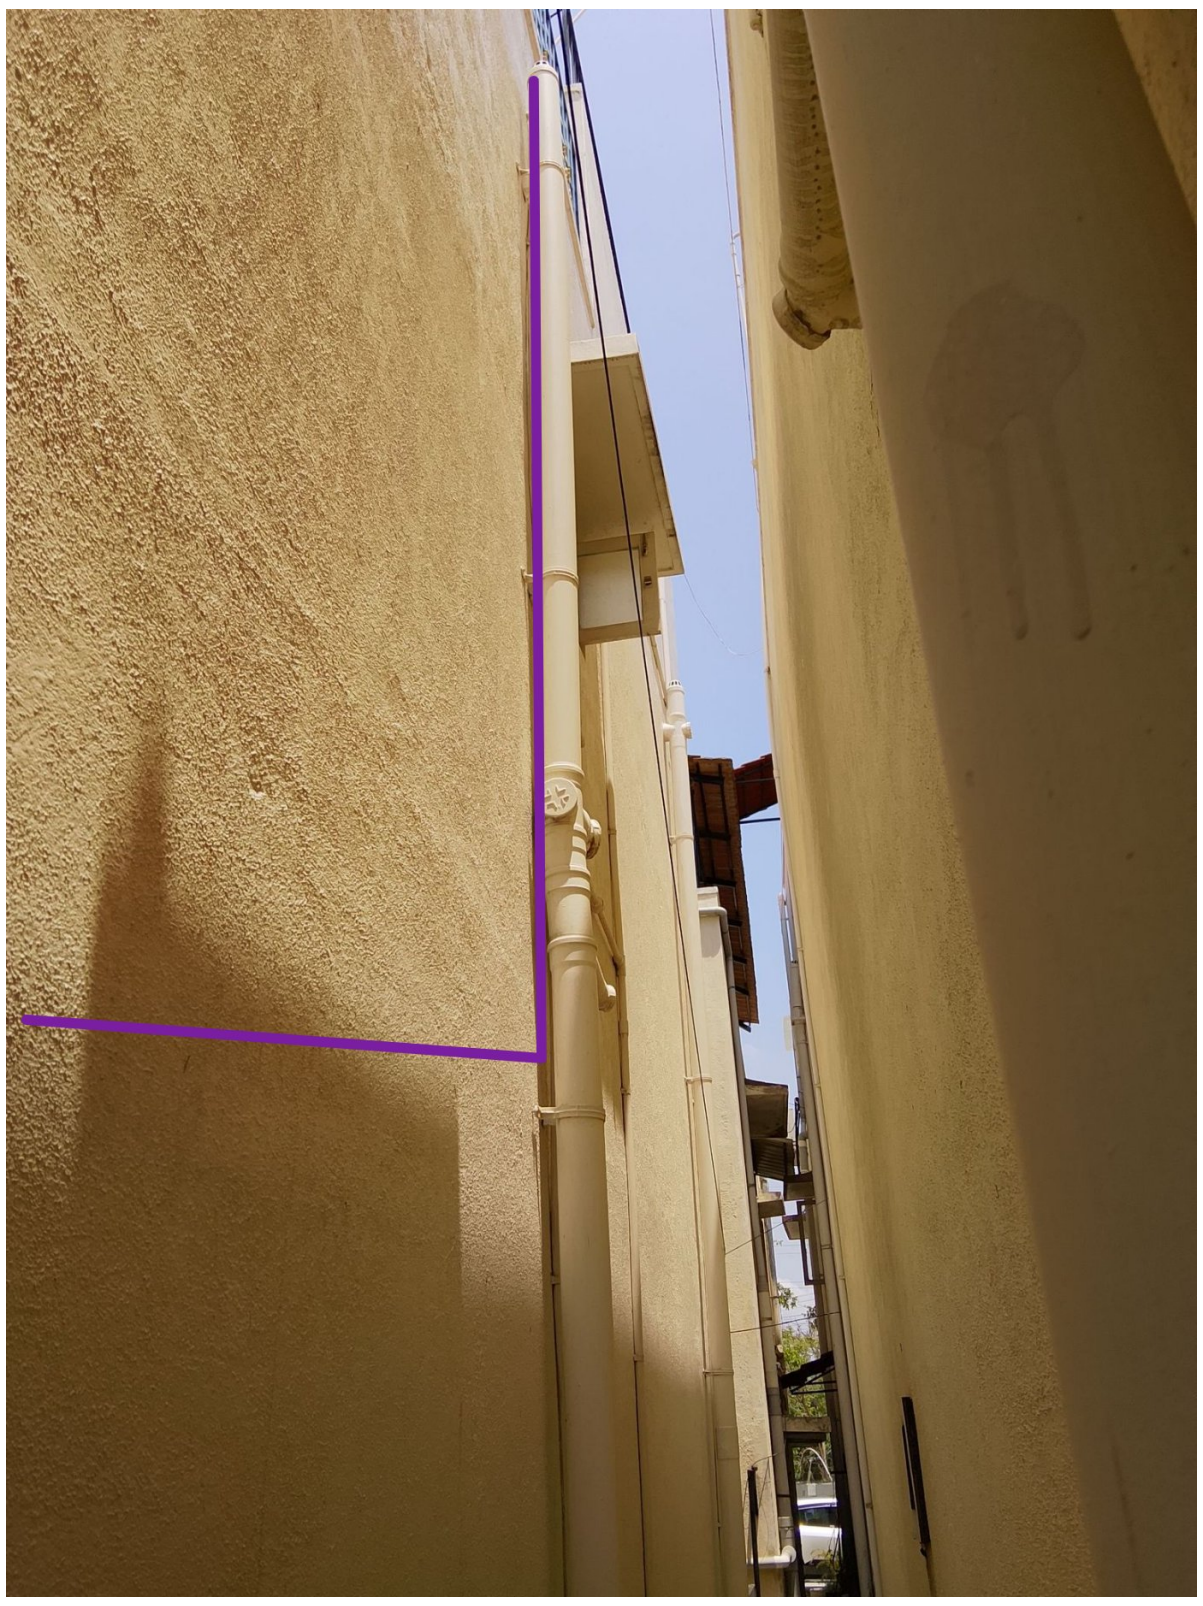

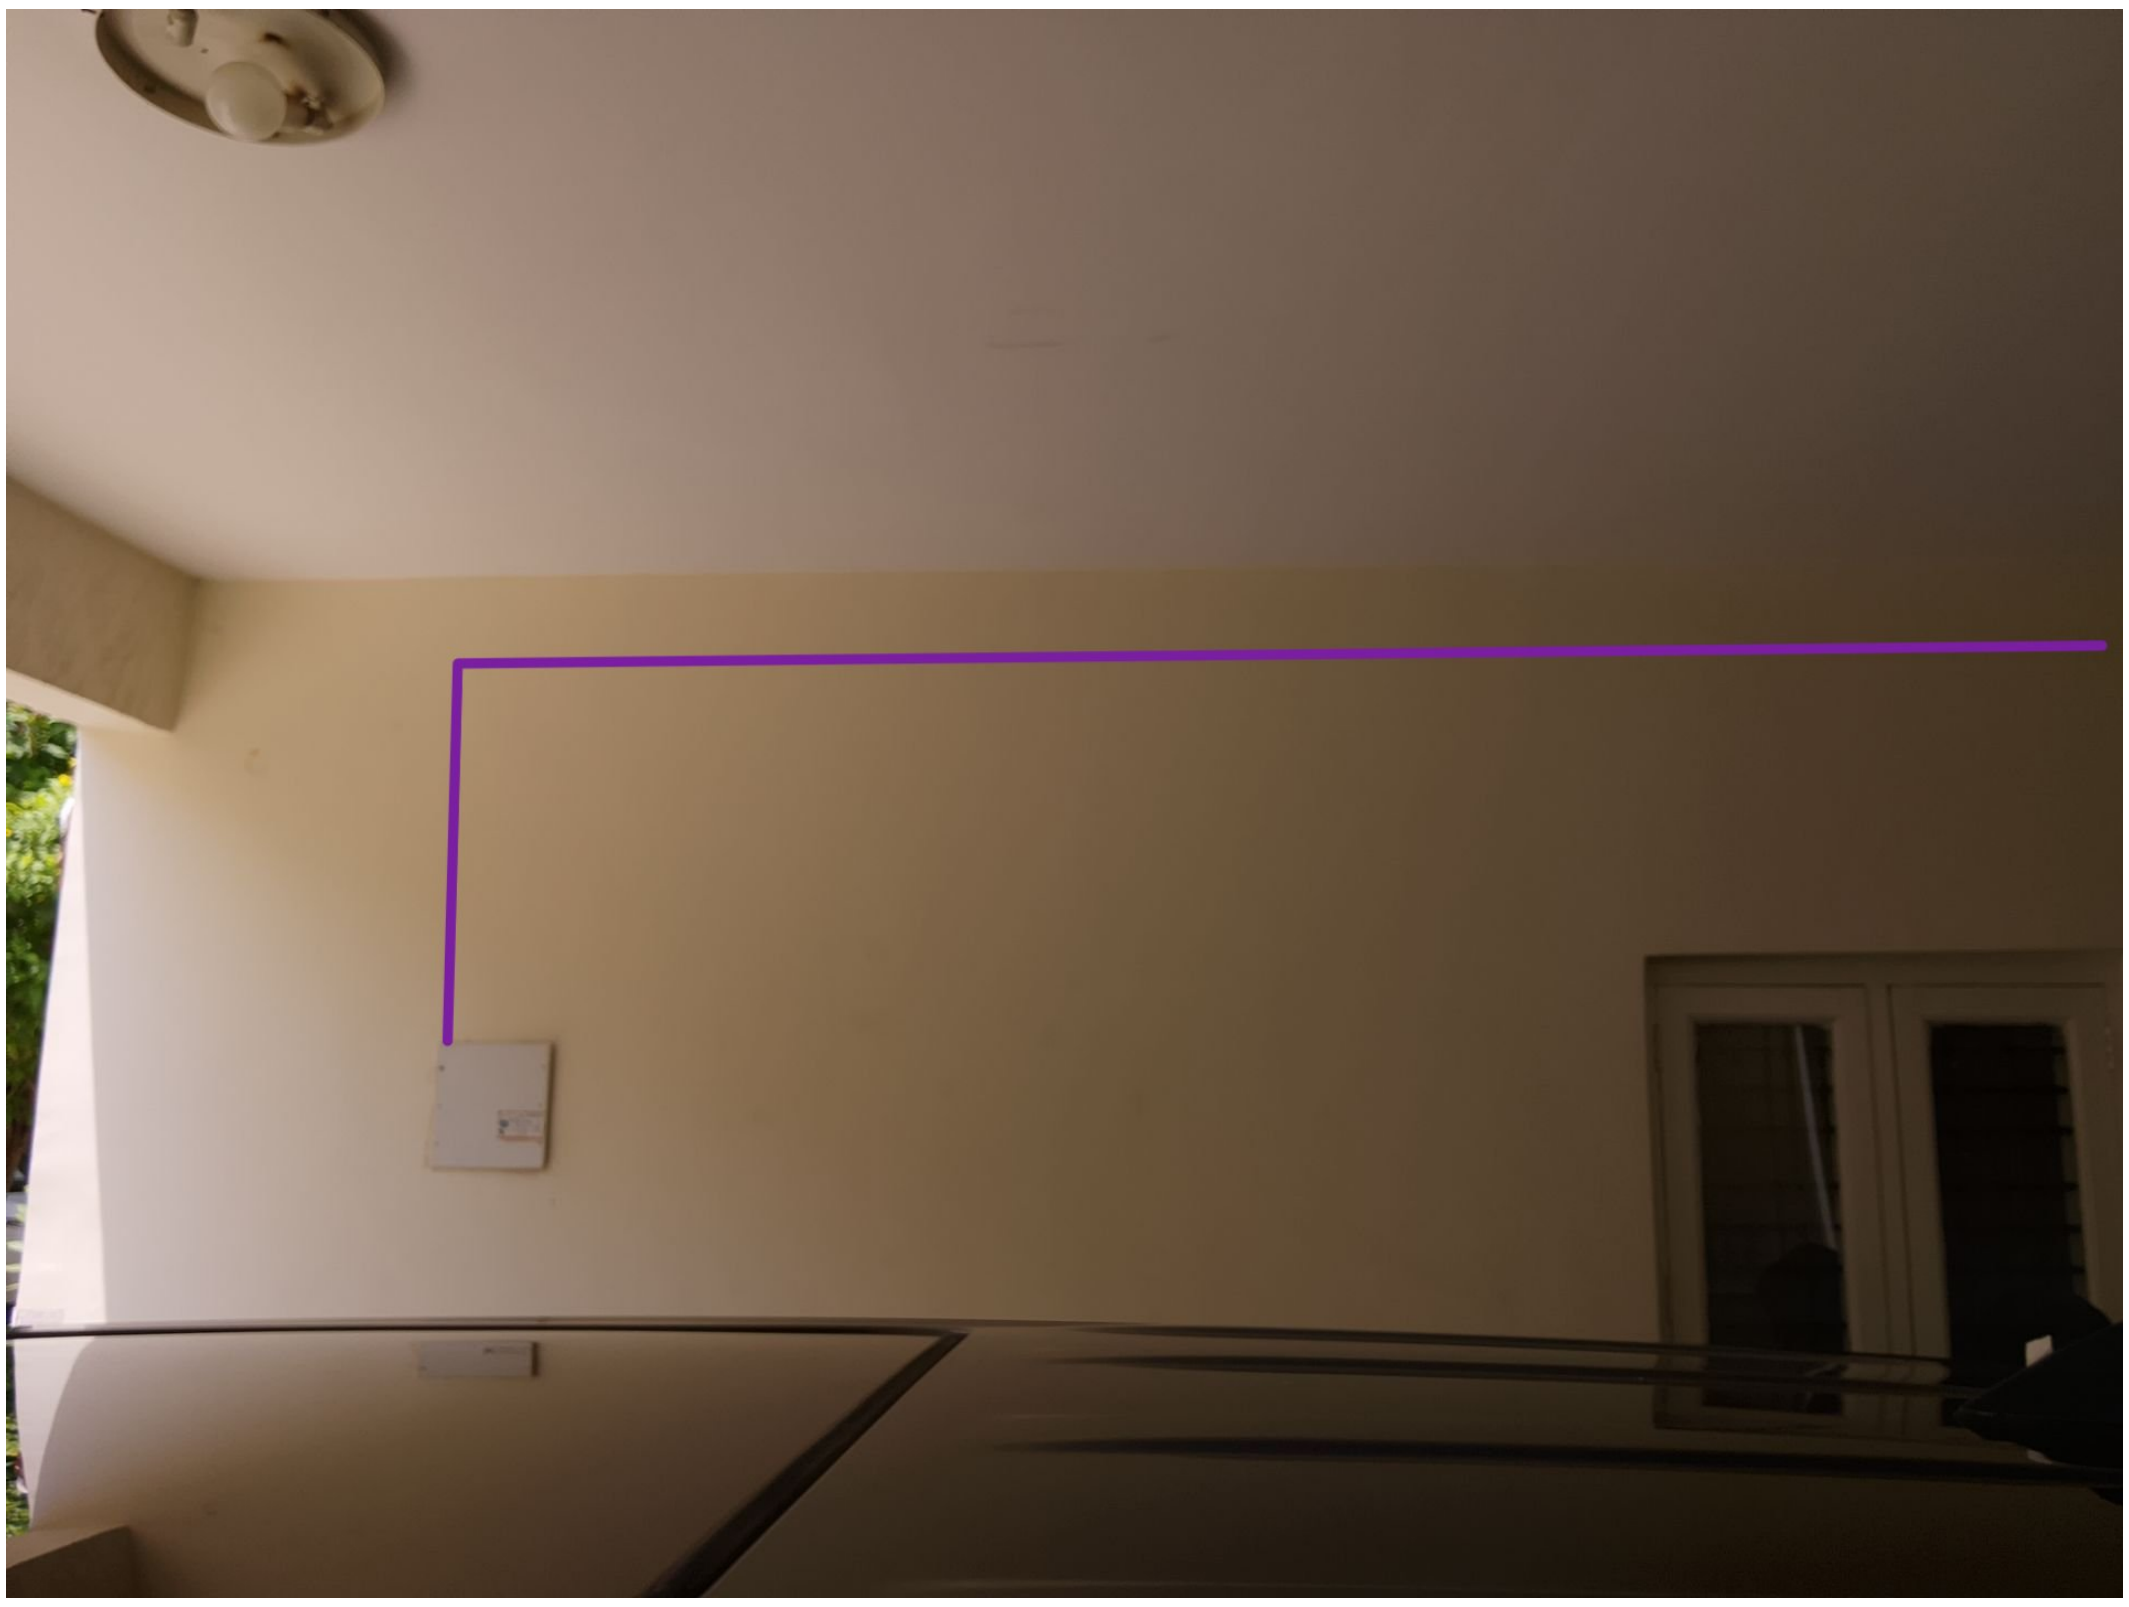

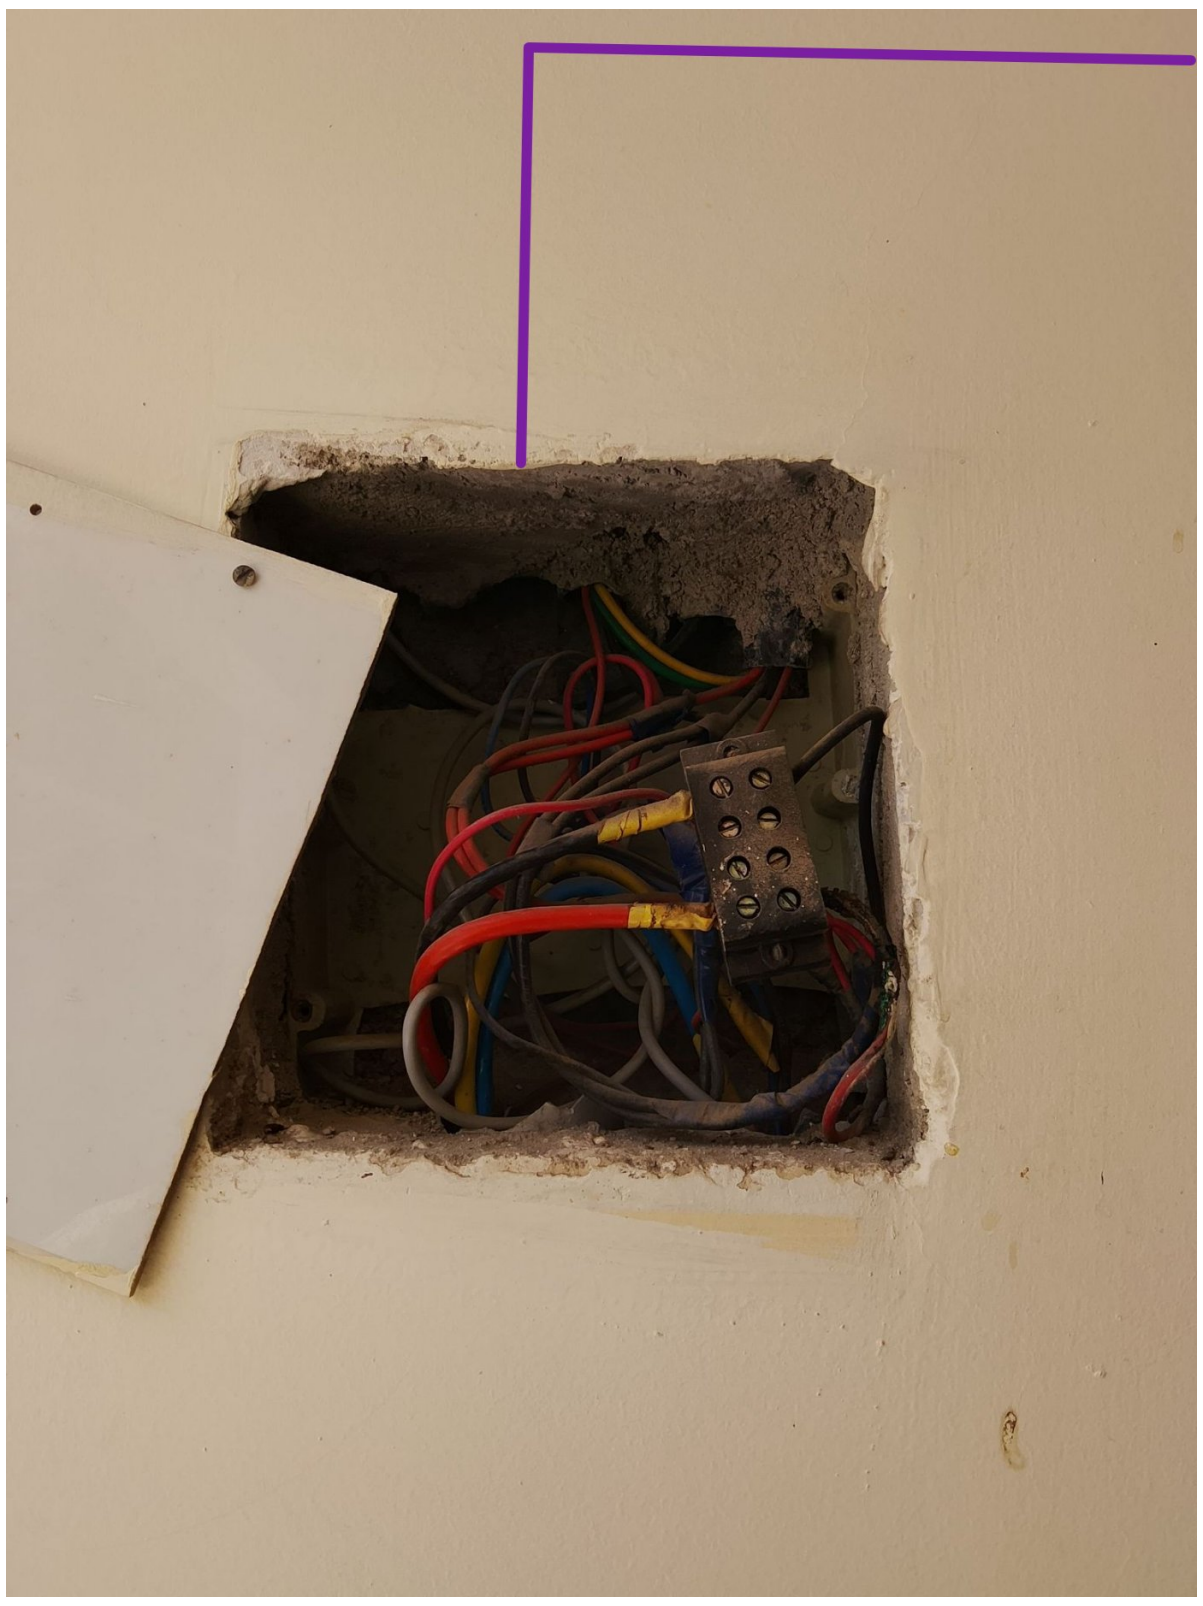

The AC cable has to be terminate in the main distrinution board

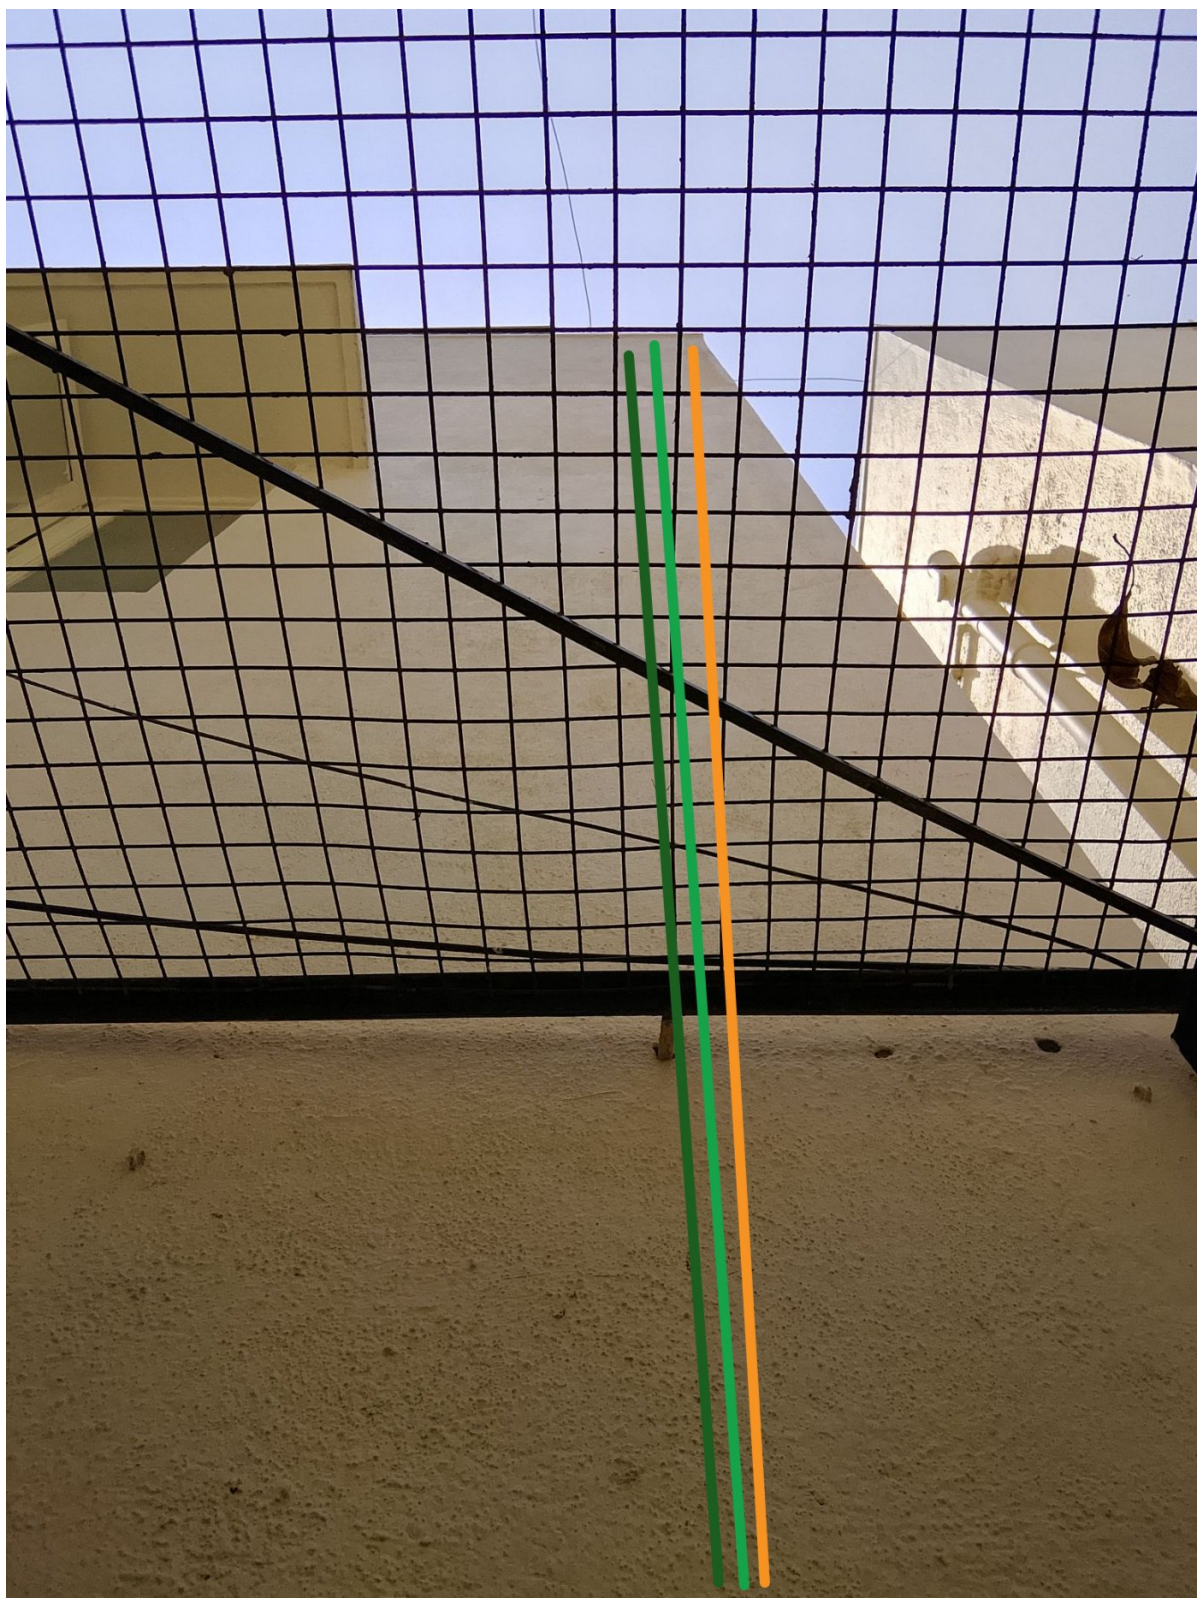

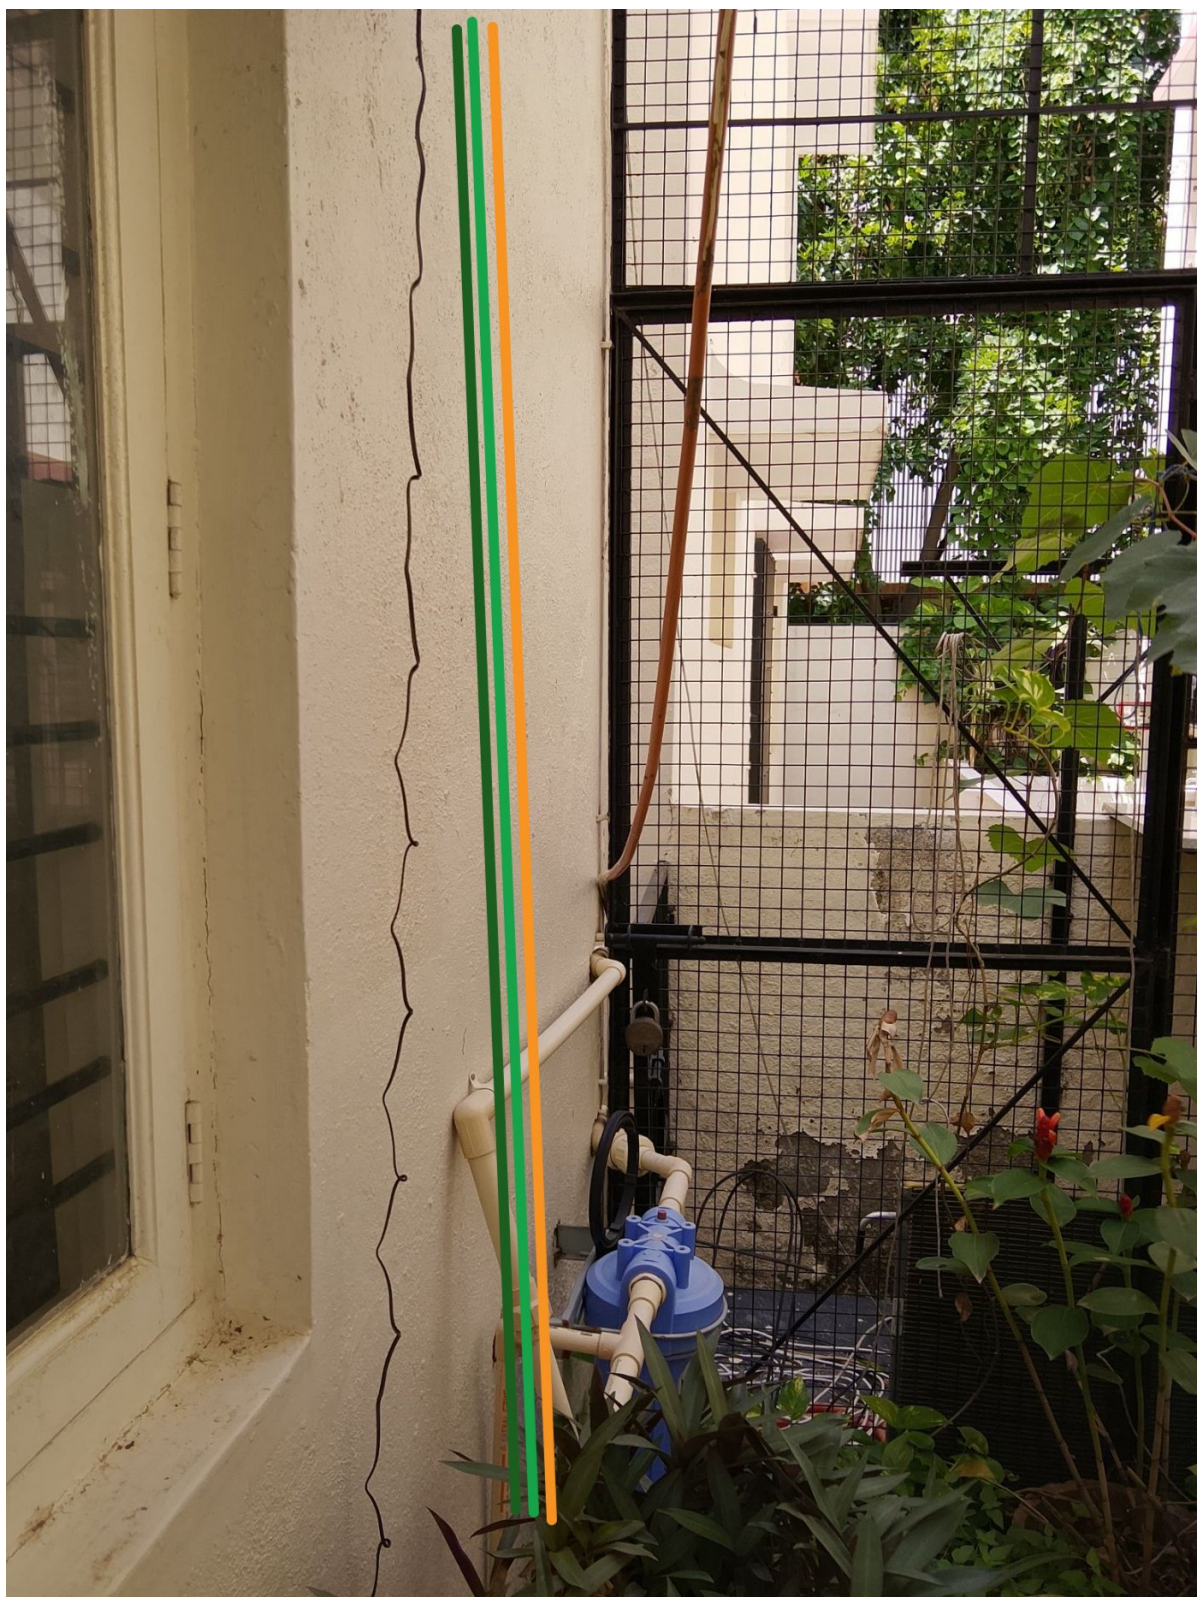

Equipment Location

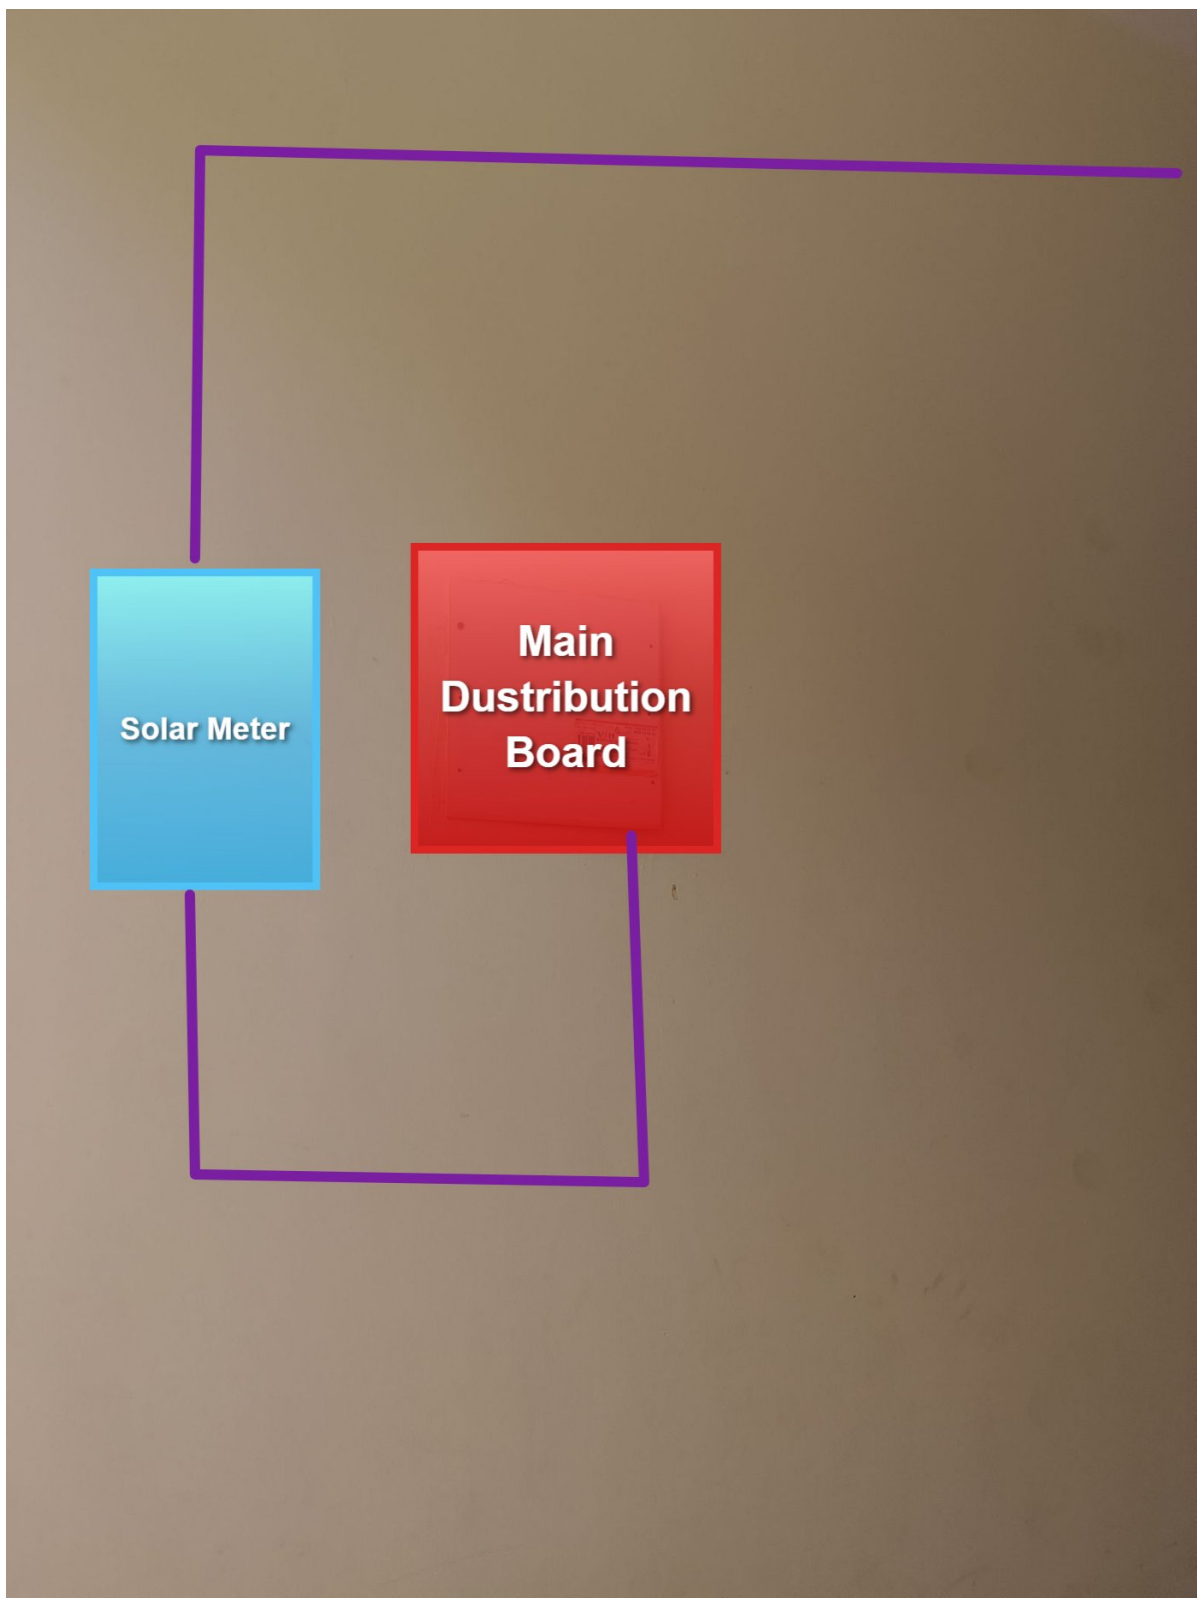

Earth Pit Location

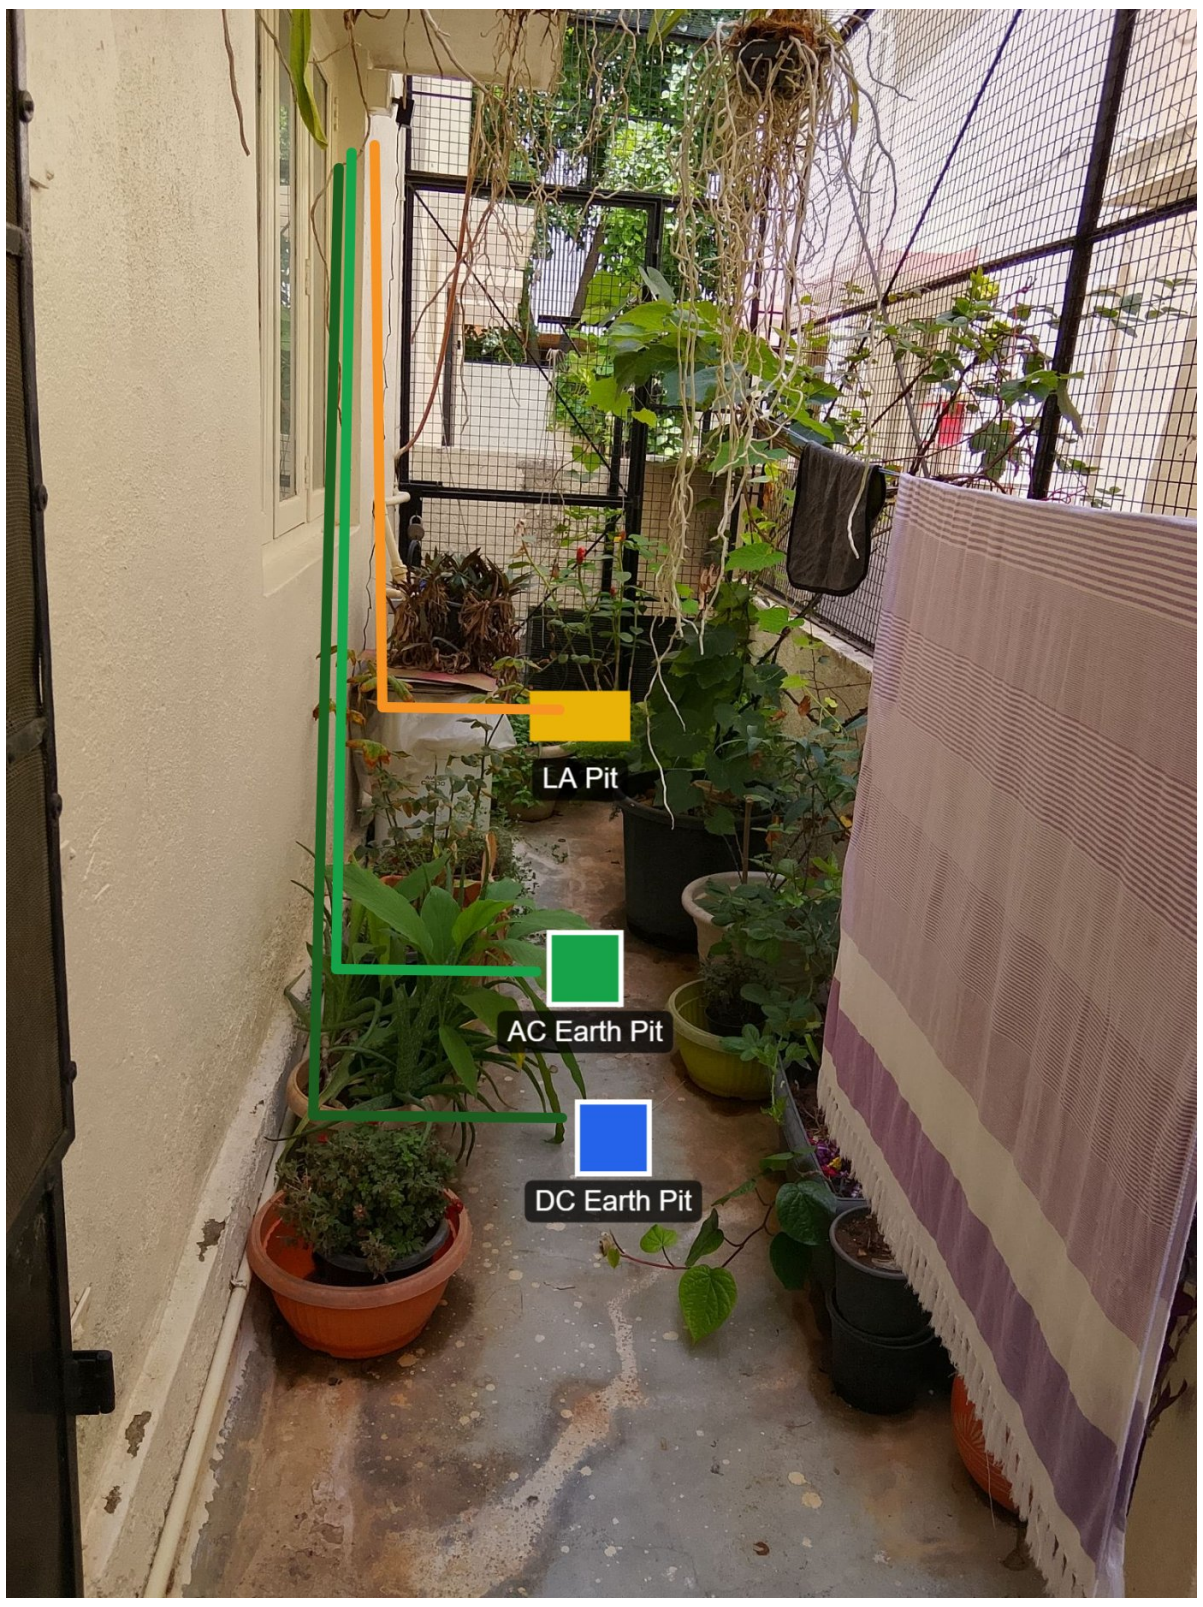

Site Layout - Top View

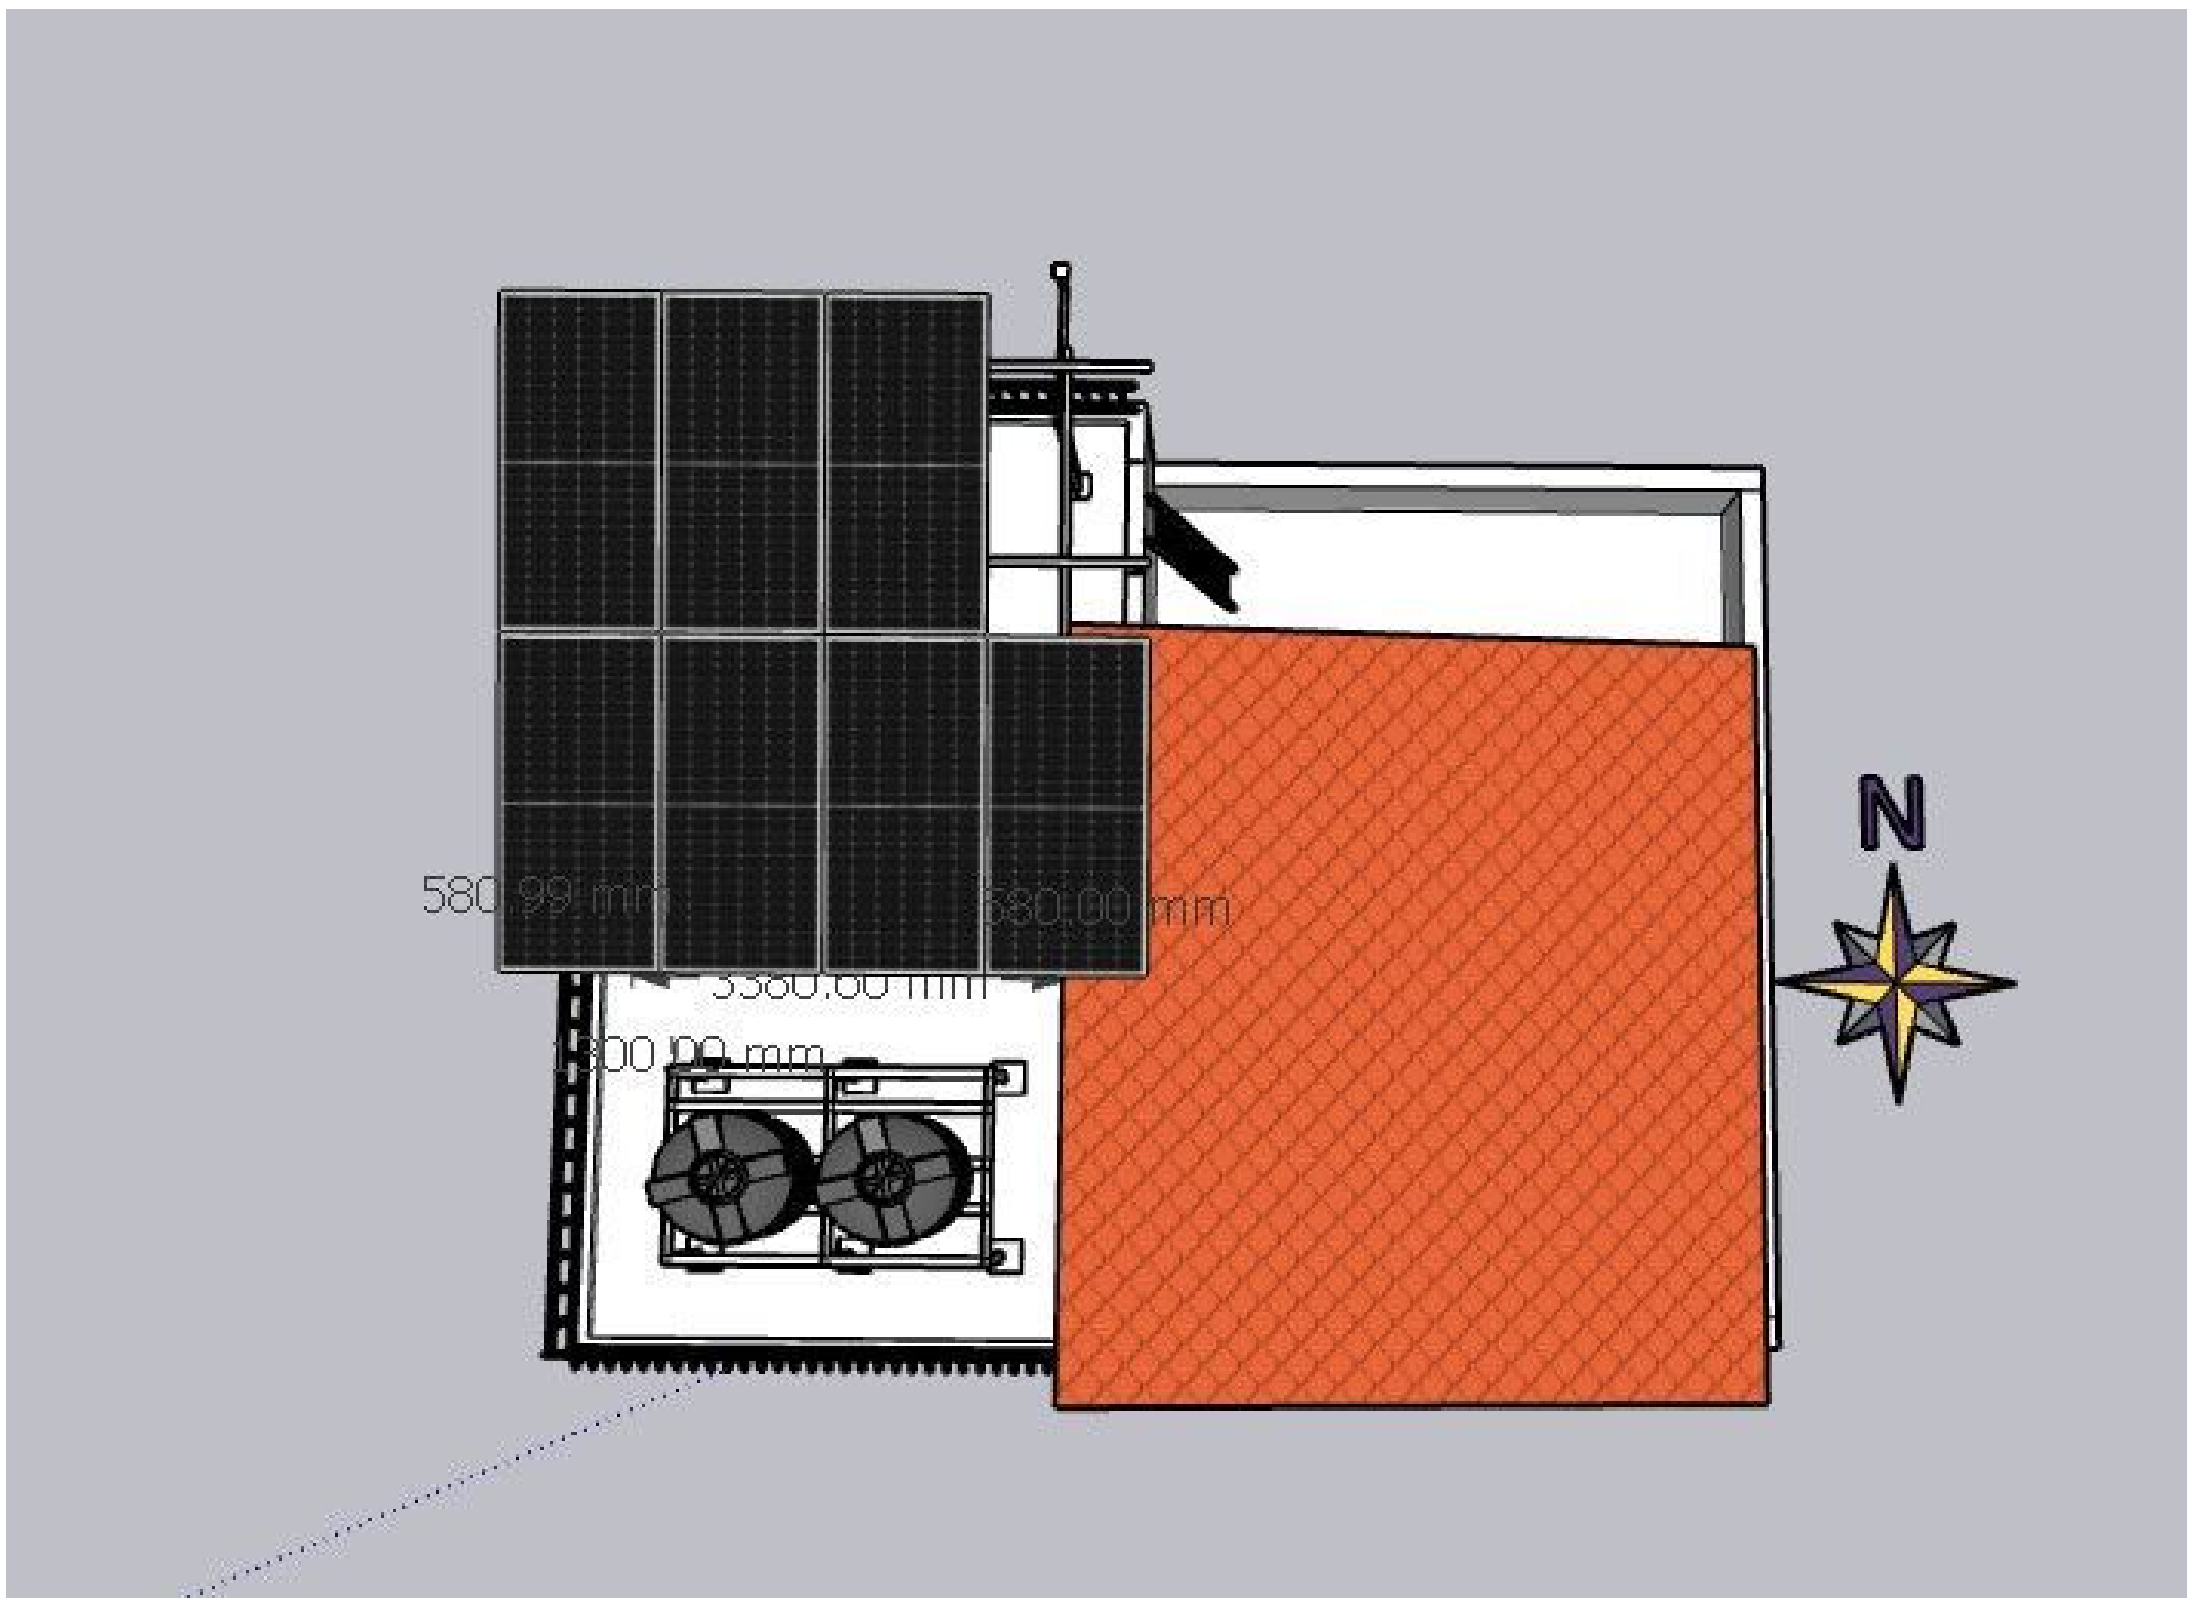

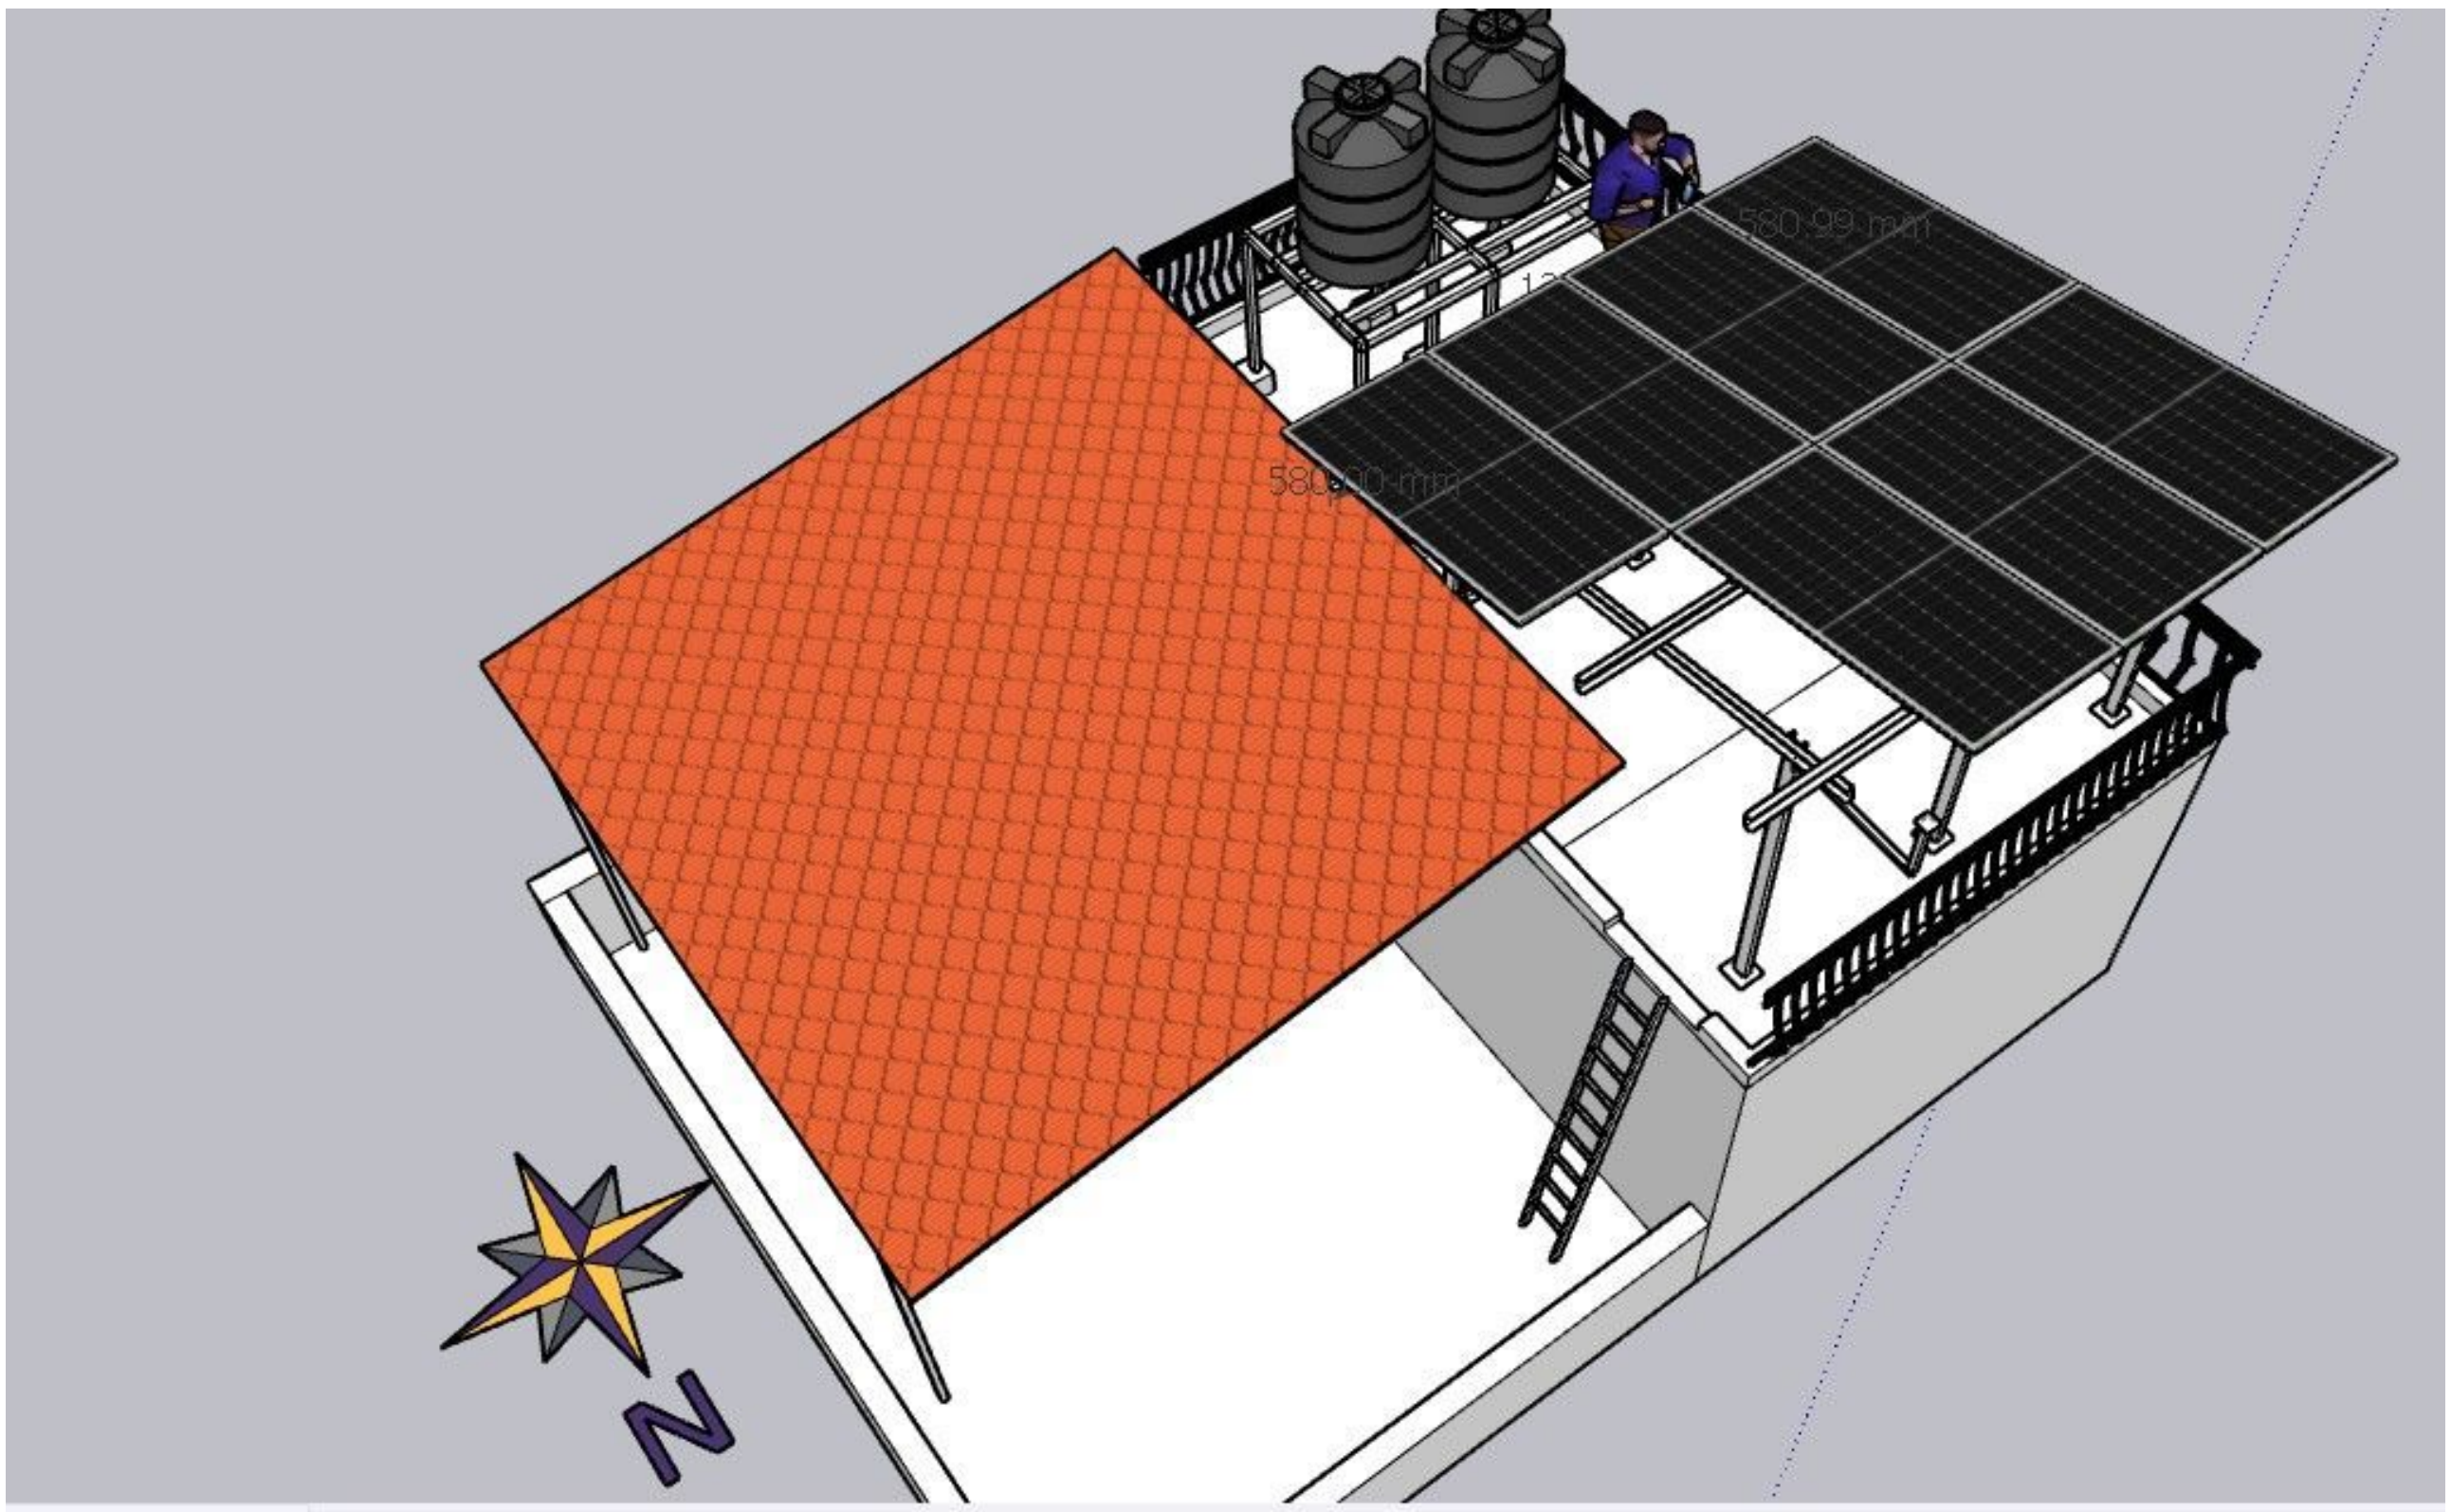

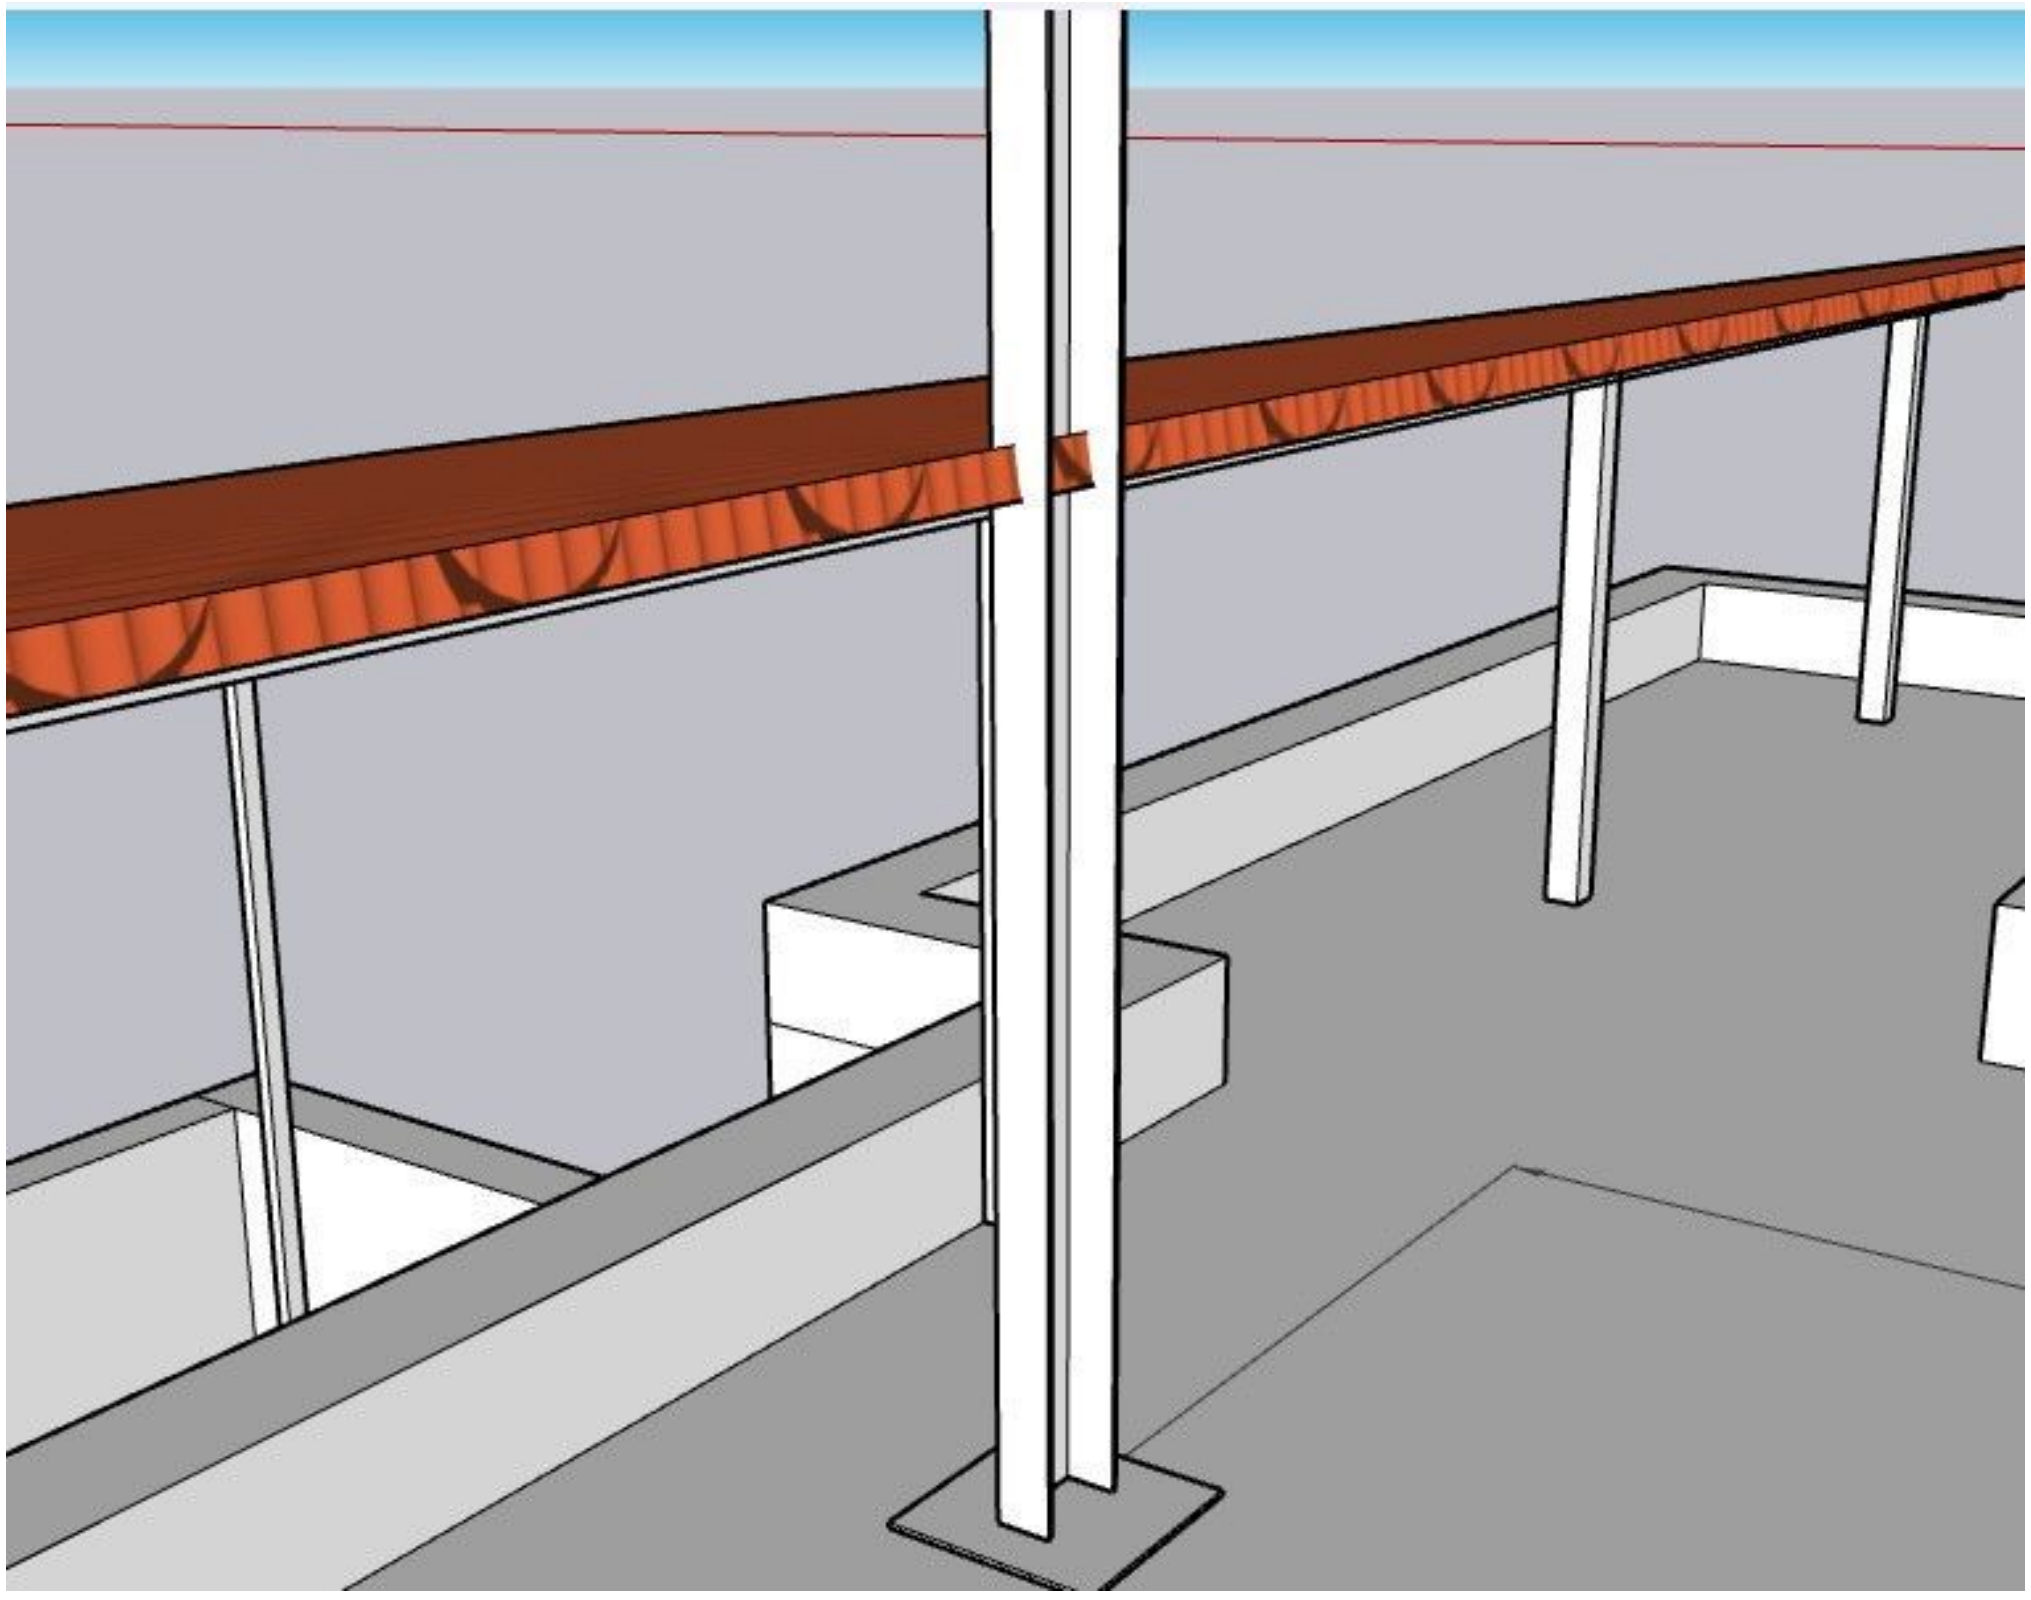

At the time of installation client has to be removed some tiles to avoid installation distrubnces

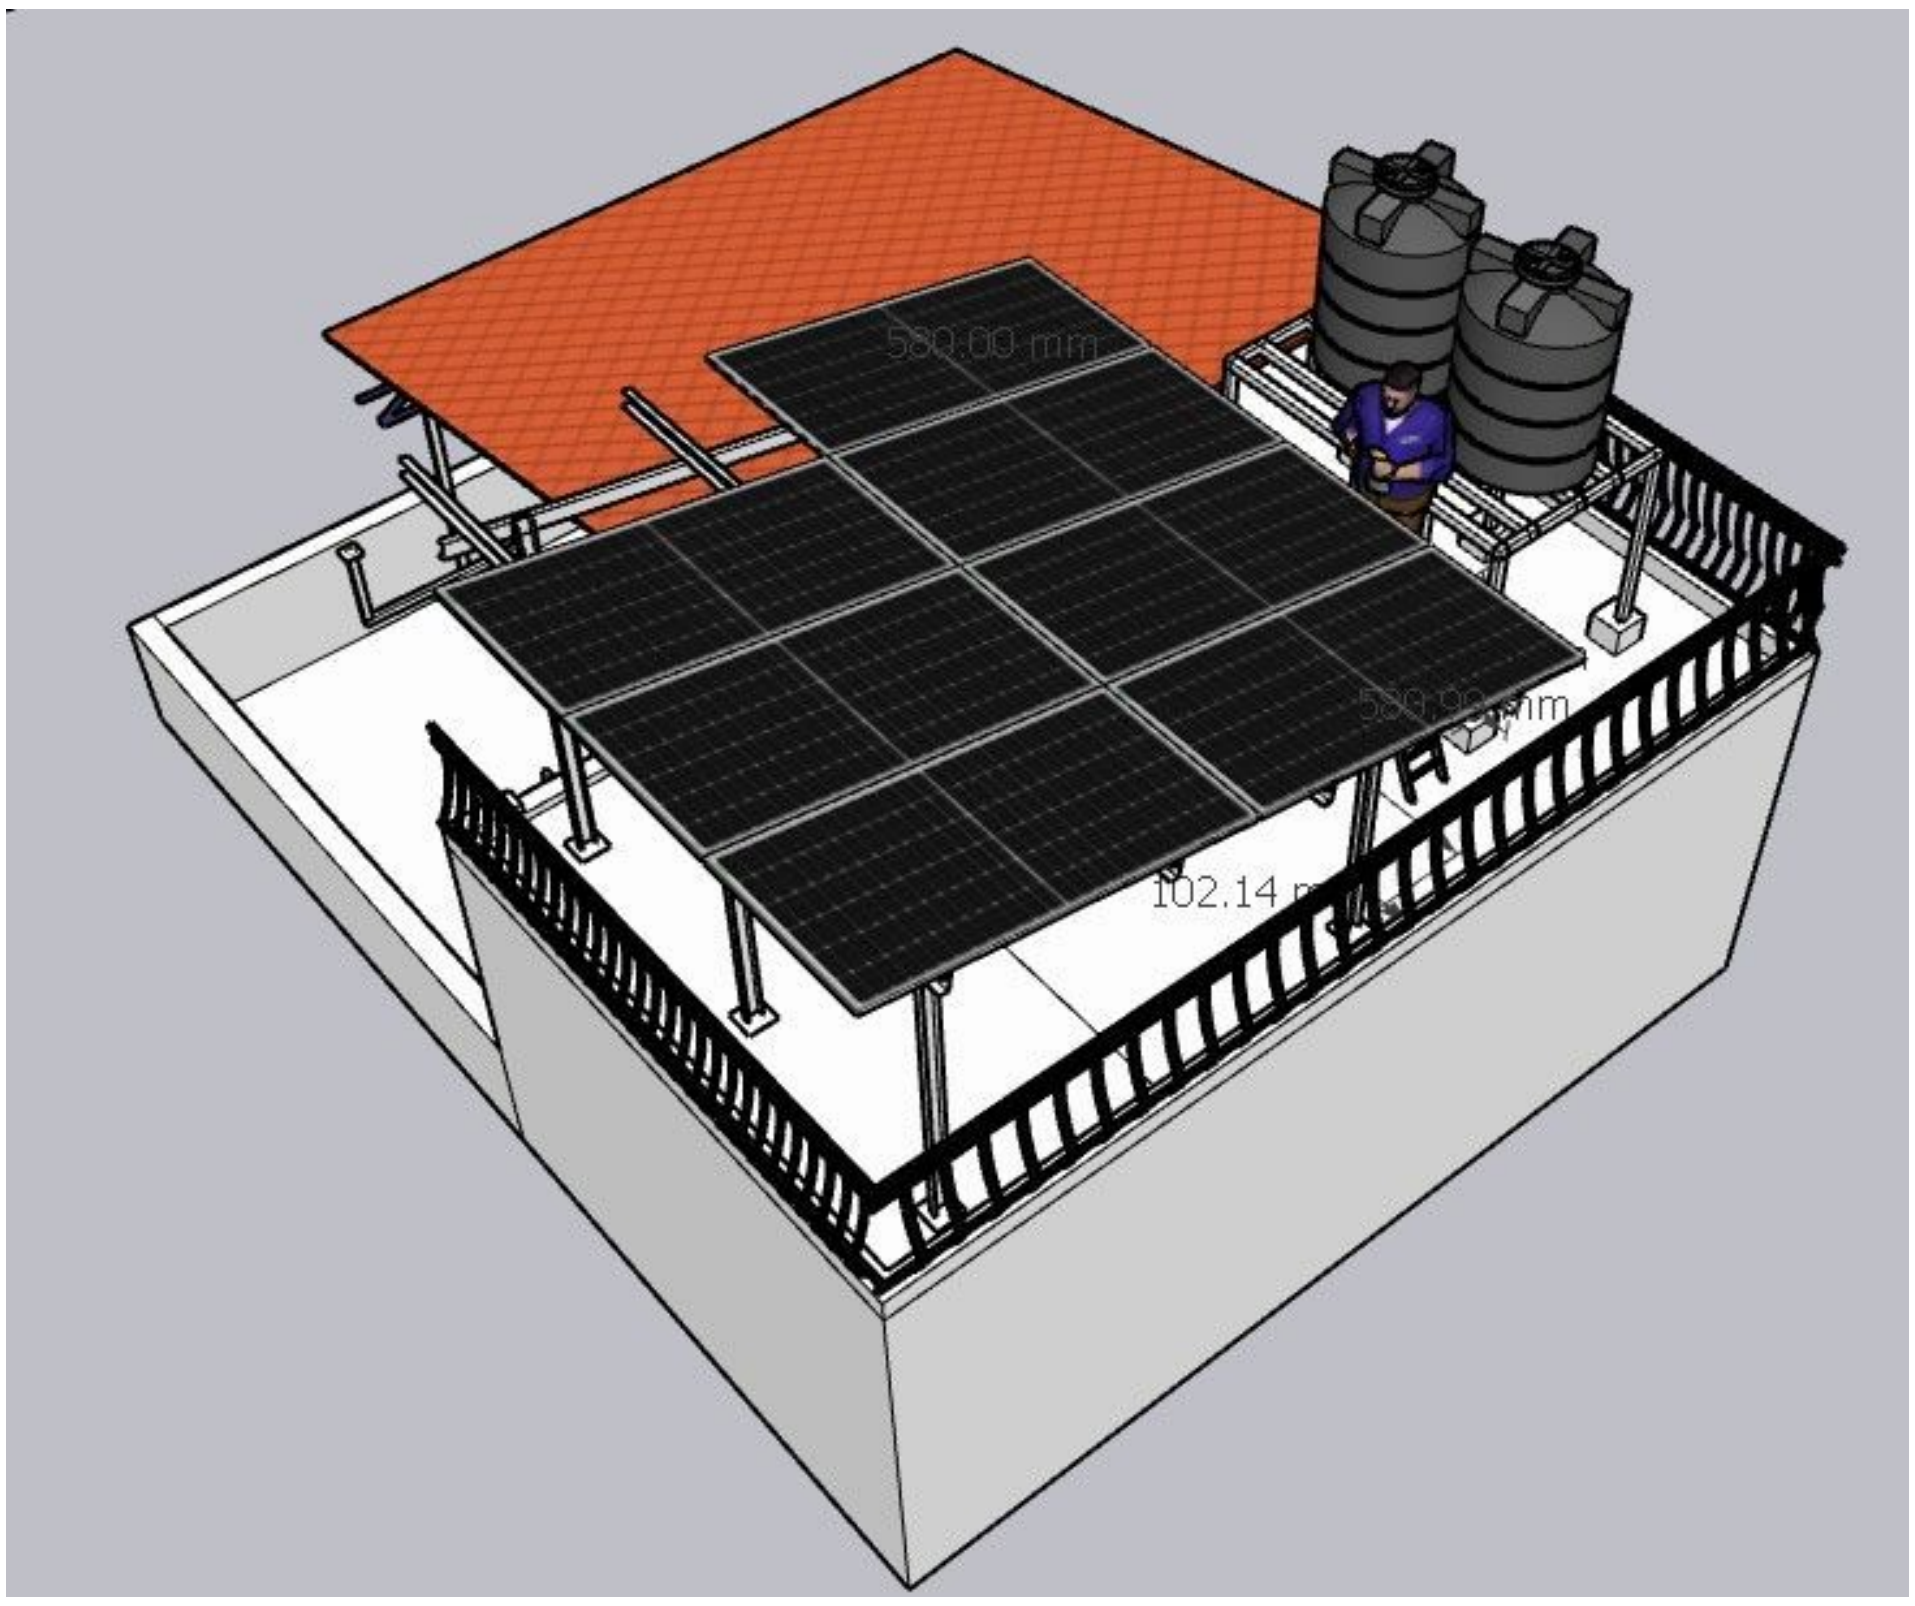

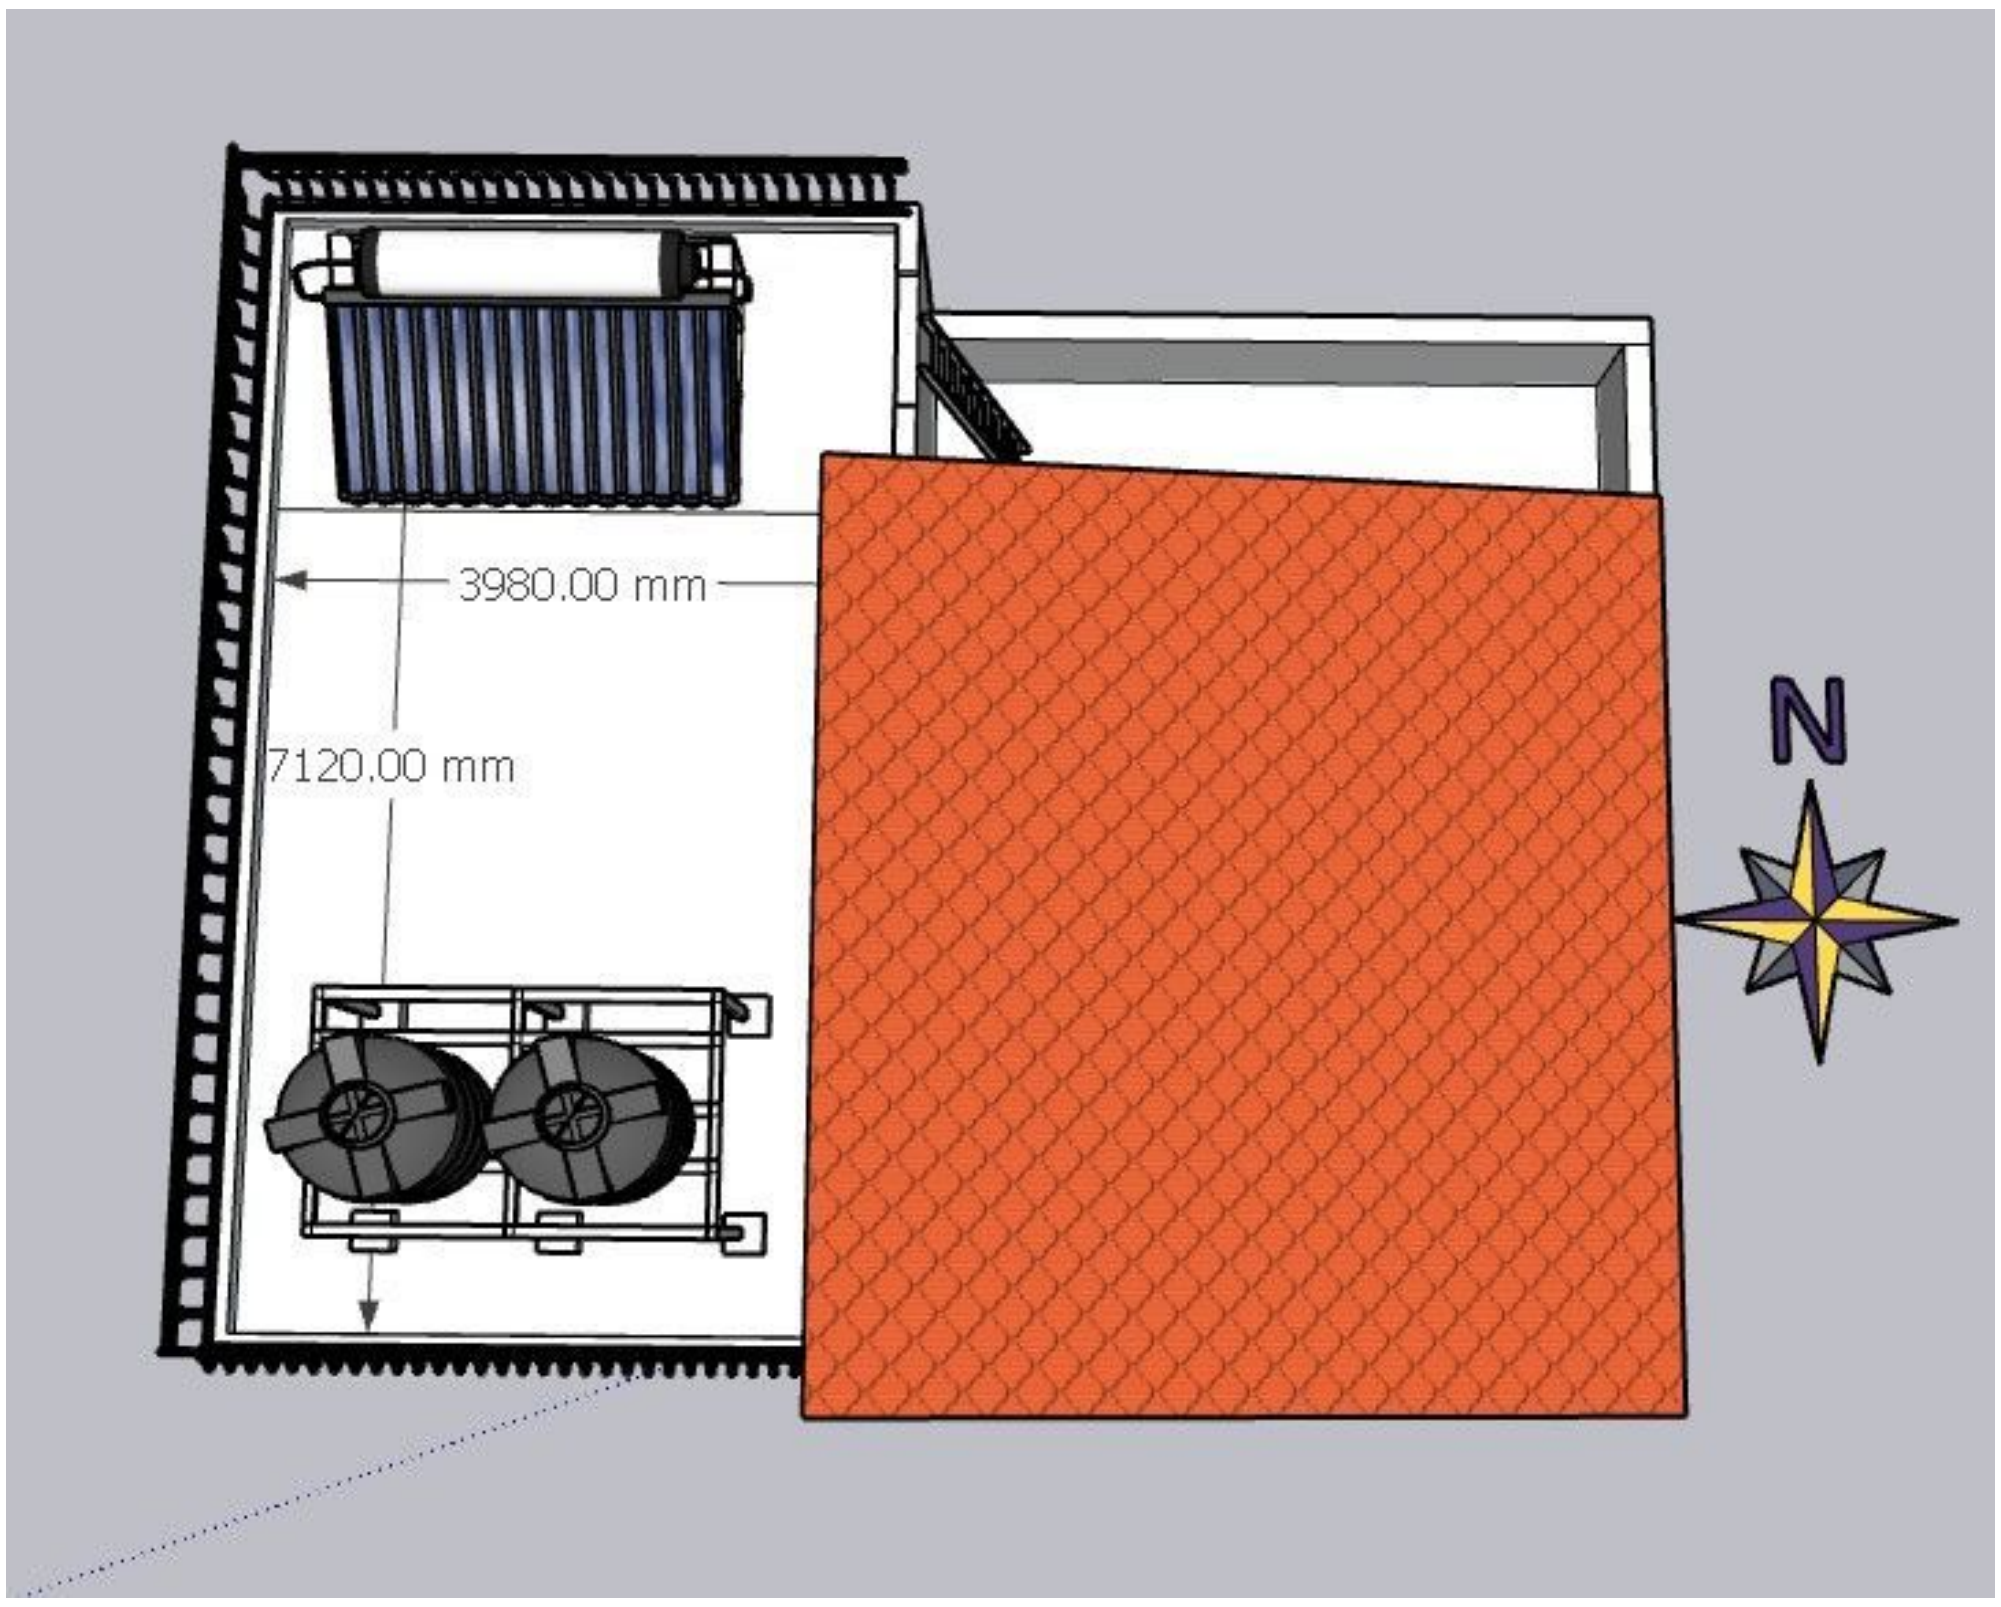

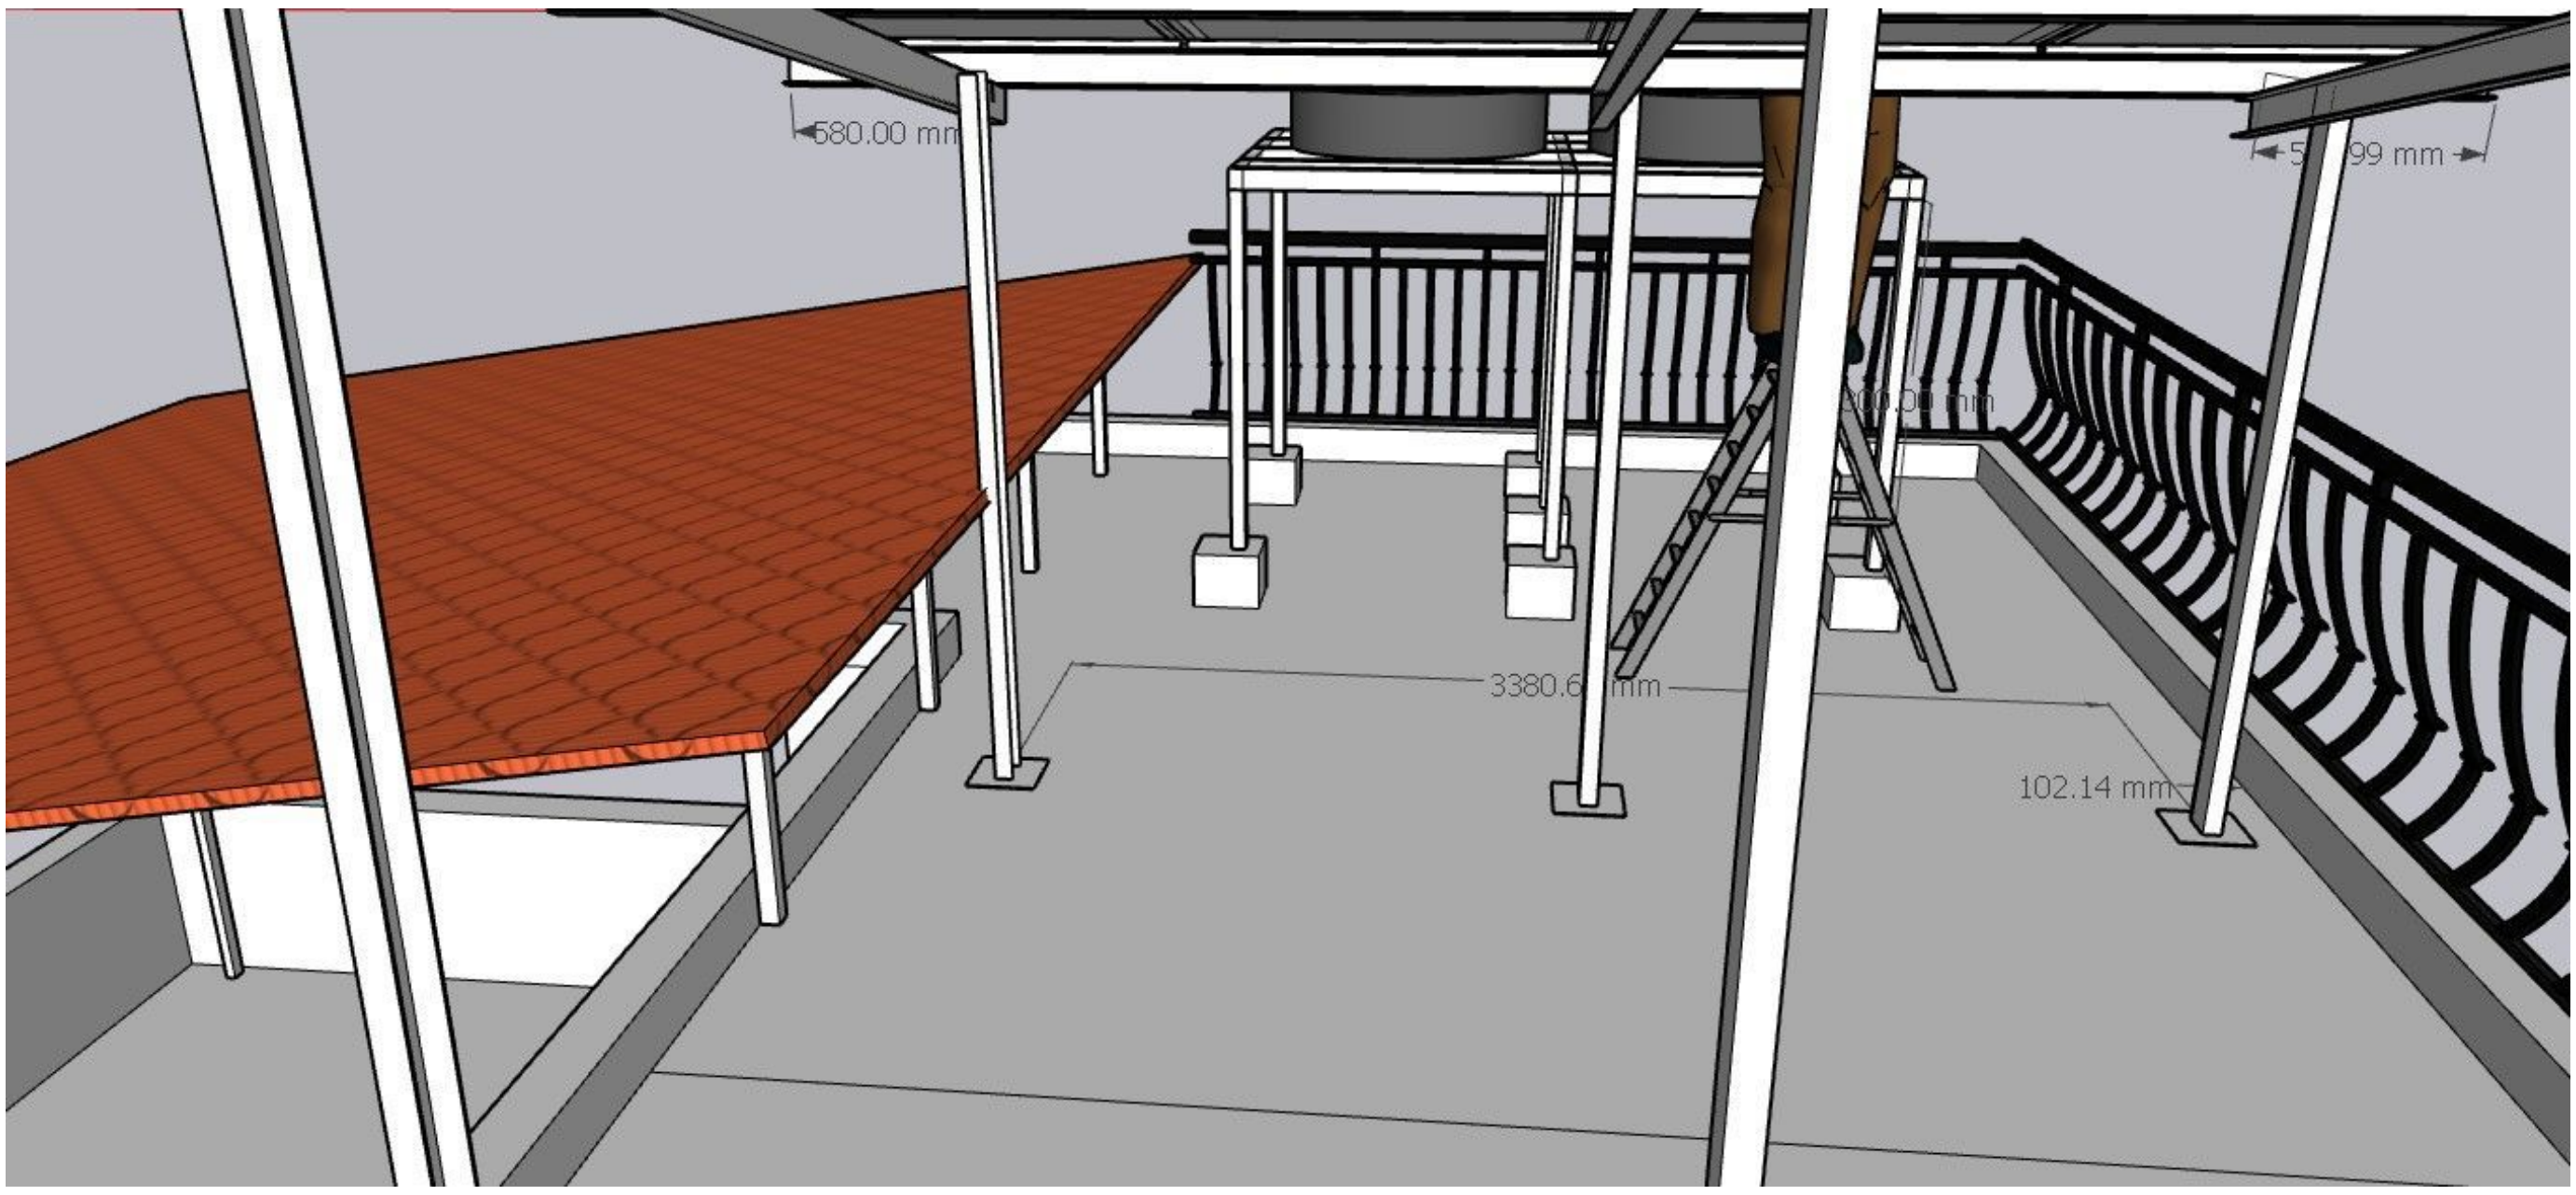

Building Exterior

Shadow Analysis

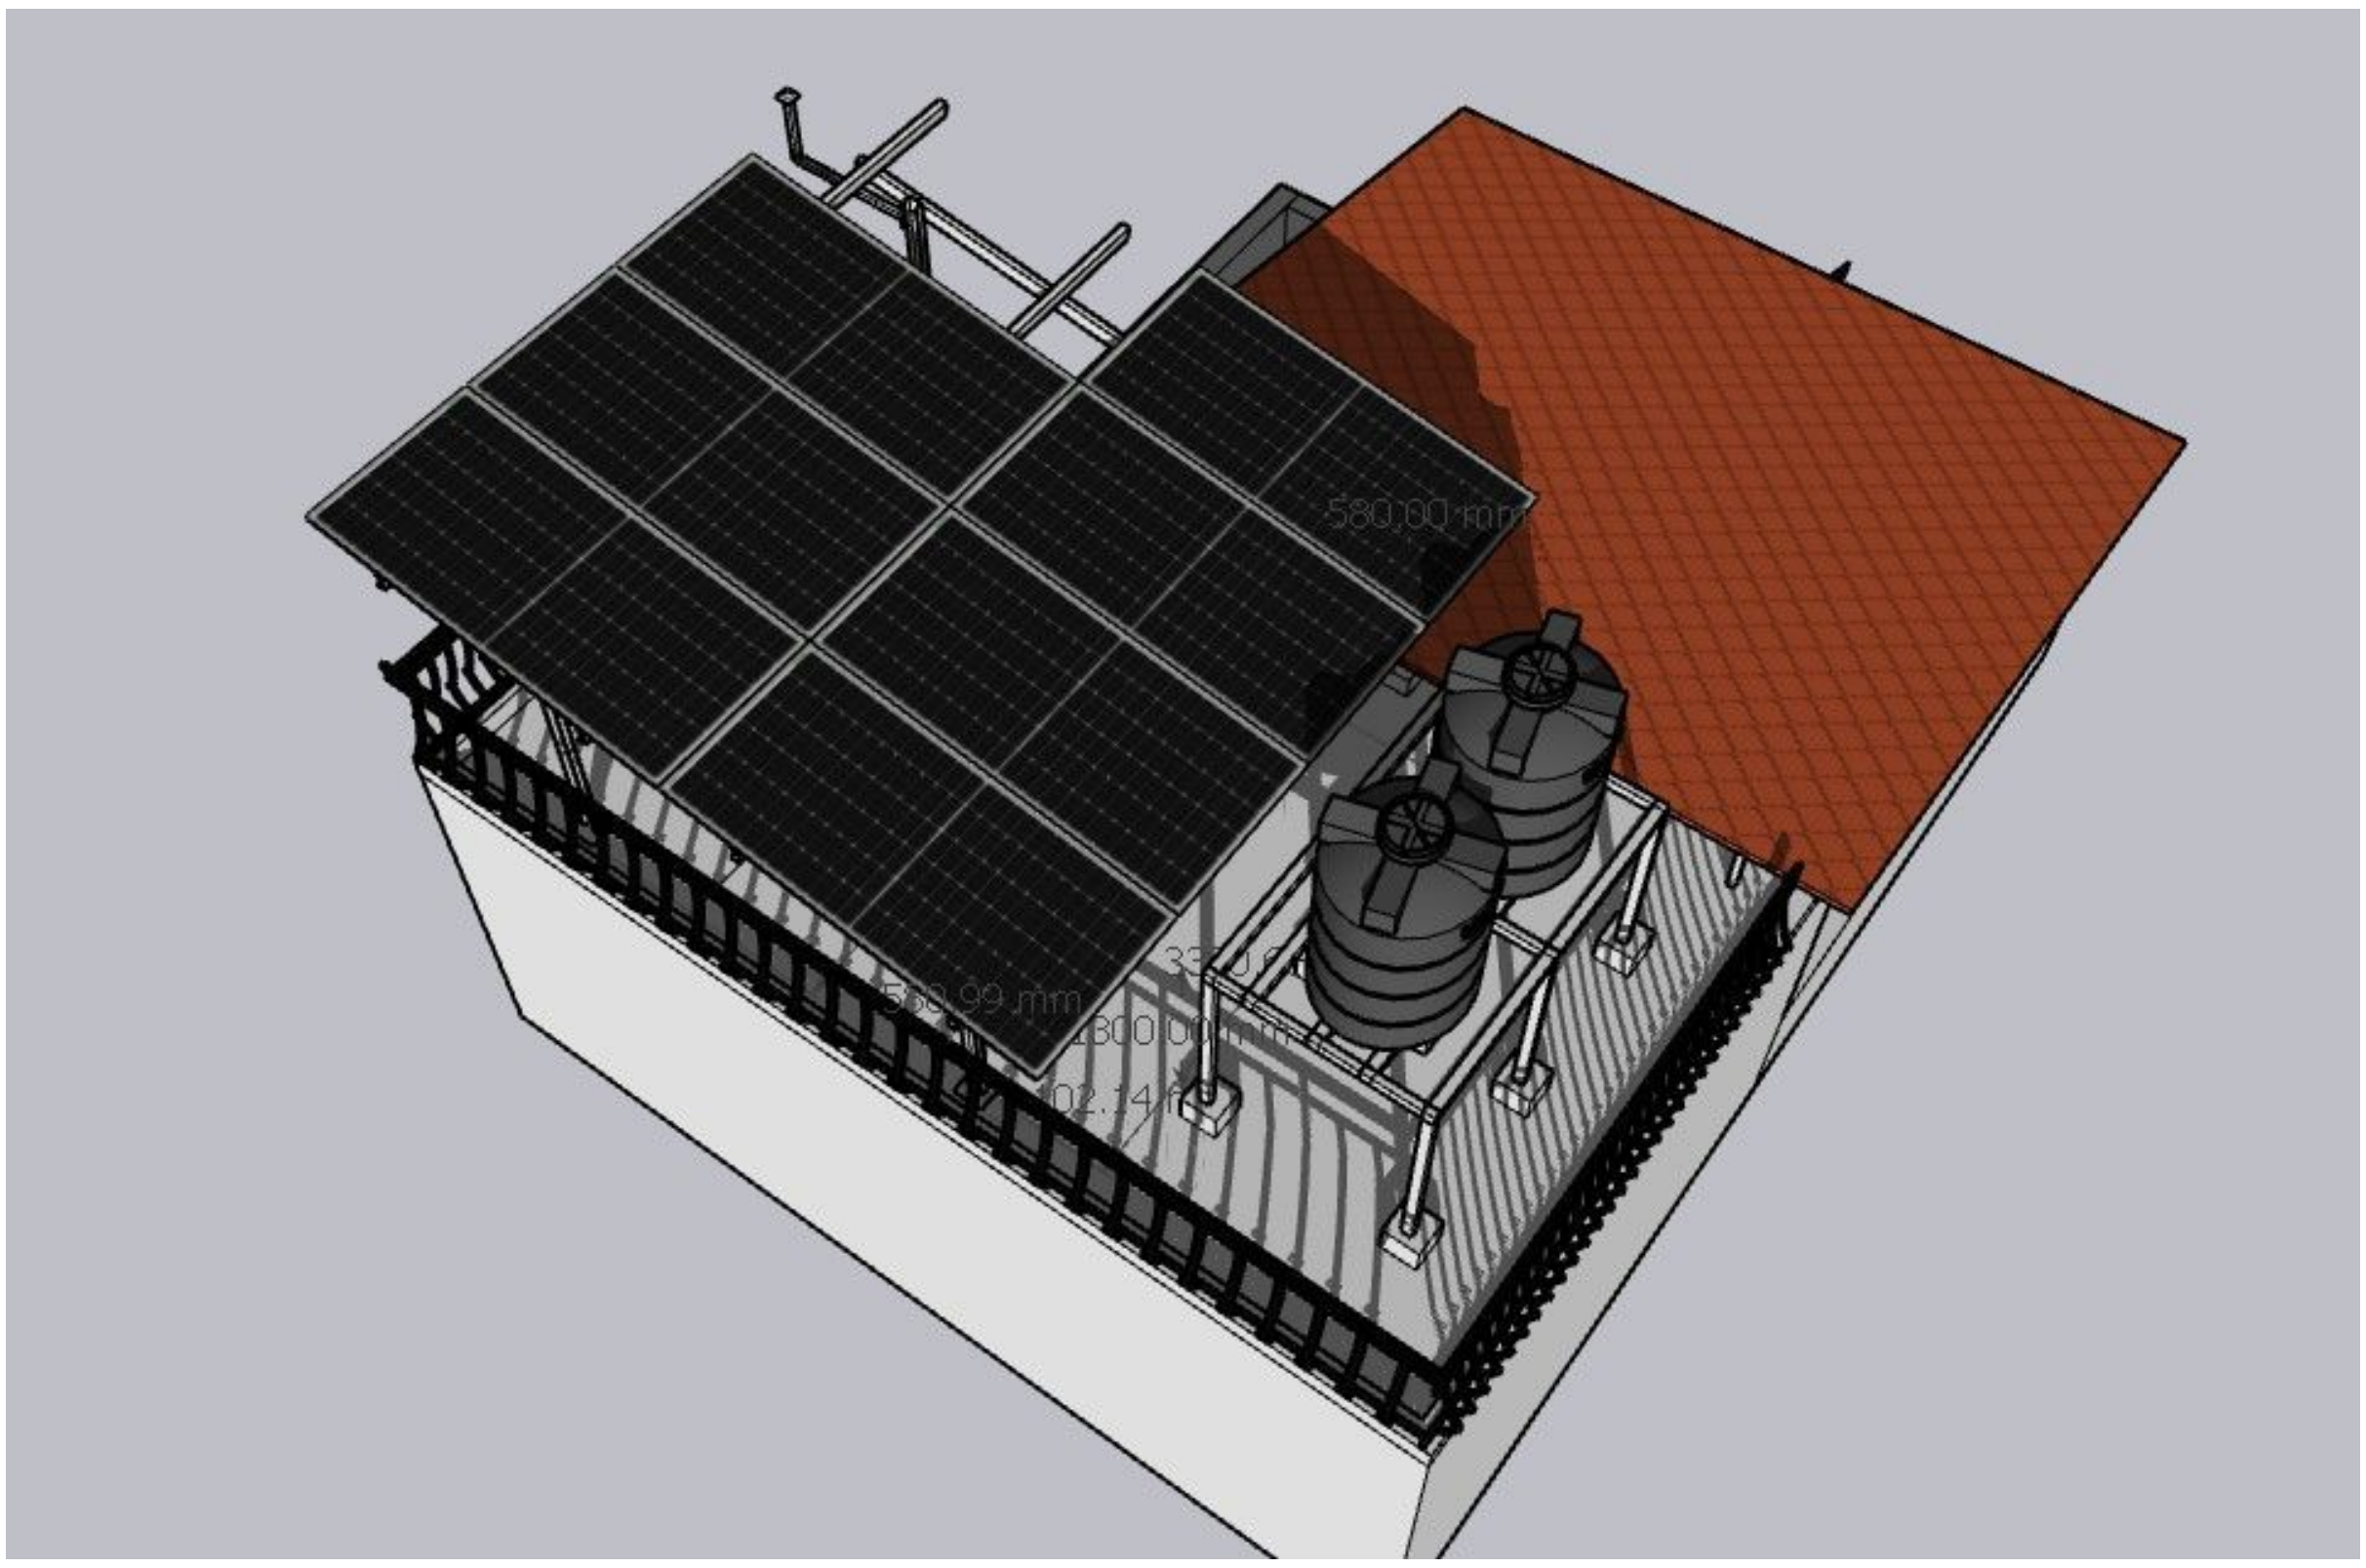

The existing water tank shadow will fall on the panels during the month of May to september between 3.30 PM to 4.00 PM.

OBSERVATIONS & RECOMMENDATIONS

EcoSoch Scope

#	Observation
1	The client main meter is located faraway ,but we have to terminate in main distribution board

Customer Scope

#	Observation
1	Wi-fi up to the inverter location is under customer scope.
2	As per the customer suggestions only the inverter location cable routing and earthing location hasbeen considere
3	At the time of installation client has to be removed some tiles to avoid installation distrubnces
4	Re locate the solar water heater is under customer scope
5	The existing water tank shadow will fall on the panels during the month of May to september between 3.30 PM to 4.00 PM.

THANK YOU

Dear Bomman Sreekumar,

Thank you for choosing EcoSoch Solar for your solar installation. We appreciate your trust in us and your commitment to sustainable energy. Our team is dedicated to ensuring a seamless installation experience and long-term performance of your solar system.

Should you have any questions or require further assistance, please do not hesitate to reach out to us.

Warm Regards,
Team EcoSoch

& Did You Know?

The Sun burns 600 million tonnes of hydrogen per second — and your panels get a share.

EcoSoch Solar Pvt. Ltd.
#940, Sha Arcade, 2nd Phase, NTI Layout, Kodigehalli, Bengaluru 560097
www.ecosoch.com | info@ecosoch.com