Technical Site Visit Report

Prepared for: Pallavi Goel_Chaitanya Samarth_3.075kWp_Microinverter

PROJECT INFORMATION

Report Number	ESV-2026-0196
Project ID	9A021A2C
Project Name	Pallavi Goel_Chaitanya Samarth_3.075kWp_Microinverter
Project Sector	Residential
Project Type	Without Subsidy
Sales Lead	Harsha Kuntur
Site Address	B35, Chaitanya Samarth,Near New Baldwin International School Mandur village, Budigere Main Road, Off: Old Madras Road Bidarhalli, Hobli, Manduru, Karnataka 560049
Visit Date	2026-08-26
Visited By	Charan P
Revision	Rev 0

CLIENT INFORMATION

Client Name	Pallavi Goel
Contact	+973397 40832

PROJECT DETAILS

Solar Rooftop System Type	On-Grid
System Capacity (kWp)	3.075
Sanction Load (kW)	5
Module Make & Capacity	Waaree Bi-facial Non DCR and 615Wp
Module Length (mm)	2382
Module Width (mm)	1134
Number of Panels	5

Inverter Type	Micro
Inverter Brand	Enphase IQ8P
Number of Inverters	5
Mounting Structure Type	Mixed

SITE INSPECTION CHECKLIST

General

#	Question	Answer	Notes
1	Can the delivery van/truck reach the material unloading point?	Yes	-
2	Are there any obstacles at the site that could hinder material lifting?	**No**	-
3	Where will the Inverter, DCDB, ACDB, Battery, etc. be located?	N/A	-
4	Is a canopy required for protecting the Inverters/ACDB/DCDB?	**No**	-
5	Did you discuss the location of the earth pits with the customer?	Earthing is already completed no we are upgrading the system capacity.	-
6	Where is the Internet Router located?	Ground floor	-
7	What's the Wi-Fi strength of the router near to the String inverter/Envoy?	2 bars	-
8	Did you pin the site location in your WhatsApp when you were at the site?	Yes	-

Roof Details

#	Question	Answer	Notes
1	What type of roof is present at the site?	Other	*RCC Slope roof*
2	Are there any obstructions on the roof that could affect the solar installation?	**No**	-
3	What is the angle of the panels? (in degrees)	15	*15 degrees as per the slope*
4	In case of sloped roof, what is the slope angle of the roof? (in degrees)	15	-
5	On how many roofs at the site are we installing solar?	1	-
6	If it is a Tiled roof, what is underneath the tiles?	N/A	-
7	If it is a Tiled roof with MS or Wooden rafters, is it Single-tiled or Double-tiled?	N/A	-
8	What type of mounting structure is planned?	Long rails with L clamps	-
9	What is the orientation of the solar panels?	["South"]	-
10	How can the roof be accessed?	Ladder	-
11	Is the building currently under construction?	**No**	-
12	In an under-construction building, are existing conduit pipes available for AC, DC	N/A	-

#	Question	Answer	Notes
	cables, and earthing?		
13	What is the height of the building and how many floors does it have?	G+1 with 8m	-
14	Is the site photo matching with the building description?	Yes	-
15	Is there an overhead HT line passing within a 10-meter radius of the site?	**No**	-

Residential / Electrical

#	Question	Answer	Notes
1	What type of energy meter is currently installed?	Phase: Single, Type: Digital	-
2	Is the Meter cubicle photo matching with the previous answer?	Yes	-
3	Has the termination point in the Main meter panel been identified?	Yes	-
4	Is the Termination Point easily visible or sealed?	Visible	-
5	Is a Lightning Arrestor (LA) already available at the site?	Yes	-
6	Is space available for CT within Energy meter panel?	**No**	-
7	In case of an Enphase system, is the distance between the farthest micro-inverter and IQ Gateway > 50m?	Less than 50m	-
8	Provide details of the existing CT ratings (if applicable).	N/A	-
9	In Main meter panel, is empty space available for solar meter?	Yes	-
10	In Main meter panel, is empty space available to house the Enphase accessories or ACDB components?	Yes	-
11	Is there space available to dig DC, AC and LA earth pits?	Yes	-
12	In case of elevated structures, is an LA extension provided at the far end?	N/A	-
13	In case of elevated structures, is it with or without grouting?	N/A	-
14	Are there any challenges with respect to Installation and Maintenance activities?	**No**	-
15	Are there any safety risks associated with accessing the roof for installation?	**No**	-
16	Is space present in rooftop to store the panels?	Horizontally sleeping	-
17	In case of sloped roof MS structure, provide the dimension of rafter to rafter, purlin to purlin.	N/A	-
18	Is ventilation available in the battery location?	N/A	-
19	Should the Inverters/ACDB/DCDB be installed on a metal grill or wall mount?	N/A	-
20	Provide the dimensions for solar meter cubicle placement (L x W of wall).	length: 500, width: 500	*Sufficient space is available in the existing panel board.*
21	Provide the dimension for earth pits location (L x W of available space).	N/A	-
22	Is LAN cable under customer scope?	N/A	-
23	Is there any shadow that affects the solar installation?	**No**	-
24	Is there any trench work to be done to carry the AC cable to the meter location?	**No**	-

PHOTO DOCUMENTATION

Cable Routing Legend

Legend	Description
	Proposed PV Module Array
	Main Meter Location
	Solar Meter
	Battery
	Inverter
	Other Equipment
	DC Cable
	AC Cable
	Material Shifting
	DC Earthing Cable
	AC Earthing Cable
	LA Cable
	DC Earth Pit
	AC Earth Pit
	LA Pit
	LA

Site Layout

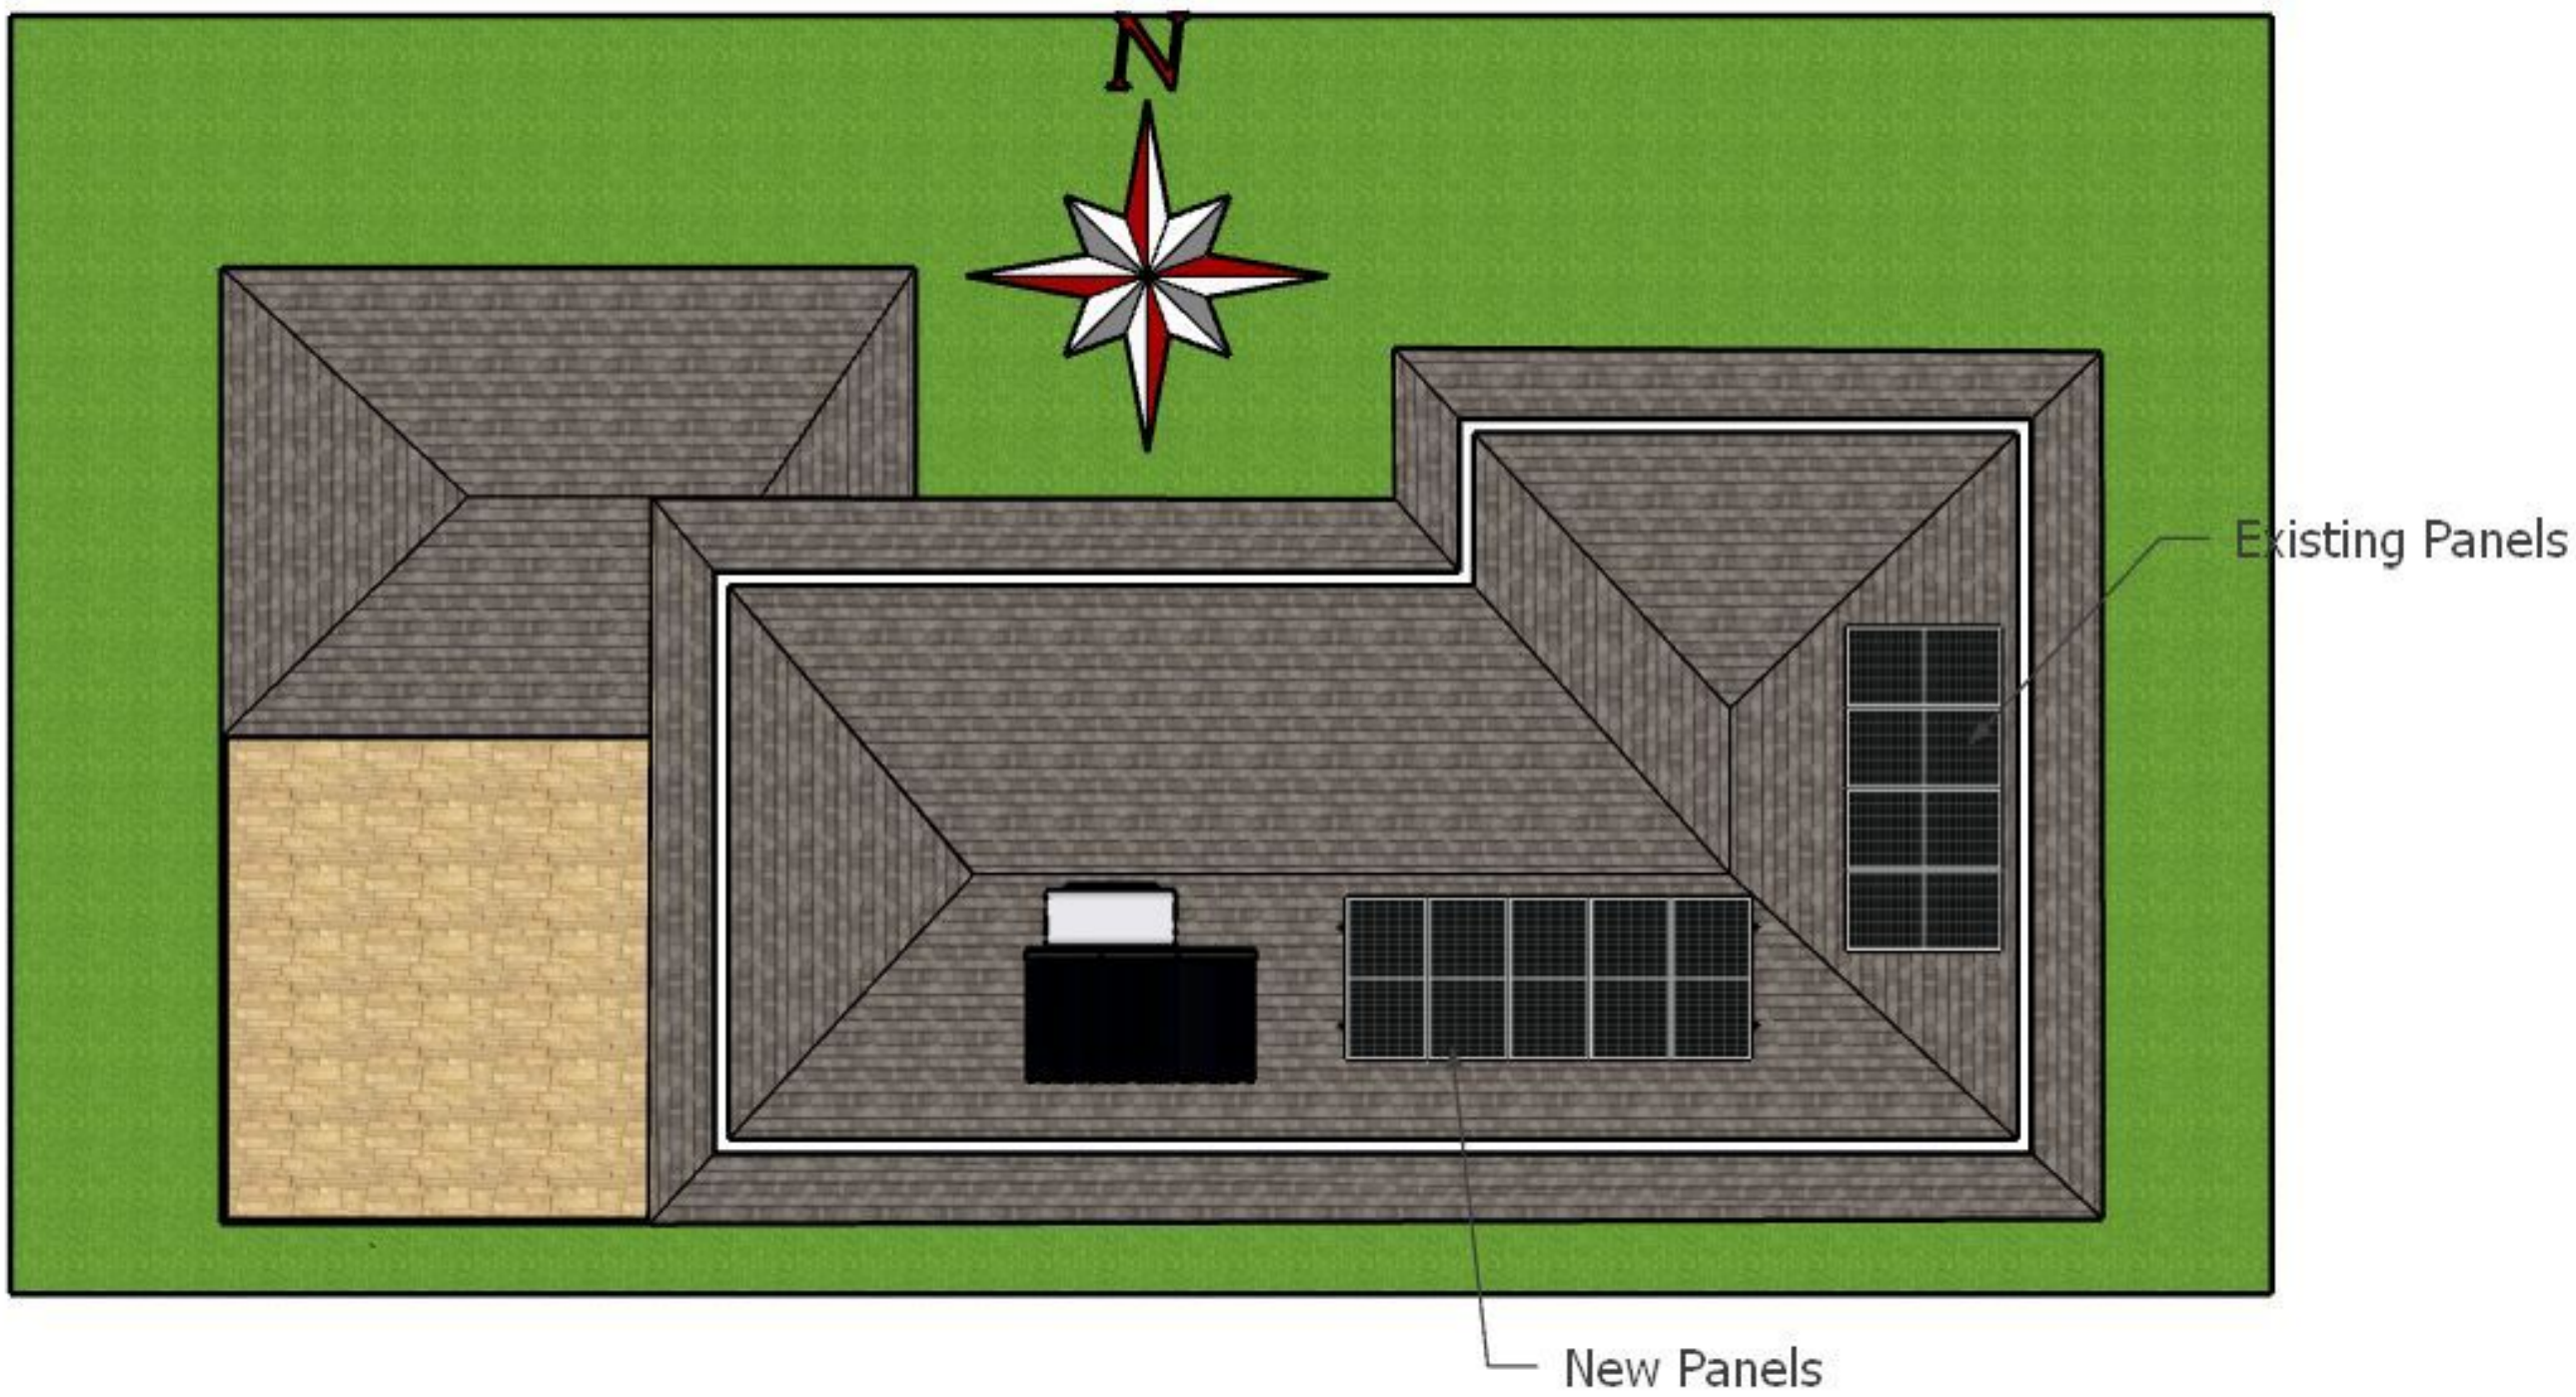
N
Existing Panels
New Panels

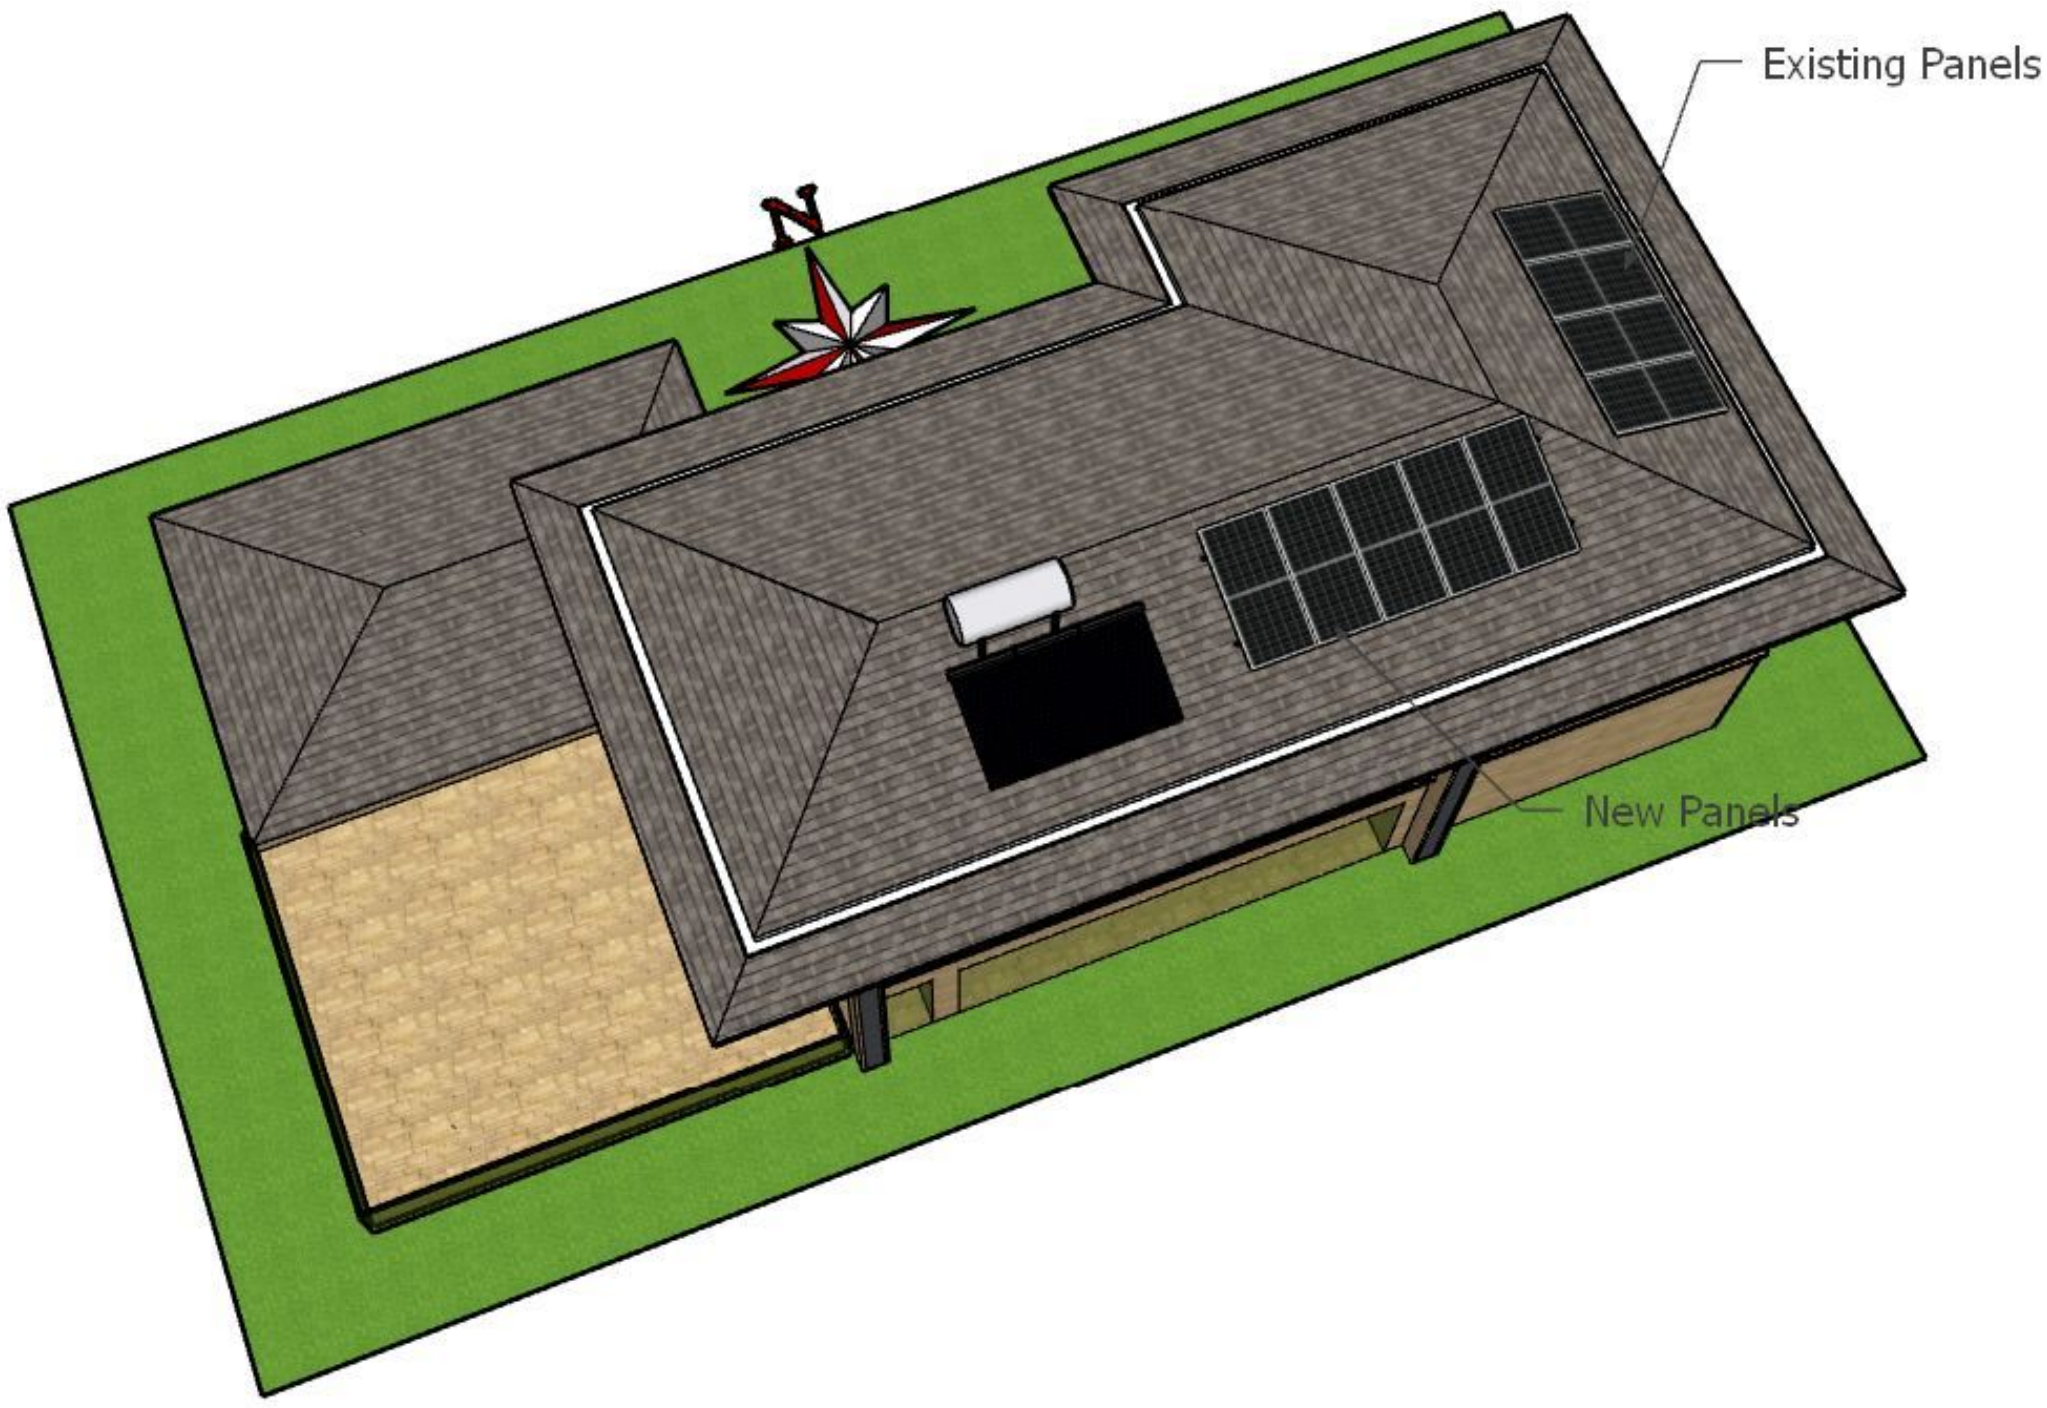
N
Existing Panels
New Panels

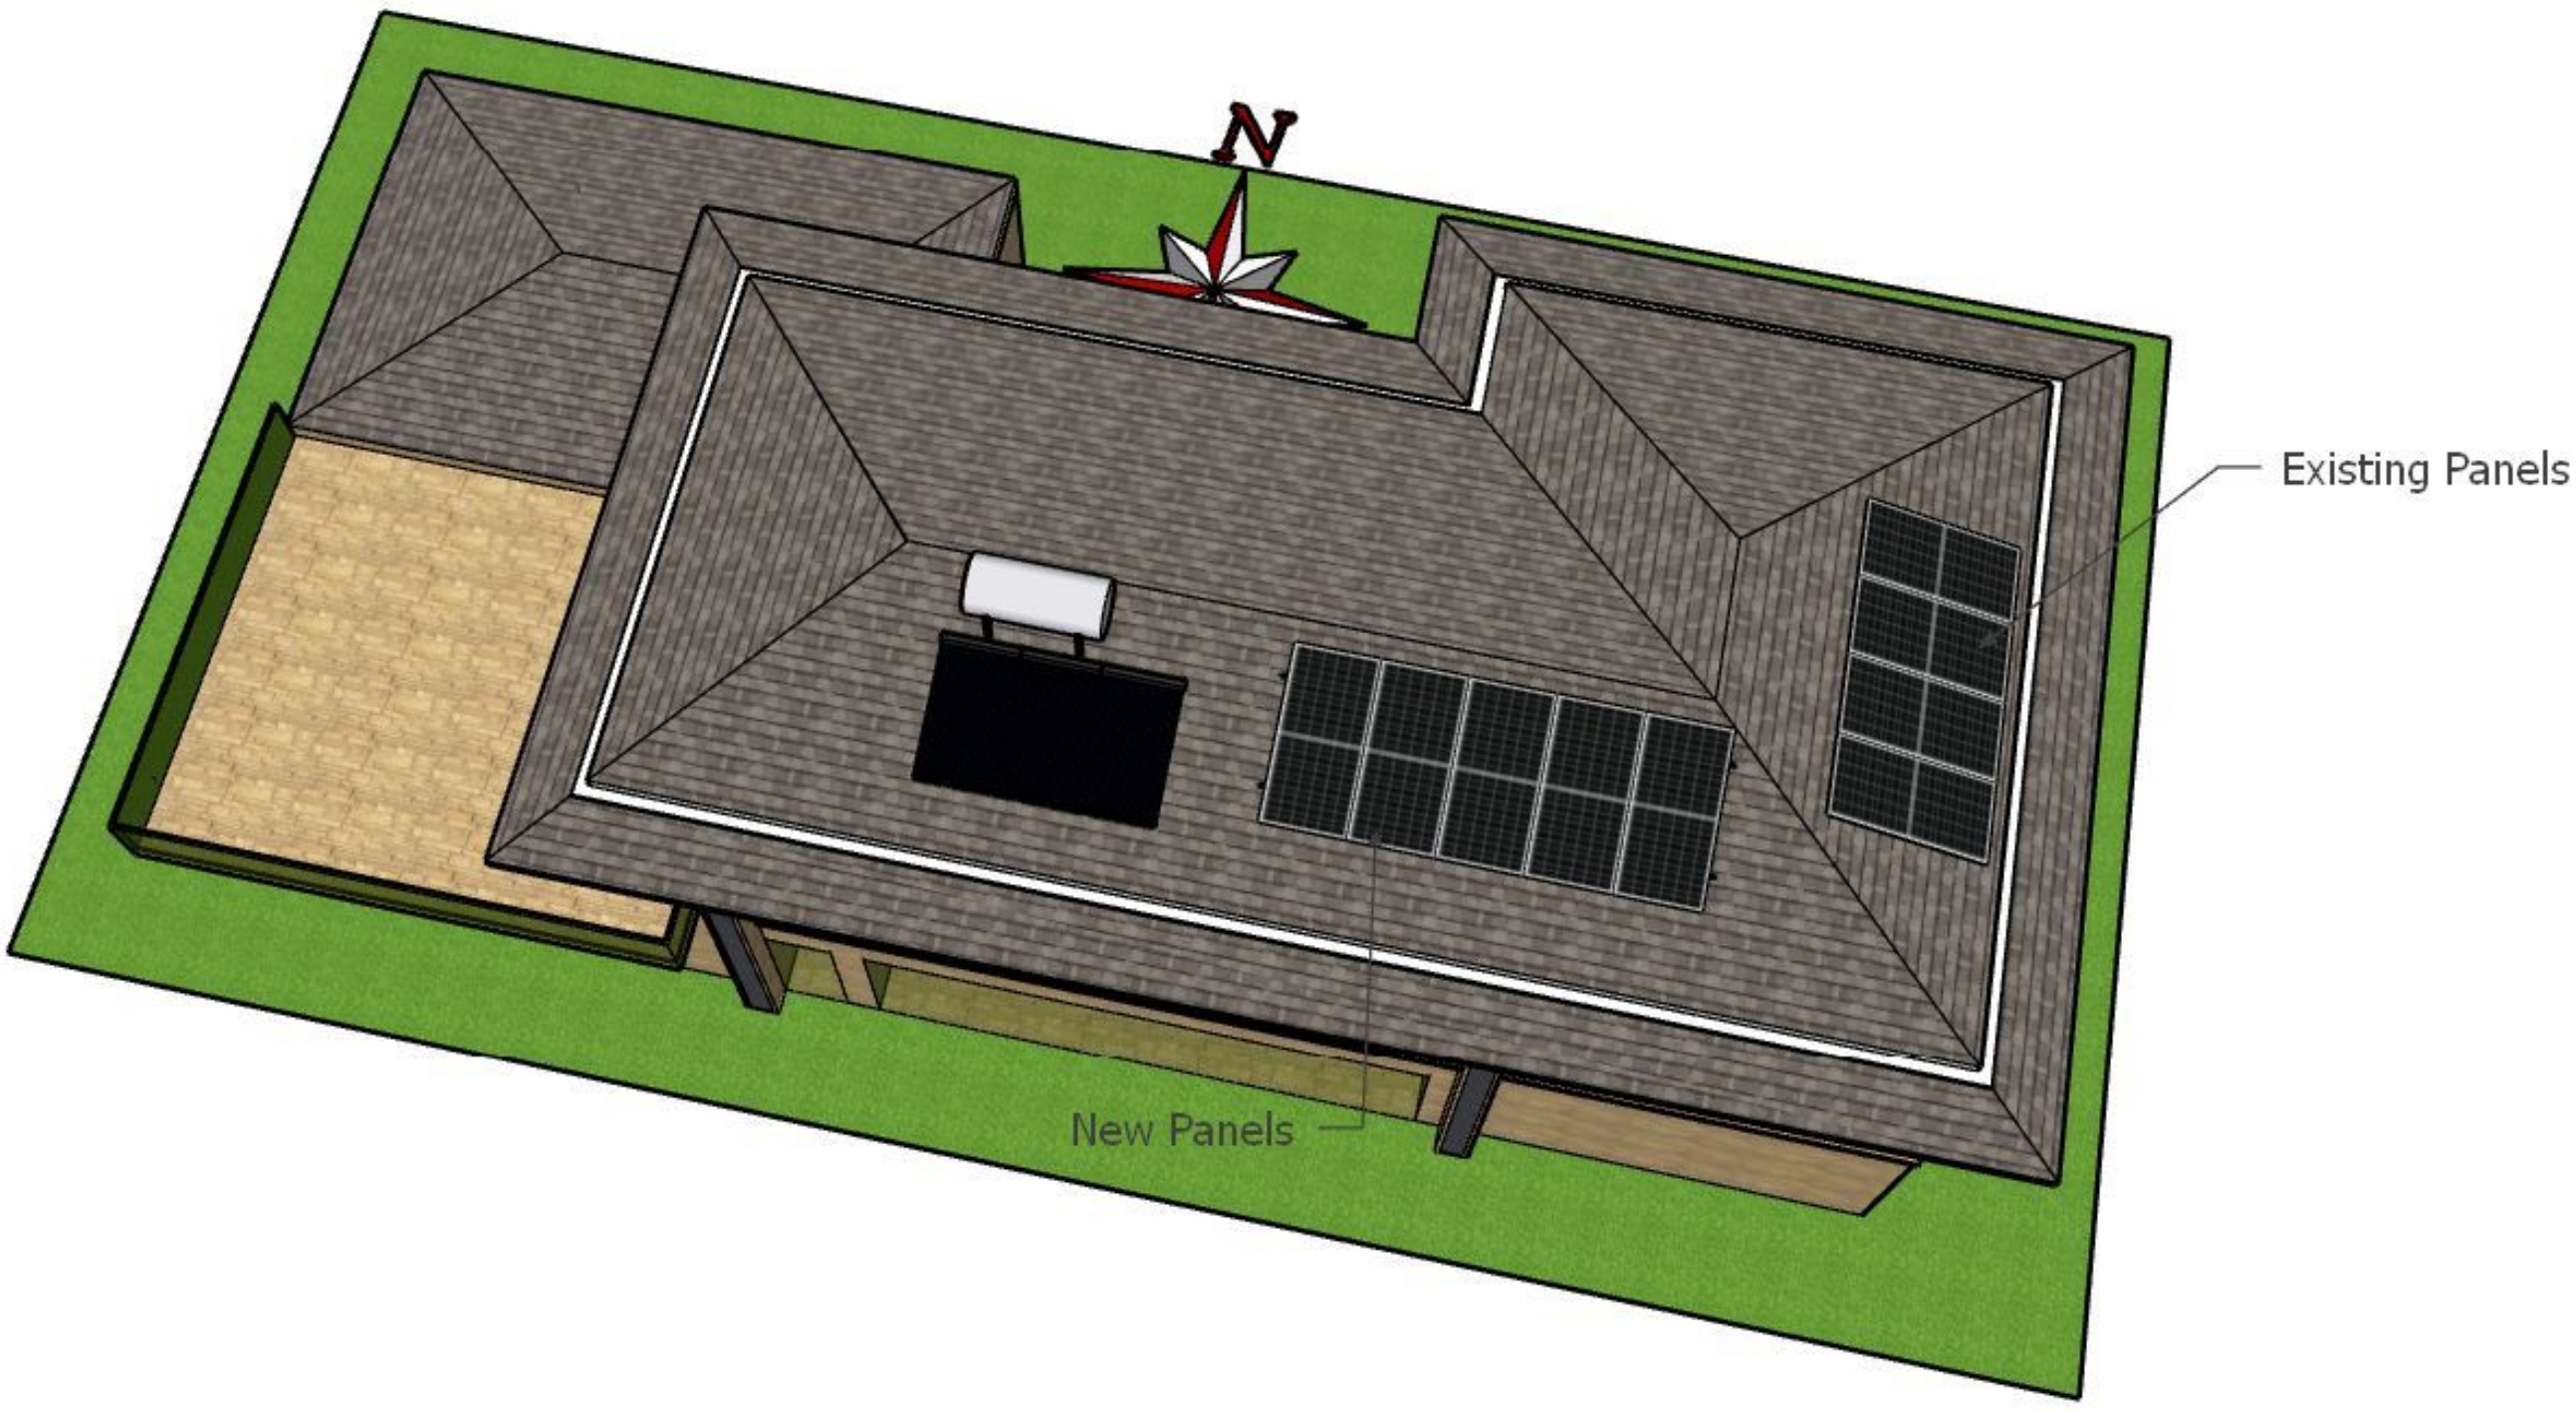

Building Exterior

Material Delivery Route

This route (using side wall) will be followed to carry all items.

The customer will provide a ladder for roof access.

Material Storage

Proposed PV Area

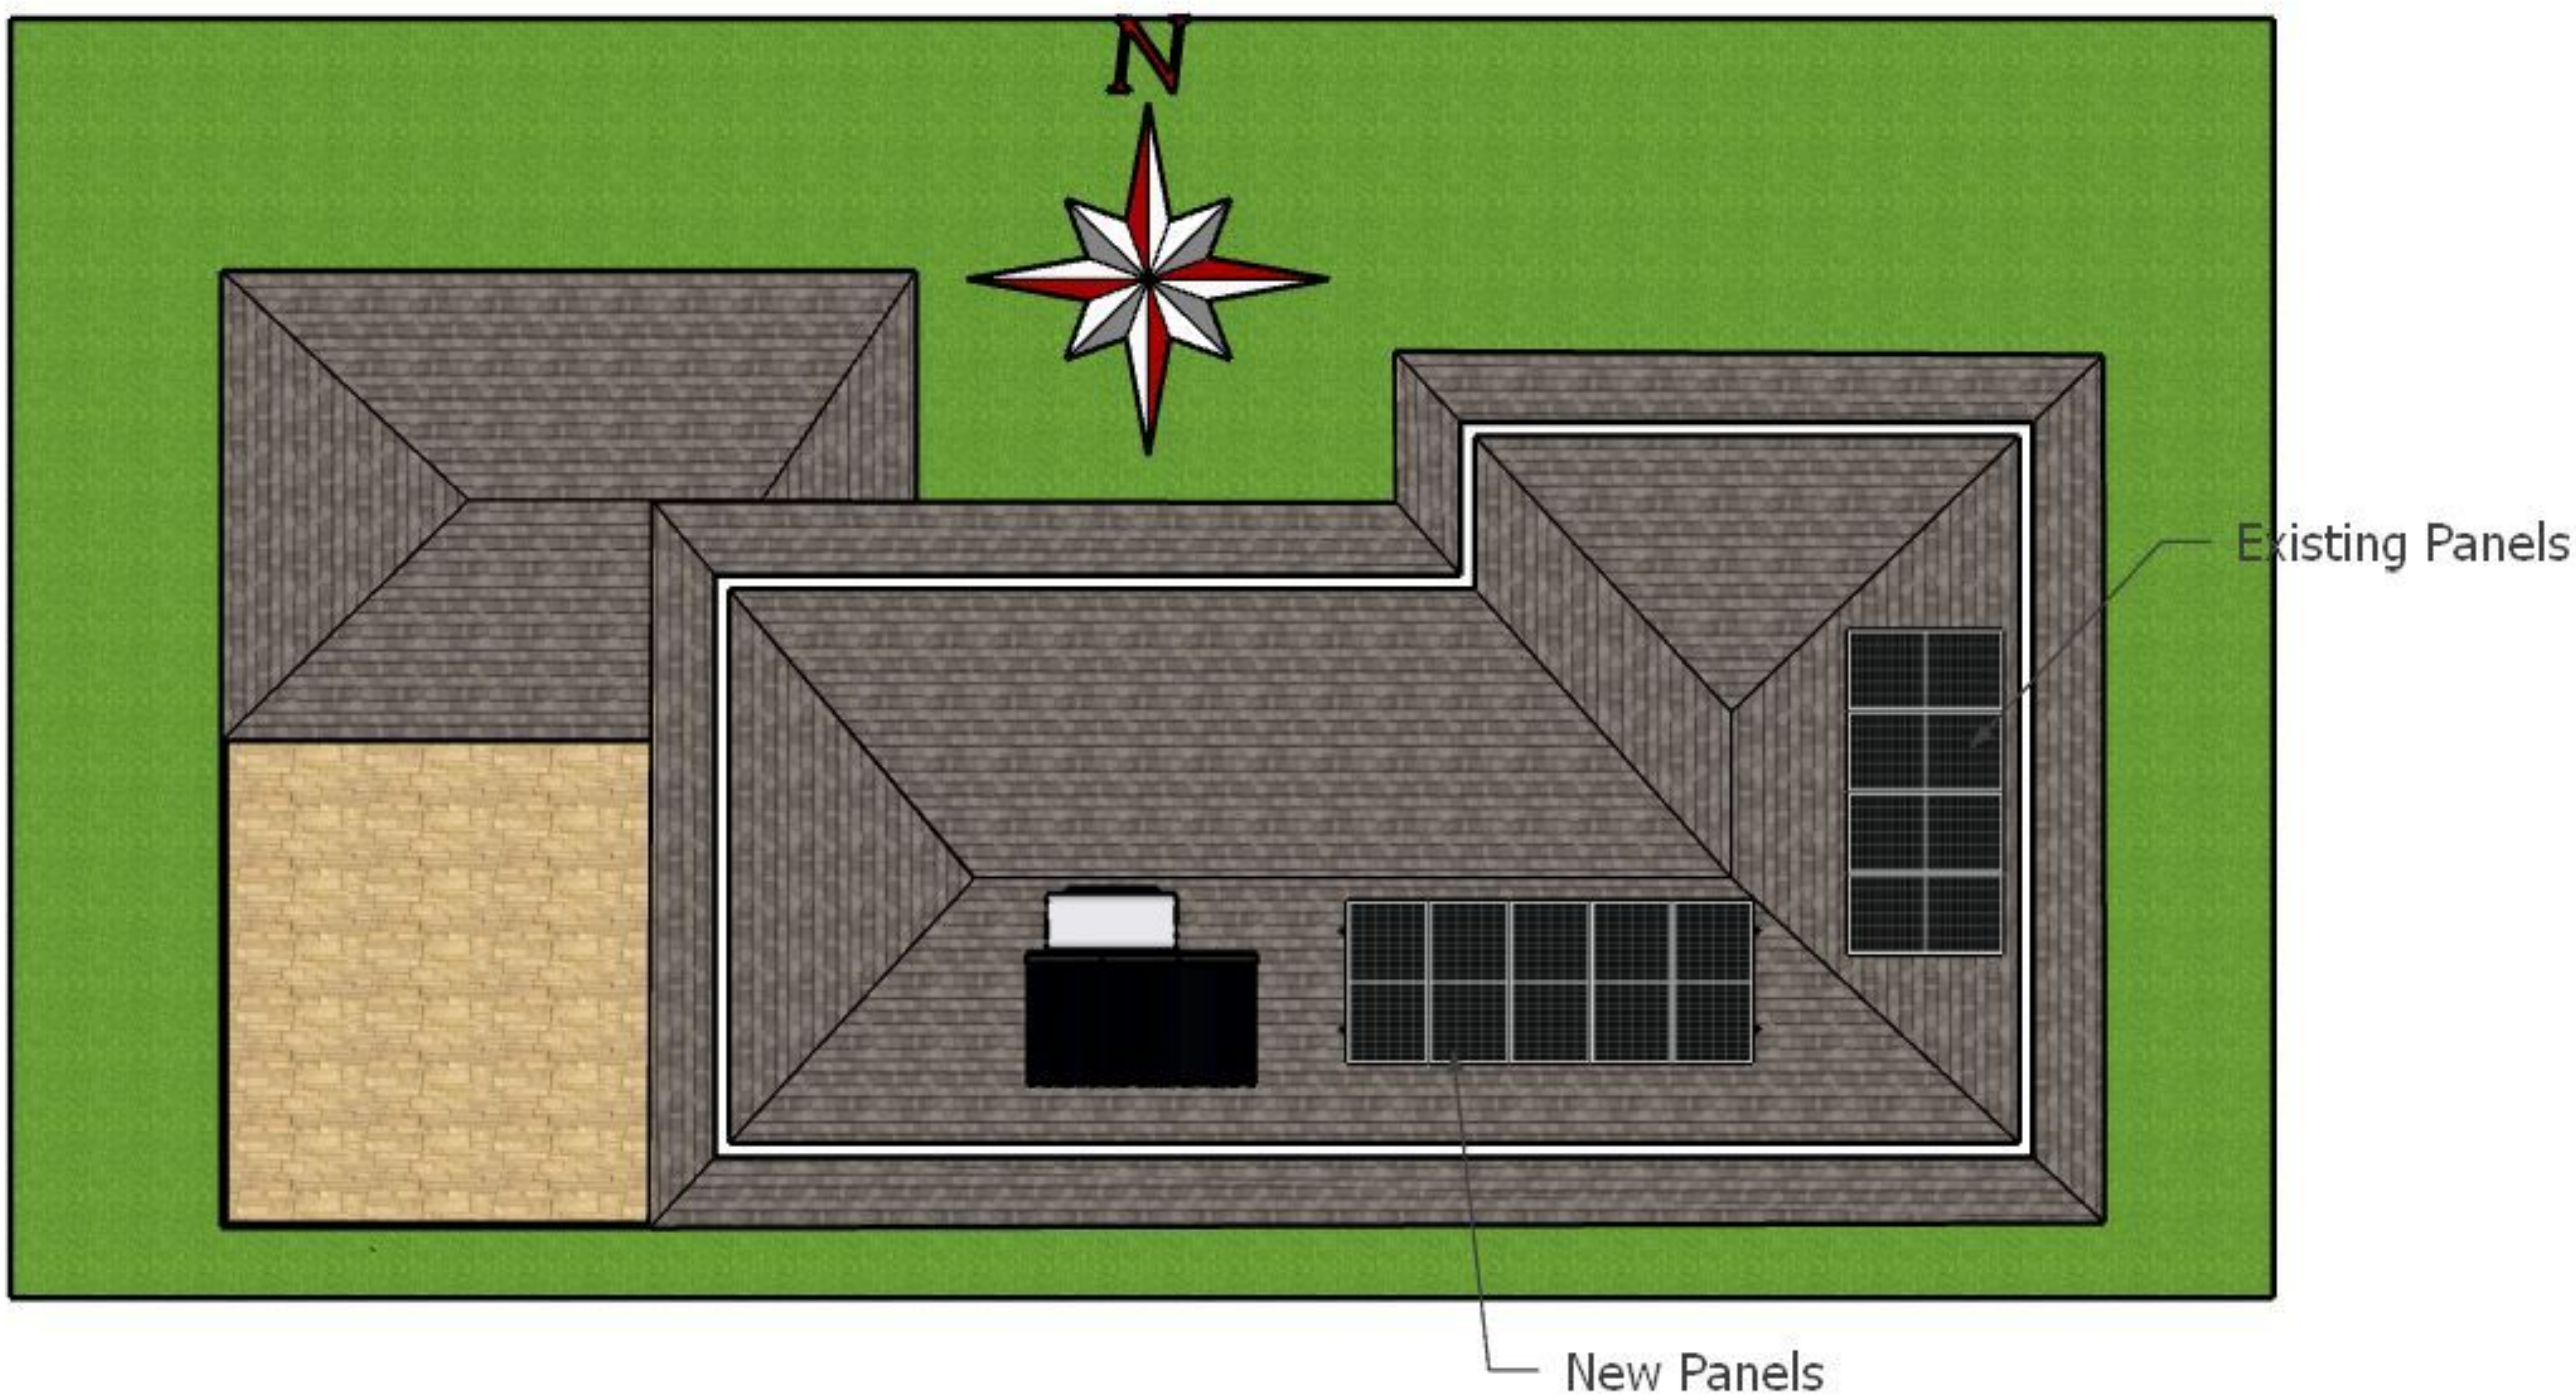

Cable Routing

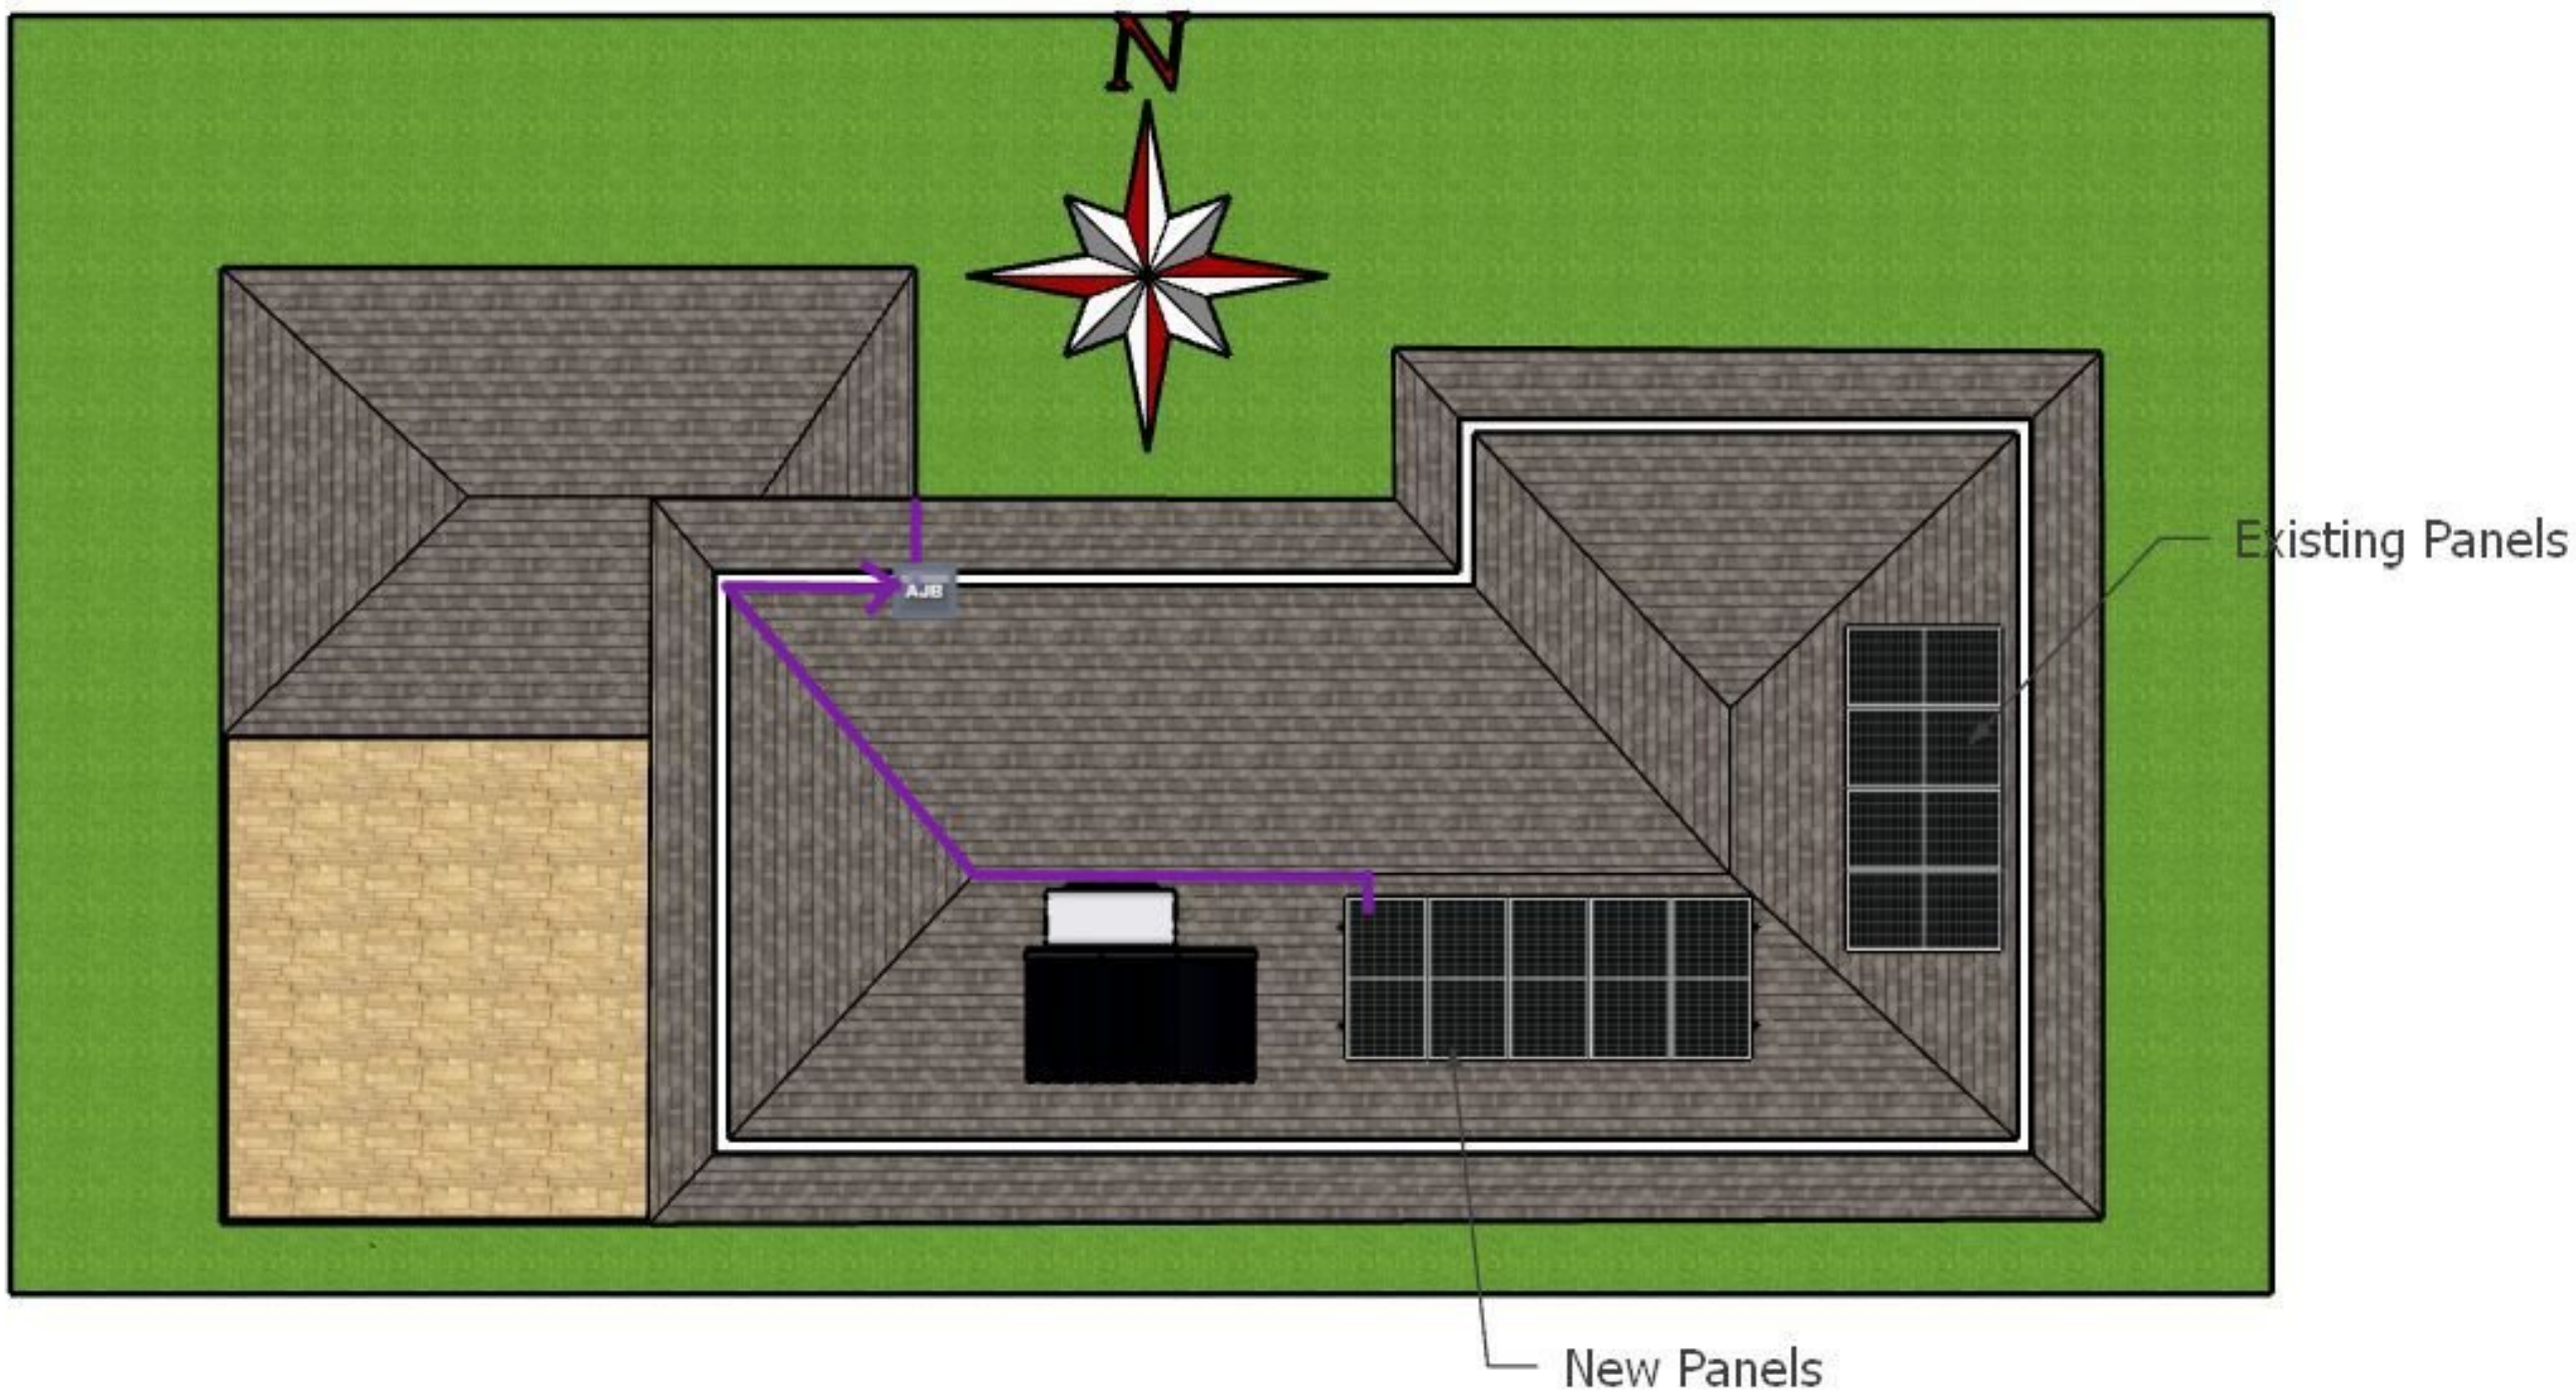

Existing AC cable

Existing AC cable

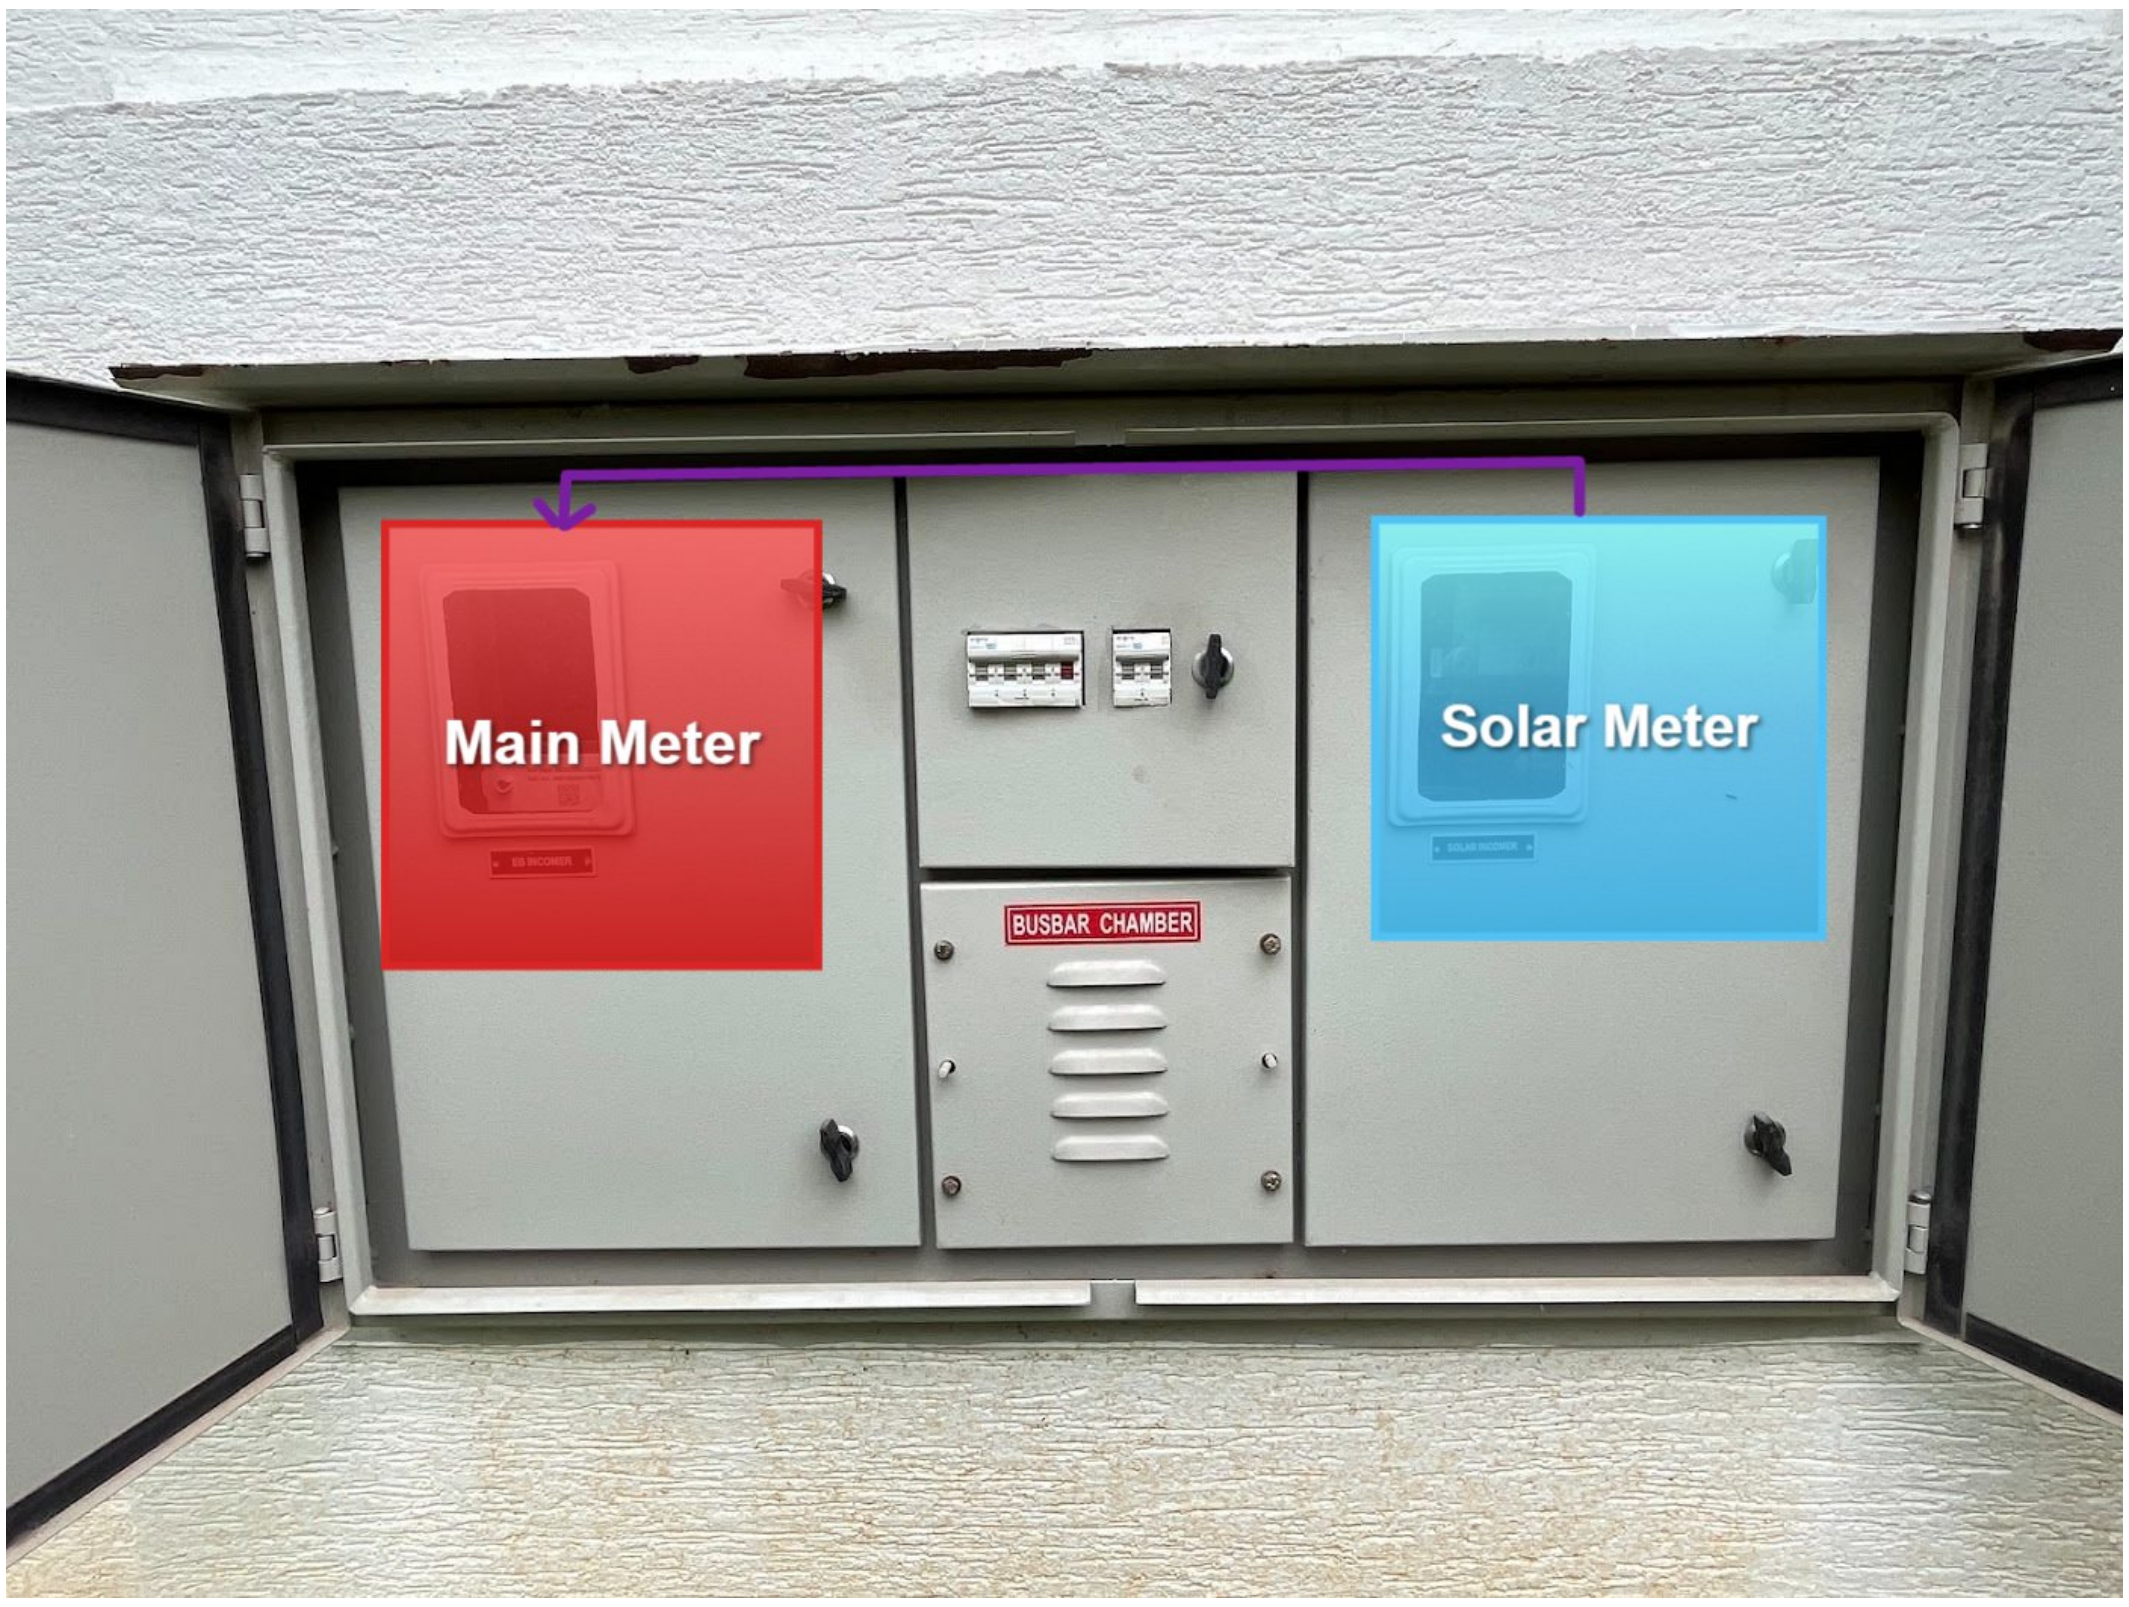
Main Meter
BUSBAR CHAMBER
Solar Meter


ENPHASE.

Earthing Routing

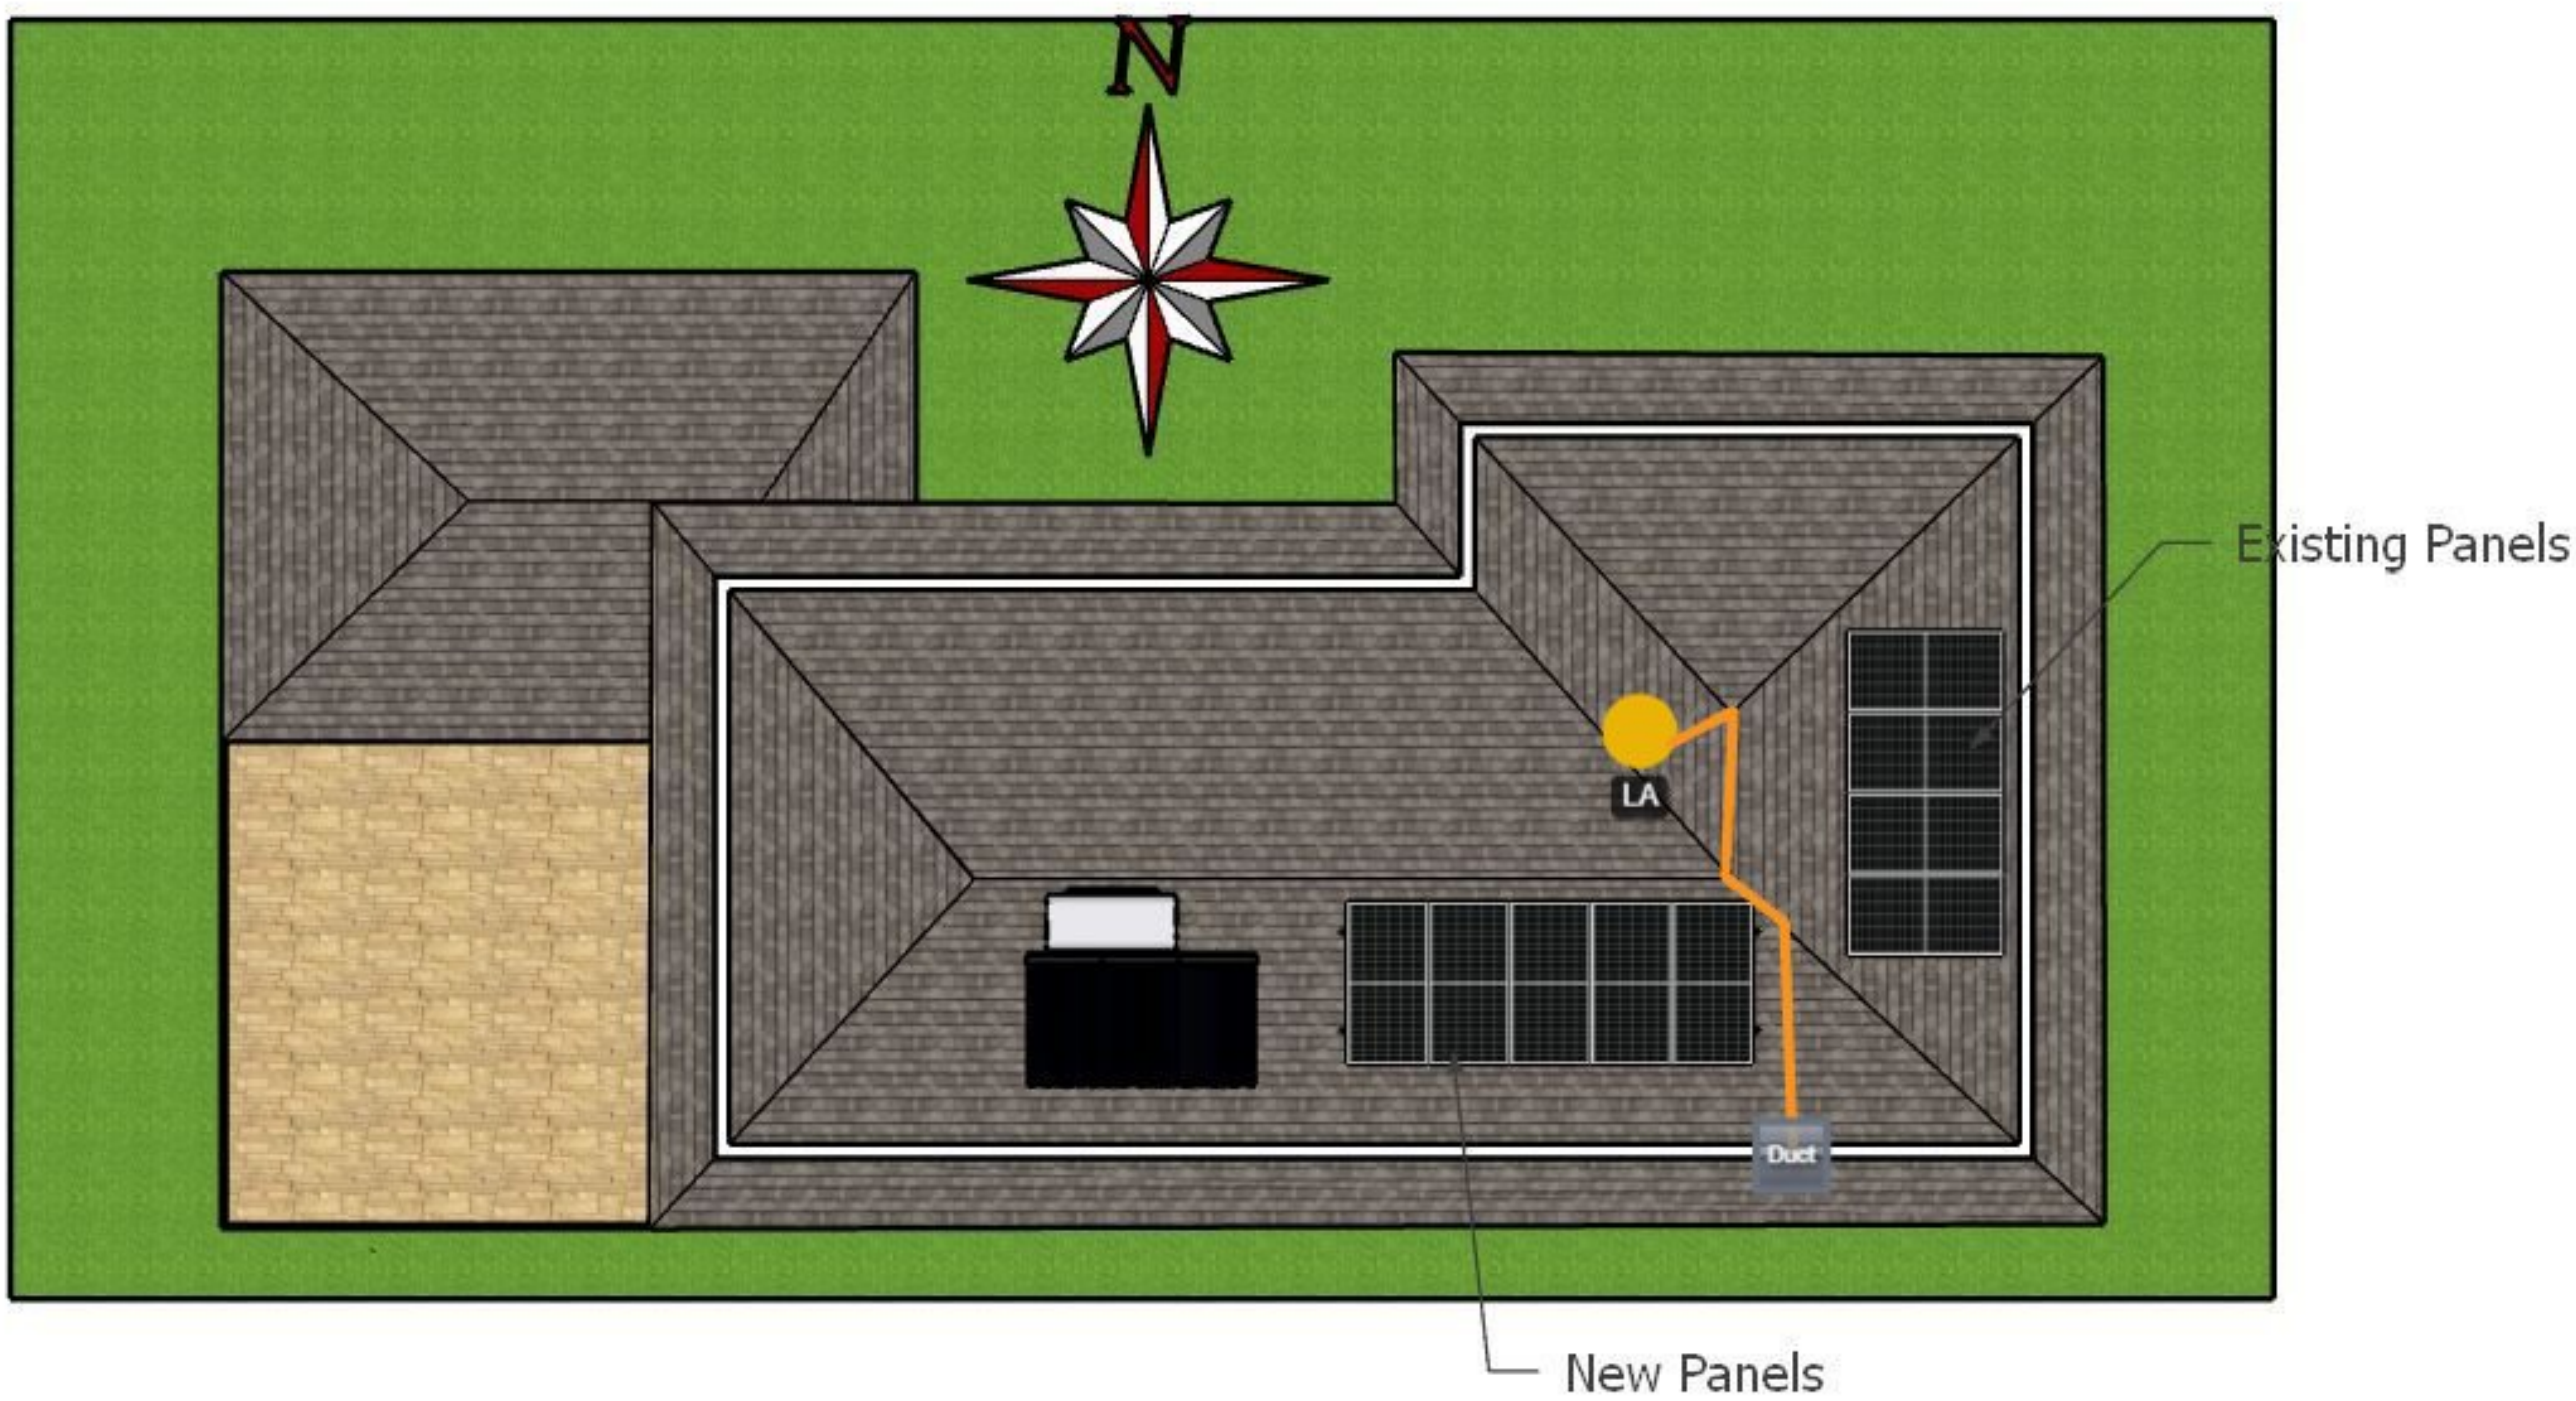

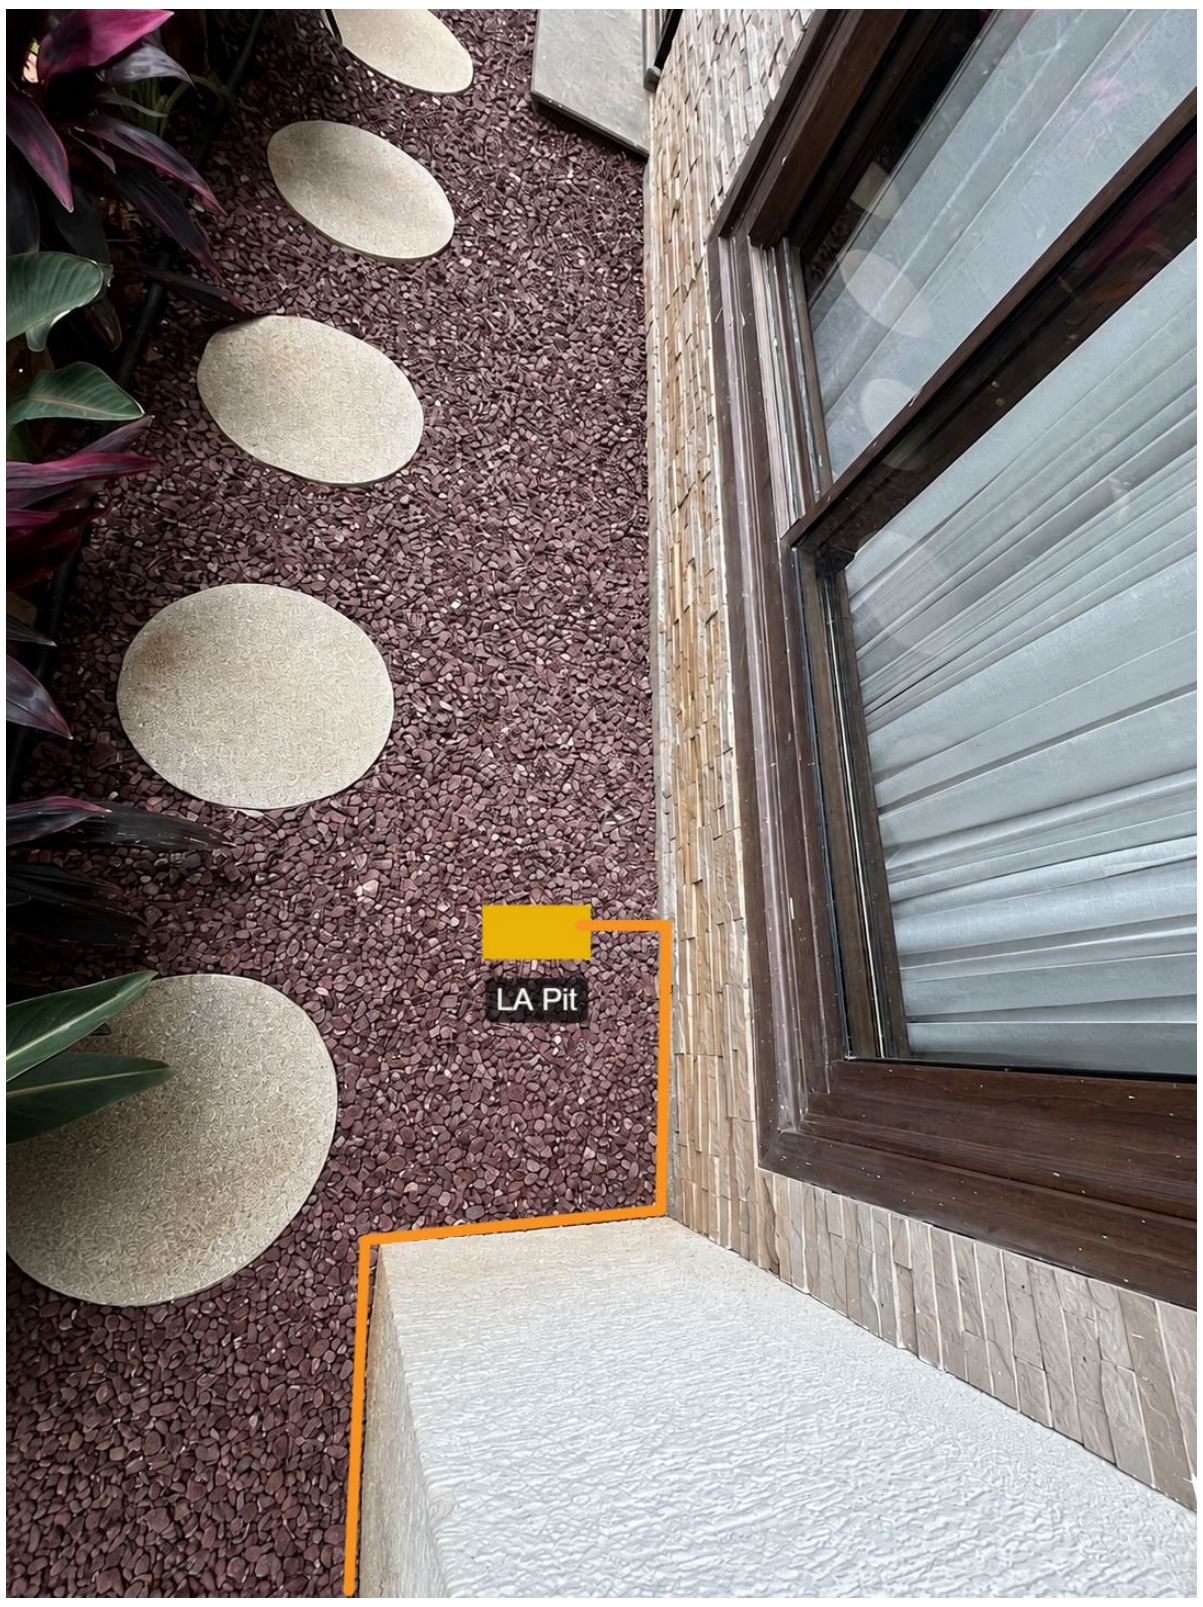
LA Pit


METER BOARD
Enphase accessories

OBSERVATIONS & RECOMMENDATIONS

EcoSoch Scope

#	Observation
1	This is an upgrade project. The existing system is a single-phase system, and we are upgrading it to a three-phase system by adding 5 additional panels. The existing AJB is already installed, and no existing cables will be changed. The additional panels will be connected to the existing AJB.
2	AC and LA earthing will be considered as DC earthing and will be tapped from the existing earthing system.

Customer Scope

#	Observation
1	Wi-Fi up to solar meter location.
2	Ladder to access the roof.

THANK YOU

Dear Pallavi Goel,

Thank you for choosing EcoSoch Solar for your solar installation. We appreciate your trust in us and your commitment to sustainable energy. Our team is dedicated to ensuring a seamless installation experience and long-term performance of your solar system.

Should you have any questions or require further assistance, please do not hesitate to reach out to us.

Warm Regards,
Team EcoSoch

& Did You Know?

The Sun burns 600 million tonnes of hydrogen per second — and your panels get a share.

EcoSoch Solar Pvt. Ltd.

#940, Sha Arcade, 2nd Phase, NTI Layout, Kodigehalli, Bengaluru 560097

www.ecosoch.com | info@ecosoch.com