Technical Site Visit Report

Prepared for: Vasanth_Signature Tulips Non Subsidy_9.76kWp_Hybrid

PROJECT INFORMATION

Report Number	ESV-2026-0182
Project ID	62A3D94B
Project Name	Vasanth_Signature Tulips Non Subsidy_9.76kWp_Hybrid
Billing Name	Vasanth
Project Sector	Residential
Project Type	Without Subsidy
Sales Lead	Govindaraju
Site Address	#480,Signature Tulips Layout, Huskur Village, Mandur Panchayath, Bidarahalli Hobli, Bengaluru-560049
GPS Coordinates	13.06487270870414, 77.76111369968469
Google Maps	https://www.google.com/maps?q=13.06487270870414,77.76111369968469
Visit Date	2026-08-05
Visited By	K Naveen
Revision	Rev 3

CLIENT INFORMATION

Client Name	Vasanth
Contact	9945792699

PROJECT DETAILS

Solar Rooftop System Type	Hybrid
System Capacity (kWp)	9.76
Sanction Load (kW)	15
Module Make & Capacity	Premier Bifacial Non DCR 610

Module Length (mm)	2382
Module Width (mm)	1133
Number of Panels	16
Inverter Type	Hybrid (String)
Inverter Brand	Deye 10 kW 3phase Hybrid
Number of Inverters	1
Battery	Needed
Number of Batteries	2
Capacity of each Battery (kWh)	5.12
Battery Model No.	Deye SE-F5plus
Mounting Structure Type	RCC Flat Roof

SITE INSPECTION CHECKLIST

General

#	Question	Answer	Notes
1	Can the delivery van/truck reach the material unloading point?	Yes	-
2	Are there any obstacles at the site that could hinder material lifting?	**No**	-
3	Where will the Inverter, DCDB, ACDB, Battery, etc. be located?	The Inverter, ACDB, DCDB,Battery will be located near the headroom	-
4	Is a canopy required for protecting the Inverters/ACDB/DCDB?	**No**	-
5	Did you discuss the location of the earth pits with the customer?	The earth pits are located near the corriodor which is located north west cornner.	-
6	Where is the Internet Router located?	Under construction	-
7	What's the Wi-Fi strength of the router near to the String inverter/Envoy?	Not Available / Under Construction	-
8	Did you pin the site location in your WhatsApp when you were at the site?	Yes	-

Roof Details

#	Question	Answer	Notes
1	What type of roof is present at the site?	RCC Flat Roof	-
2	Are there any obstructions on the roof that could affect the solar installation?	**No**	*The skylights and west side headroom and east side parapet wall are the obstructions that could affect the solar installation*
3	What is the angle of the panels? (in degrees)	10	-
4	In case of sloped roof, what is the slope angle of the roof? (in degrees)	N/A	-
5	On how many roofs at the site are we installing solar?	1	-
6	If it is a Tiled roof, what is underneath the tiles?	N/A	-
7	If it is a Tiled roof with MS or Wooden rafters, is it Single-tiled or Double-tiled?	N/A	-
8	What type of mounting structure is planned?	Ballast	-
9	What is the orientation of the solar panels?	["South"]	-
10	How can the roof be accessed?	Ladder	-
11	Is the building currently under construction?	Yes	-
12	In an under-construction building, are existing conduit pipes available for AC, DC cables, and earthing?	Yes	*The conduit pipes are only available near the corridor to run the AC, and DC earthing cables*
13	What is the height of the building and how many floors does it have?	The height of the building is G+2+Headroom is approximately 12 meters	-
14	Is the site photo matching with the building description?	Yes	-
15	Is there an overhead HT line passing within a 10-meter radius of the site?	**No**	-

Residential / Electrical

#	Question	Answer	Notes
1	What type of energy meter is currently installed?	Phase: Three Phase, Type: Digital	*Currently Temperarory meter is available*
2	Is the Meter cubicle photo matching with the previous answer?	Yes	-
3	Has the termination point in the Main meter panel been identified?	Yes	-
4	Is the Termination Point easily visible or sealed?	Visible	-
5	Is a Lightning Arrestor (LA) already available at the site?	**No**	-
6	Is space available for CT within Energy meter panel?	N/A	-
7	In case of an Enphase system, is the distance between the farthest micro-inverter and IQ Gateway > 50m?	N/A	-
8	Provide details of the existing CT ratings (if applicable).	N/A	-
9	In Main meter panel, is empty space available for solar meter?	Yes	-

#	Question	Answer	Notes
10	In Main meter panel, is empty space available to house the Enphase accessories or ACDB components?	N/A	-
11	Is there space available to dig DC, AC and LA earth pits?	Yes	-
12	In case of elevated structures, is an LA extension provided at the far end?	Yes	-
13	In case of elevated structures, is it with or without grouting?	N/A	-
14	Are there any challenges with respect to Installation and Maintenance activities?	**No**	-
15	Are there any safety risks associated with accessing the roof for installation?	**No**	-
16	Is space present in rooftop to store the panels?	Horizontally sleeping	-
17	In case of sloped roof MS structure, provide the dimension of rafter to rafter, purlin to purlin.	N/A	-
18	Is ventilation available in the battery location?	Yes	-
19	Should the Inverters/ACDB/DCDB be installed on a metal grill or wall mount?	Wall Mount	-
20	Provide the dimensions for solar meter cubicle placement (L x W of wall).	length: 450, width: 500	-
21	Provide the dimension for earth pits location (L x W of available space).	length: 2000, width: 2000	-
22	Is LAN cable under customer scope?	**No**	-
23	Is there any shadow that affects the solar installation?	Yes	-
24	Is there any trench work to be done to carry the AC cable to the meter location?	**No**	-

PHOTO DOCUMENTATION

Cable Routing Legend

Legend	Description
	Proposed PV Module Array
	Main Meter Location
	Solar Meter
	Battery
	Inverter
	Other Equipment
	DC Cable
	AC Cable
	Material Shifting
	DC Earthing Cable
	AC Earthing Cable
	LA Cable
	DC Earth Pit
	AC Earth Pit
	LA Pit
	LA

Material Delivery Route

This route (using lifting) will be followed to carry large items (like Panels).

This route (using Staircase) will be followed to carry Small items.

Staircase Details

Meter Box

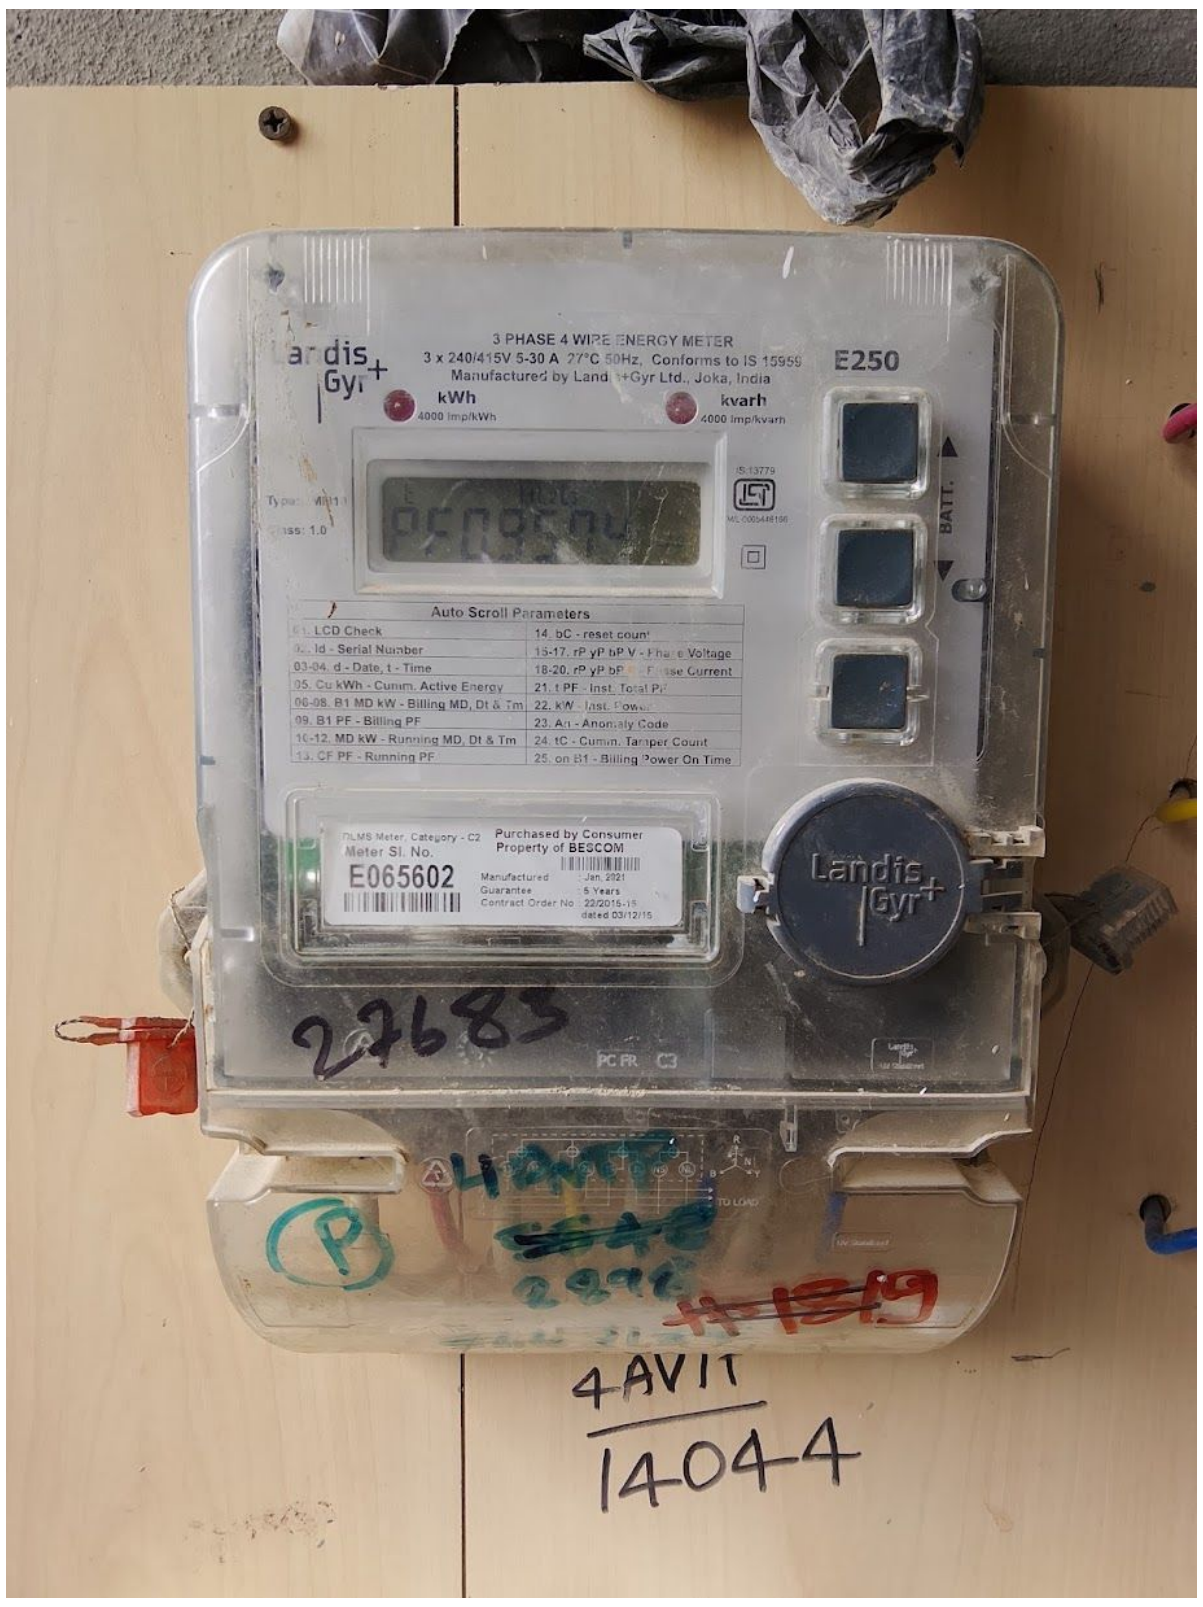

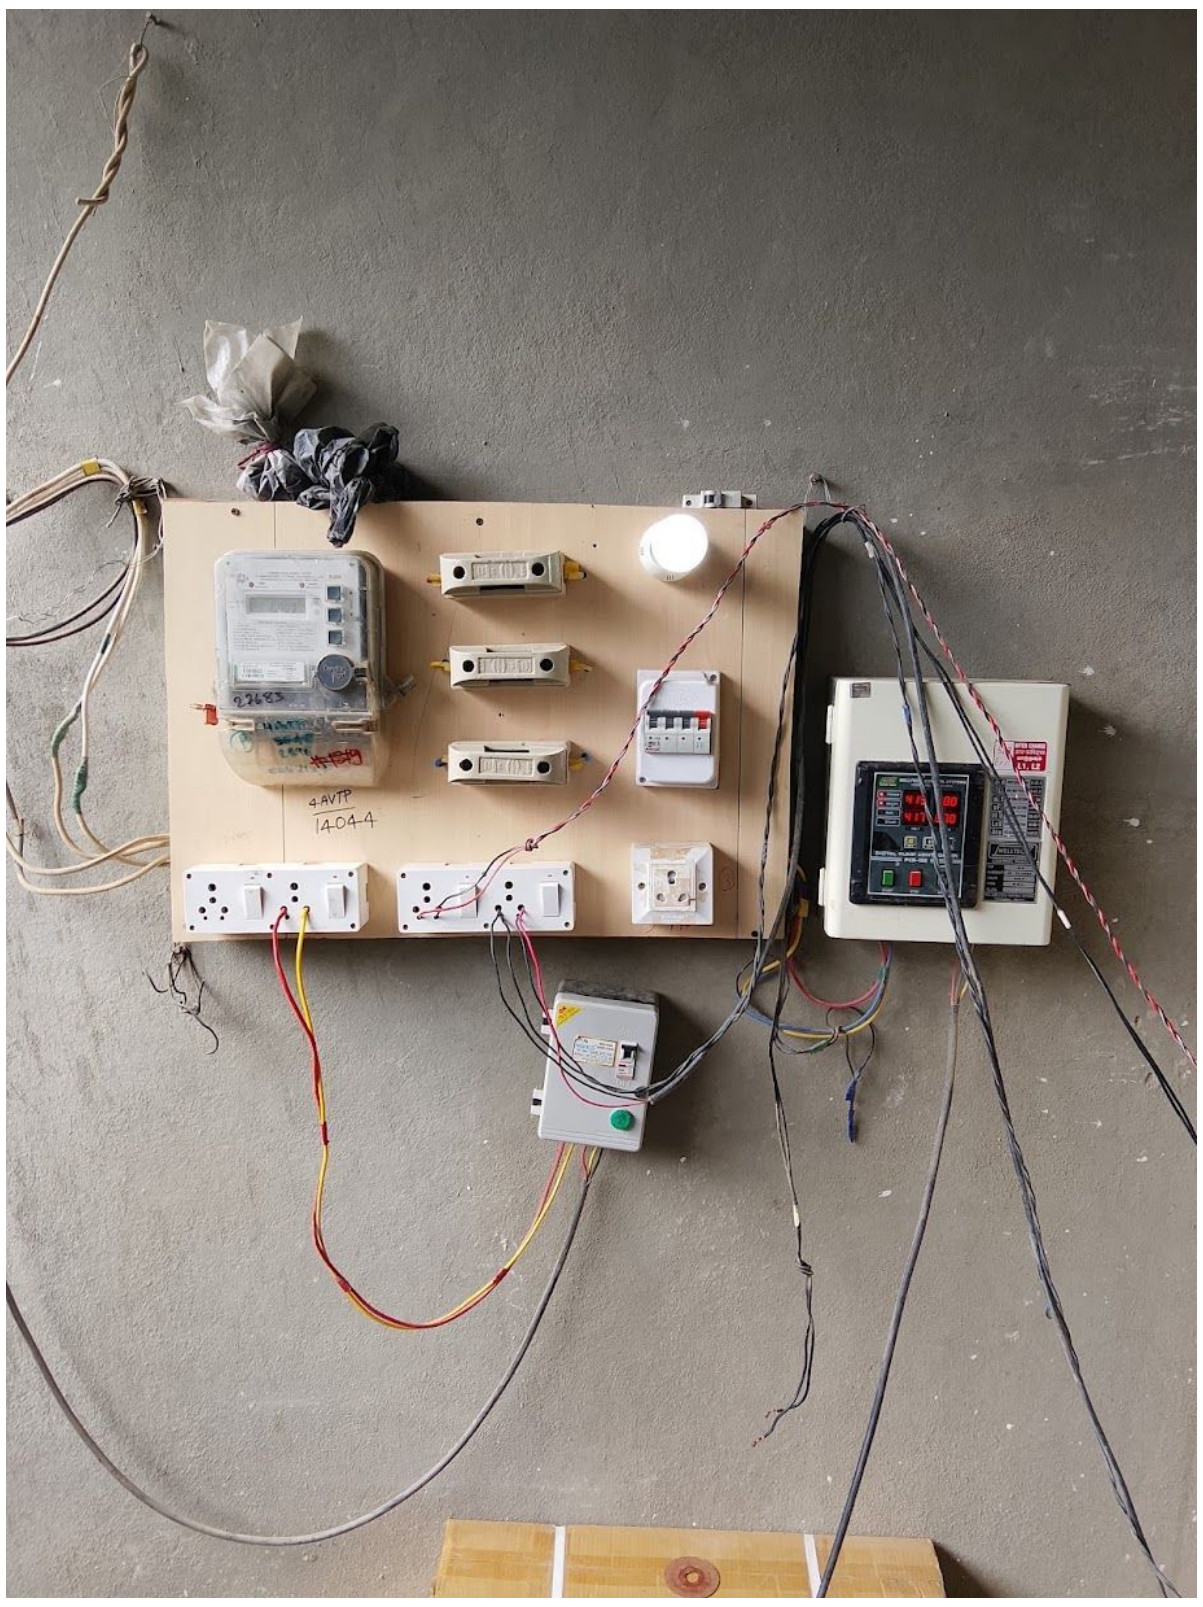

Material Storage

Proposed PV Area

Cable Routing

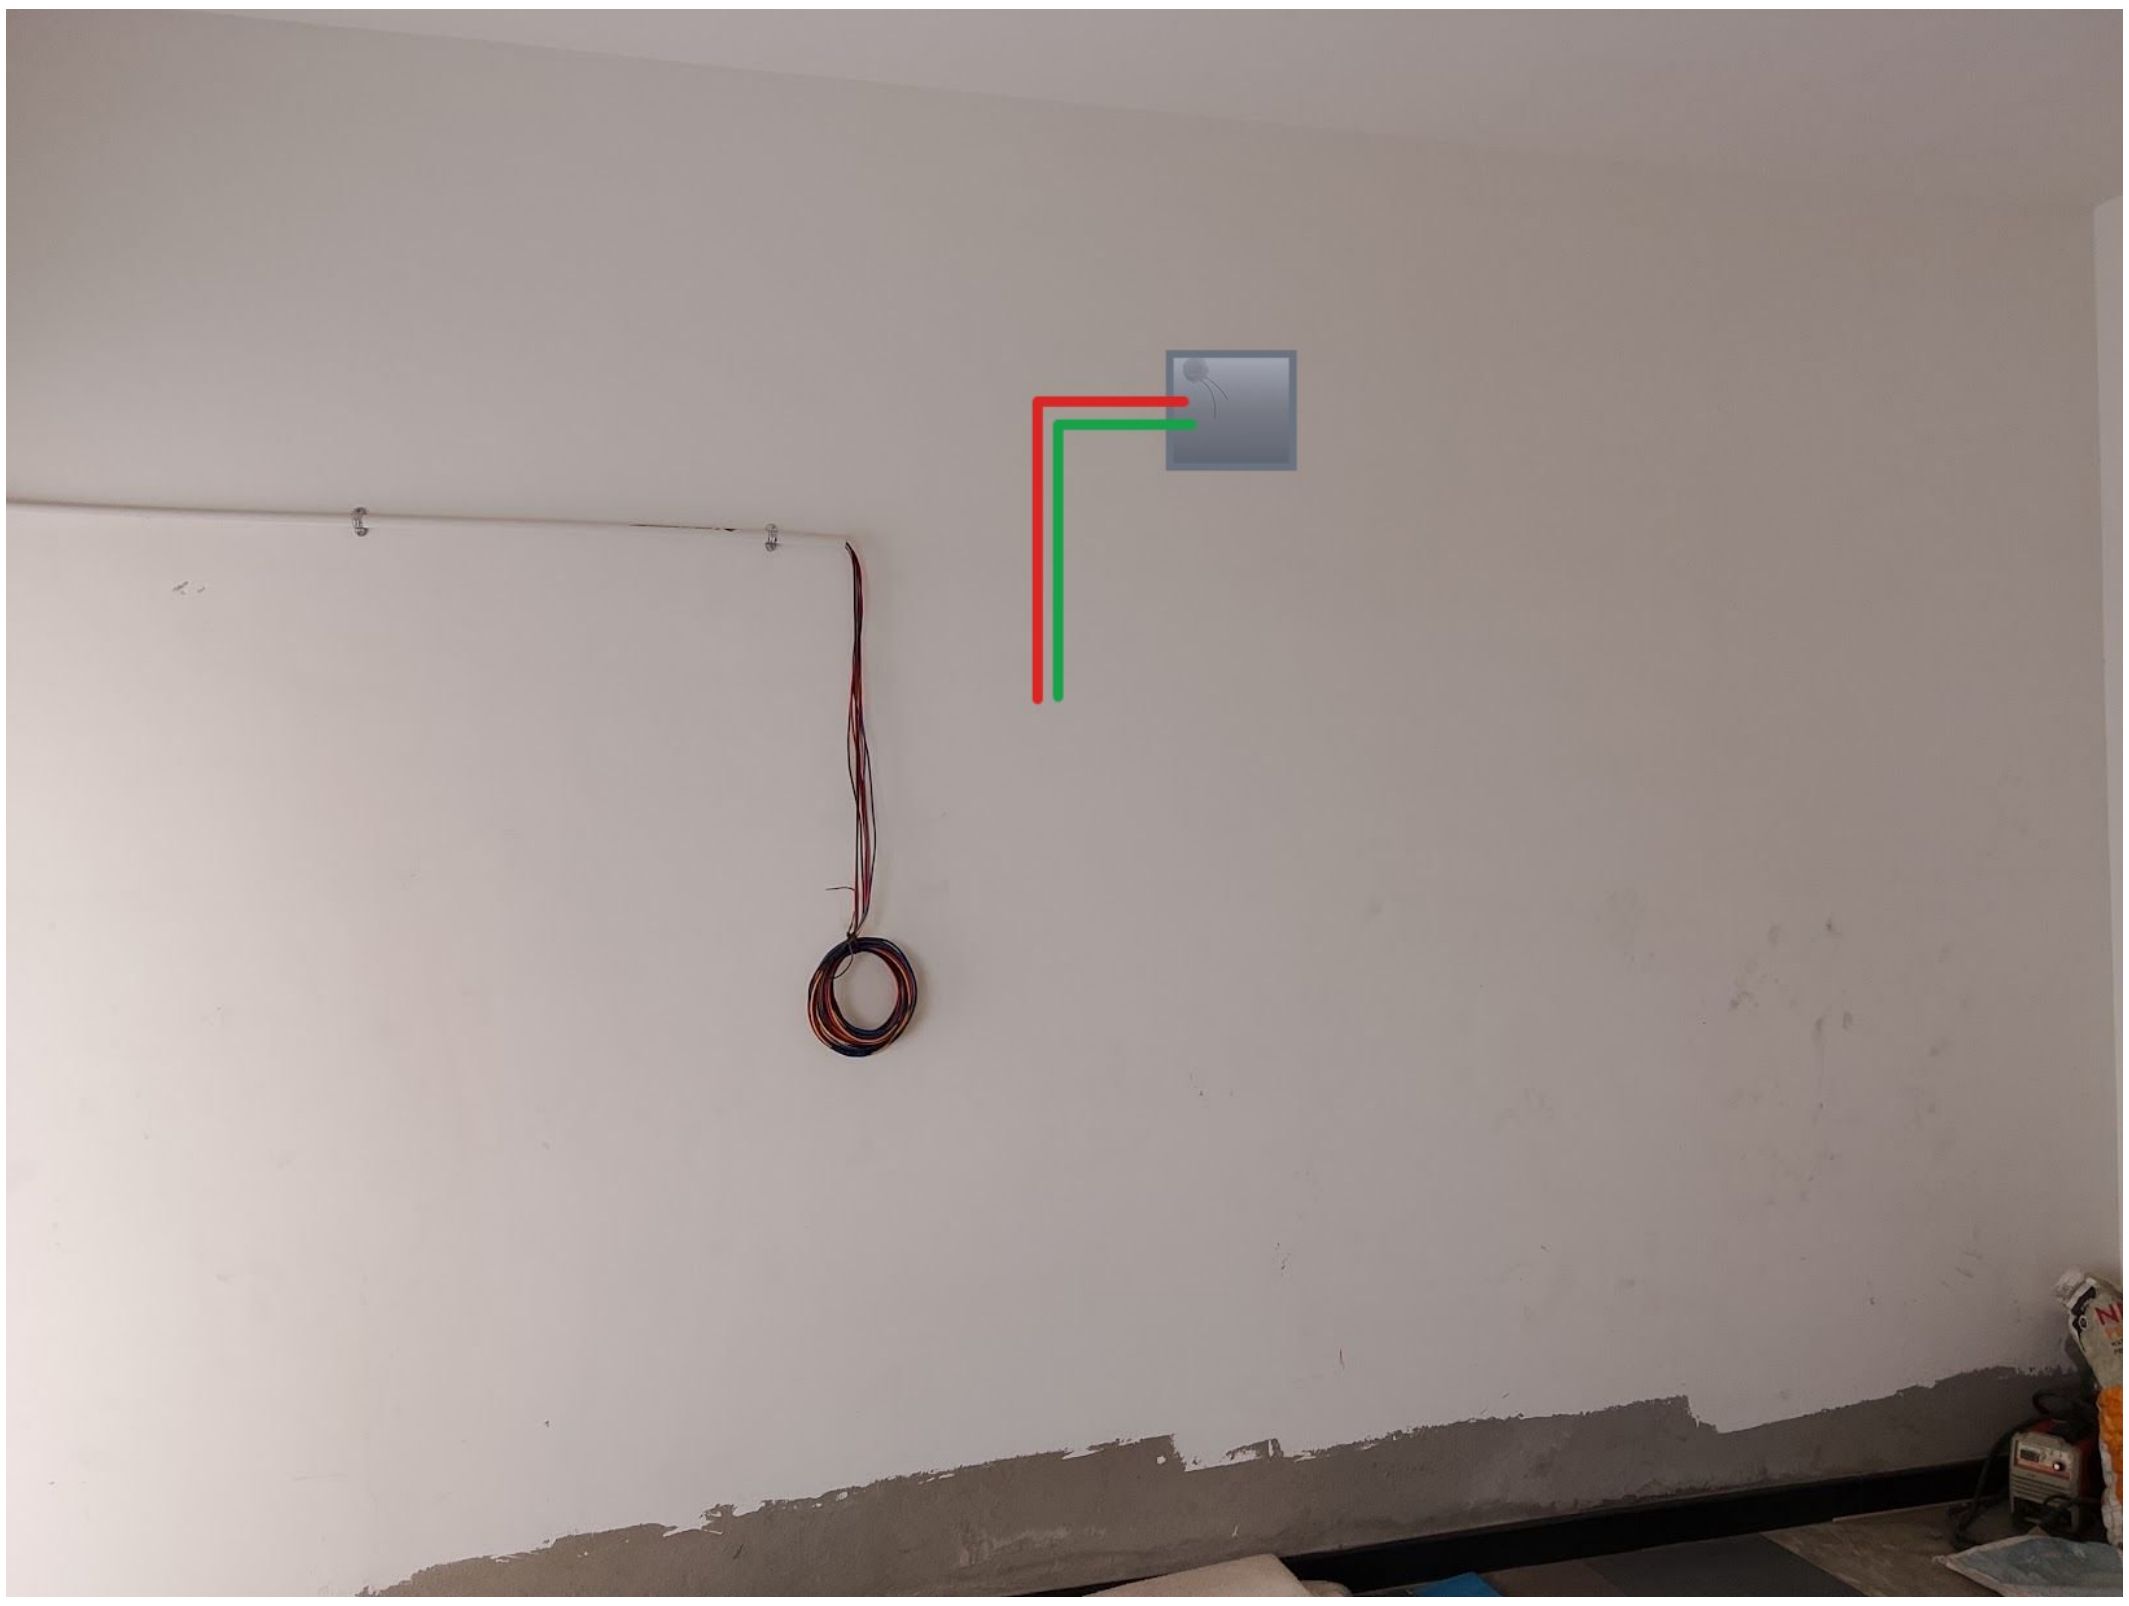

Make a hole to run the AC,DC,LA earthig cables

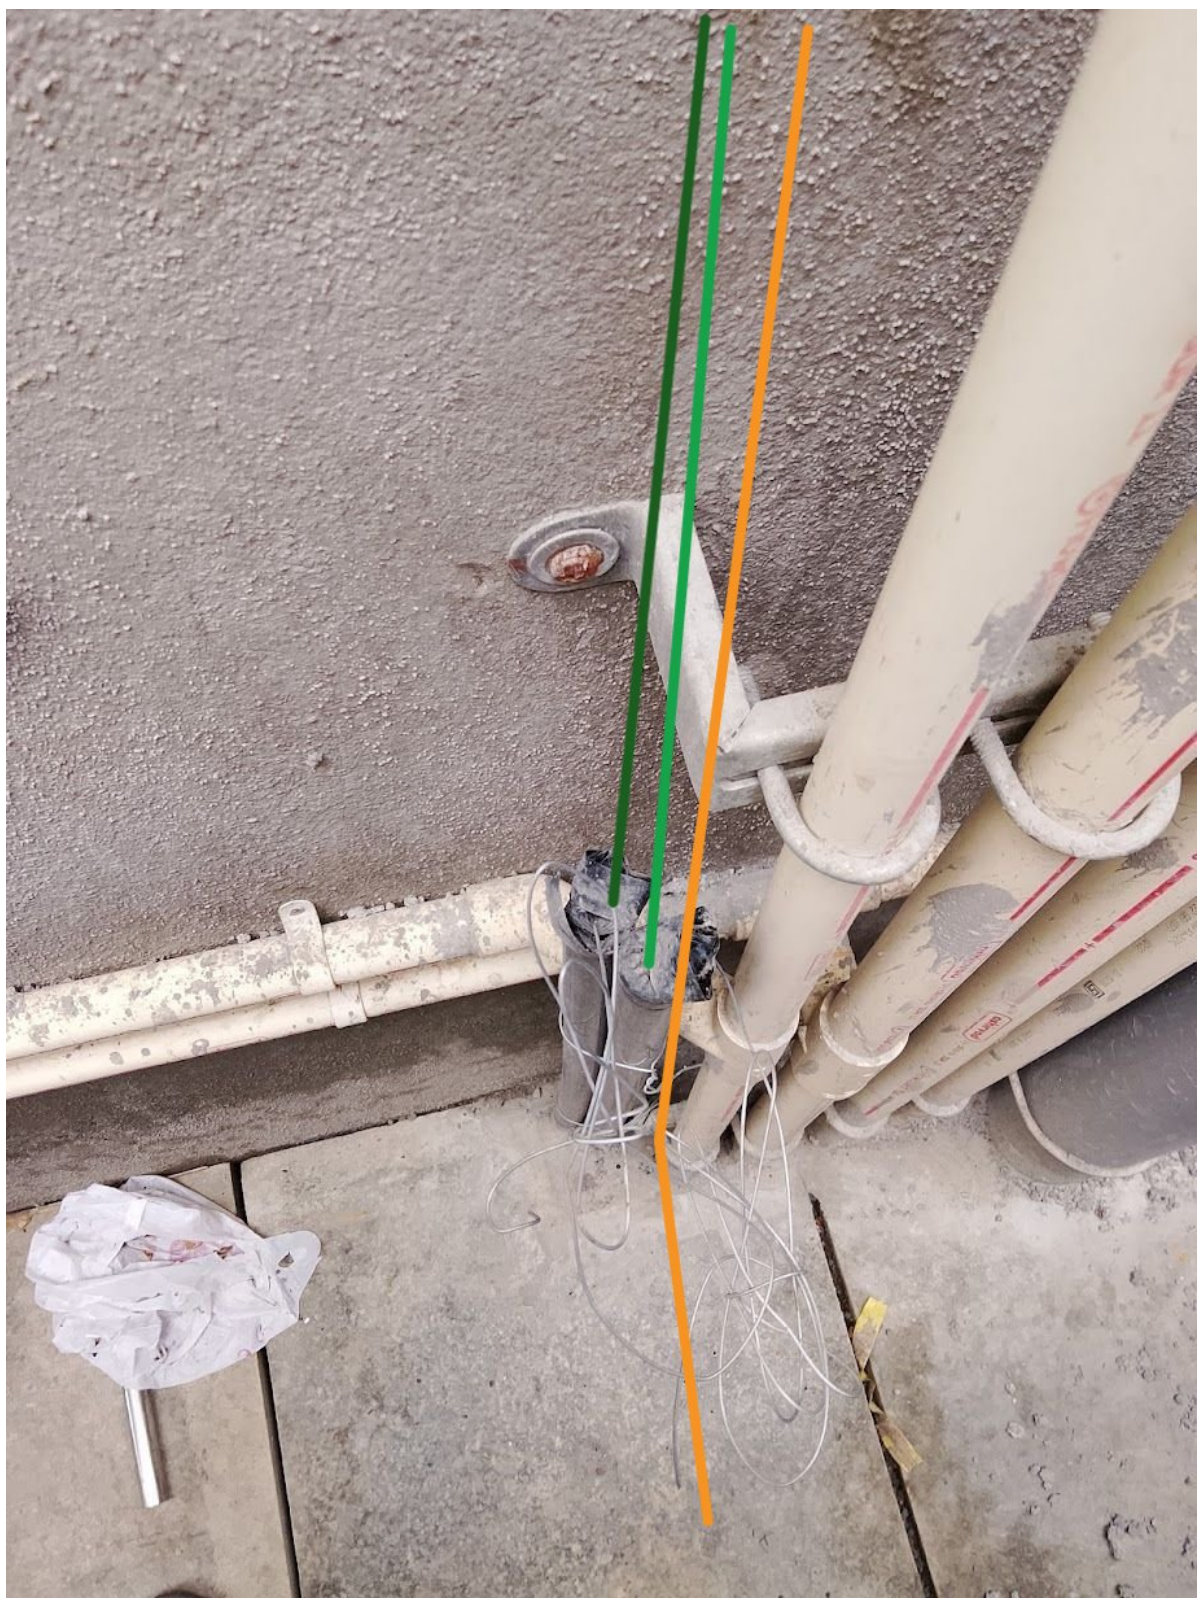

Clent has to be pull the AC,DC earthing cables in the existing conduit pipes

LA earthing has to be done here only

Equipment Location

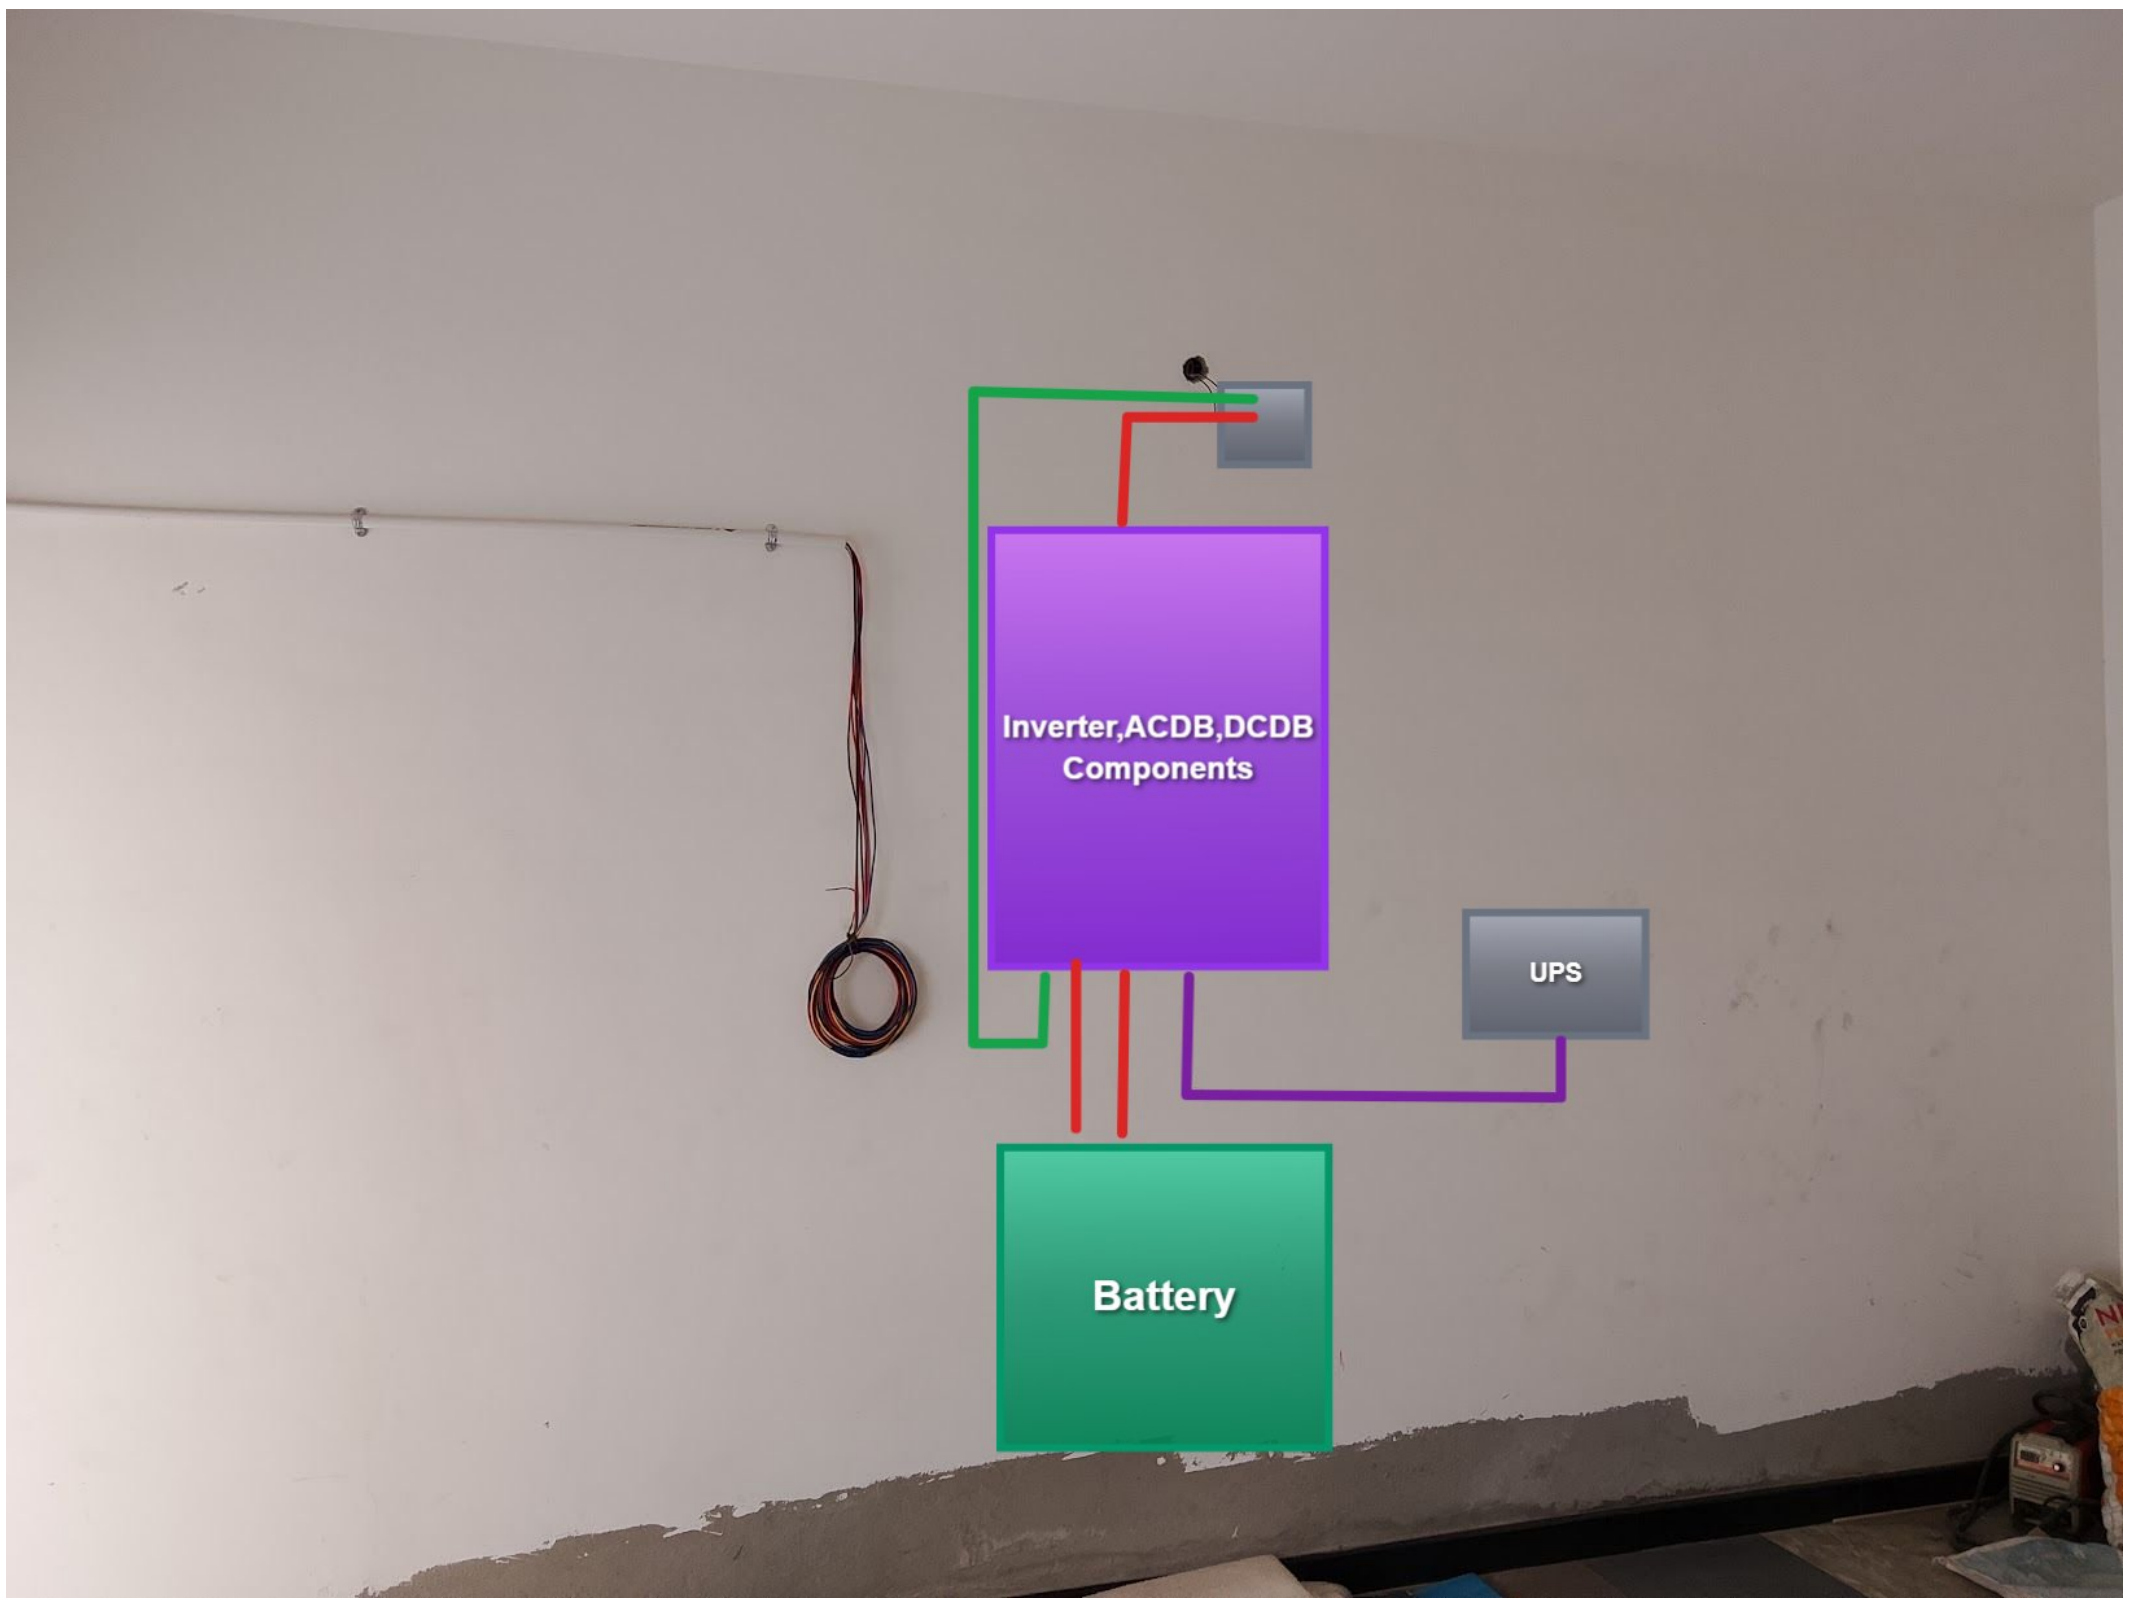

Earth Pit Location

Site Layout - Top View

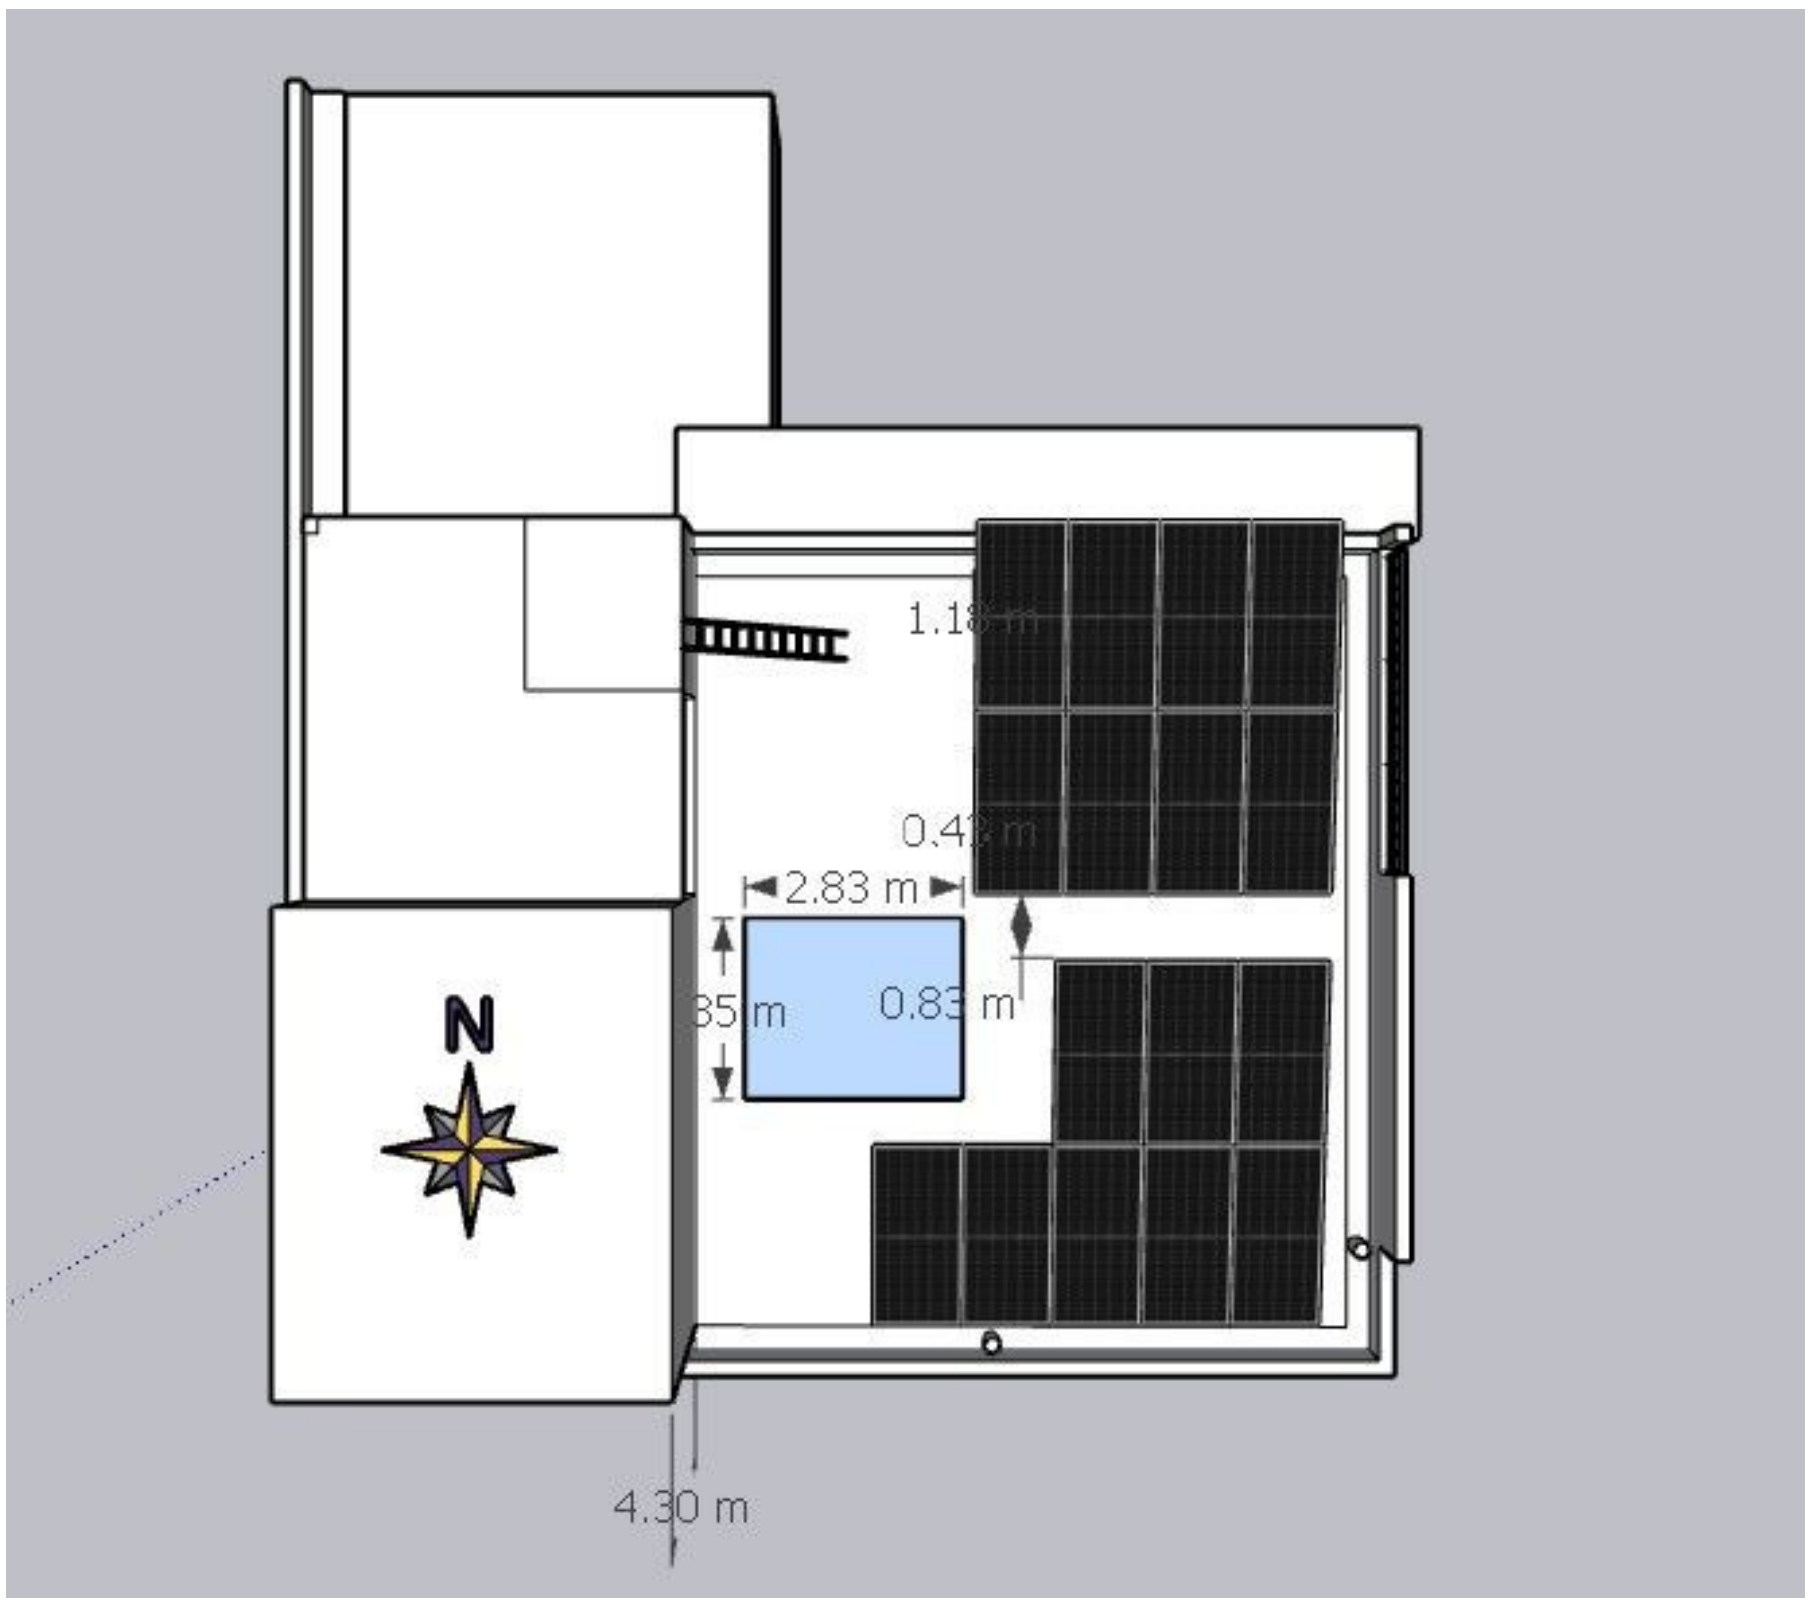

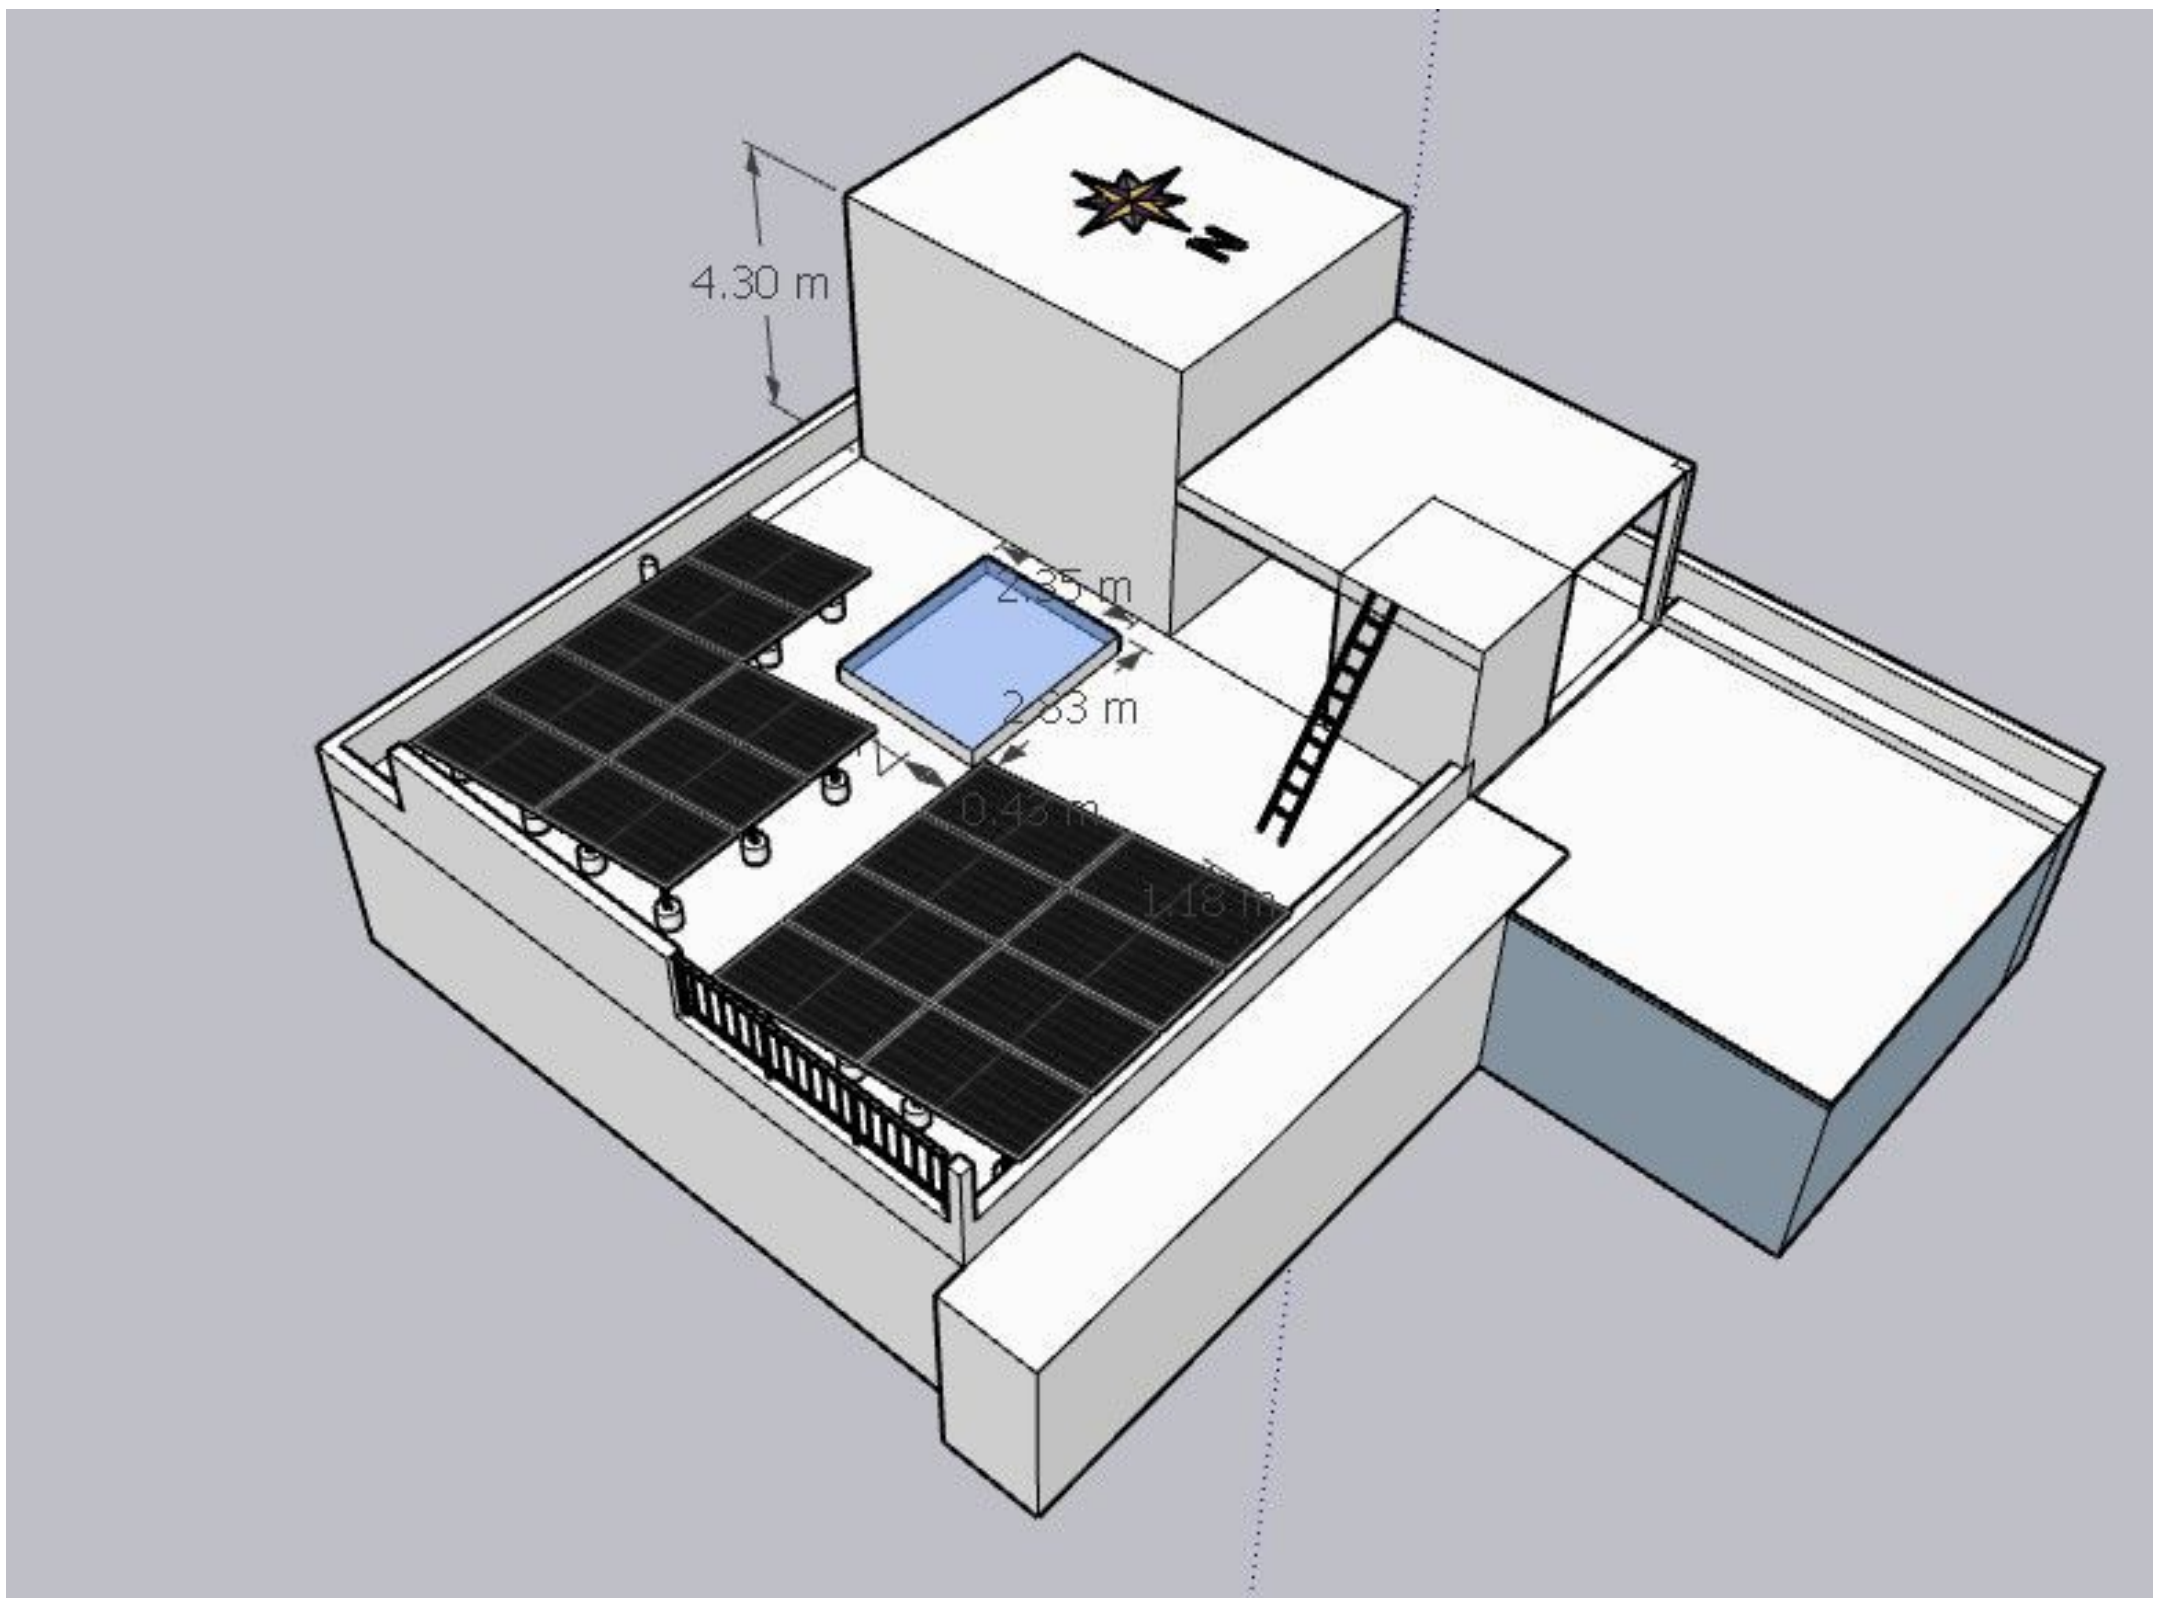
4.30 m
2.35 m
2.83 m
0.43 m
1.18 m

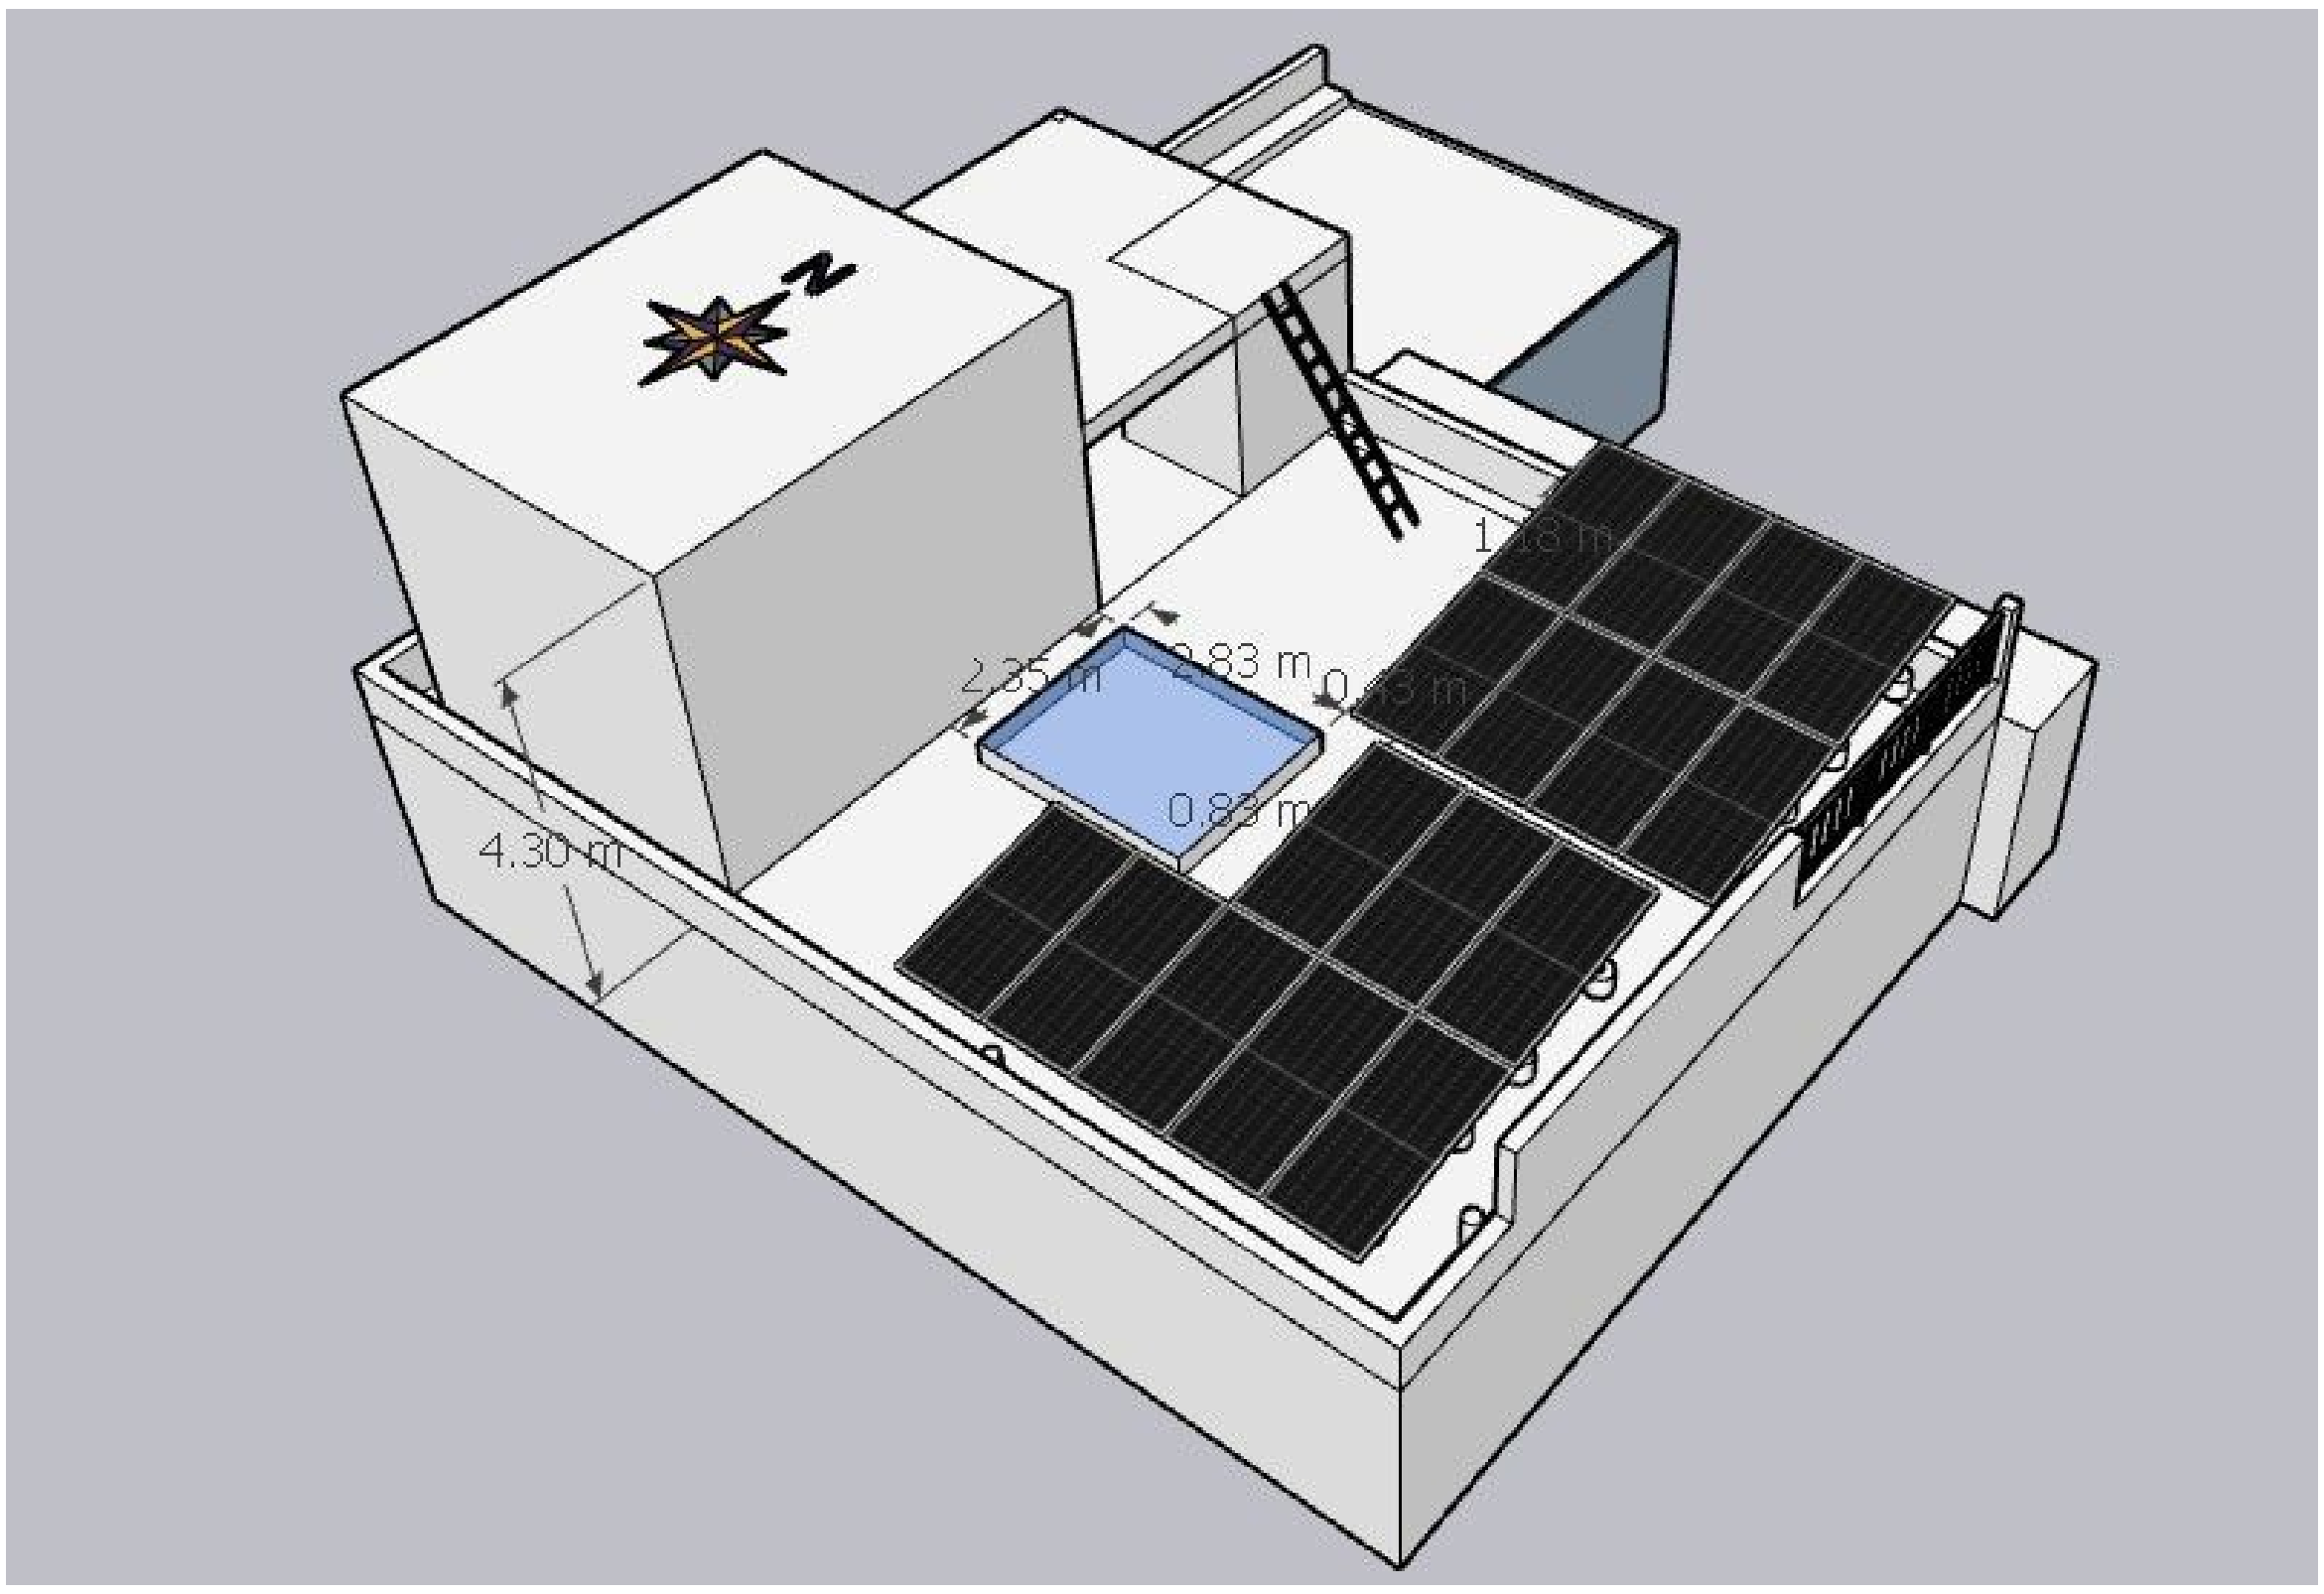
1.18 m
2.35 m
2.83 m
0.43 m
0.83 m
4.30 m

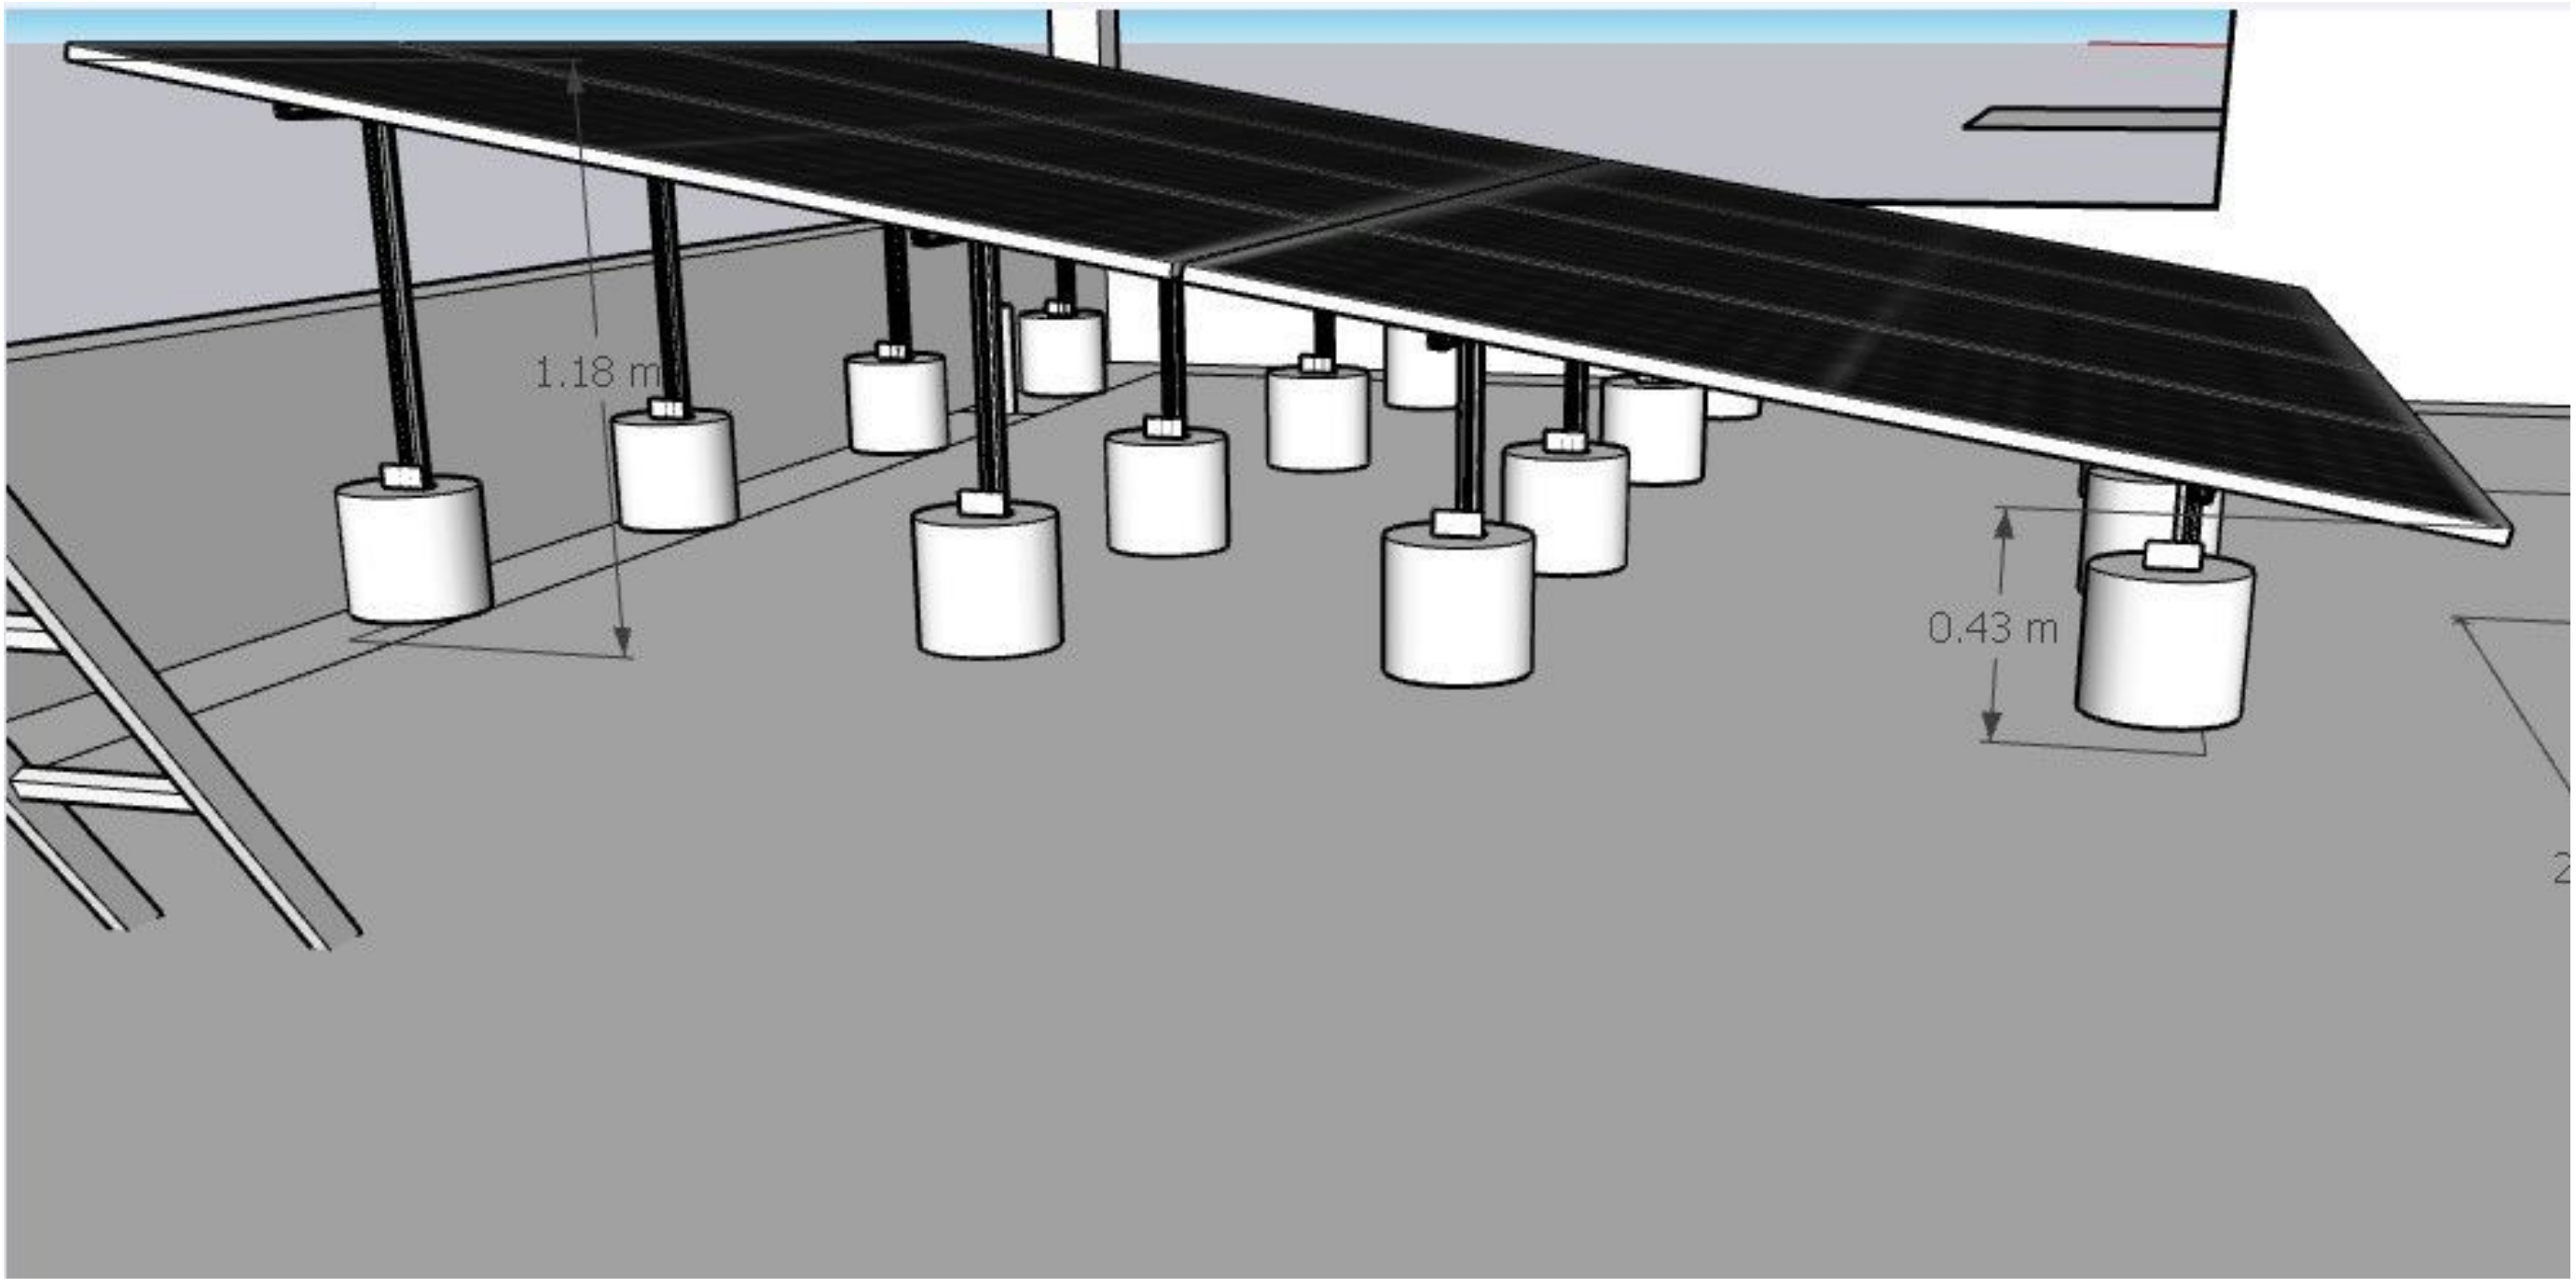

Shadow Analysis

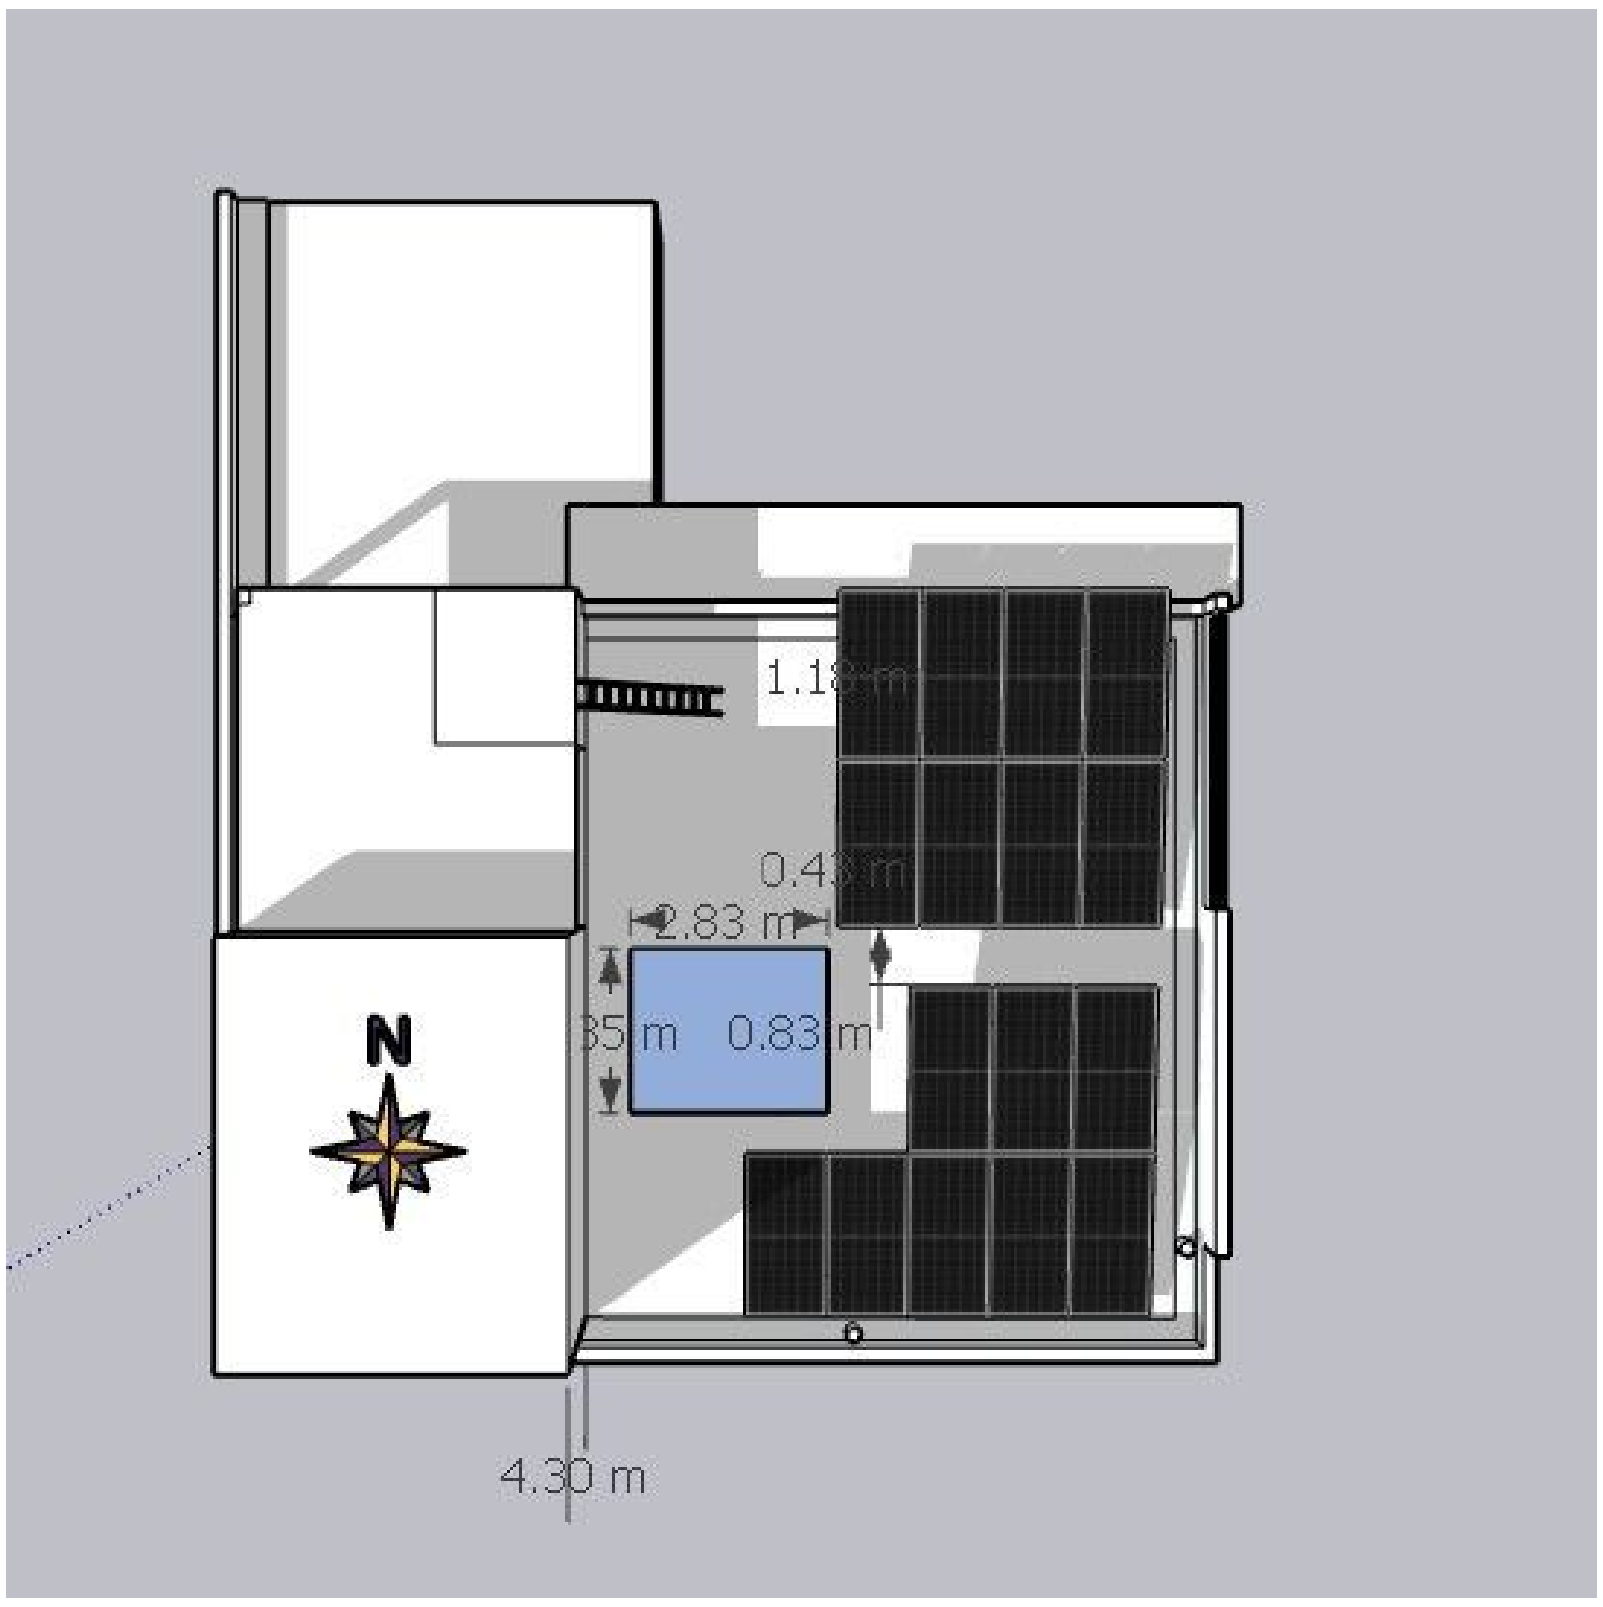

From January to December, between 09:00 AM and 11:00 AM, the east-side parapet wall will cast a shadow on the solar panels.

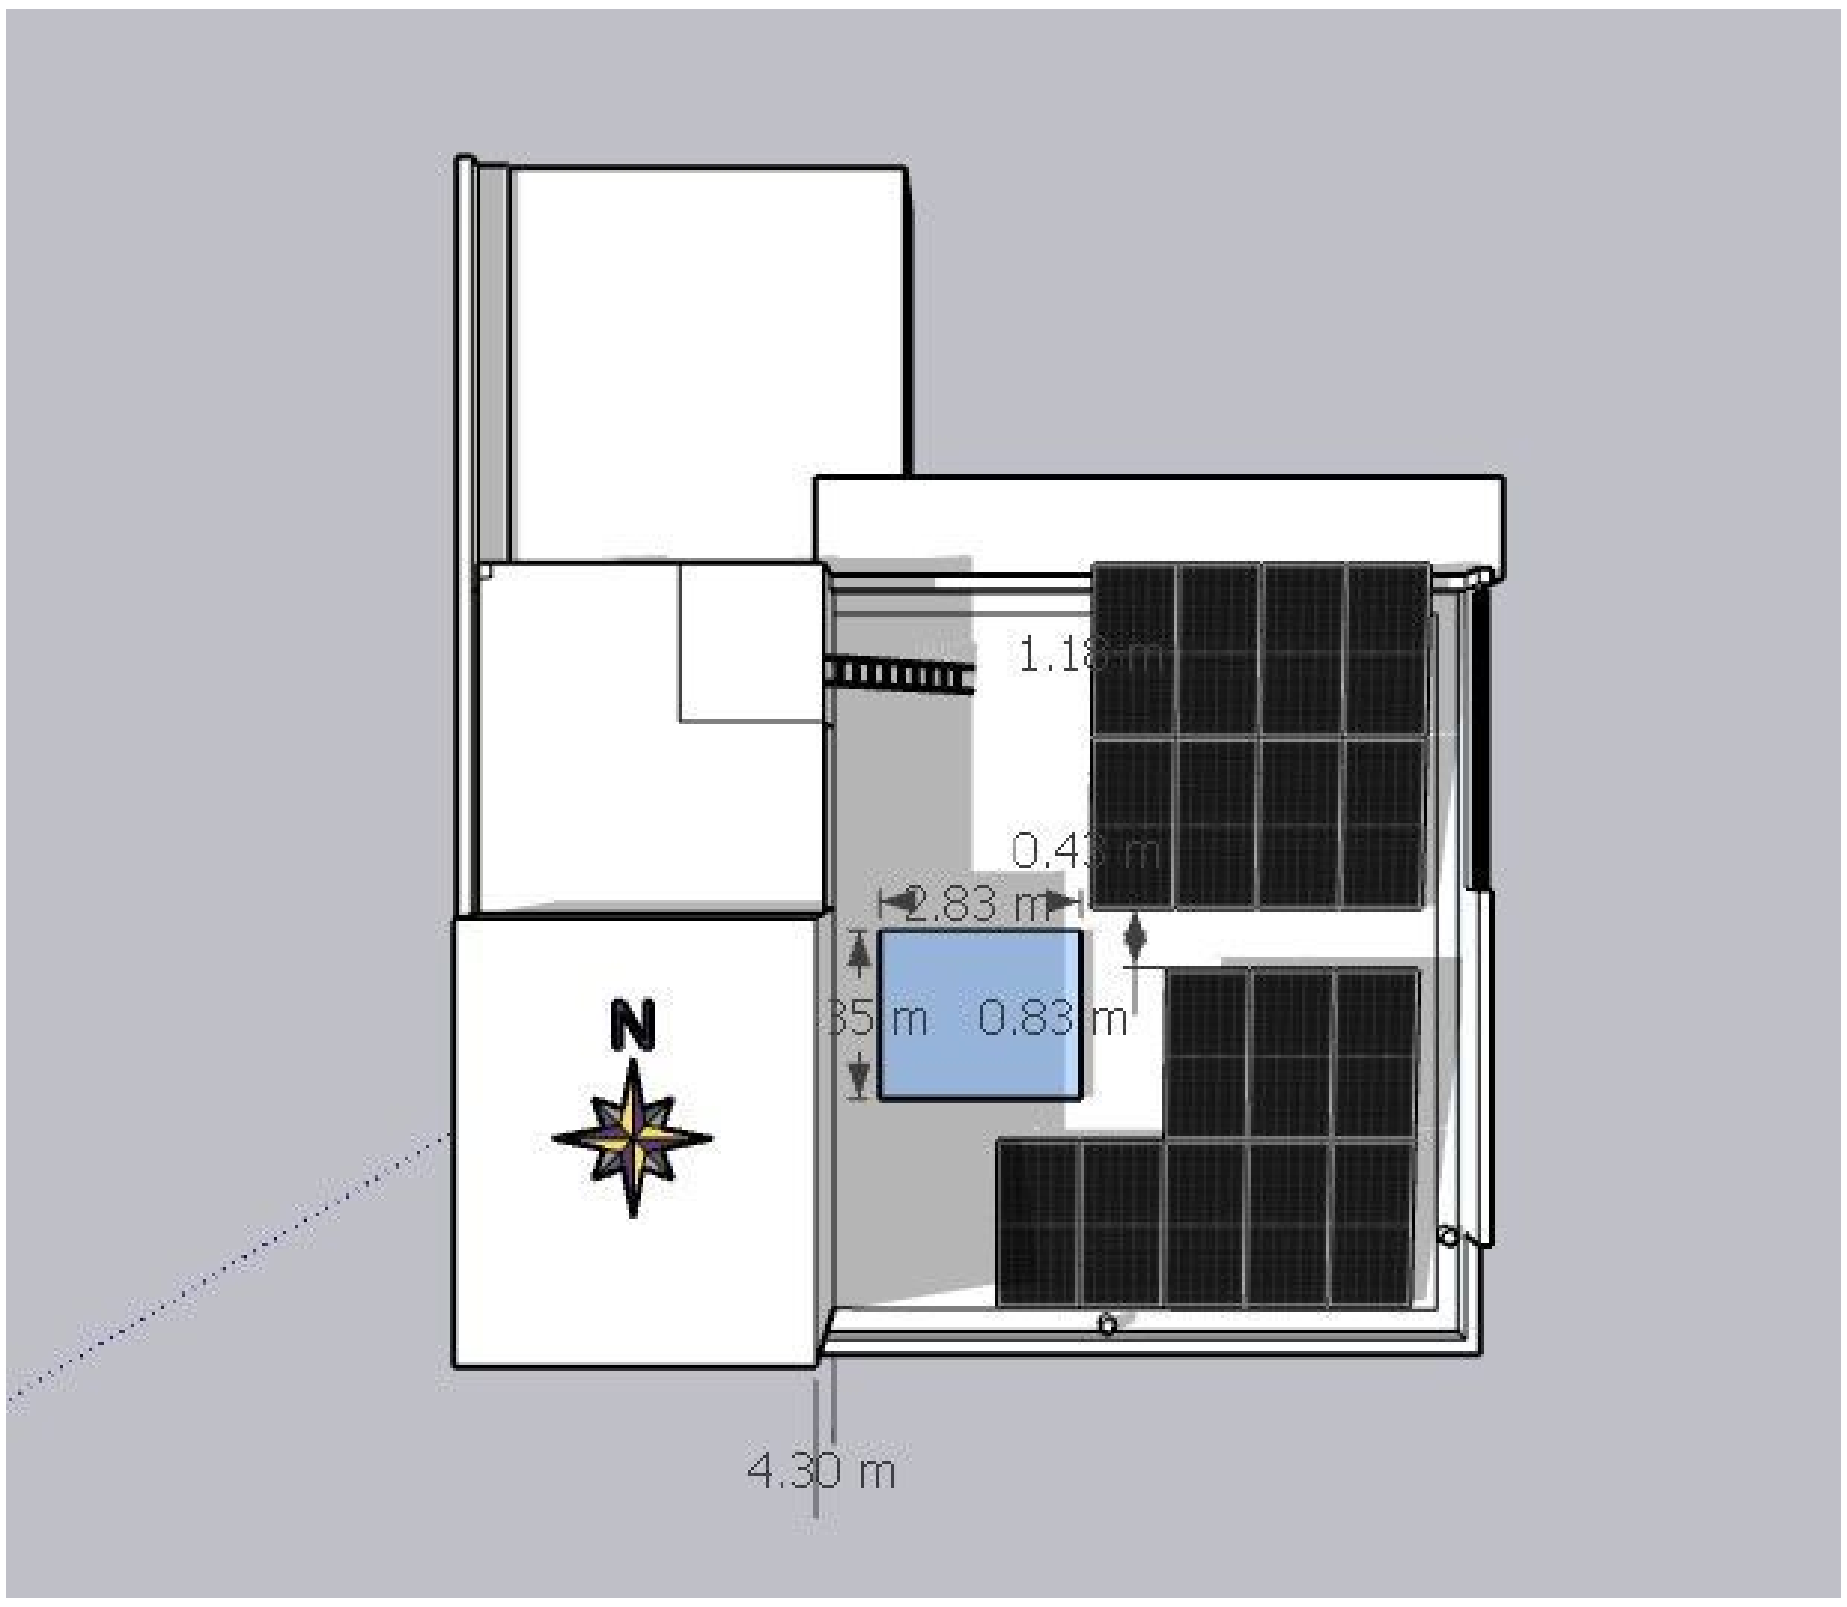

From January to February, between 03:00 PM and 04:30 PM, the west-side parapet wall will cast a shadow on the solar panels.

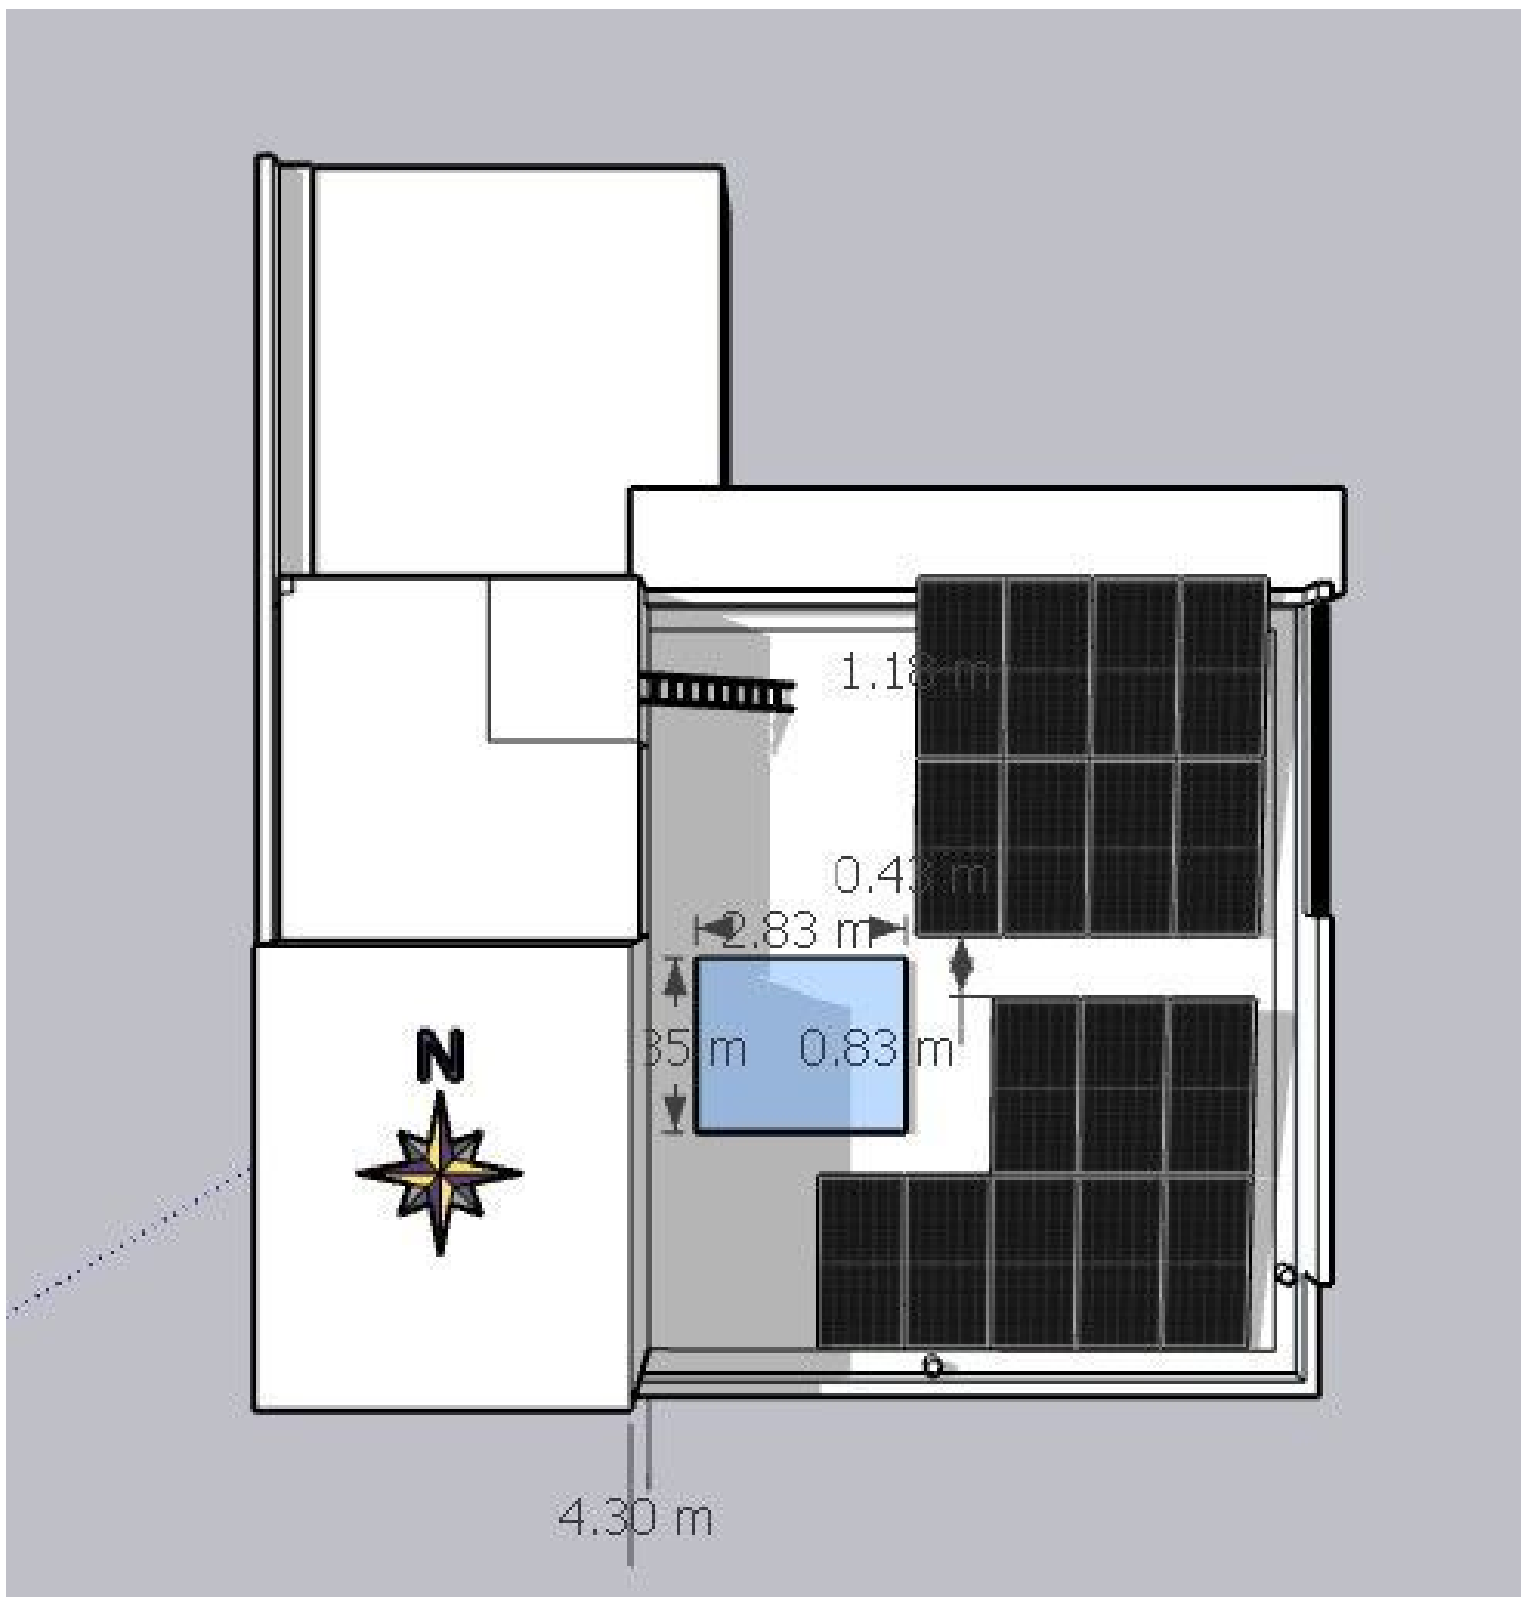

From April to August, between 02:00 PM and 04:30 PM, the west-side headroom will cast a shadow on the first row of panels.

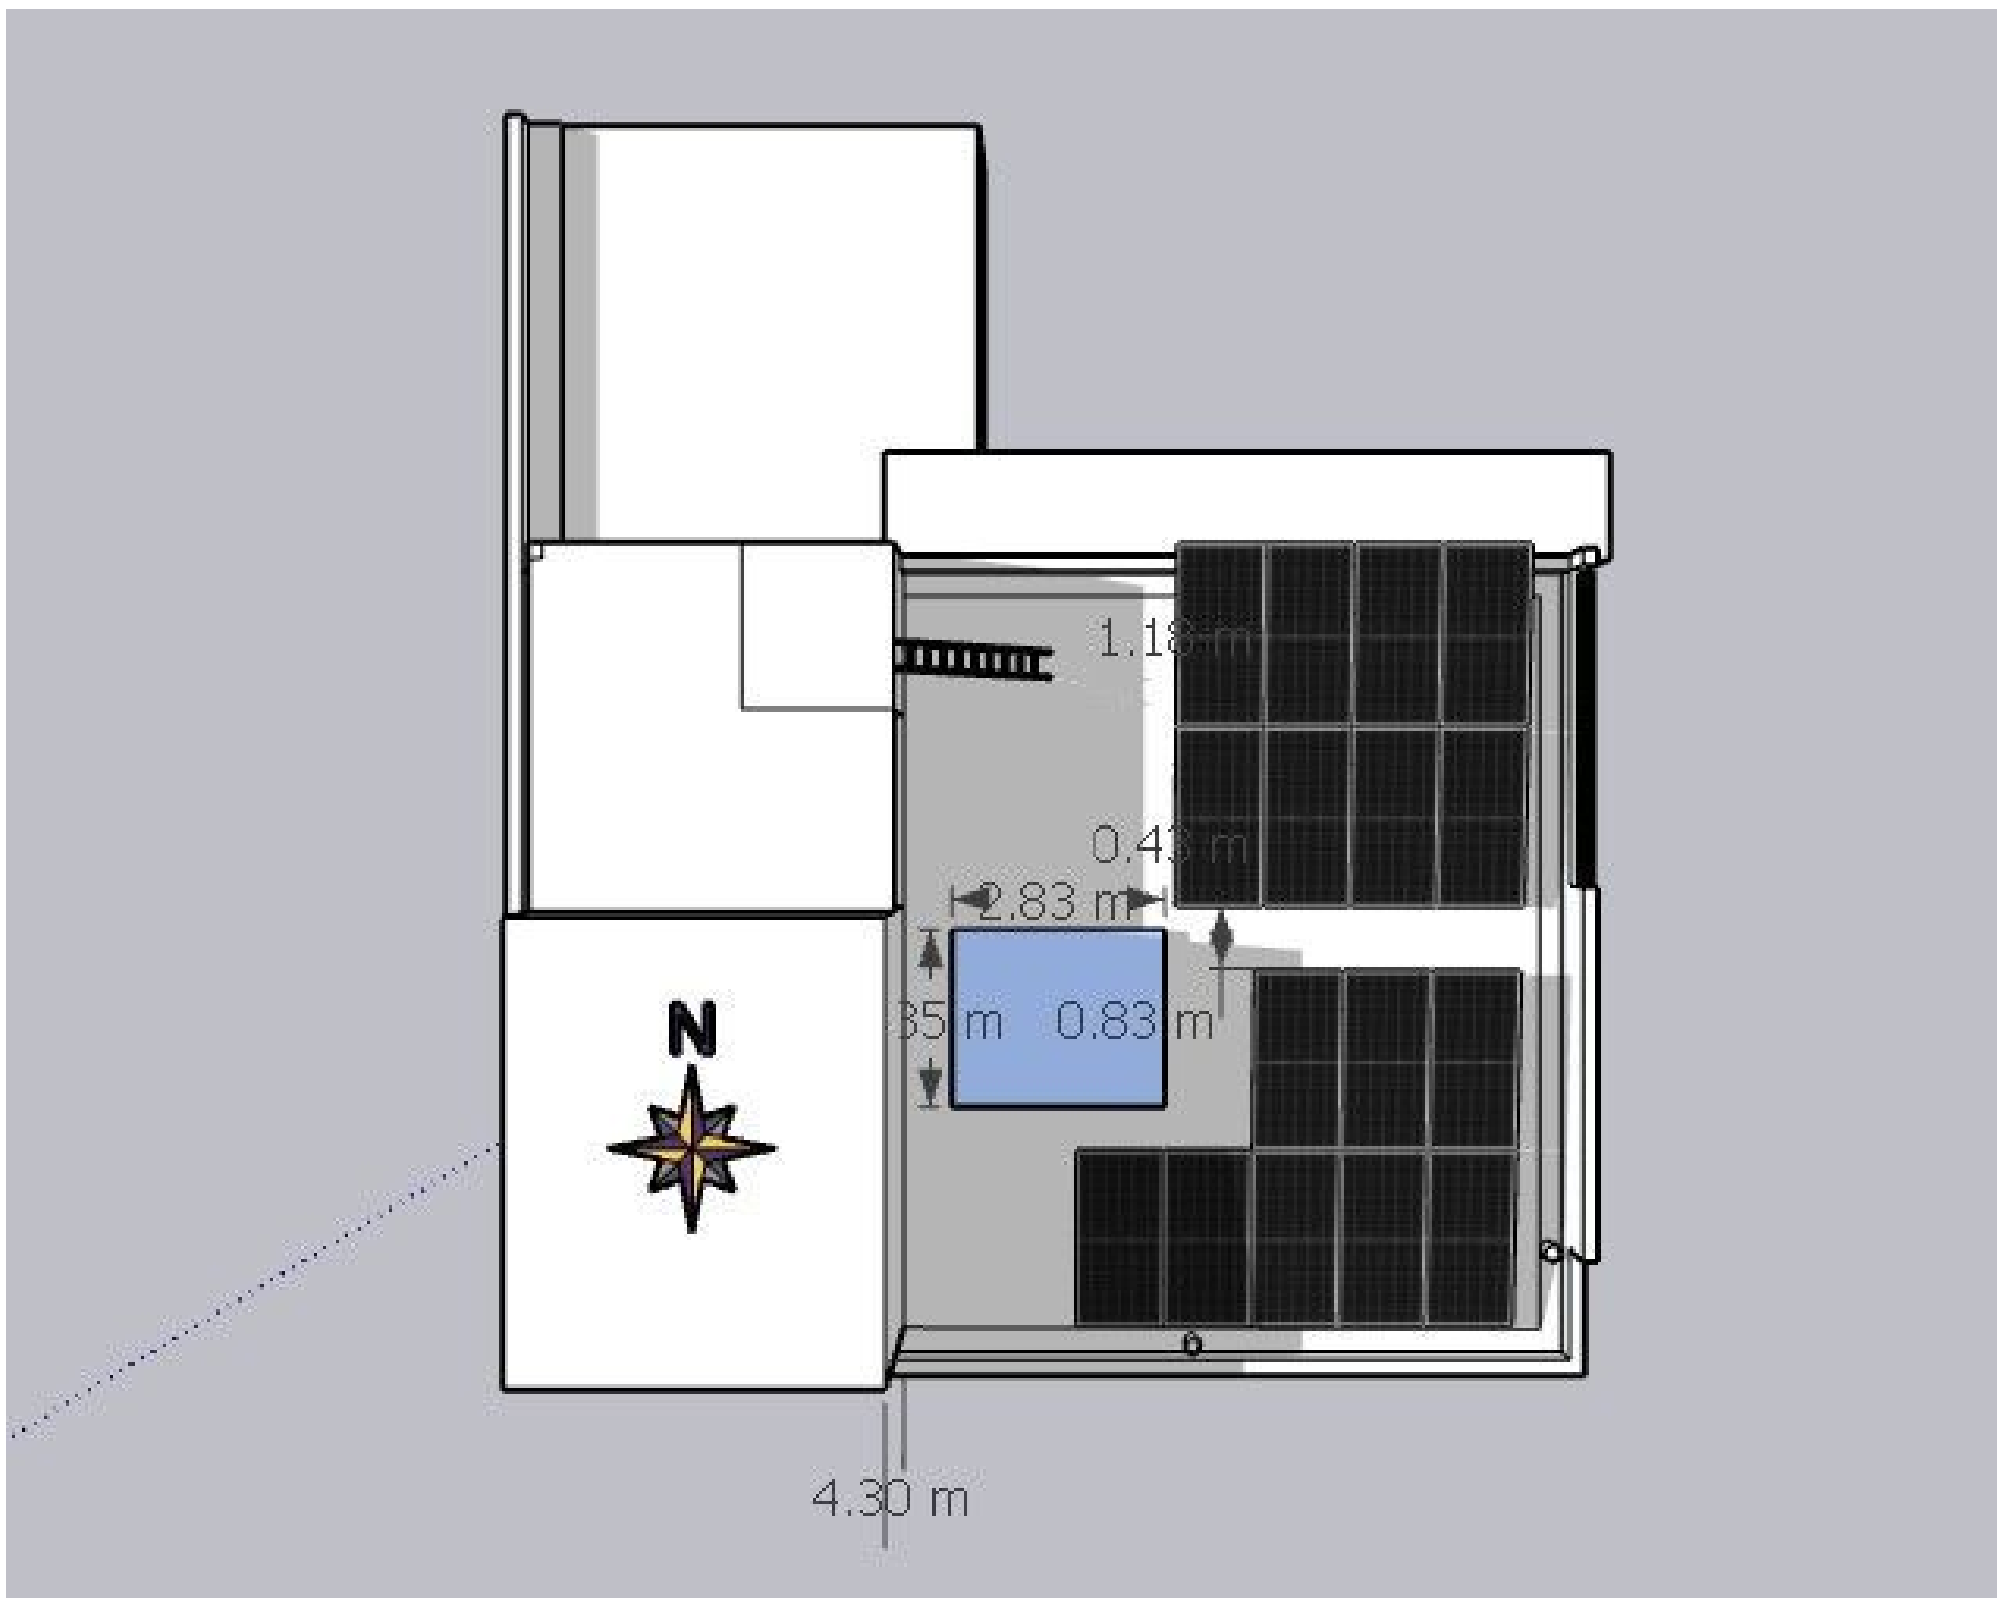

From September to December, between 02:00 PM and 04:30 PM, the west-side headroom will cast a shadow on the first two rows of panels.

Building Exterior

Existing Electrical

Client already done the AC cabling from inverter location to main meter location

OBSERVATIONS & RECOMMENDATIONS

Customer Scope

#	Observation
1	WI-Fi up to the inverter location is under customer scope
2	As per the customer suggestions only the panel layout, earthing, cable routing has been considered.
3	UPS point near the inverter location is under customer scope.
4	AC, DC earthing cables have to pull in the existing conduit pipe near the north side corridor is under customer scope.
5	Client already done the AC cabling from inverter location to main meter location

THANK YOU

Dear Vasanth,

Thank you for choosing EcoSoch Solar for your solar installation. We appreciate your trust in us and your commitment to sustainable energy. Our team is dedicated to ensuring a seamless installation experience and long-term performance of your solar system.

Should you have any questions or require further assistance, please do not hesitate to reach out to us.

Warm Regards,
Team EcoSoch

& Did You Know?

The Sun burns 600 million tonnes of hydrogen per second — and your panels get a share.

EcoSoch Solar Pvt. Ltd.

#940, Sha Arcade, 2nd Phase, NTI Layout, Kodigehalli, Bengaluru 560097

www.ecosoch.com | info@ecosoch.com