ECO SOCH® Sunny Living

Technical Site Visit Report

Prepared for: Dr Arun - Villa 252

PROJECT INFORMATION

Report Number	ESV-2026-0082
Project ID	5C90BDD2
Project Name	Dr Arun
Building Name	Villa 252
Billing Name	Dr Arun
Project Sector	Residential
Project Type	Without Subsidy
Sales Lead	Gautam
Site Address	Villa 252, Nambiar Bellezea, Chandapura Dommasandra Road Circle, near Muthanallur, Narayanaghatta Village, Bengaluru, Bommasandra, Karnataka 560099
GPS Coordinates	12.8467907, 77.7212051
Google Maps	https://www.google.com/maps?q=12.8467907,77.7212051
Visit Date	2026-04-15
Visited By	K Naveen
Revision	Rev 3

CLIENT INFORMATION

Client Name	Dr Arun
Contact	+91 80085 79479

PROJECT DETAILS

Solar Rooftop System Type	On-Grid
System Capacity (kWp)	4.92
Sanction Load (kW)	8

Module Make & Capacity	Waaree Bifacial Non DCR 615
Module Length (mm)	2382
Module Width (mm)	1134
Number of Panels	8
Inverter Type	Hybrid (Enphase)
Inverter Brand	Enphase IQ8P
Number of Inverters	8
Battery	Needed
Number of Batteries	1
Capacity of each Battery (kWh)	5.0
Battery Model No.	Enphase IQ 5P Battery 5kWh
Mounting Structure Type	Sheet Roof

SITE INSPECTION CHECKLIST

Roof Details

#	Question	Answer	Notes
1	What type of roof is present at the site?	Corrugated Sheet Roof	-
2	Are there any obstructions on the roof that could affect the solar installation?	**No**	-
3	What is the angle of the panels? (in degrees)	7	-
4	In case of sloped roof, what is the slope angle of the roof? (in degrees)	7	-
5	On how many roofs at the site are we installing solar?	1	*In one existing roof two corrguated sheet roof are available*
6	If it is a Tiled roof, what is underneath the tiles?	N/A	-
7	If it is a Tiled roof with MS or Wooden rafters, is it Single-tiled or Double-tiled?	N/A	-
8	What type of mounting structure is planned?	Mini-rails	*AL Short Rail Elevated structure*
9	What is the orientation of the solar panels?	["South"]	-
10	How can the roof be accessed?	Ladder	-
11	Is the building currently under construction?	Yes	-
12	In an under-construction building, are existing conduit pipes available for AC, DC cables, and earthing?	Yes	*The existing conduit pipe is available from main meter location to electrical shaft .From shaft to till terrace there is no provision.*

#	Question	Answer	Notes
13	What is the height of the building and how many floors does it have?	G+1+Headroom is approximately 10 meters	-
14	Is the site photo matching with the building description?	Yes	-
15	Is there an overhead HT line passing within a 10-meter radius of the site?	**No**	-

General

#	Question	Answer	Notes
1	Can the delivery van/truck reach the material unloading point?	Yes	-
2	Are there any obstacles at the site that could hinder material lifting?	Yes	-
3	Where will the Inverter, DCDB, ACDB, Battery, etc. be located?	N/A	-
4	Is a canopy required for protecting the Inverters/ACDB/DCDB?	N/A	-
5	Did you discuss the location of the earth pits with the customer?	The location of the earth is pits rear side of the house which is located south facing garden area	-
6	Where is the Internet Router located?	Customer scope	*The site is still under construction*
7	What's the Wi-Fi strength of the router near to the String inverter/Envoy?	Not Available / Under Construction	-
8	Did you pin the site location in your WhatsApp when you were at the site?	Yes	-

Residential / Electrical

#	Question	Answer	Notes
1	What type of energy meter is currently installed?	Phase: Three Phase, Type: Digital, If 3-phase: Normal Three Phase	-
2	Is the Meter cubicle photo matching with the previous answer?	Yes	-
3	Has the termination point in the Main meter panel been identified?	Yes	-
4	Is the Termination Point easily visible or sealed?	Visible	-
5	Is a Lightning Arrestor (LA) already available at the site?	**No**	-
6	Is space available for CT within Energy meter panel?	N/A	-
7	In case of an Enphase system, is the distance between the farthest micro-inverter and IQ Gateway > 50m?	Less than 50m	-
8	Provide details of the existing CT ratings (if applicable).	N/A	-
9	In Main meter panel, is empty space available for solar meter?	Yes	-
10	In Main meter panel, is empty space available to house the Enphase accessories or ACDB components?	Yes	-

#	Question	Answer	Notes
11	Is there space available to dig DC, AC and LA earth pits?	Yes	-
12	In case of elevated structures, is an LA extension provided at the far end?	N/A	-
13	In case of elevated structures, is it with or without grouting?	N/A	-
14	Are there any challenges with respect to Installation and Maintenance activities?	**No**	-
15	Are there any safety risks associated with accessing the roof for installation?	N/A	-
16	Is space present in rooftop to store the panels?	Horizontally sleeping	-
17	In case of sloped roof MS structure, provide the dimension of rafter to rafter, purlin to purlin.	N/A	-
18	Is ventilation available in the battery location?	Yes	*Client will made a provision for ventilation for battery location.*
19	Should the Inverters/ACDB/DCDB be installed on a metal grill or wall mount?	N/A	-
20	Provide the dimensions for solar meter cubicle placement (L x W of wall).	length: 830, width: 900	-
21	Provide the dimension for earth pits location (L x W of available space).	length: 2000, width: 2000	-
22	Is LAN cable under customer scope?	**No**	-
23	Is there any shadow that affects the solar installation?	**No**	-
24	Is there any trench work to be done to carry the AC cable to the meter location?	**No**	-

PHOTO DOCUMENTATION

Cable Routing Legend

Legend	Description
	Proposed PV Module Array
	Main Meter Location
	Solar Meter
	Battery
	Inverter
	Other Equipment
	DC Cable
	AC Cable
	Material Shifting
	DC Earthing Cable
	AC Earthing Cable
	LA Cable
	DC Earth Pit
	AC Earth Pit
	LA Pit
	LA

Material Delivery Route

This route (using staircase) will be followed to carry small items.

This route (using lifting) will be followed to carry large items (like Panels).

Staircase Details

Meter Box

Material Storage

Proposed PV Area

Cable Routing

Make a hole to run the AC cable, DC and LA earthing routing through the electrical shaft

Make a hole to run the AC cable till the existing conduit pipe

Run the AC cable in the conduit pipe till the main meter location

Equipment Location

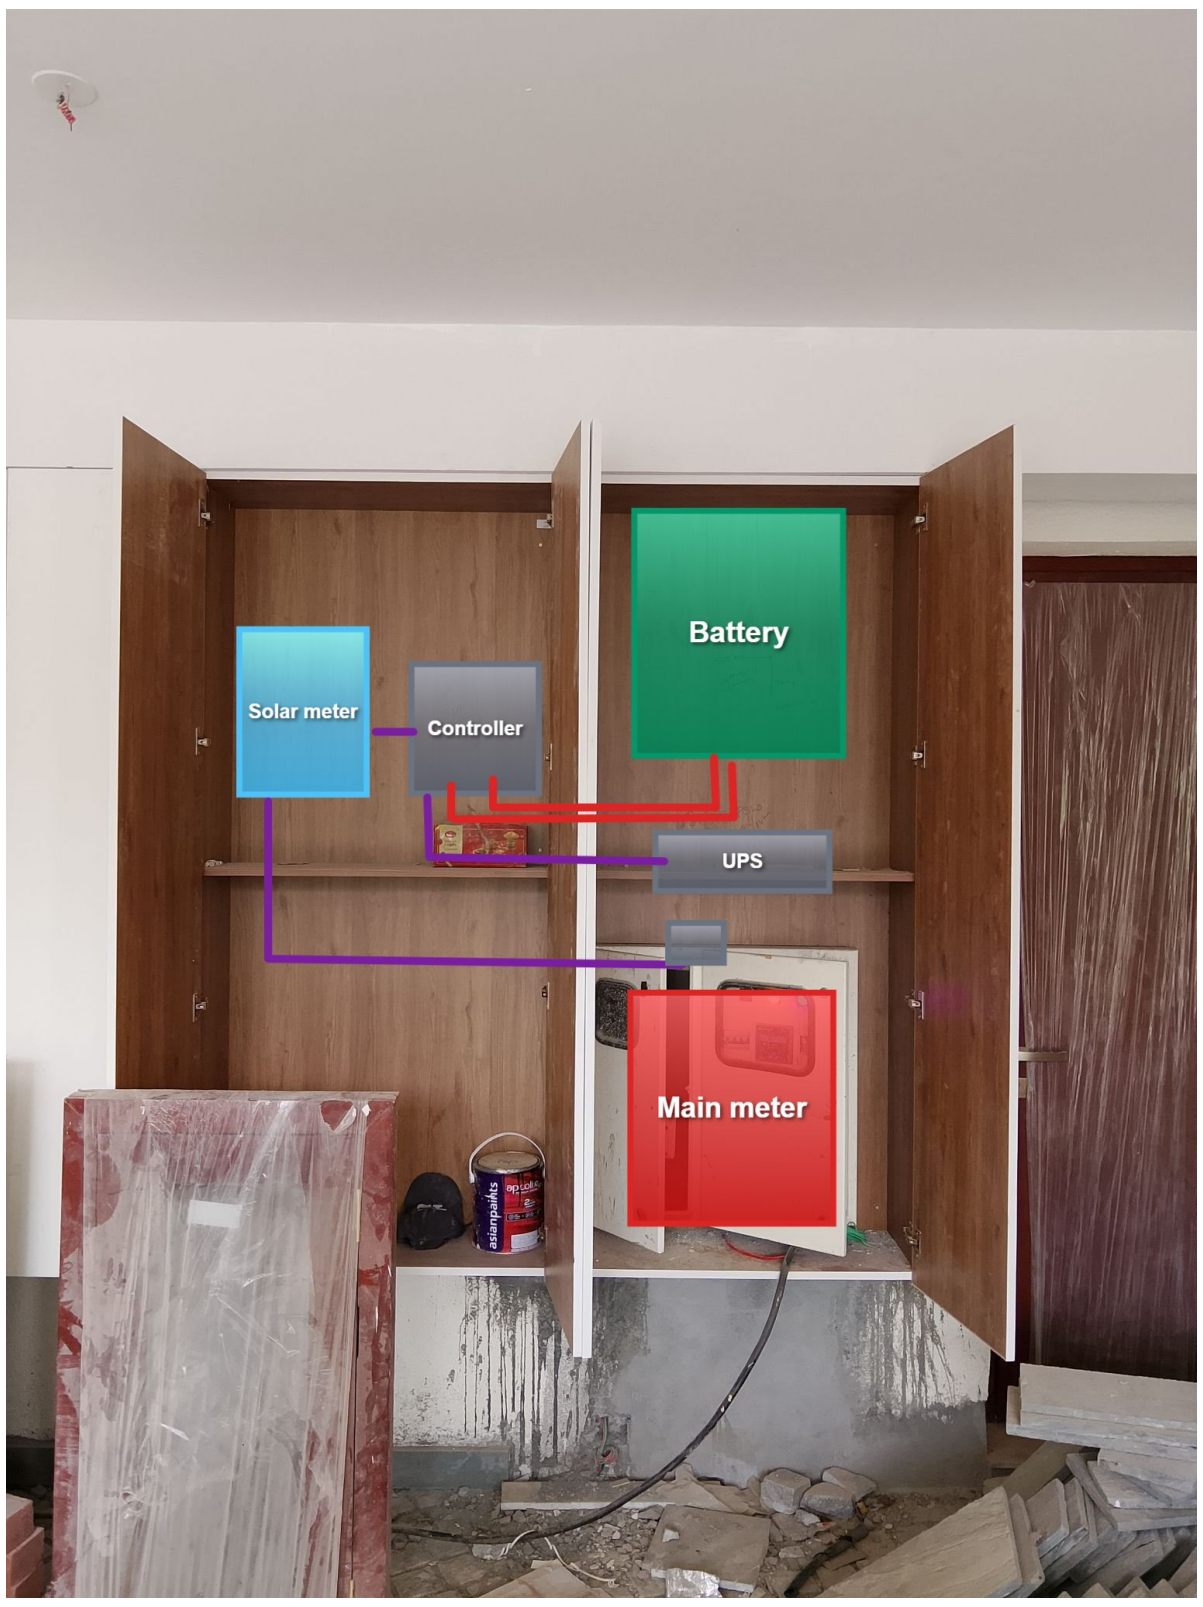

Earth Pit Location

Run the AC earthing cable below the cupbaord

Site Layout - Top View

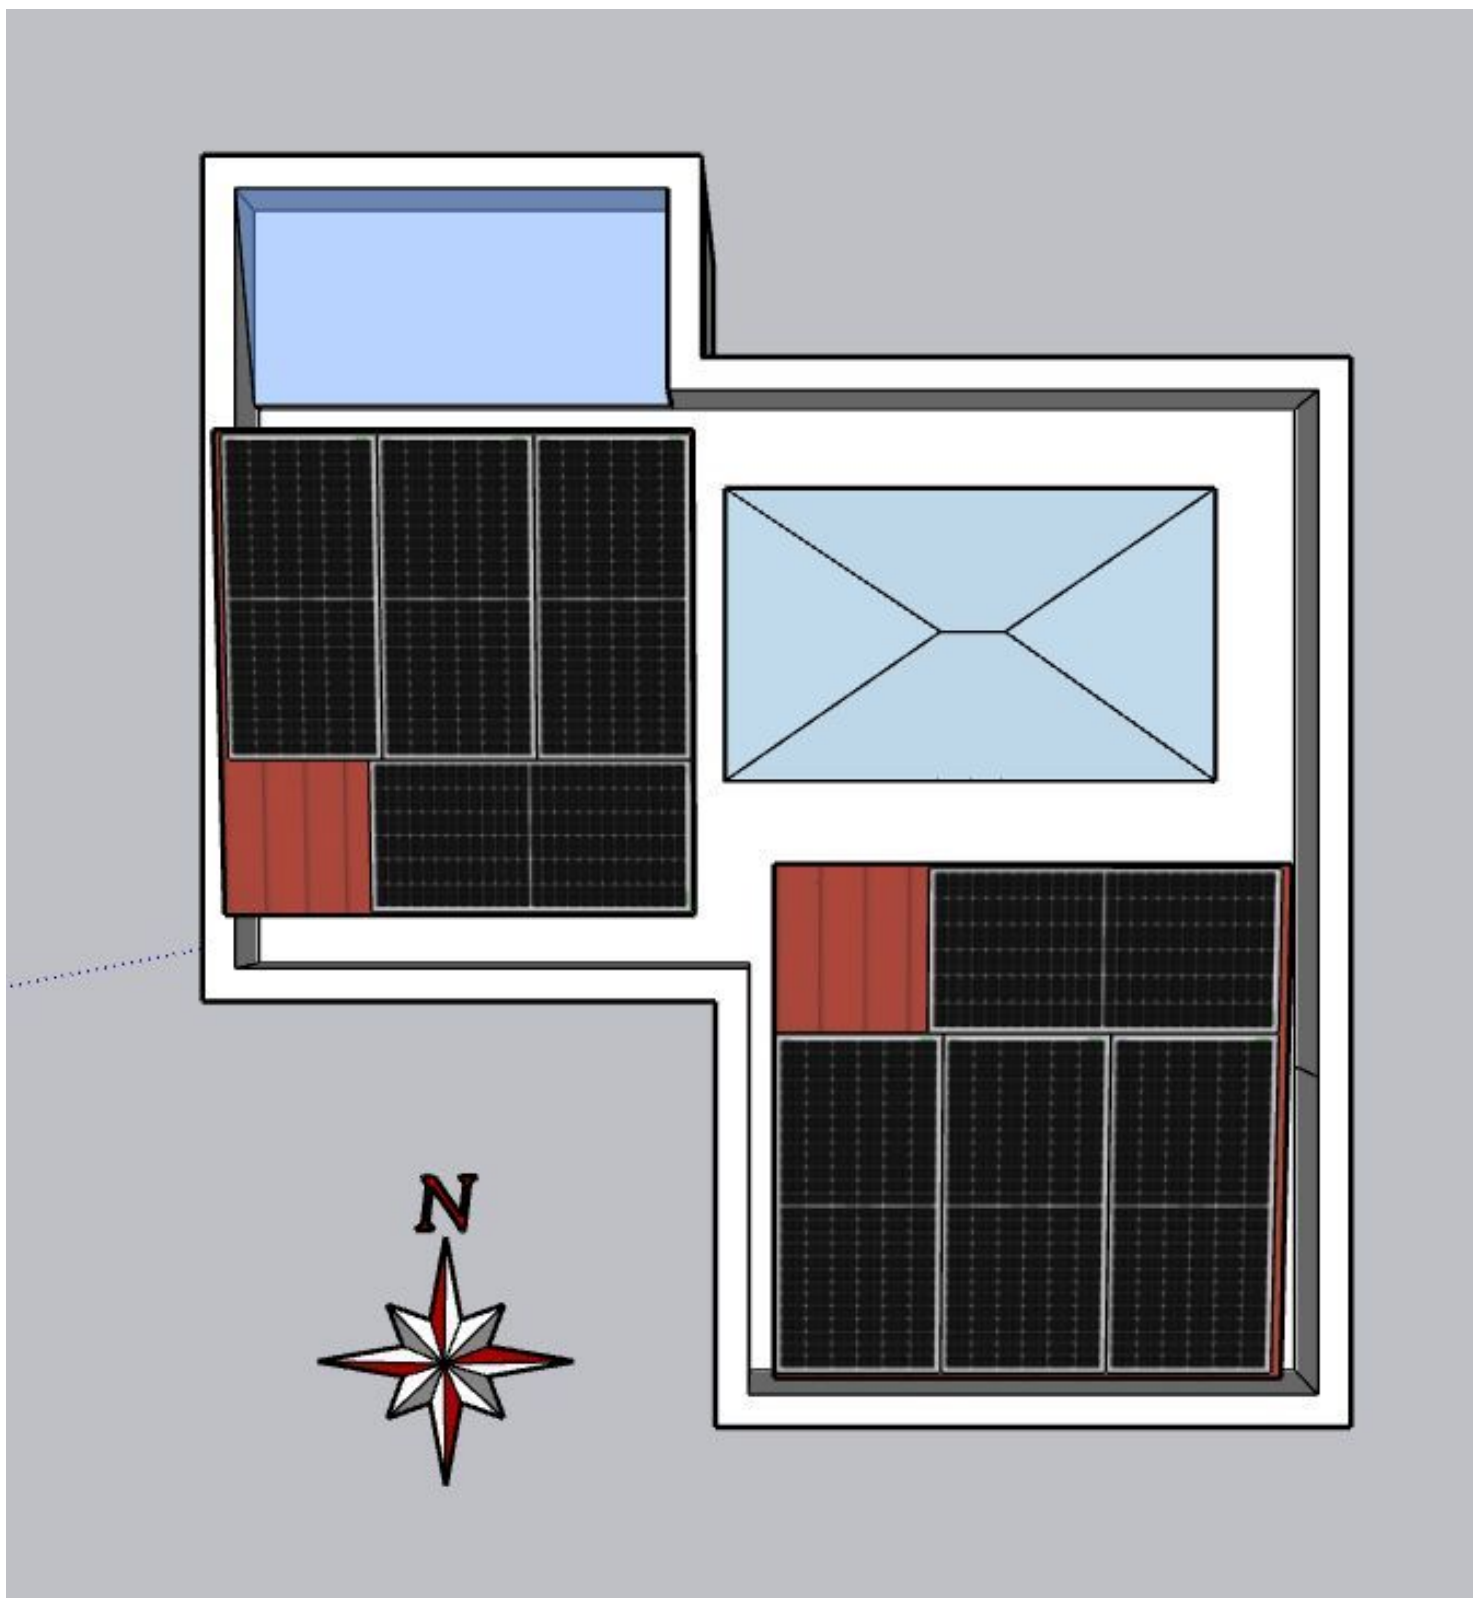
N

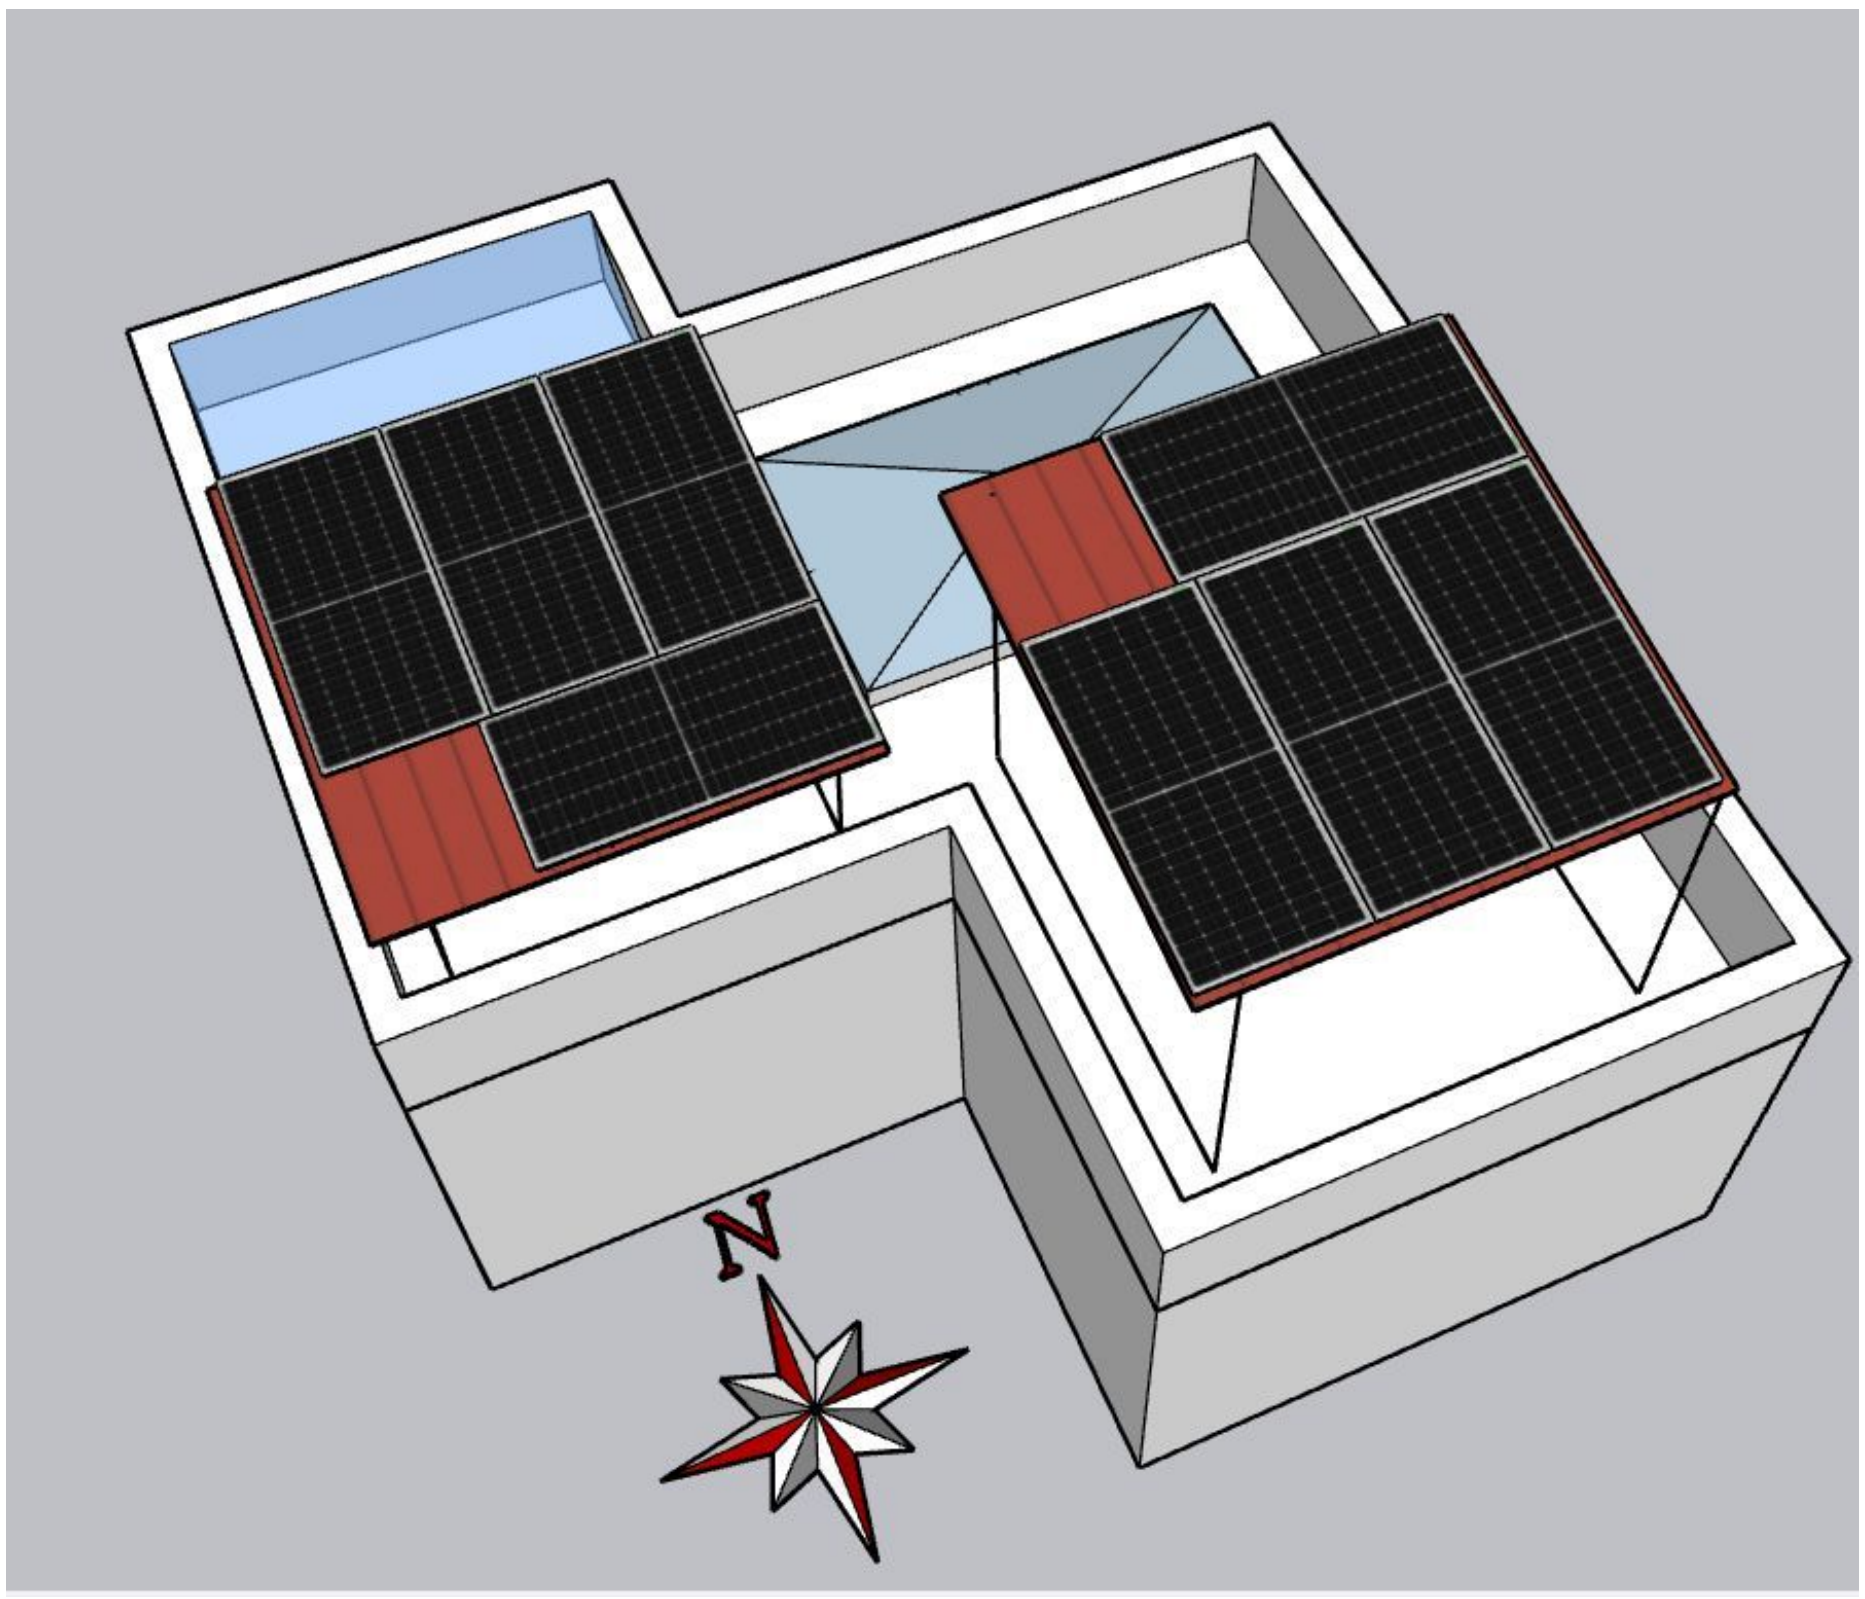
N

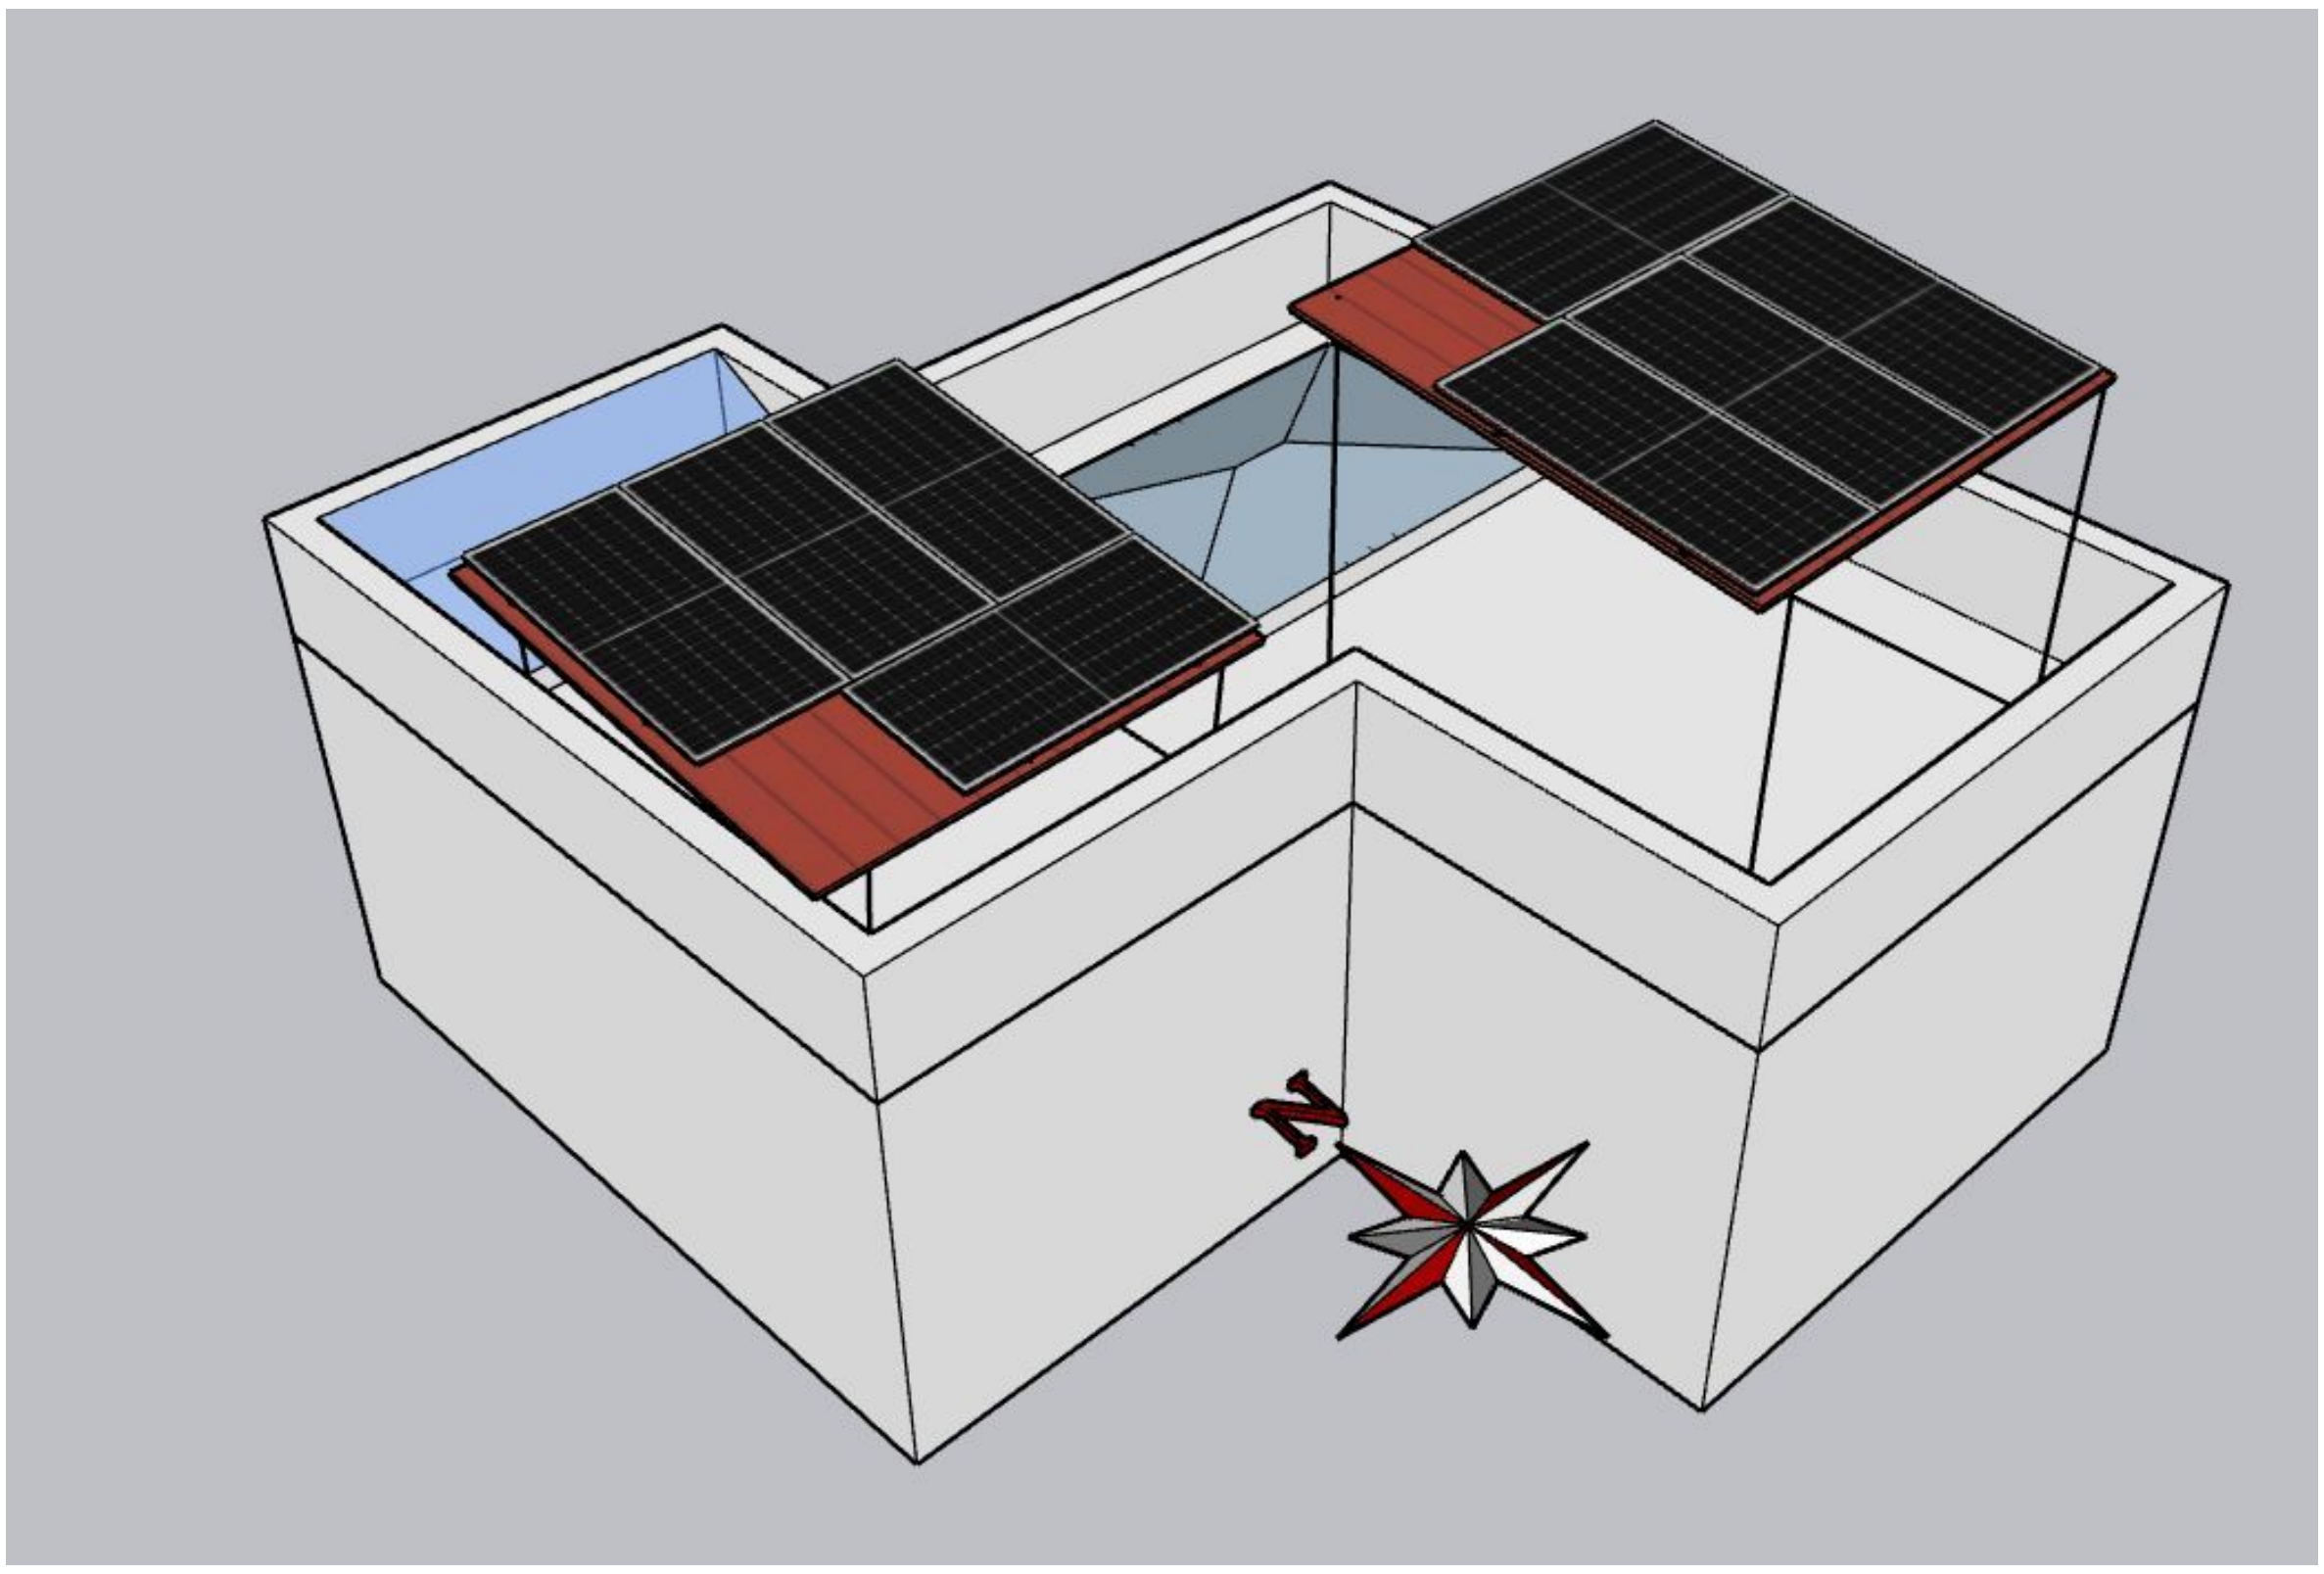

Building Exterior

OBSERVATIONS & RECOMMENDATIONS

Customer Scope

#	Observation
1	Wi-Fi up to the solar meter location is under customer scope
2	MS fabrication is under customer scope
3	Make a hole to run the AC cable till the meter location is under customer scope
4	To avoid the obstructions for placing battery near the solar meter location is under customer scope
5	Make a ventilation for battery location is under customer scope
6	UPS point near the solar meter location is under customer scope
7	As per the site engineer suggestions only the above cable routing and earthing location has been considered

THANK YOU

Dear Dr Arun,

Thank you for choosing EcoSoch Solar for your solar installation. We appreciate your trust in us and your commitment to sustainable energy. Our team is dedicated to ensuring a seamless installation experience and long-term performance of your solar system.

Should you have any questions or require further assistance, please do not hesitate to reach out to us.

Warm Regards,
Team EcoSoch

& Did You Know?

The Sun burns 600 million tonnes of hydrogen per second — and your panels get a share.

EcoSoch Solar Pvt. Ltd.
#940, Sha Arcade, 2nd Phase, NTI Layout, Kodigehalli, Bengaluru 560097
www.ecosoch.com | info@ecosoch.com