Technical Site Visit Report

Prepared for: M N Shamanna_Banagirinagara Subsidy_3.07kWp_Microinverter (IQ Series)

PROJECT INFORMATION

Report Number	ESV-2026-0133
Project ID	7485B380
Project Name	M N Shamanna_Banagirinagara Subsidy_3.07kWp_Microinverter (IQ Series)
Project Sector	Residential
Project Type	With Subsidy
Sales Lead	Govindaraju JS
Site Address	#3, 2nd Cross, 3rd Main, Banagirinagar, BSK 3rd Stage, Bangalore 560085.
GPS Coordinates	12.926078, 77.559577
Google Maps	https://www.google.com/maps?q=12.926078,77.559577
Visit Date	2026-06-06
Visited By	ABILASH N K
Revision	Rev 4

CLIENT INFORMATION

Client Name	M N Shamanna
Contact	9535572084

PROJECT DETAILS

Solar Rooftop System Type	On-Grid
System Capacity (kWp)	3.075
Sanction Load (kW)	3
Module Make & Capacity	Adani TOPCon Bi-facial DCR, 615 Wp
Module Length (mm)	2382
Module Width (mm)	1133

Number of Panels	5
Inverter Type	Micro
Inverter Brand	Enphase IQ8P
Number of Inverters	5
Mounting Structure Type	RCC Flat Roof

SITE INSPECTION CHECKLIST

General

#	Question	Answer	Notes
1	Can the delivery van/truck reach the material unloading point?	Yes	-
2	Are there any obstacles at the site that could hinder material lifting?	**No**	-
3	Where will the Inverter, DCDB, ACDB, Battery, etc. be located?	The Enphase accessories box has to be installed on the wall, near the main meter box on the ground floor.	-
4	Is a canopy required for protecting the Inverters/ACDB/DCDB?	**No**	-
5	Did you discuss the location of the earth pits with the customer?	Yes, Discussed with the customer and finalised the location for earthing.	-
6	Where is the Internet Router located?	Ground floor	-
7	What's the Wi-Fi strength of the router near to the String inverter/Envoy?	3 bars	-
8	Did you pin the site location in your WhatsApp when you were at the site?	Yes	-

Roof Details

#	Question	Answer	Notes
1	What type of roof is present at the site?	RCC Flat Roof	-
2	Are there any obstructions on the roof that could affect the solar installation?	details: The nearby building (height ~6 metres) is causing a shadow fall on the panels after 3pm.	-
3	What is the angle of the panels? (in degrees)	10	-
4	In case of sloped roof, what is the slope angle of the roof? (in degrees)	N/A	-

#	Question	Answer	Notes
5	On how many roofs at the site are we installing solar?	1	-
6	If it is a Tiled roof, what is underneath the tiles?	N/A	-
7	If it is a Tiled roof with MS or Wooden rafters, is it Single-tiled or Double-tiled?	N/A	-
8	What type of mounting structure is planned?	Elevated	-
9	What is the orientation of the solar panels?	["South"]	-
10	How can the roof be accessed?	Staircase	-
11	Is the building currently under construction?	No	-
12	In an under-construction building, are existing conduit pipes available for AC, DC cables, and earthing?	N/A	-
13	What is the height of the building and how many floors does it have?	7 metres. (G + 1)	-
14	Is the site photo matching with the building description?	Yes	-
15	Is there an overhead HT line passing within a 10-meter radius of the site?	No	-

Residential / Electrical

#	Question	Answer	Notes
1	What type of energy meter is currently installed?	Phase: Single, Type: Digital, If 3-phase: N/A	-
2	Is the Meter cubicle photo matching with the previous answer?	Yes	-
3	Has the termination point in the Main meter panel been identified?	Yes	-
4	Is the Termination Point easily visible or sealed?	Visible	-
5	Is a Lightning Arrestor (LA) already available at the site?	No	-
6	Is space available for CT within Energy meter panel?	N/A	-
7	In case of an Enphase system, is the distance between the farthest micro-inverter and IQ Gateway > 50m?	Less than 50m	-
8	Provide details of the existing CT ratings (if applicable).	N/A	-
9	In Main meter panel, is empty space available for solar meter?	No	-
10	In Main meter panel, is empty space available to house the Enphase accessories or ACDB components?	No	-
11	Is there space available to dig DC, AC and LA earth pits?	Yes	-
12	In case of elevated structures, is an LA extension provided at the far end?	No	-
13	In case of elevated structures, is it with or without grouting?	Without Grouting	-
14	Are there any challenges with respect to Installation and Maintenance activities?	No	-
15	Are there any safety risks associated with accessing the roof for installation?	No	-
16	Is space present in rooftop to store the panels?	Vertically leaning against the wall	-
17	In case of sloped roof MS structure, provide the dimension of rafter to rafter, purlin to purlin.	N/A	-
18	Is ventilation available in the battery location?	N/A	-

#	Question	Answer	Notes
19	Should the Inverters/ACDB/DCDB be installed on a metal grill or wall mount?	Wall mounted.	-
20	Provide the dimensions for solar meter cubicle placement (L x W of wall).	length: 500, width: 400	-
21	Provide the dimension for earth pits location (L x W of available space).	length: 3000, width: 500	-
22	Is LAN cable under customer scope?	Yes	-
23	Is there any shadow that affects the solar installation?	Yes	*The nearby building (height ~6 metres) is causing a shadow to fall on the panels after 3pm.*
24	Is there any trench work to be done to carry the AC cable to the meter location?	N/A	-

PHOTO DOCUMENTATION

Cable Routing Legend

Legend	Description
	Proposed PV Module Array
	Main Meter Location
	Solar Meter
	Battery
	Inverter
	Other Equipment
	DC Cable
	AC Cable
	Material Shifting
	DC Earthing Cable
	AC Earthing Cable
	LA Cable
	DC Earth Pit
	AC Earth Pit
	LA Pit
	LA

Site Layout - Top View

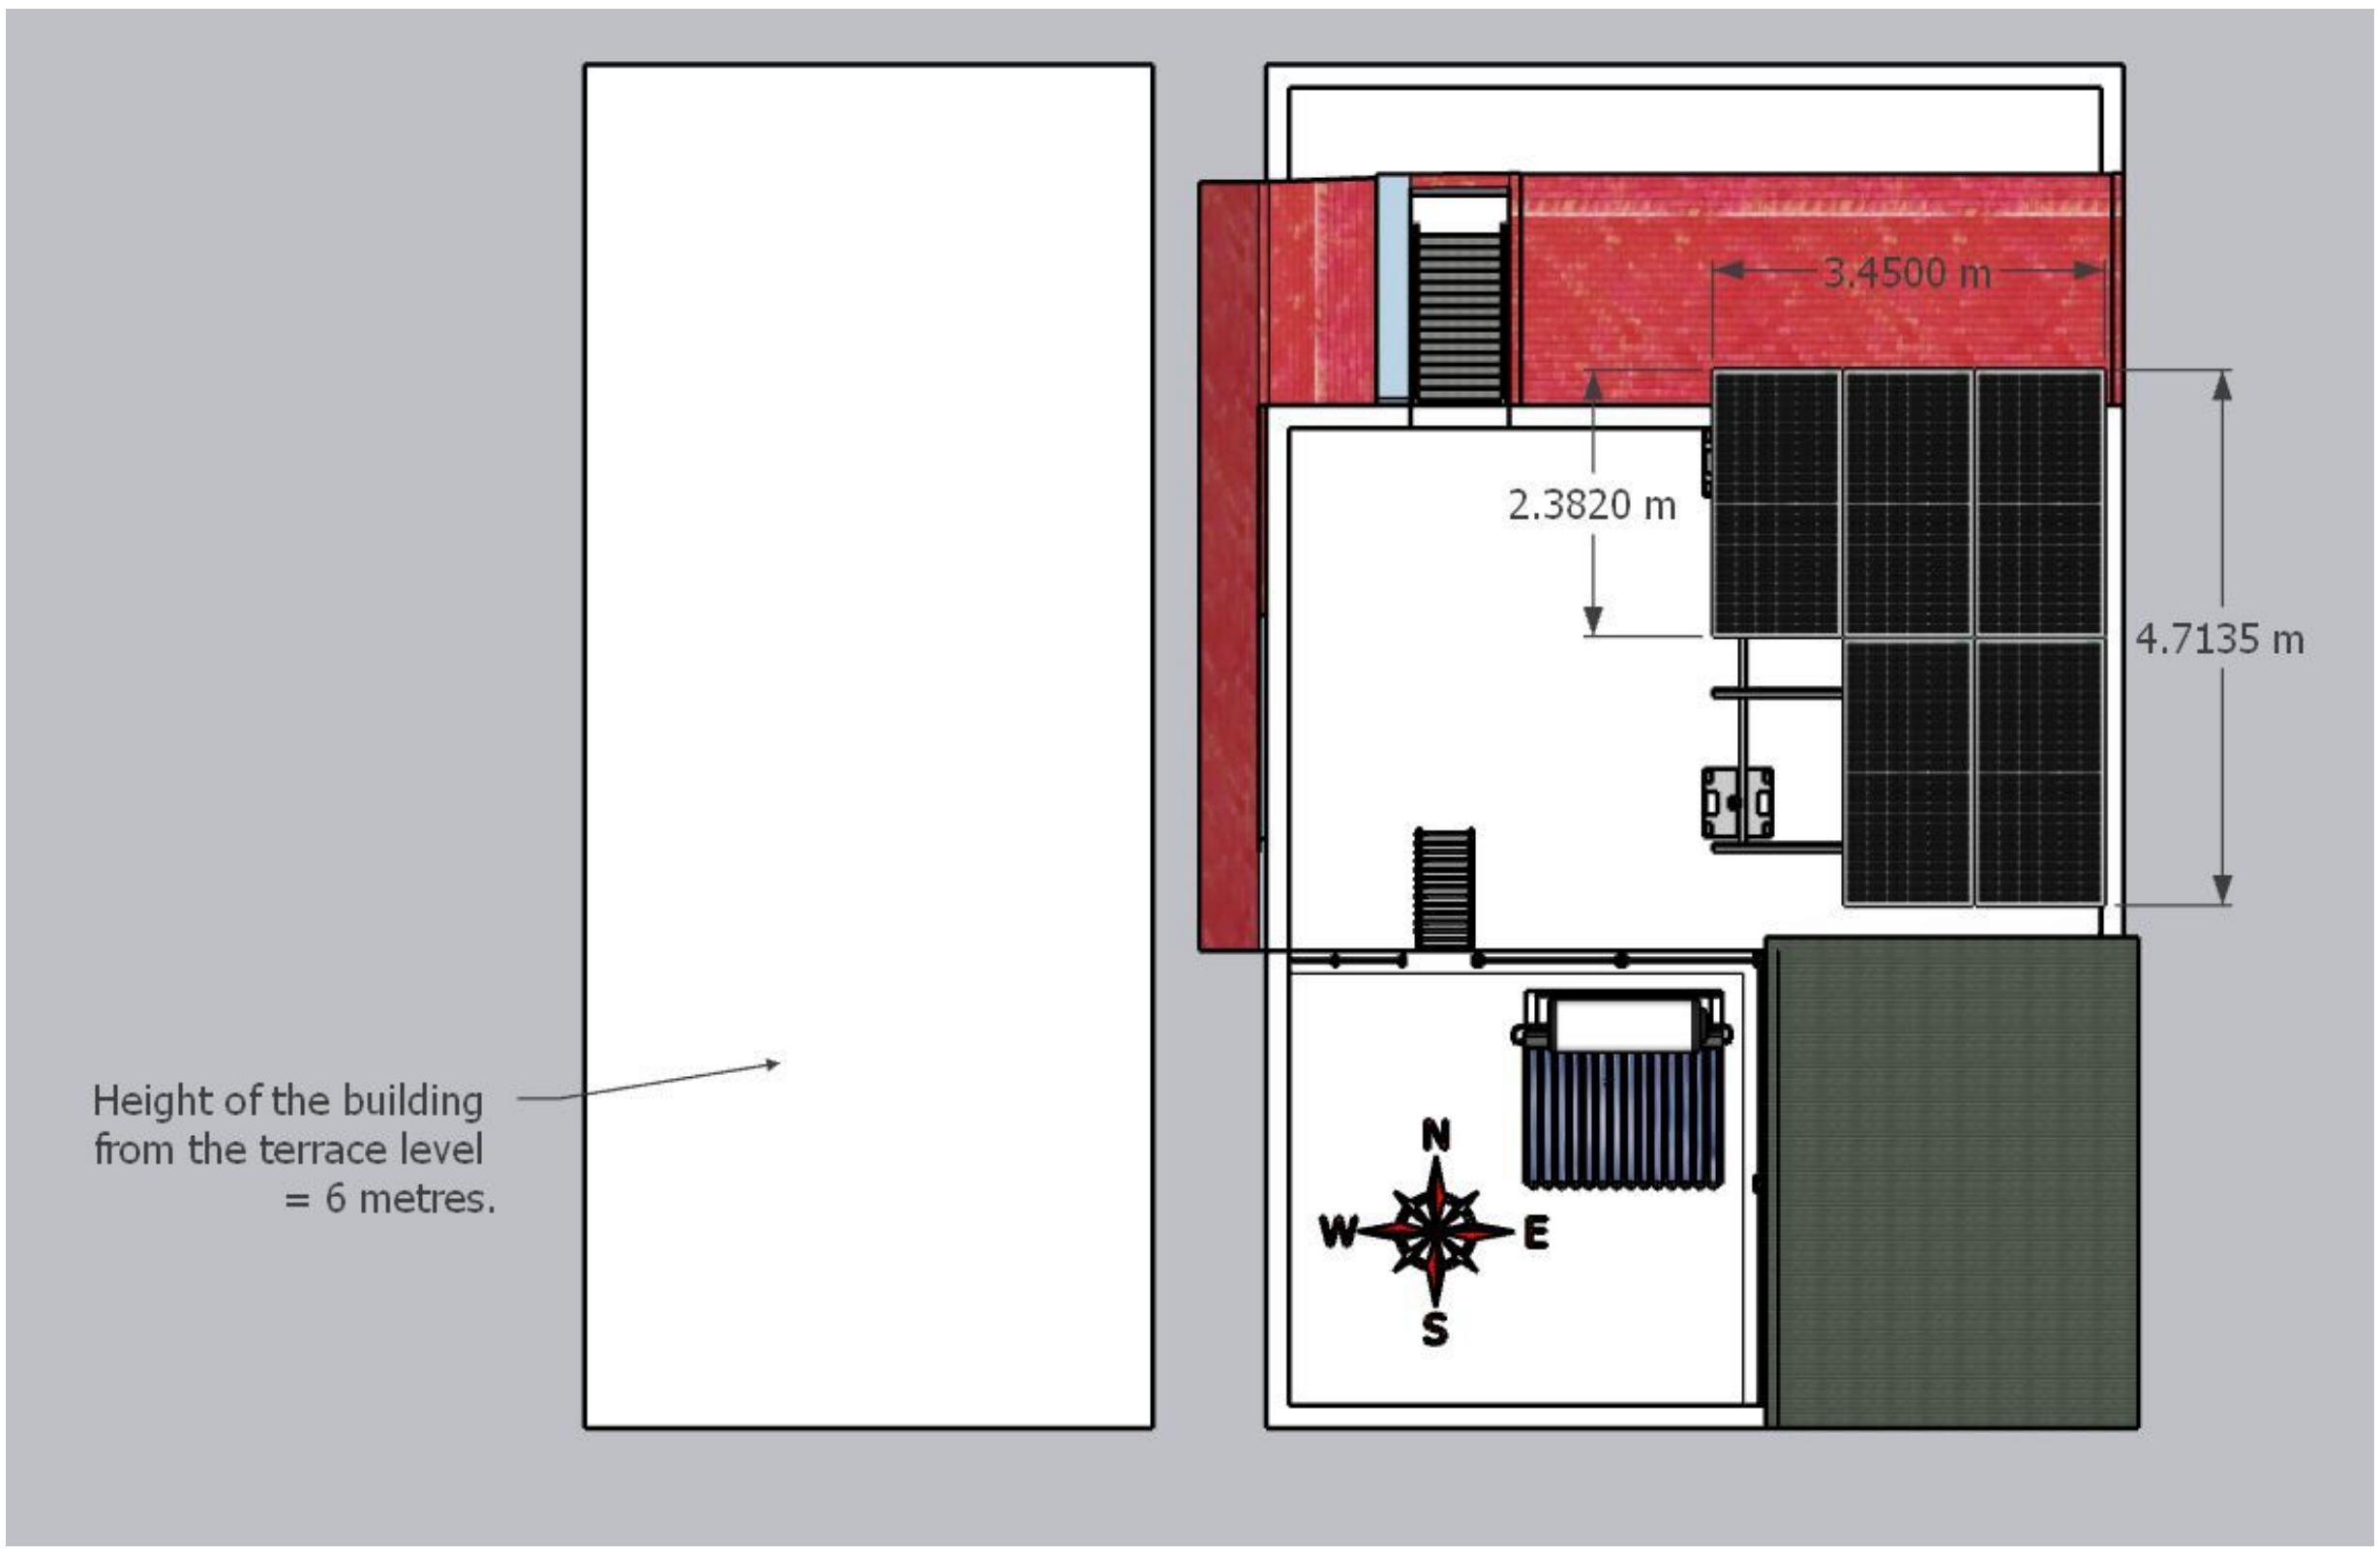
3.4500 m
2.3820 m
4.7135 m
Height of the building from the terrace level = 6 metres.
N
W
E
S

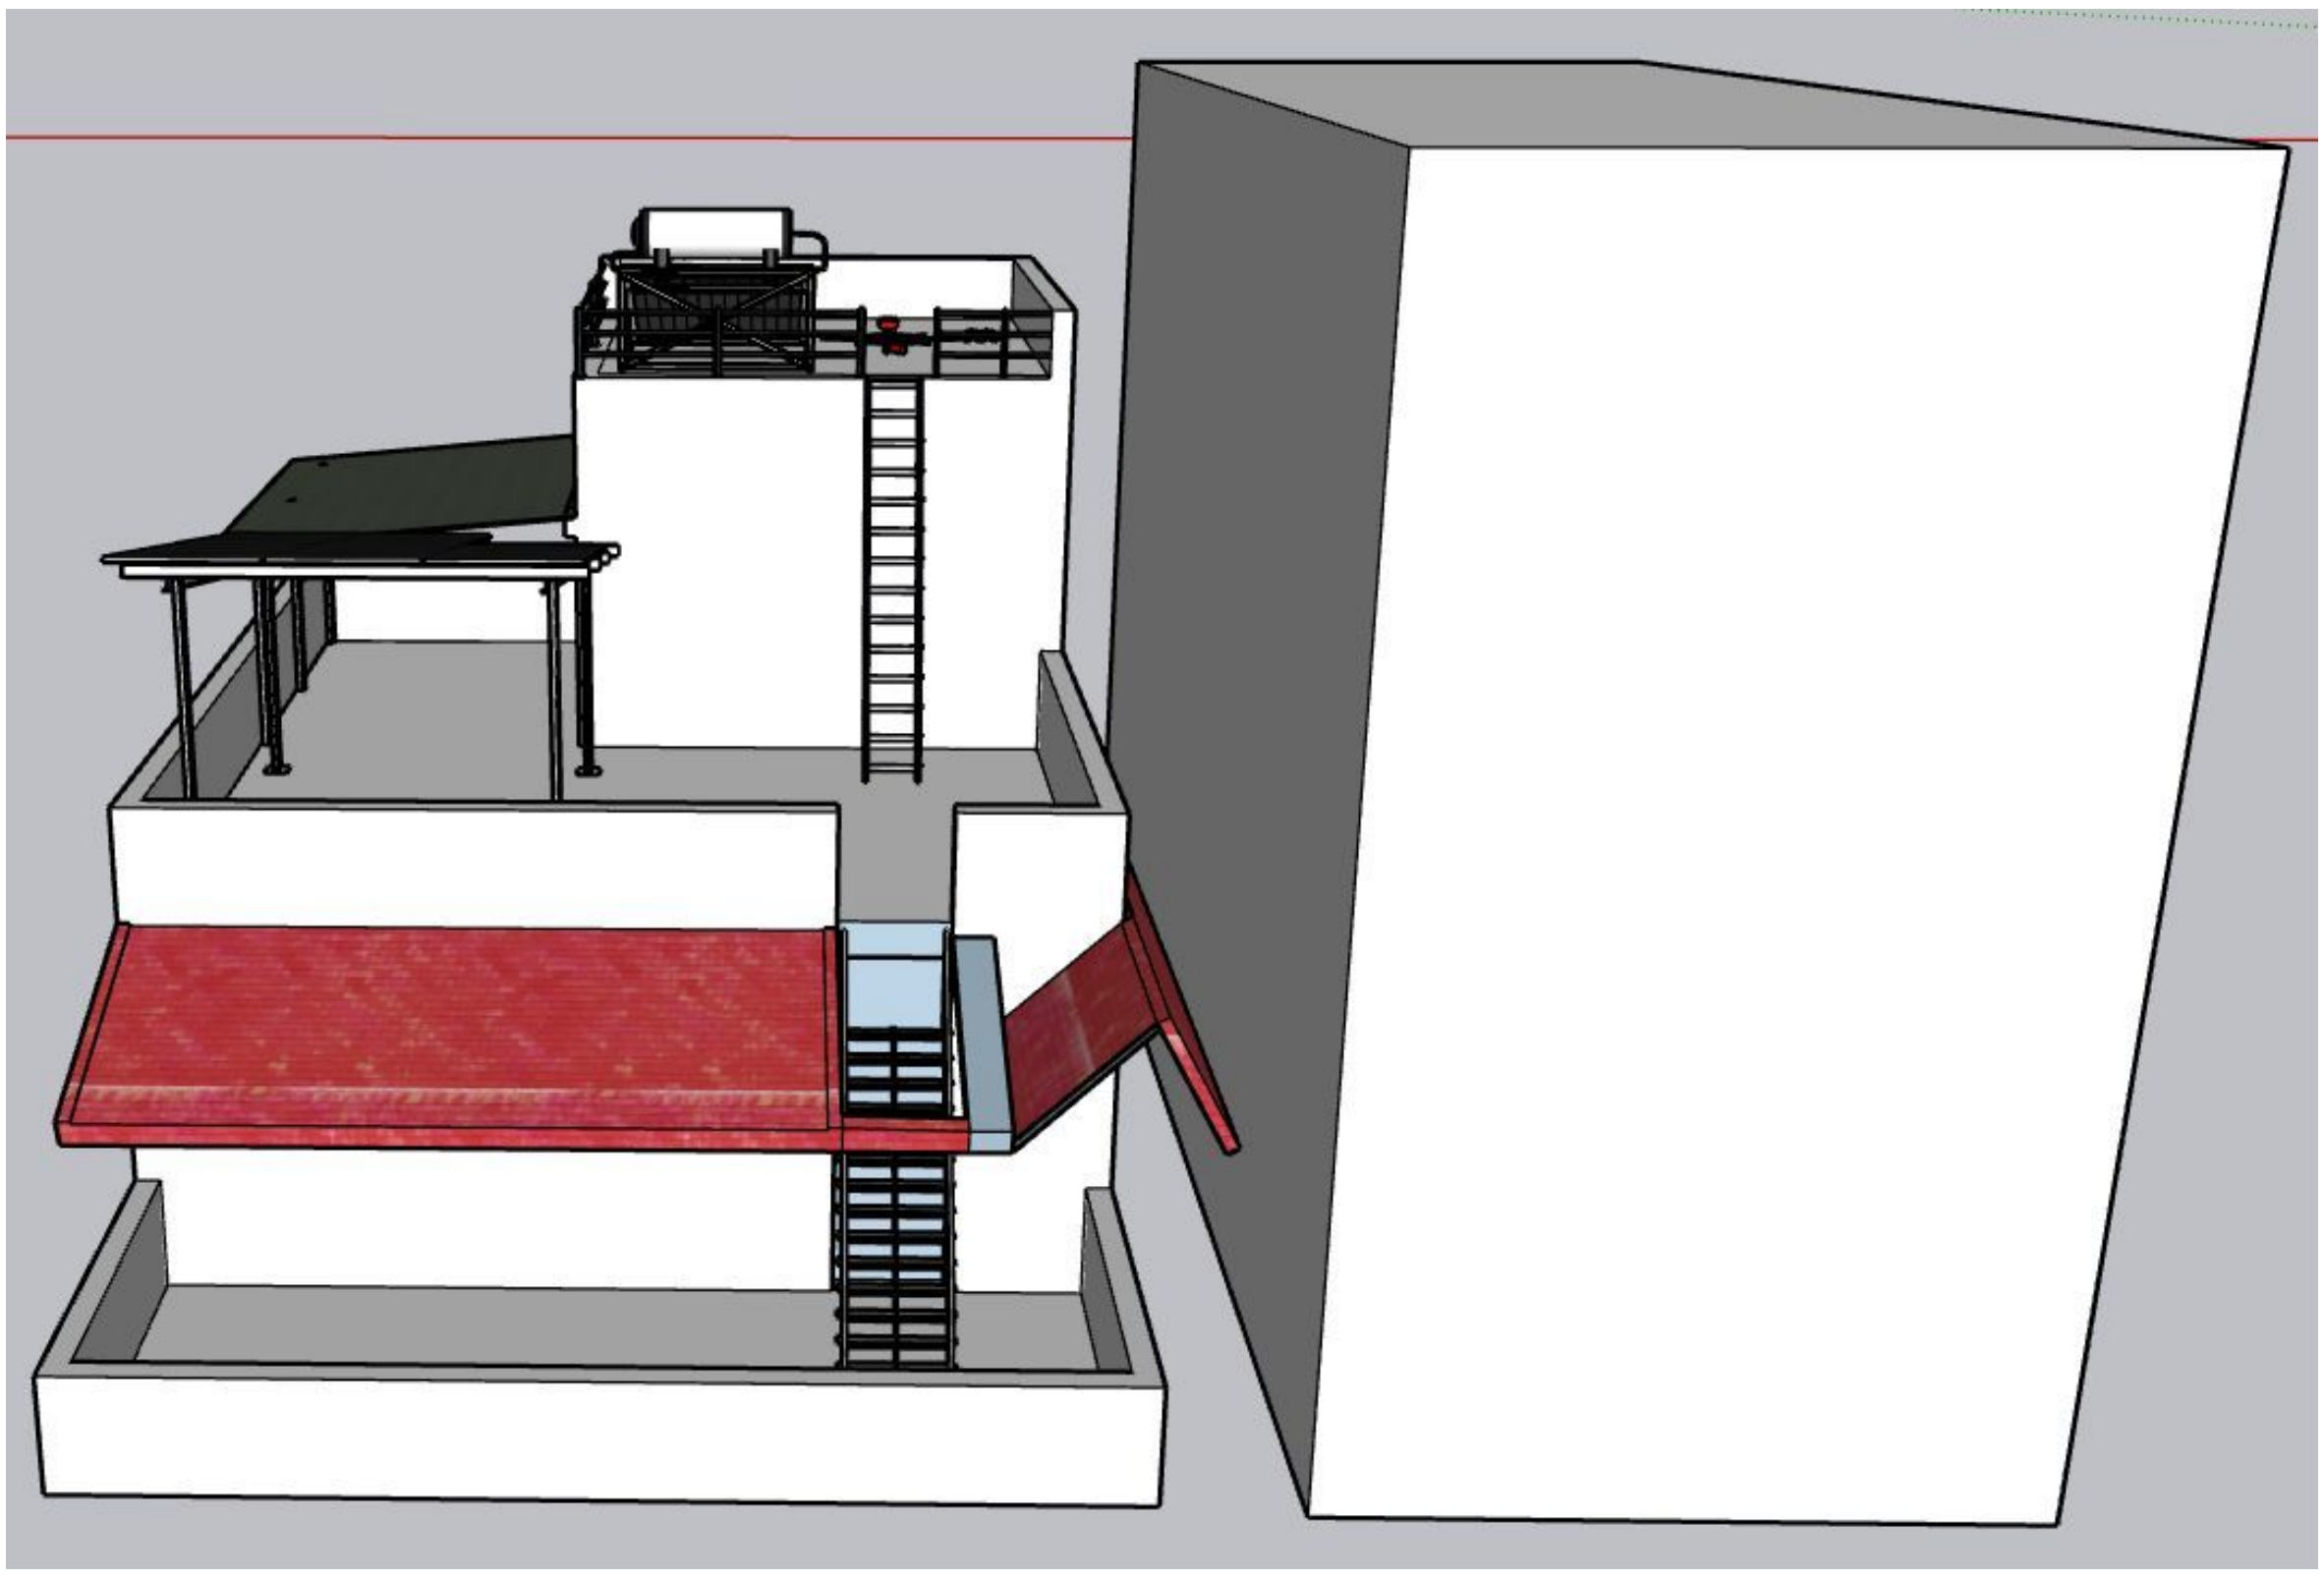

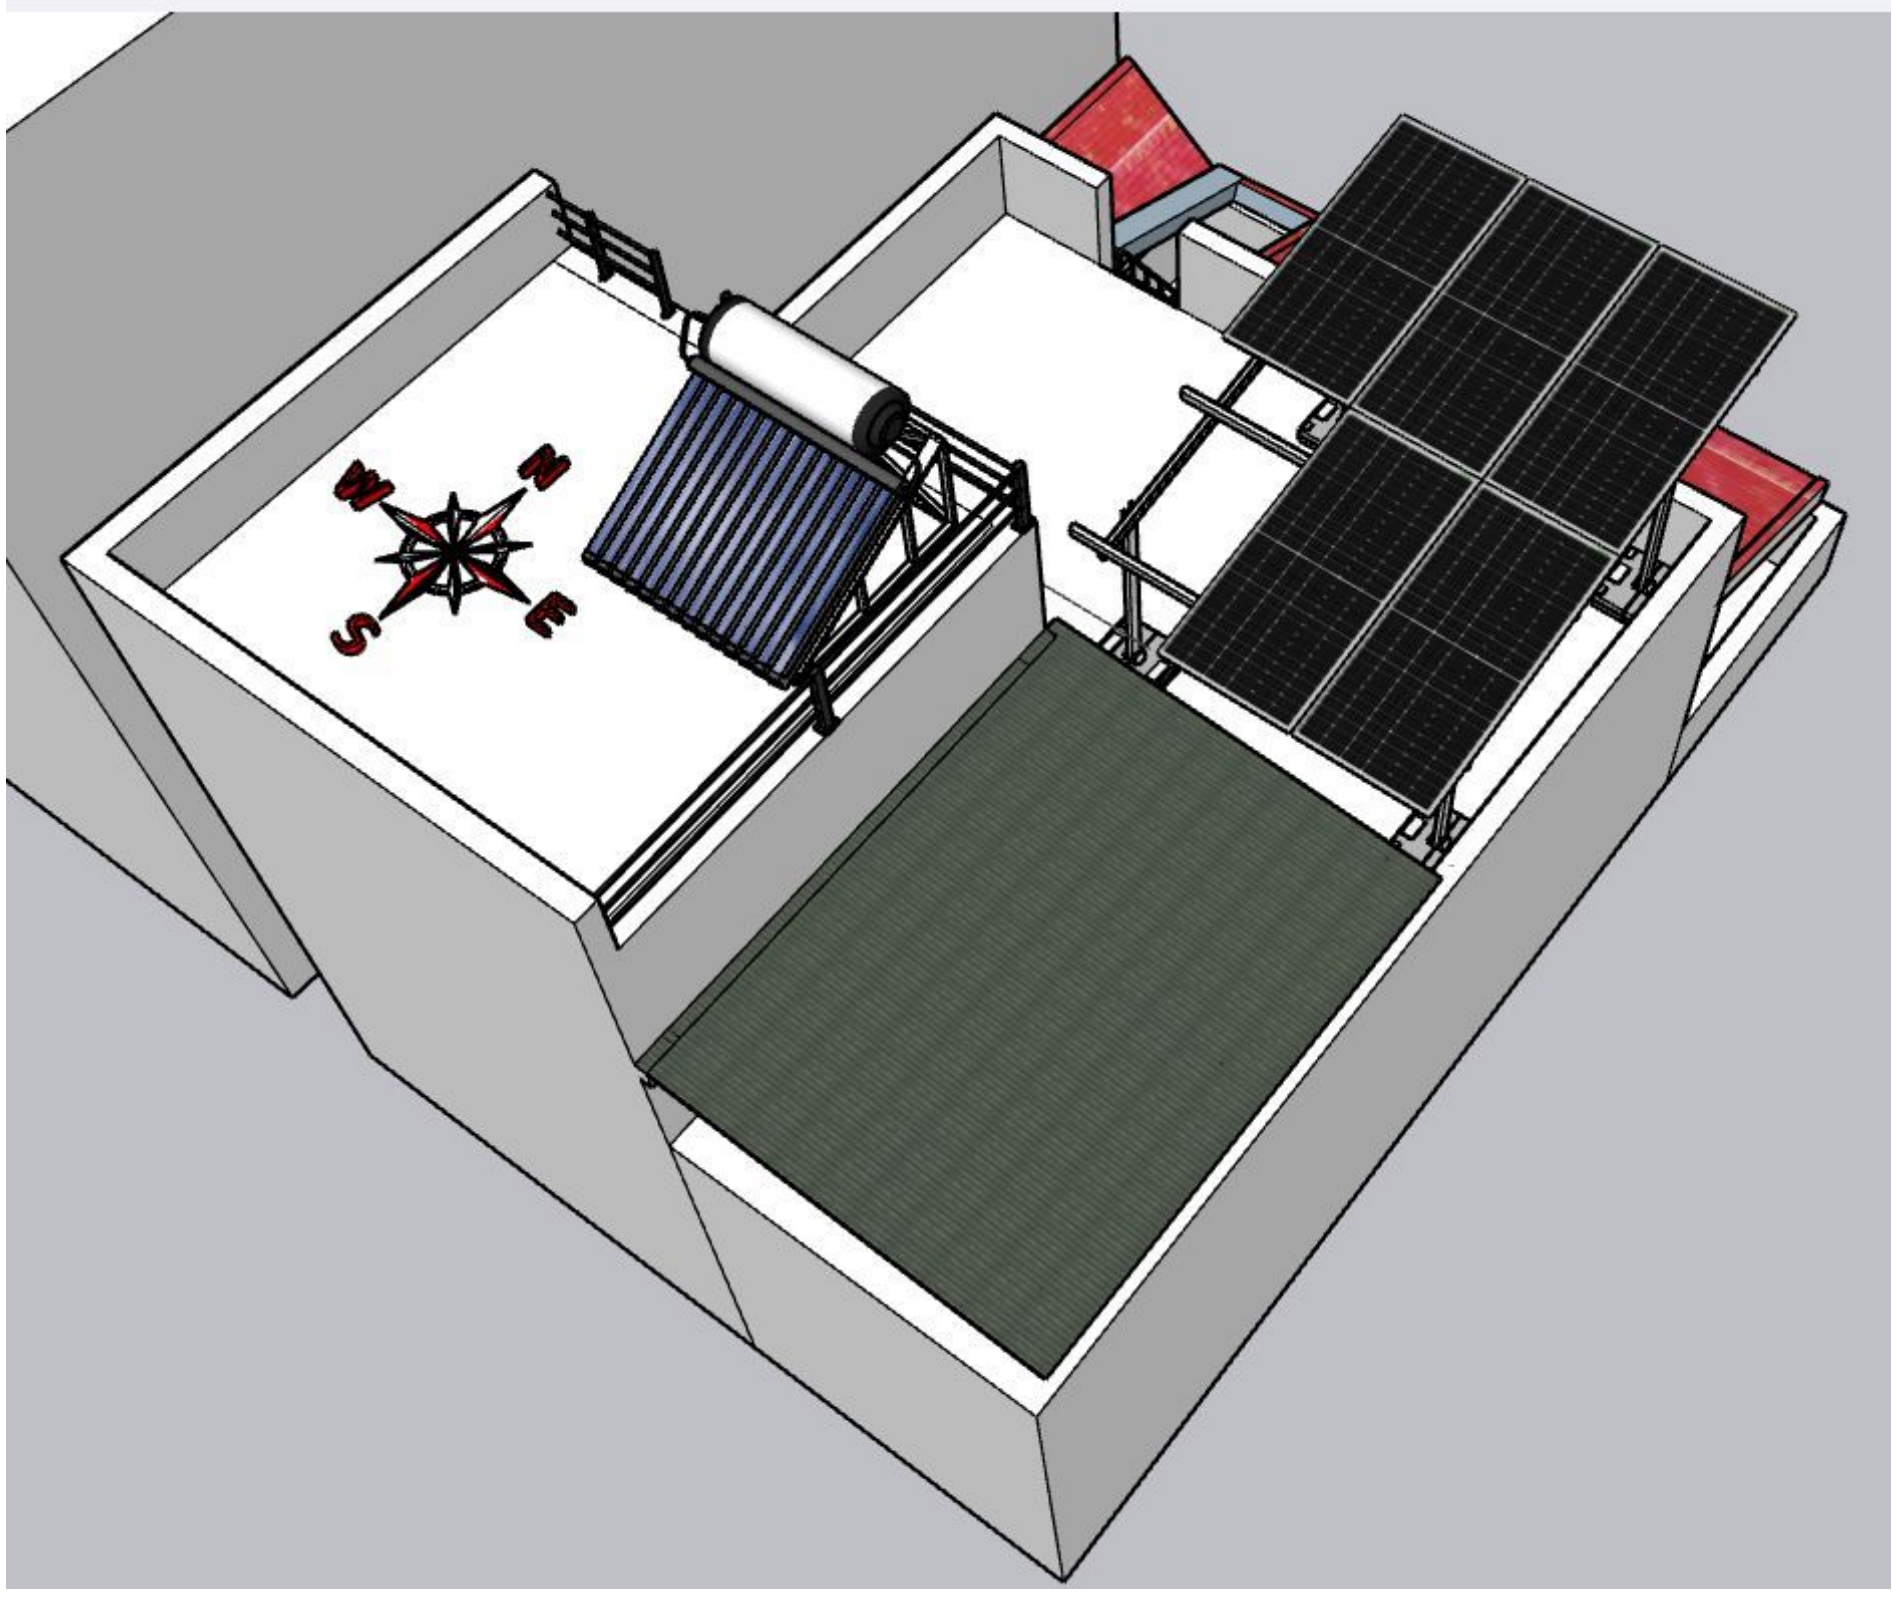
N
E
S
W

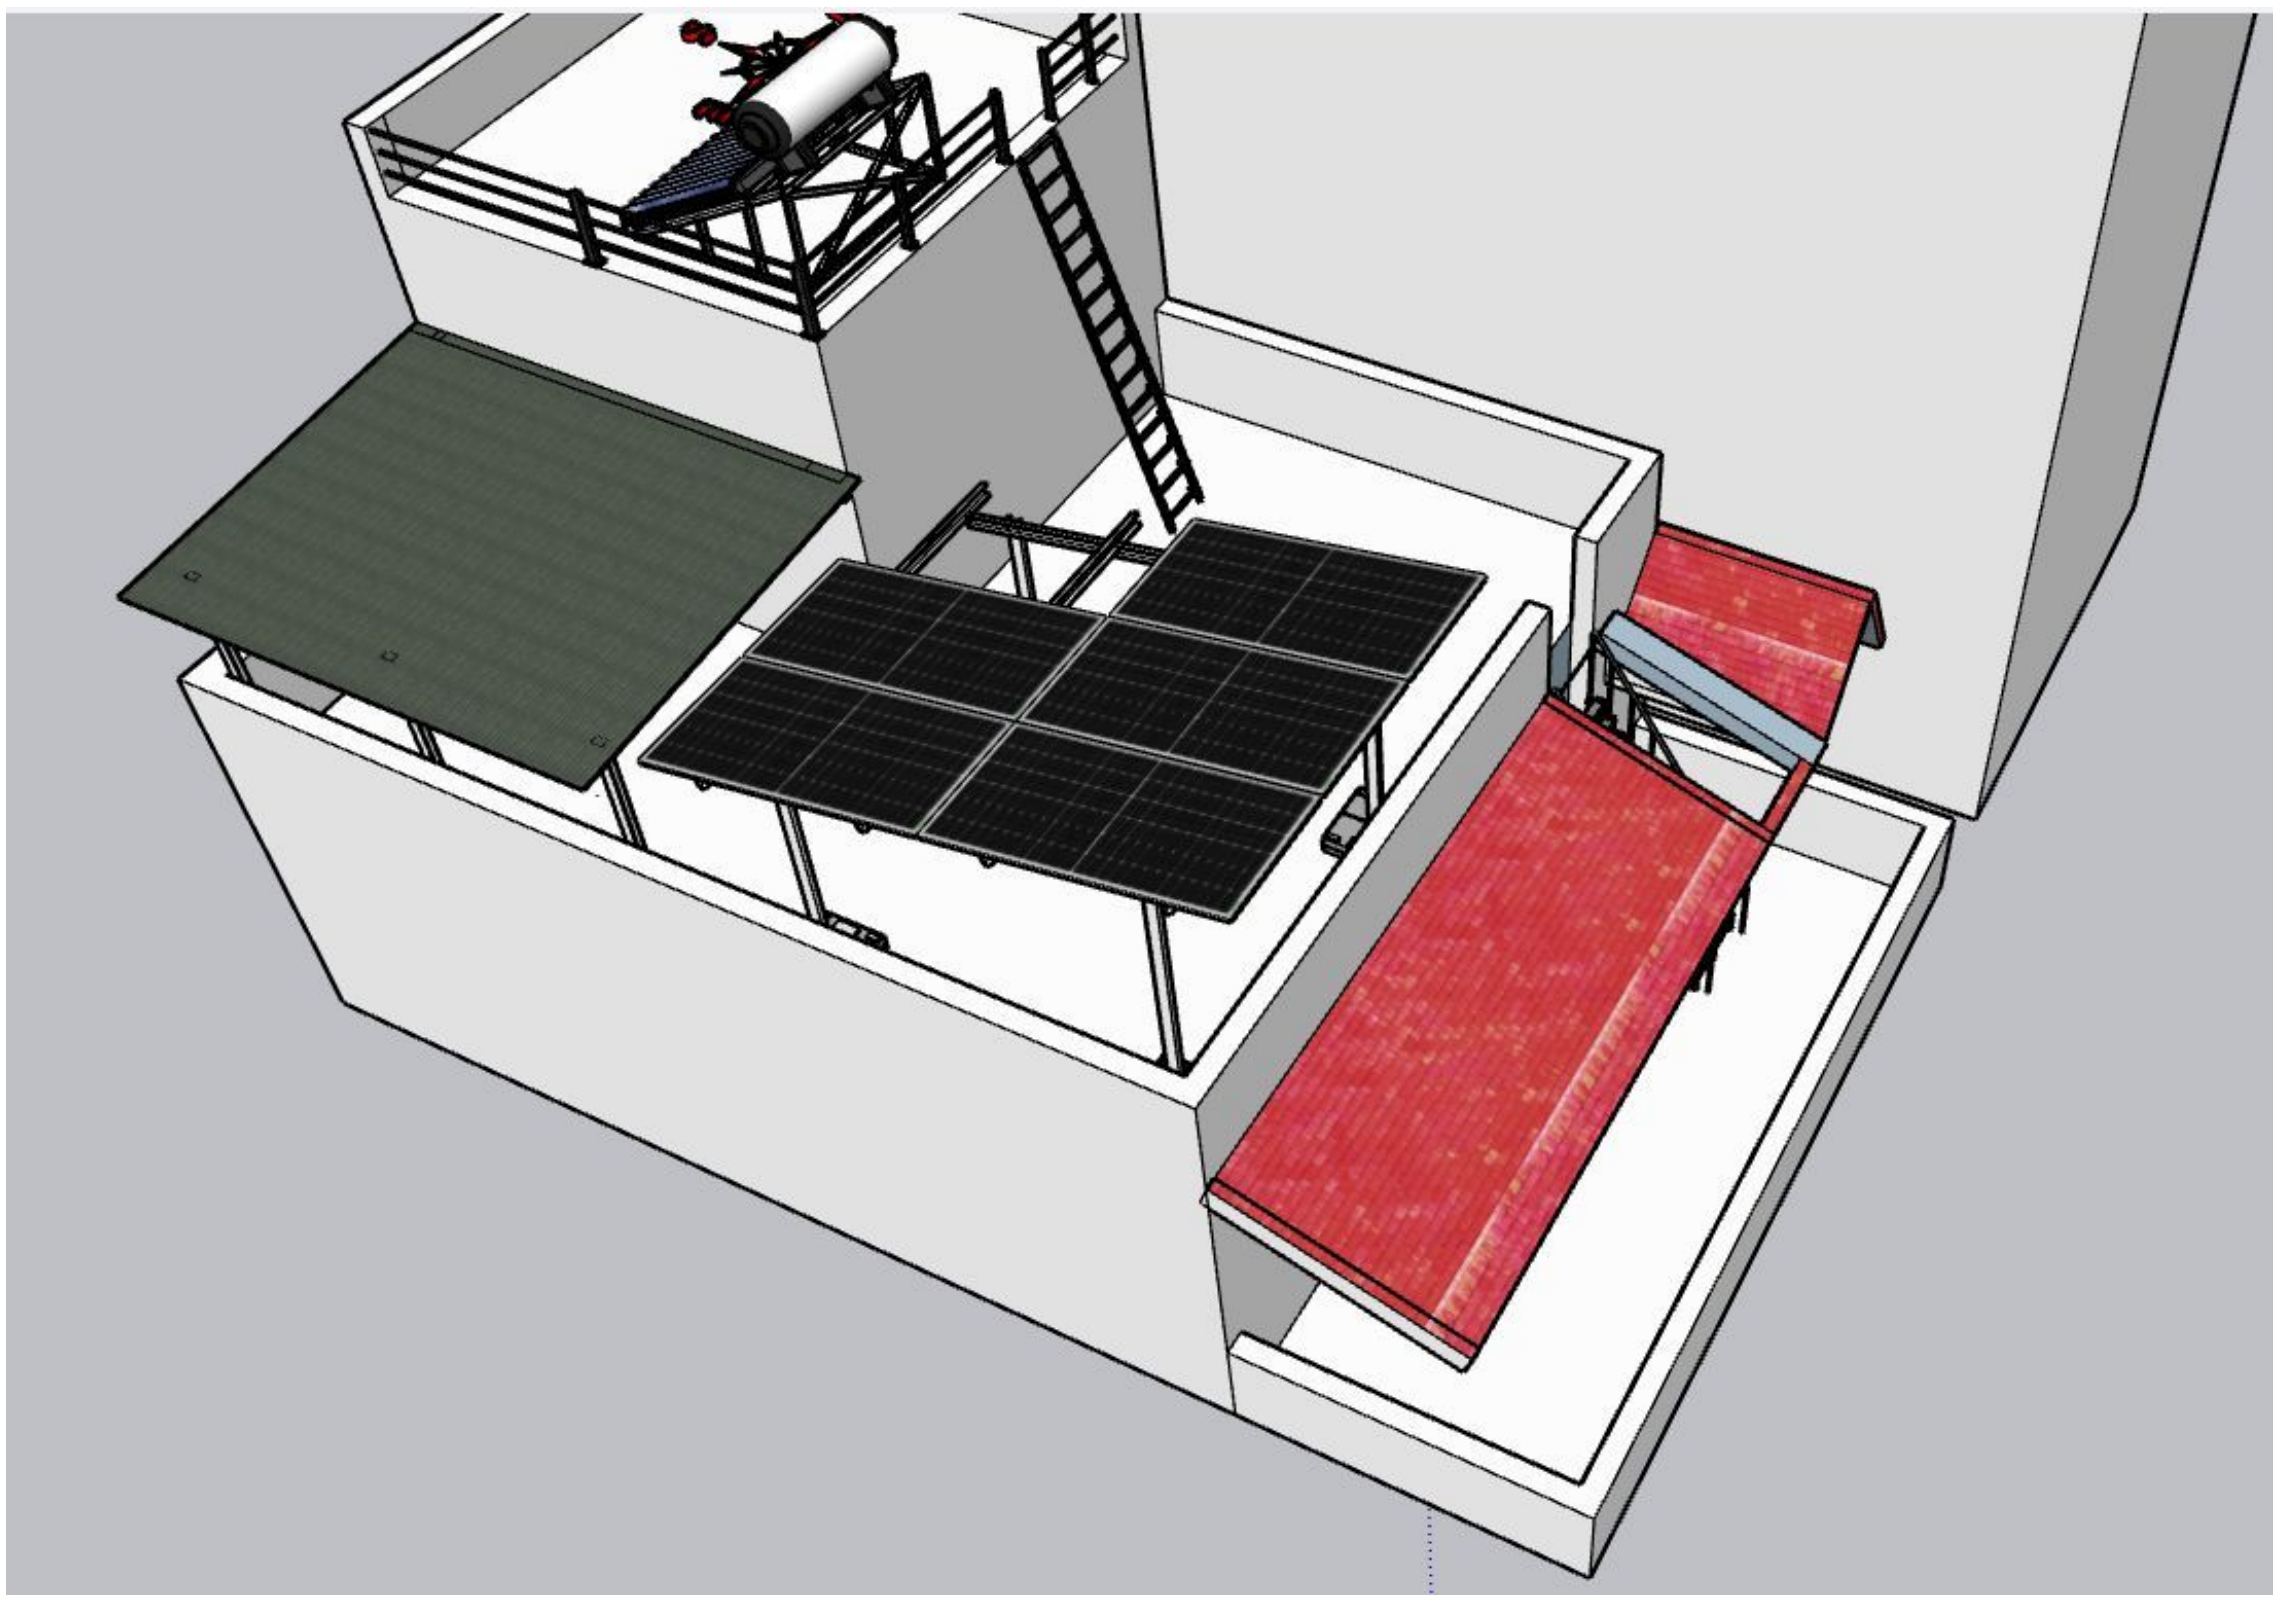

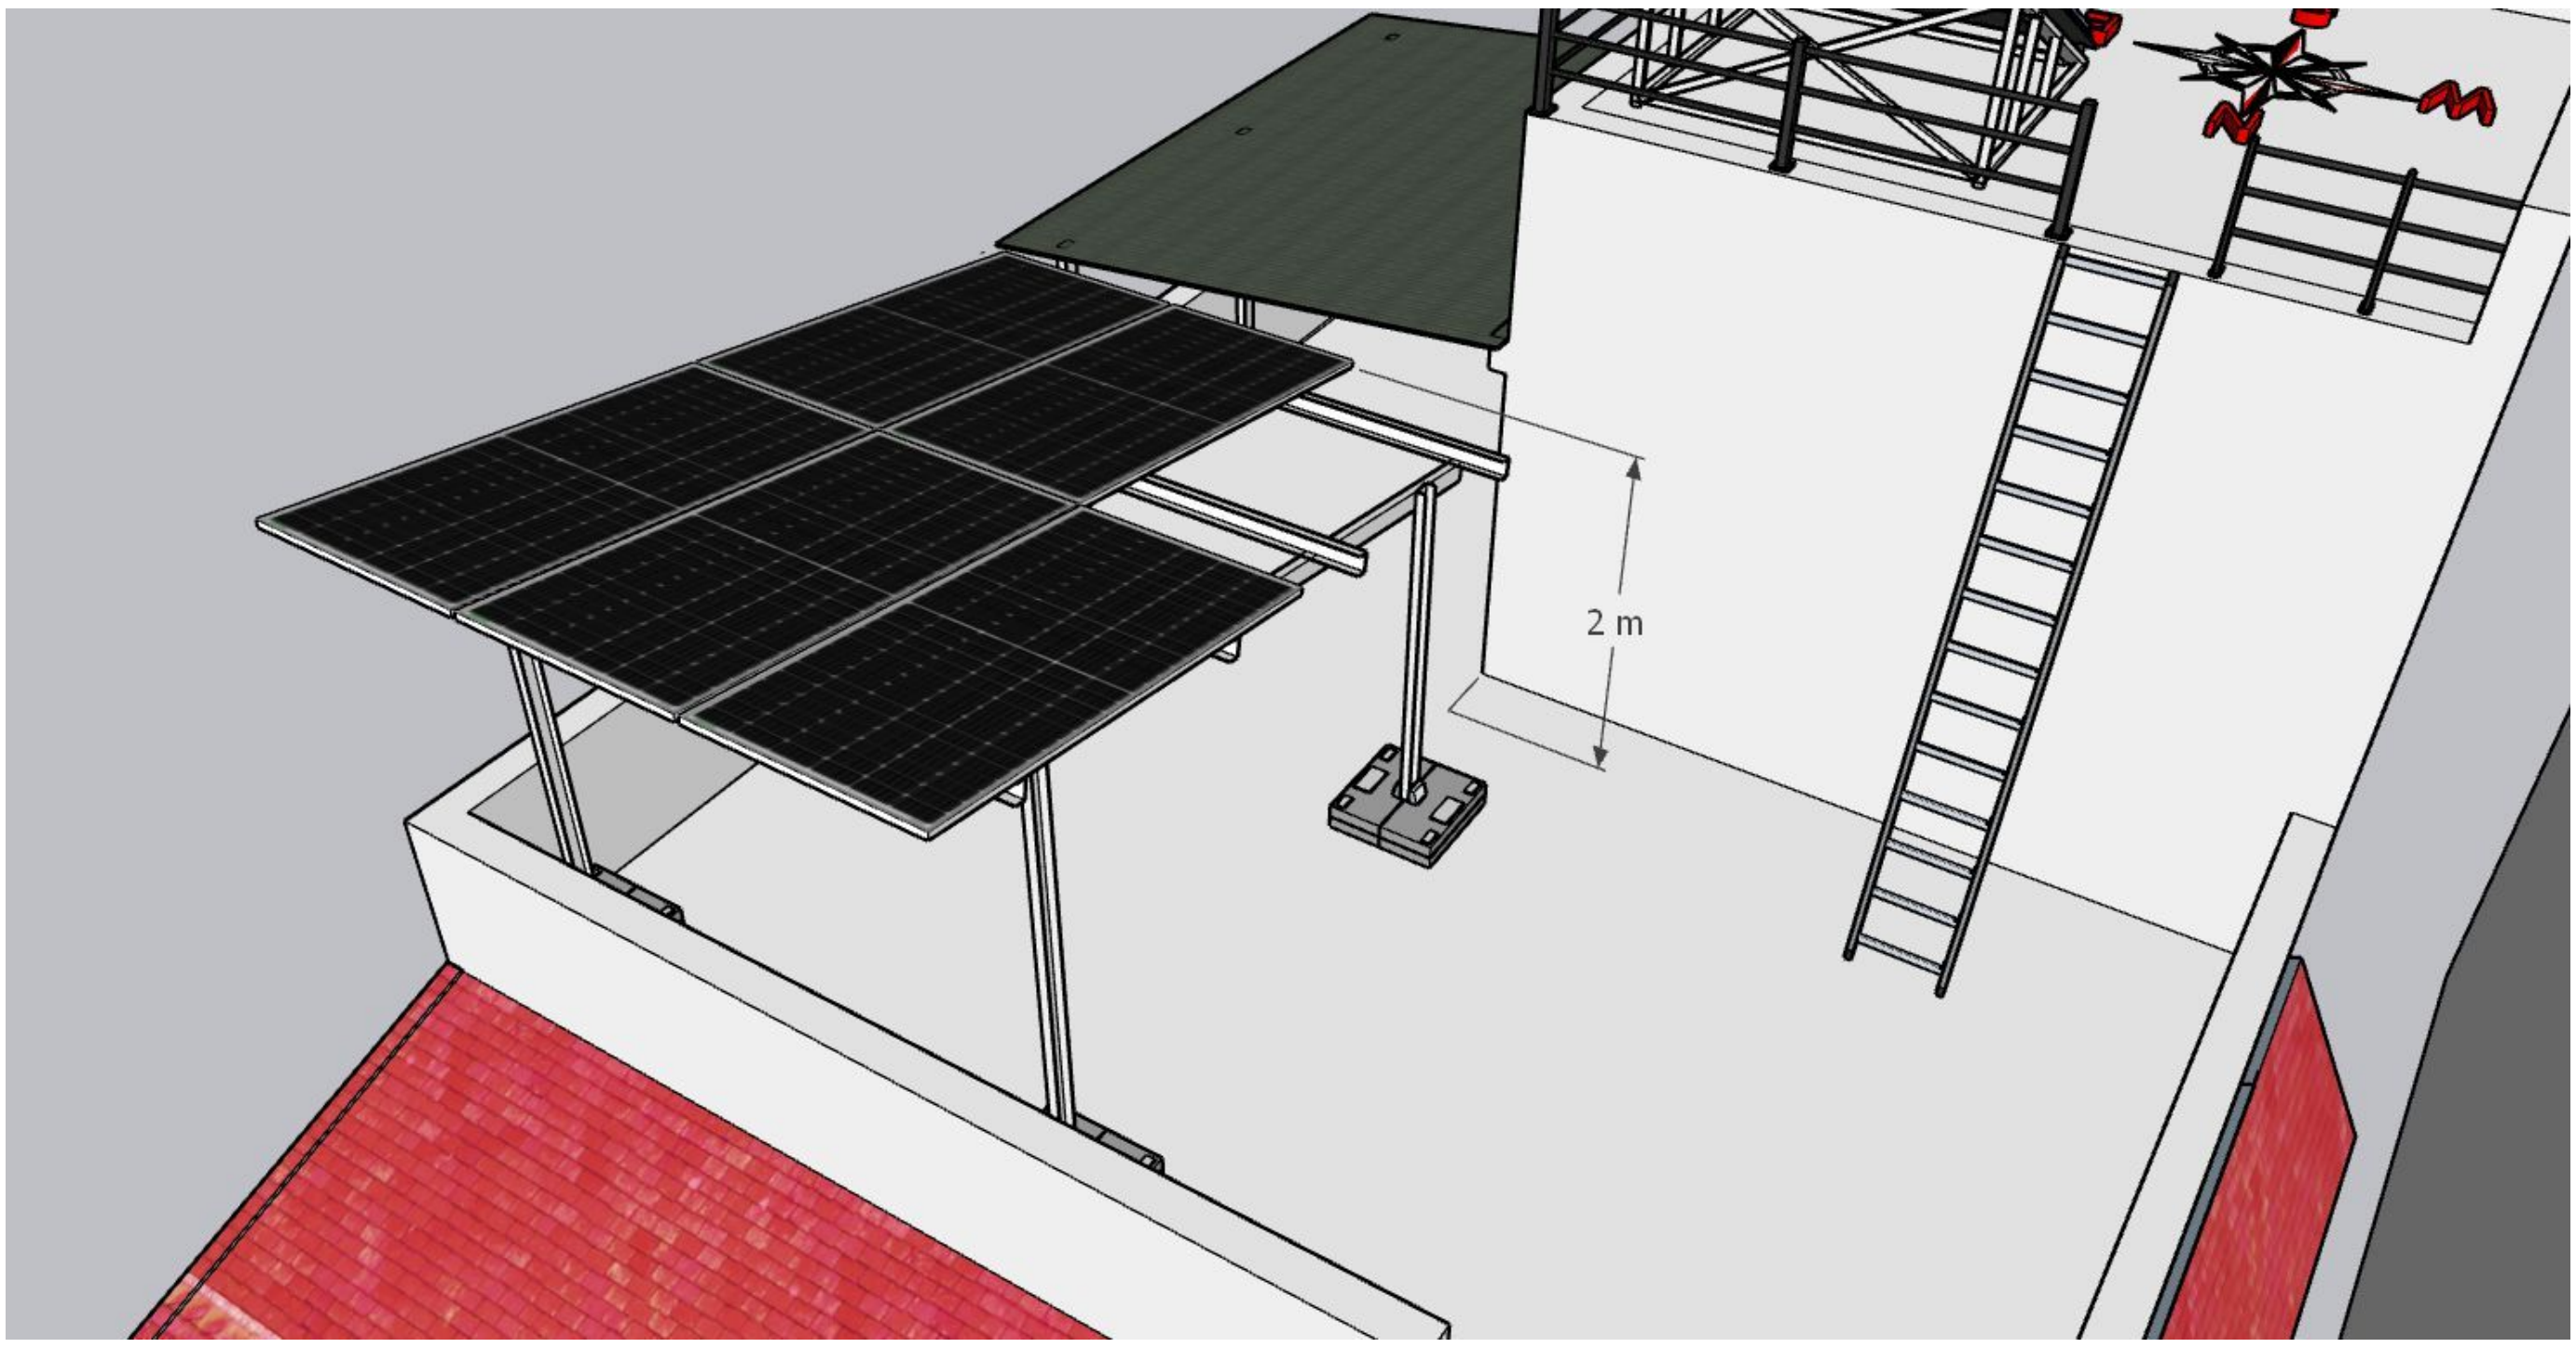

Building Exterior

Material Delivery Route

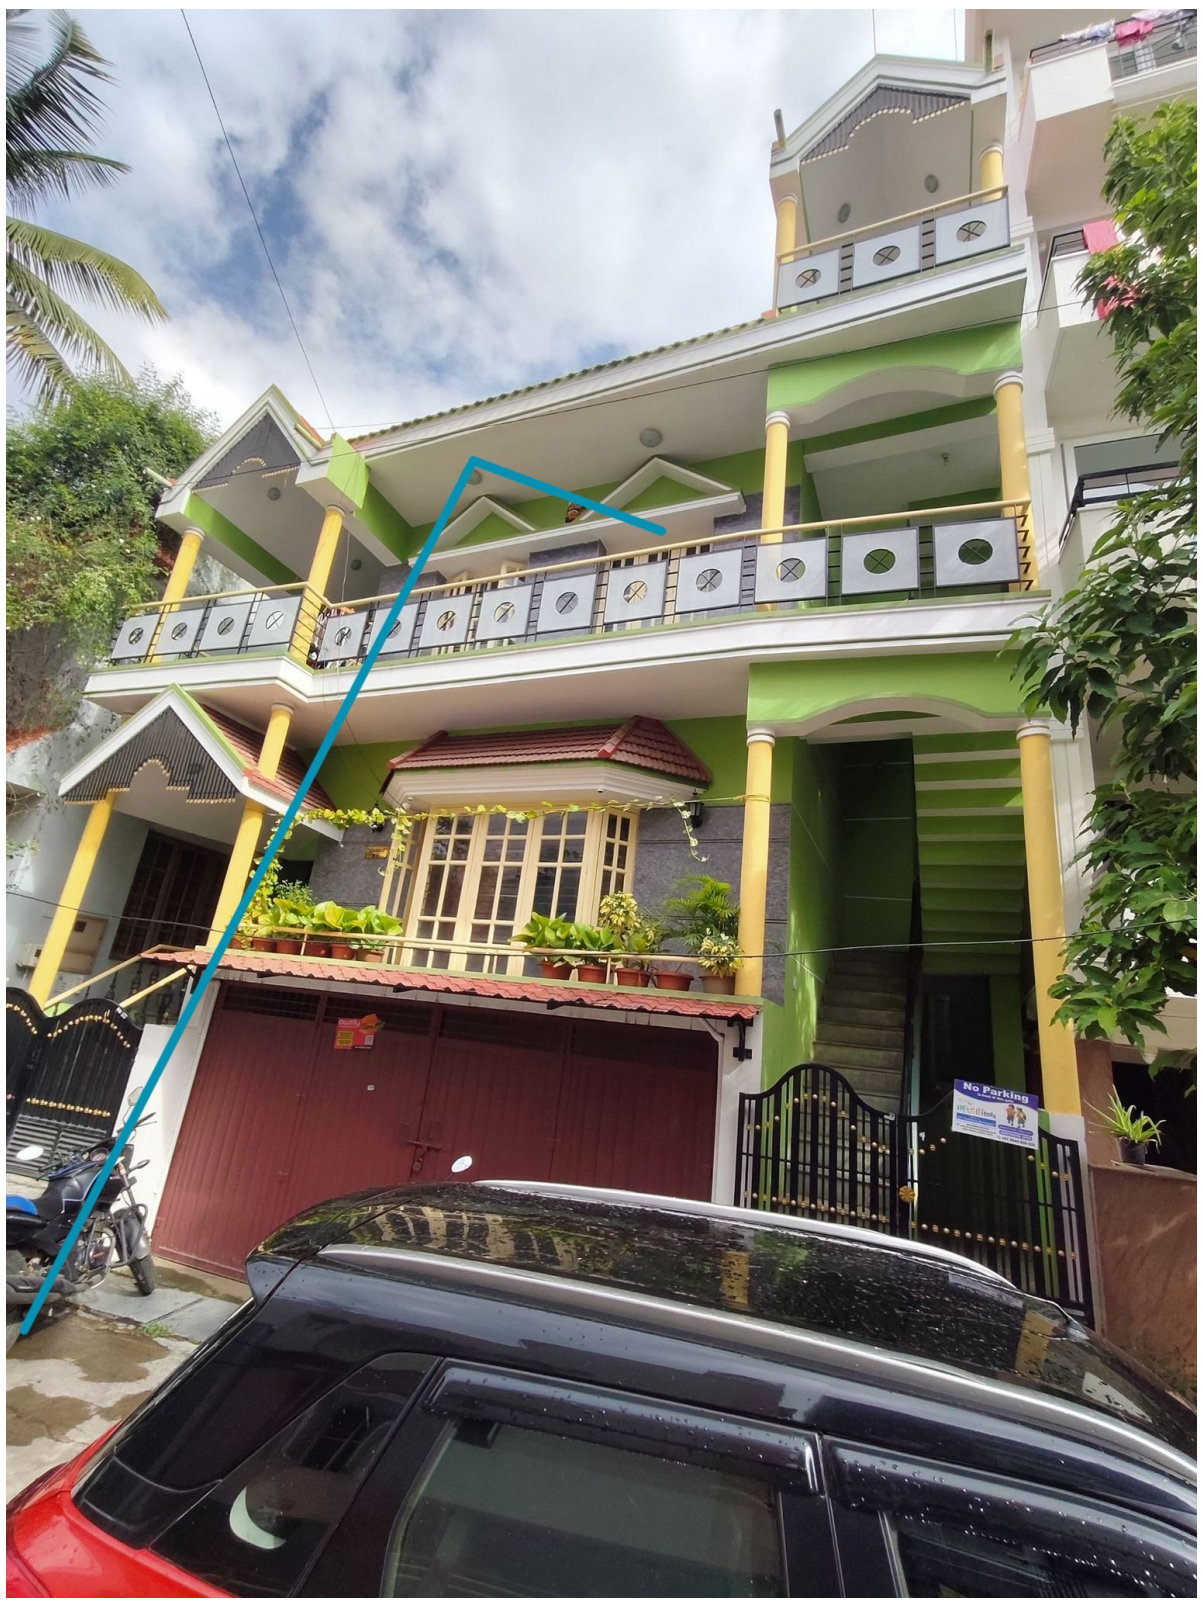

Heavy materials such as PV modules can be shifted over the side wall of the building.

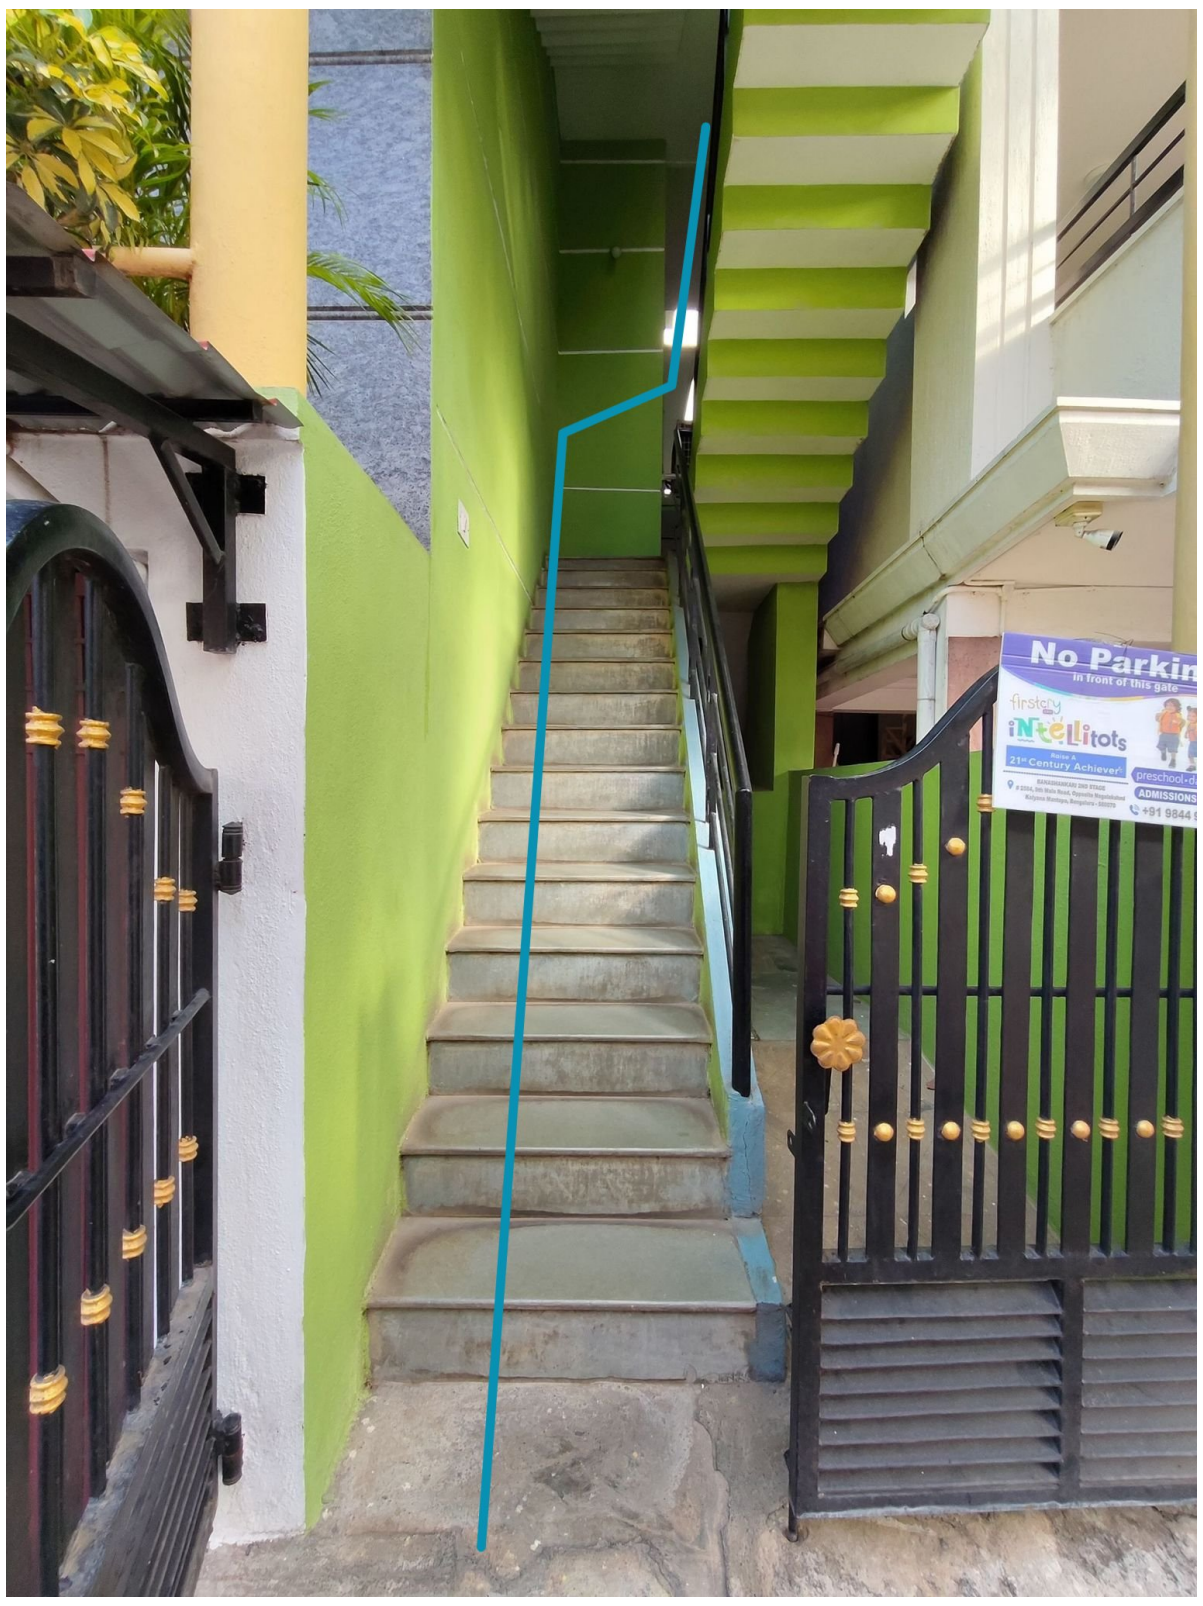

Light weight materials can be shifted to the terrace via the inner staircase.

Materials after reaching the 1st floor can be shifted to the terrace roof via the metal staircase.

Staircase Details

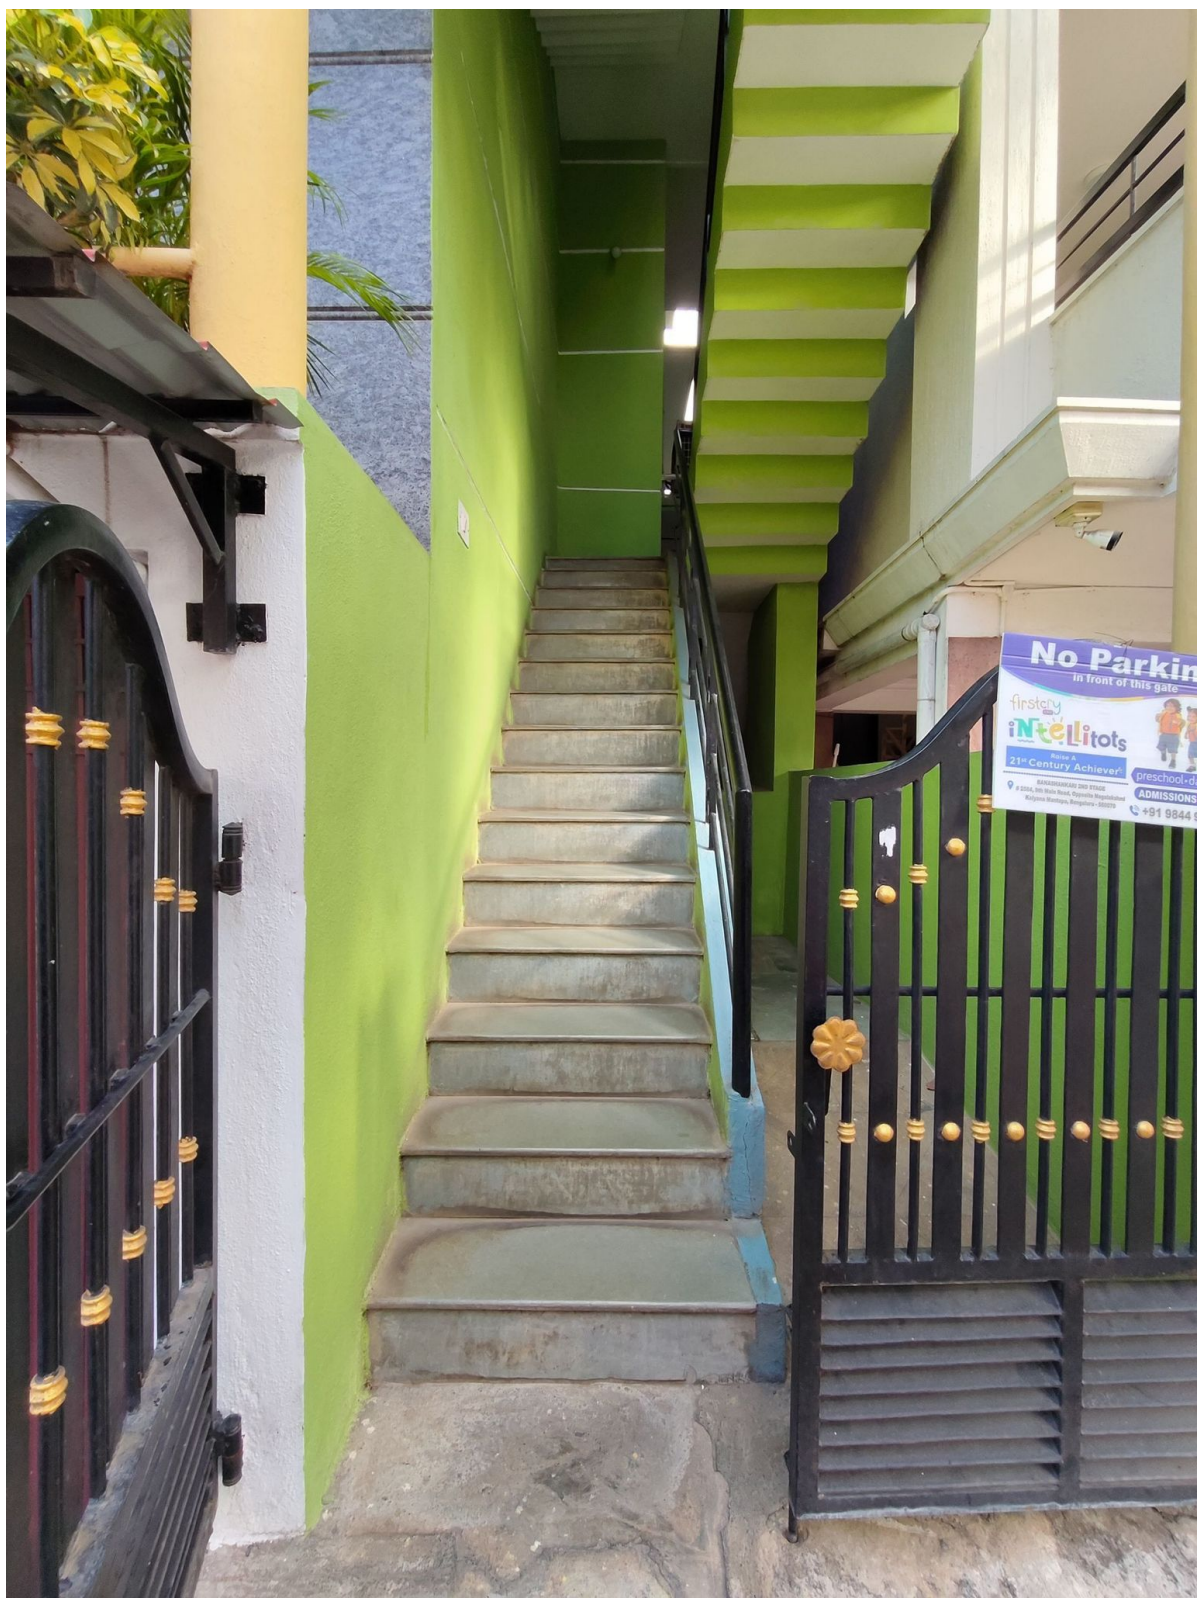

Staircase width: 800 mm

Material Storage

Meter Box

Proposed PV Area

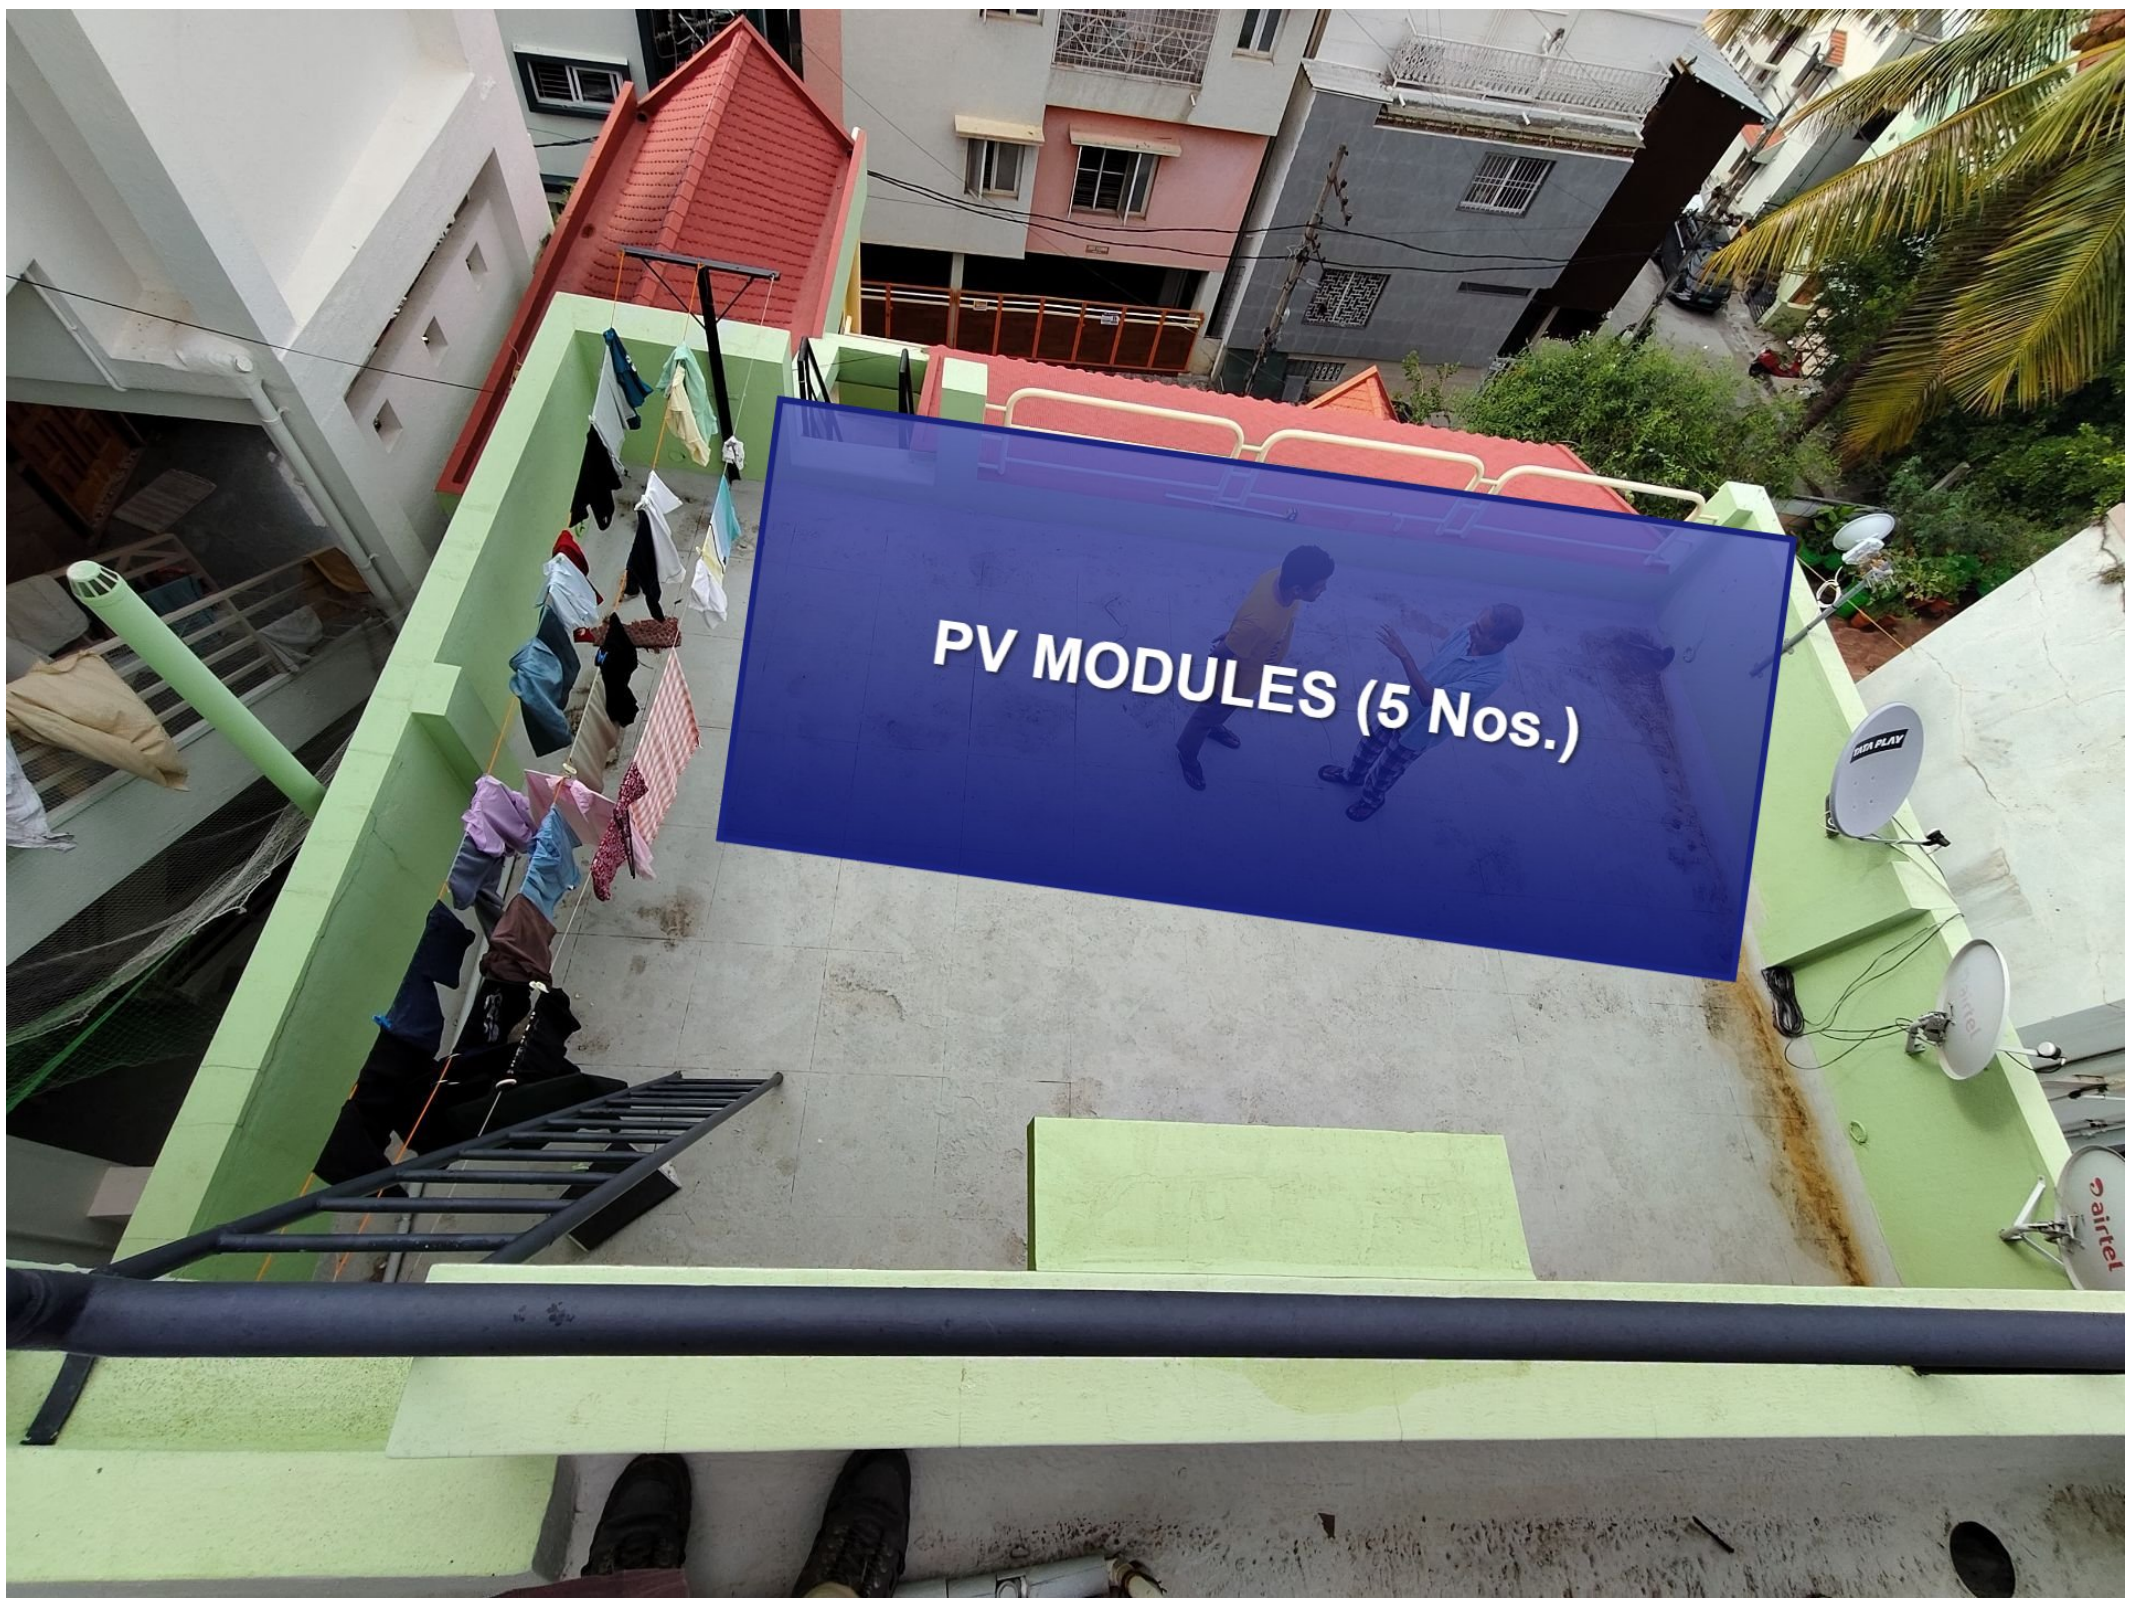

Cable Routing


LA Pit
DC Earth Pit

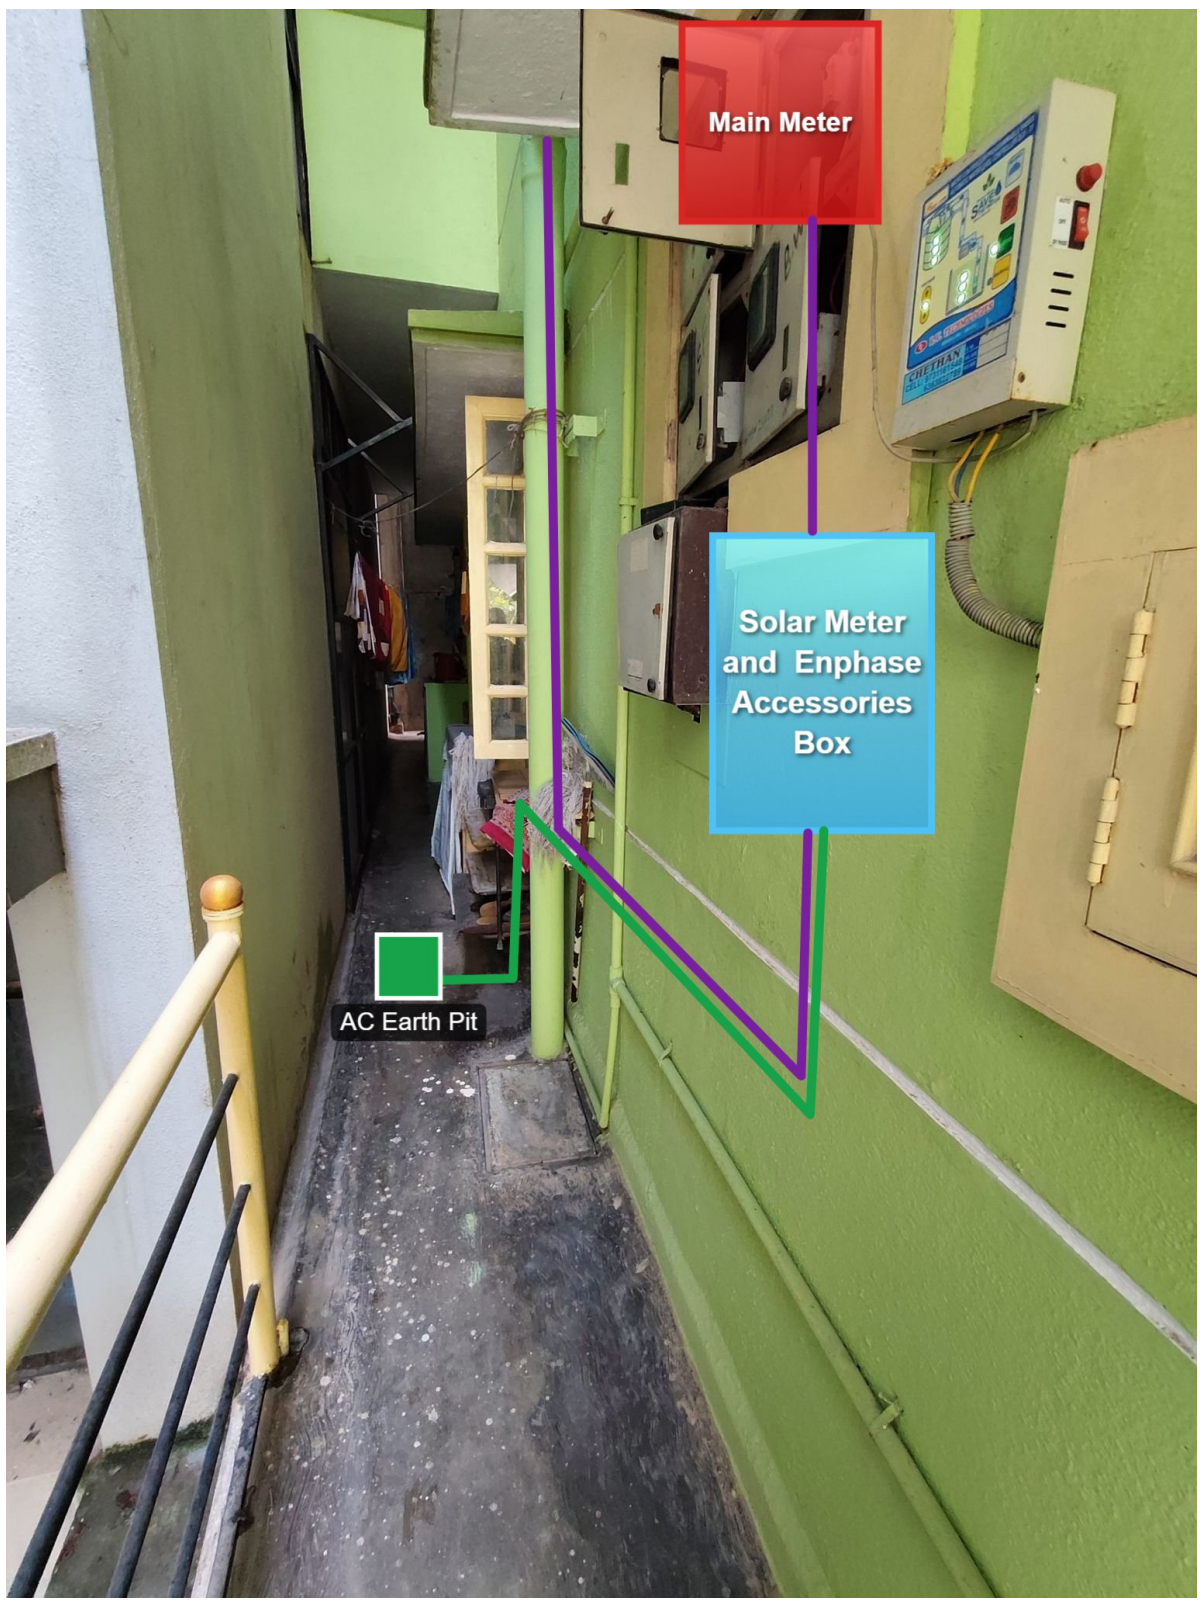

Shadow Analysis

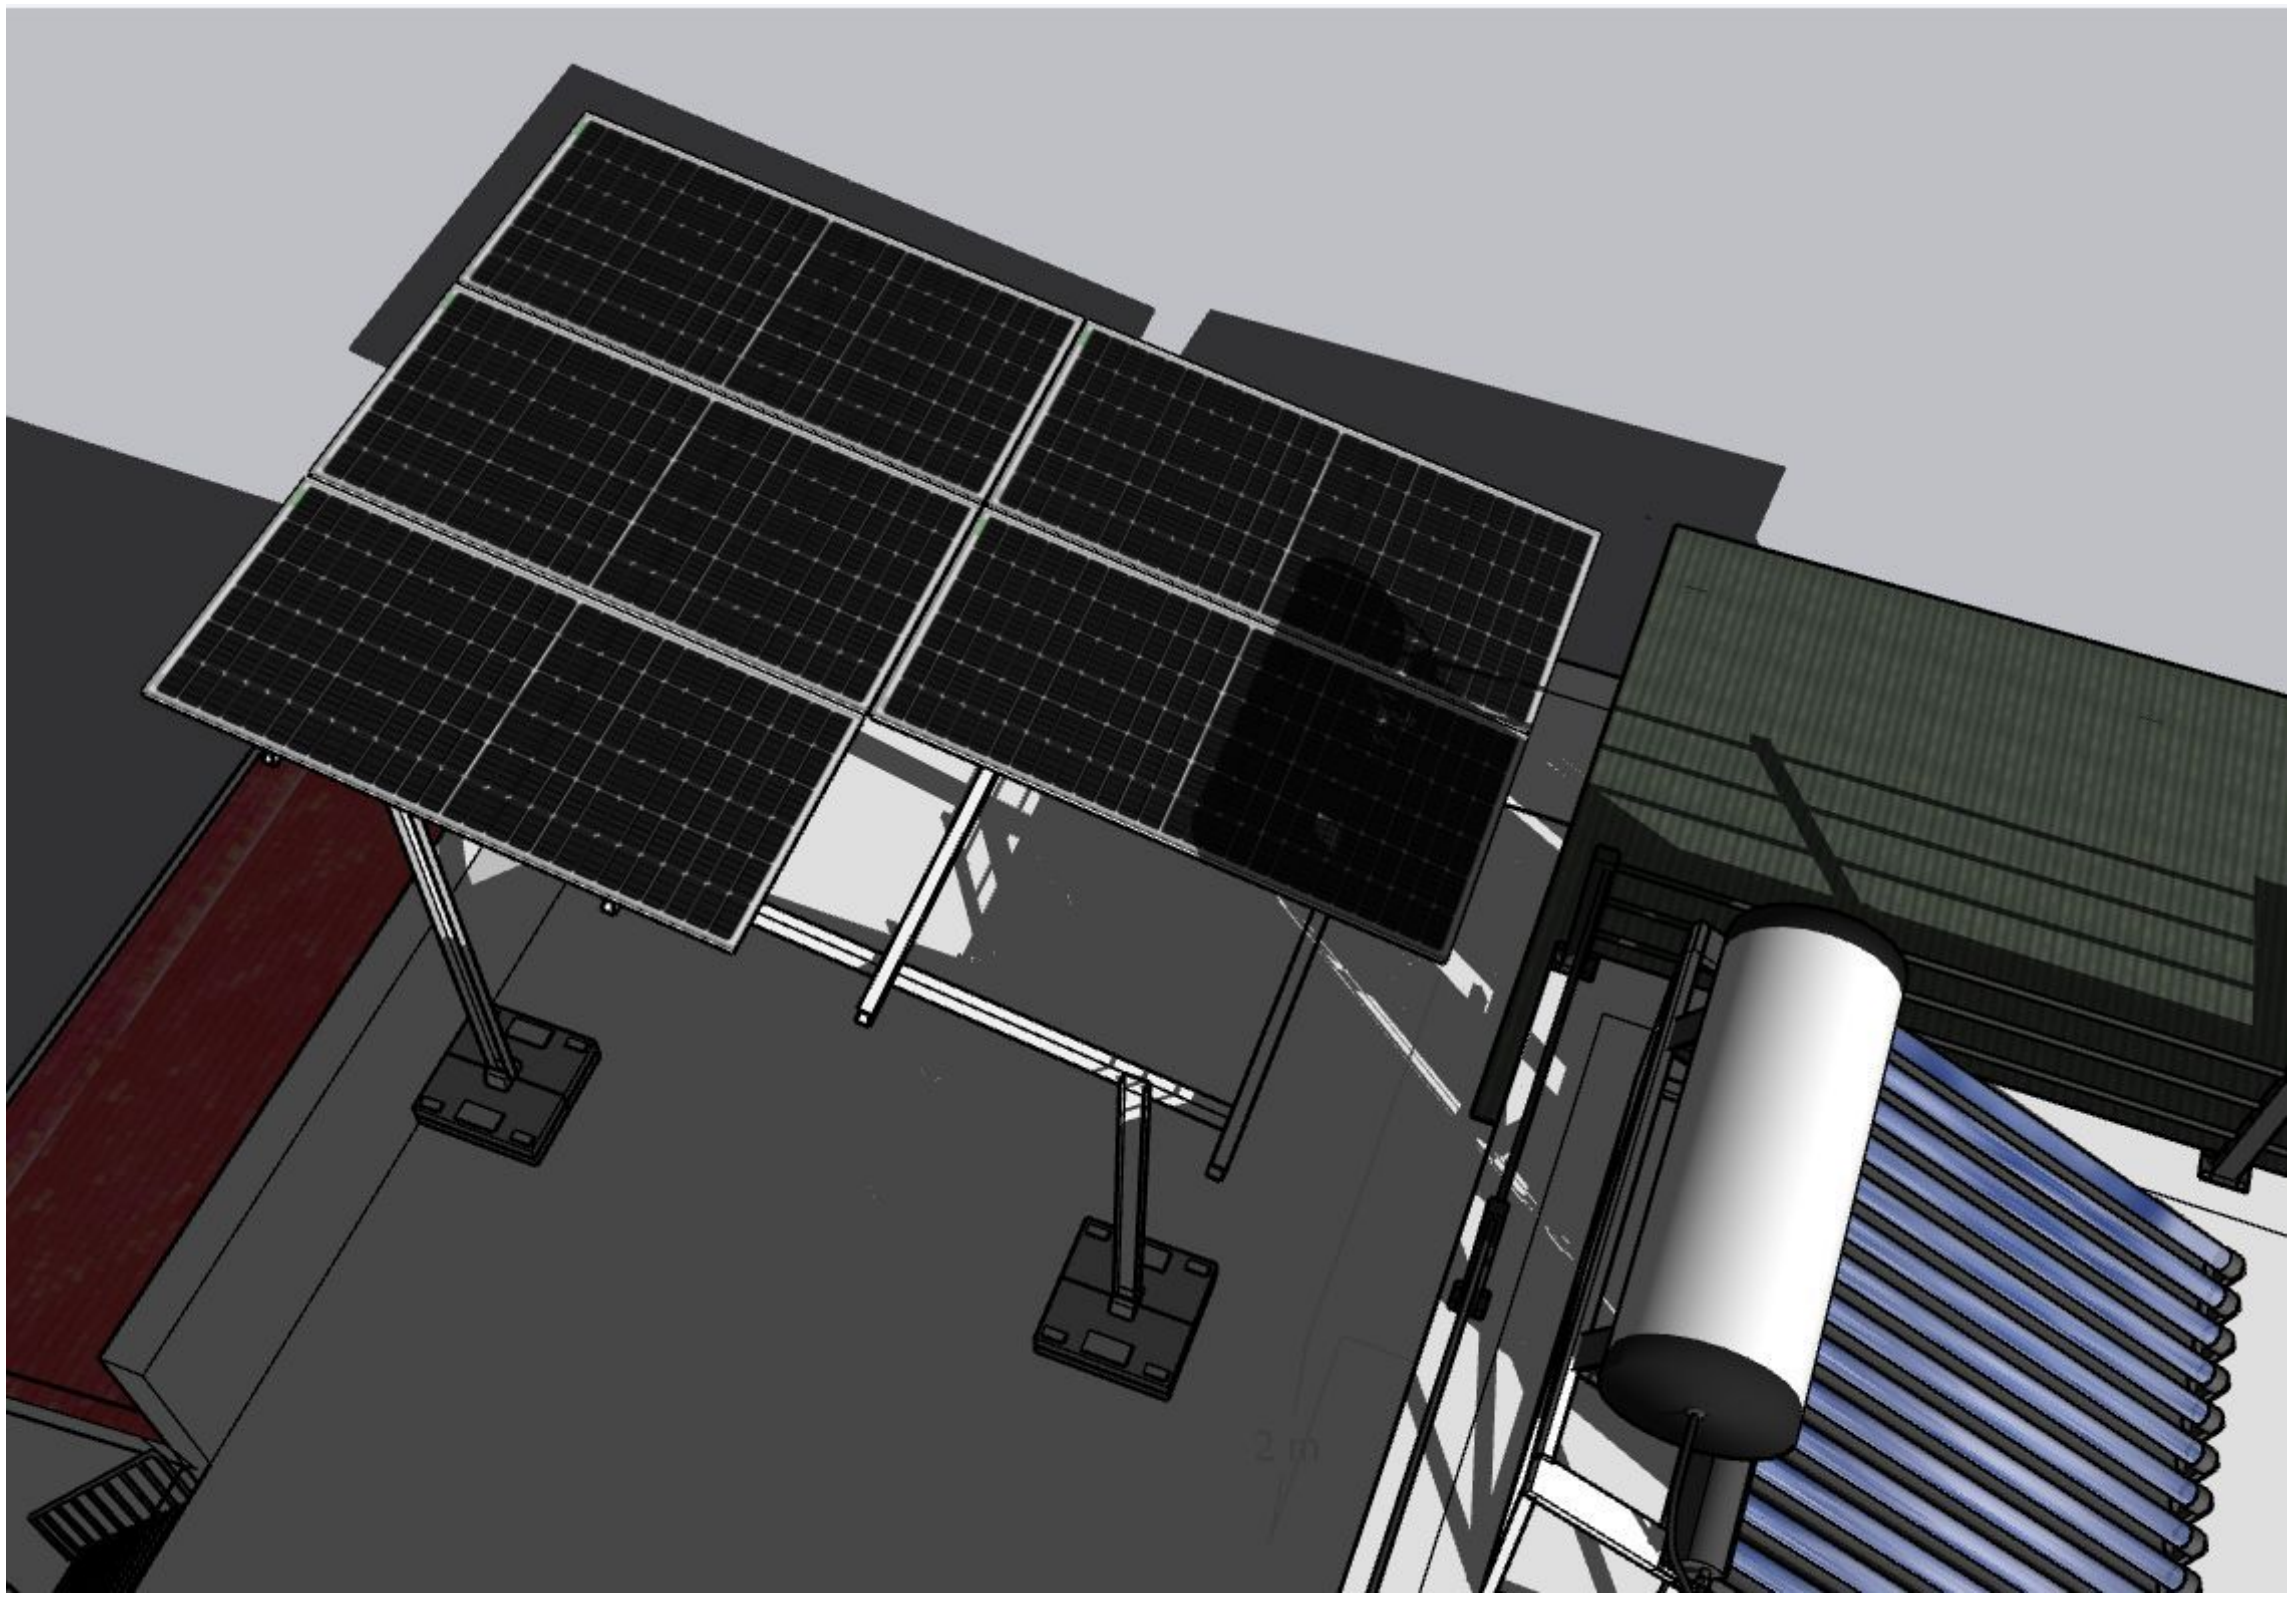

shadow_Dec 3pm

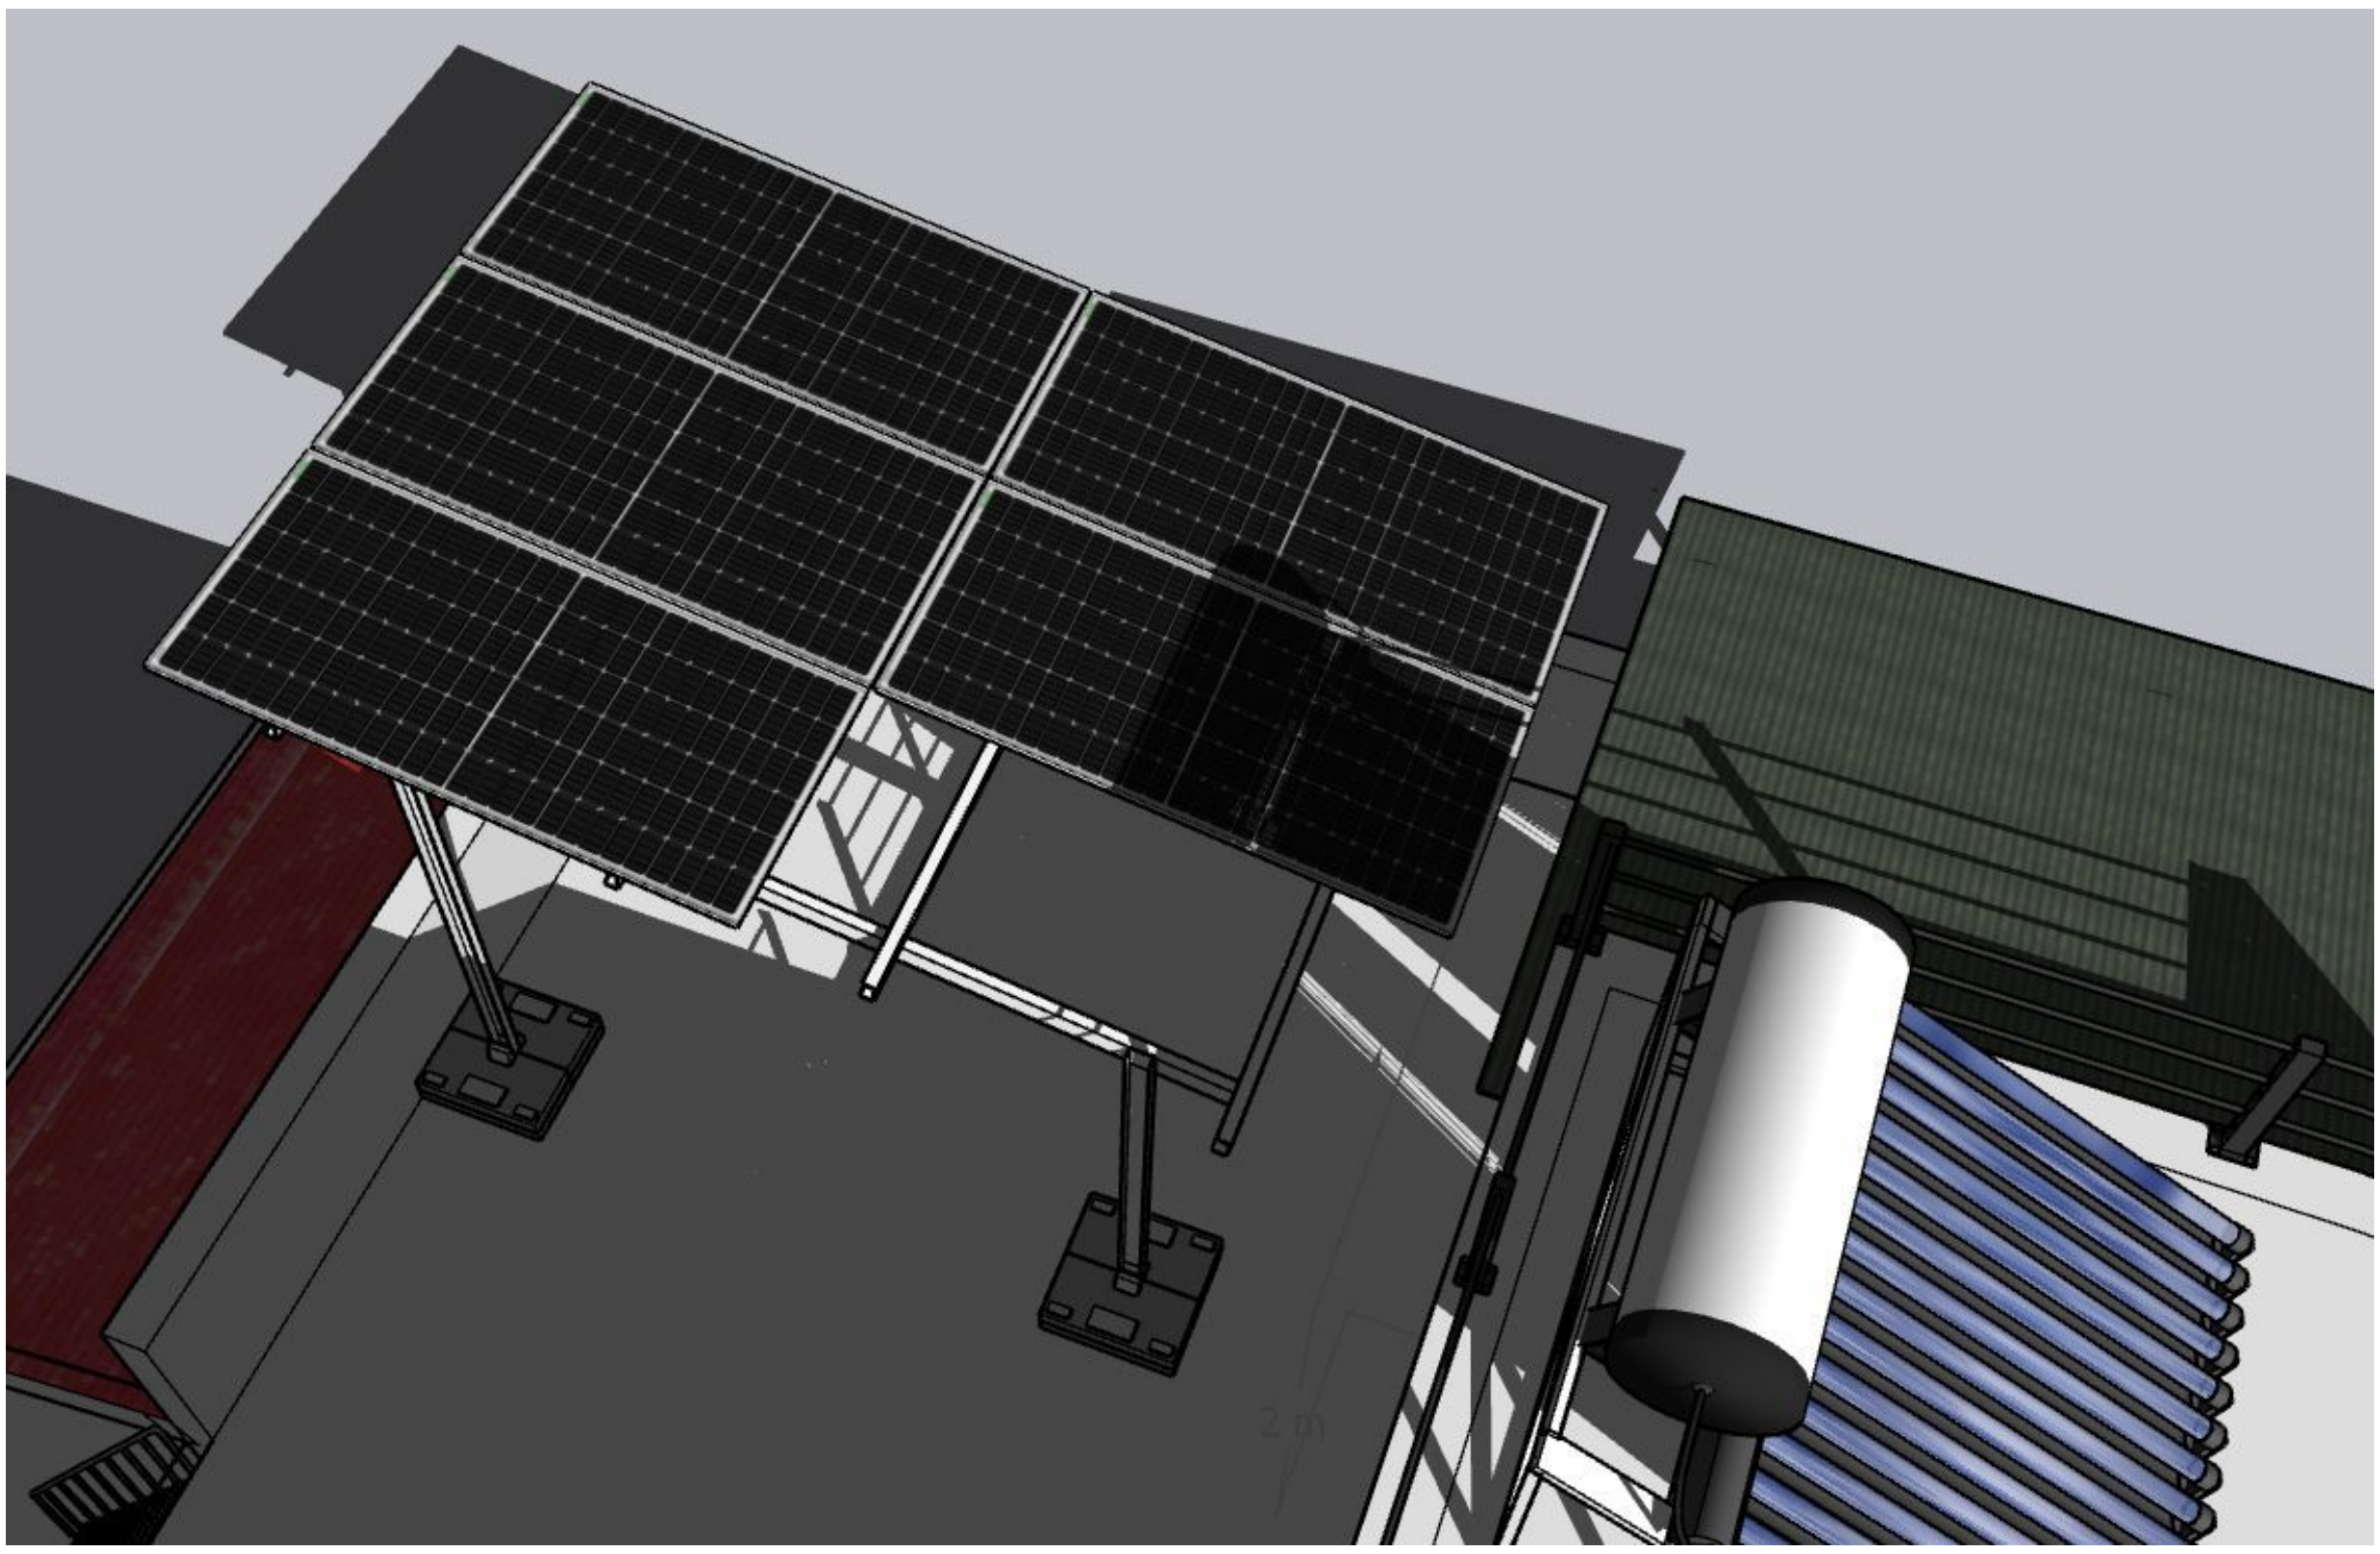

shadow_Nov 3pm

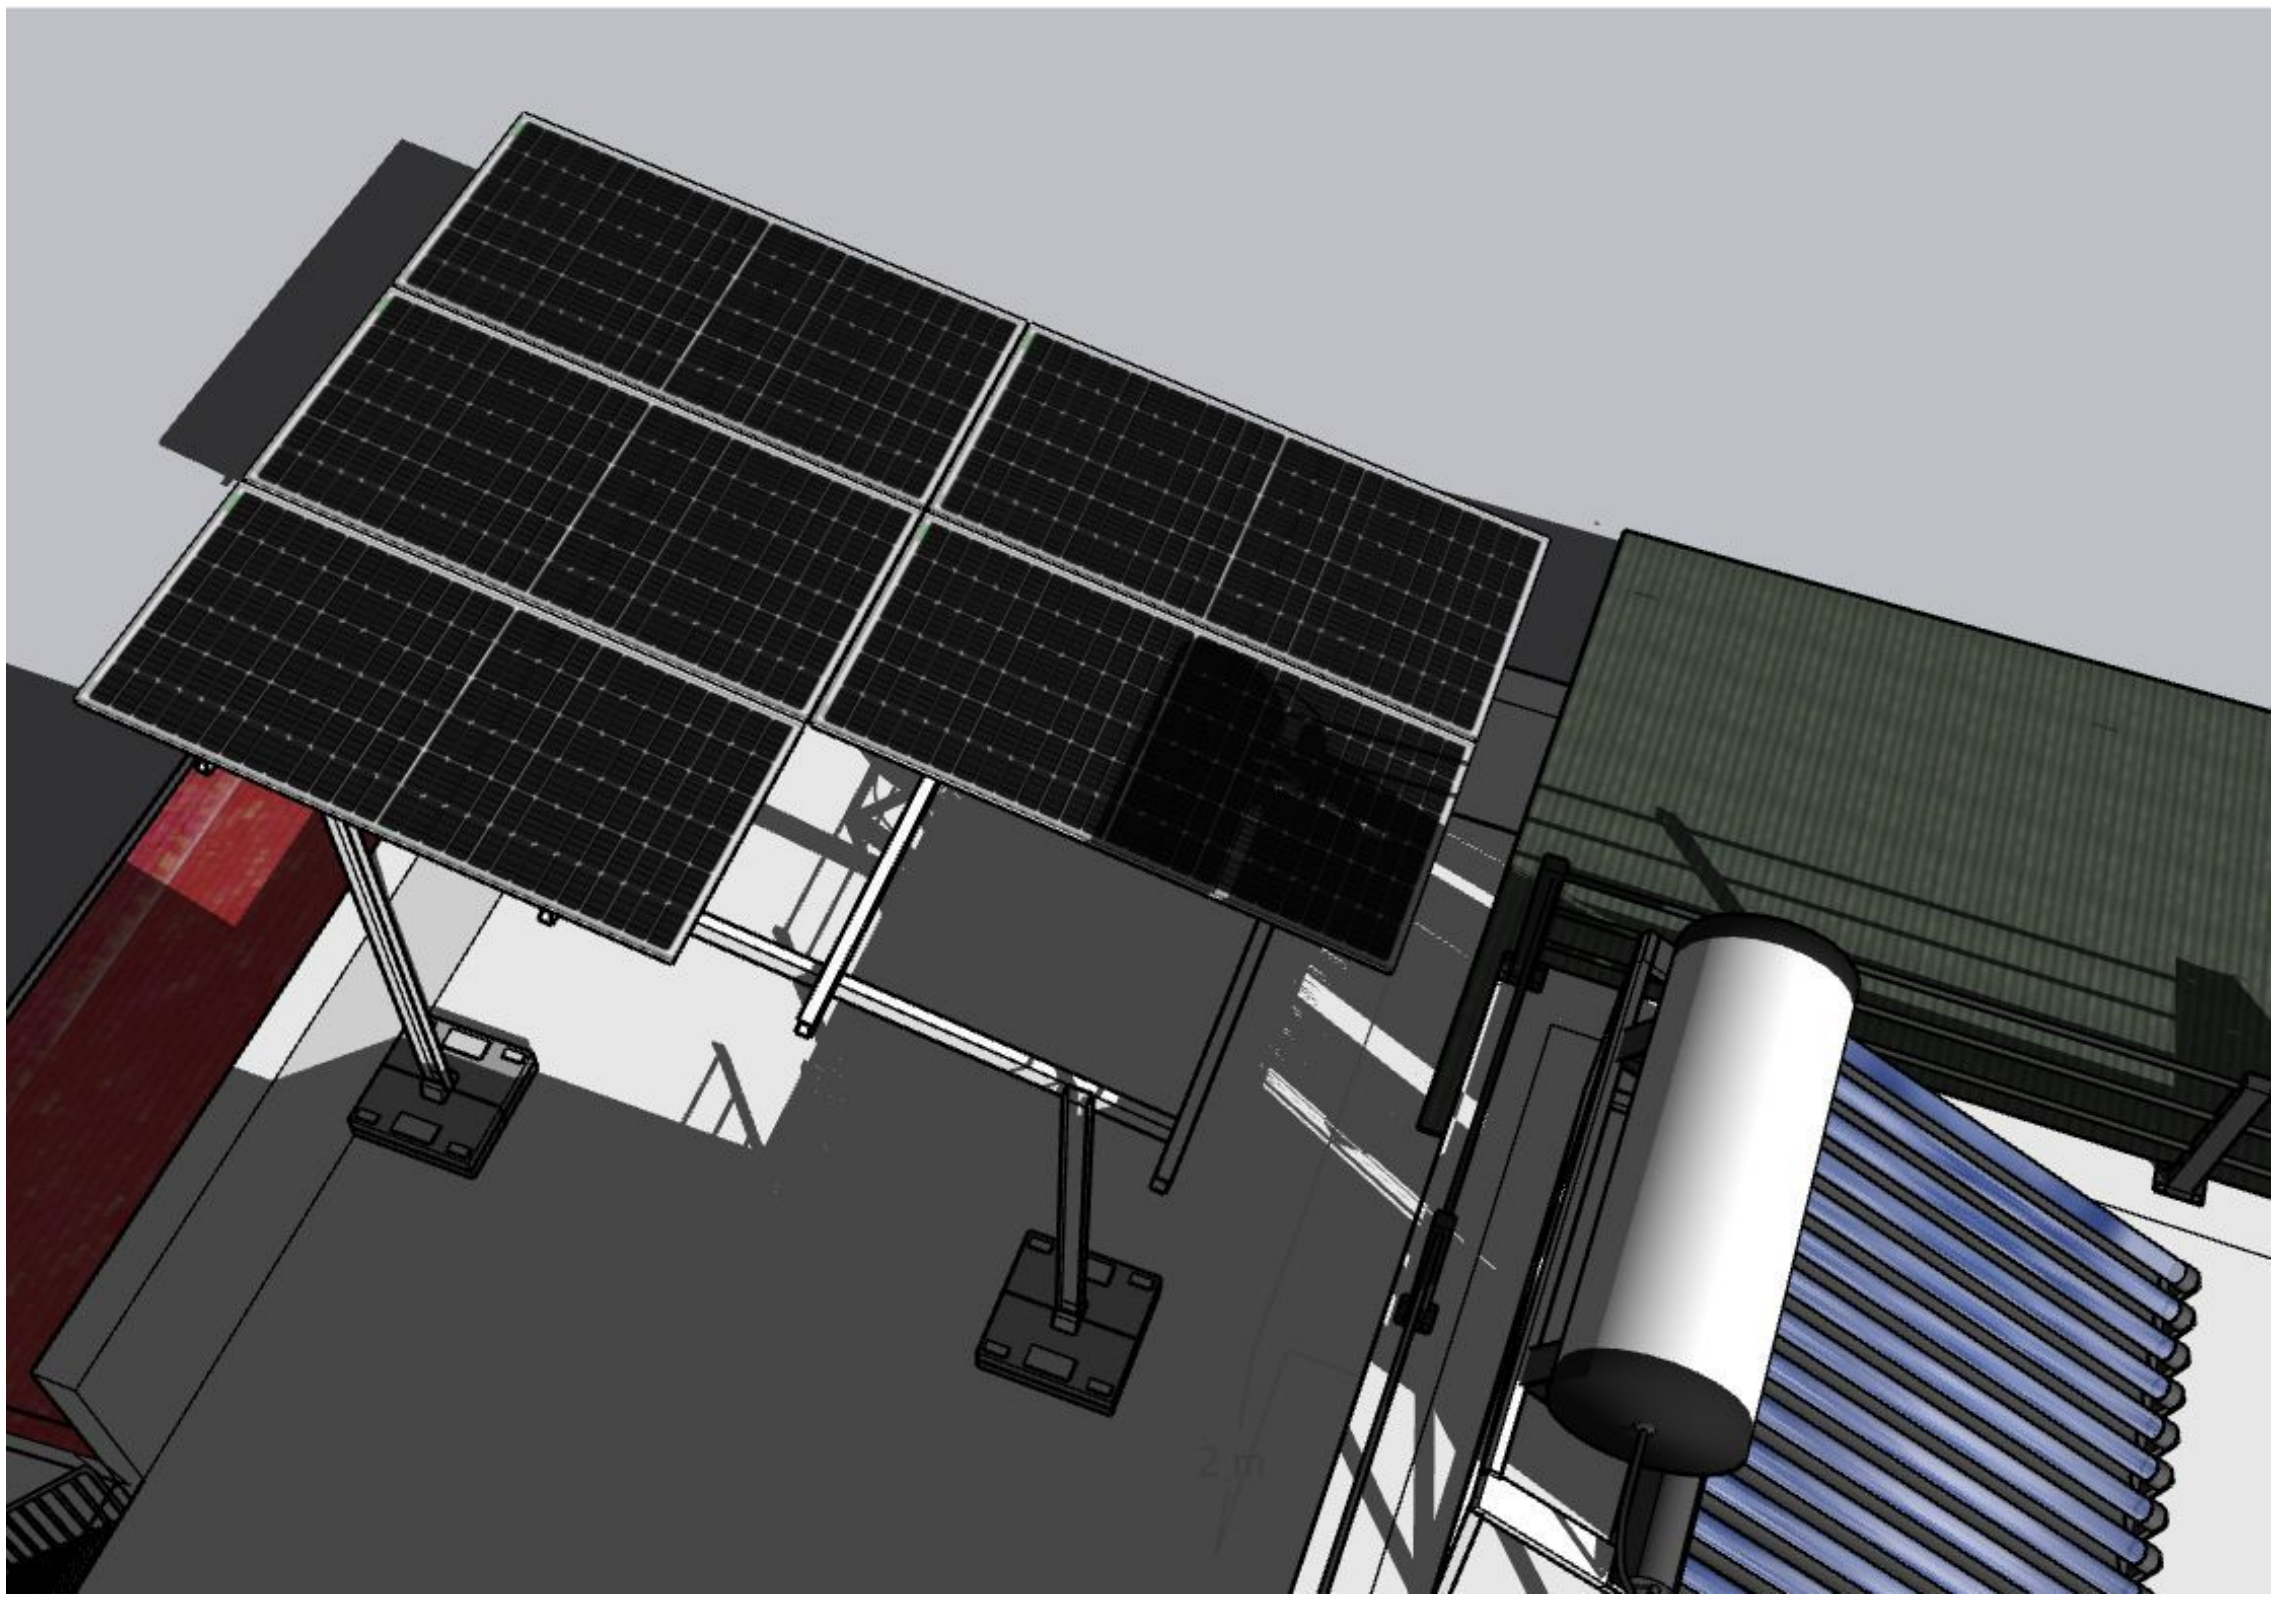

shadow_Jan 3pm

OBSERVATIONS & RECOMMENDATIONS

EcoSoch Scope

#	Observation
1	Installation and commissioning of 3.075 kWp, On-grid solar power plant at the proposed premises.
2	The co-ordination and follow-up with BESCOM regarding solar connectivity till commissioning.

Customer Scope

#	Observation
1	Providing an active Wi-Fi or LAN cable connection up to the inverter location.
2	The customer is responsible for arranging the ladder provision to get access to the proposed solar panel installation area prior to the project's execution.
3	Fabrication of a canopy to protect the Enphase accessories box installed at the premises

THANK YOU

Dear M N Shamanna,

Thank you for choosing EcoSoch Solar for your solar installation. We appreciate your trust in us and your commitment to sustainable energy. Our team is dedicated to ensuring a seamless installation experience and long-term performance of your solar system.

Should you have any questions or require further assistance, please do not hesitate to reach out to us.

Warm Regards,
Team EcoSoch

& Did You Know?

The Sun burns 600 million tonnes of hydrogen per second — and your panels get a share.

EcoSoch Solar Pvt. Ltd.
#940, Sha Arcade, 2nd Phase, NTI Layout, Kodigehalli, Bengaluru 560097
www.ecosoch.com | info@ecosoch.com