Technical Site Visit Report

Prepared for: Prestige Kensington Gardens_Jalahalli_38.34kWp_Optimizer

PROJECT INFORMATION

Report Number	ESV-2026-0170
Project ID	AC698FD4
Project Name	Prestige Kensington Gardens_Jalahalli_38.34kWp_Optimizer
Project Sector	Commercial
Project Type	With Subsidy
Sales Lead	Gautam
Site Address	3G2P+MQG, HMT Watch Factory Rd, HMT Estate, Jalahalli, Bengaluru, Karnataka 560013
GPS Coordinates	13.05085519022244, 77.53600948851171
Google Maps	https://www.google.com/maps?q=13.050855190222435,77.53600948851171
Visit Date	2026-07-17
Visited By	Charan
Revision	Rev 1

CLIENT INFORMATION

Client Name	Prestige Kensington Gardens
Contact	63644 65951

PROJECT DETAILS

Solar Rooftop System Type	On-Grid
System Capacity (kWp)	38.34
Sanction Load (kW)	45
Module Make & Capacity	Premier Mono PERC DCR and 540Wp
Module Length (mm)	2278
Module Width (mm)	1134

Number of Panels	71
Inverter Type	SolarEdge
Inverter Brand	Solaredge 33.33 kW 3ph - Optimizer S1200
Number of Inverters	1
Number of Optimizers	36
Mounting Structure Type	RCC Flat Roof

SITE INSPECTION CHECKLIST

General

#	Question	Answer	Notes
1	Can the delivery van/truck reach the material unloading point?	Yes	-
2	Are there any obstacles at the site that could hinder material lifting?	**No**	-
3	Where will the Inverter, DCDB, ACDB, Battery, etc. be located?	Inside the staircase room	-
4	Is a canopy required for protecting the Inverters/ACDB/DCDB?	**No**	-
5	Did you discuss the location of the earth pits with the customer?	Yes, out side the electrical room	-
6	Where is the Internet Router located?	On lift room	-
7	What's the Wi-Fi strength of the router near to the String inverter/Envoy?	2 bars	-
8	Did you pin the site location in your WhatsApp when you were at the site?	Yes	-

Roof Details

#	Question	Answer	Notes
1	What type of roof is present at the site?	RCC Flat Roof	-
2	Are there any obstructions on the roof that could affect the solar installation?	**No**	-
3	What is the angle of the panels? (in degrees)	10	-
4	In case of sloped roof, what is the slope angle of the roof? (in degrees)	N/A	-
5	On how many roofs at the site are we installing solar?	1	-
6	If it is a Tiled roof, what is underneath the tiles?	N/A	-
7	If it is a Tiled roof with MS or Wooden rafters, is it Single-tiled or Double-tiled?	N/A	-
8	What type of mounting structure is planned?	Ballast	*Ballast structure with 1m height.*
9	What is the orientation of the solar panels?	["South"]	-
10	How can the roof be accessed?	Staircase	-
11	Is the building currently under construction?	**No**	-

#	Question	Answer	Notes
12	In an under-construction building, are existing conduit pipes available for AC, DC cables, and earthing?	**No**	-
13	What is the height of the building and how many floors does it have?	18m with B+G+ floors	-
14	Is the site photo matching with the building description?	Yes	-
15	Is there an overhead HT line passing within a 10-meter radius of the site?	**No**	-

Residential / Electrical

#	Question	Answer	Notes
1	What type of energy meter is currently installed?	Phase: Three Phase, Type: Digital, If 3-phase: LT with CT (35 - 49.999)	-
2	Is the Meter cubicle photo matching with the previous answer?	Yes	-
3	Has the termination point in the Main meter panel been identified?	Yes	-
4	Is the Termination Point easily visible or sealed?	Sealed	-
5	Is a Lightning Arrestor (LA) already available at the site?	Yes	-
6	Is space available for CT within Energy meter panel?	**No**	-
7	In case of an Enphase system, is the distance between the farthest micro-inverter and IQ Gateway > 50m?	N/A	-
8	Provide details of the existing CT ratings (if applicable).	75/5A	-
9	In Main meter panel, is empty space available for solar meter?	**No**	-
10	In Main meter panel, is empty space available to house the Enphase accessories or ACDB components?	N/A	-
11	Is there space available to dig DC, AC and LA earth pits?	Yes	-
12	In case of elevated structures, is an LA extension provided at the far end?	N/A	-
13	In case of elevated structures, is it with or without grouting?	N/A	-
14	Are there any challenges with respect to Installation and Maintenance activities?	**No**	-
15	Are there any safety risks associated with accessing the roof for installation?	**No**	-
16	Is space present in rooftop to store the panels?	Horizontally sleeping	-
17	In case of sloped roof MS structure, provide the dimension of rafter to rafter, purlin to purlin.	N/A	-
18	Is ventilation available in the battery location?	N/A	-
19	Should the Inverters/ACDB/DCDB be installed on a metal grill or wall mount?	N/A	-
20	Provide the dimensions for solar meter cubicle placement (L x W of wall).	length: 2000, width: 1500	-
21	Provide the dimension for earth pits location (L x W of available space).	length: 1500, width: 1500	-
22	Is LAN cable under customer scope?	Yes	-
23	Is there any shadow that affects the solar installation?	Yes	-

#	Question	Answer	Notes
24	Is there any trench work to be done to carry the AC cable to the meter location?	**No**	-

PHOTO DOCUMENTATION

Cable Routing Legend

Legend	Description
	Proposed PV Module Array
	Main Meter Location
	Solar Meter
	Battery
	Inverter
	Other Equipment
	DC Cable
	AC Cable
	Material Shifting
	DC Earthing Cable
	AC Earthing Cable
	LA Cable
	DC Earth Pit
	AC Earth Pit
	LA Pit
	LA

Site Layout

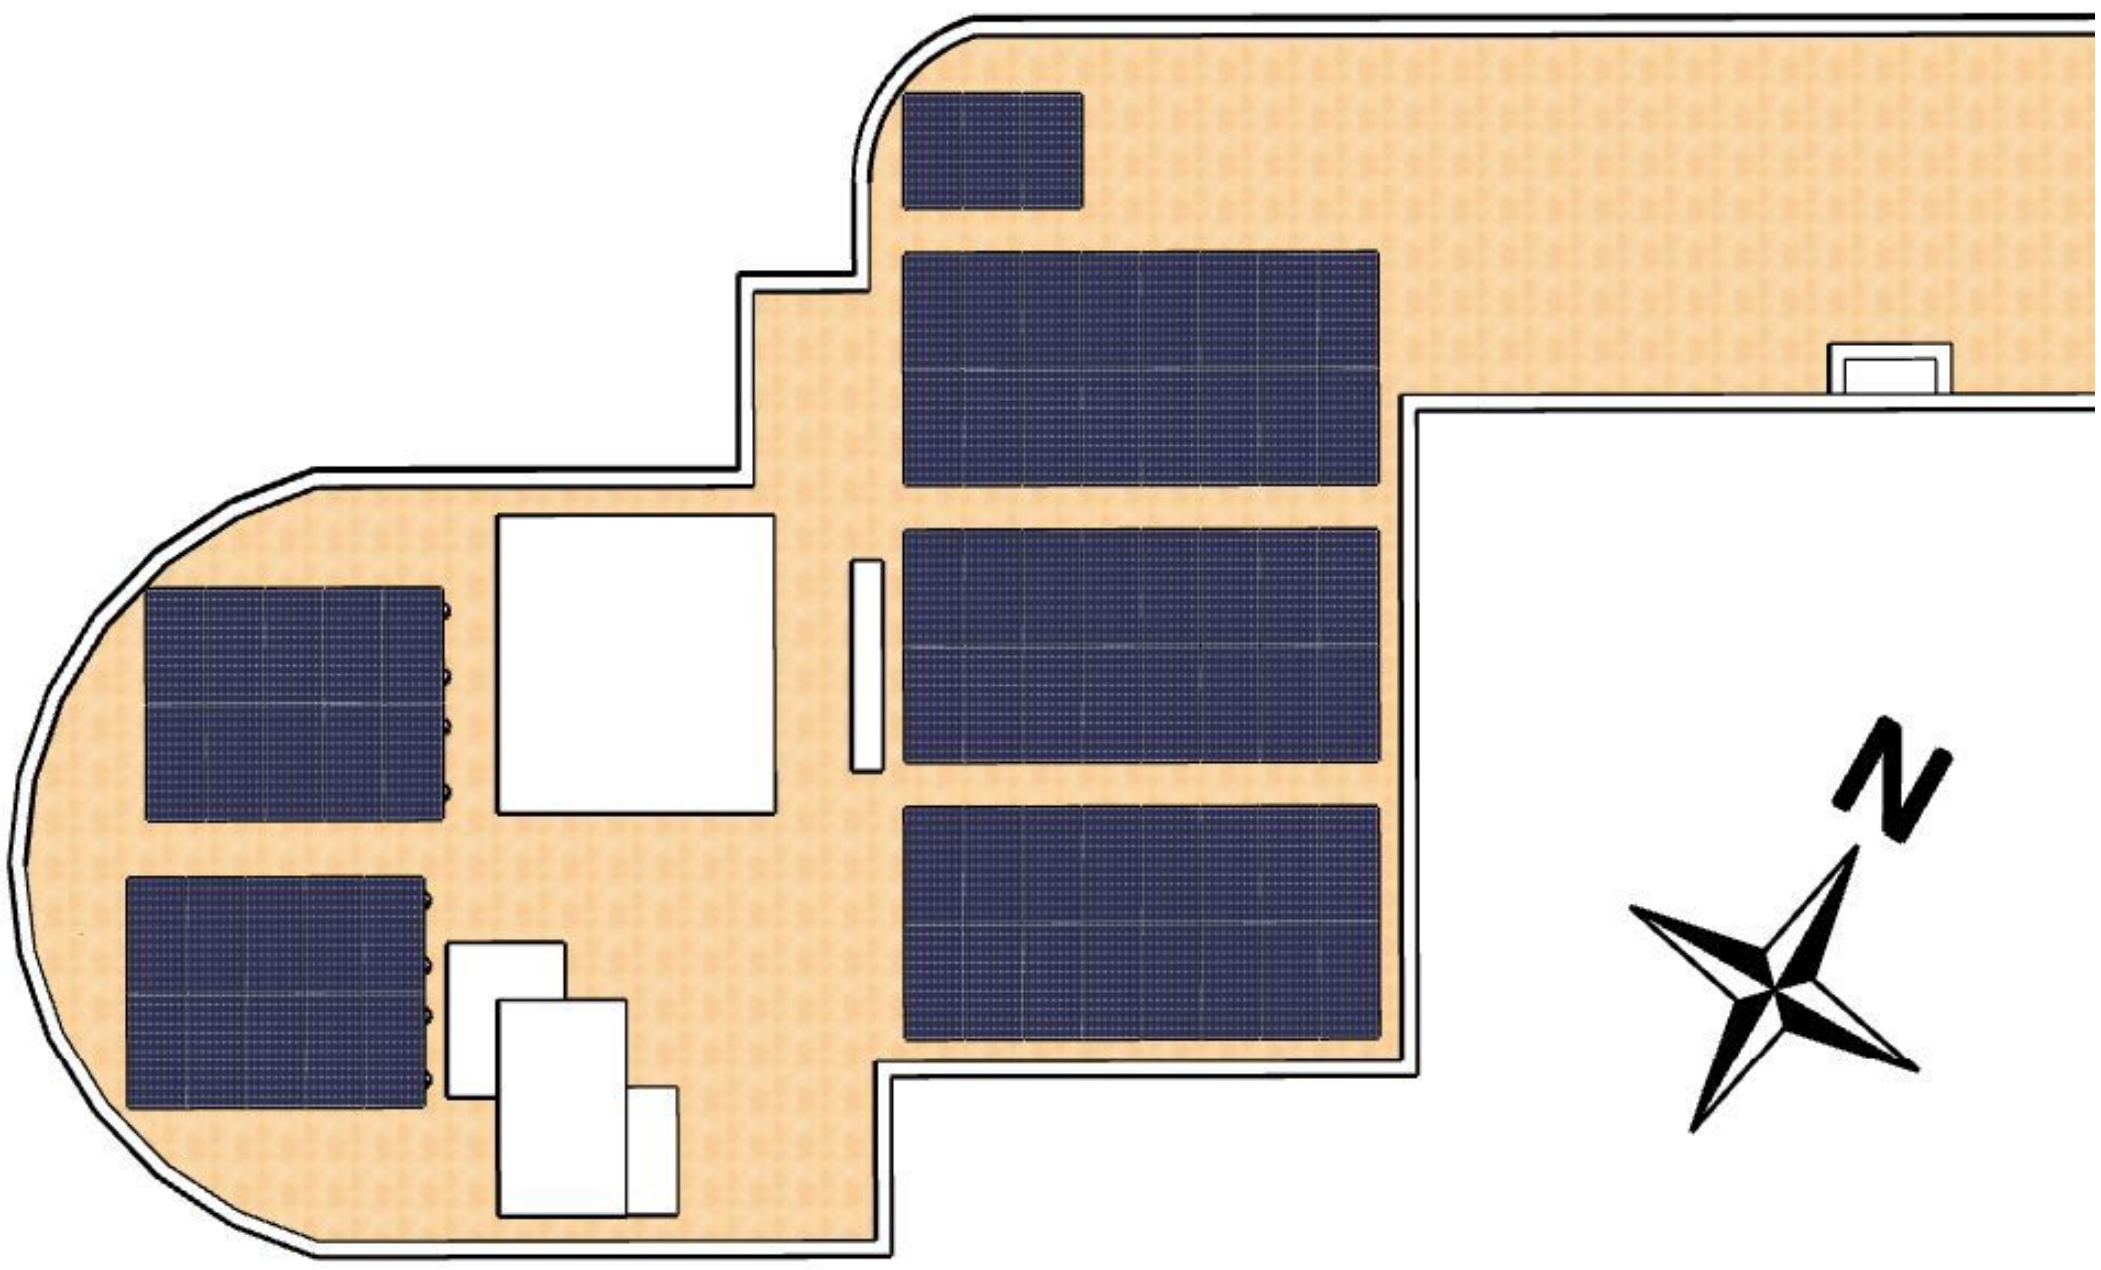
N

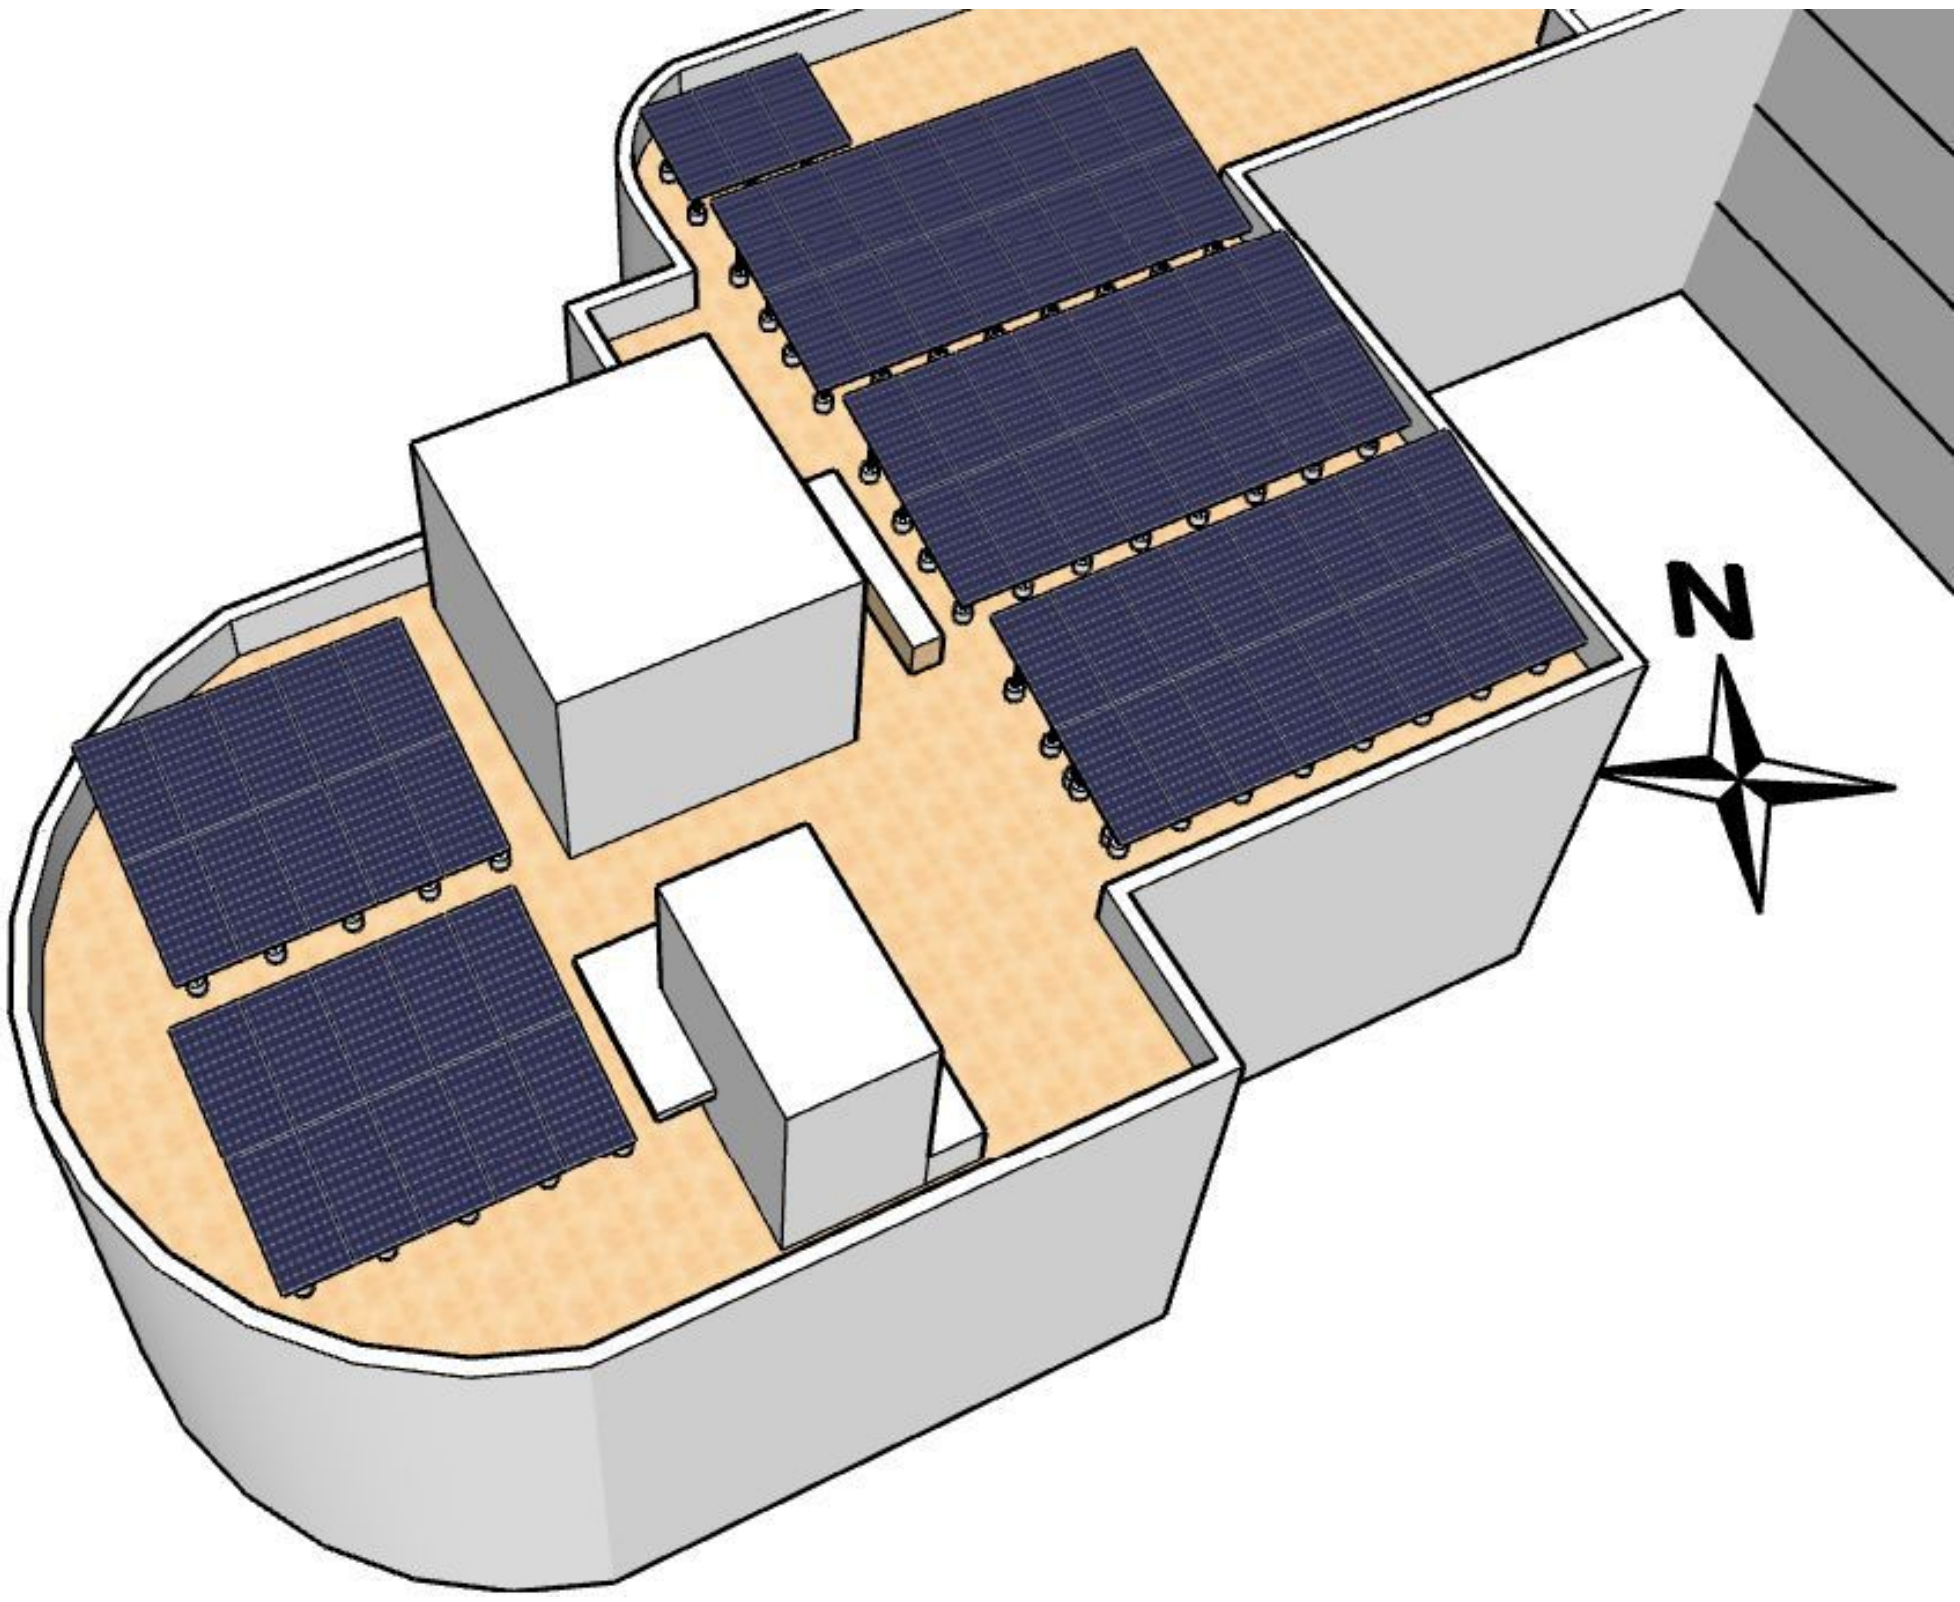
N

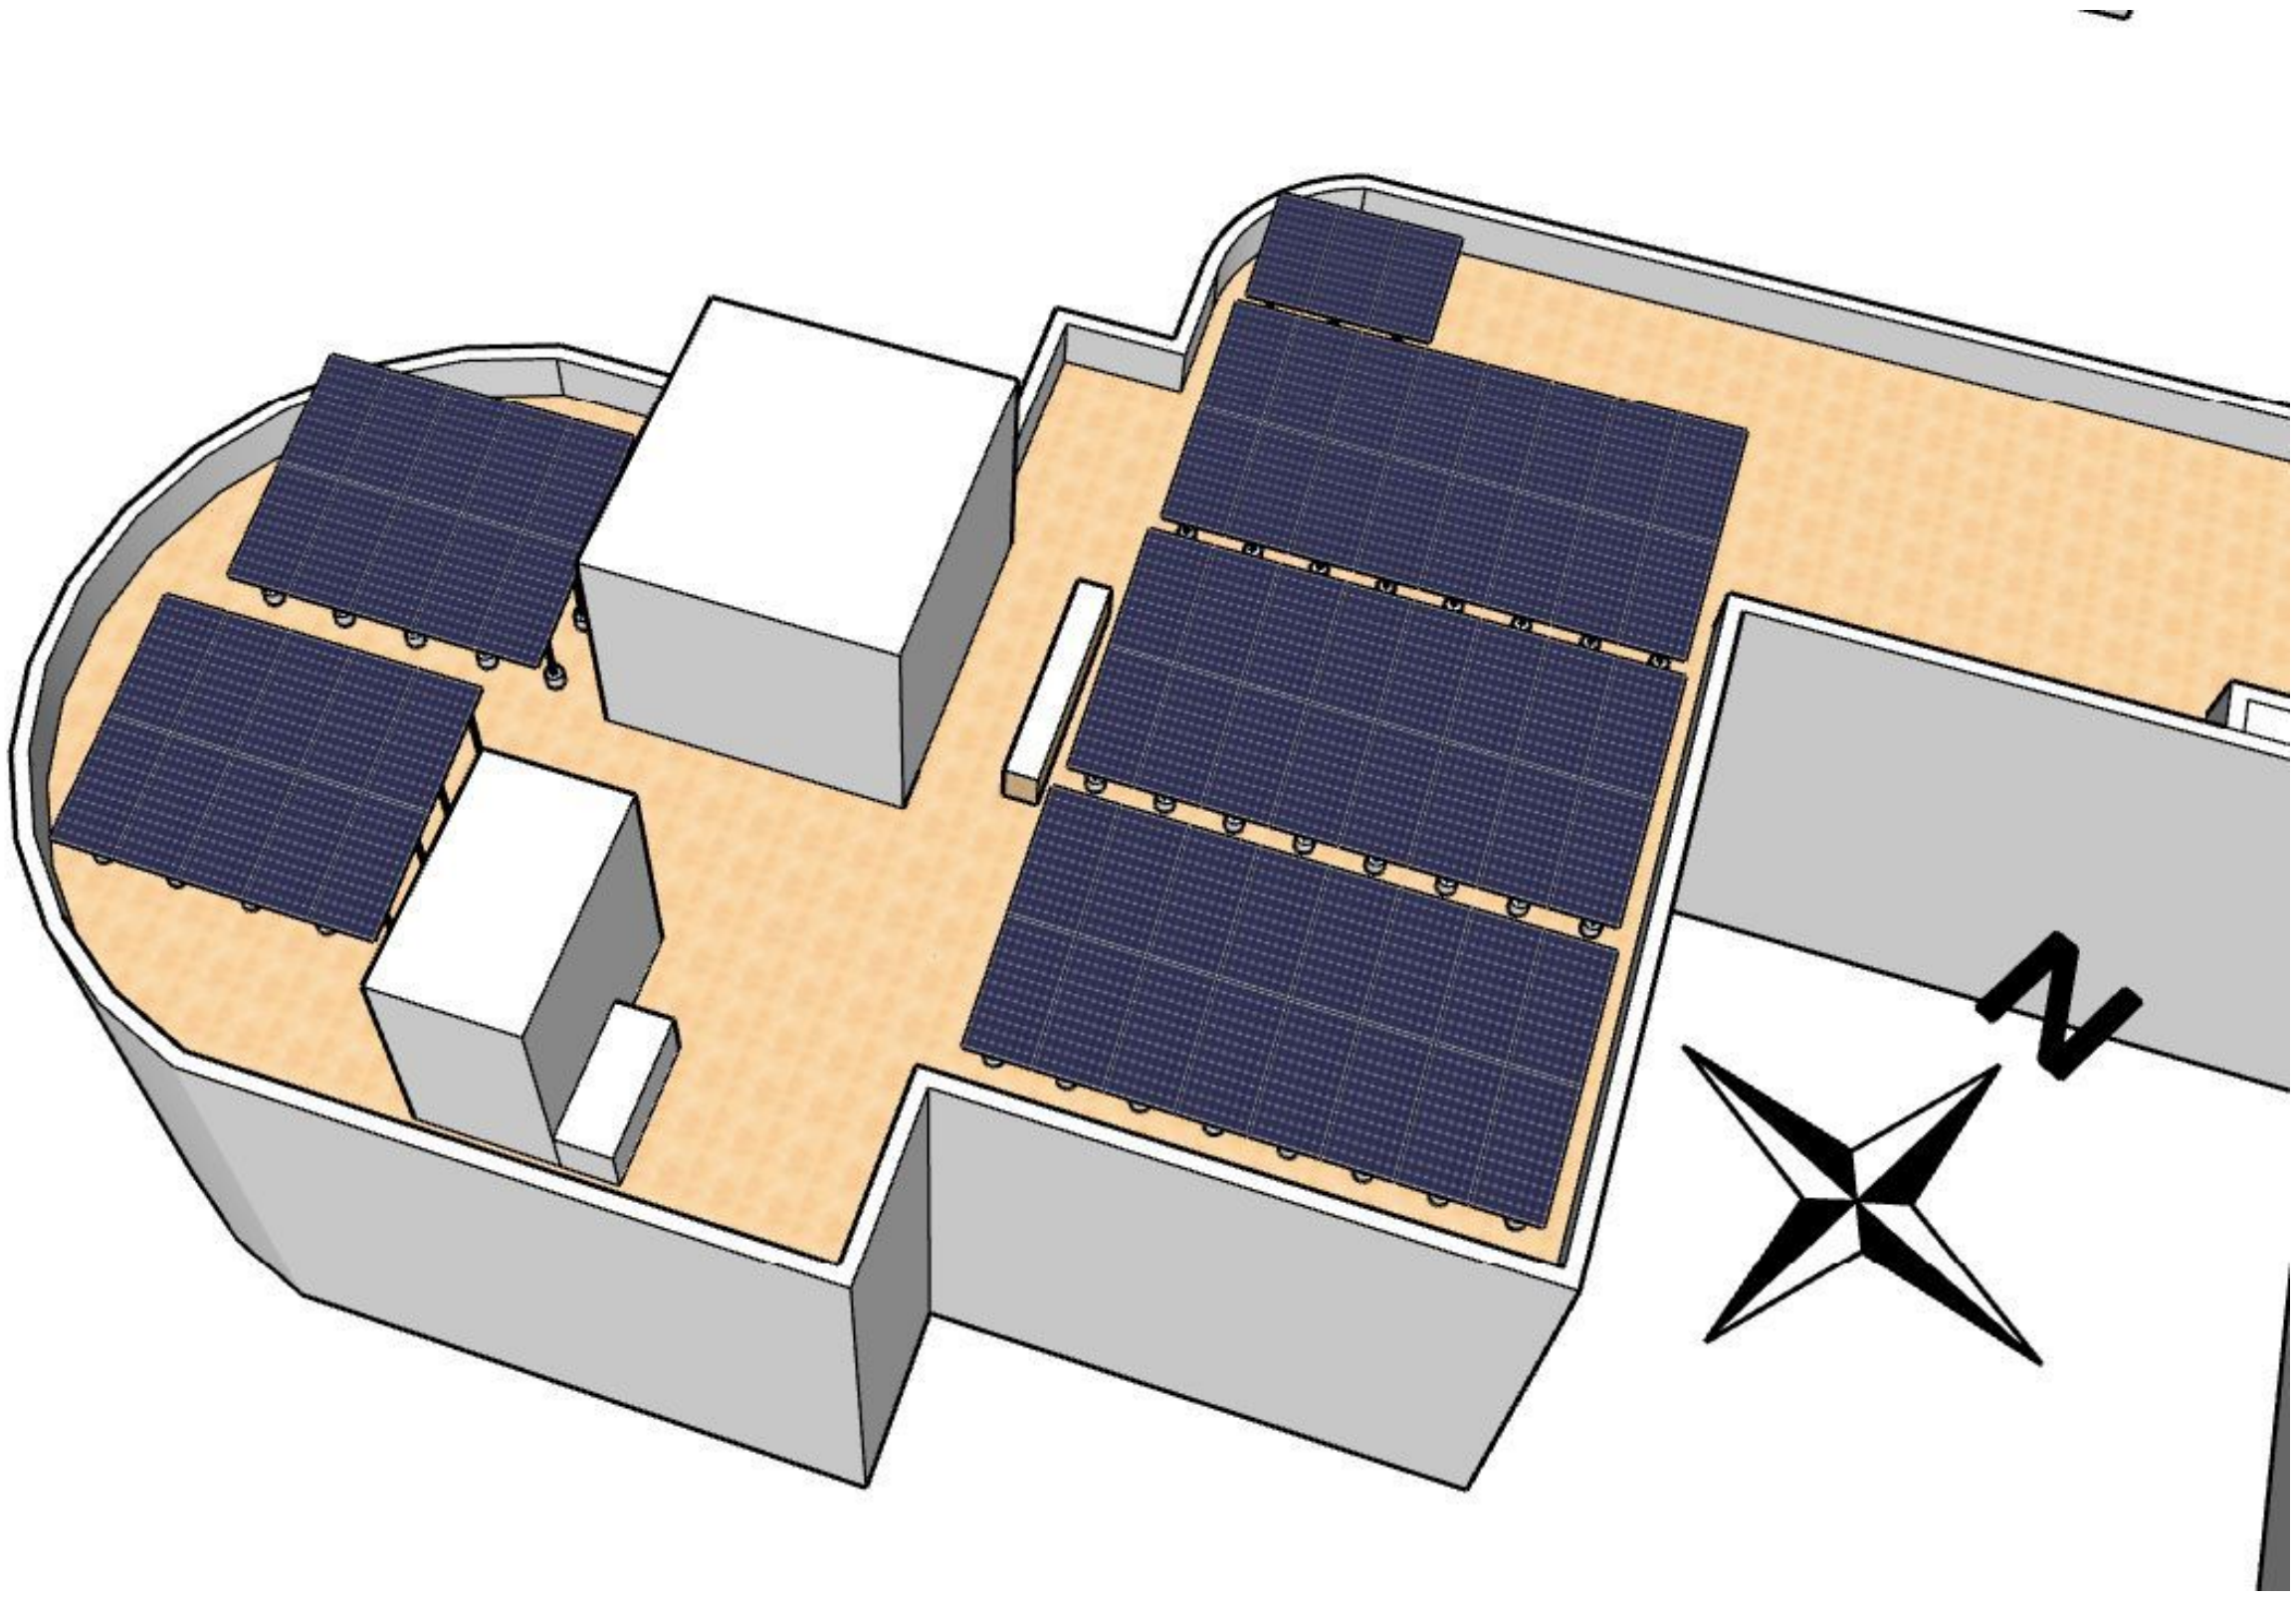

Structure Details

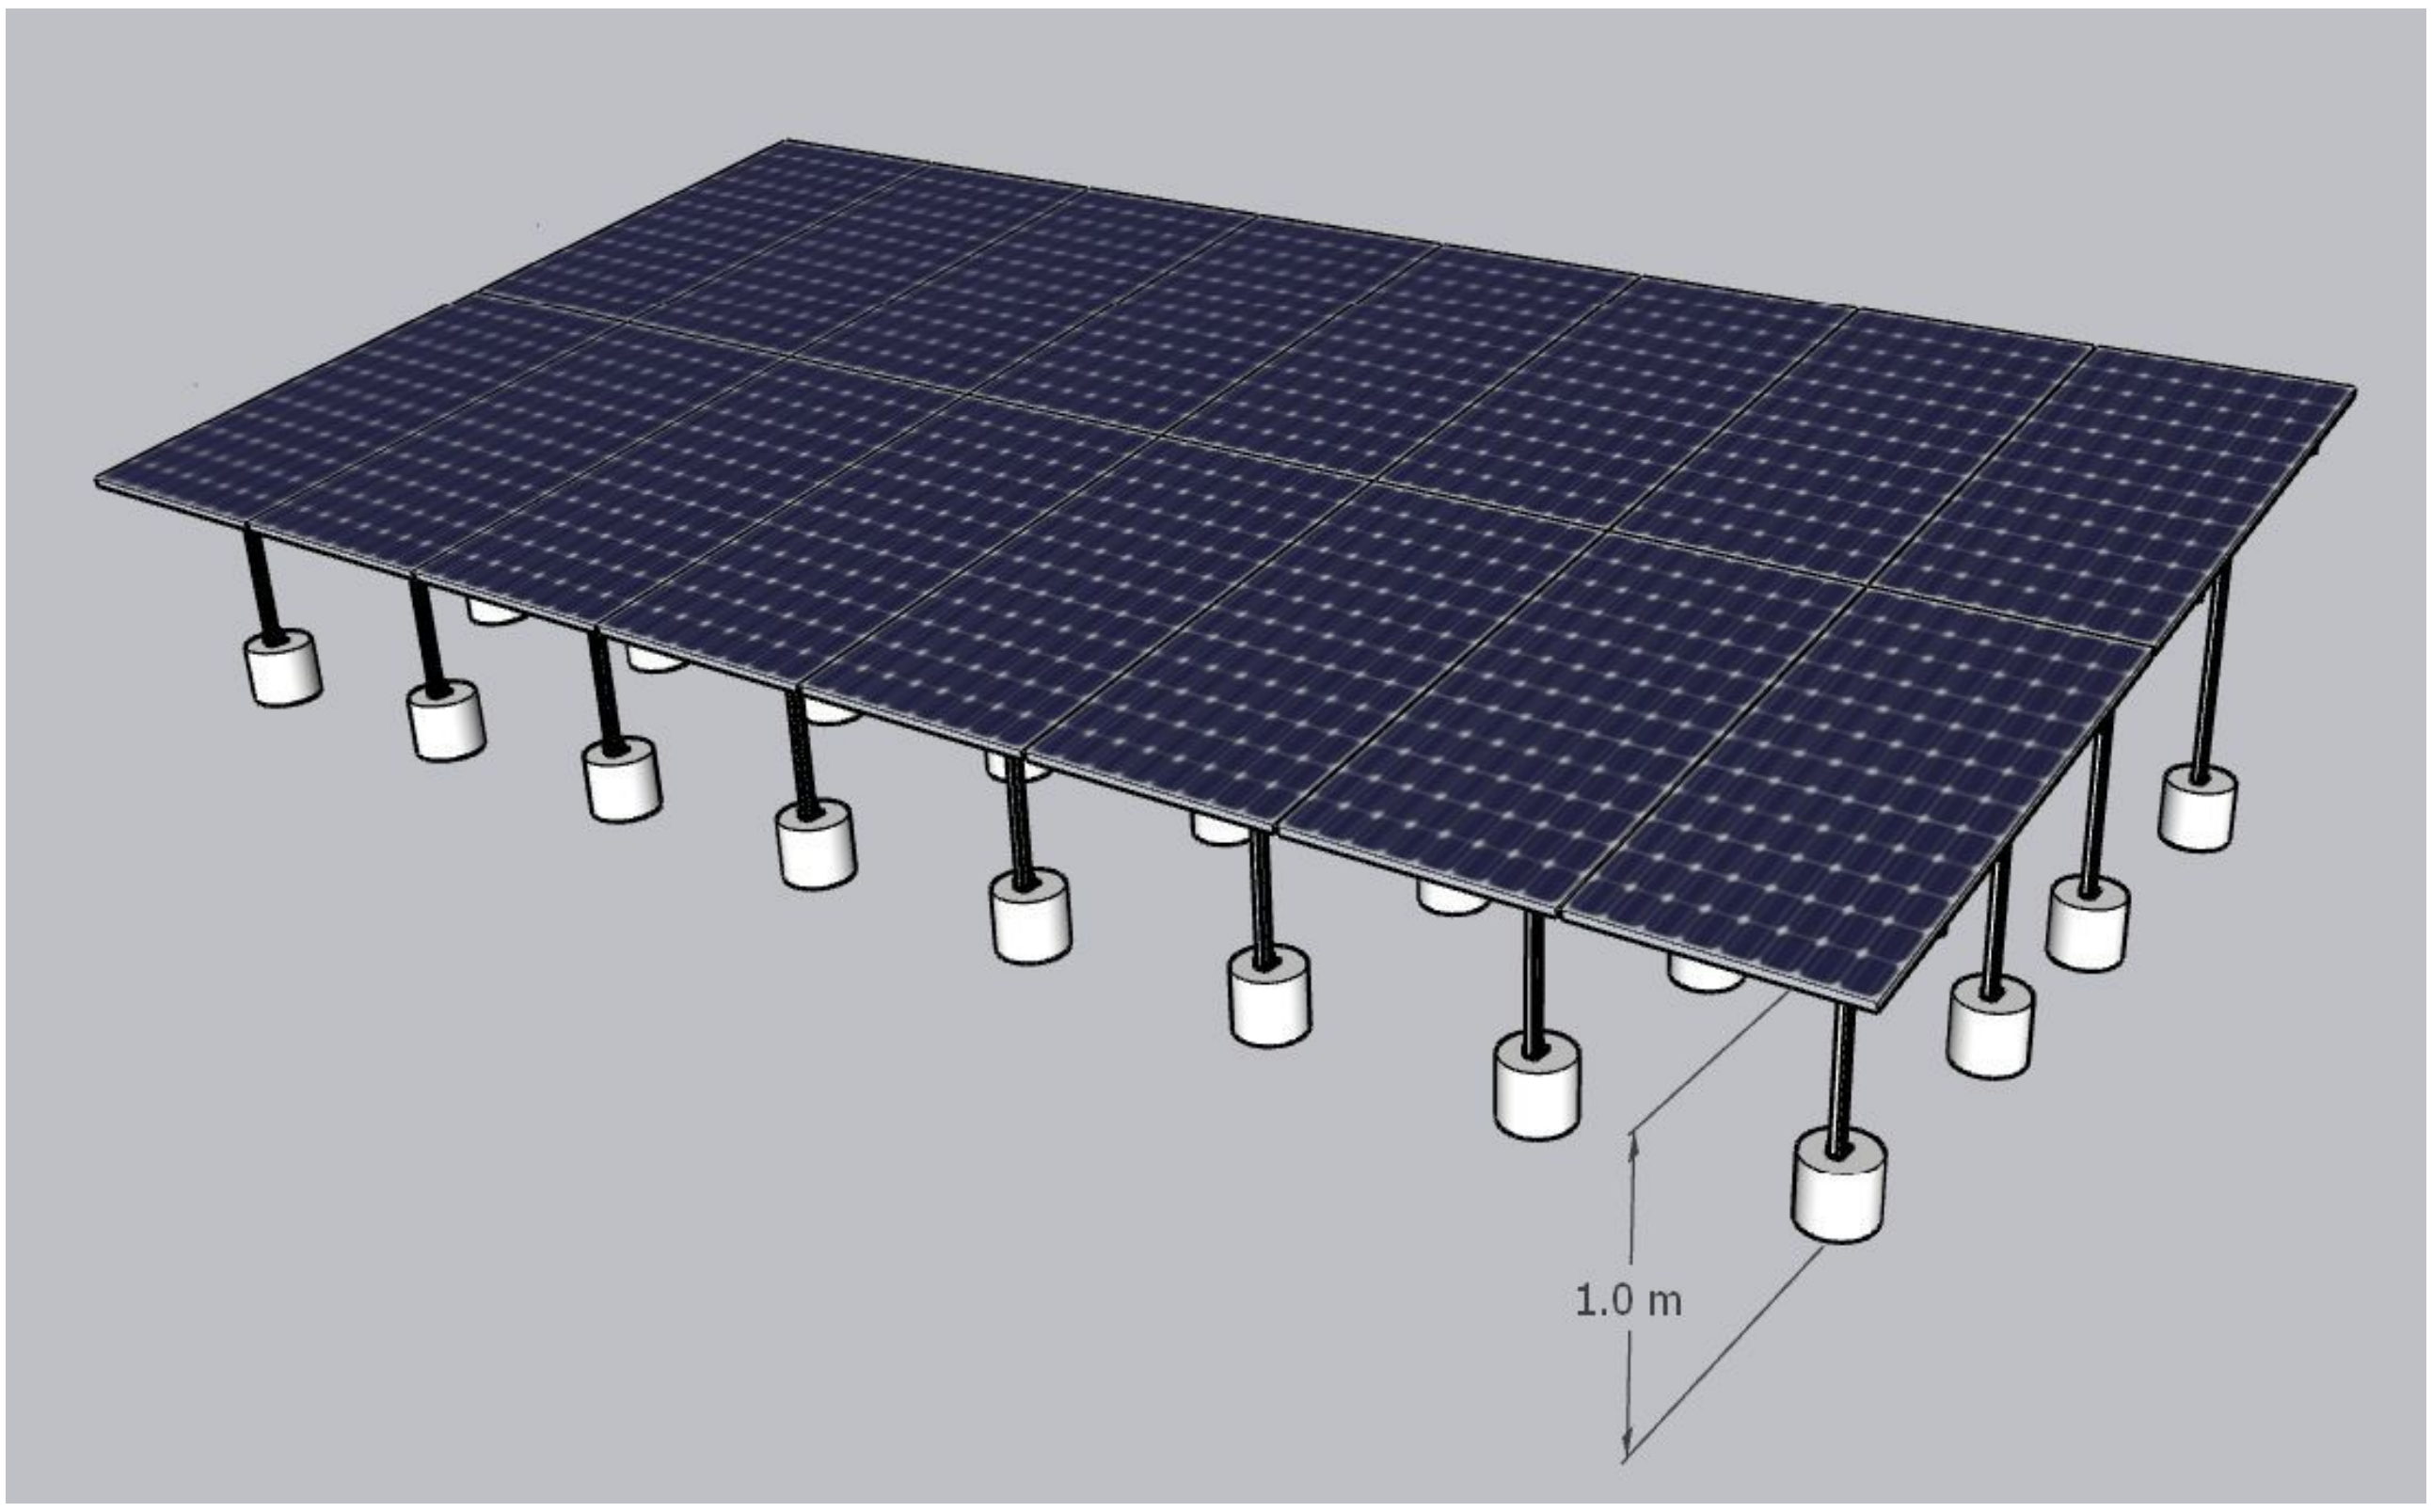

8P2 Structure - 3no.s

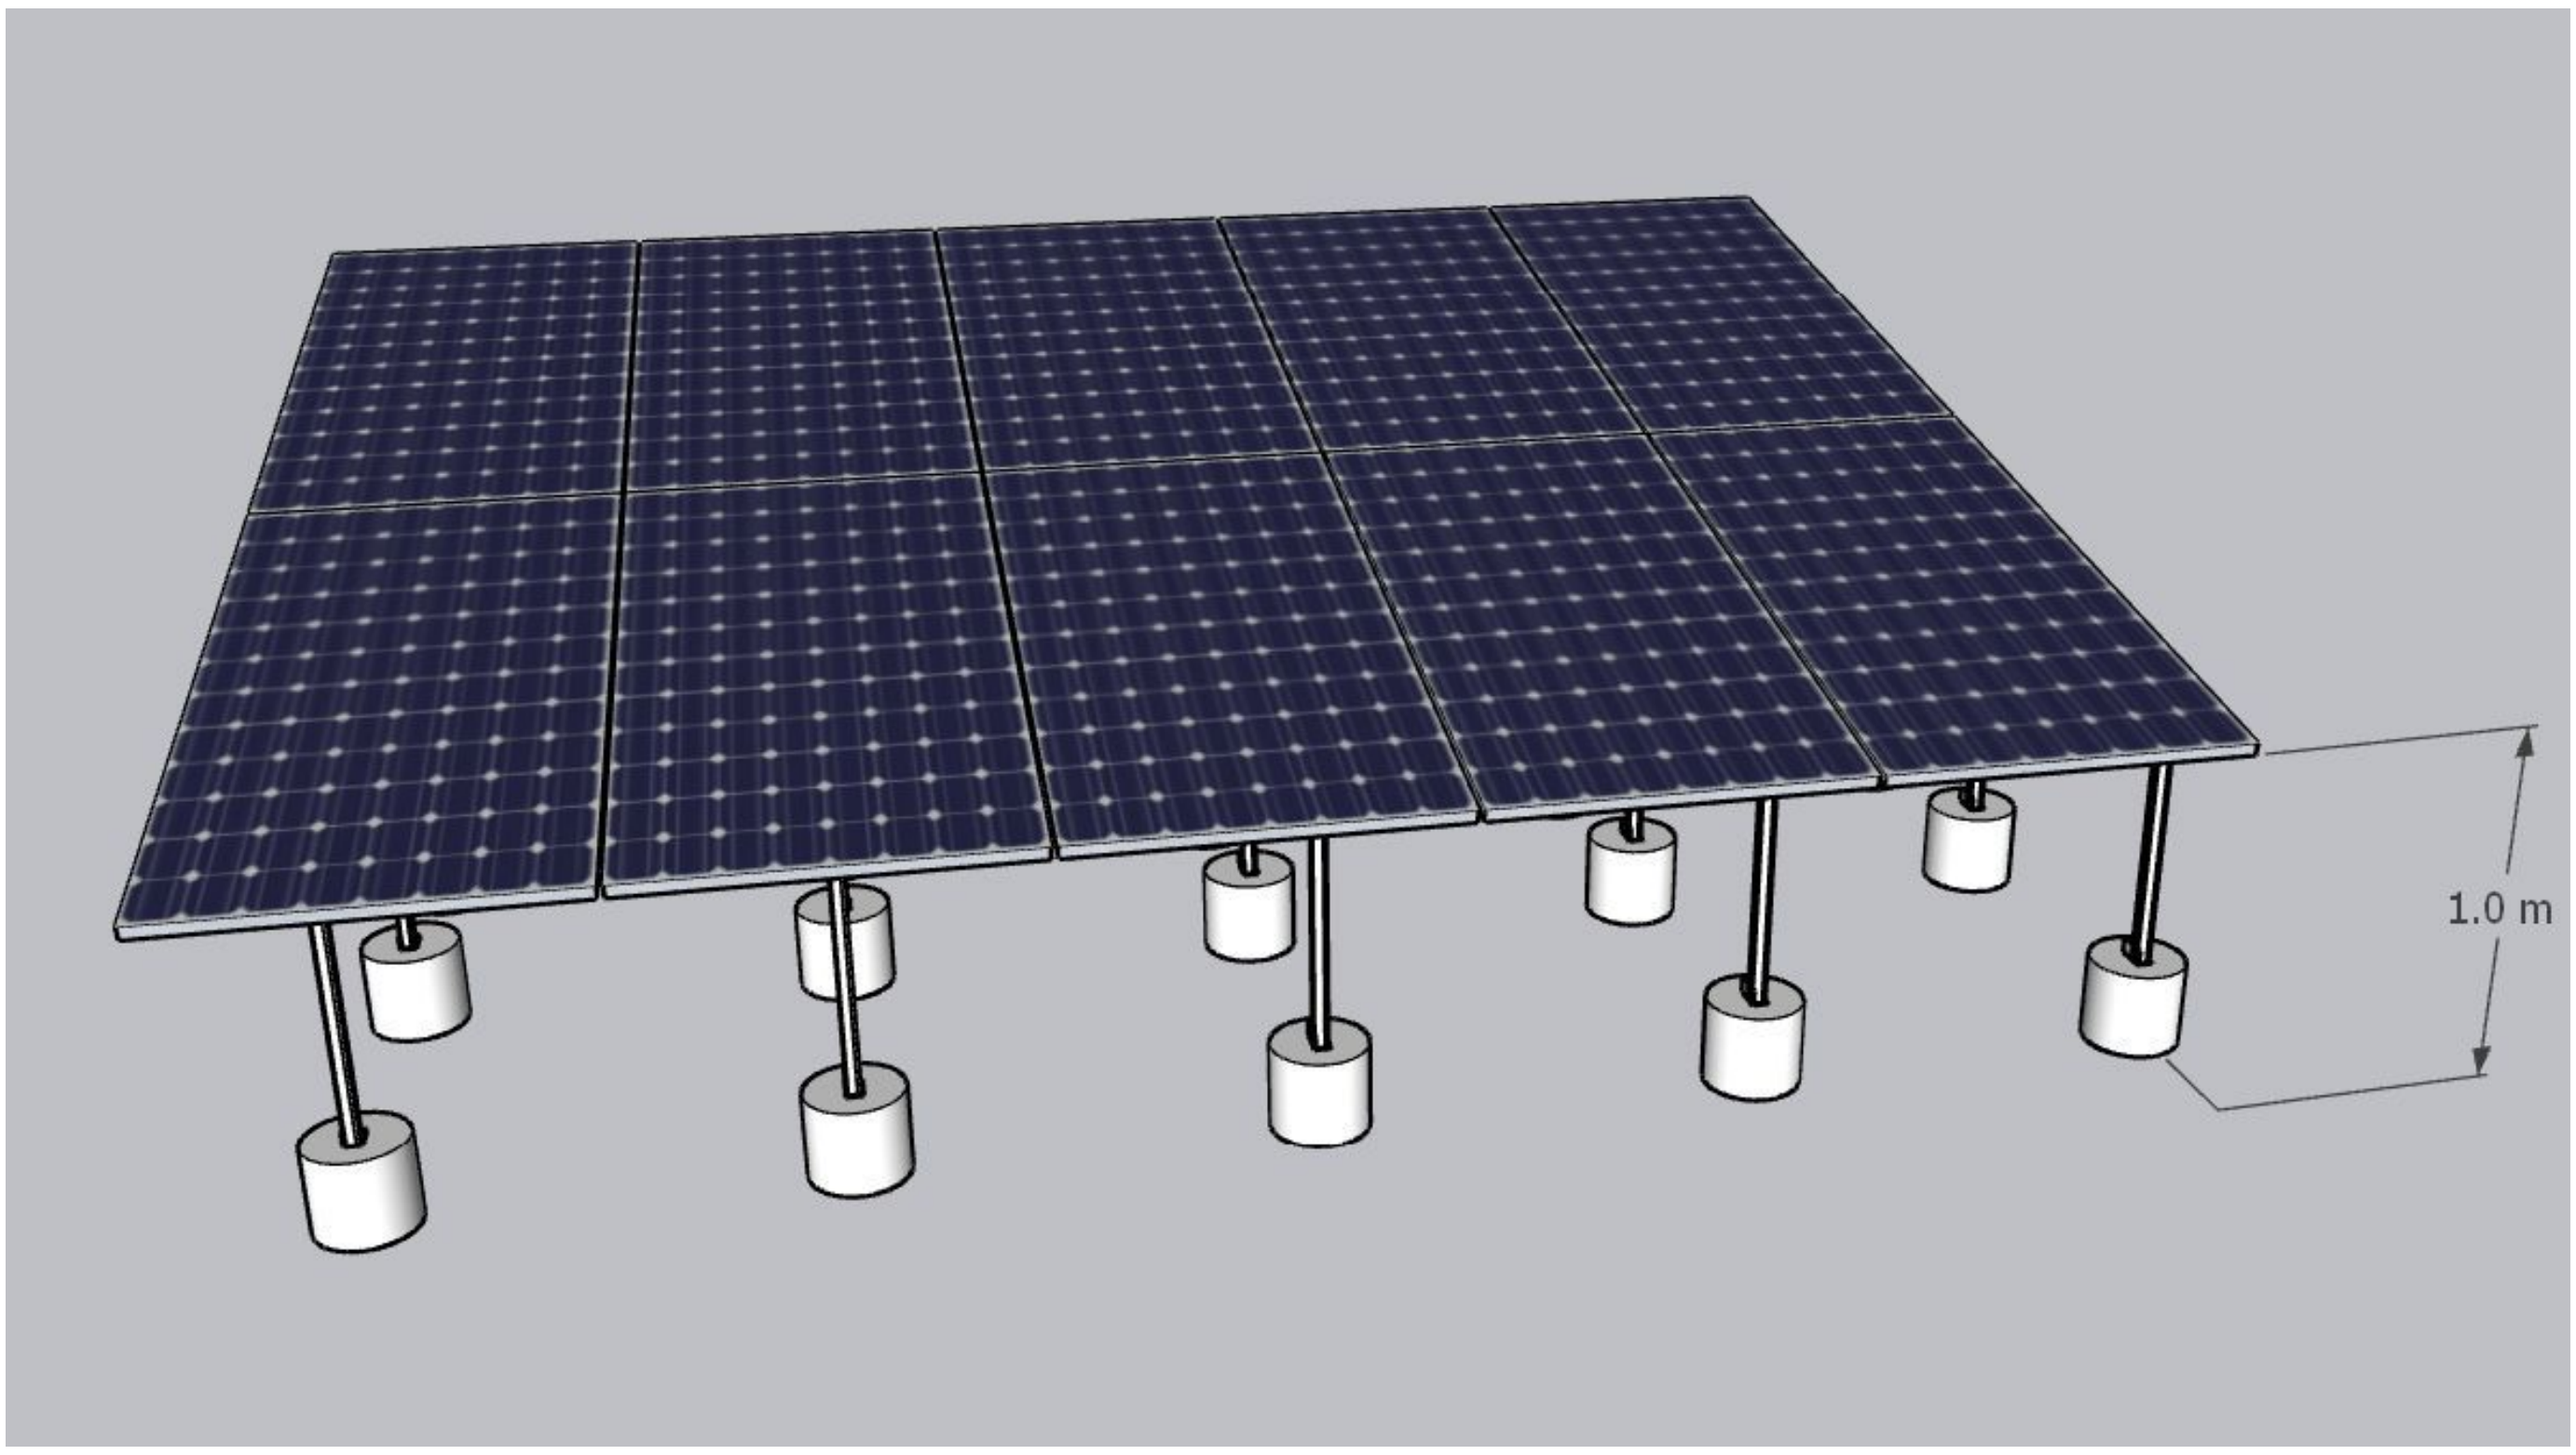

5P2 Structure - 2no.s

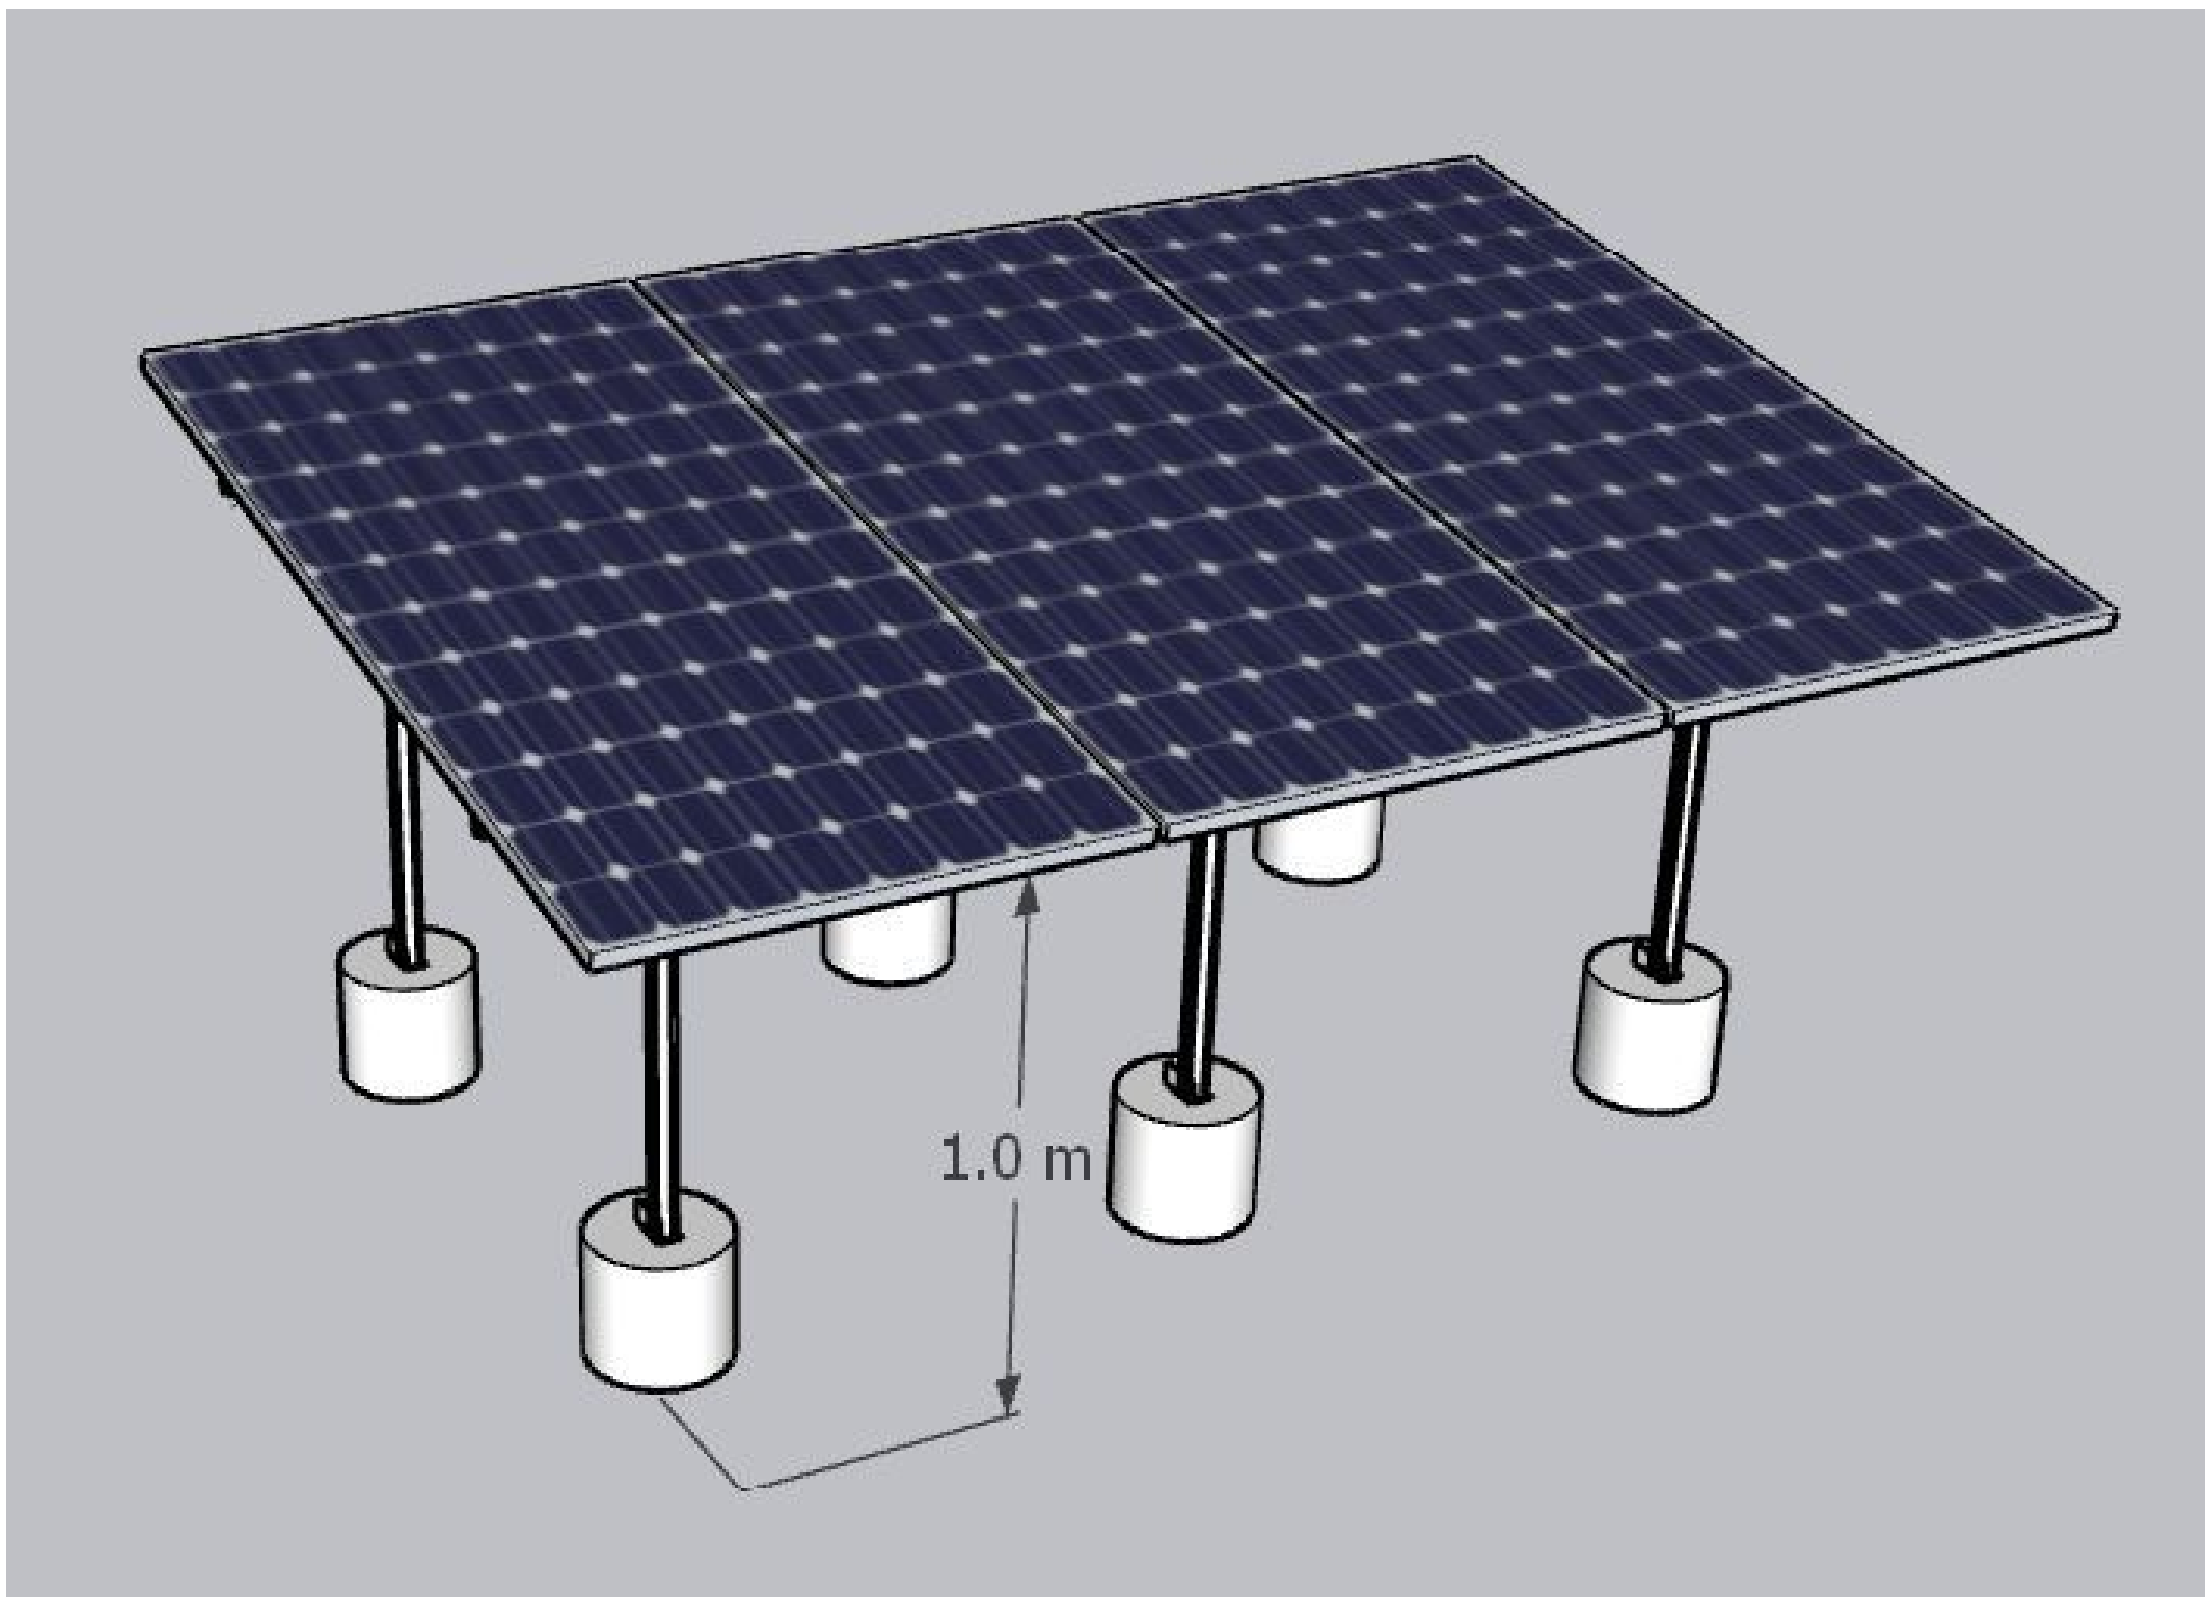

3P1 Structure - 1no.

Shadow Analysis

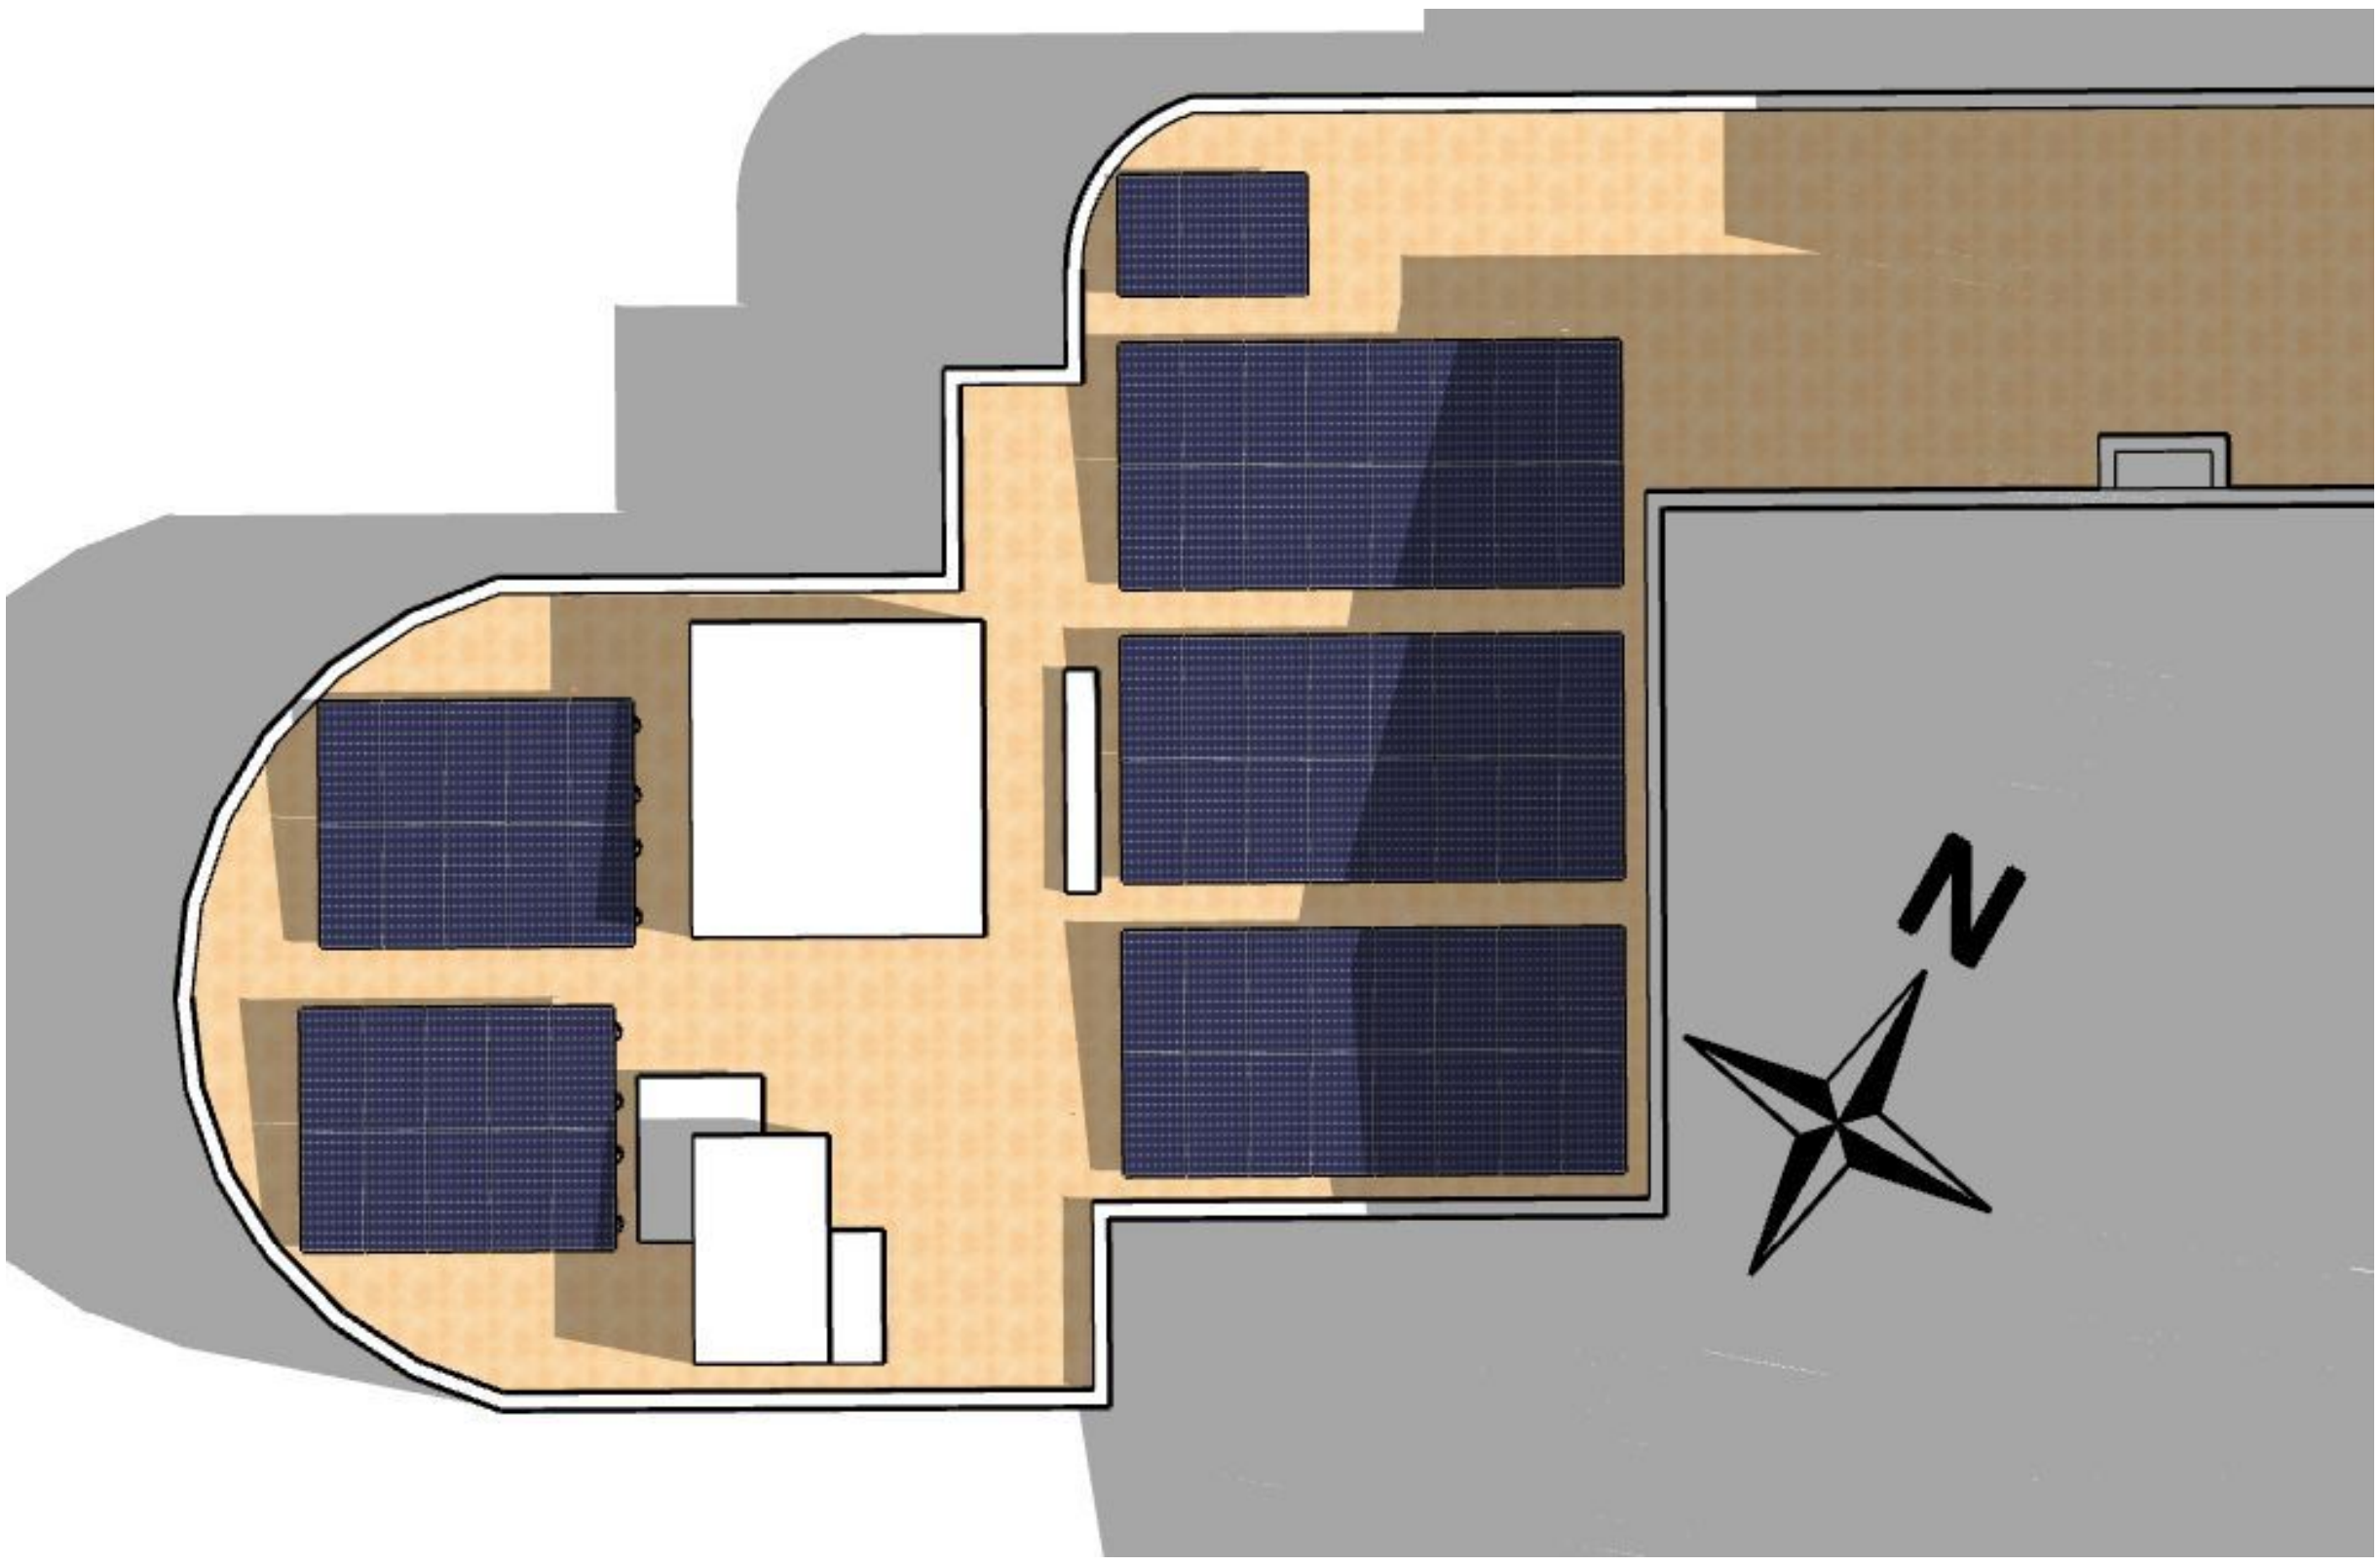

Every month 9AM to 11AM

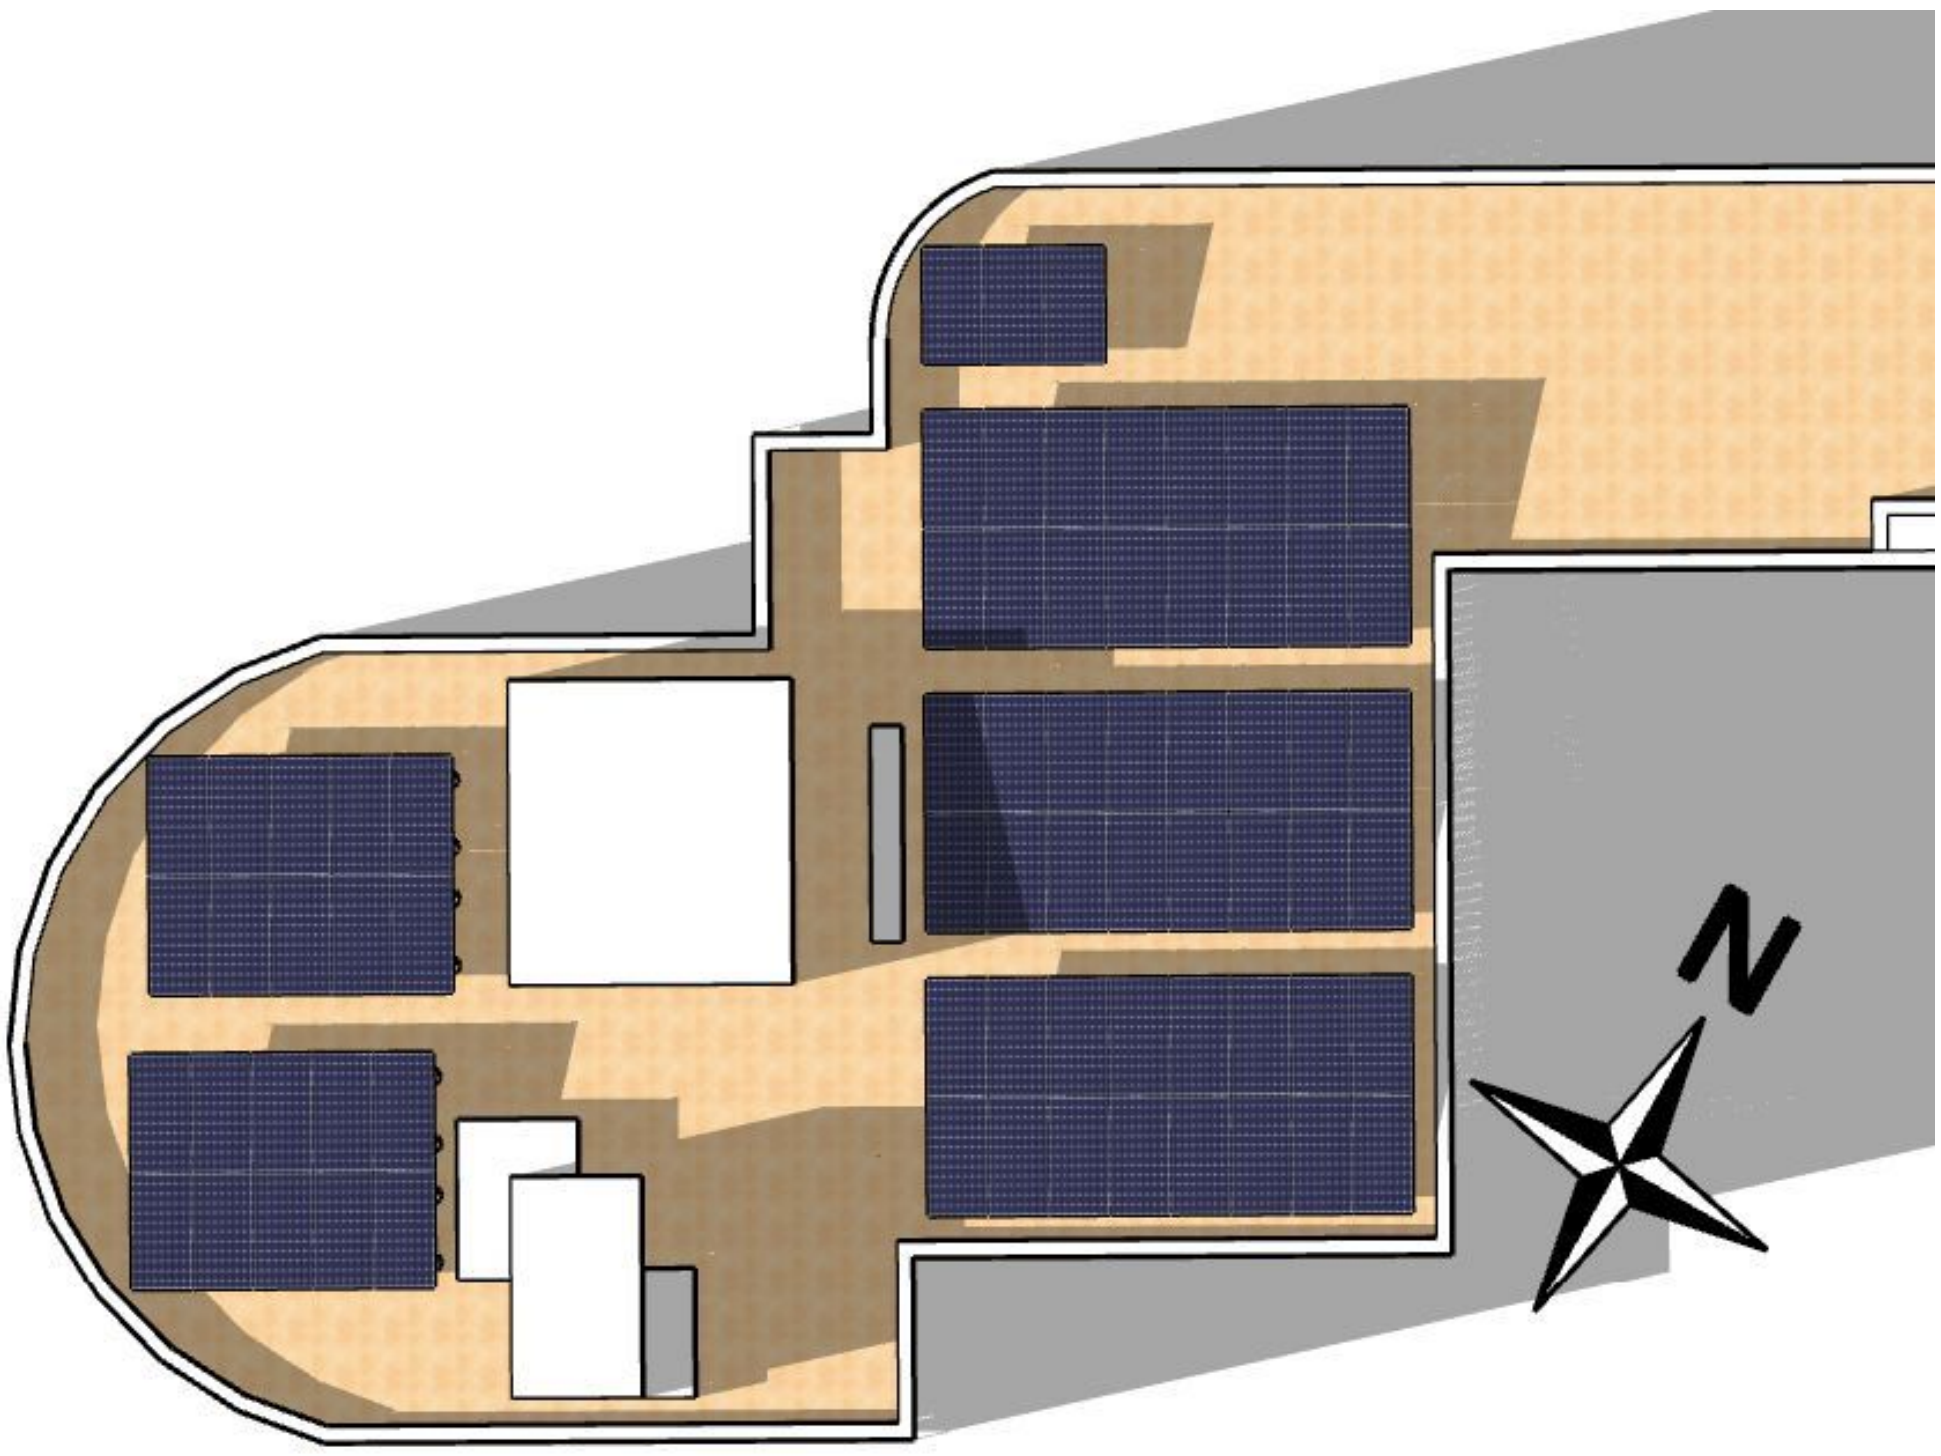

Every month after 2:30PM

Building Exterior

Material Delivery Route

This route (using side wall) will be followed to carry large items (like Panels).

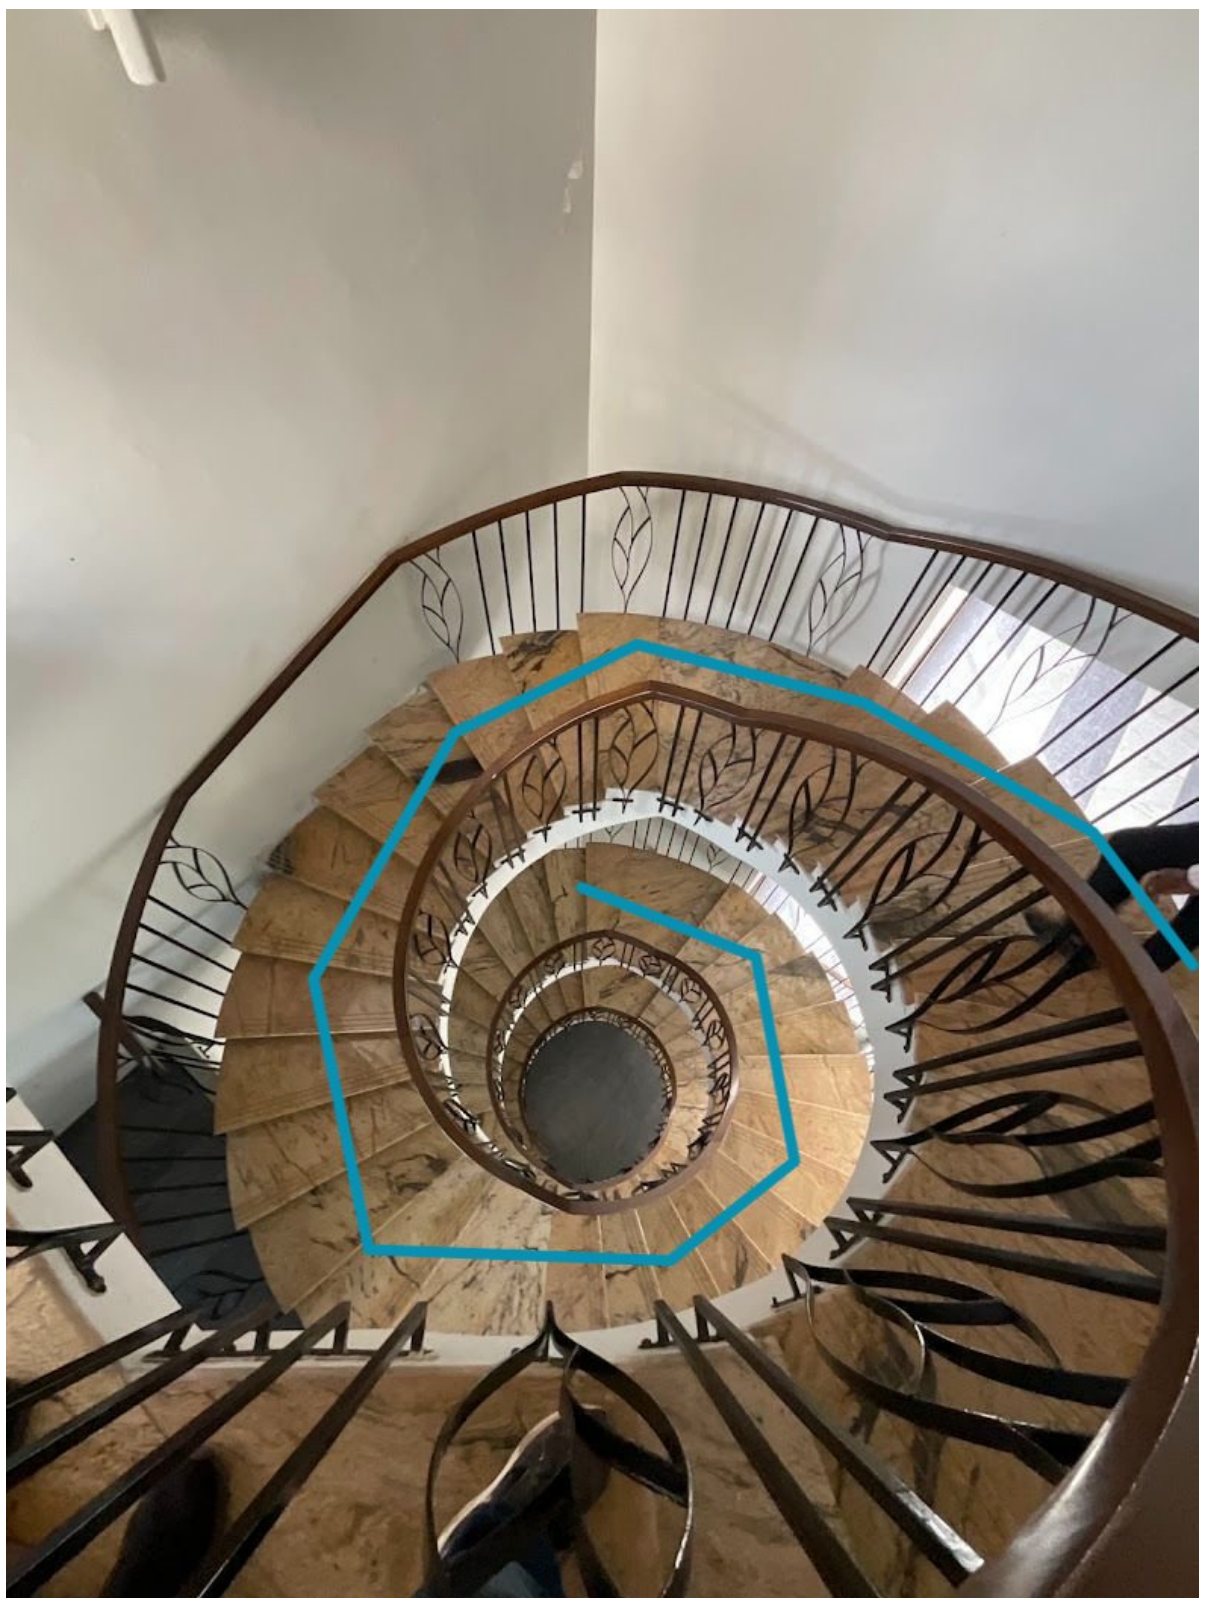

This route (using staircase) will be followed to carry small items.

Staircase Details

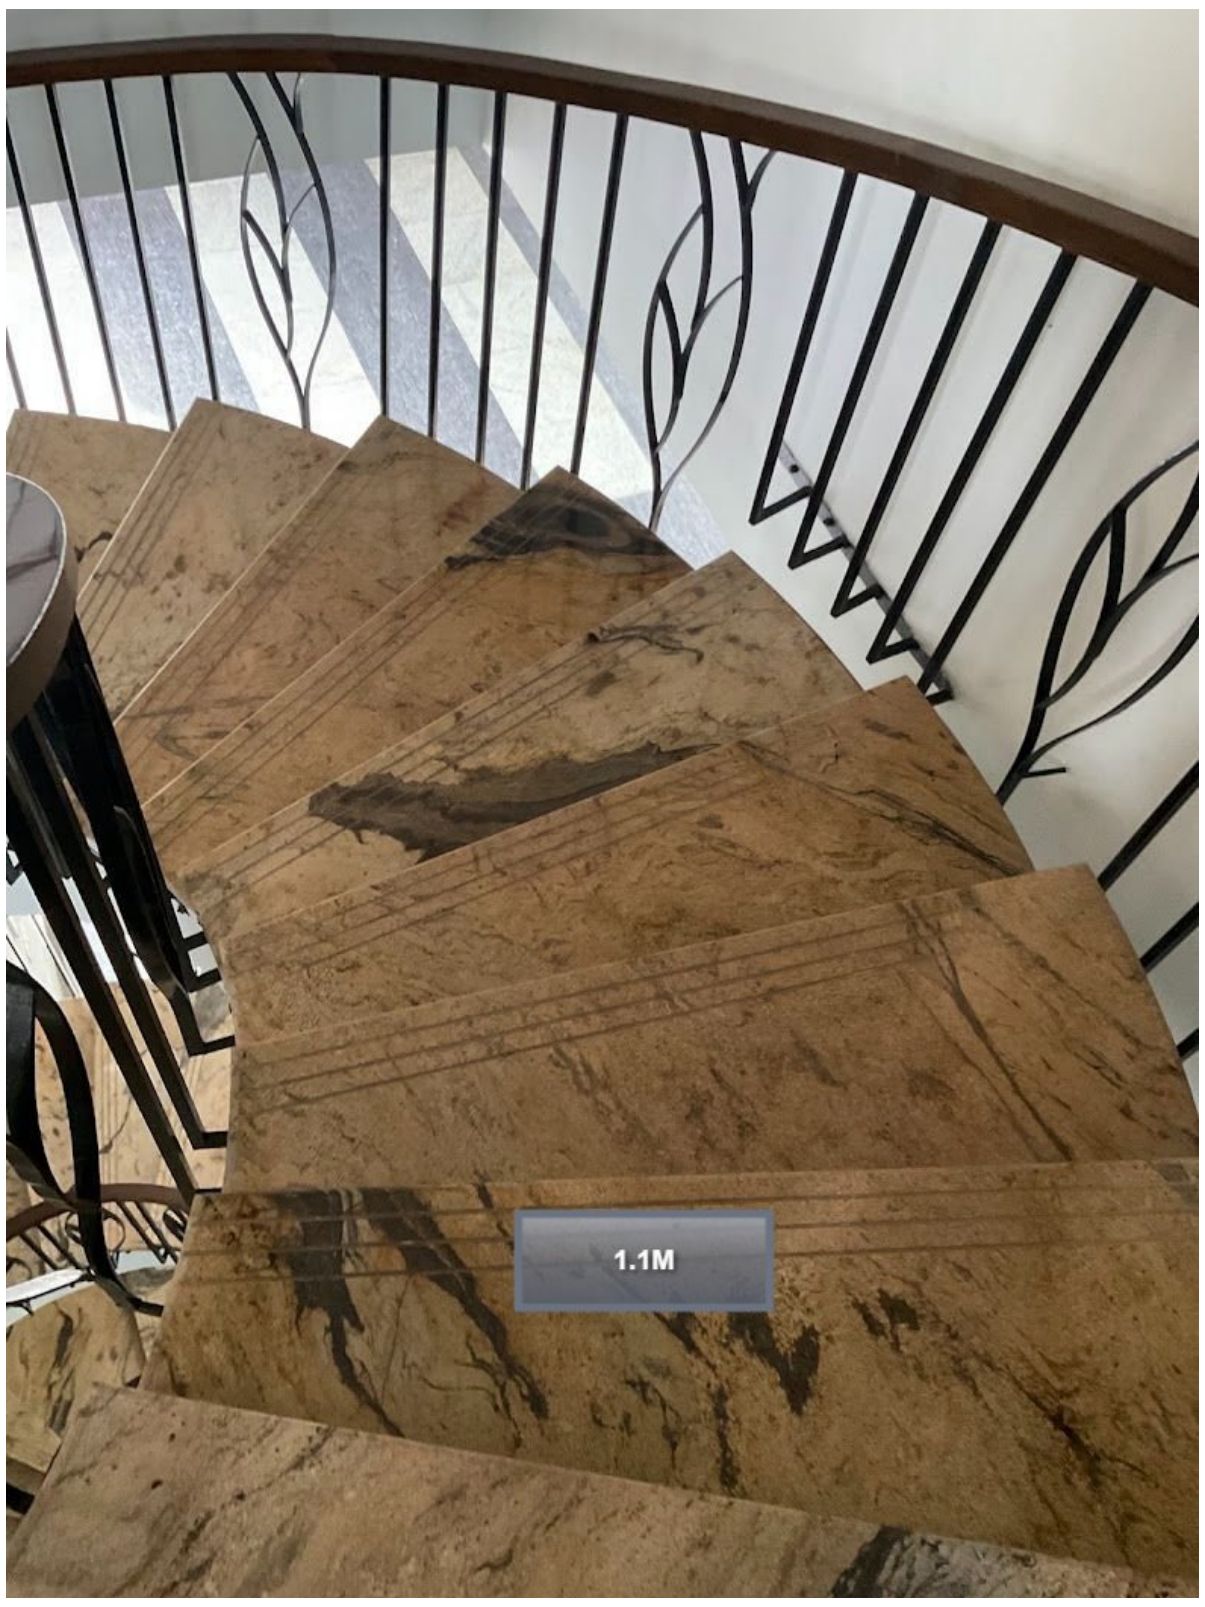

Material Storage

Proposed PV Area

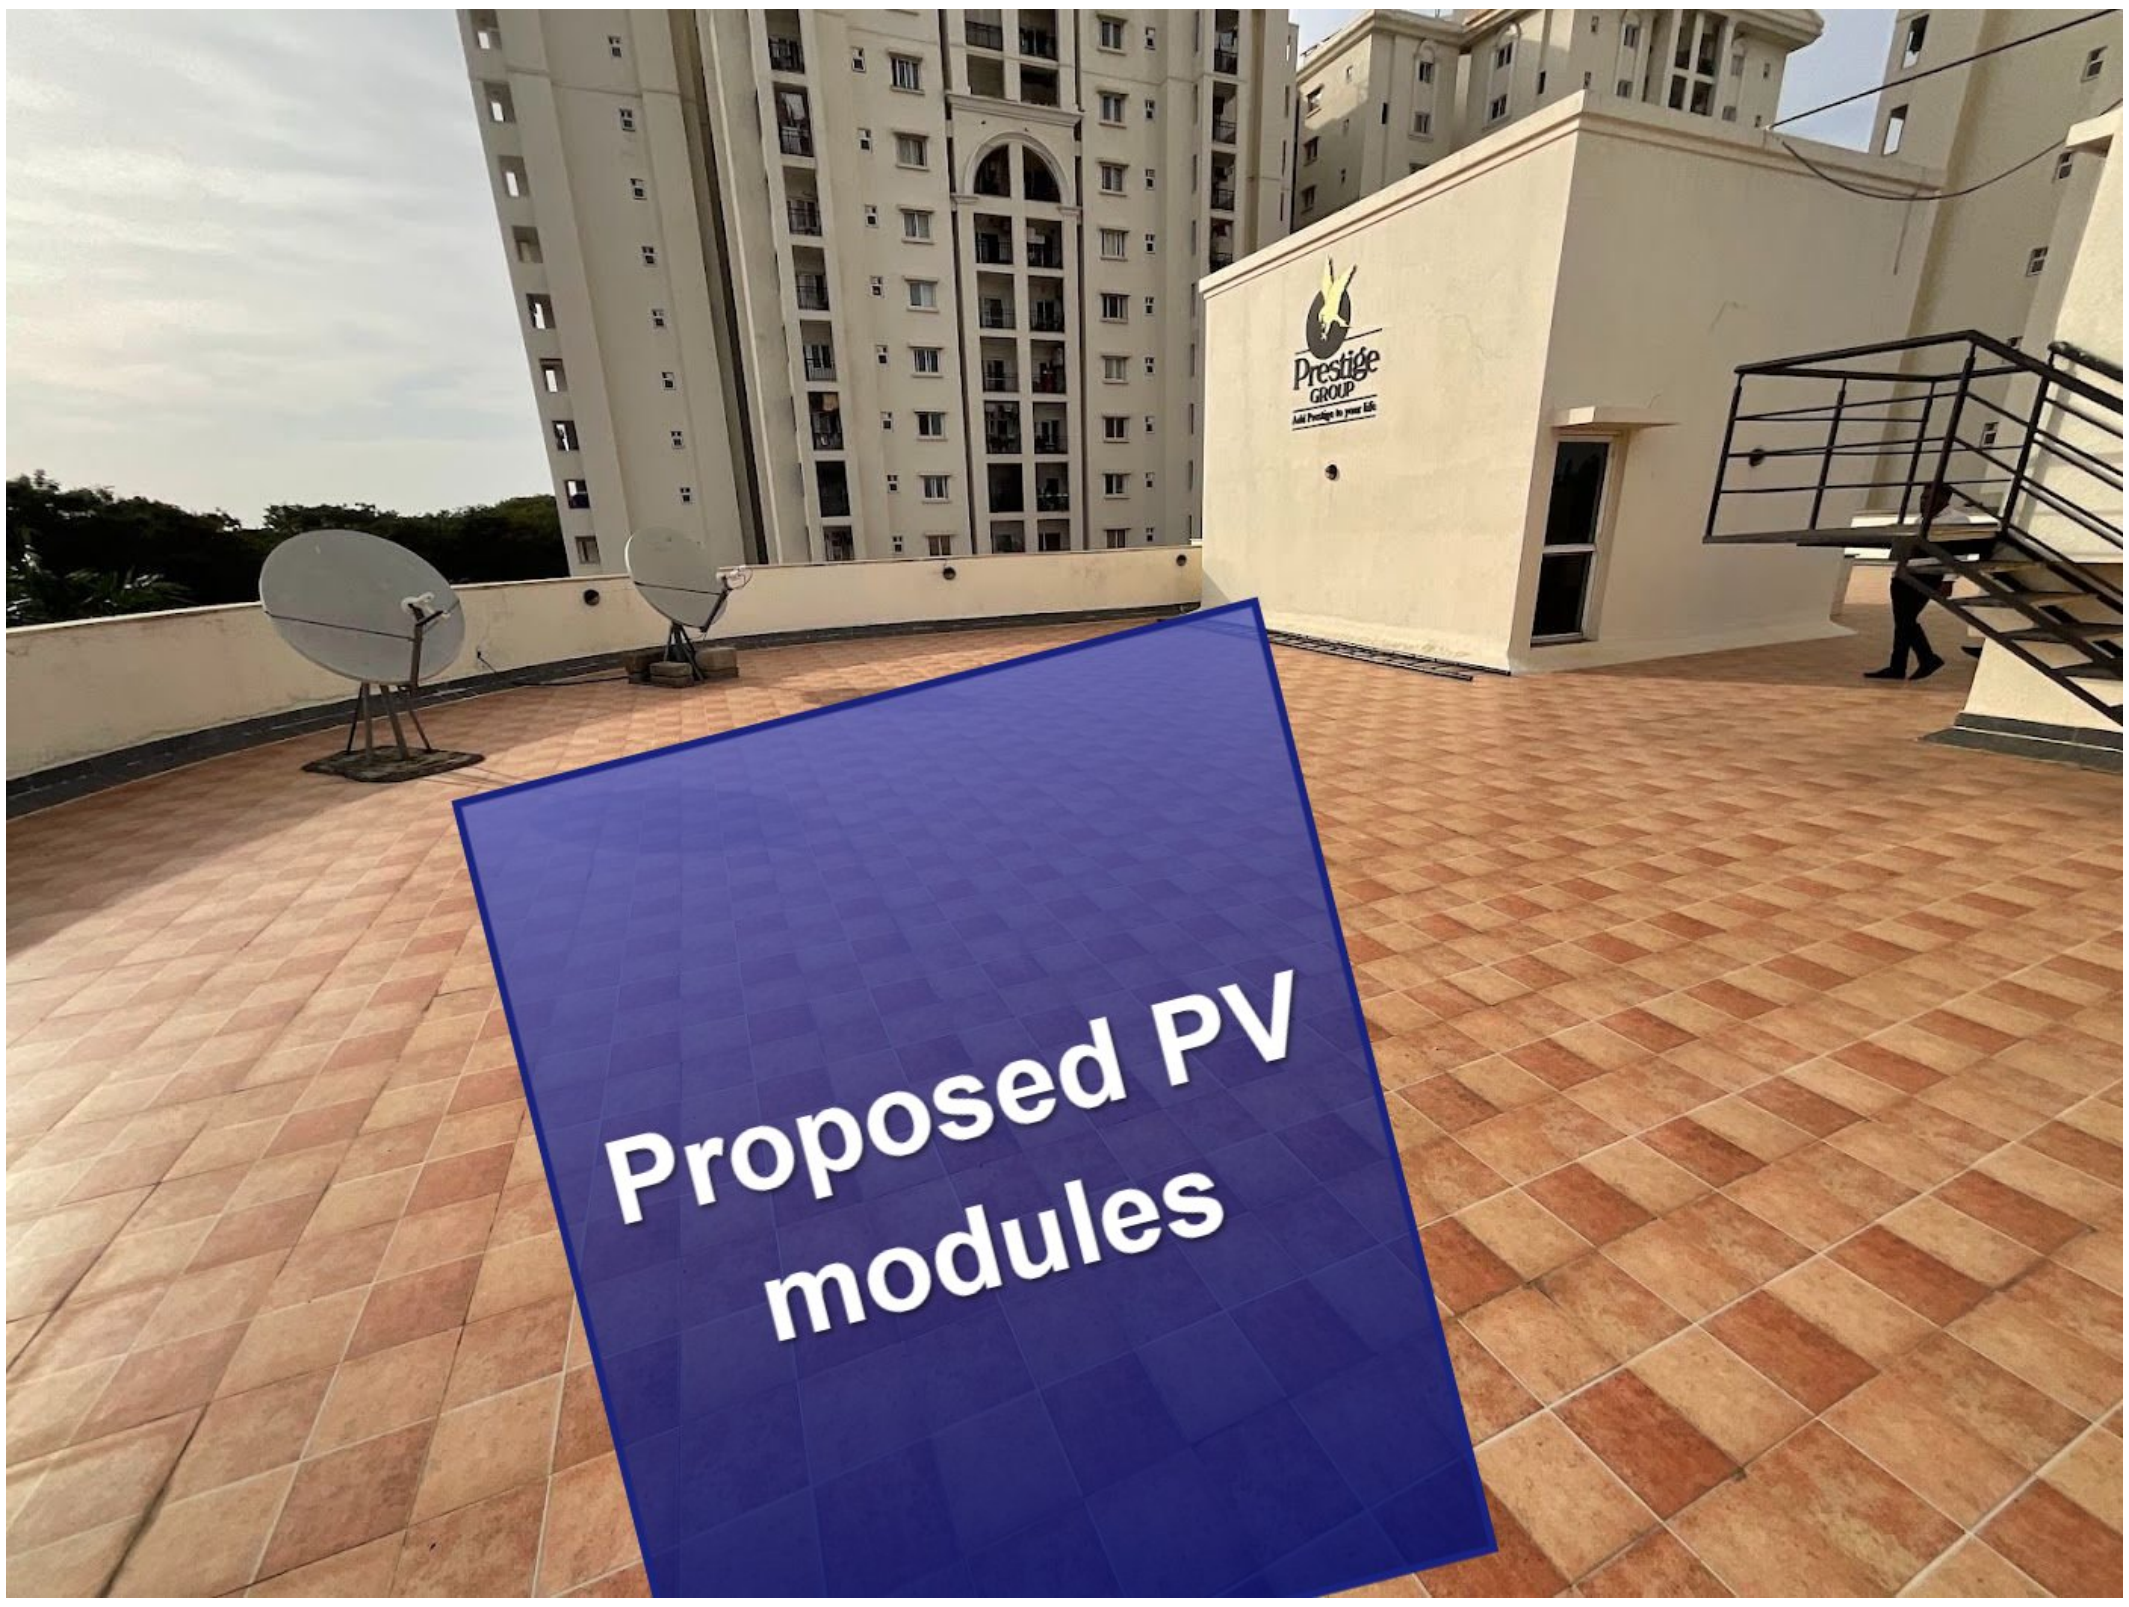

Cable Routing

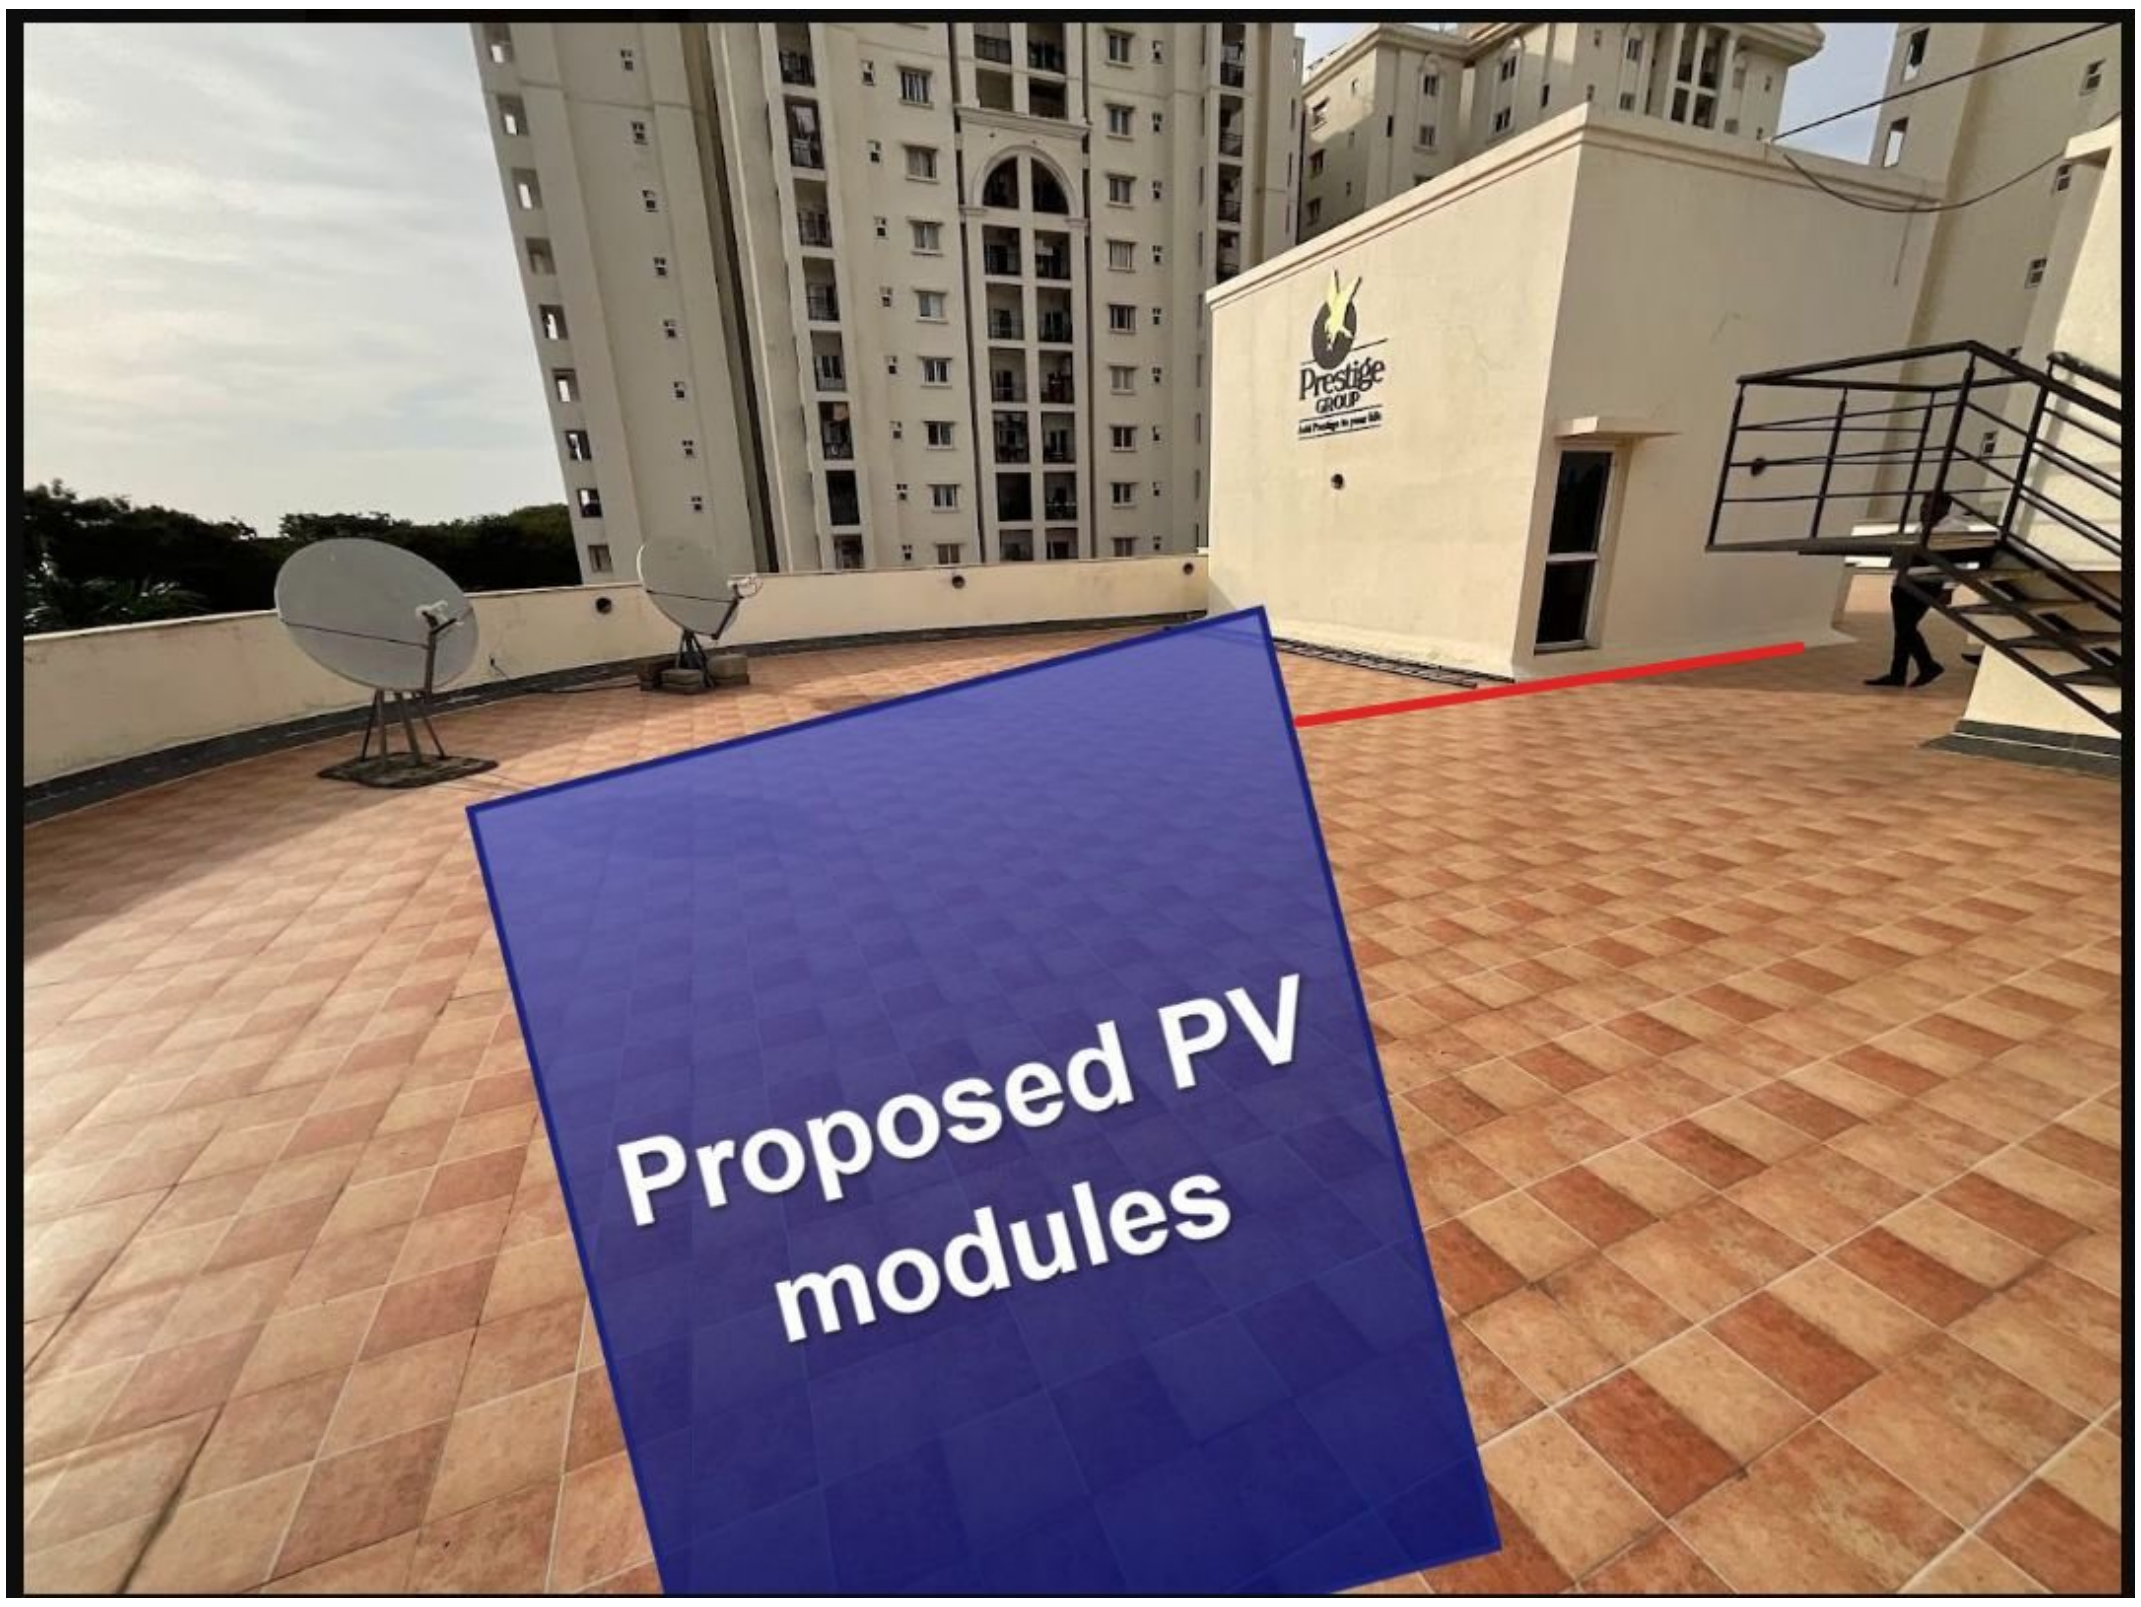
Proposed PV modules


Hole

A hole should be made to pass DC and AC cables


Hole

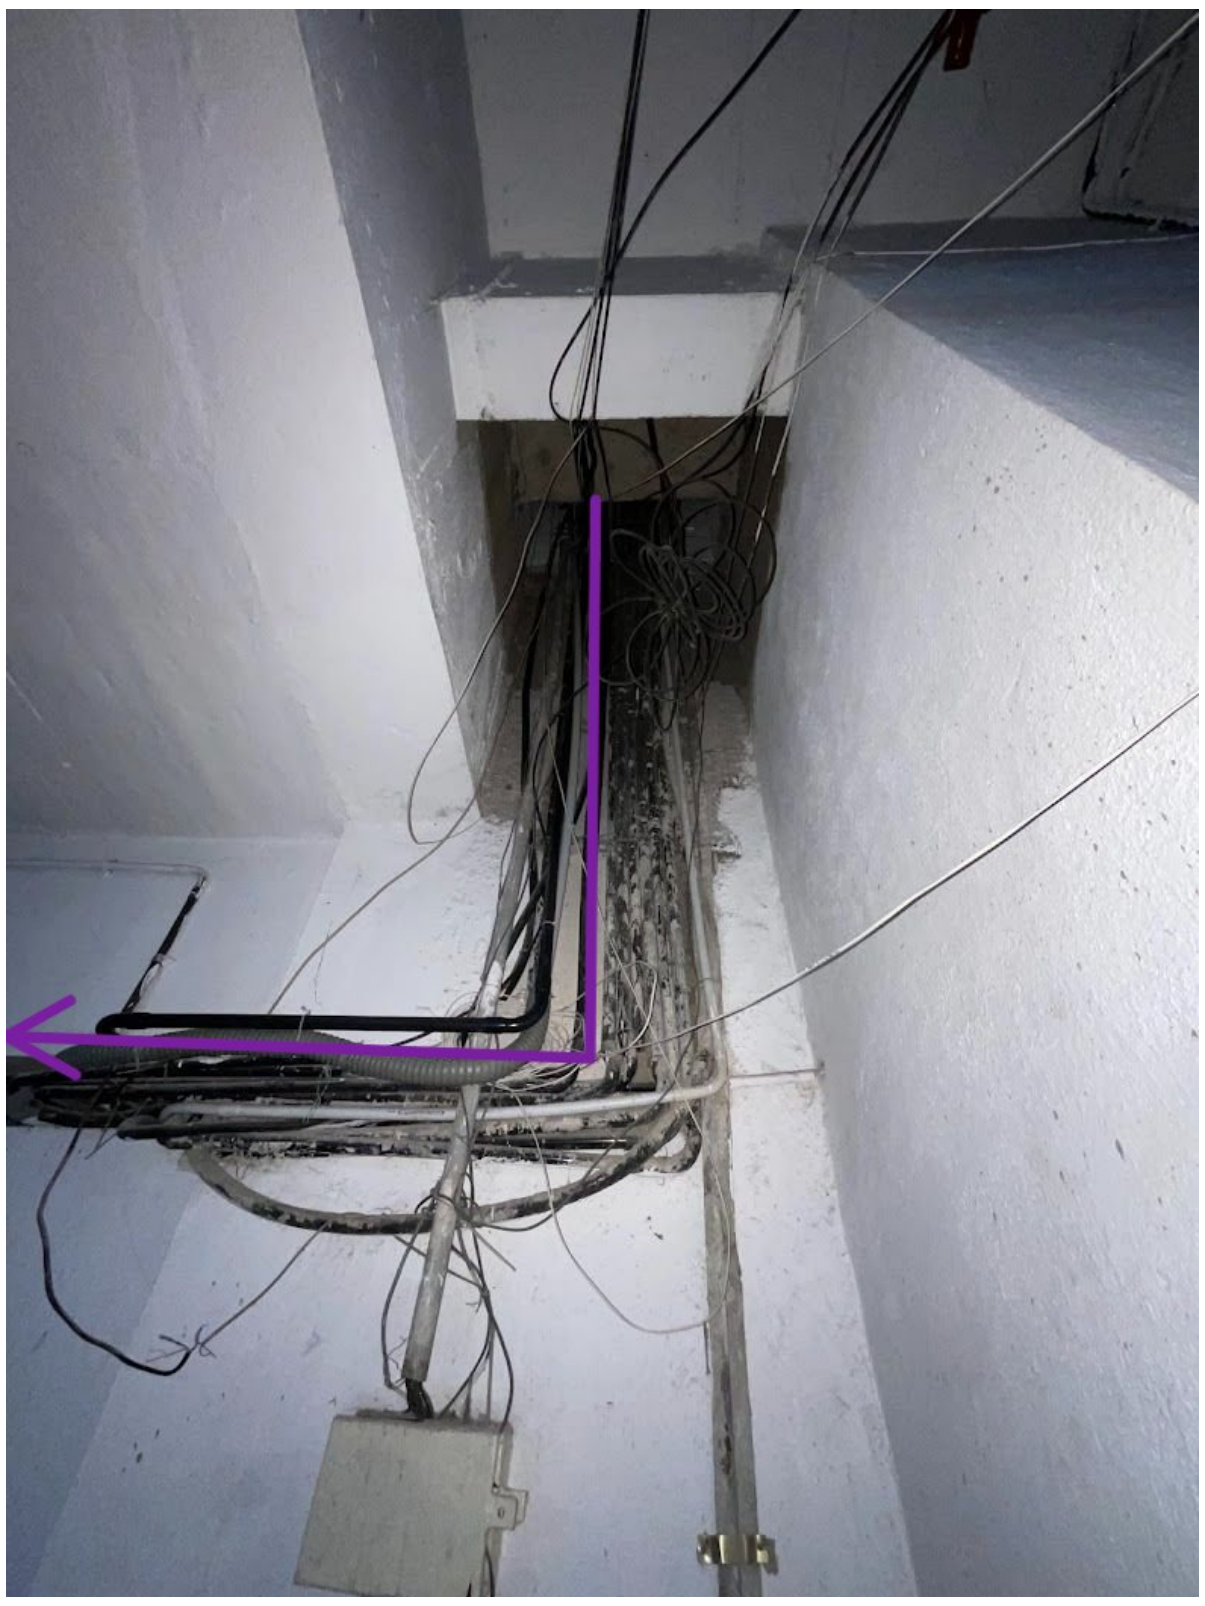


25 KVAR ACCP PANEL


25 KVA


Solar Meter
Main Meter
CABLE

Earthing Routing

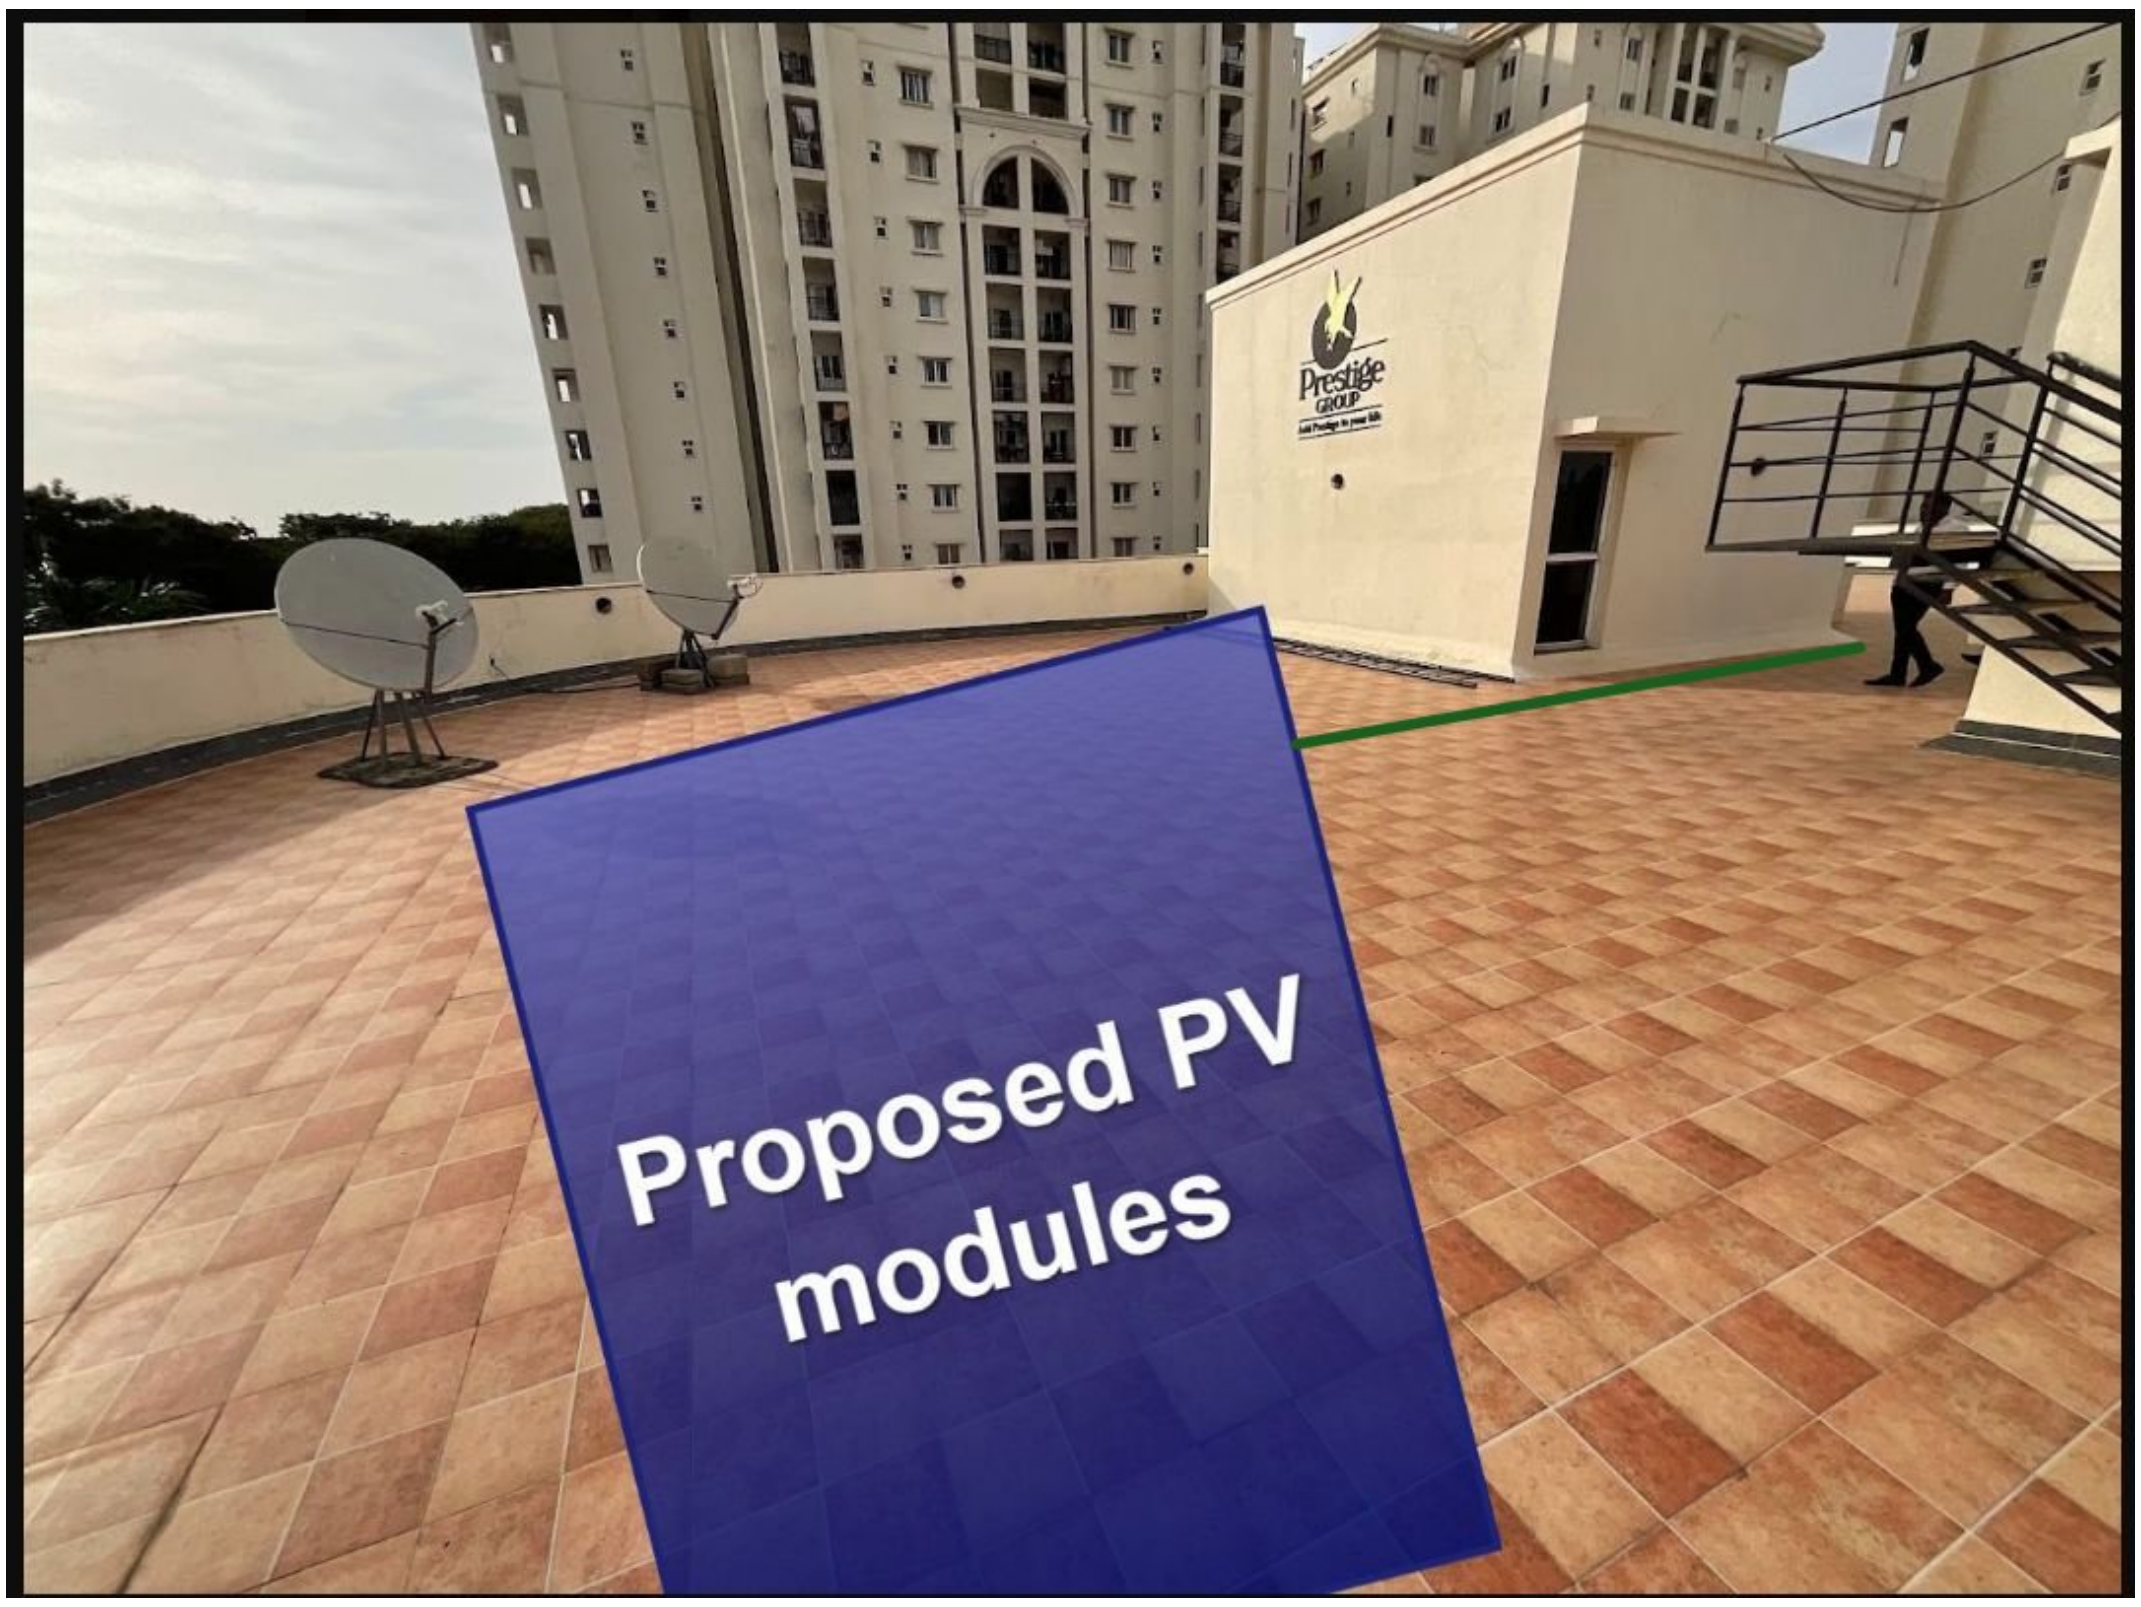
Proposed PV modules


LA
Hole

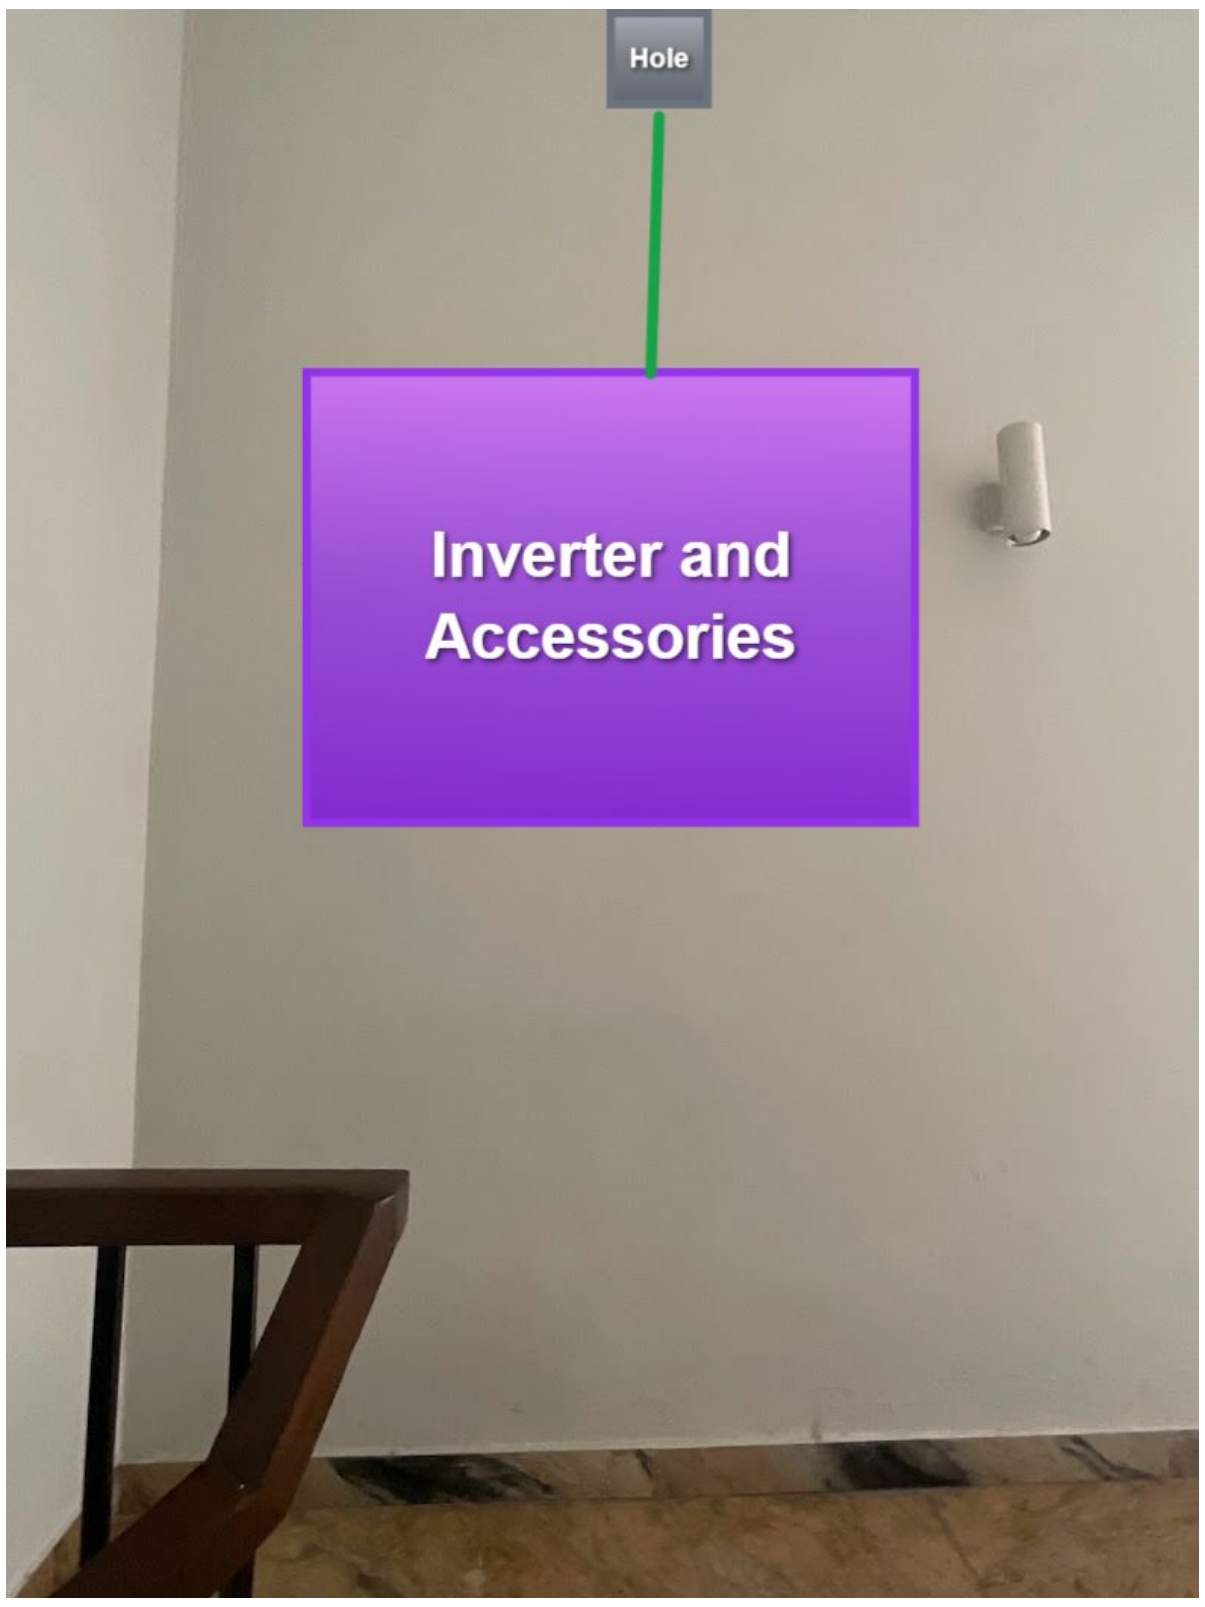

A hole should be made to pass Earthing cables


Hole
LA
PV modules


190A
3105


DC Earth Pit
AC Earth Pit
LA Pit

OBSERVATIONS & RECOMMENDATIONS

Customer Scope

#	Observation
1	Wi-Fi up to Inverter location.
2	Provide a plumbing line for module cleaning.
3	The existing ATM receiver (antenna) needs to be removed or relocated to accommodate the proposed solar panels.

THANK YOU

Dear Prestige Kensington Gardens,

Thank you for choosing EcoSoch Solar for your solar installation. We appreciate your trust in us and your commitment to sustainable energy. Our team is dedicated to ensuring a seamless installation experience and long-term performance of your solar system.

Should you have any questions or require further assistance, please do not hesitate to reach out to us.

Warm Regards,
Team EcoSoch

& Did You Know?

The Sun burns 600 million tonnes of hydrogen per second — and your panels get a share.

EcoSoch Solar Pvt. Ltd.

#940, Sha Arcade, 2nd Phase, NTI Layout, Kodigehalli, Bengaluru 560097

www.ecosoch.com | info@ecosoch.com