Technical Site Visit Report

Prepared for: Sangeeta Rupesh Pillai_Green Valley Non Subsidy_6.76kWp_IQ8P - Samahita apartments, house #202

PROJECT INFORMATION

Report Number	ESV-2026-0113
Project ID	91A1202B
Project Name	Sangeeta Rupesh Pillai_Green Valley Non Subsidy_6.76kWp_IQ8P
Building Name	Samahita apartments, house #202
Billing Name	Sangeeta Rupesh Pillai_Green Valley Non Subsidy_6.76kWp_IQ8P
Project Sector	Residential
Sales Lead	Govindaraju
Site Address	Bldg #44, Samahita apartments, house #202, 2nd cross, central excise layout, tejaswini nagar, doddakamanahalli, bannerghatta road, bangalore 560083
GPS Coordinates	12.84927858030492, 77.61192791097025
Google Maps	https://www.google.com/maps?q=12.84927858030492,77.61192791097025
Visit Date	2026-05-16
Visited By	Sai
Revision	Rev 2

CLIENT INFORMATION

Client Name	Sangeeta Rupesh Pillai
Contact	9972999220

PROJECT DETAILS

Solar Rooftop System Type	On-Grid
System Capacity (kWp)	6.77
Sanction Load (kW)	10
Module Make & Capacity	Waaree bifacial Non DCR 615 Wp

Module Length (mm)	2382
Module Width (mm)	1134
Number of Panels	11
Inverter Type	Micro
Inverter Brand	Enphase IQ8P
Number of Inverters	11
Mounting Structure Type	Elevated

SITE INSPECTION CHECKLIST

General

#	Question	Answer	Notes
1	Can the delivery van/truck reach the material unloading point?	Yes	-
2	Are there any obstacles at the site that could hinder material lifting?	**No**	-
3	Where will the Inverter, DCDB, ACDB, Battery, etc. be located?	N/A	-
4	Is a canopy required for protecting the Inverters/ACDB/DCDB?	N/A	-
5	Did you discuss the location of the earth pits with the customer?	Earth pits are located near the ground area (towards the east direction)	-
6	Where is the Internet Router located?	N/A	-
7	What's the Wi-Fi strength of the router near to the String inverter/Envoy?	N/A	-
8	Did you pin the site location in your WhatsApp when you were at the site?	Yes	-

Roof Details

#	Question	Answer	Notes
1	What type of roof is present at the site?	RCC Flat Roof	-
2	Are there any obstructions on the roof that could affect the solar installation?	details: The skylight is causing an obstruction on the roof that could affect the solar installation	-
3	What is the angle of the panels? (in degrees)	10	-
4	In case of sloped roof, what is the slope angle of the roof? (in degrees)	N/A	-
5	On how many roofs at the site are we installing solar?	0	-
6	If it is a Tiled roof, what is underneath the tiles?	N/A	-

#	Question	Answer	Notes
7	If it is a Tiled roof with MS or Wooden rafters, is it Single-tiled or Double-tiled?	N/A	-
8	What type of mounting structure is planned?	Elevated	*MS fabrication structure planned for this project.*
9	What is the orientation of the solar panels?	["South"]	-
10	How can the roof be accessed?	Ladder	*Building is under construction.*
11	Is the building currently under construction?	Yes	-
12	In an under-construction building, are existing conduit pipes available for AC, DC cables, and earthing?	**No**	-
13	What is the height of the building and how many floors does it have?	Height of the building is 13m; it has G+2+Headroom	-
14	Is the site photo matching with the building description?	Yes	-
15	Is there an overhead HT line passing within a 10-meter radius of the site?	**No**	-

Residential / Electrical

#	Question	Answer	Notes
1	What type of energy meter is currently installed?	-	*Building is under construction.*
2	Is the Meter cubicle photo matching with the previous answer?	**No**	*Building is under construction.*
3	Has the termination point in the Main meter panel been identified?	**No**	*Building is under construction.*
4	Is the Termination Point easily visible or sealed?	-	*Building is under construction.*
5	Is a Lightning Arrestor (LA) already available at the site?	**No**	-
6	Is space available for CT within Energy meter panel?	N/A	-
7	In case of an Enphase system, is the distance between the farthest micro-inverter and IQ Gateway > 50m?	Less than 50m	-
8	Provide details of the existing CT ratings (if applicable).	N/A	-
9	In Main meter panel, is empty space available for solar meter?	**No**	*Building is under construction.*
10	In Main meter panel, is empty space available to house the Enphase accessories or ACDB components?	**No**	*Building is under construction.*
11	Is there space available to dig DC, AC and LA earth pits?	Yes	-
12	In case of elevated structures, is an LA extension provided at the far end?	**No**	-
13	In case of elevated structures, is it with or without grouting?	N/A	-
14	Are there any challenges with respect to Installation and Maintenance activities?	**No**	-
15	Are there any safety risks associated with accessing the roof for installation?	**No**	-
16	Is space present in rooftop to store the panels?	Horizontally sleeping	-
17	In case of sloped roof MS structure, provide the dimension of rafter to rafter, purlin to purlin.	N/A	-

#	Question	Answer	Notes
18	Is ventilation available in the battery location?	N/A	-
19	Should the Inverters/ACDB/DCDB be installed on a metal grill or wall mount?	N/A	-
20	Provide the dimensions for solar meter cubicle placement (L x W of wall).	length: 1000, width: 1000	*Building is under construction.*
21	Provide the dimension for earth pits location (L x W of available space).	length: 1000, width: 1000	*Building is under construction.*
22	Is LAN cable under customer scope?	**No**	-
23	Is there any shadow that affects the solar installation?	**No**	-
24	Is there any trench work to be done to carry the AC cable to the meter location?	**No**	-

PHOTO DOCUMENTATION

Cable Routing Legend

Legend	Description
	Proposed PV Module Array
	Main Meter Location
	Solar Meter
	Battery
	Inverter
	Other Equipment
	DC Cable
	AC Cable
	Material Shifting
	DC Earthing Cable
	AC Earthing Cable
	LA Cable
	DC Earth Pit
	AC Earth Pit
	LA Pit
	LA

Building Exterior

Material Delivery Route

This route will carry the small items

This route will carry the Large items (like panels) items

Staircase Details

Meter Box

Material Storage

Site Layout - Top View

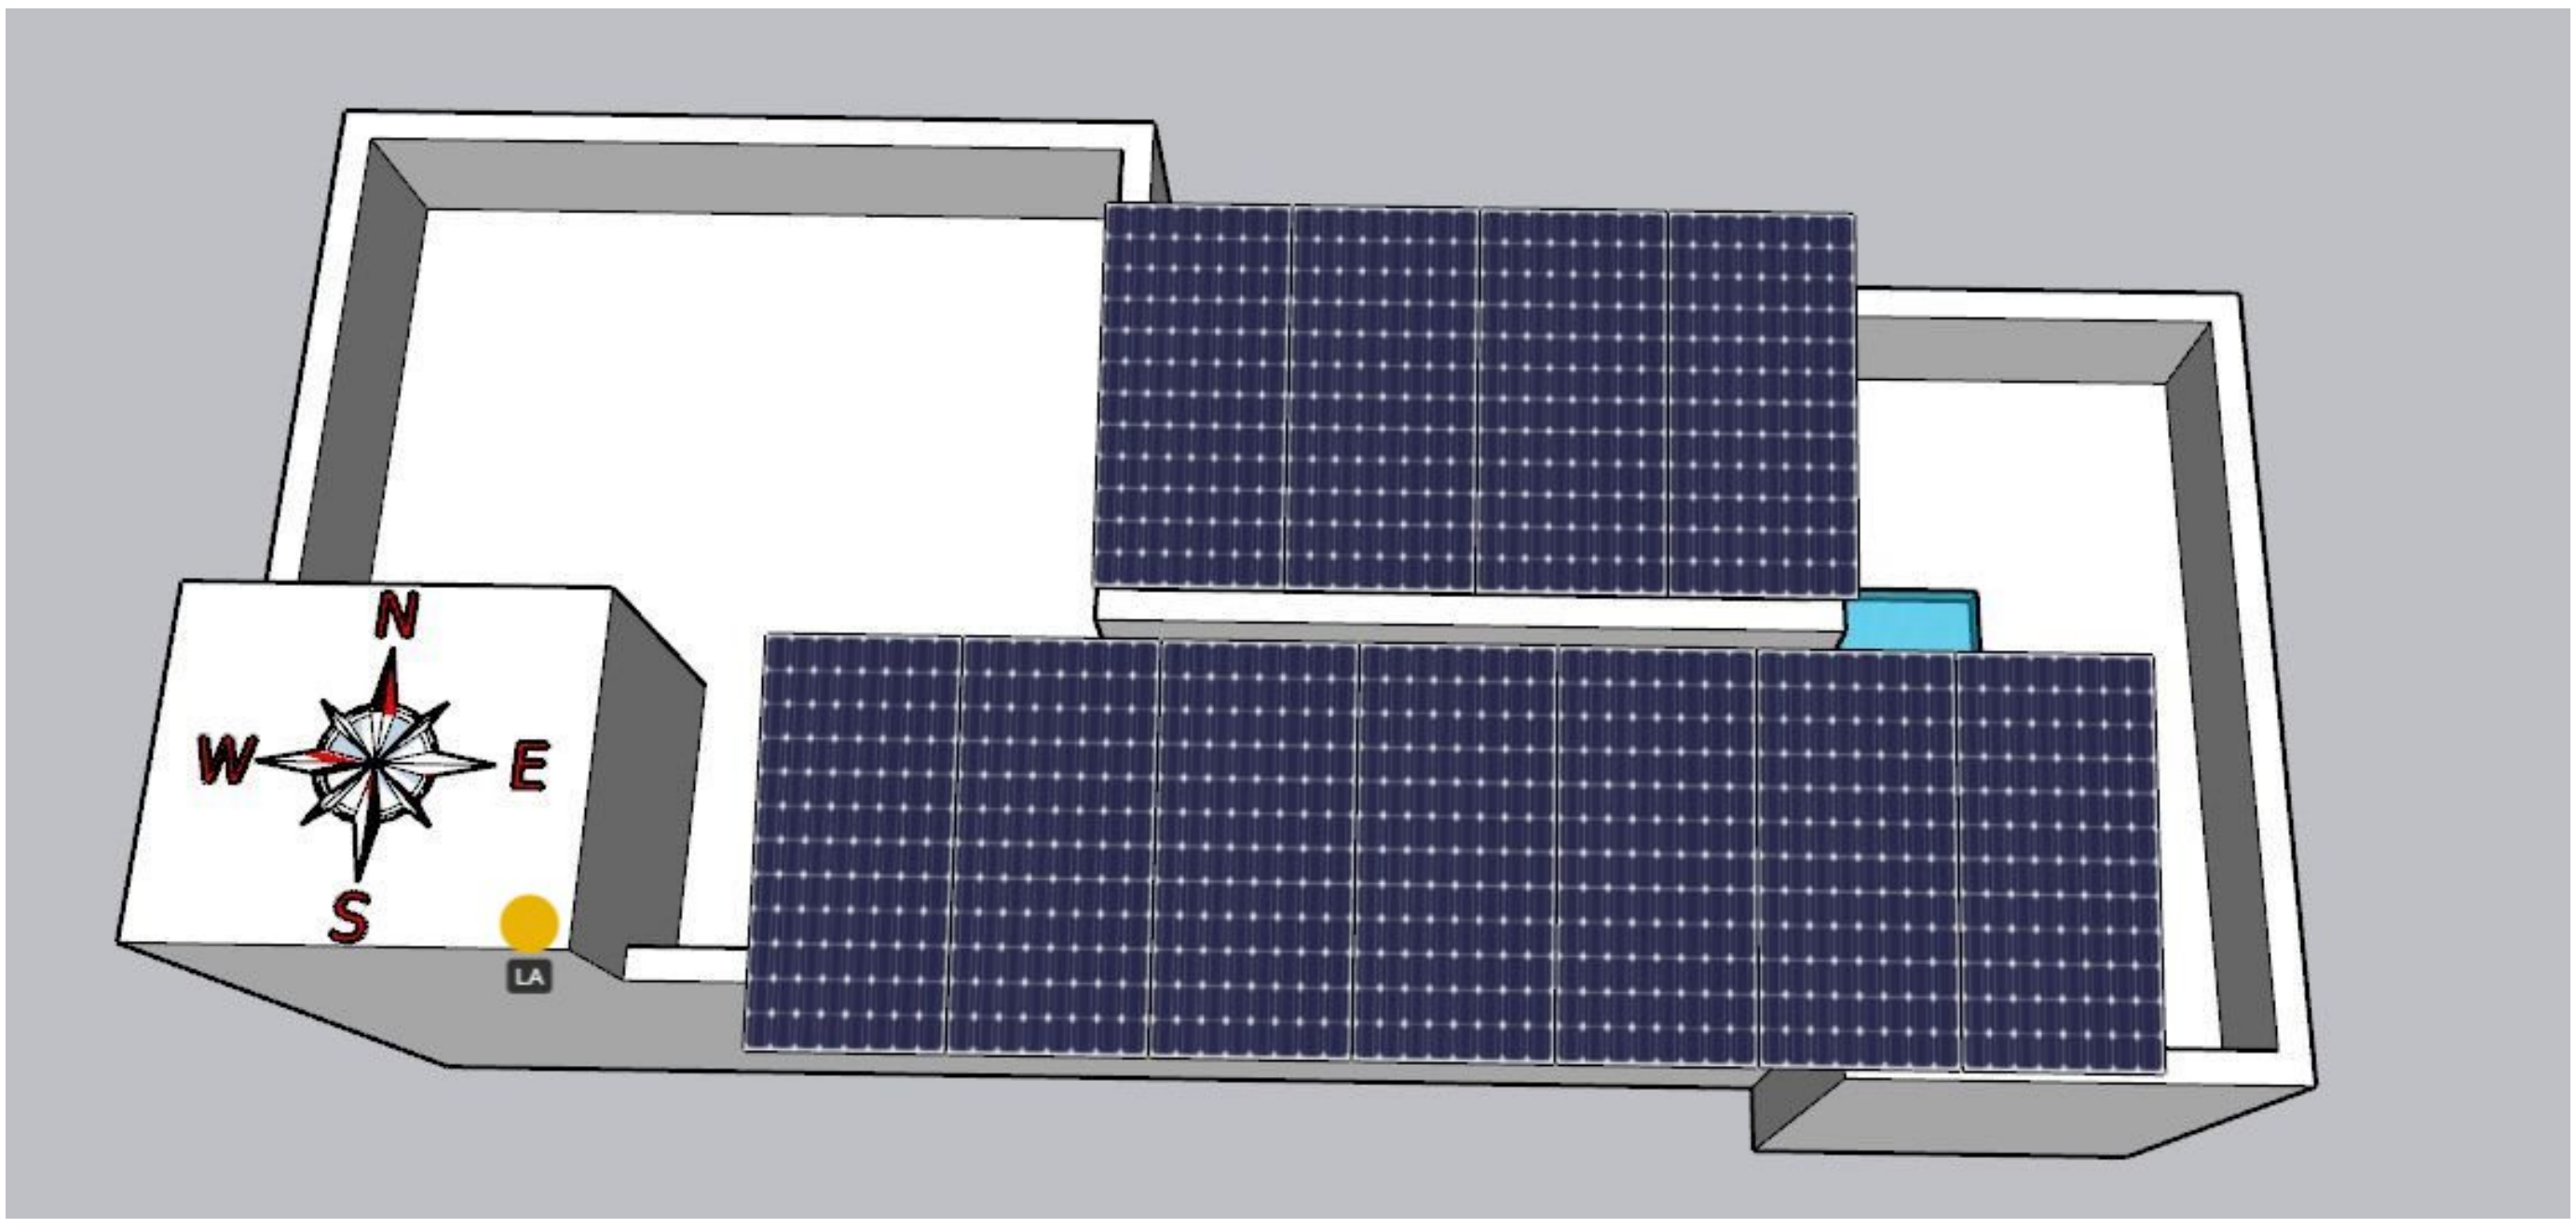

Top view

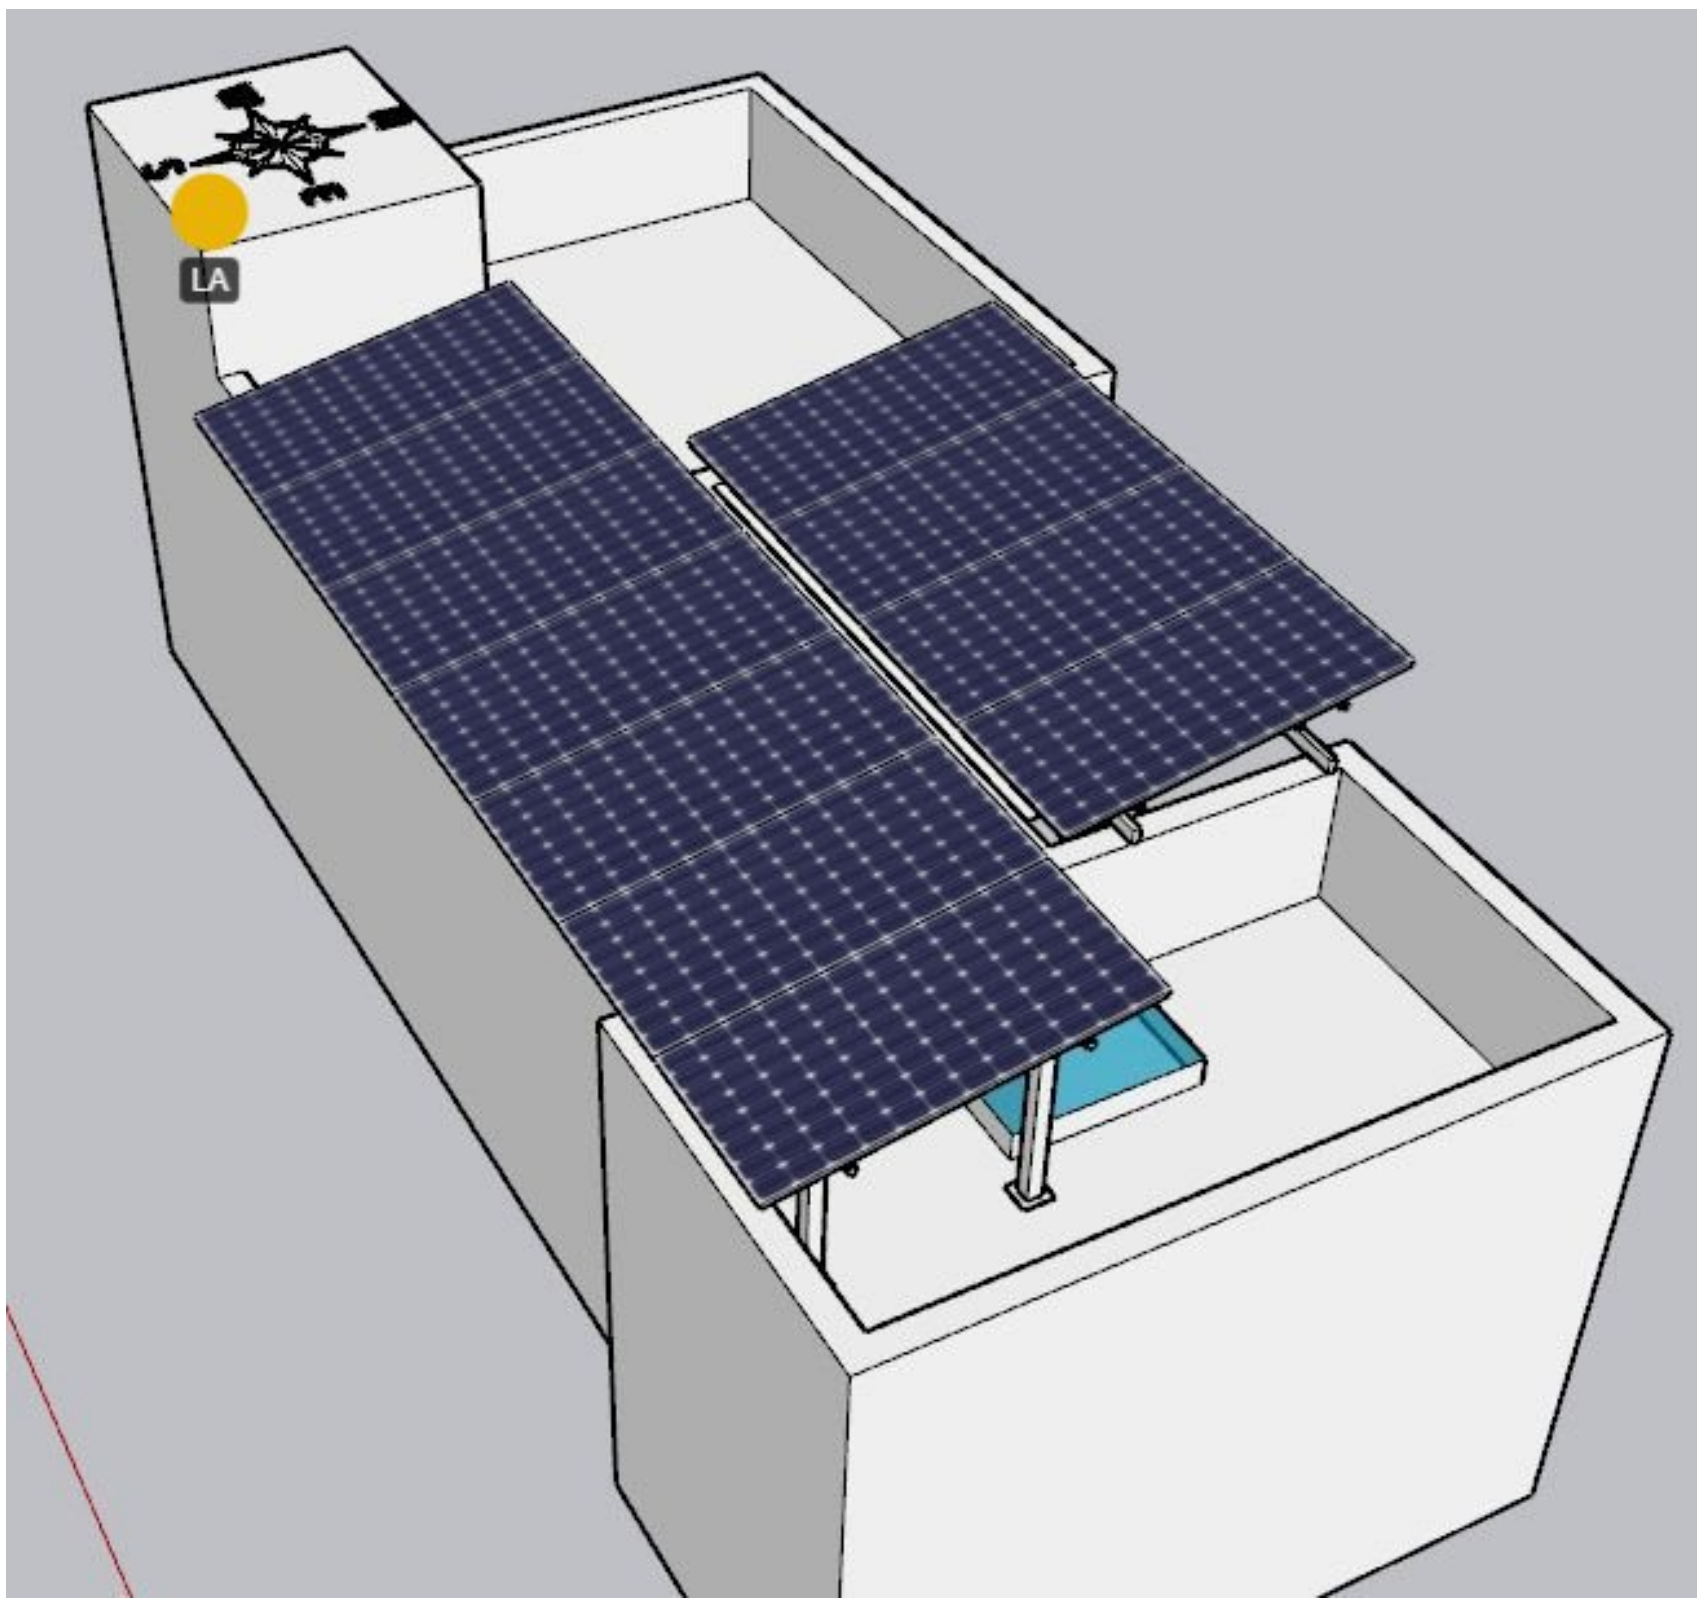

Side view (1)

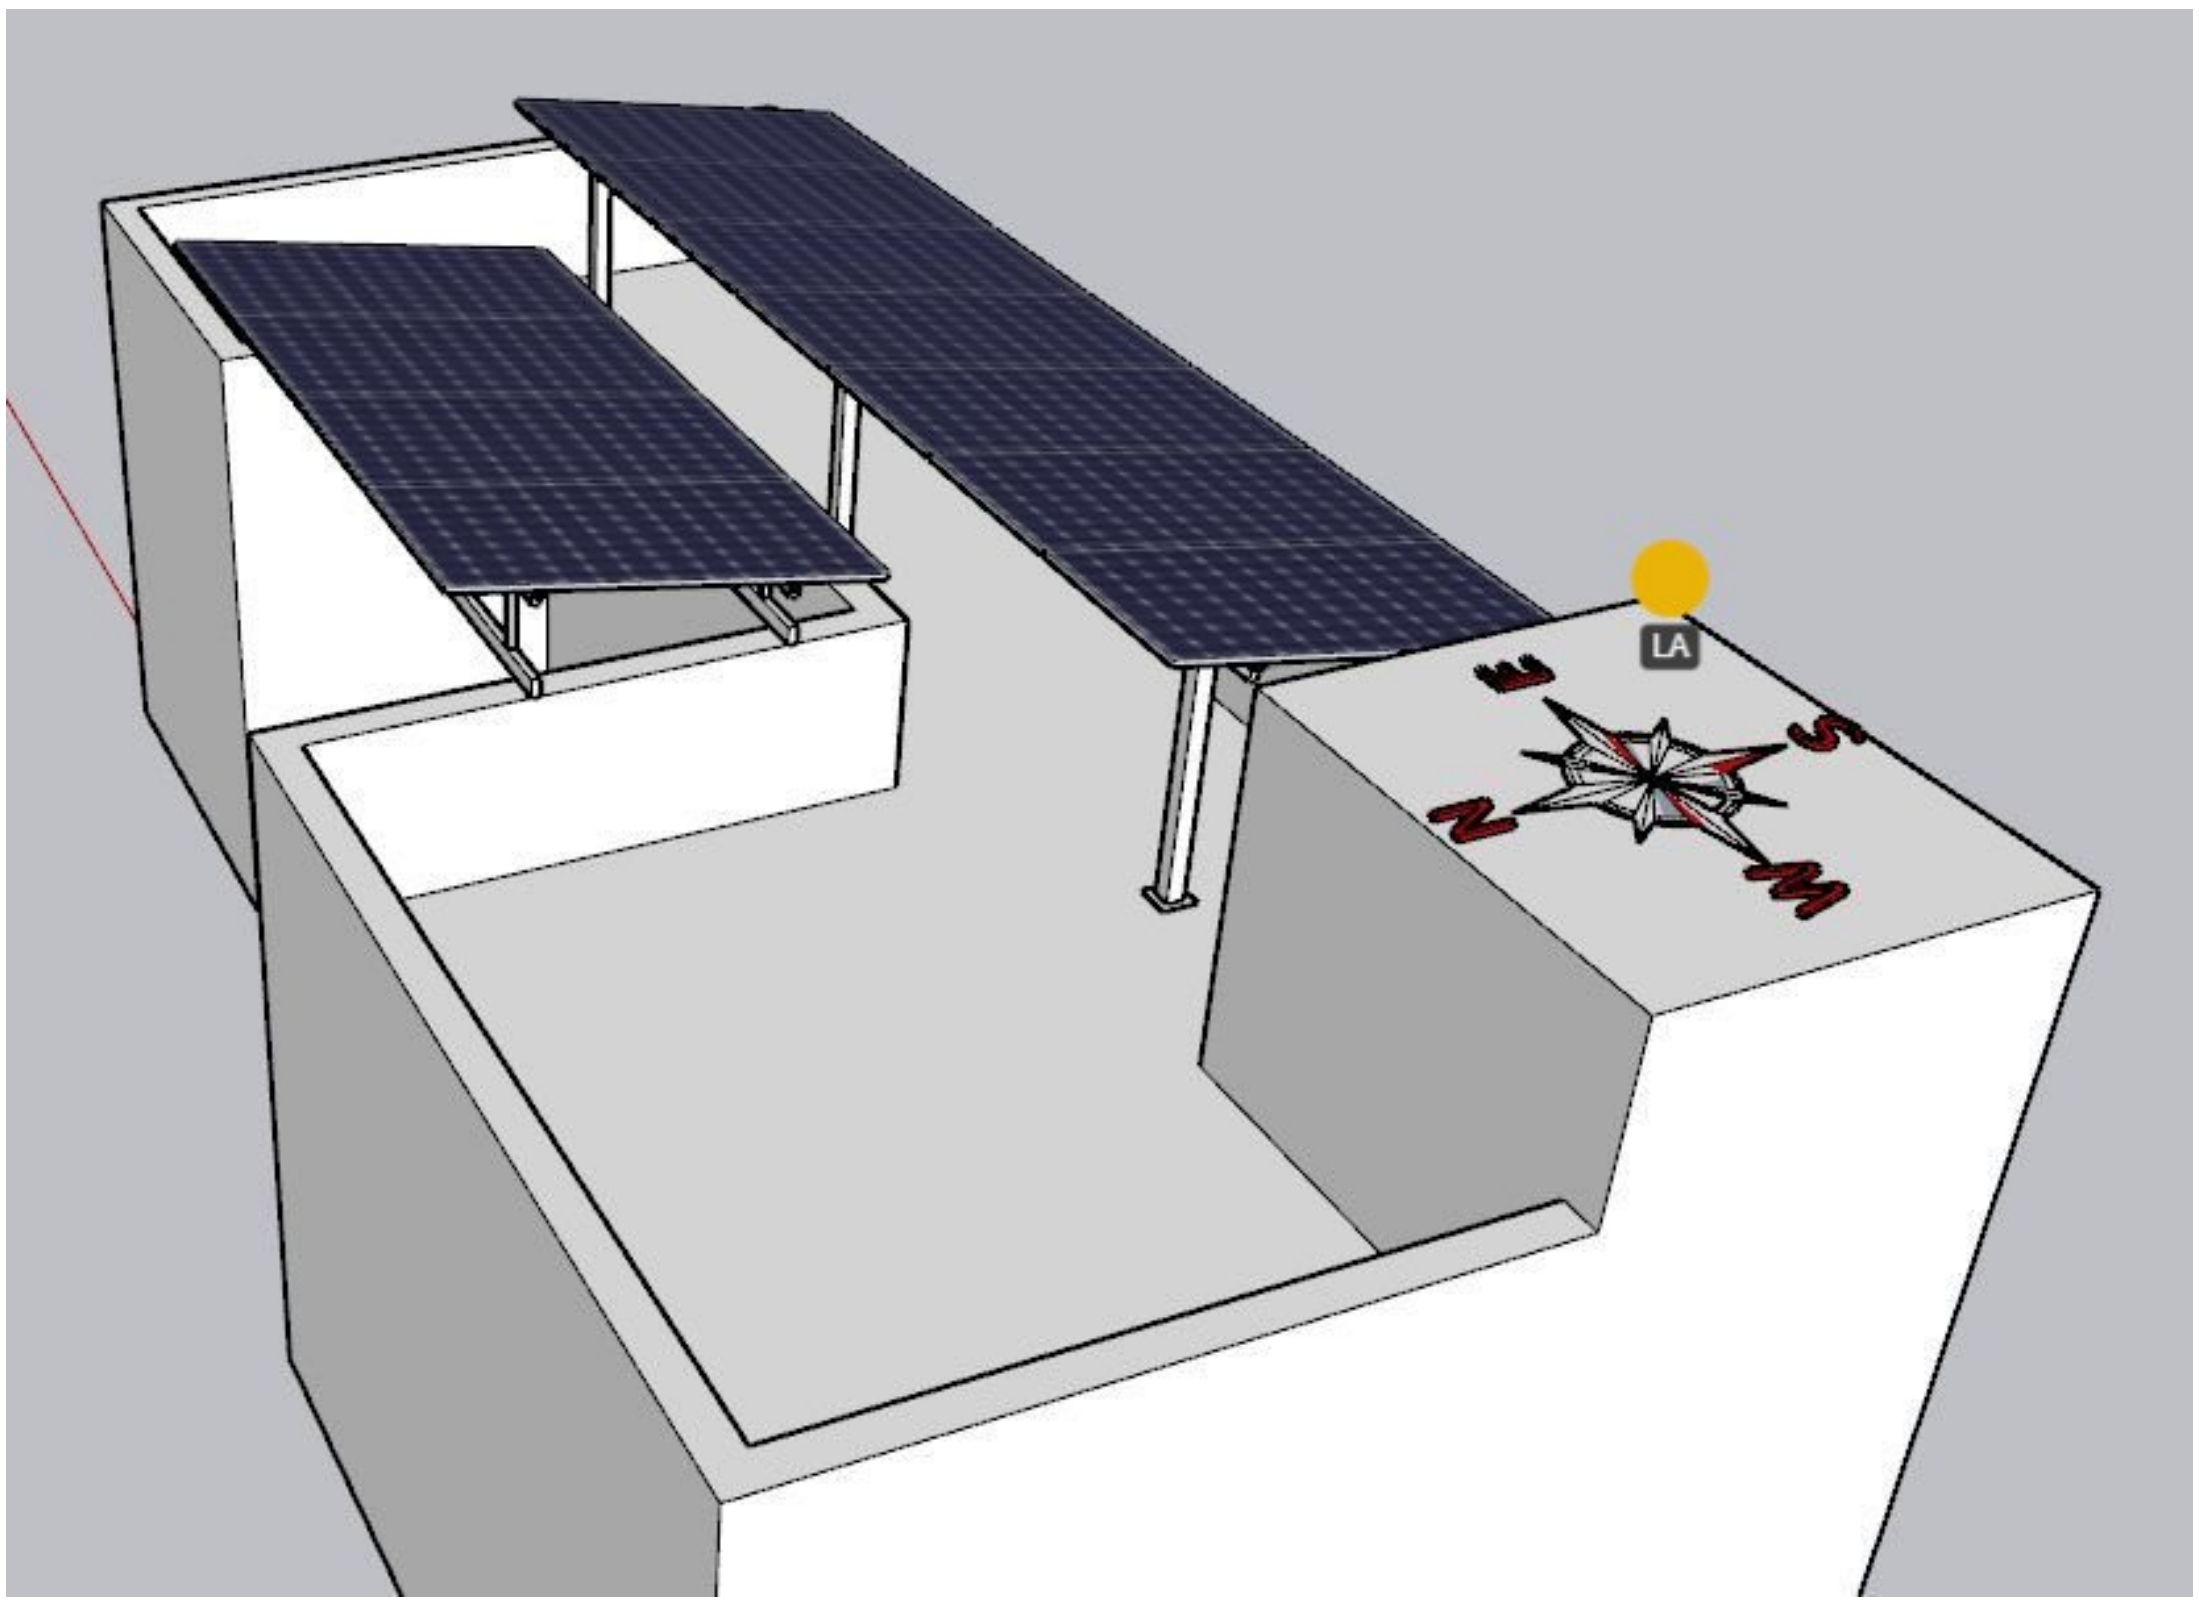

Side view (2)

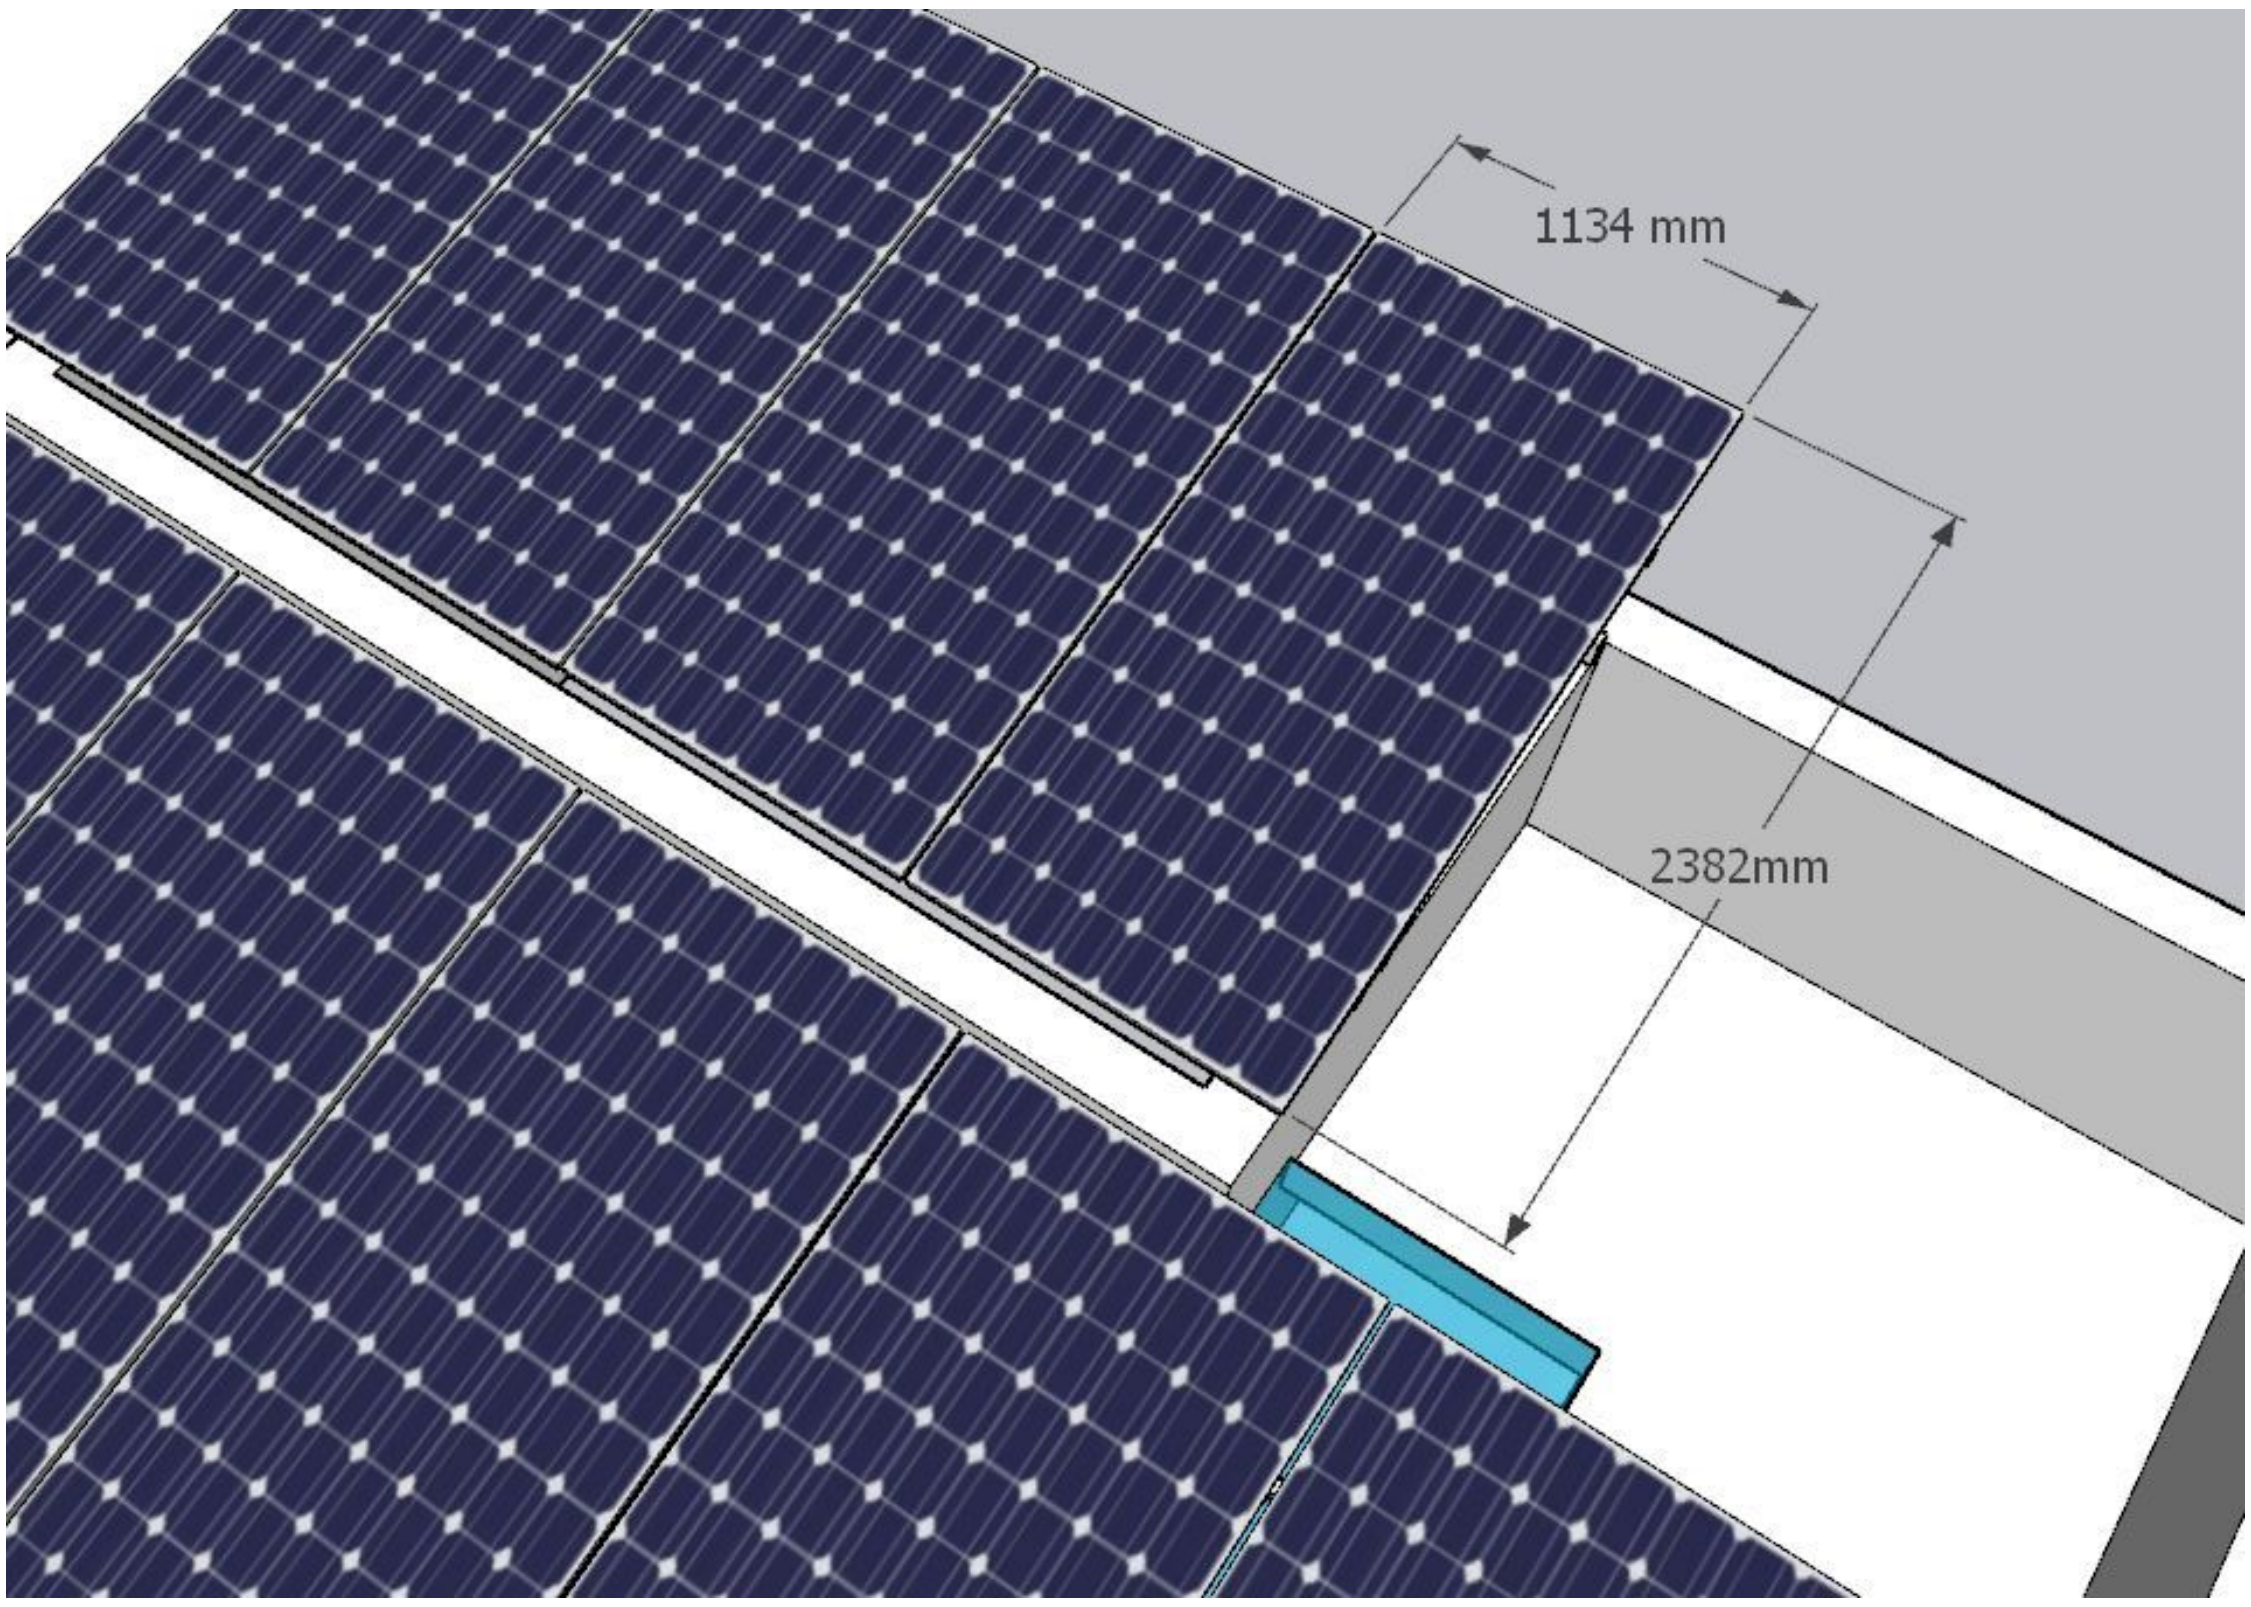

Panel Dimensions

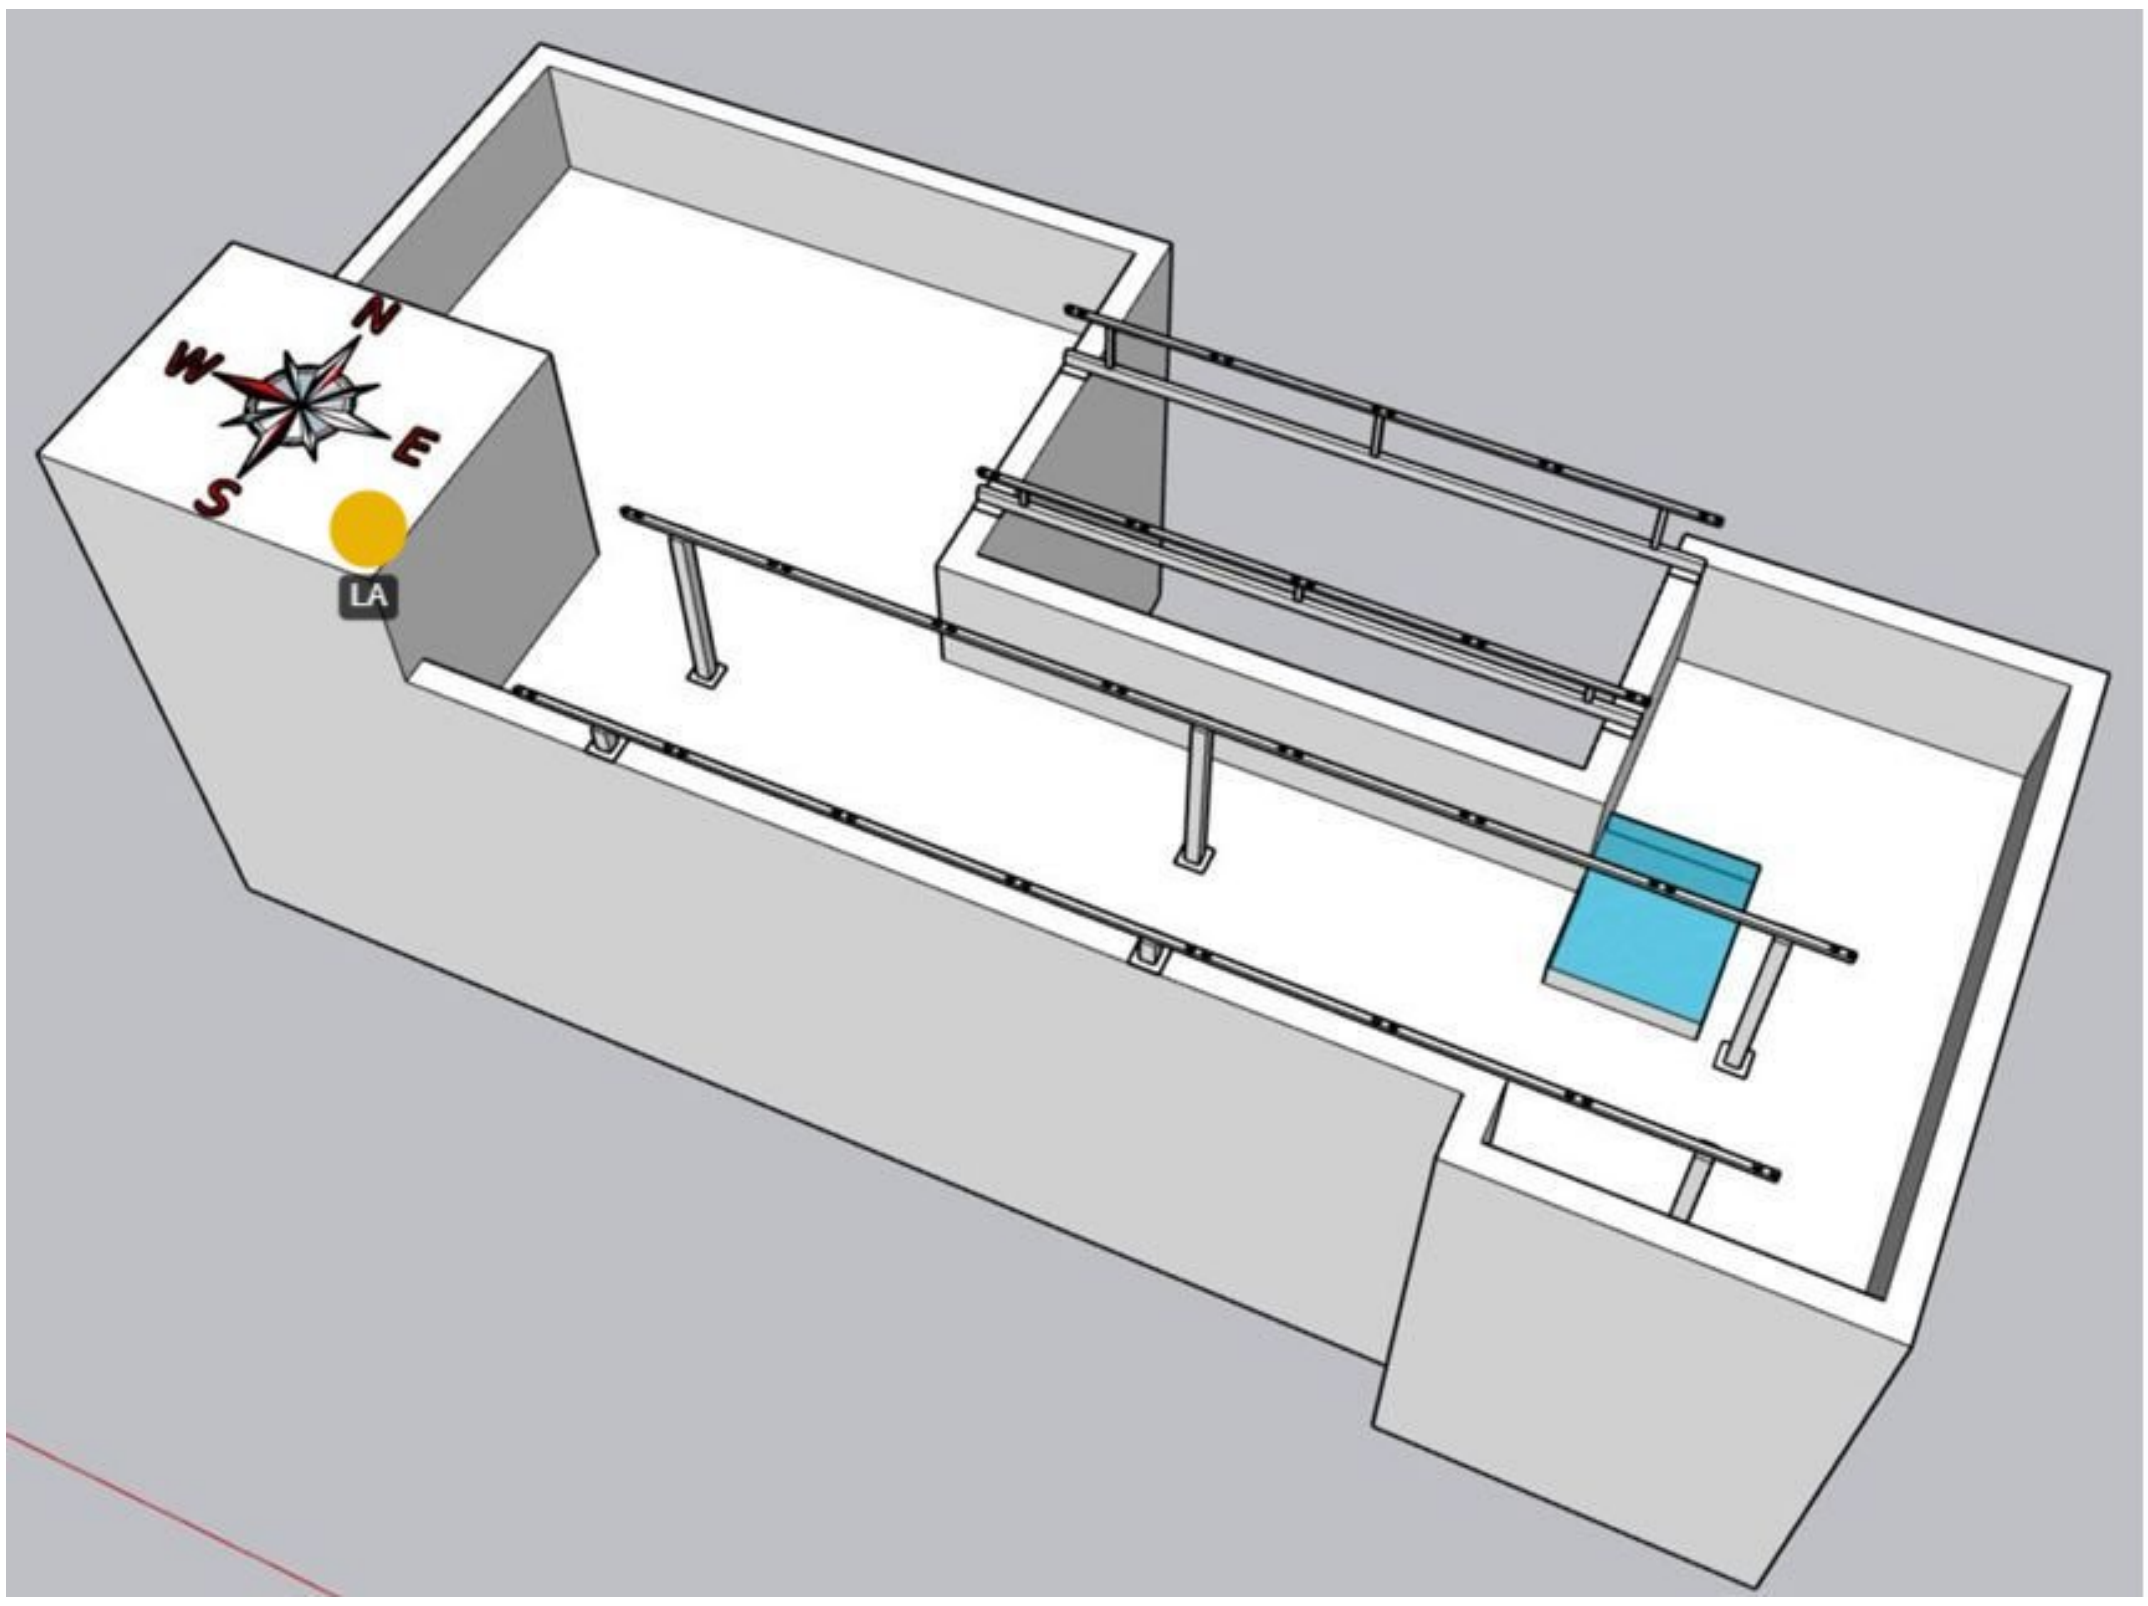

Structure detail (1)

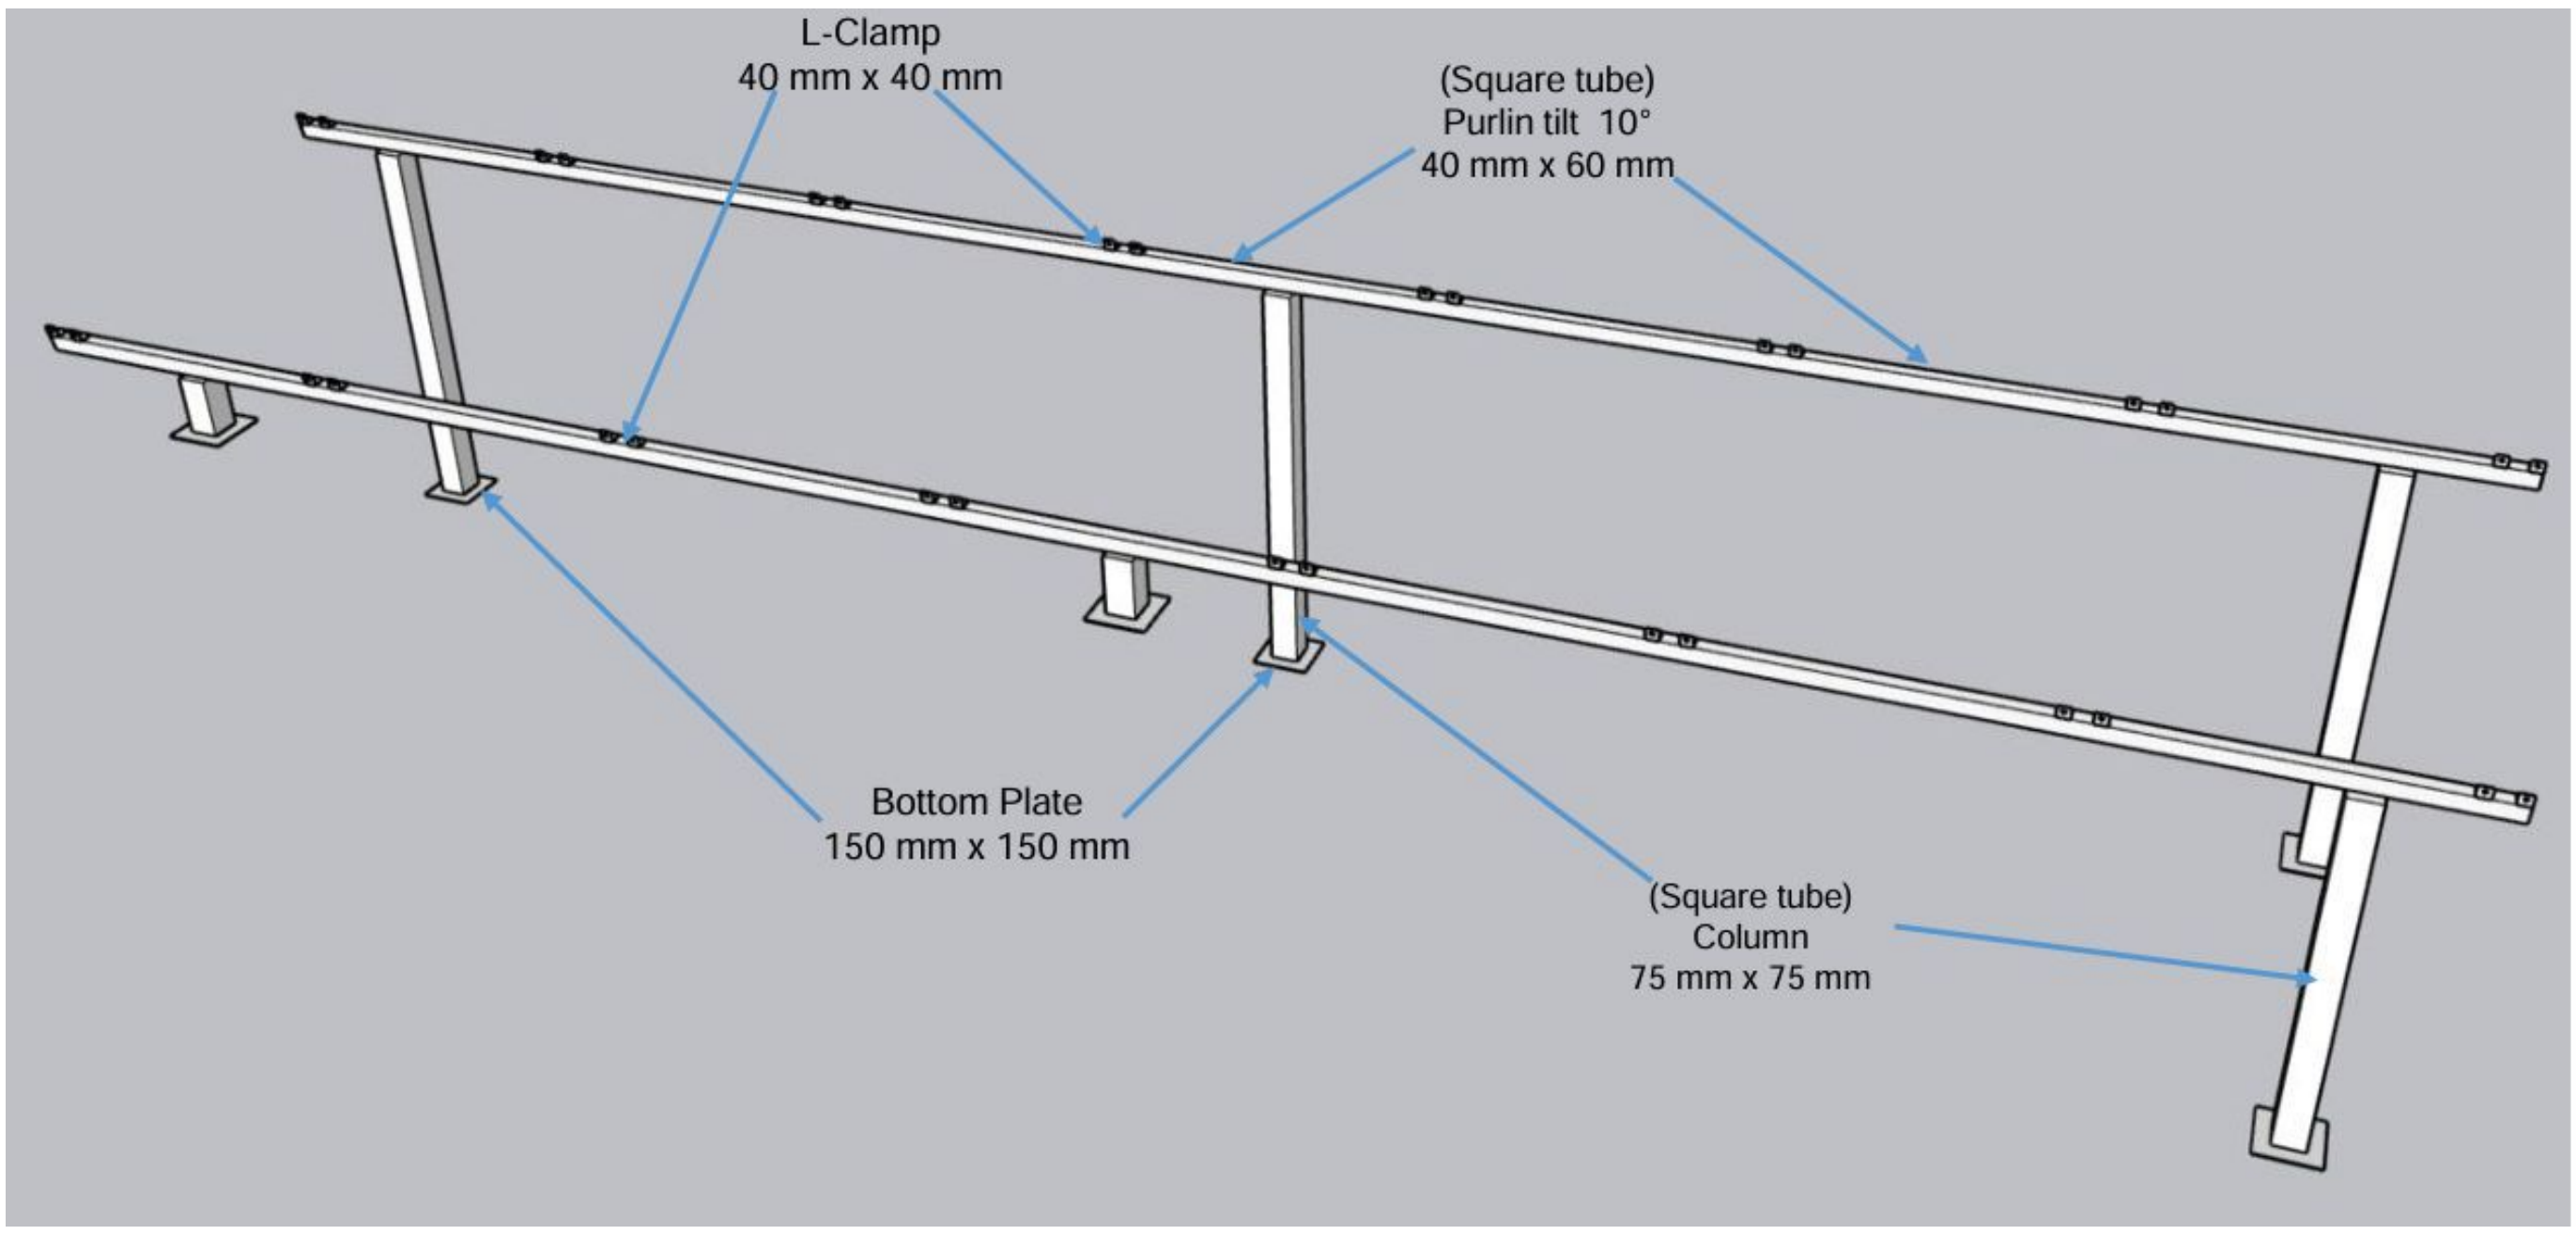

Structure detail (2)

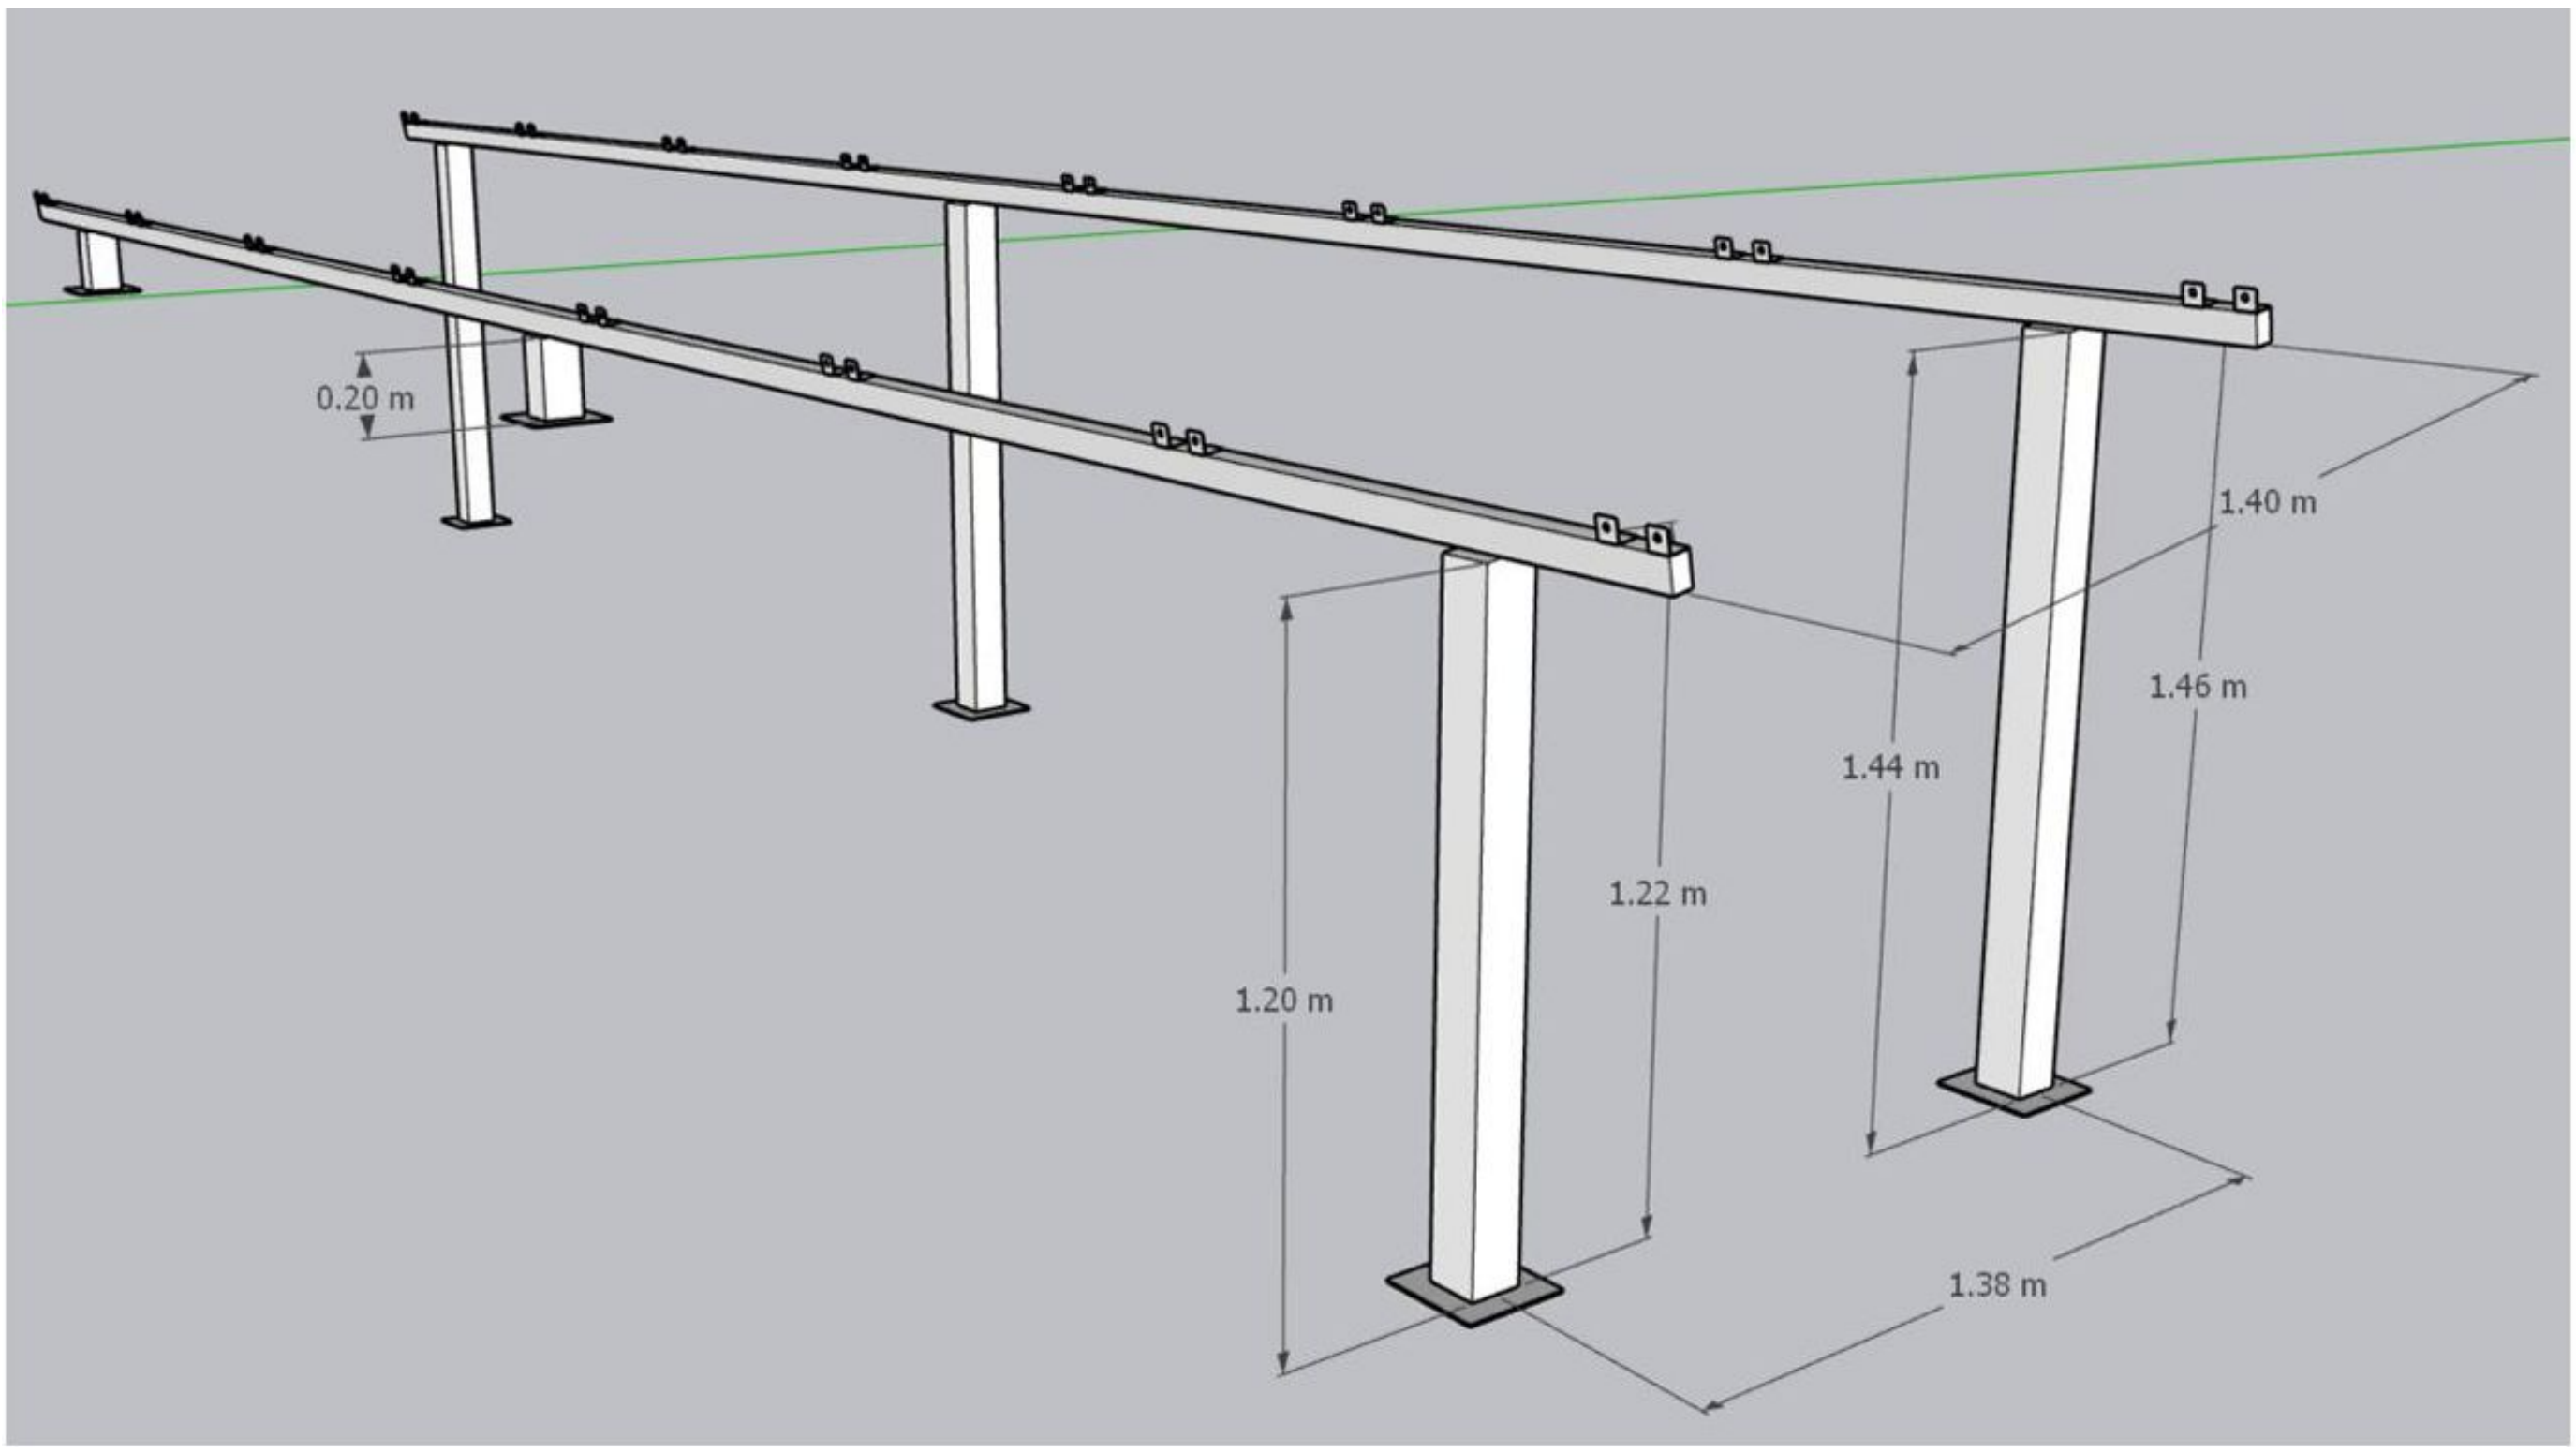

Structure detail (3)

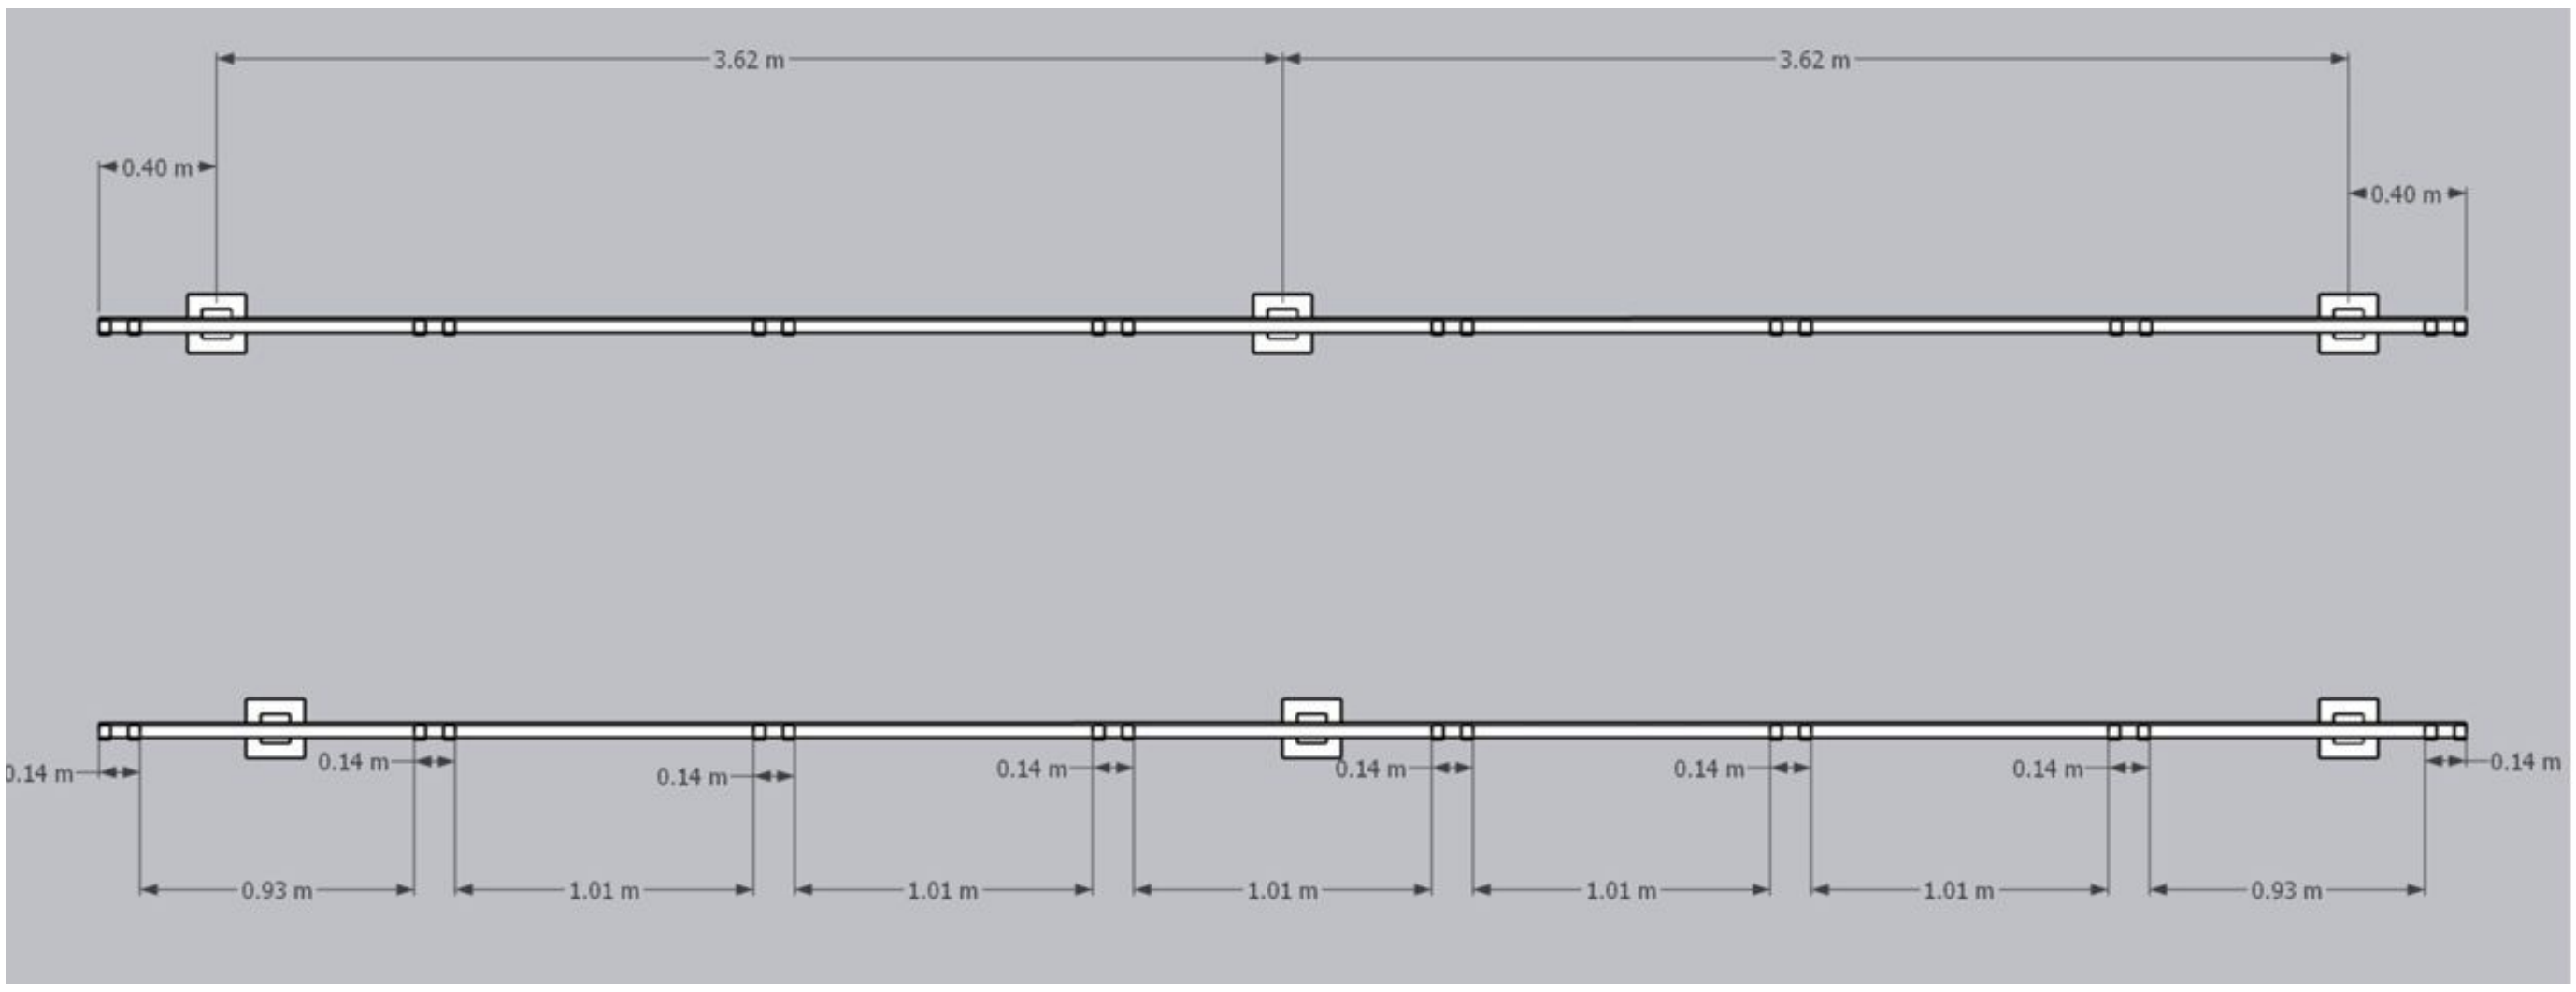

Structure detail (4)

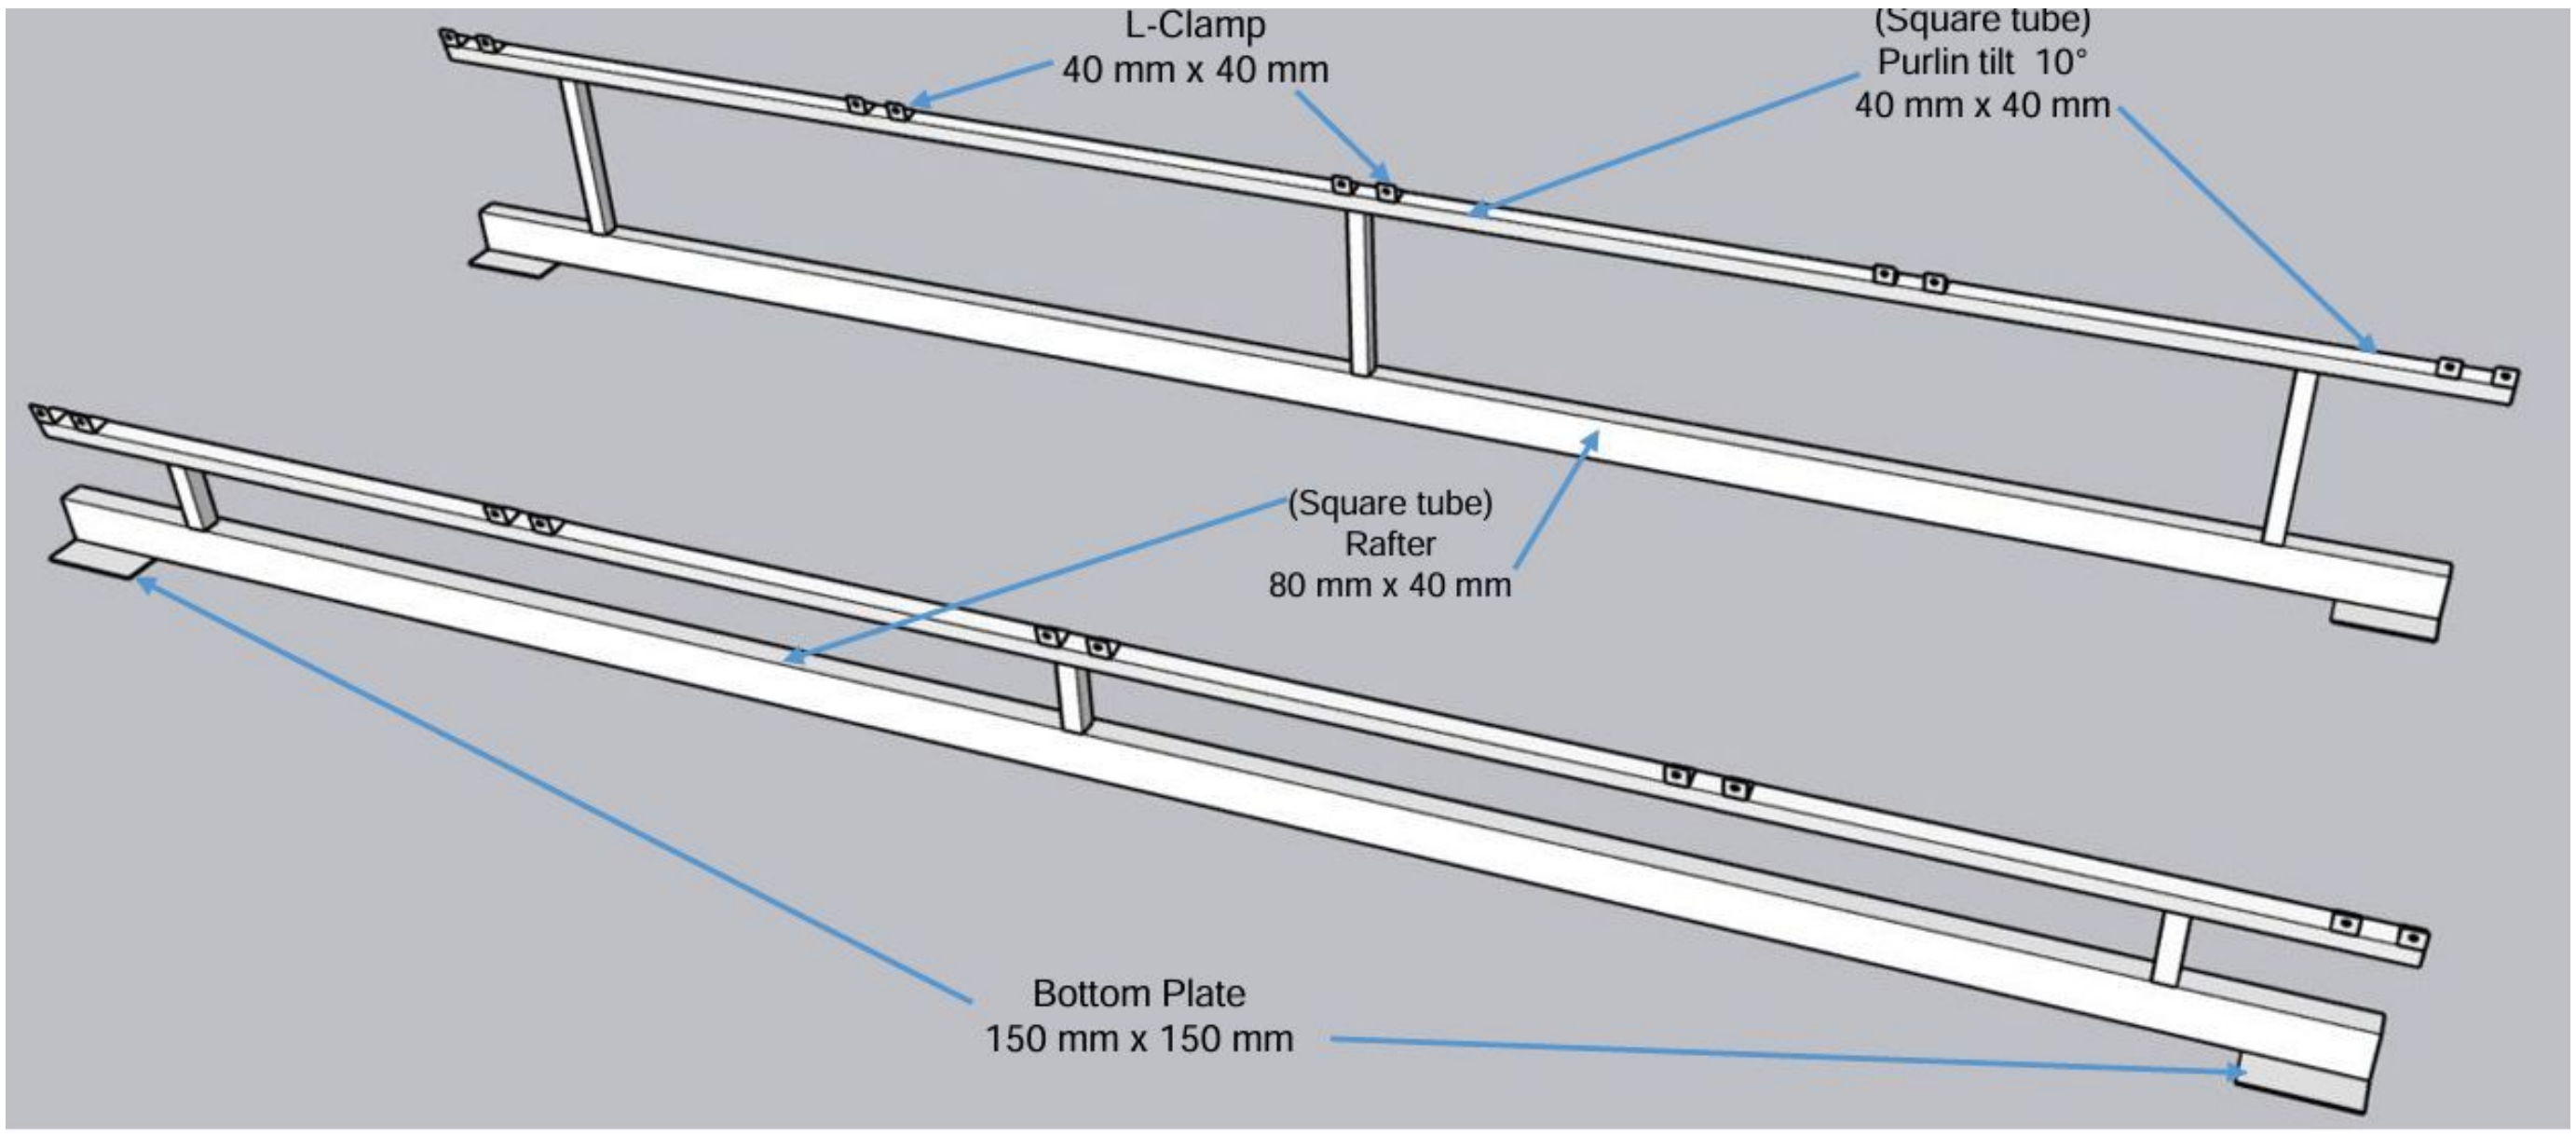

Structure detail (5)

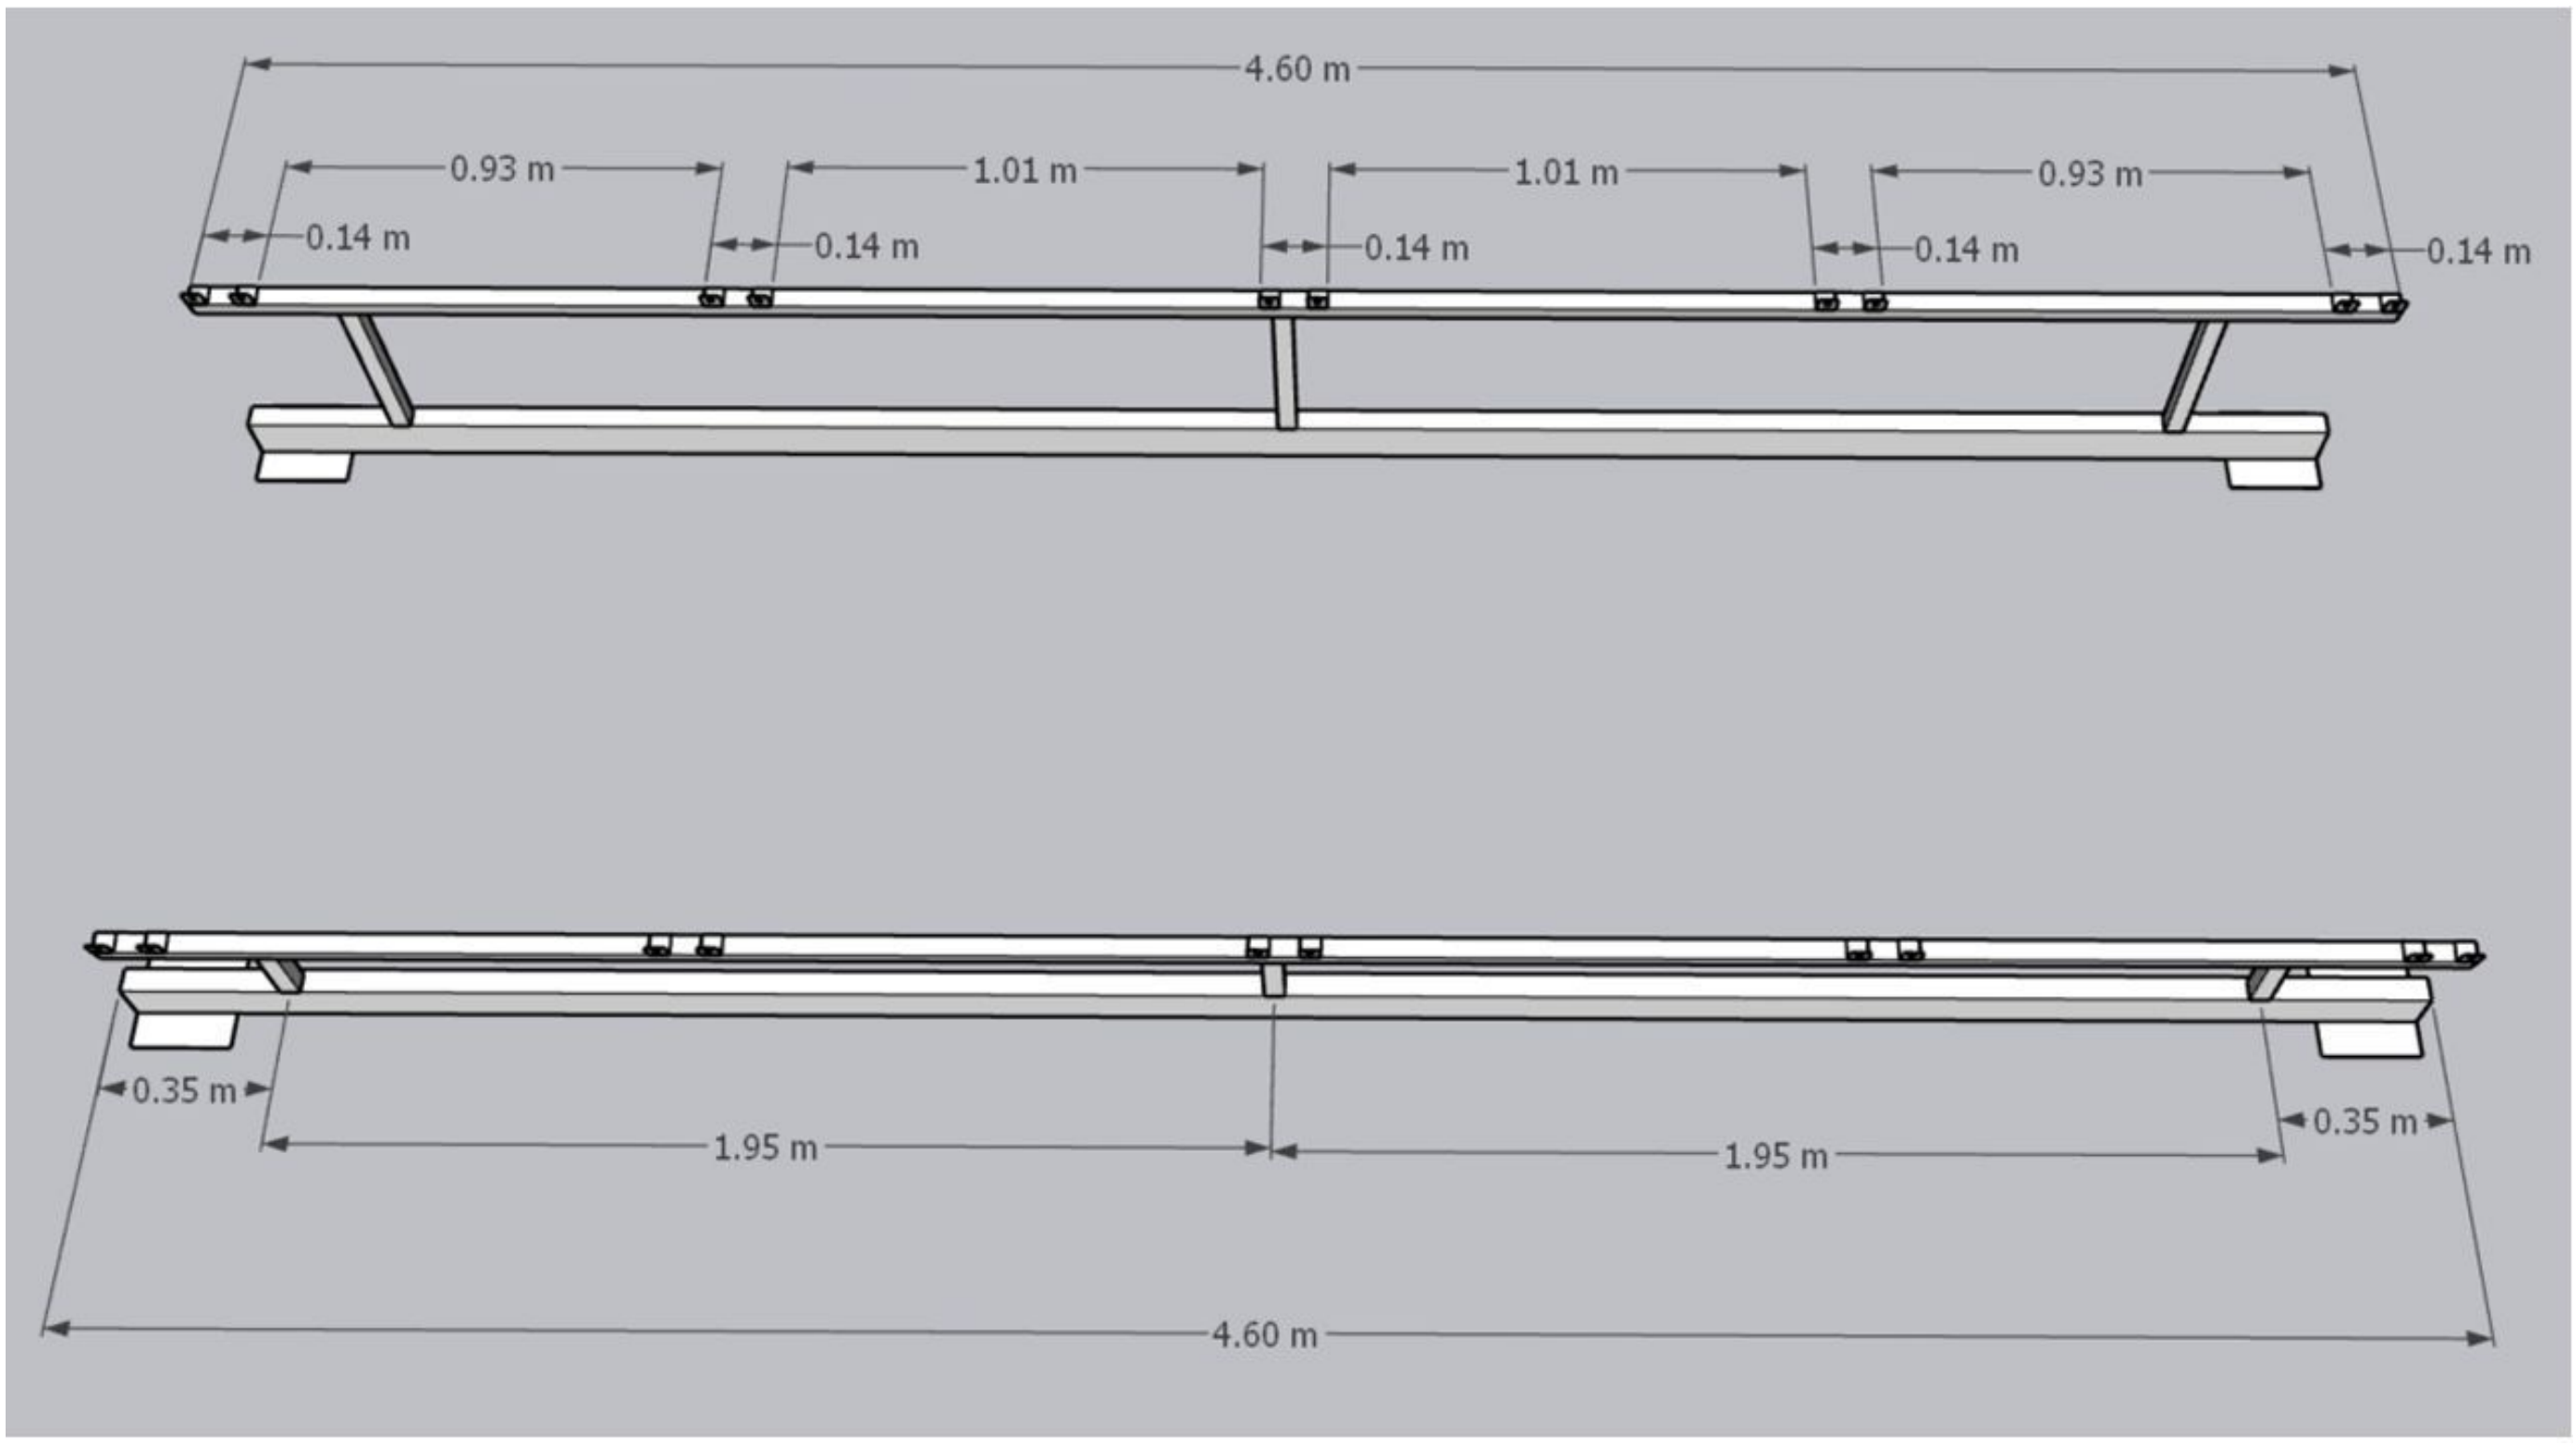

Structure detail (6)

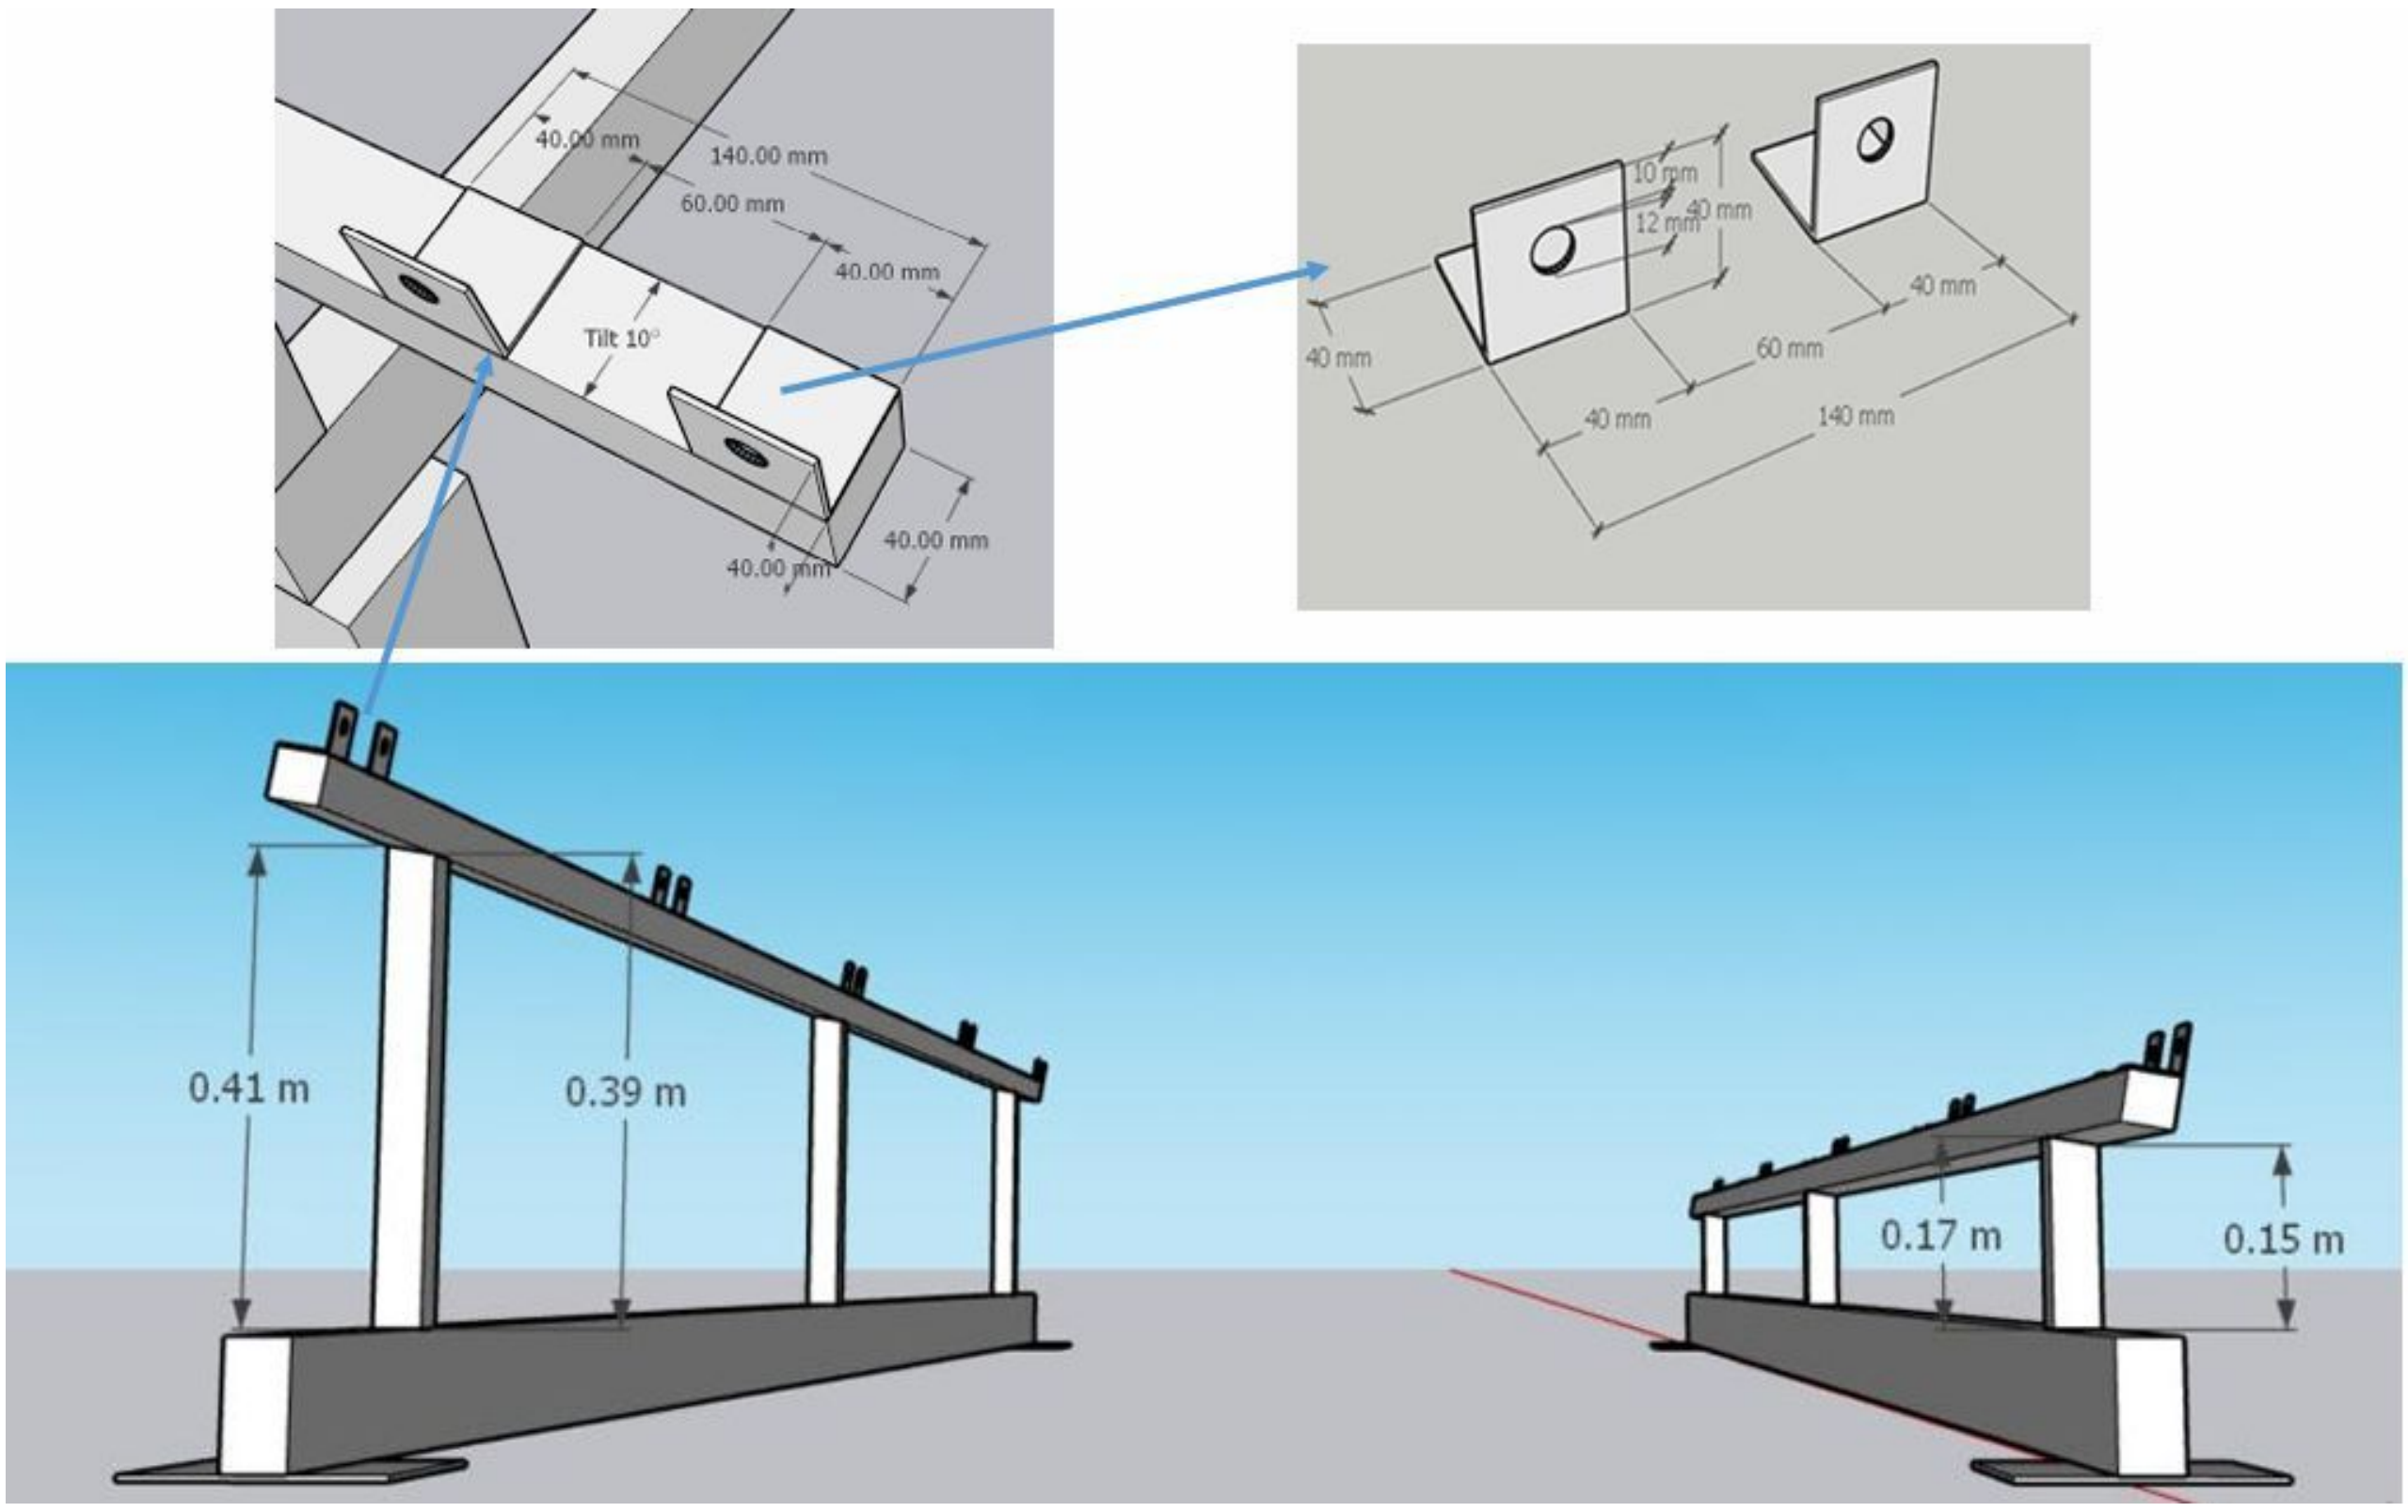

Structure detail (7)

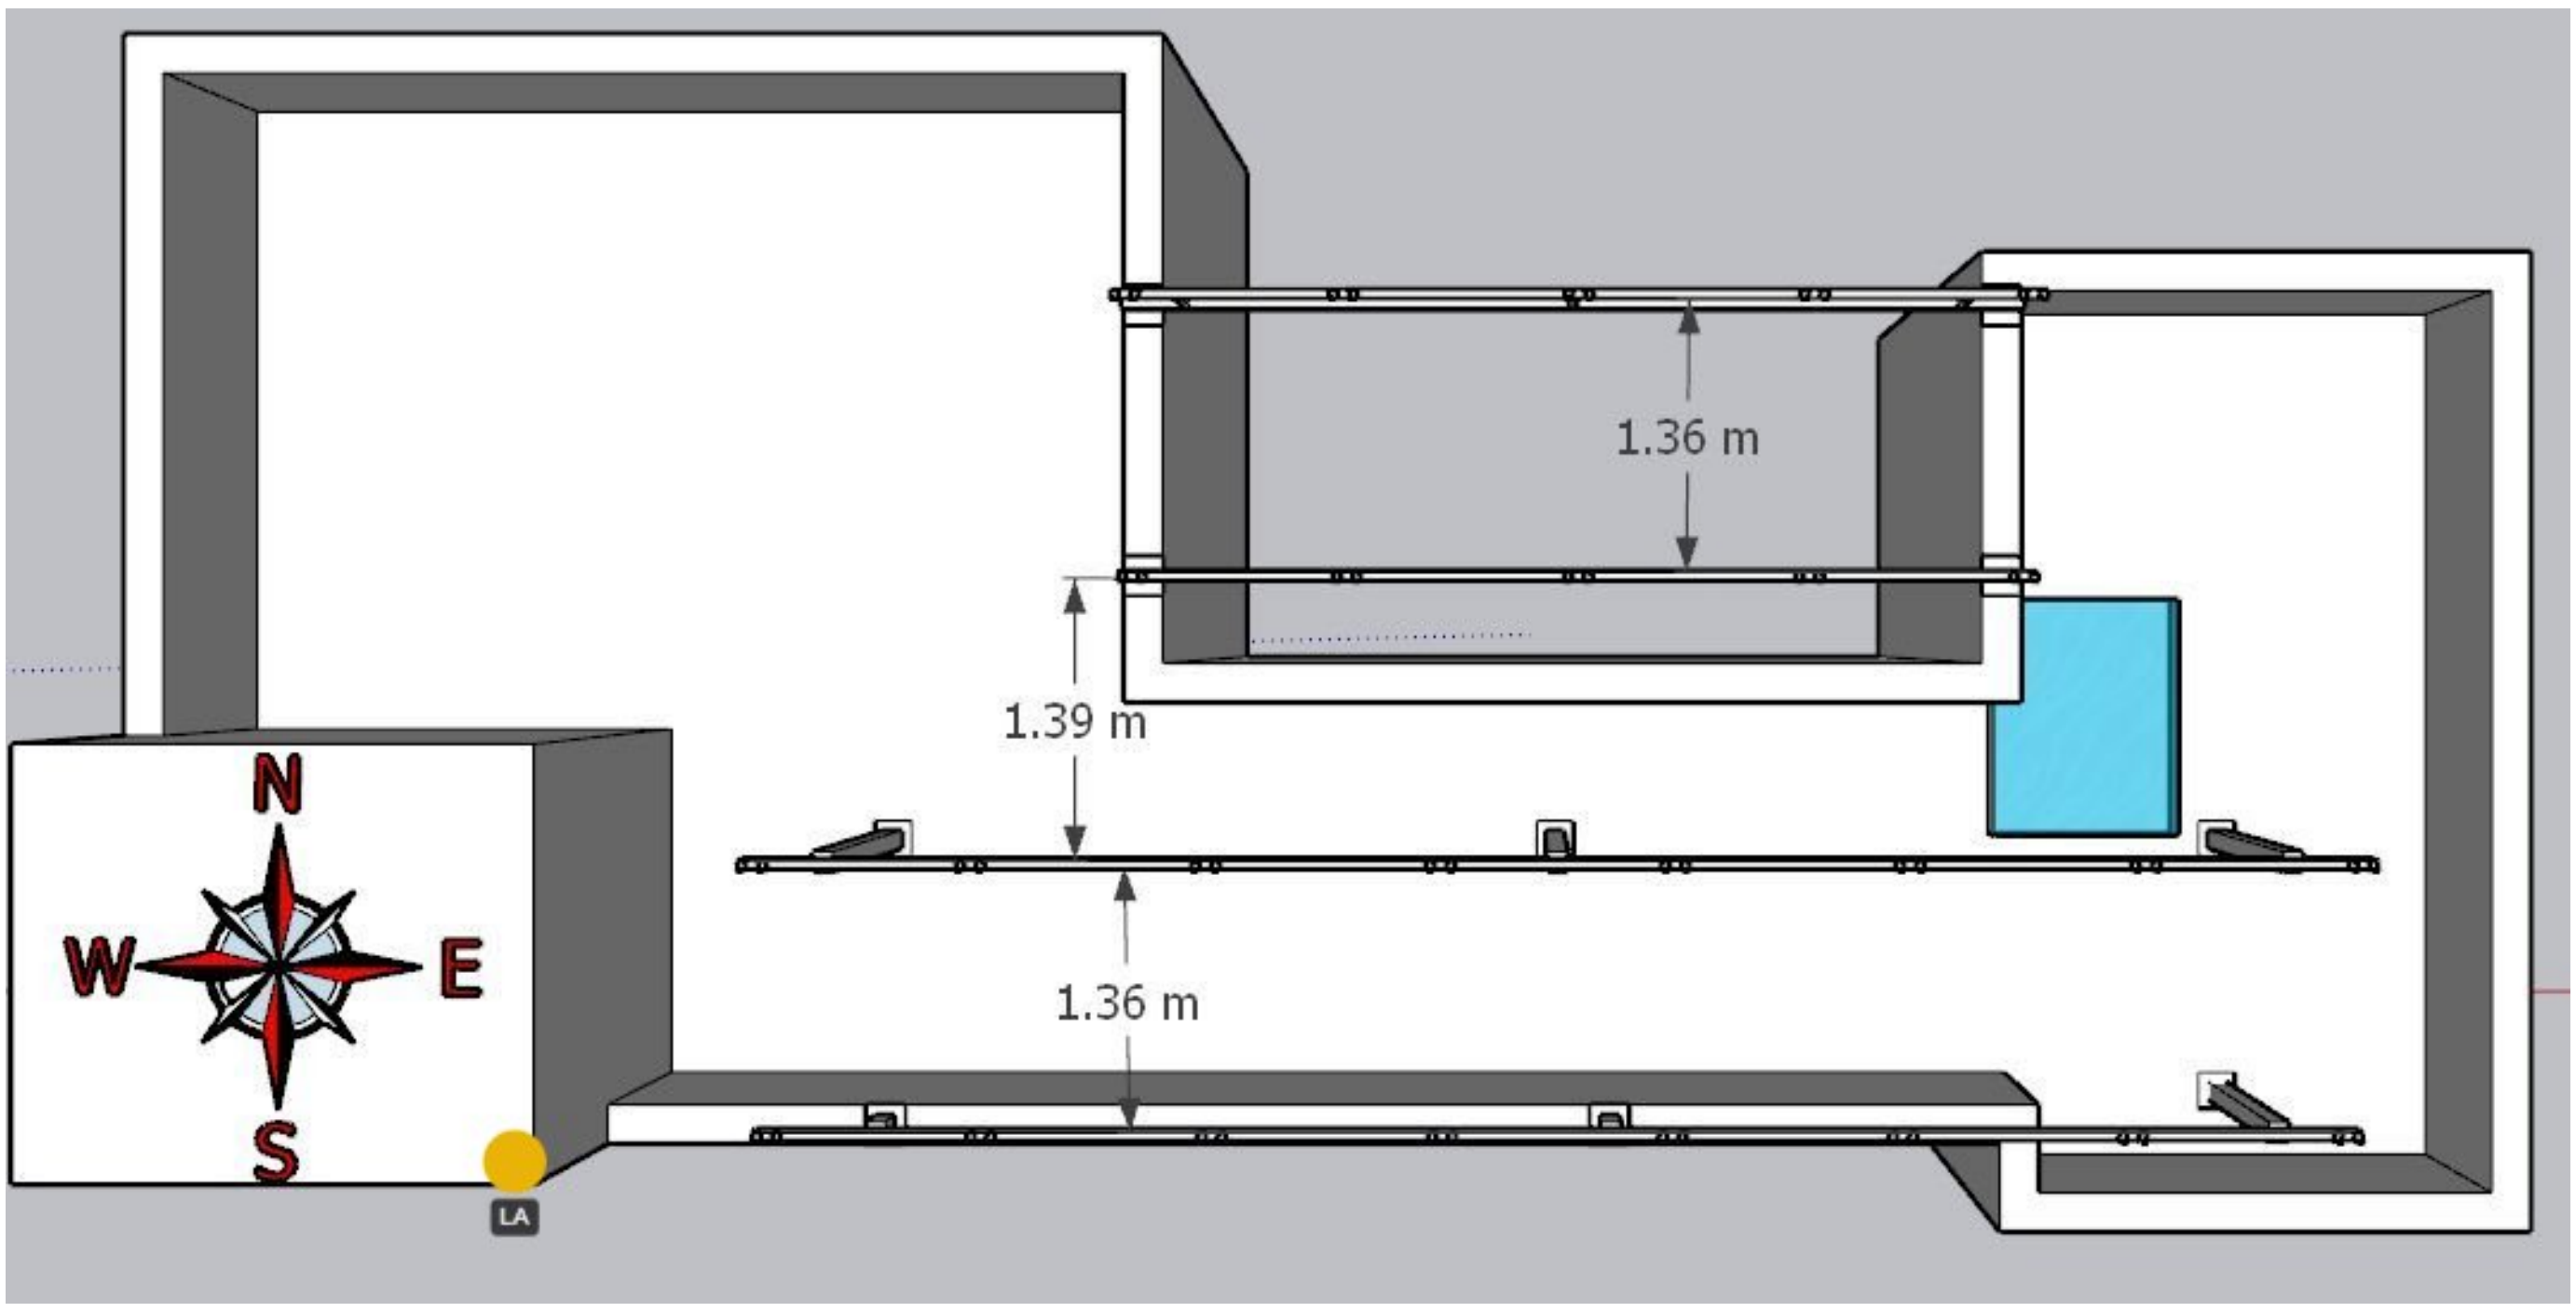

Structure detail (8)

Proposed PV Area

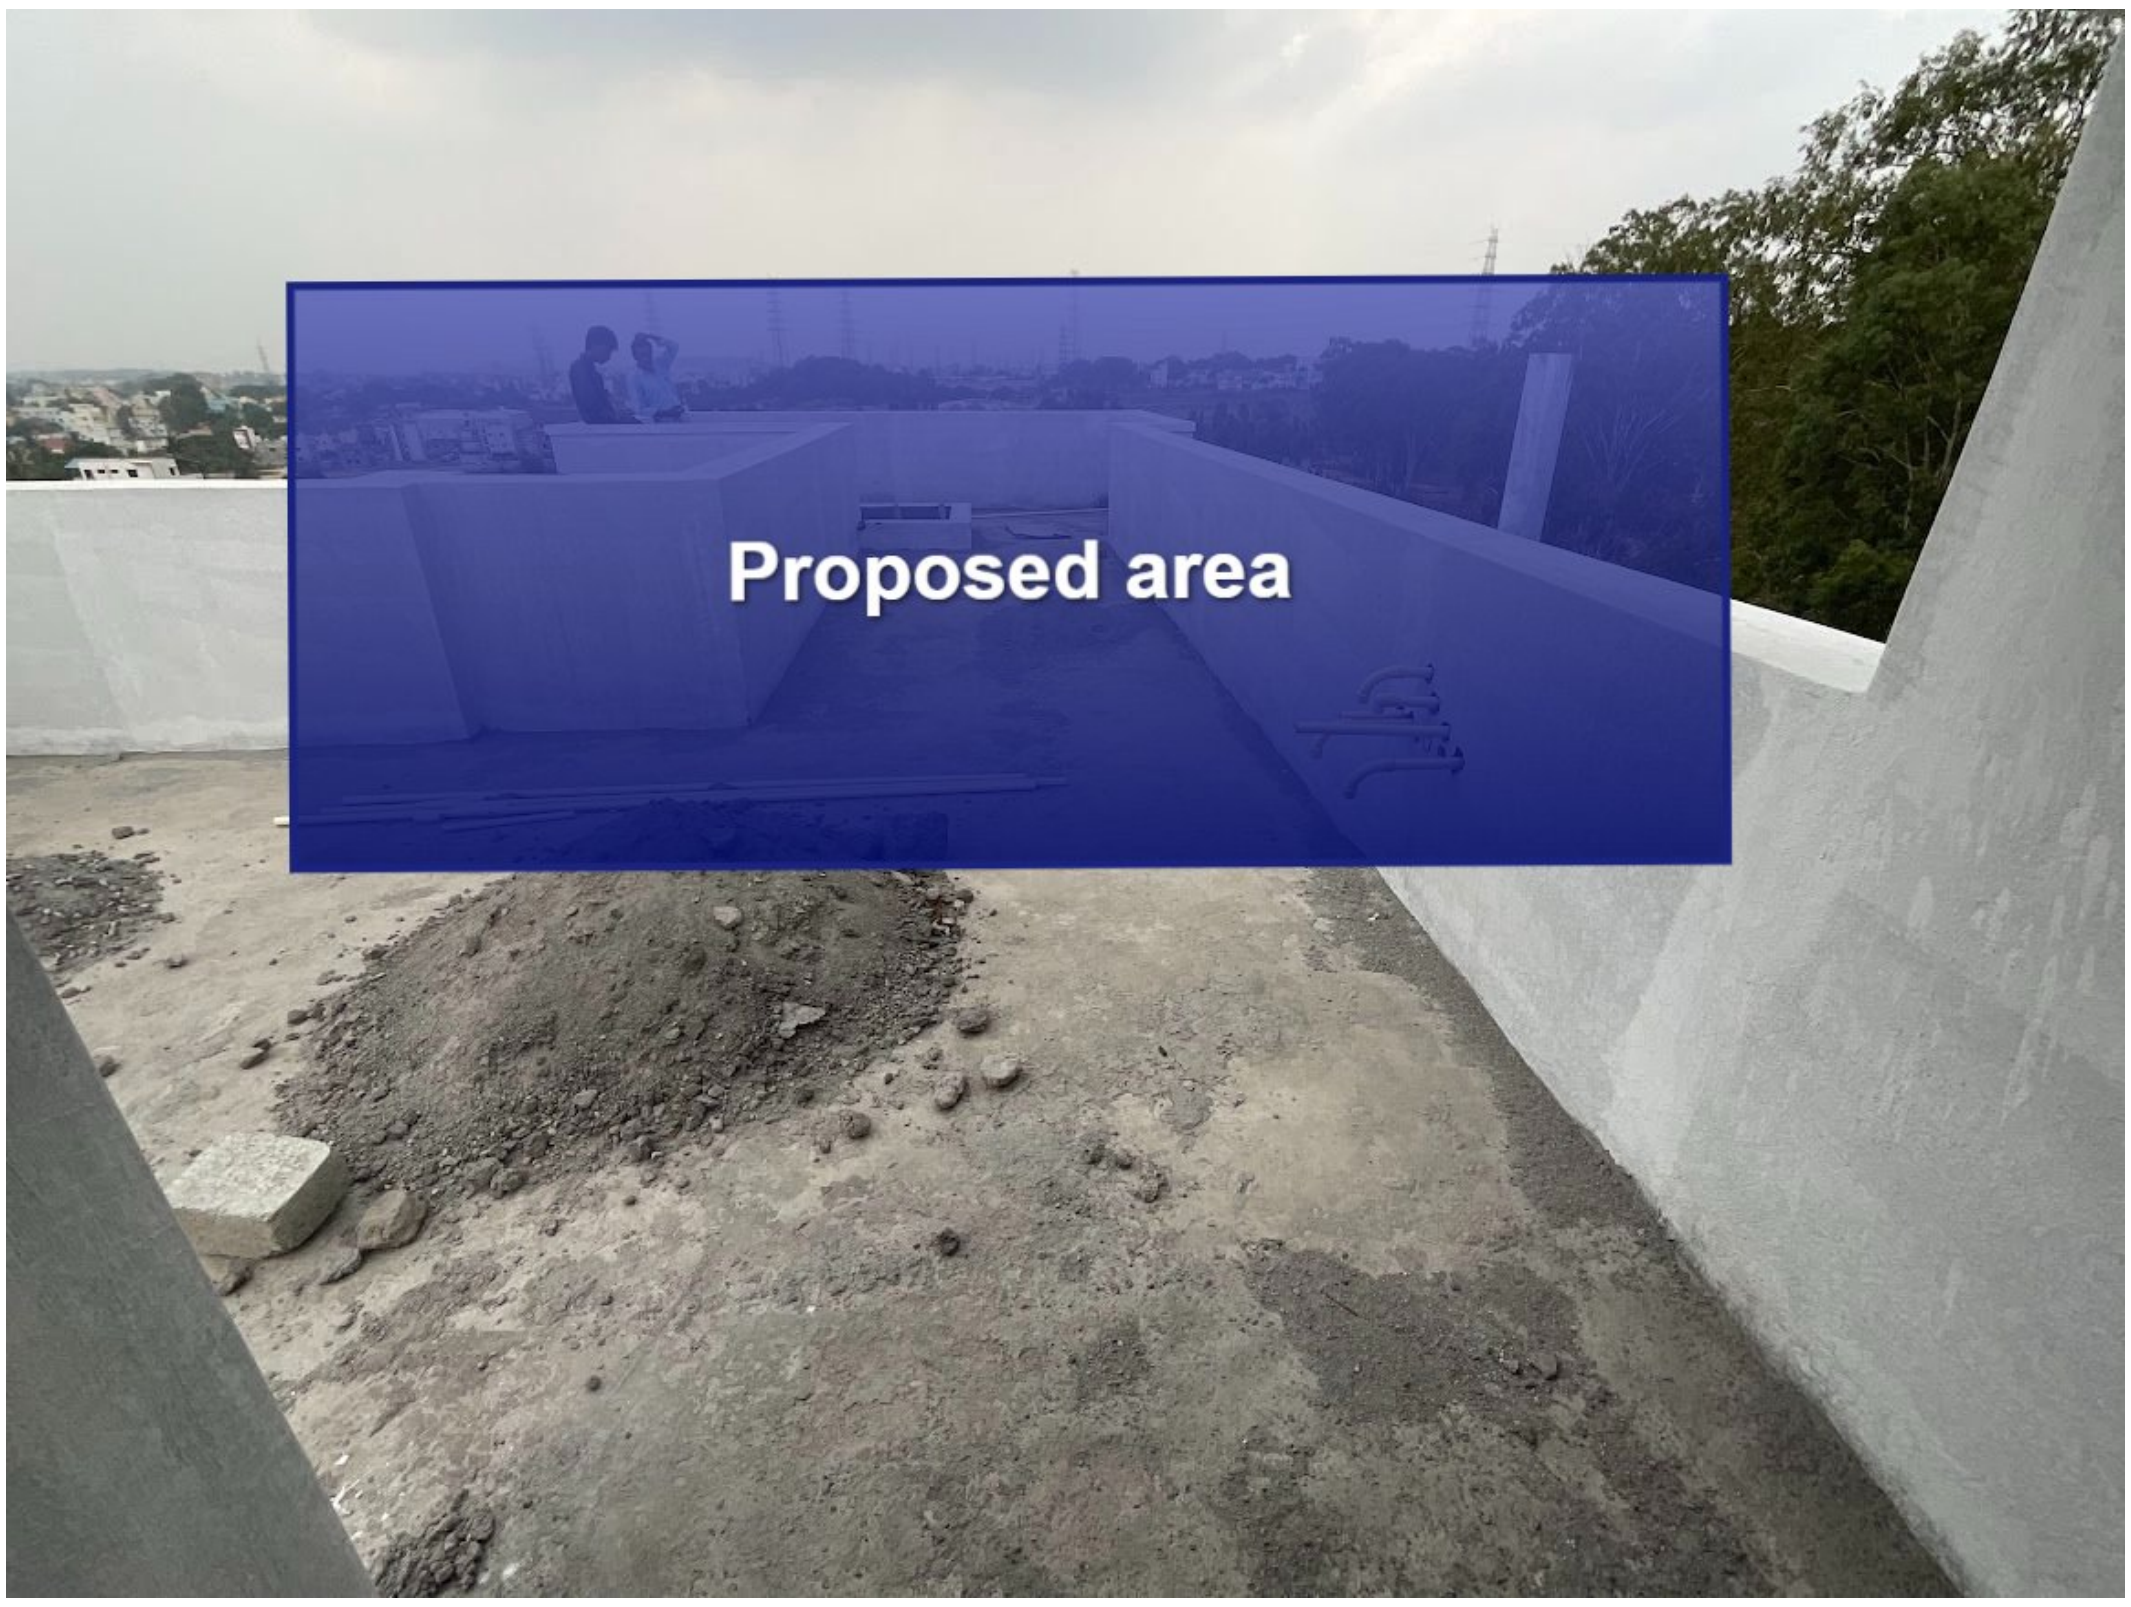

Cable Routing

Equipment Location

Earth Pit Location


DC Earth Pit
LA Pit

OBSERVATIONS & RECOMMENDATIONS

EcoSoch Scope

#	Observation
1	As per the Builder suggestion, routing, cable earthing, and also solar meter have been considered.

Customer Scope

#	Observation
1	Wi-Fi upto solar meter is under customer scope.
2	MS fabrication is under customer scope.

THANK YOU

Dear Sangeeta Rupesh Pillai,

Thank you for choosing EcoSoch Solar for your solar installation. We appreciate your trust in us and your commitment to sustainable energy. Our team is dedicated to ensuring a seamless installation experience and long-term performance of your solar system.

Should you have any questions or require further assistance, please do not hesitate to reach out to us.

Warm Regards,
Team EcoSoch

& Did You Know?

The Sun burns 600 million tonnes of hydrogen per second — and your panels get a share.

EcoSoch Solar Pvt. Ltd.

#940, Sha Arcade, 2nd Phase, NTI Layout, Kodigehalli, Bengaluru 560097

www.ecosoch.com | info@ecosoch.com