Technical Site Visit Report

Prepared for: Shriram Summitt_Electronic City_55.68kWp_String - Block 20 and Block 21

PROJECT INFORMATION

Report Number	ESV-2026-0110
Project ID	1B4376B8
Project Name	Shriram Summitt_Electronic City_55.68kWp_String
Building Name	Block 20 and Block 21
Billing Name	Shriram Summitt_Electronic City_55.68kWp_String
Project Sector	Residential
Project Type	With Subsidy
Sales Lead	Gautam
Site Address	Shriram Summit, Hebbagodi, Anekal, Bengaluru Urban, Karnataka, 560100, India
GPS Coordinates	12.8349809, 77.667137
Google Maps	https://www.google.com/maps?q=12.8349809,77.667137
Visit Date	2026-05-14
Visited By	Sai
Revision	Rev 2

CLIENT INFORMATION

Client Name	Shriram Summitt
Contact	9108772555

PROJECT DETAILS

Solar Rooftop System Type	On-Grid
System Capacity (kWp)	55.68
Sanction Load (kW)	55
Module Make & Capacity	Waaree bifacial DCR 580 Wp

Module Length (mm)	2278
Module Width (mm)	1134
Number of Panels	96
Inverter Type	String
Inverter Brand	Deye 50kW 3 phase String
Number of Inverters	01
Mounting Structure Type	RCC Flat Roof

SITE INSPECTION CHECKLIST

General

#	Question	Answer	Notes
1	Can the delivery van/truck reach the material unloading point?	Yes	-
2	Are there any obstacles at the site that could hinder material lifting?	**No**	-
3	Where will the Inverter, DCDB, ACDB, Battery, etc. be located?	Inverter, DCDB, ACDB is located near the water tank area (towards east)	-
4	Is a canopy required for protecting the Inverters/ACDB/DCDB?	**No**	-
5	Did you discuss the location of the earth pits with the customer?	As discussed with the customer earth pits are located in the basement area.	-
6	Where is the Internet Router located?	Customer scope	-
7	What's the Wi-Fi strength of the router near to the String inverter/Envoy?	N/A	-
8	Did you pin the site location in your WhatsApp when you were at the site?	Yes	-

Roof Details

#	Question	Answer	Notes
1	What type of roof is present at the site?	RCC Flat Roof	-
2	Are there any obstructions on the roof that could affect the solar installation?	details: Skylights and water tanks are the obstructions on the roof.	-
3	What is the angle of the panels? (in degrees)	10	-
4	In case of sloped roof, what is the slope angle of the roof? (in degrees)	N/A	-
5	On how many roofs at the site are we installing solar?	02	-

#	Question	Answer	Notes
6	If it is a Tiled roof, what is underneath the tiles?	N/A	-
7	If it is a Tiled roof with MS or Wooden rafters, is it Single-tiled or Double-tiled?	N/A	-
8	What type of mounting structure is planned?	Elevated	*85 Panels HDGI with 2m height , 08 Panels HDGI with 3m height and 03 Panels Ballast structure*
9	What is the orientation of the solar panels?	["South"]	-
10	How can the roof be accessed?	Staircase	-
11	Is the building currently under construction?	**No**	-
12	In an under-construction building, are existing conduit pipes available for AC, DC cables, and earthing?	N/A	-
13	What is the height of the building and how many floors does it have?	Height of the building 57m; it has B1,+B2+G+1 3+Headroom	-
14	Is the site photo matching with the building description?	Yes	-
15	Is there an overhead HT line passing within a 10-meter radius of the site?	**No**	-

Residential / Electrical

#	Question	Answer	Notes
1	What type of energy meter is currently installed?	Phase: Three Phase, Type: Digital, If 3-phase: LT with 3CT3PT (50 - 150)	-
2	Is the Meter cubicle photo matching with the previous answer?	Yes	-
3	Has the termination point in the Main meter panel been identified?	Yes	-
4	Is the Termination Point easily visible or sealed?	Visible	-
5	Is a Lightning Arrestor (LA) already available at the site?	**No**	-
6	Is space available for CT within Energy meter panel?	**No**	-
7	In case of an Enphase system, is the distance between the farthest micro-inverter and IQ Gateway > 50m?	N/A	-
8	Provide details of the existing CT ratings (if applicable).	75/5A	-
9	In Main meter panel, is empty space available for solar meter?	**No**	-
10	In Main meter panel, is empty space available to house the Enphase accessories or ACDB components?	**No**	-
11	Is there space available to dig DC, AC and LA earth pits?	Yes	-
12	In case of elevated structures, is an LA extension provided at the far end?	**No**	-
13	In case of elevated structures, is it with or without grouting?	Without Grouting	-
14	Are there any challenges with respect to Installation and Maintenance activities?	**No**	-
15	Are there any safety risks associated with accessing the roof for installation?	**No**	-
16	Is space present in rooftop to store the panels?	Horizontally sleeping	-

#	Question	Answer	Notes
17	In case of sloped roof MS structure, provide the dimension of rafter to rafter, purlin to purlin.	N/A	-
18	Is ventilation available in the battery location?	N/A	-
19	Should the Inverters/ACDB/DCDB be installed on a metal grill or wall mount?	Inverters/ACDB/DCDB be installed on a wall mount	-
20	Provide the dimensions for solar meter cubicle placement (L x W of wall).	length: 1000, width: 1000	-
21	Provide the dimension for earth pits location (L x W of available space).	length: 1000, width: 1000	-
22	Is LAN cable under customer scope?	**No**	-
23	Is there any shadow that affects the solar installation?	**No**	-
24	Is there any trench work to be done to carry the AC cable to the meter location?	**No**	-

PHOTO DOCUMENTATION

Cable Routing Legend

Legend	Description
	Proposed PV Module Array
	Main Meter Location
	Solar Meter
	Battery
	Inverter
	Other Equipment
	DC Cable
	AC Cable
	Material Shifting
	DC Earthing Cable
	AC Earthing Cable
	LA Cable
	DC Earth Pit
	AC Earth Pit
	LA Pit
	LA

Building Exterior

Material Delivery Route

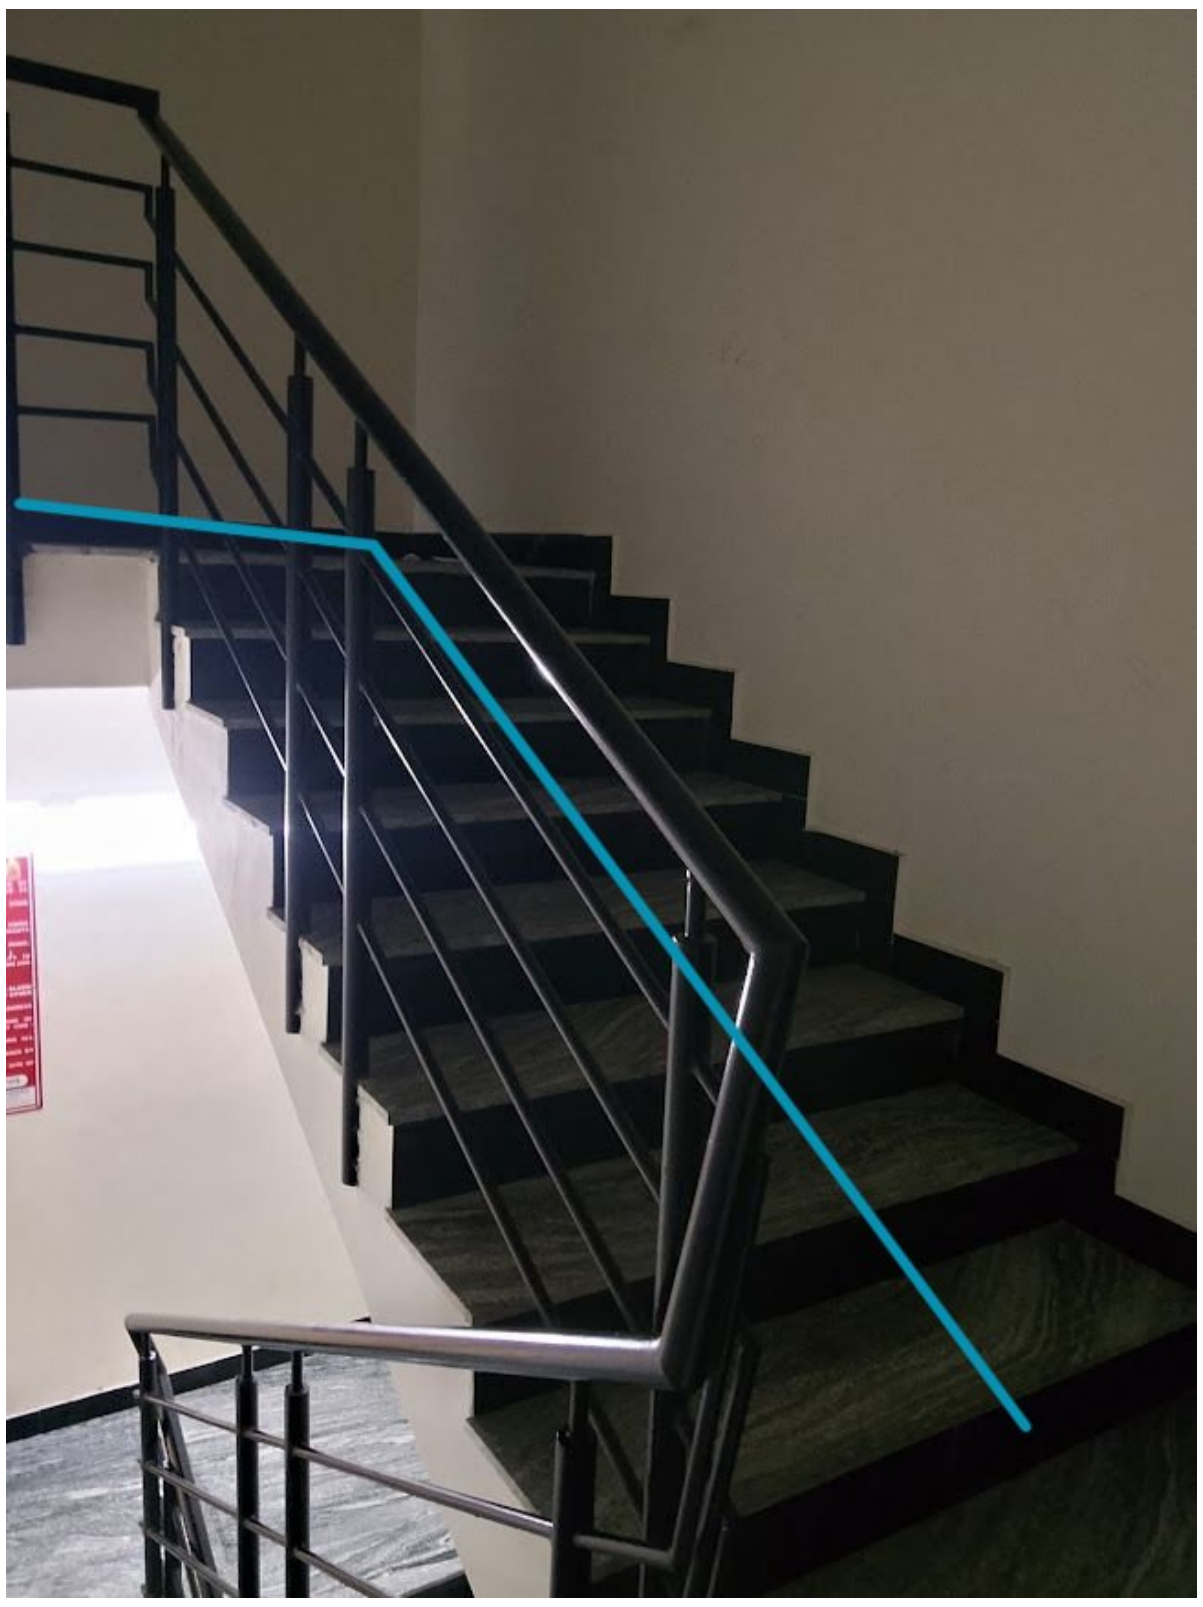

This route will carry small items

This route will carry large items (like panels)

Staircase Details

Meter Box

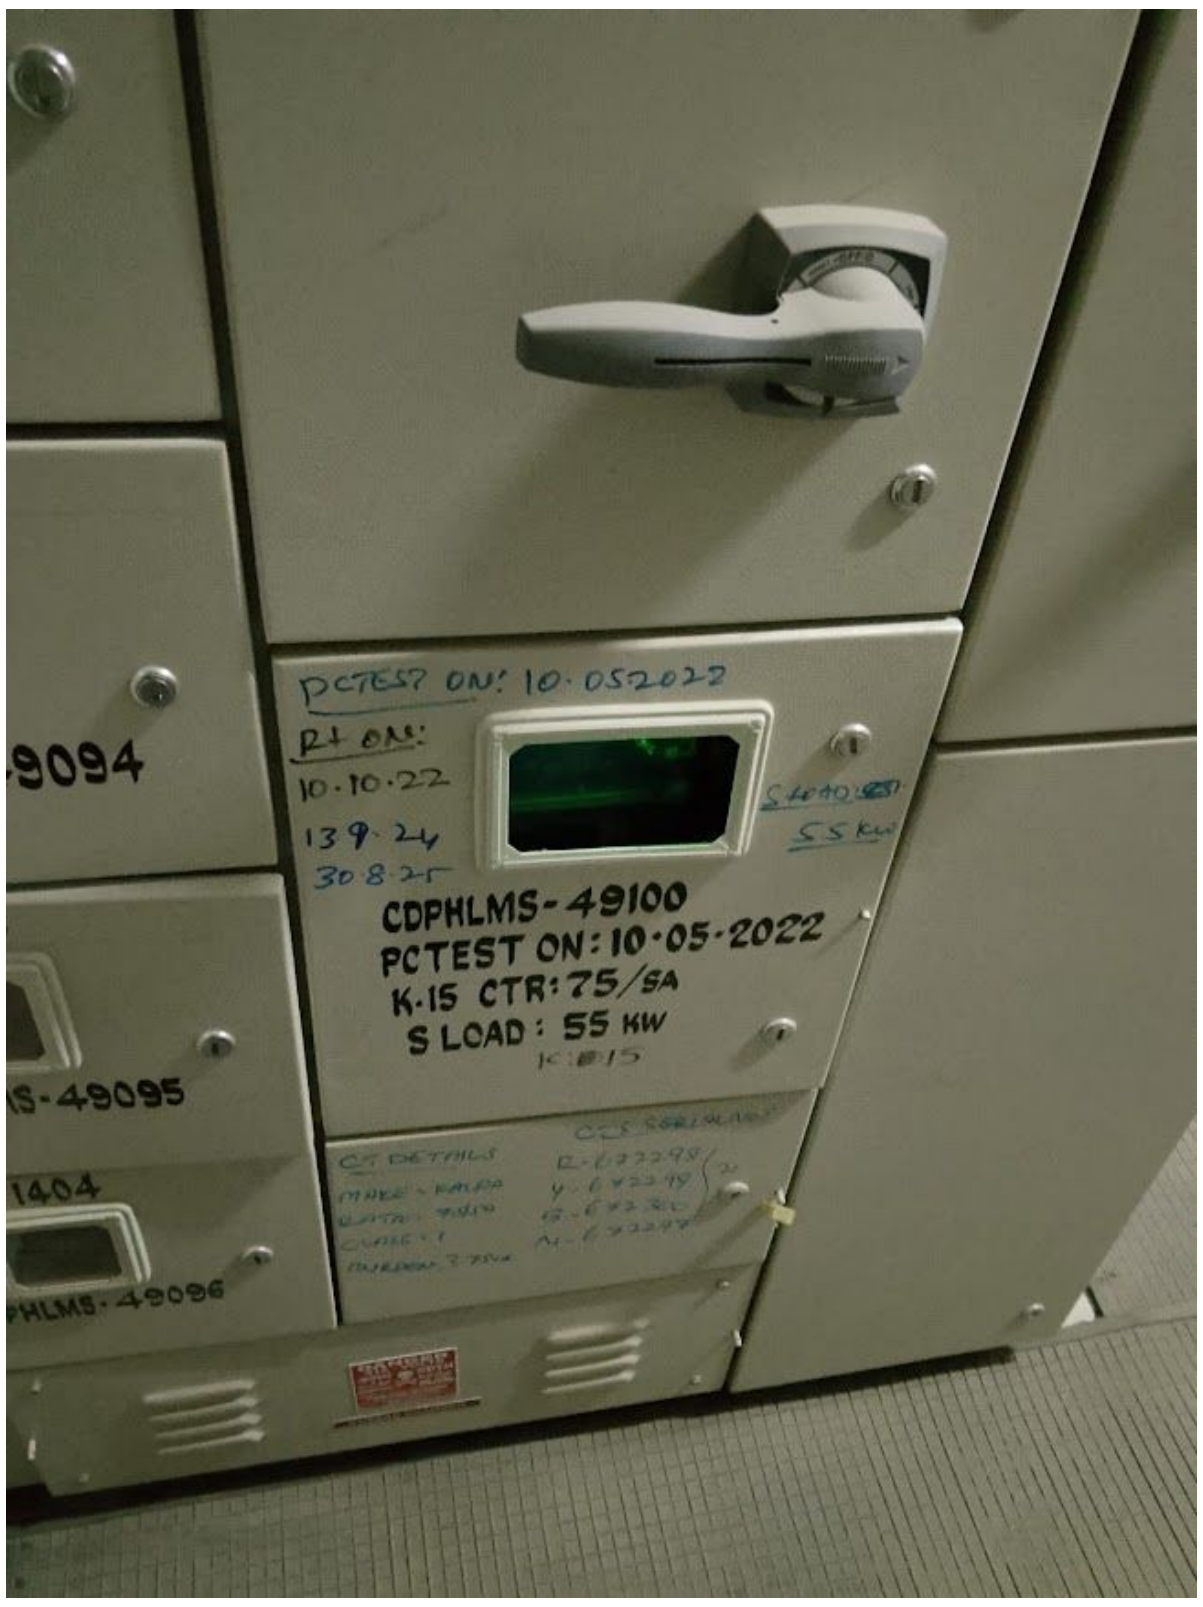

Meter was sealed

Material Storage

Site Layout - Top View

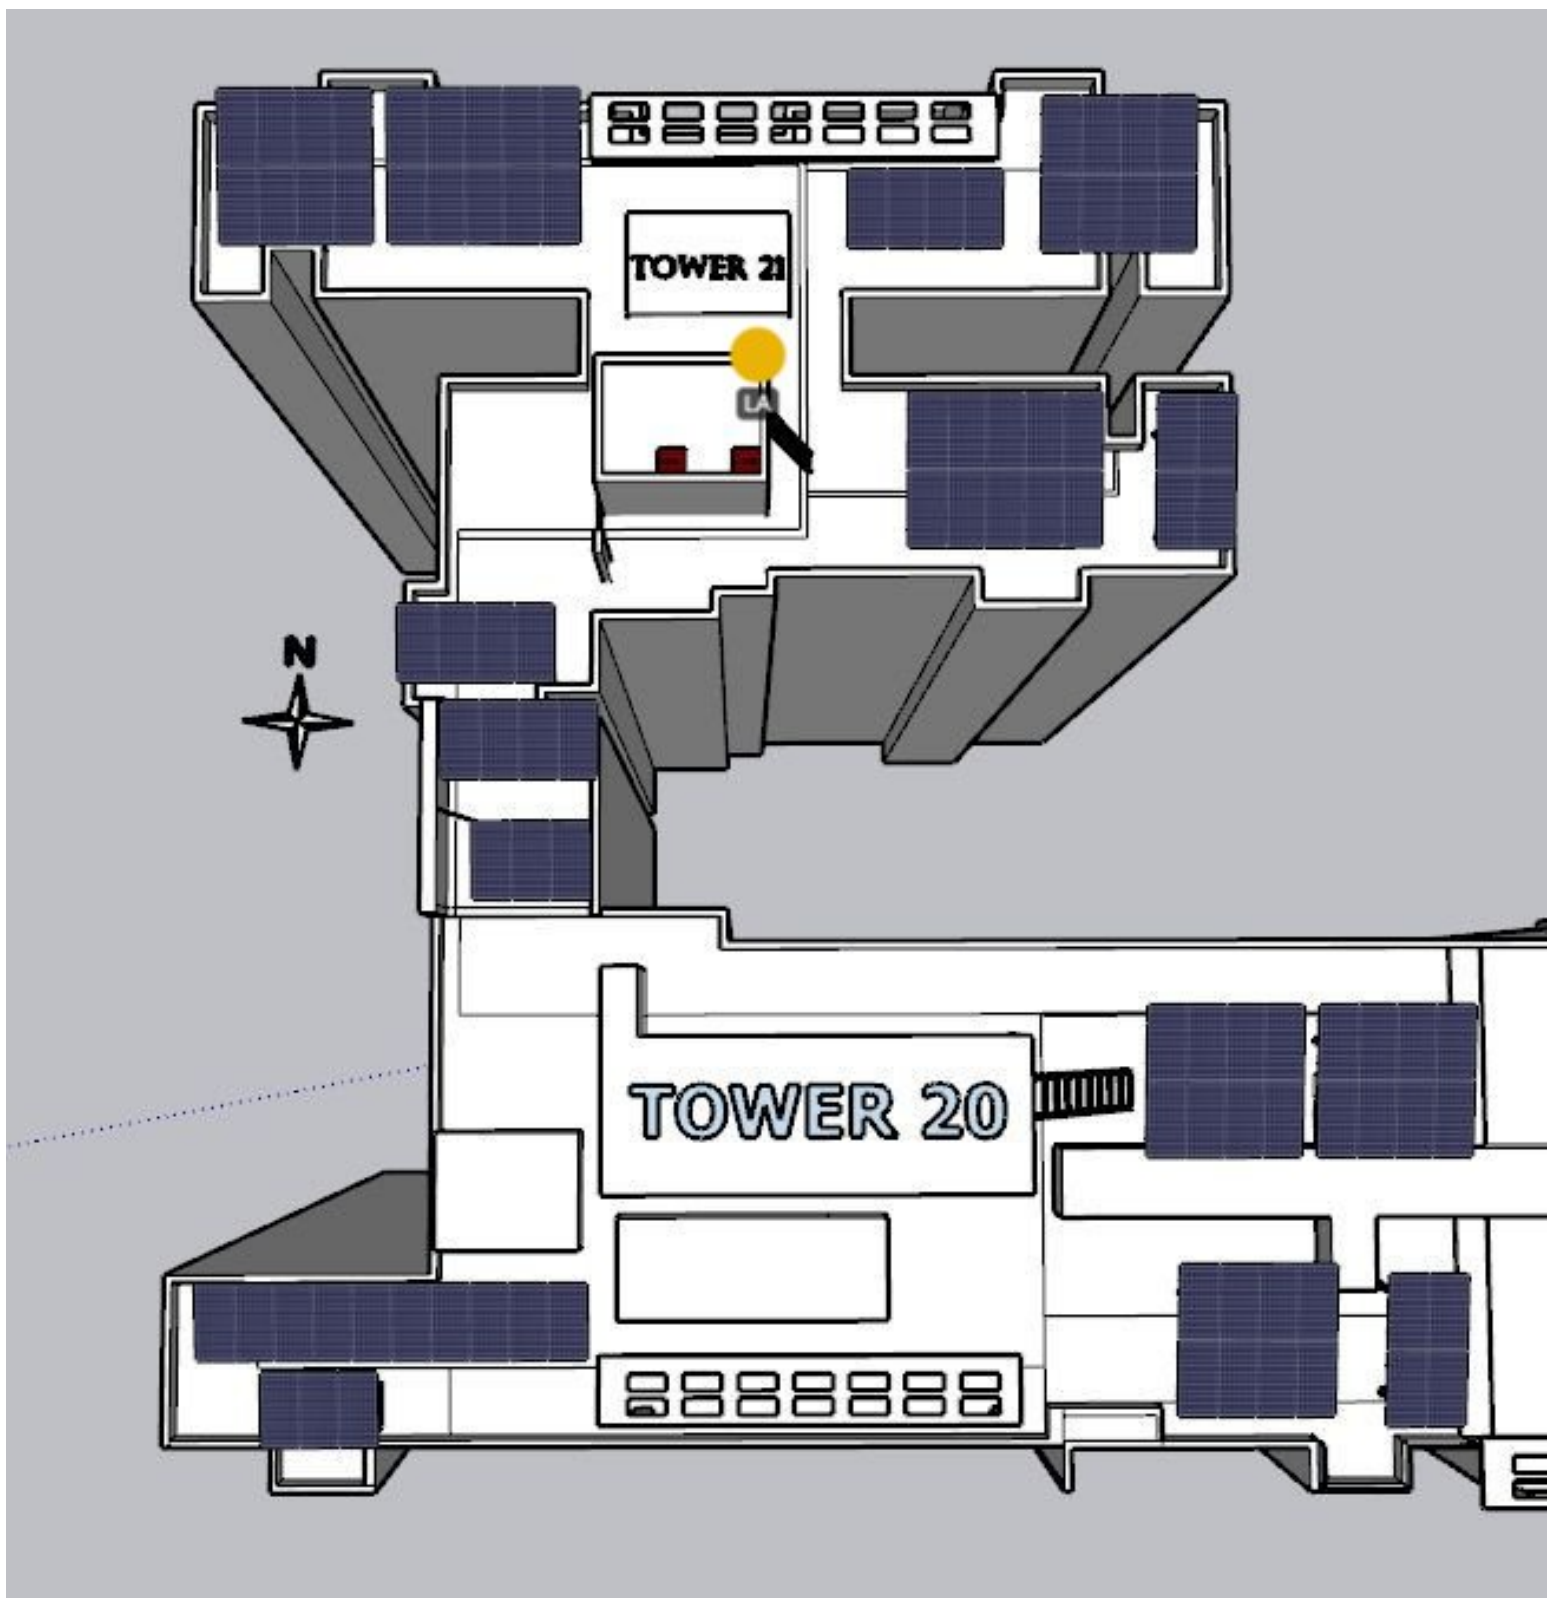

Top view

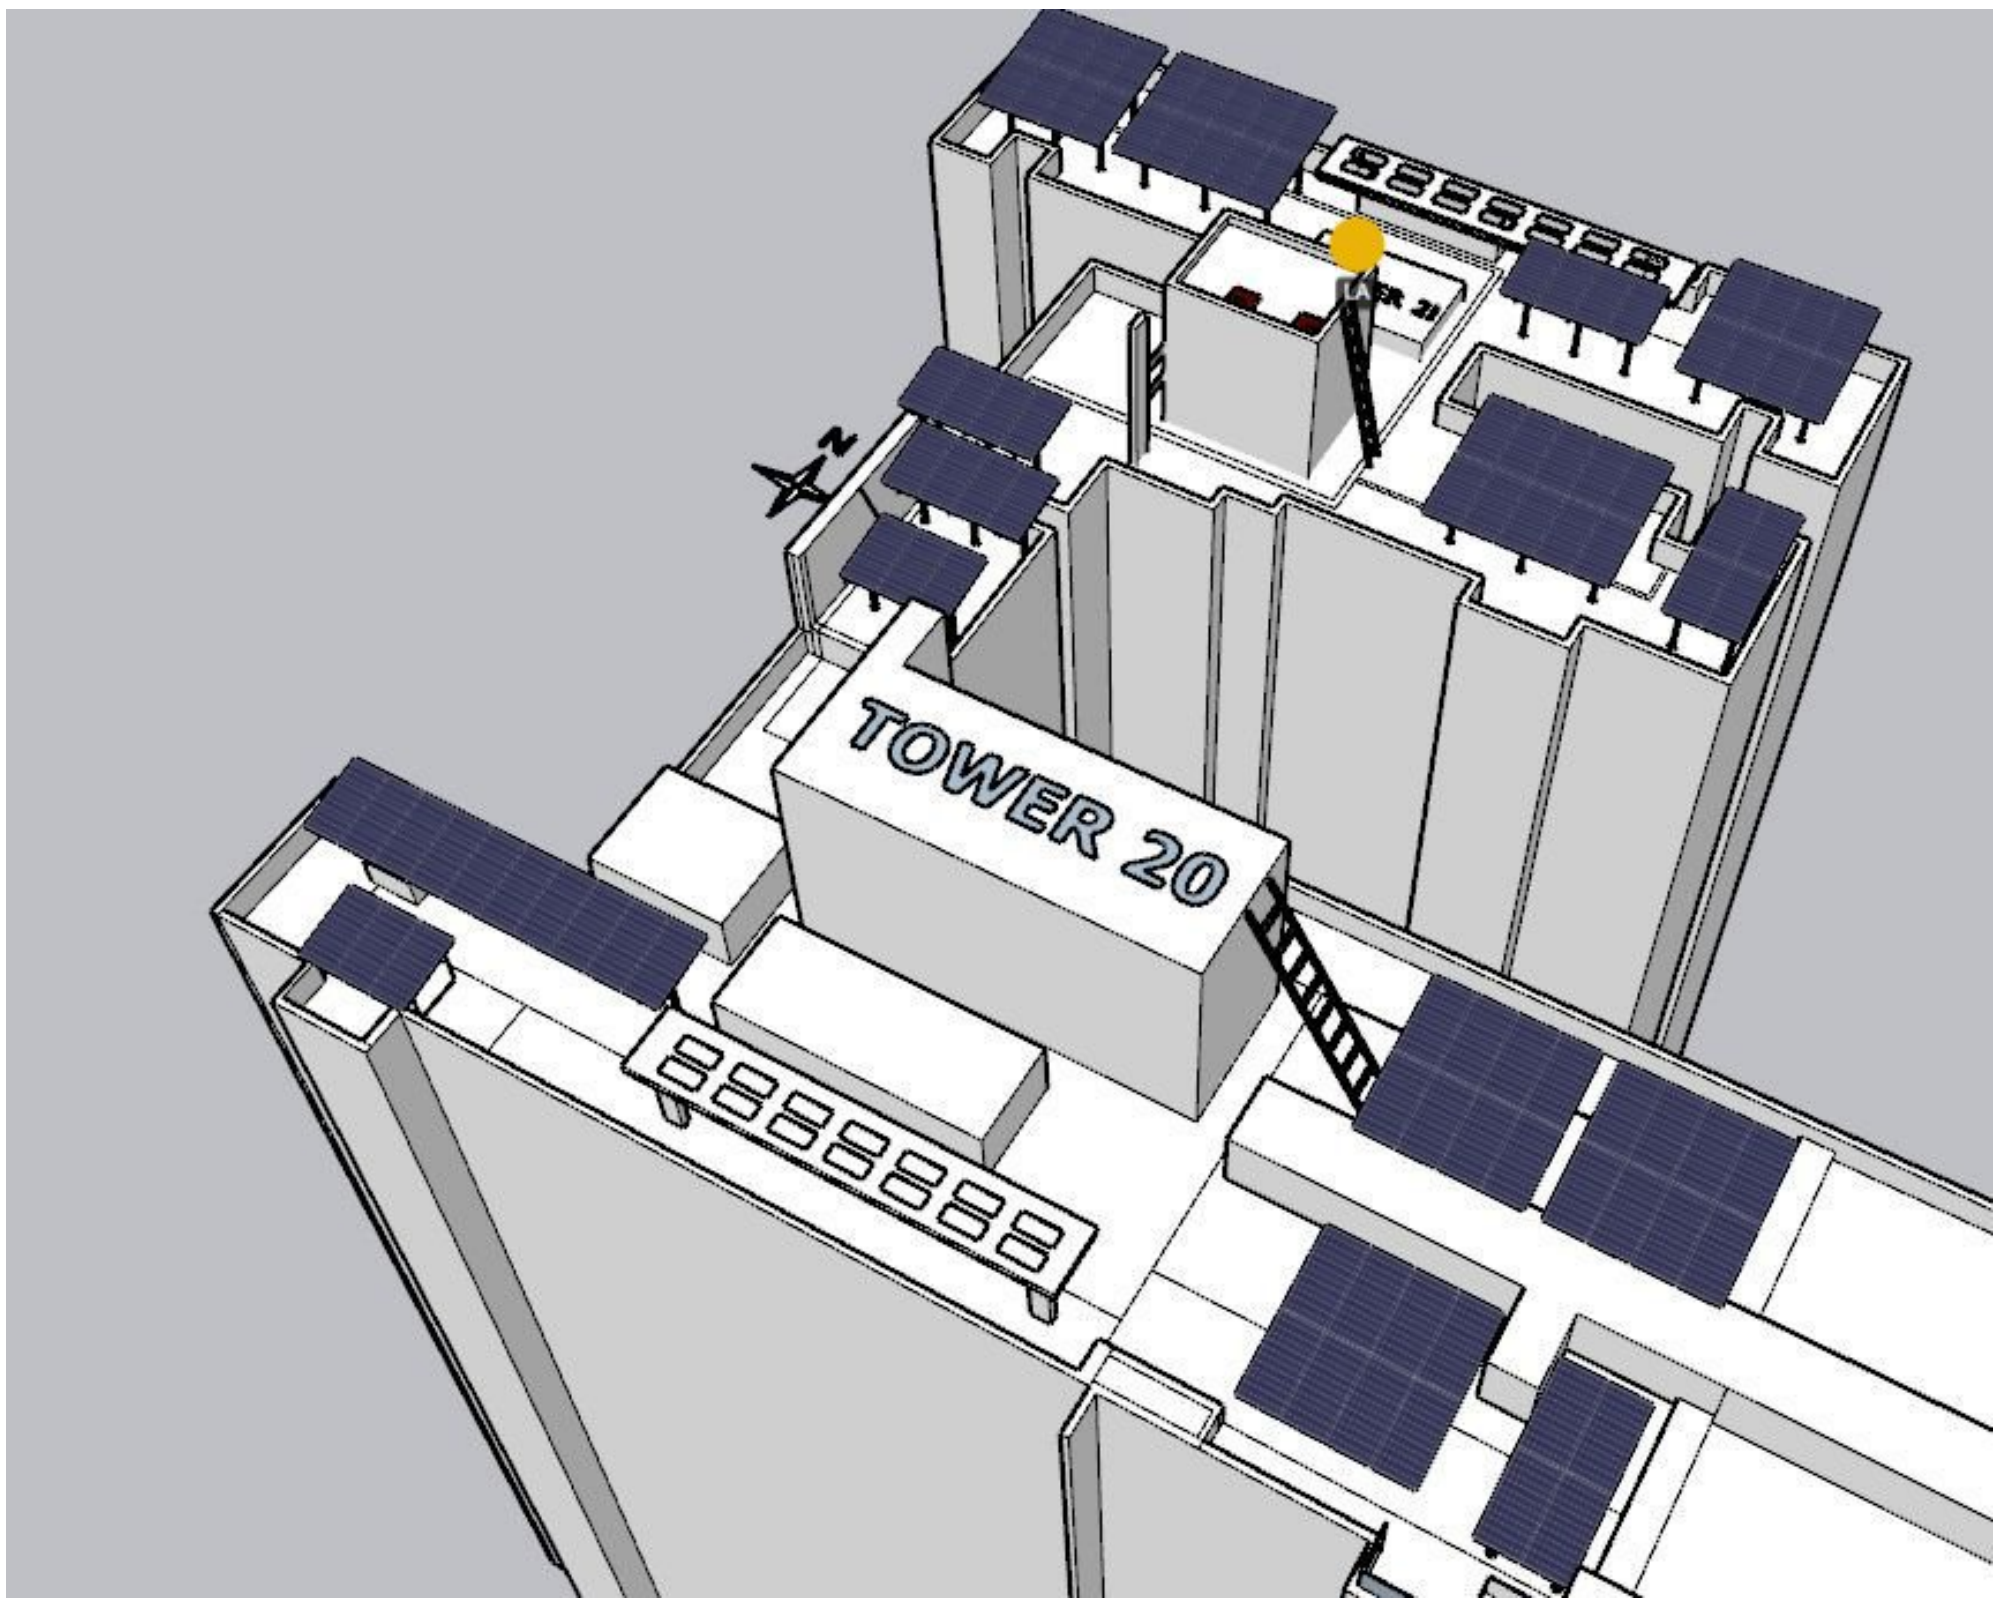

Side view (1)

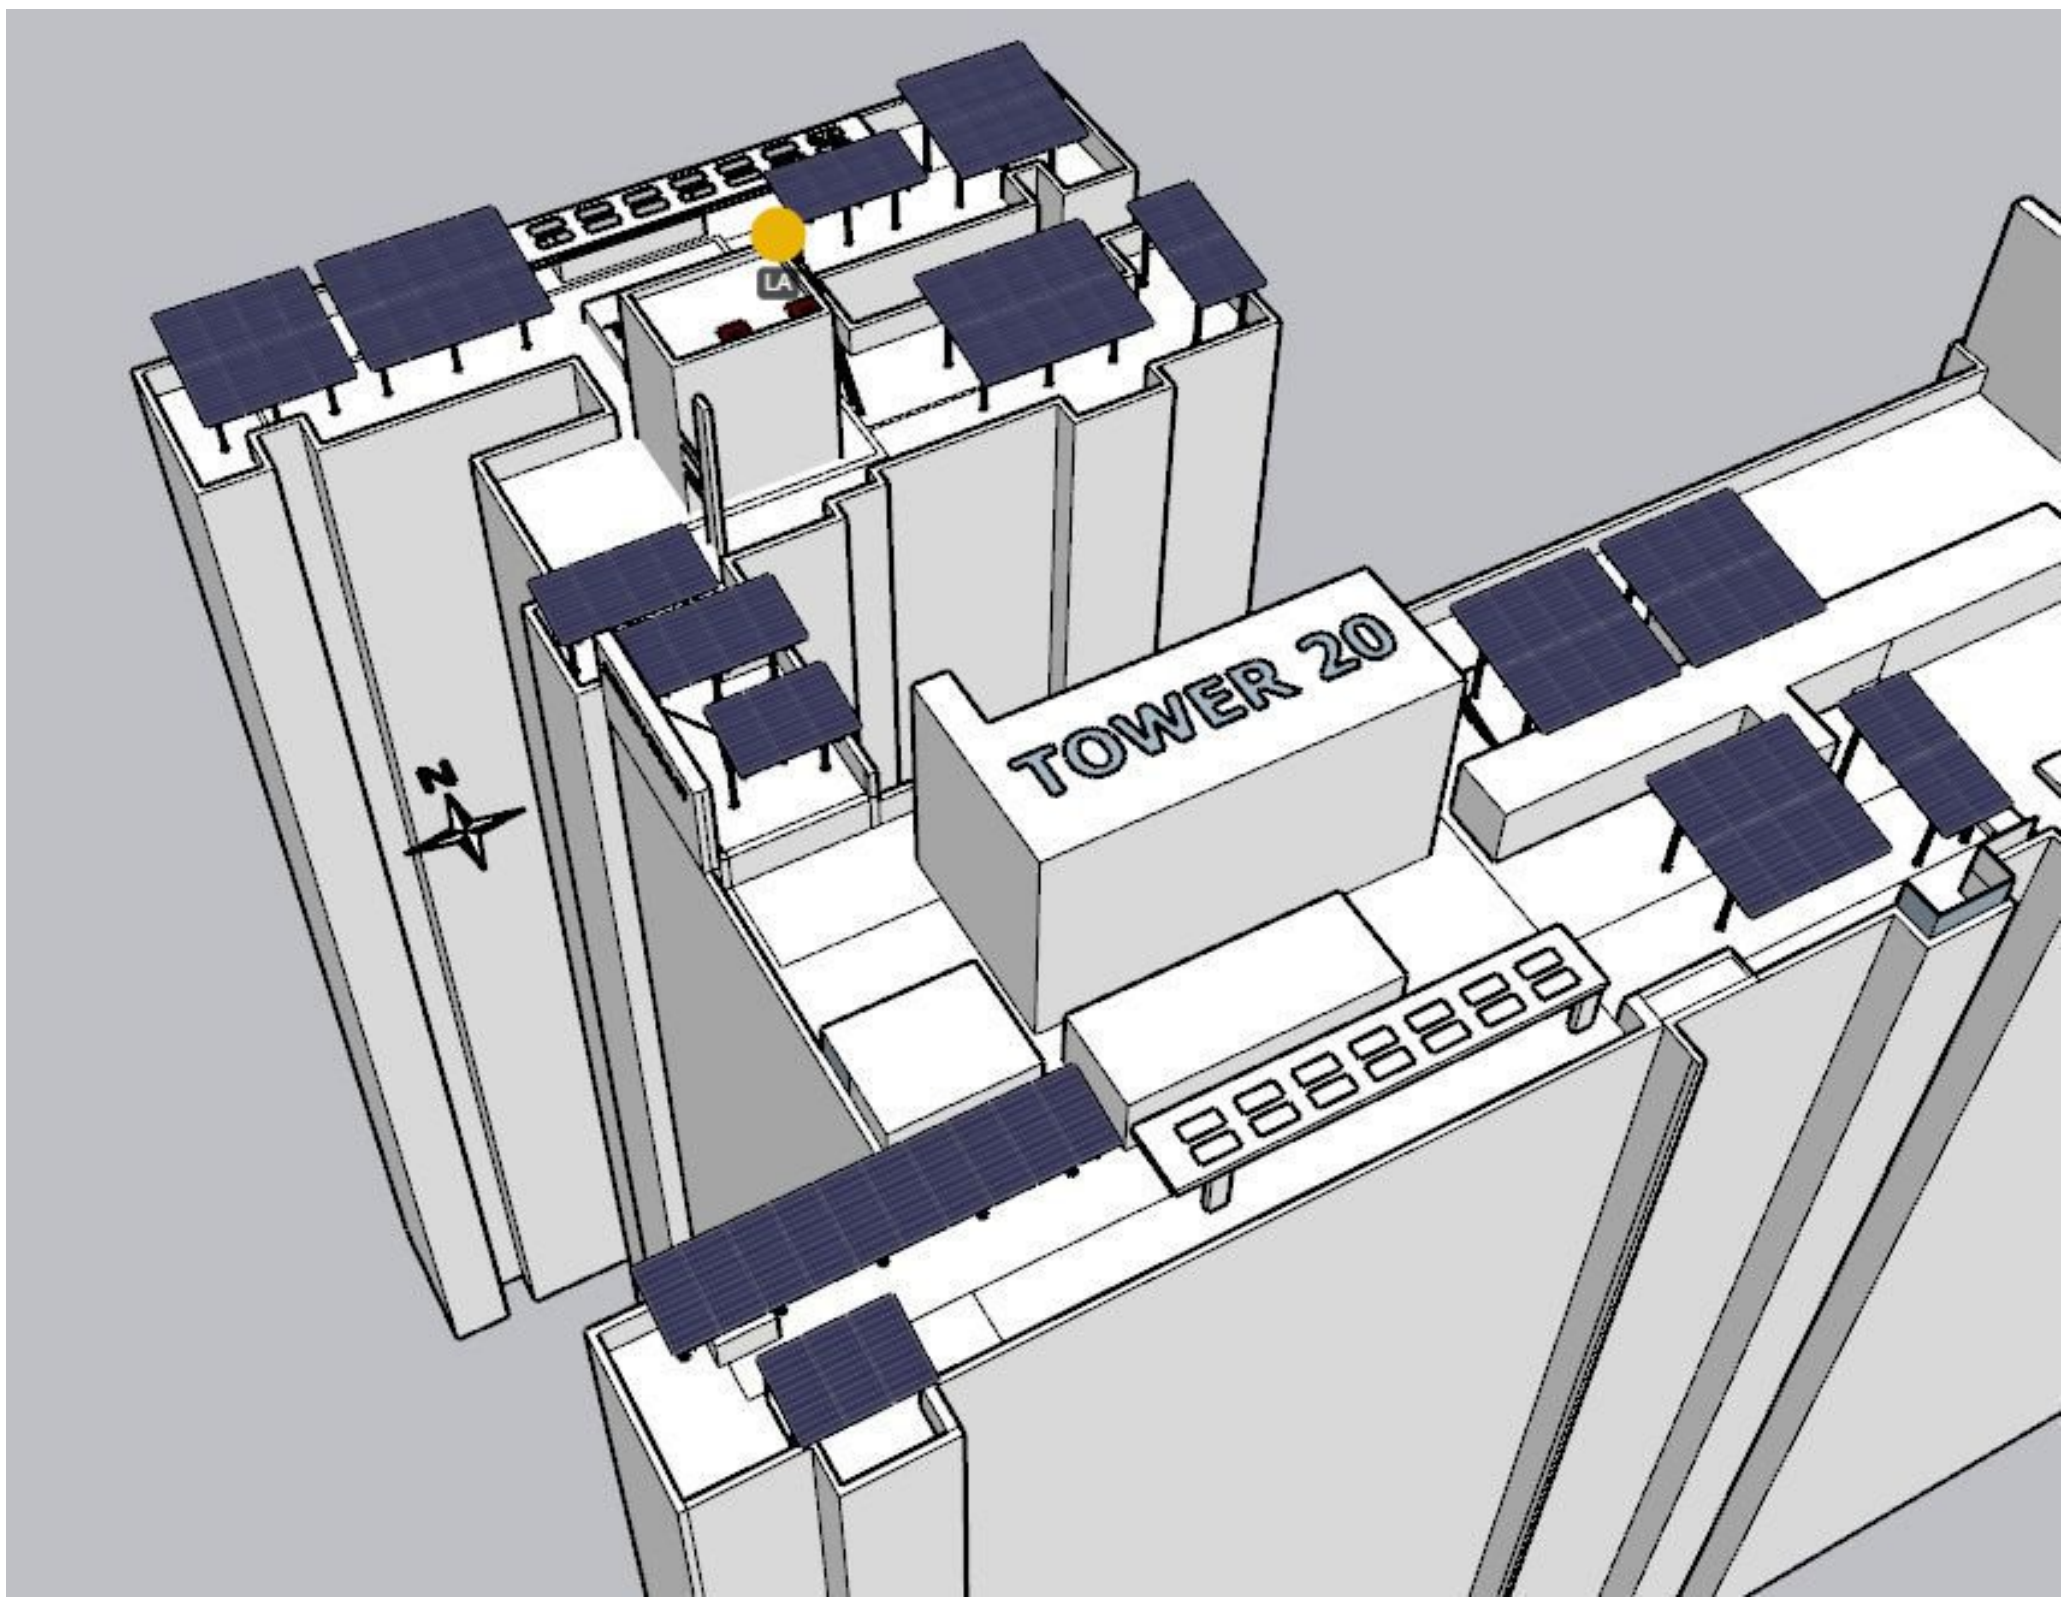

Side view (2)

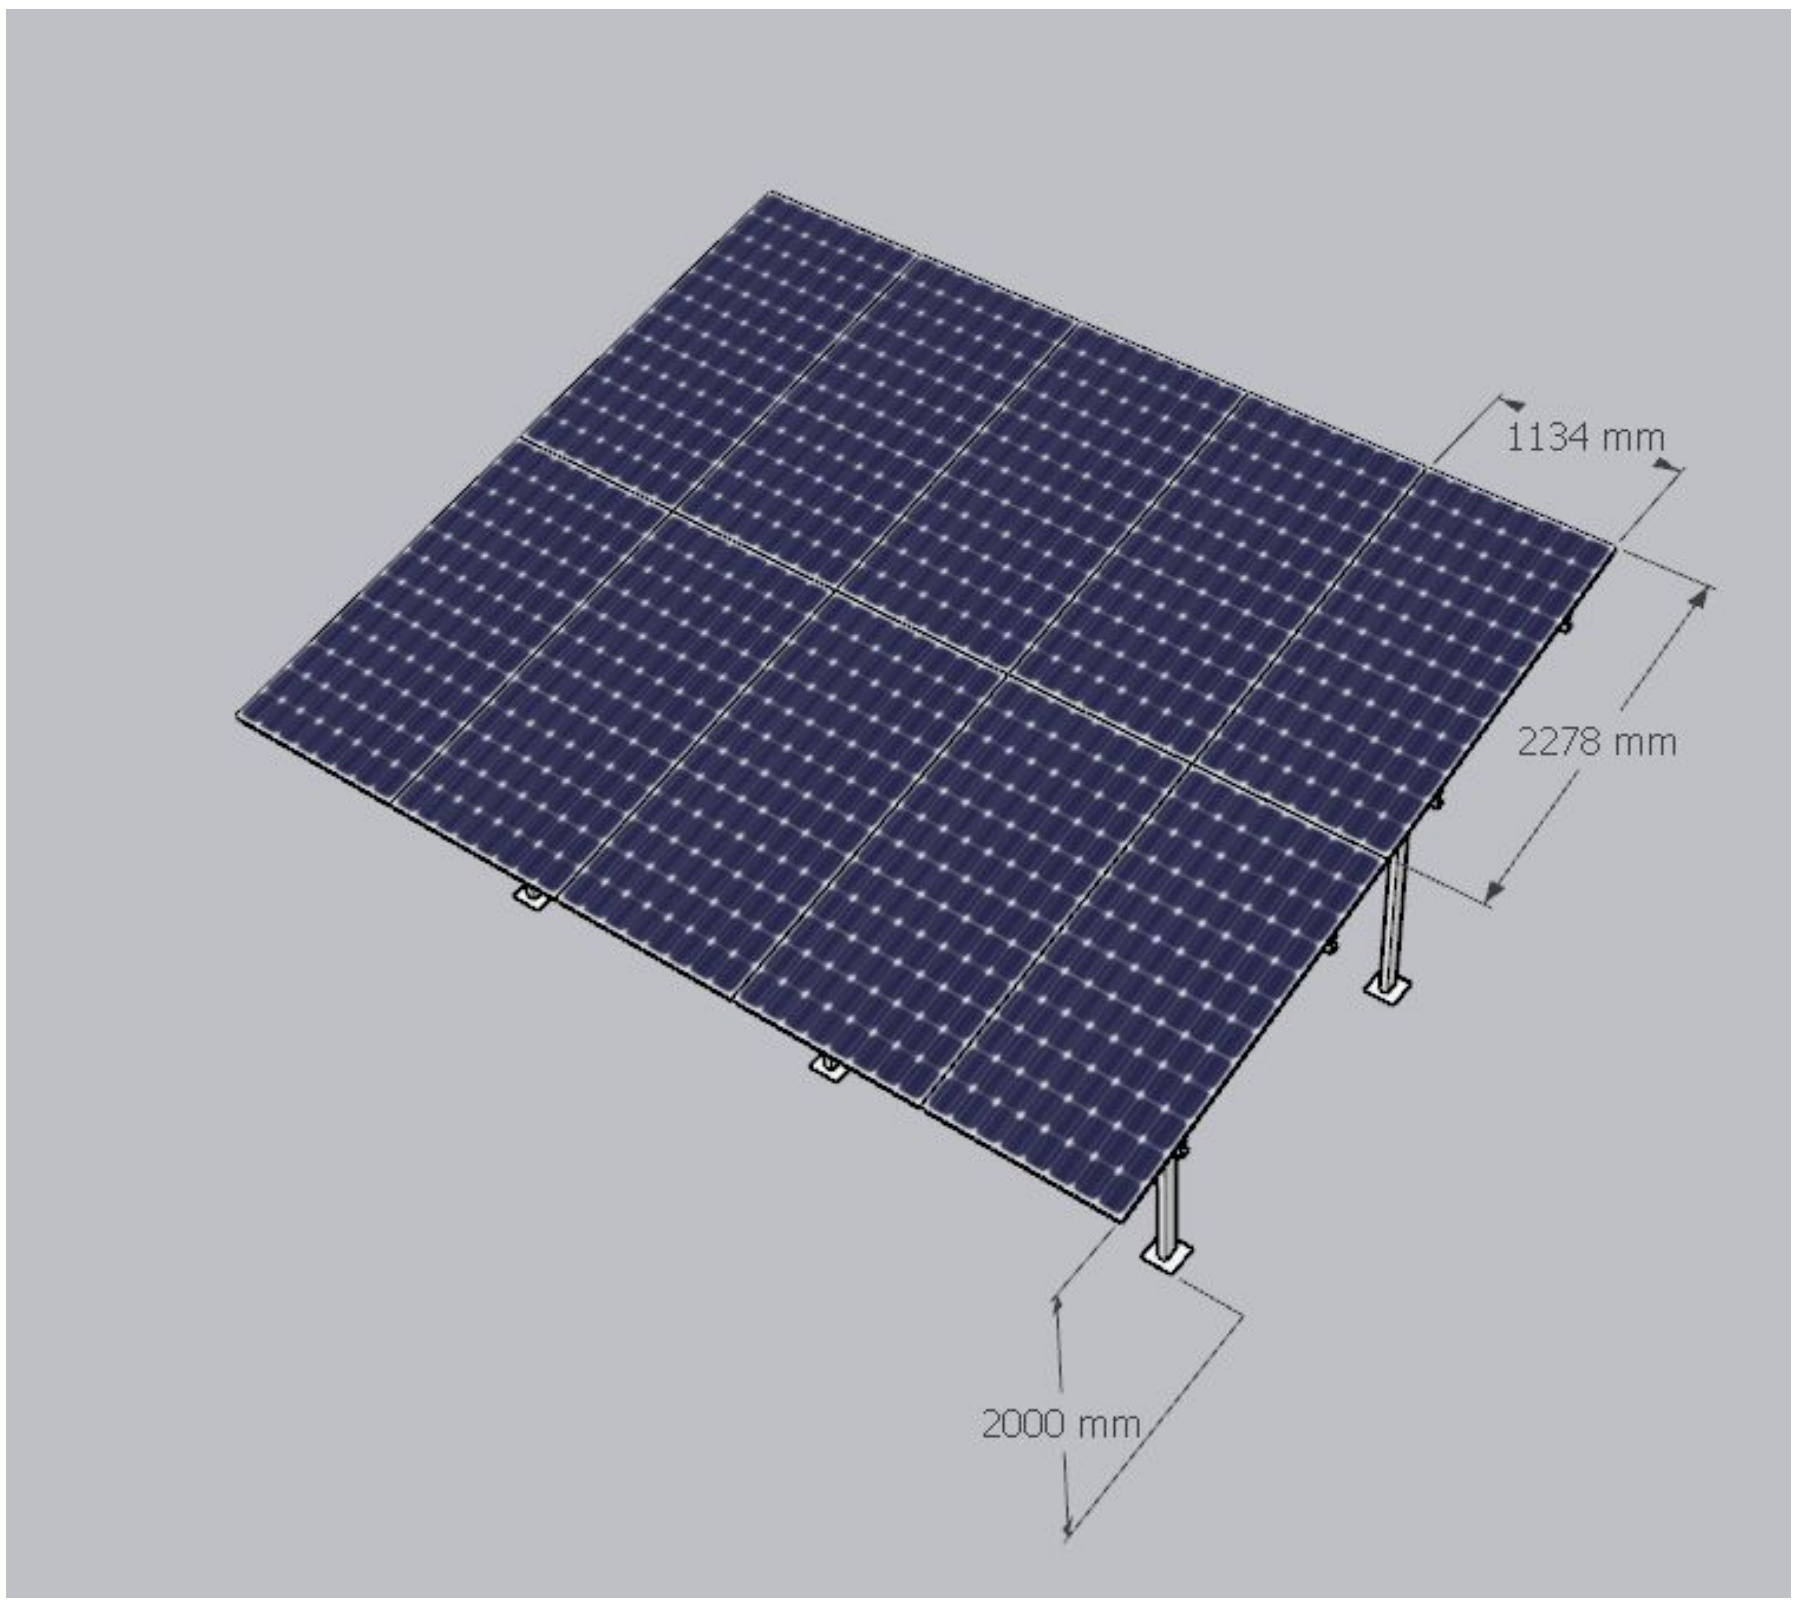

HDGI Structure (2P5 X 2 set of panels of Waaree DCR bifacial 580 Wp)

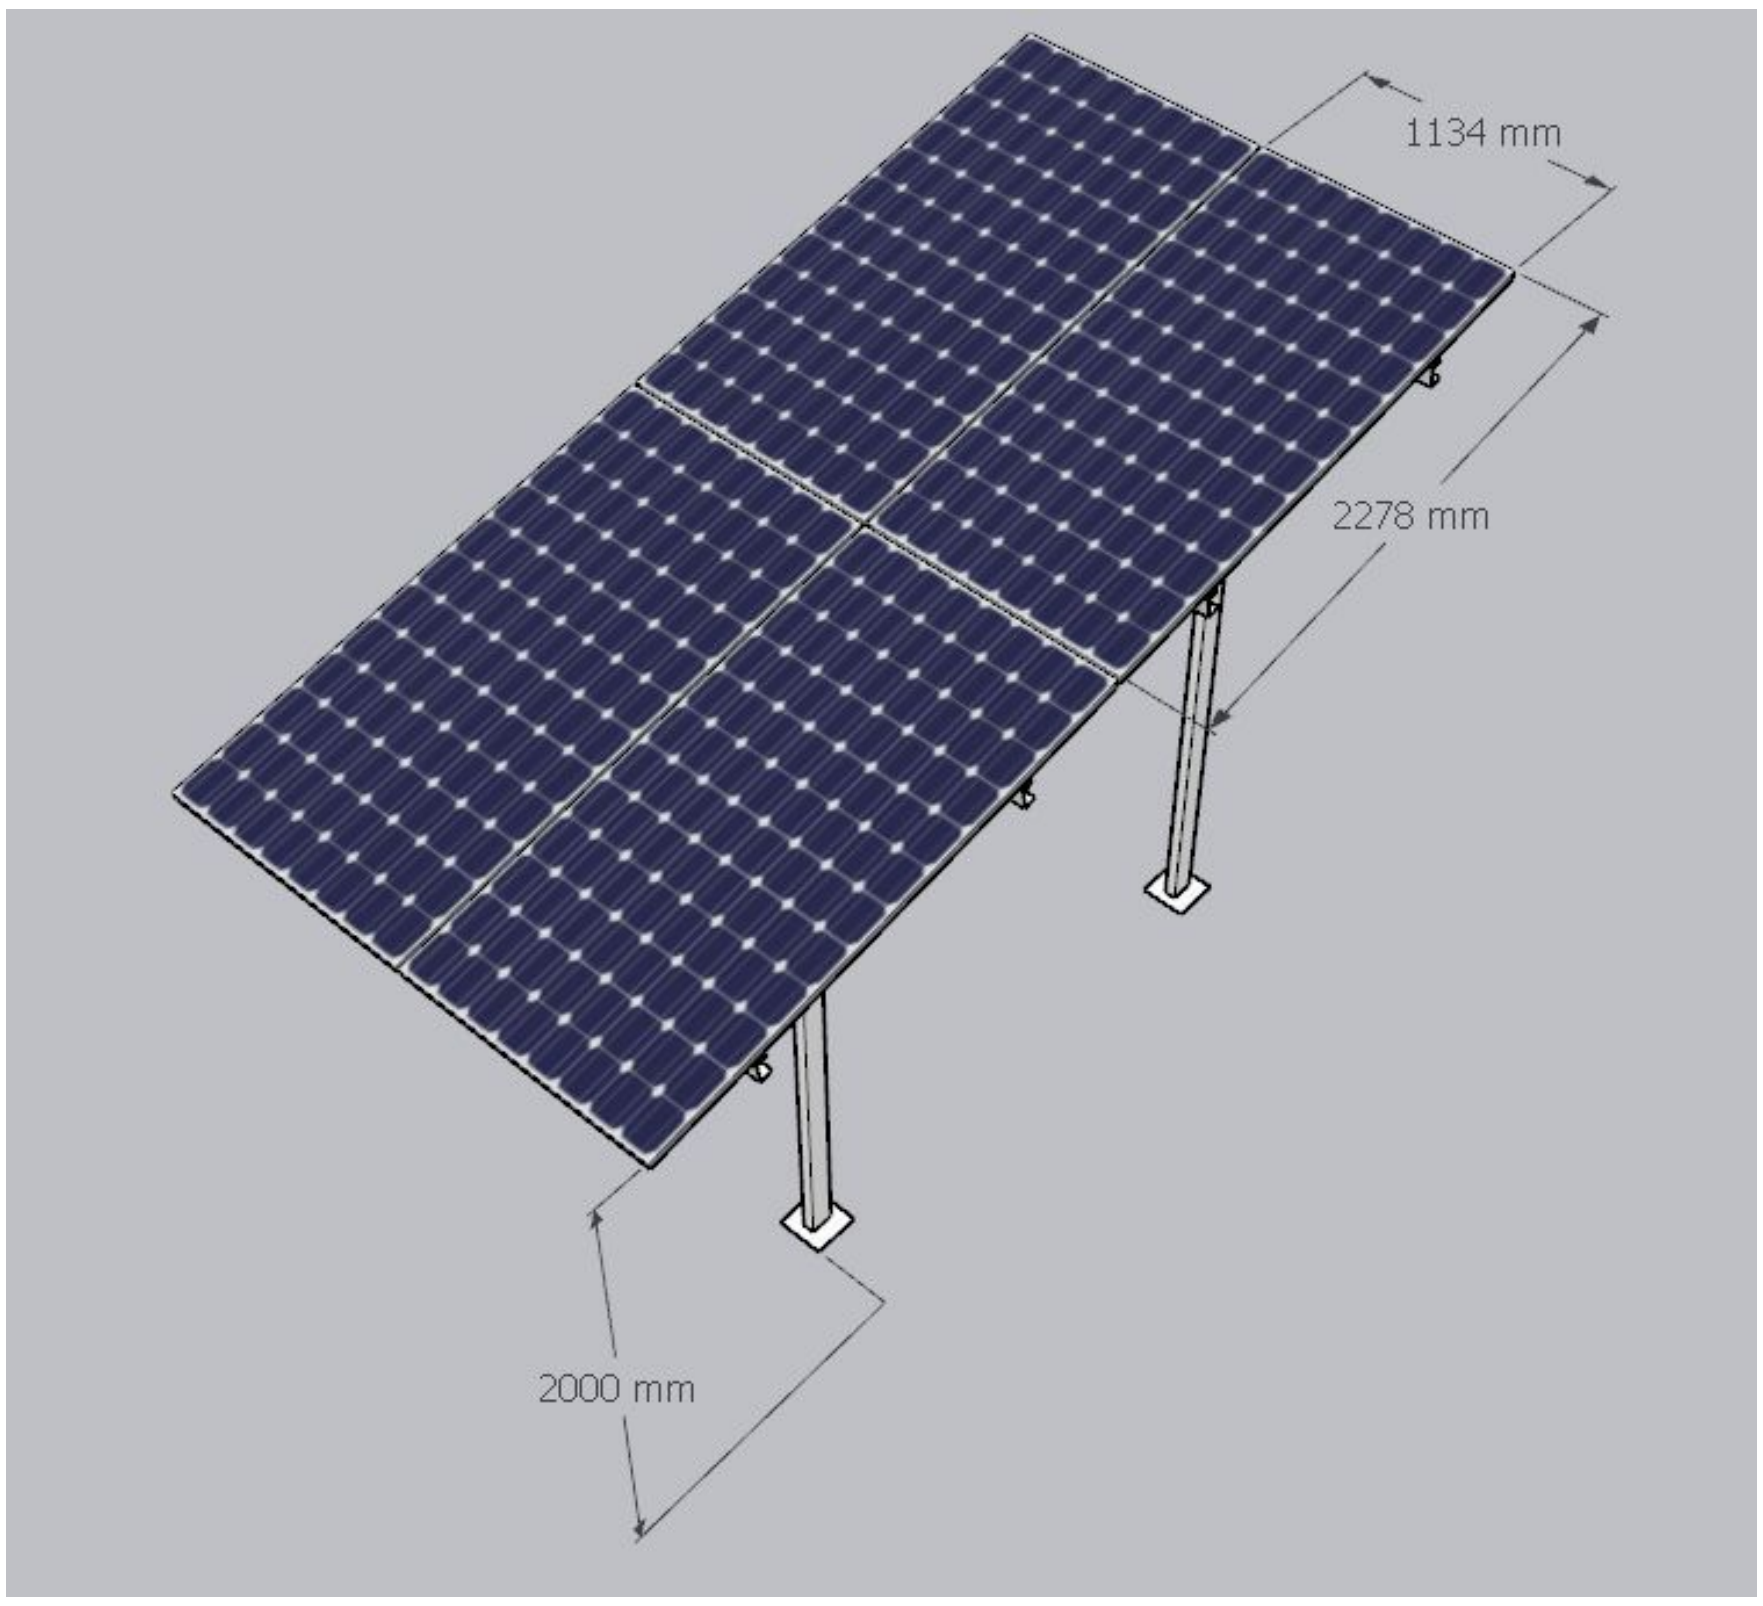

HDGI Structure (2P2 X 2 set of panels of Waaree DCR bifacial 580 Wp)

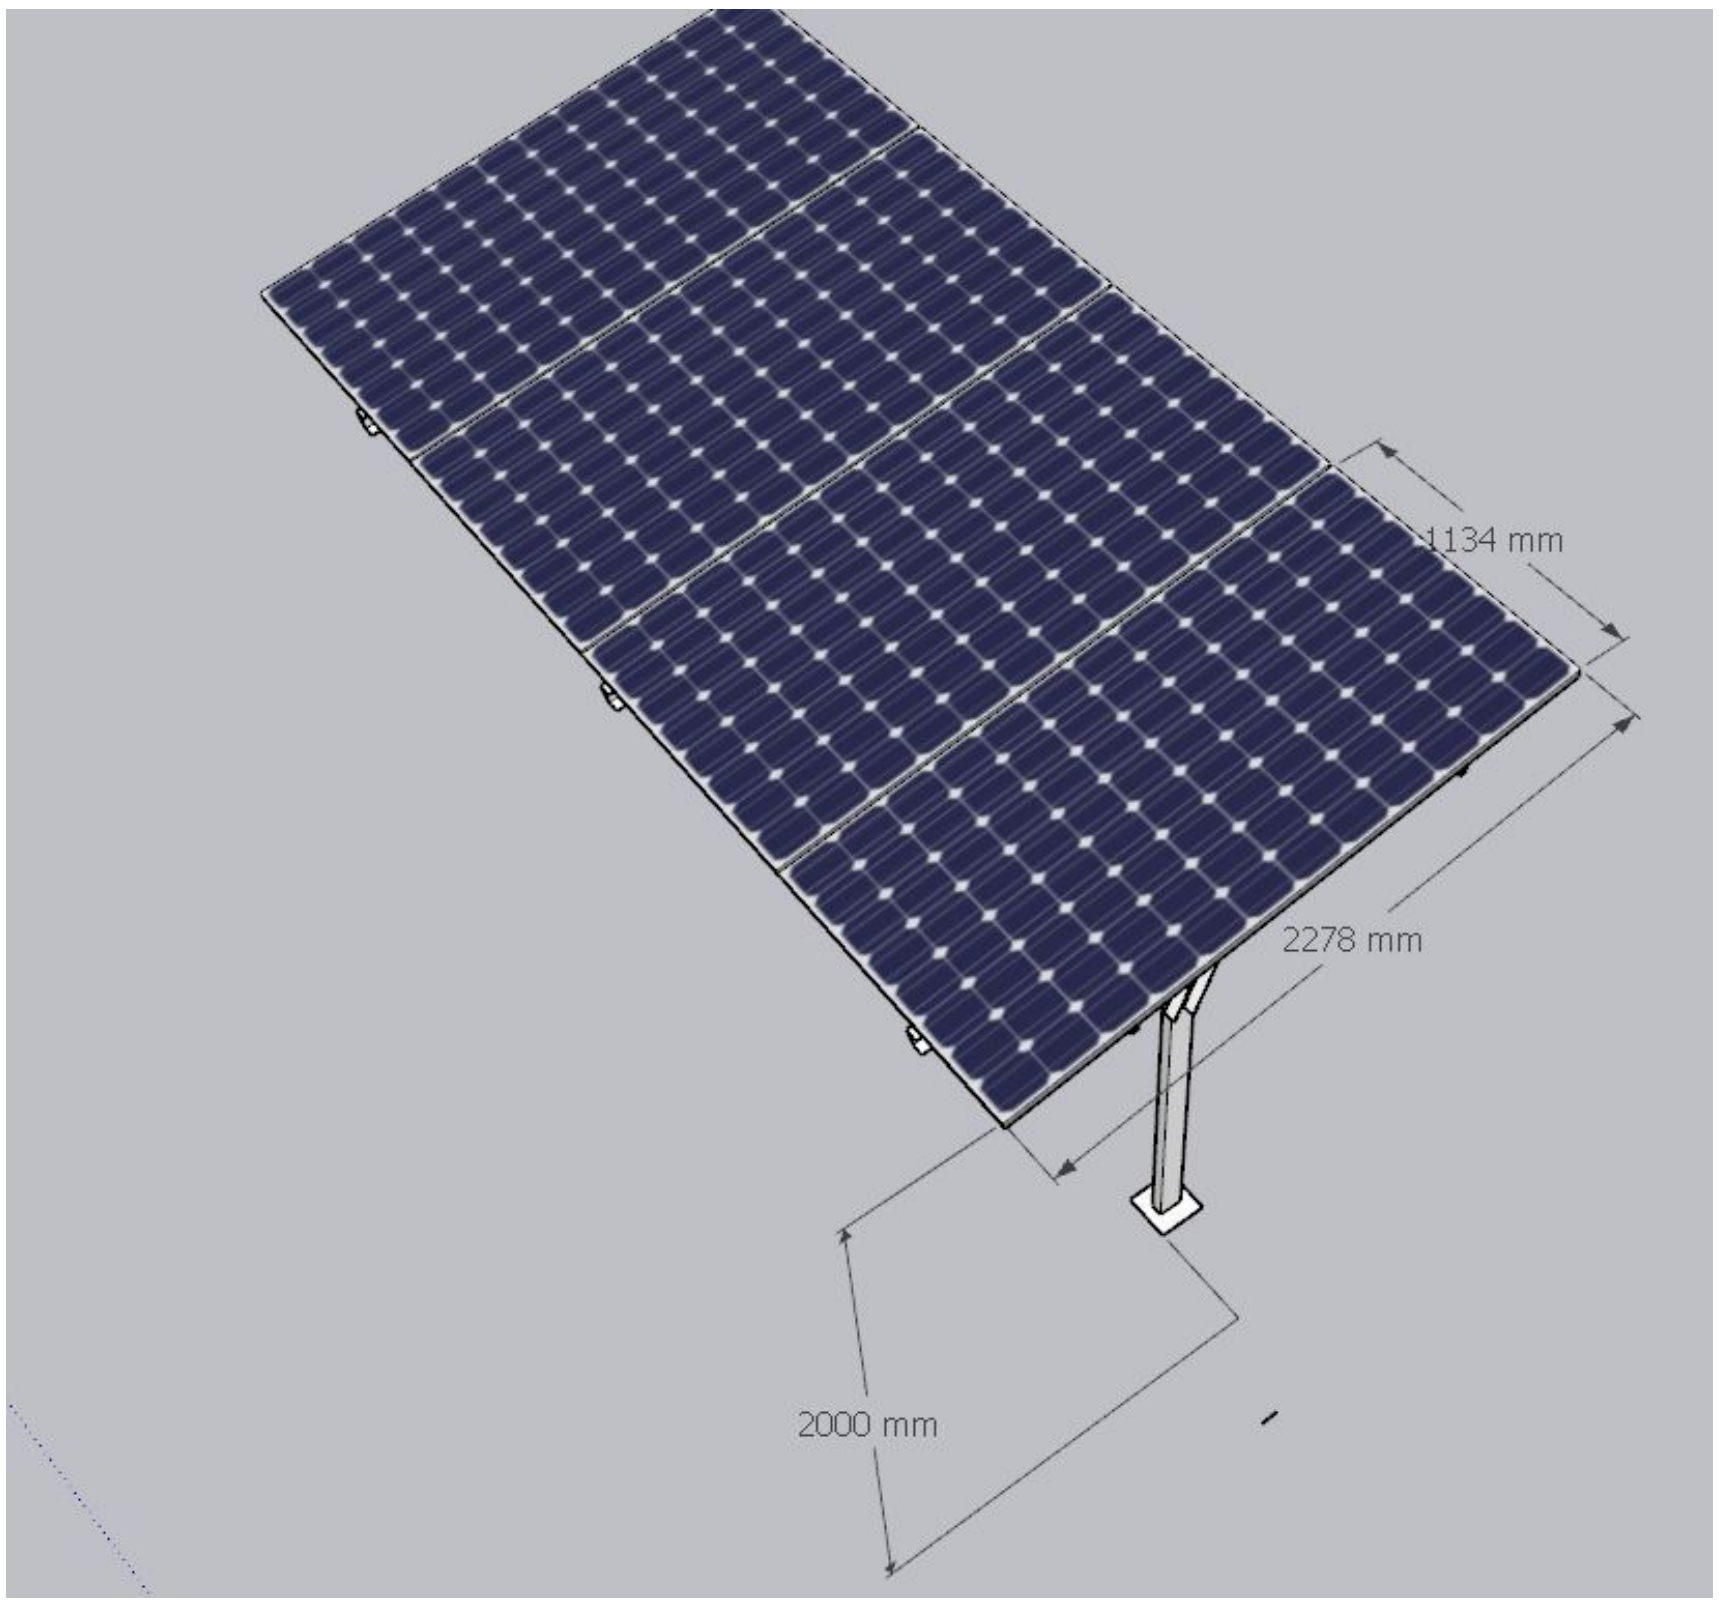

HDGI Structure (1P4 X 1 set of panels of Waaree DCR bifacial 580 Wp)

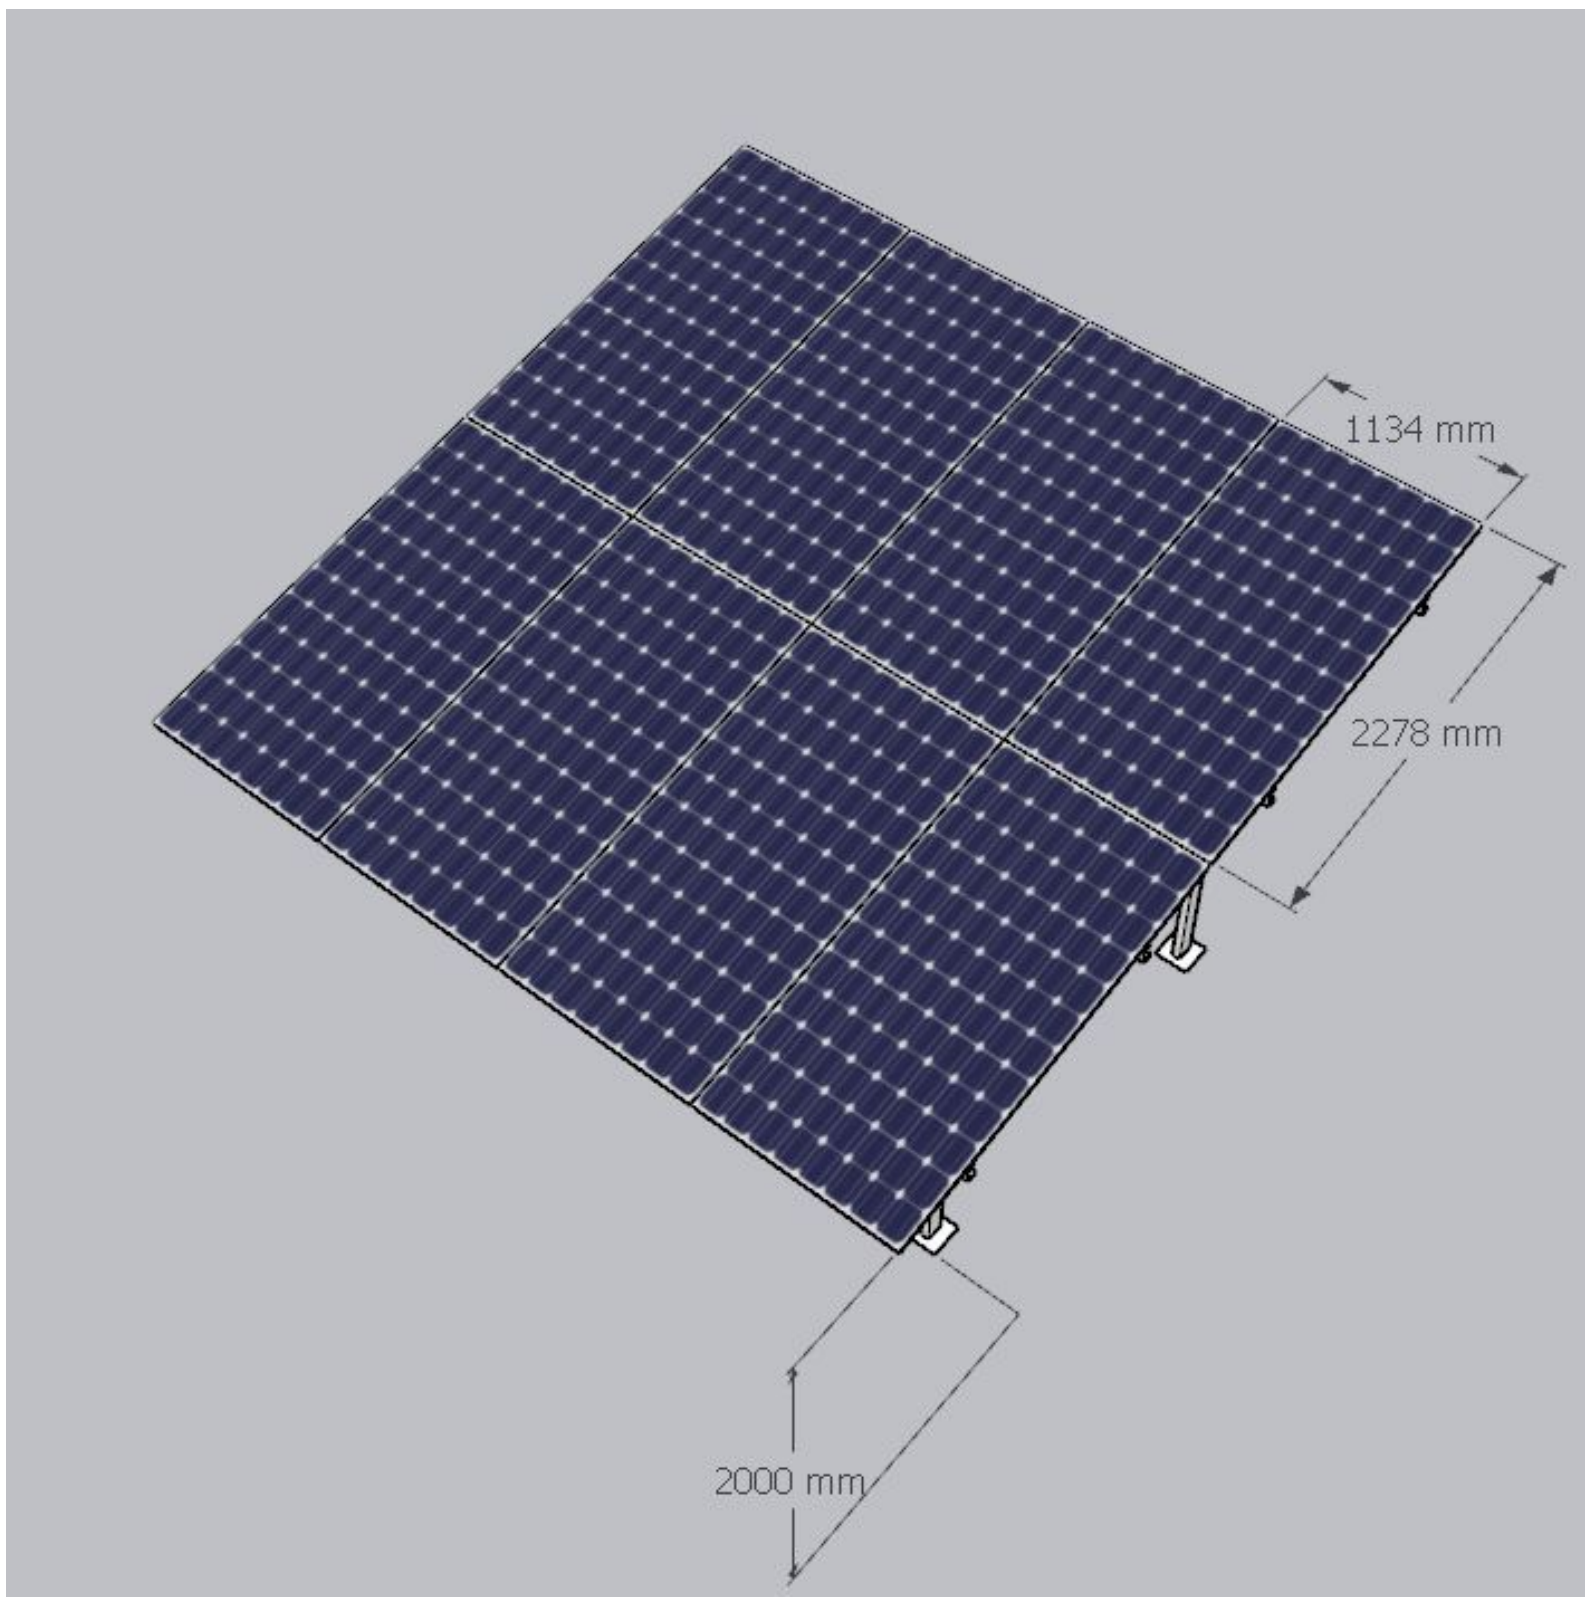

HDGI Structure (2P4 X 5 set of panels of Waaree DCR bifacial 580 Wp)

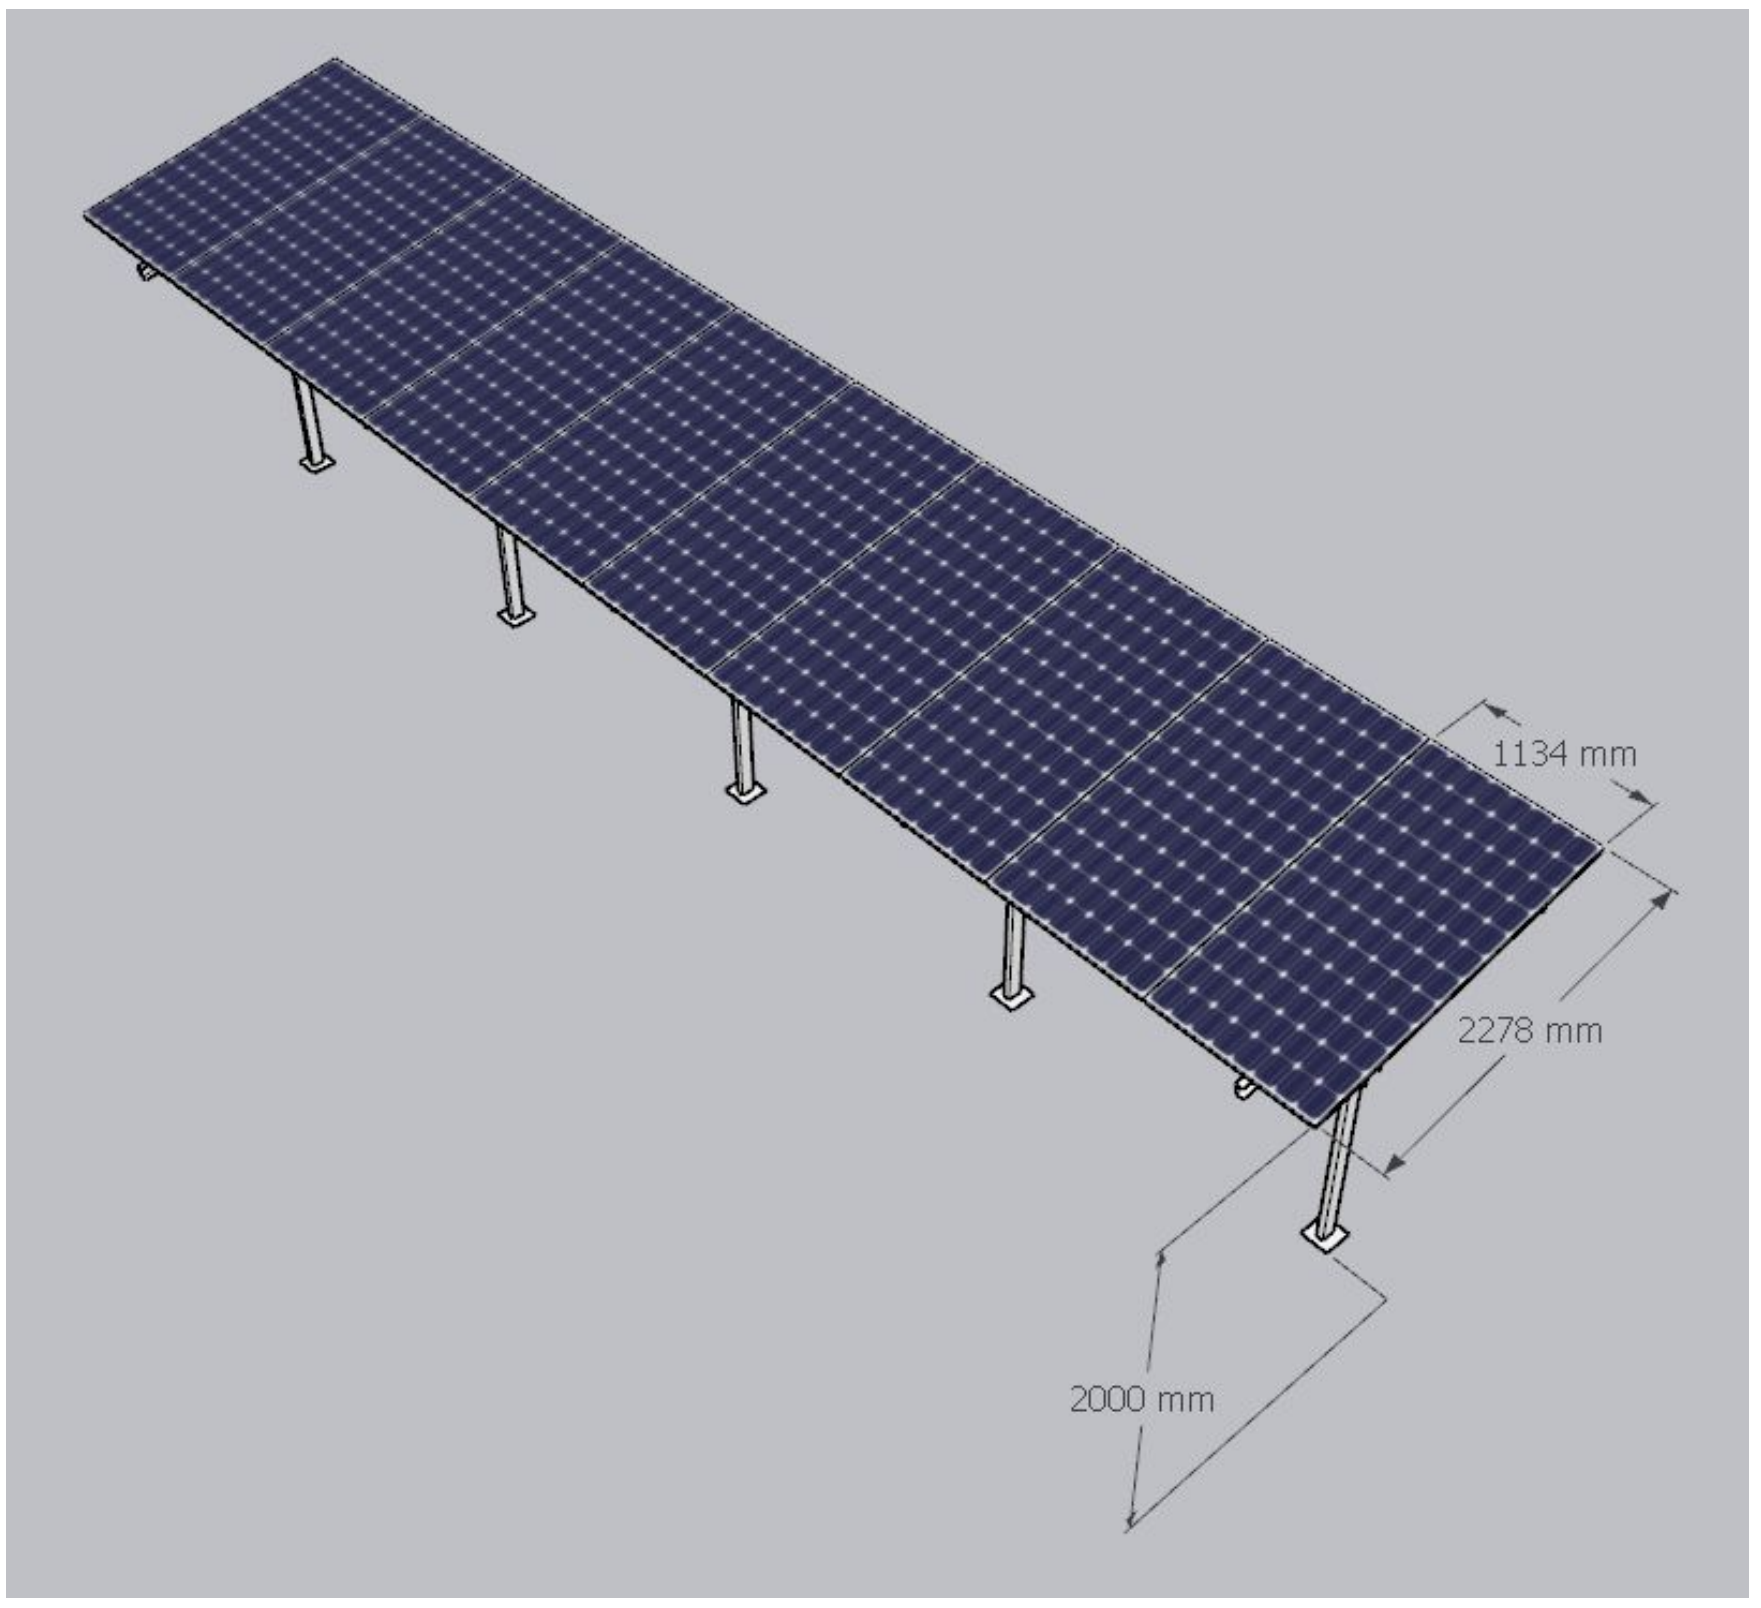

HDGI Structure (1P10 X 1 set of panels of Waaree DCR bifacial 580 Wp)

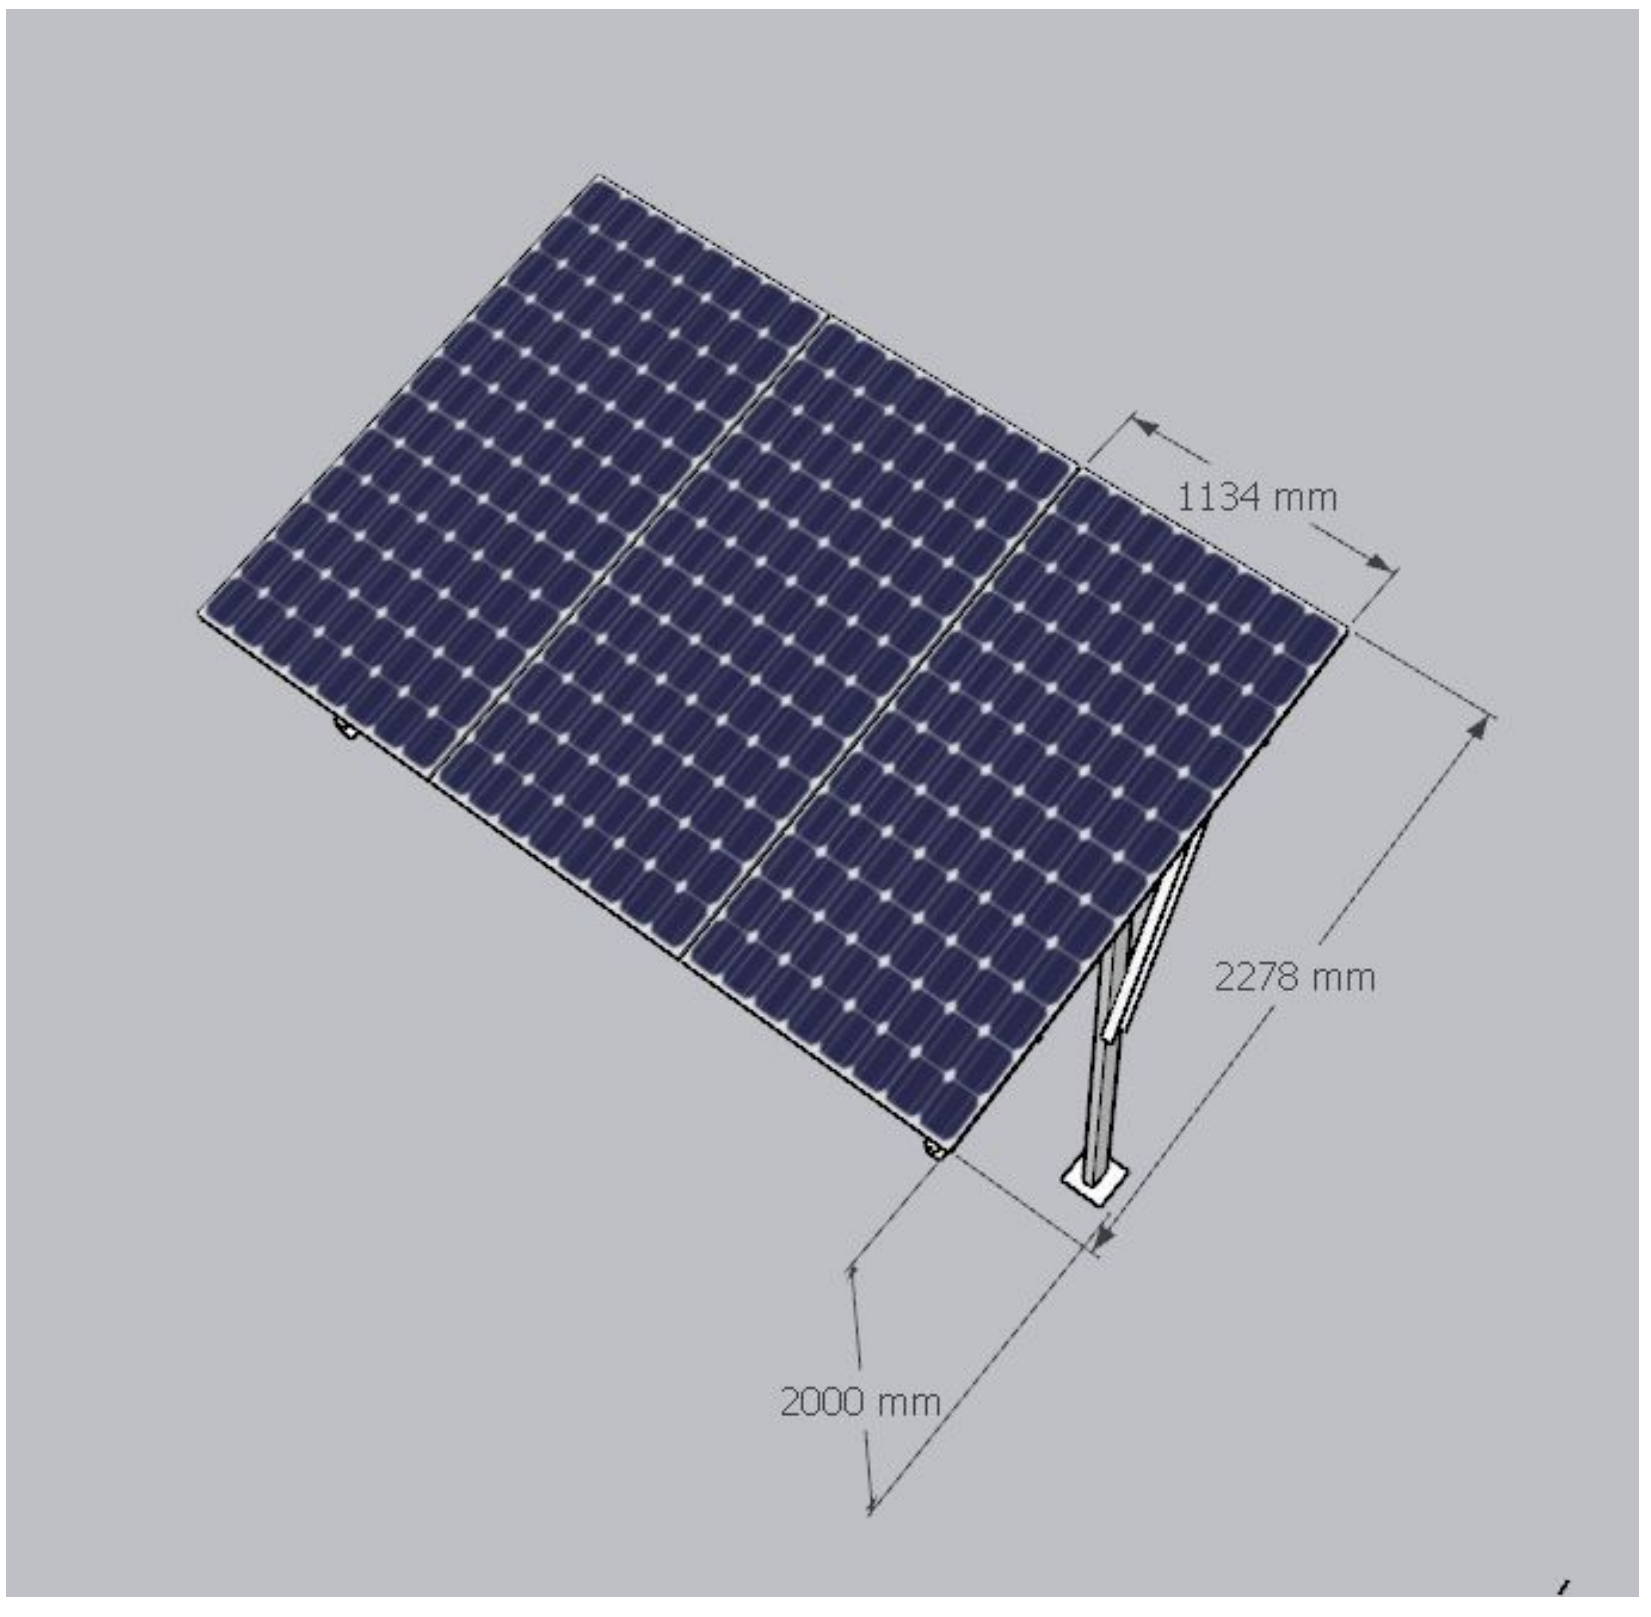

HDGI Structure (1P3 X 1 set of panels of Waaree DCR bifacial 580 Wp)

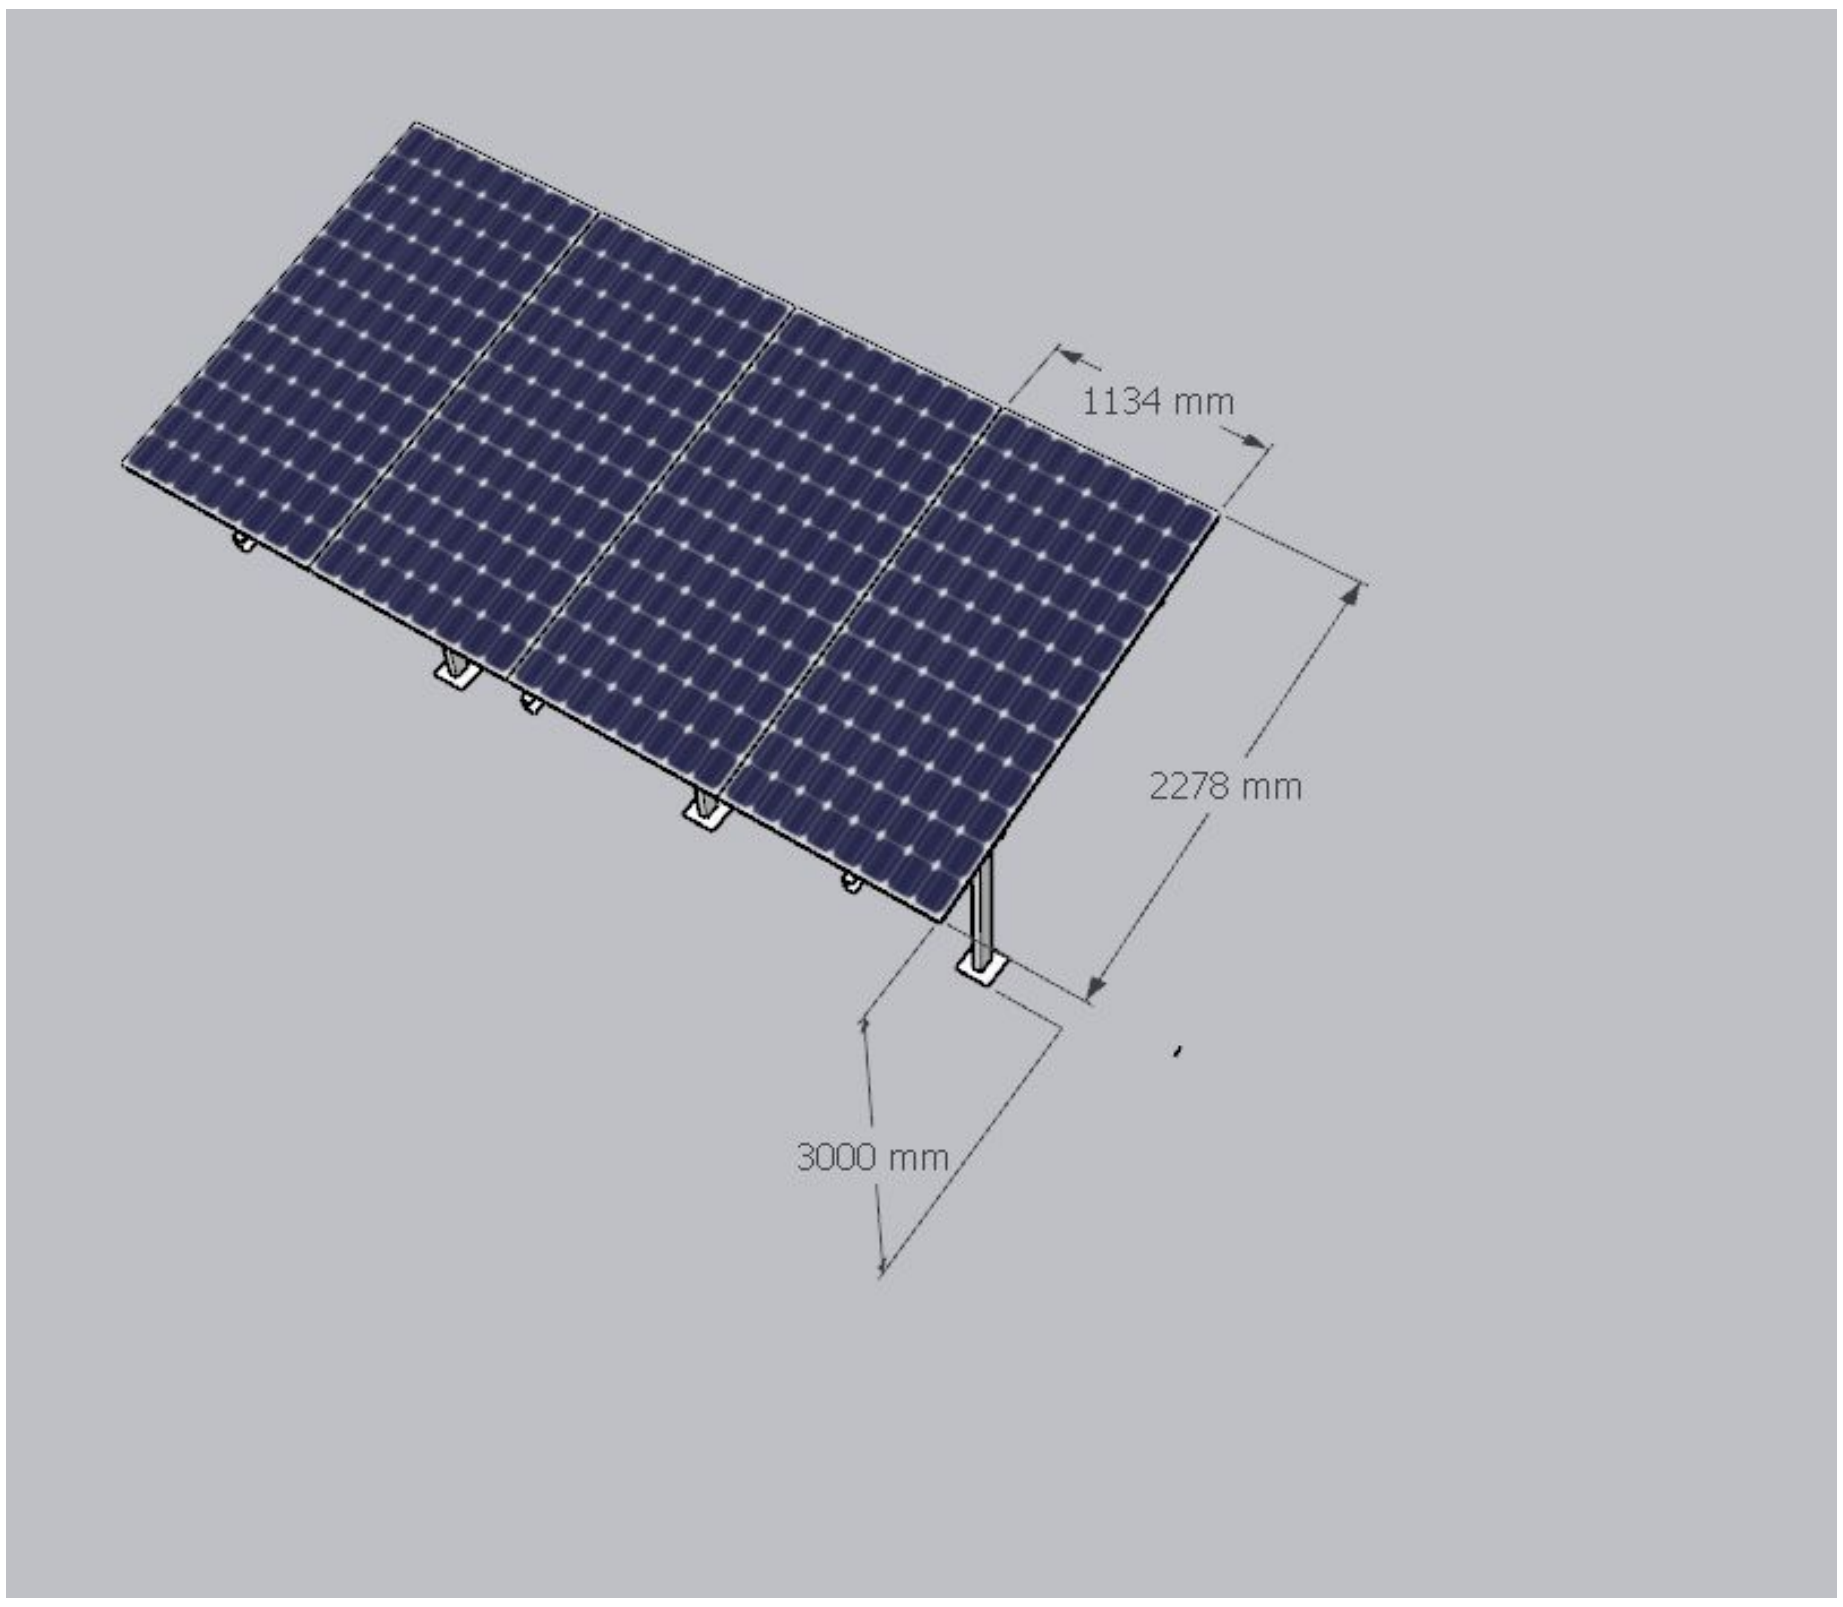

HDGI Structure (1P4 X 2 set of panels of Waaree DCR bifacial 580 Wp)

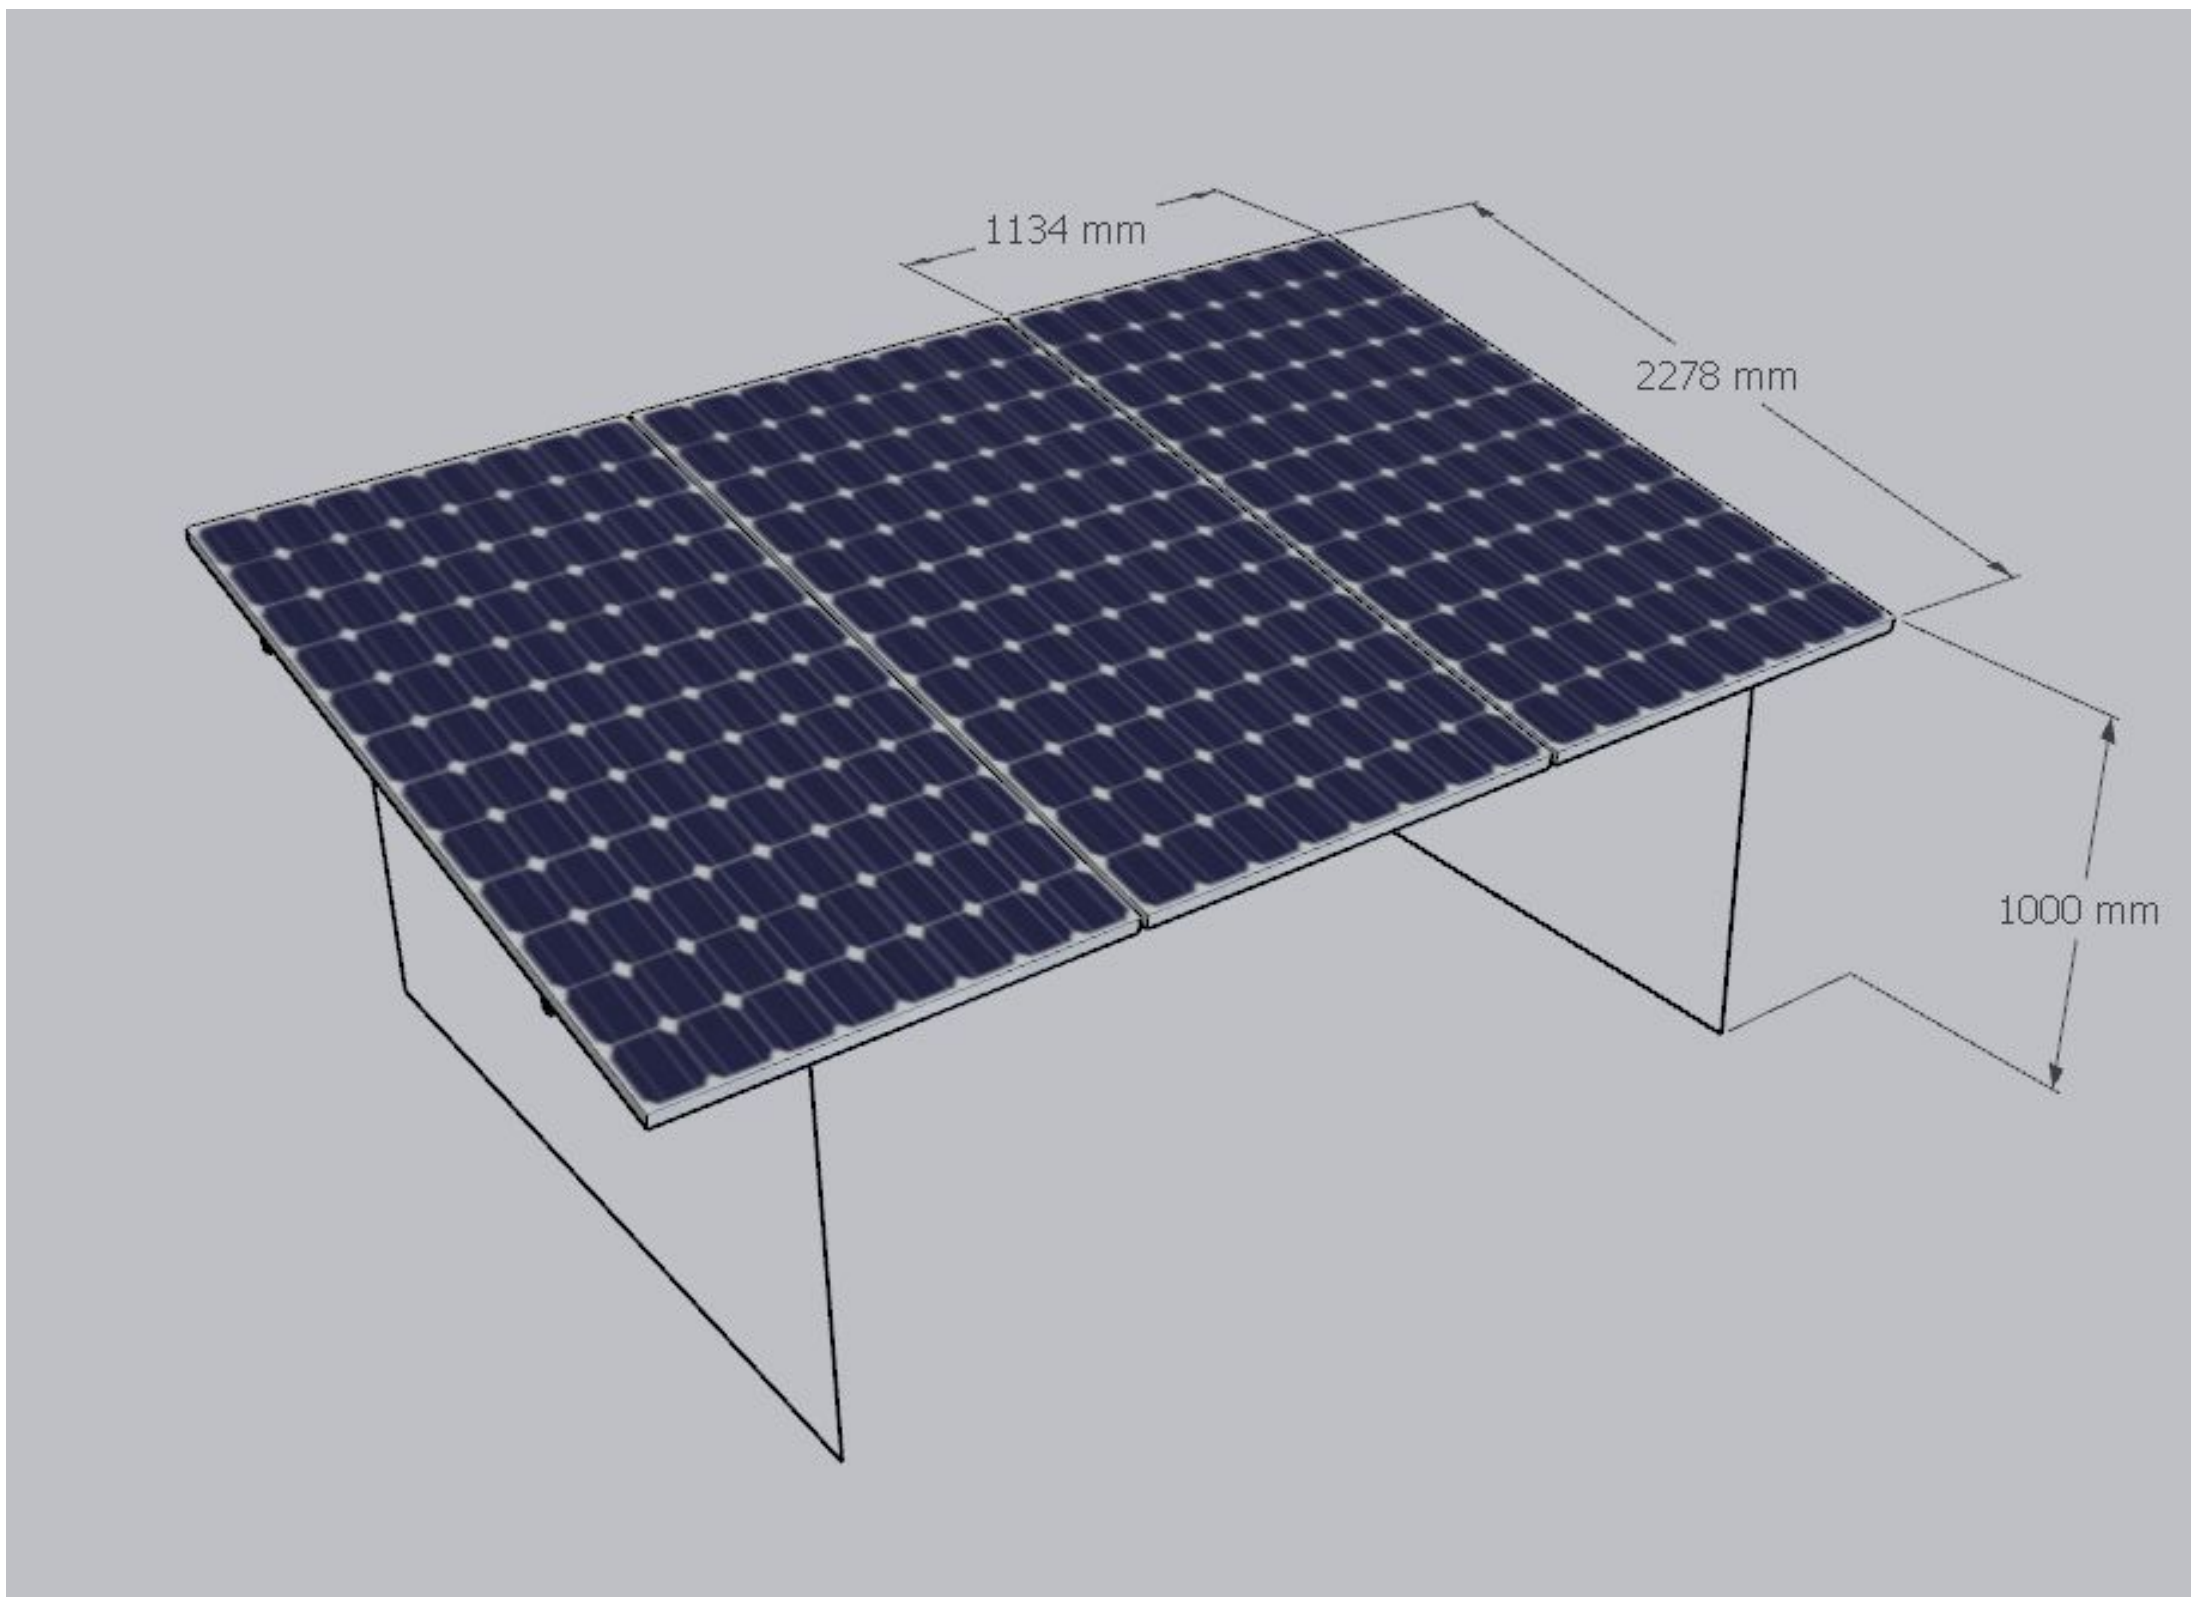

Ballast structure (1P3 X 1 set of panels of Waaree DCR bifacial 580 Wp)

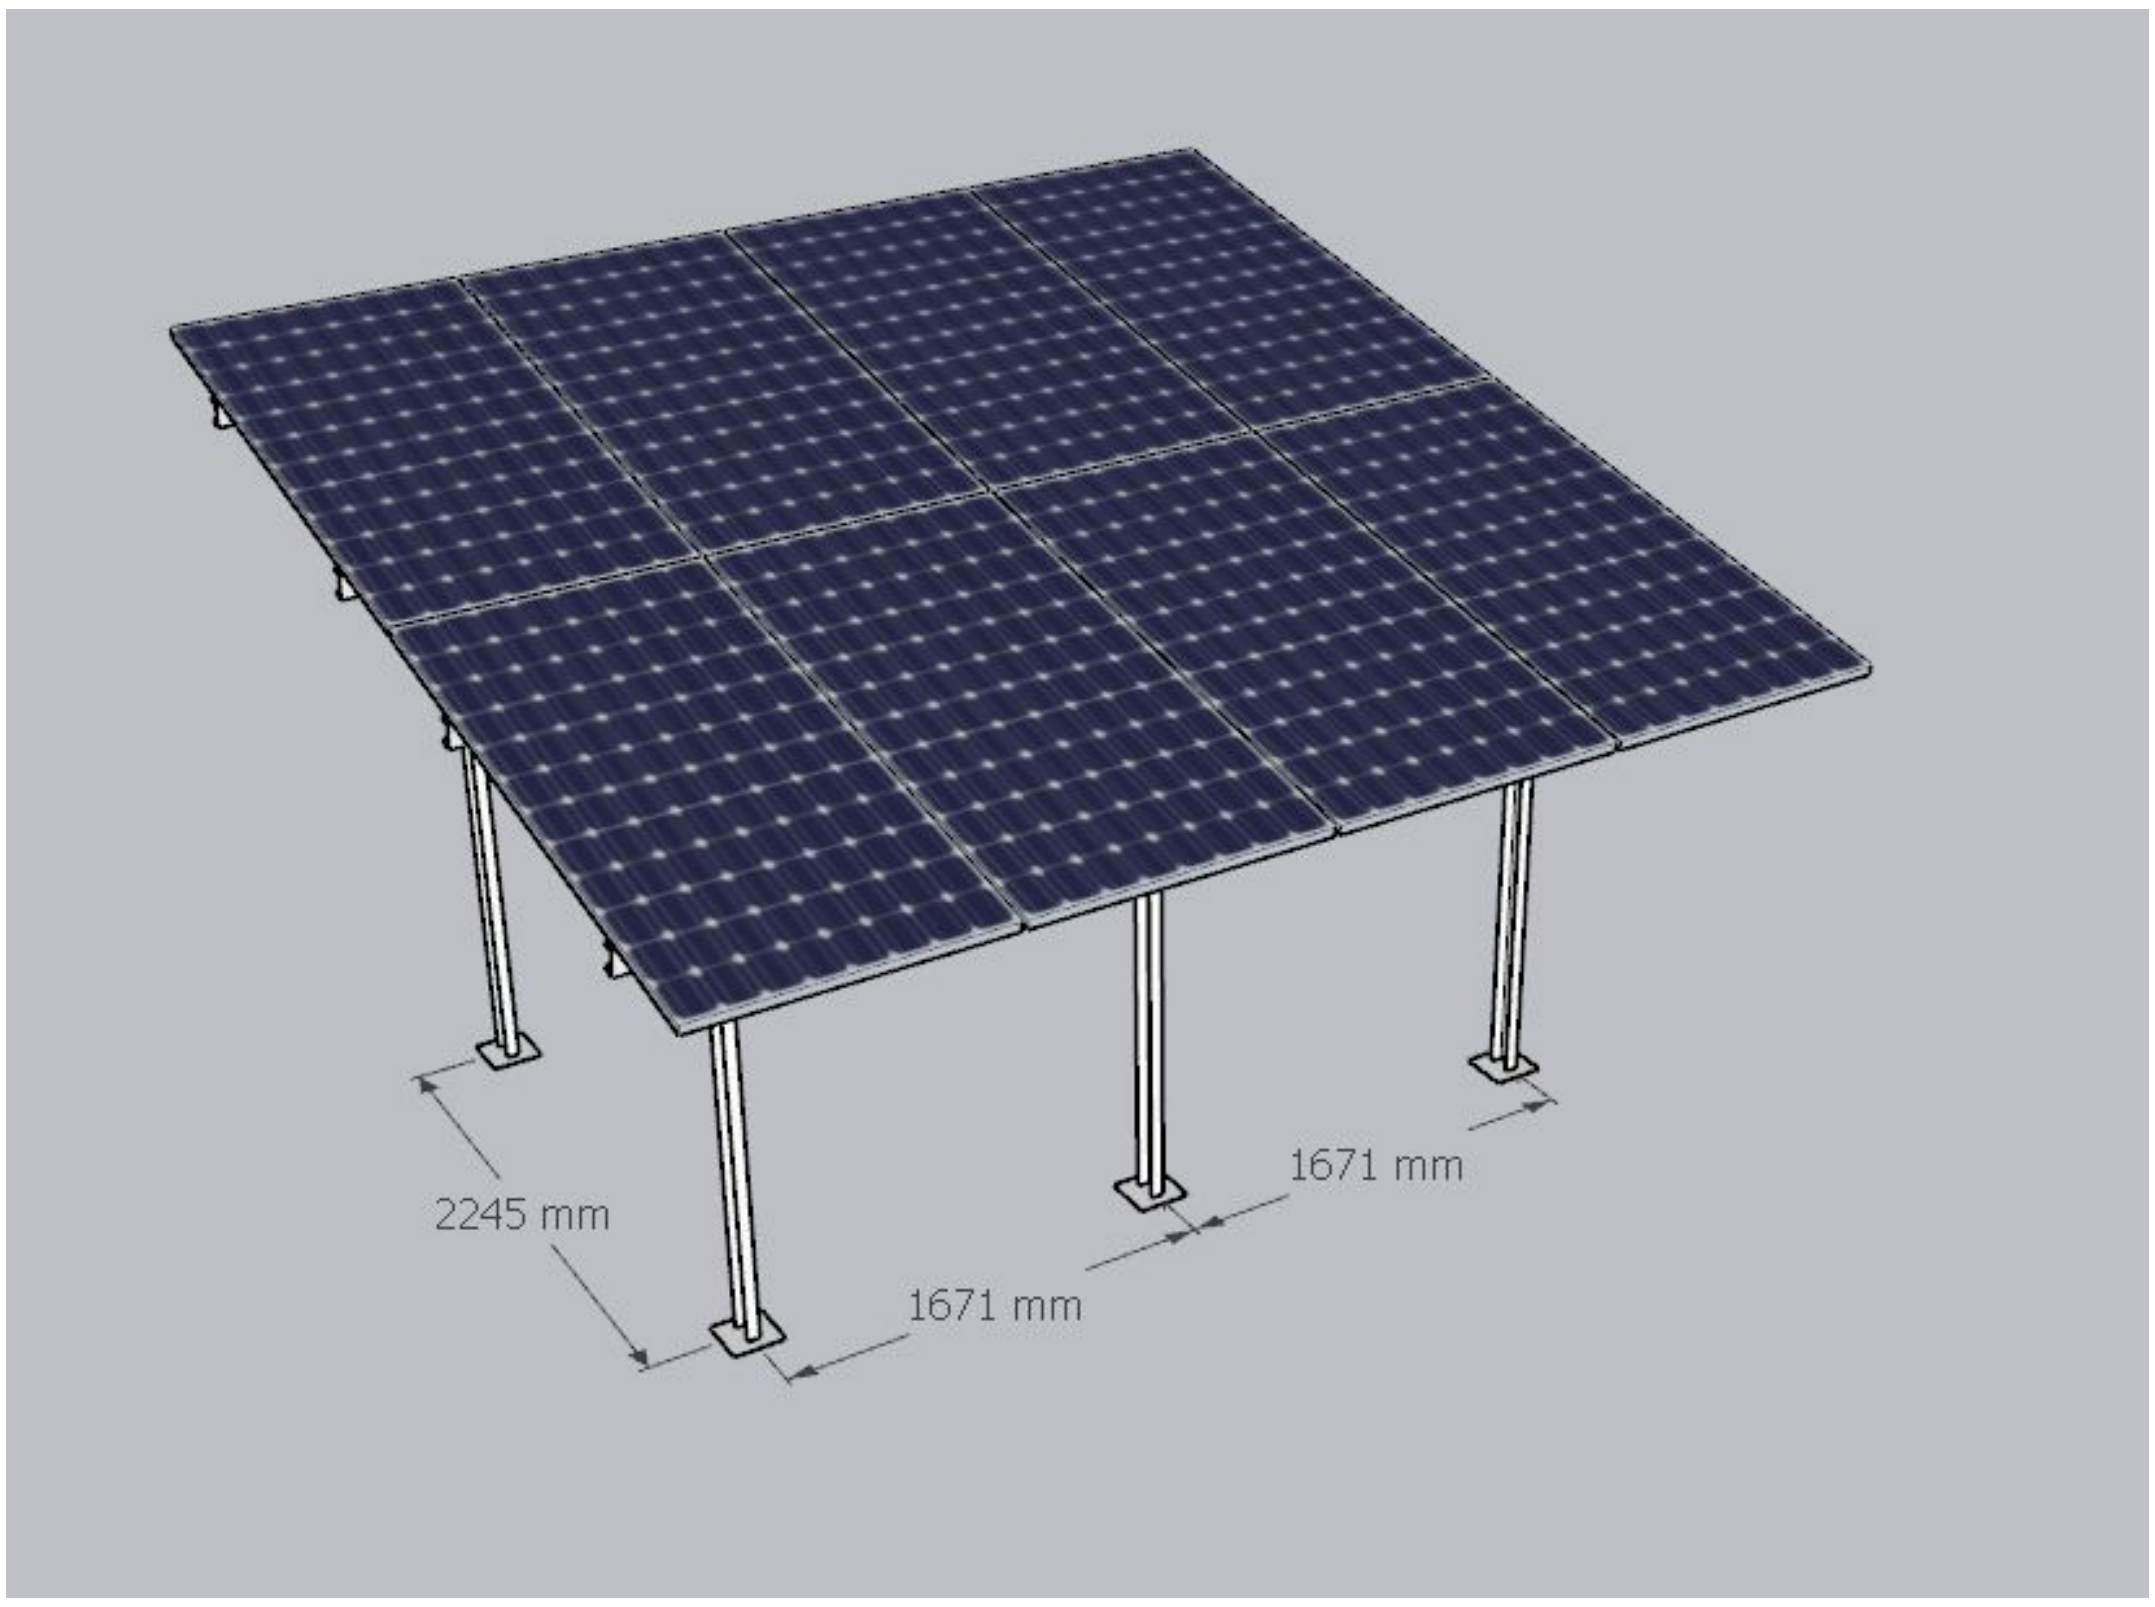

Structure details (1)

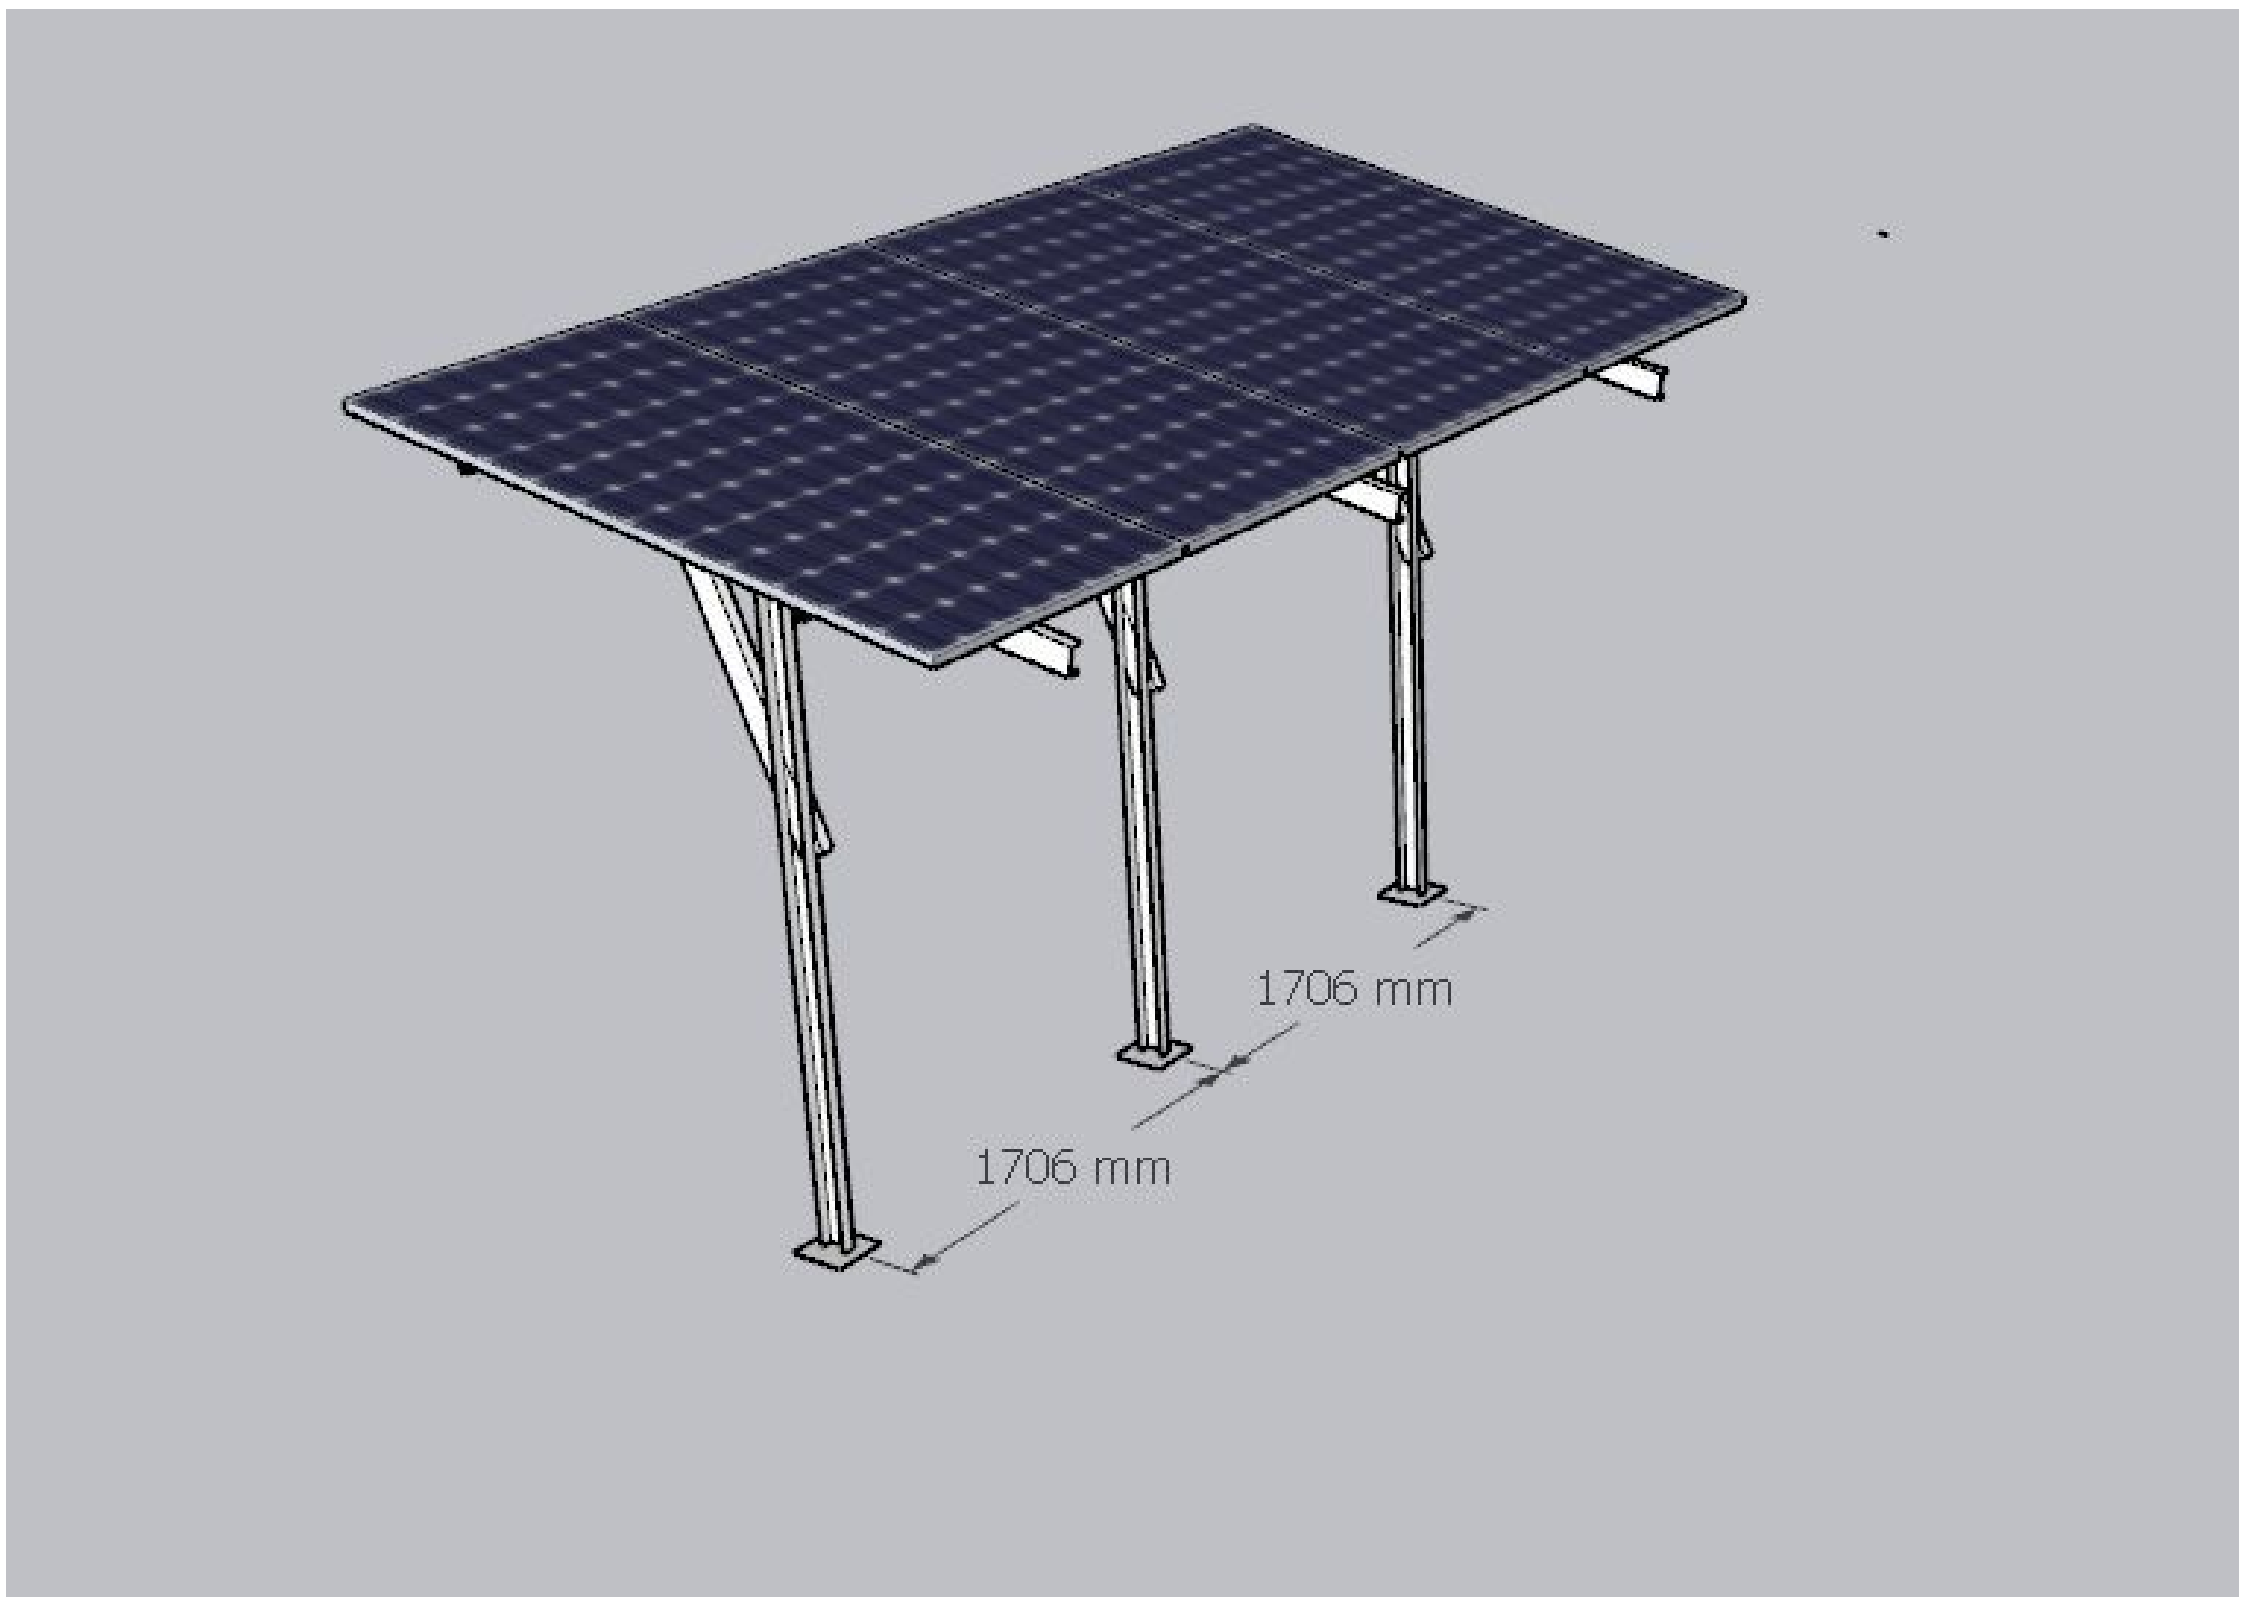

Structure details (2)

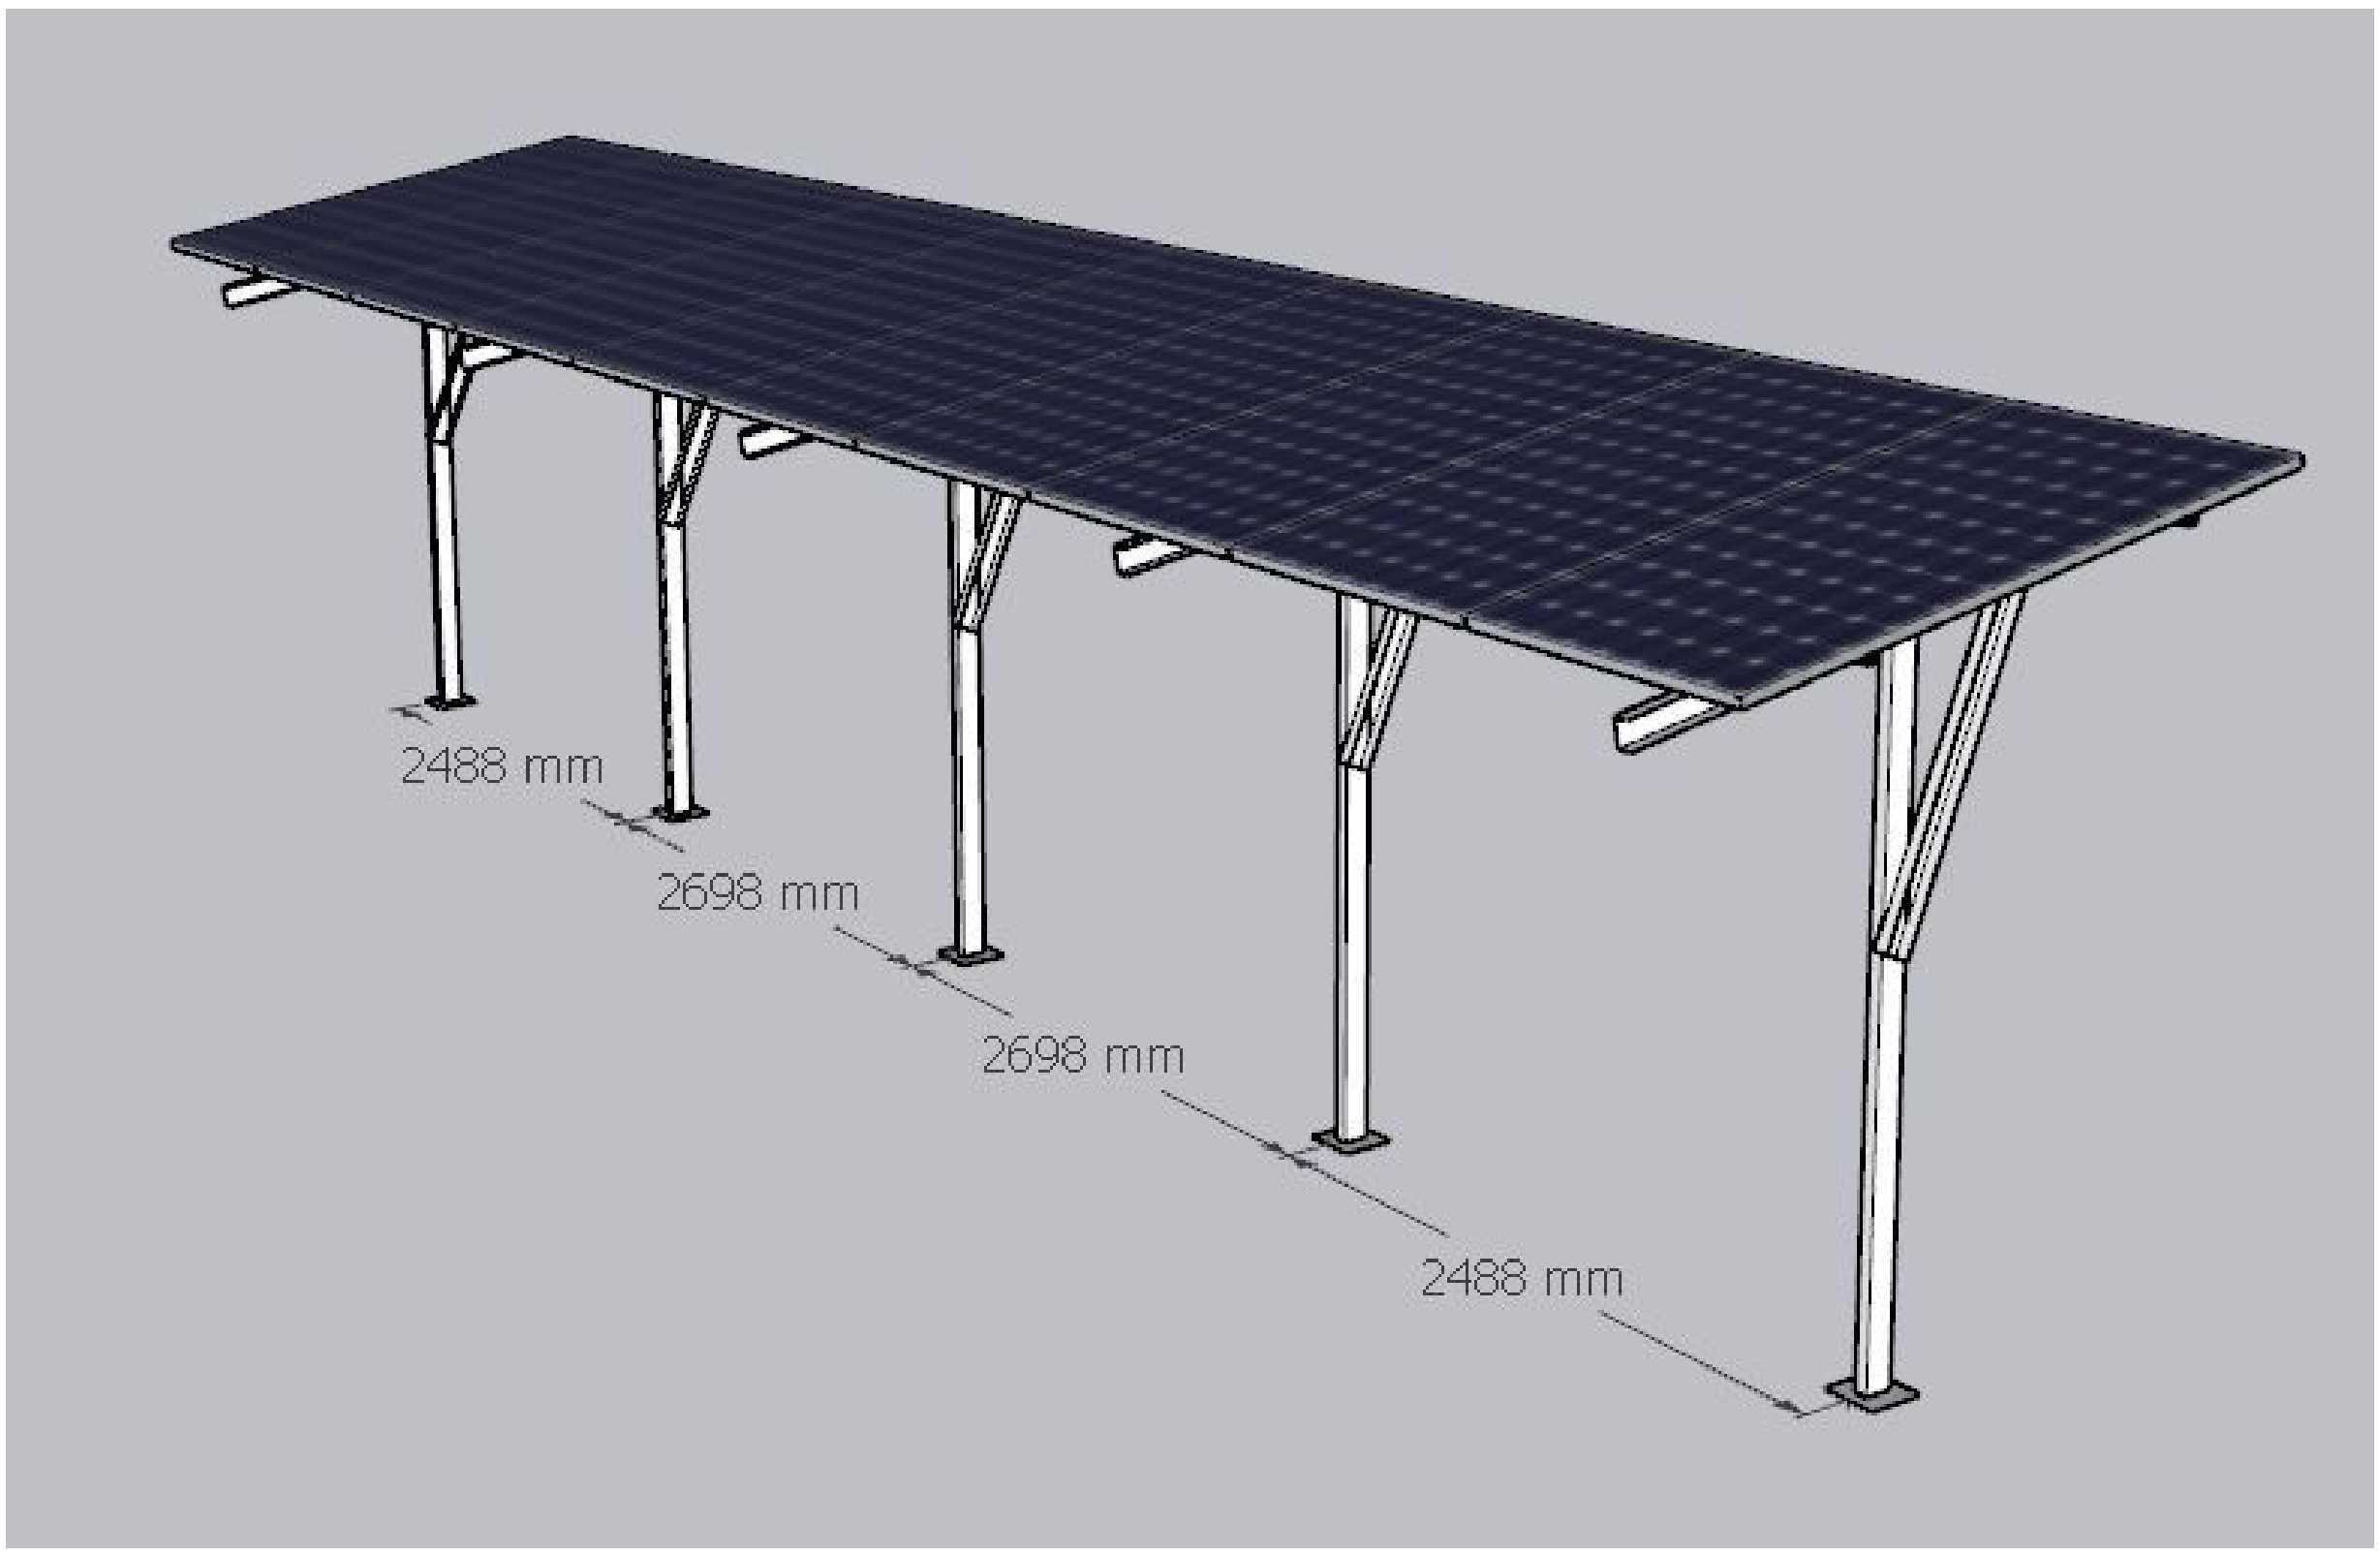

Structure details (3)

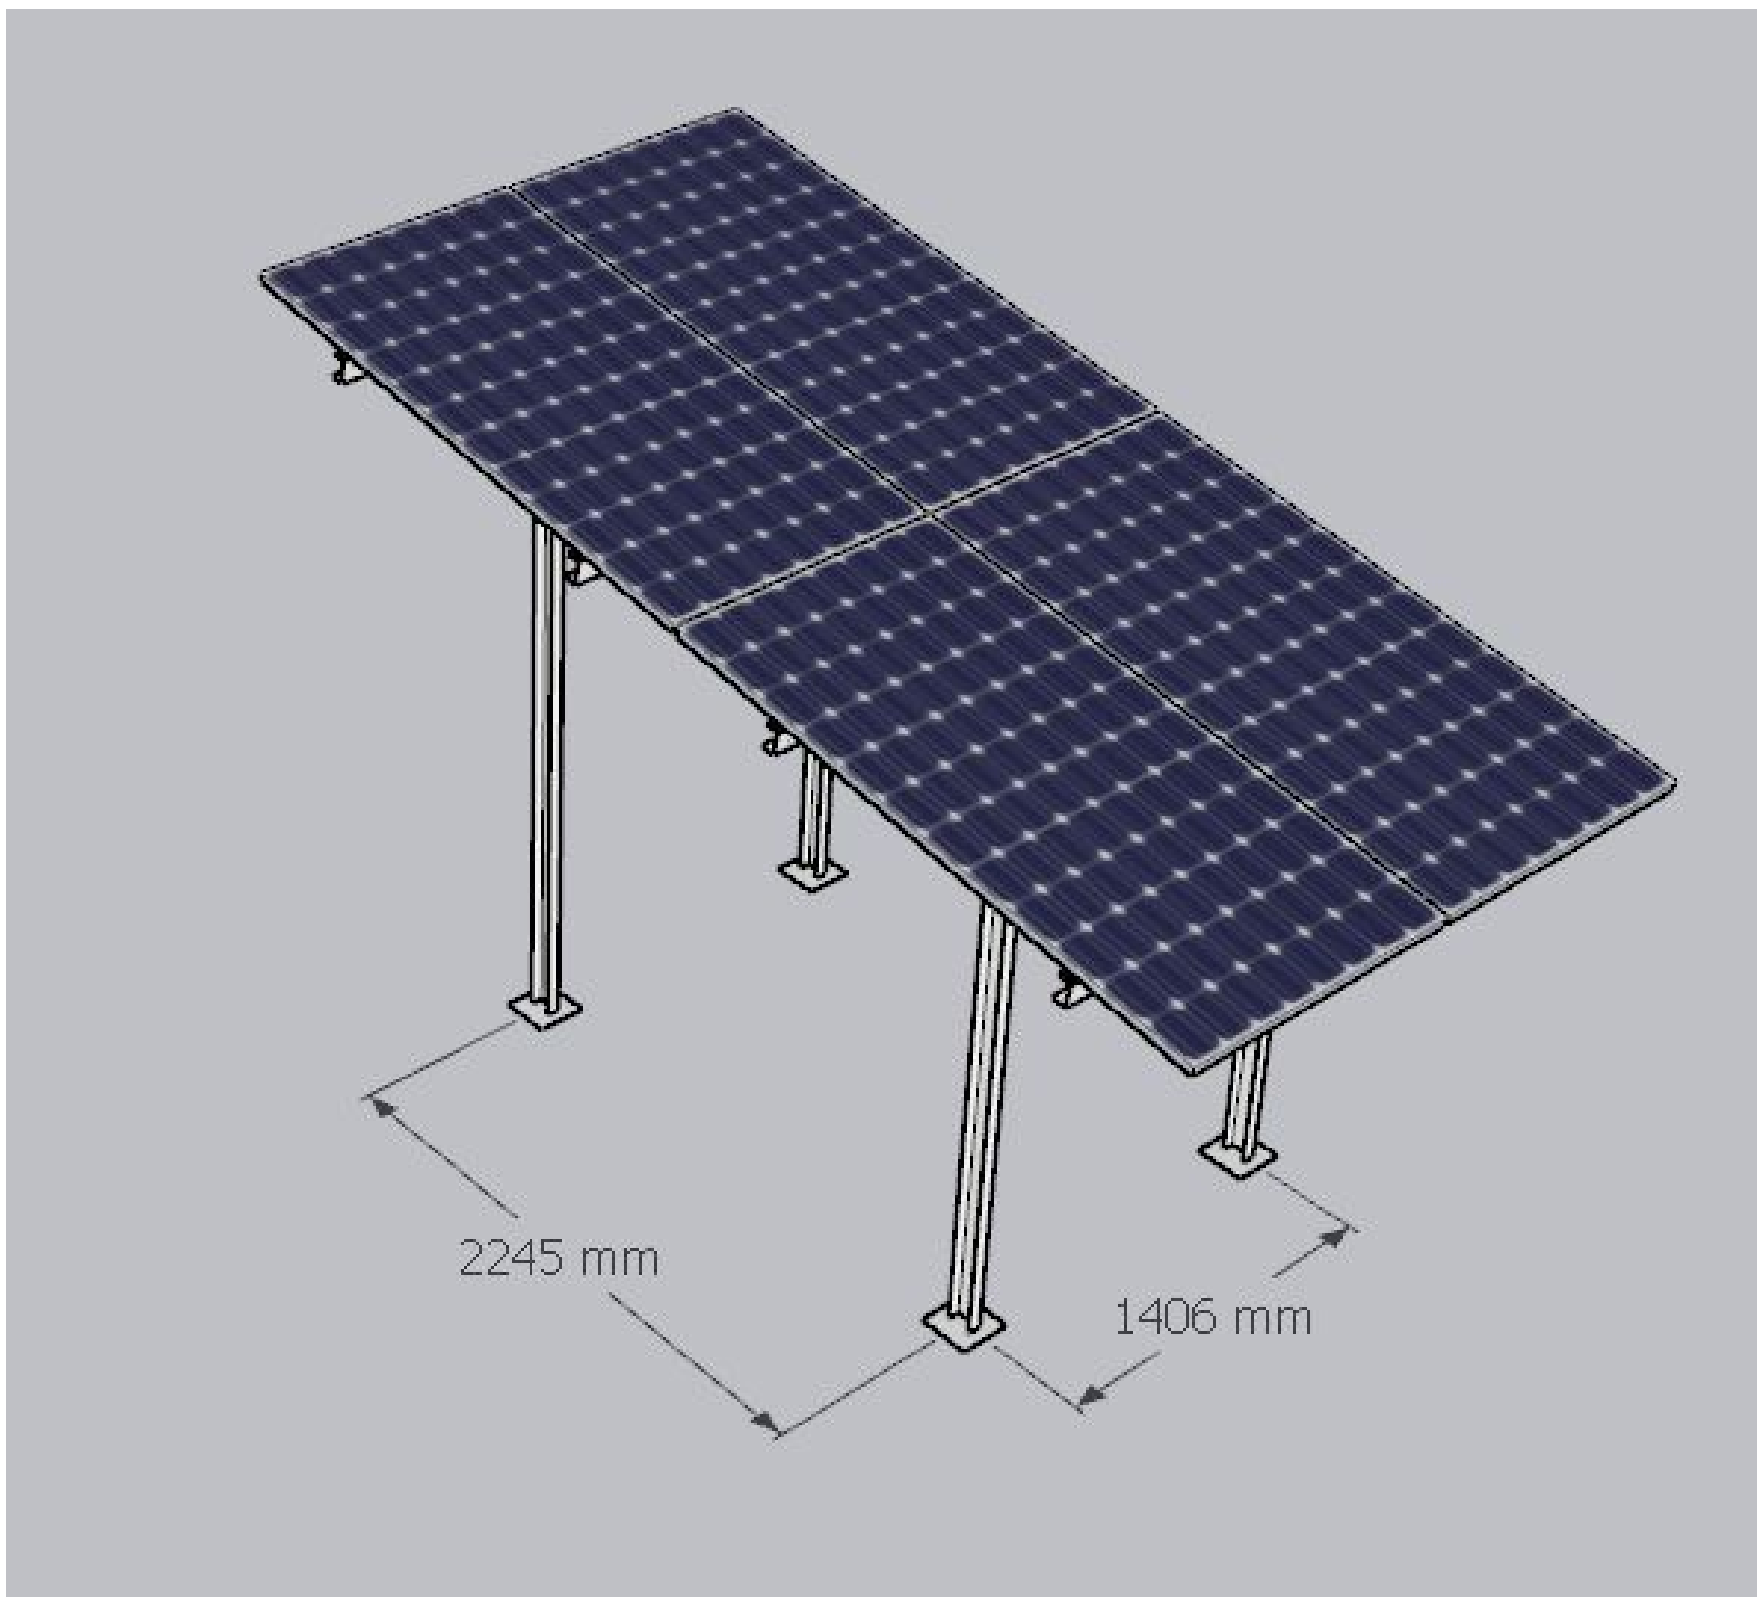

Structure details (4)

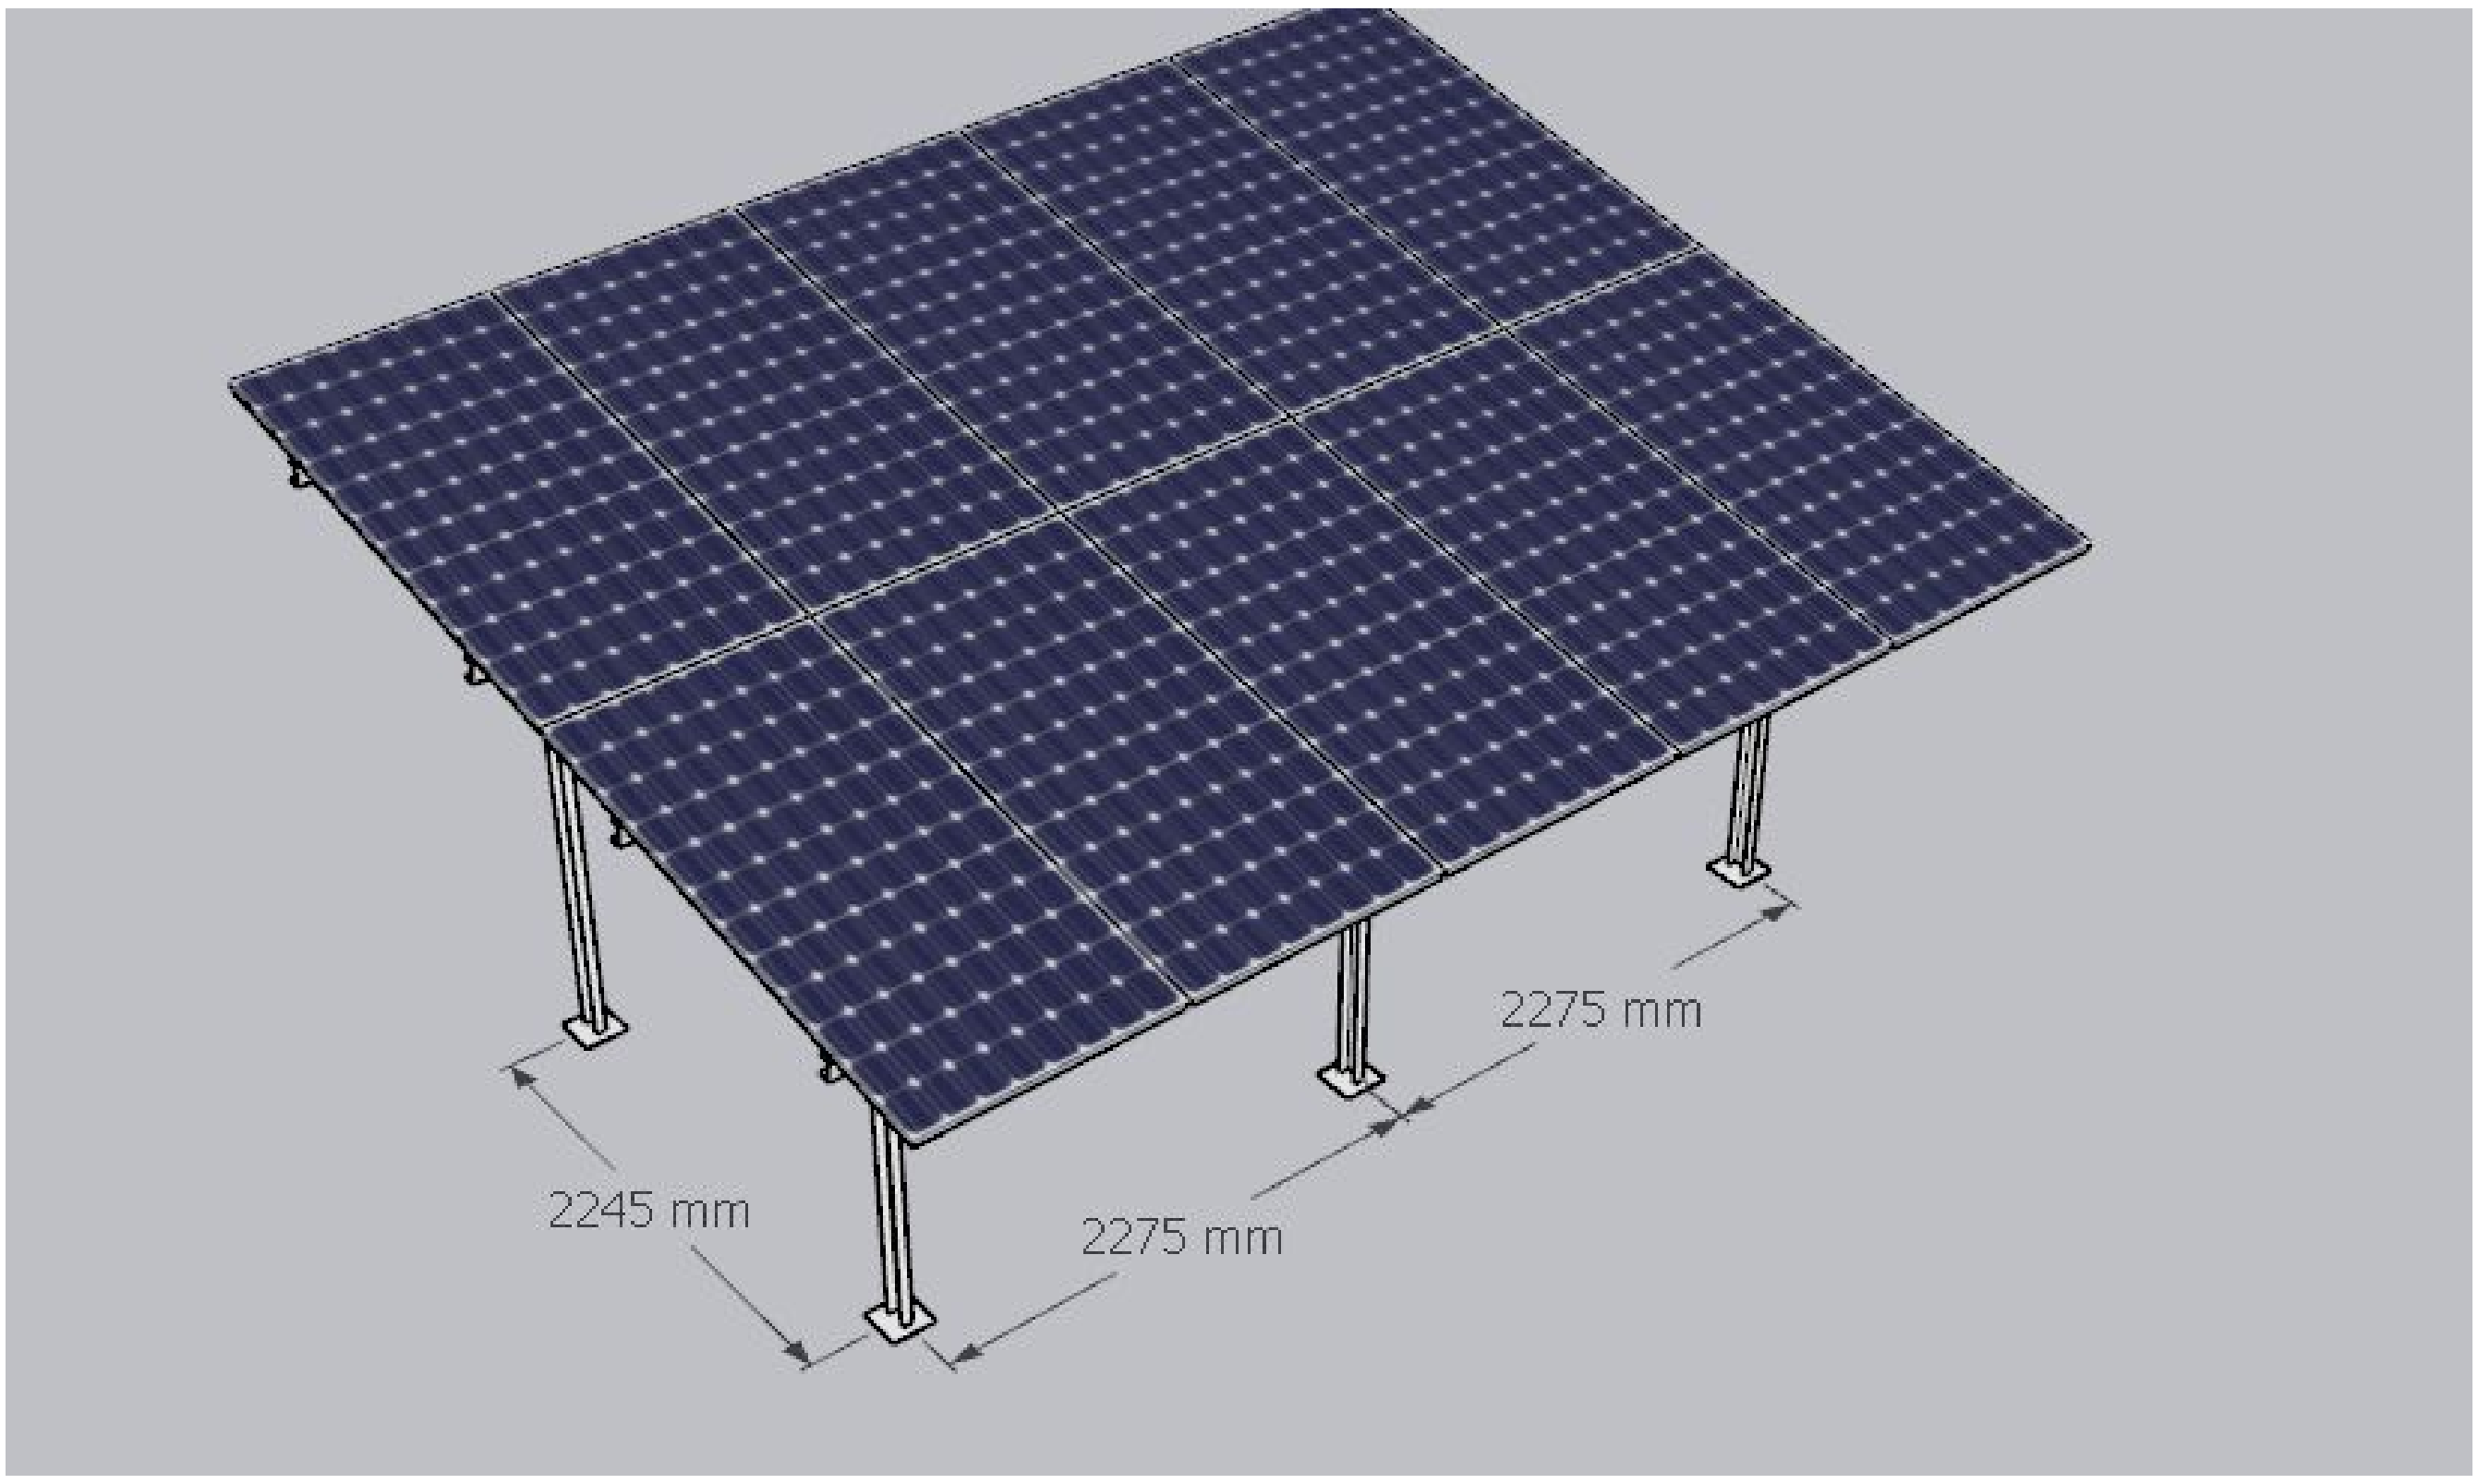

Structure details (5)

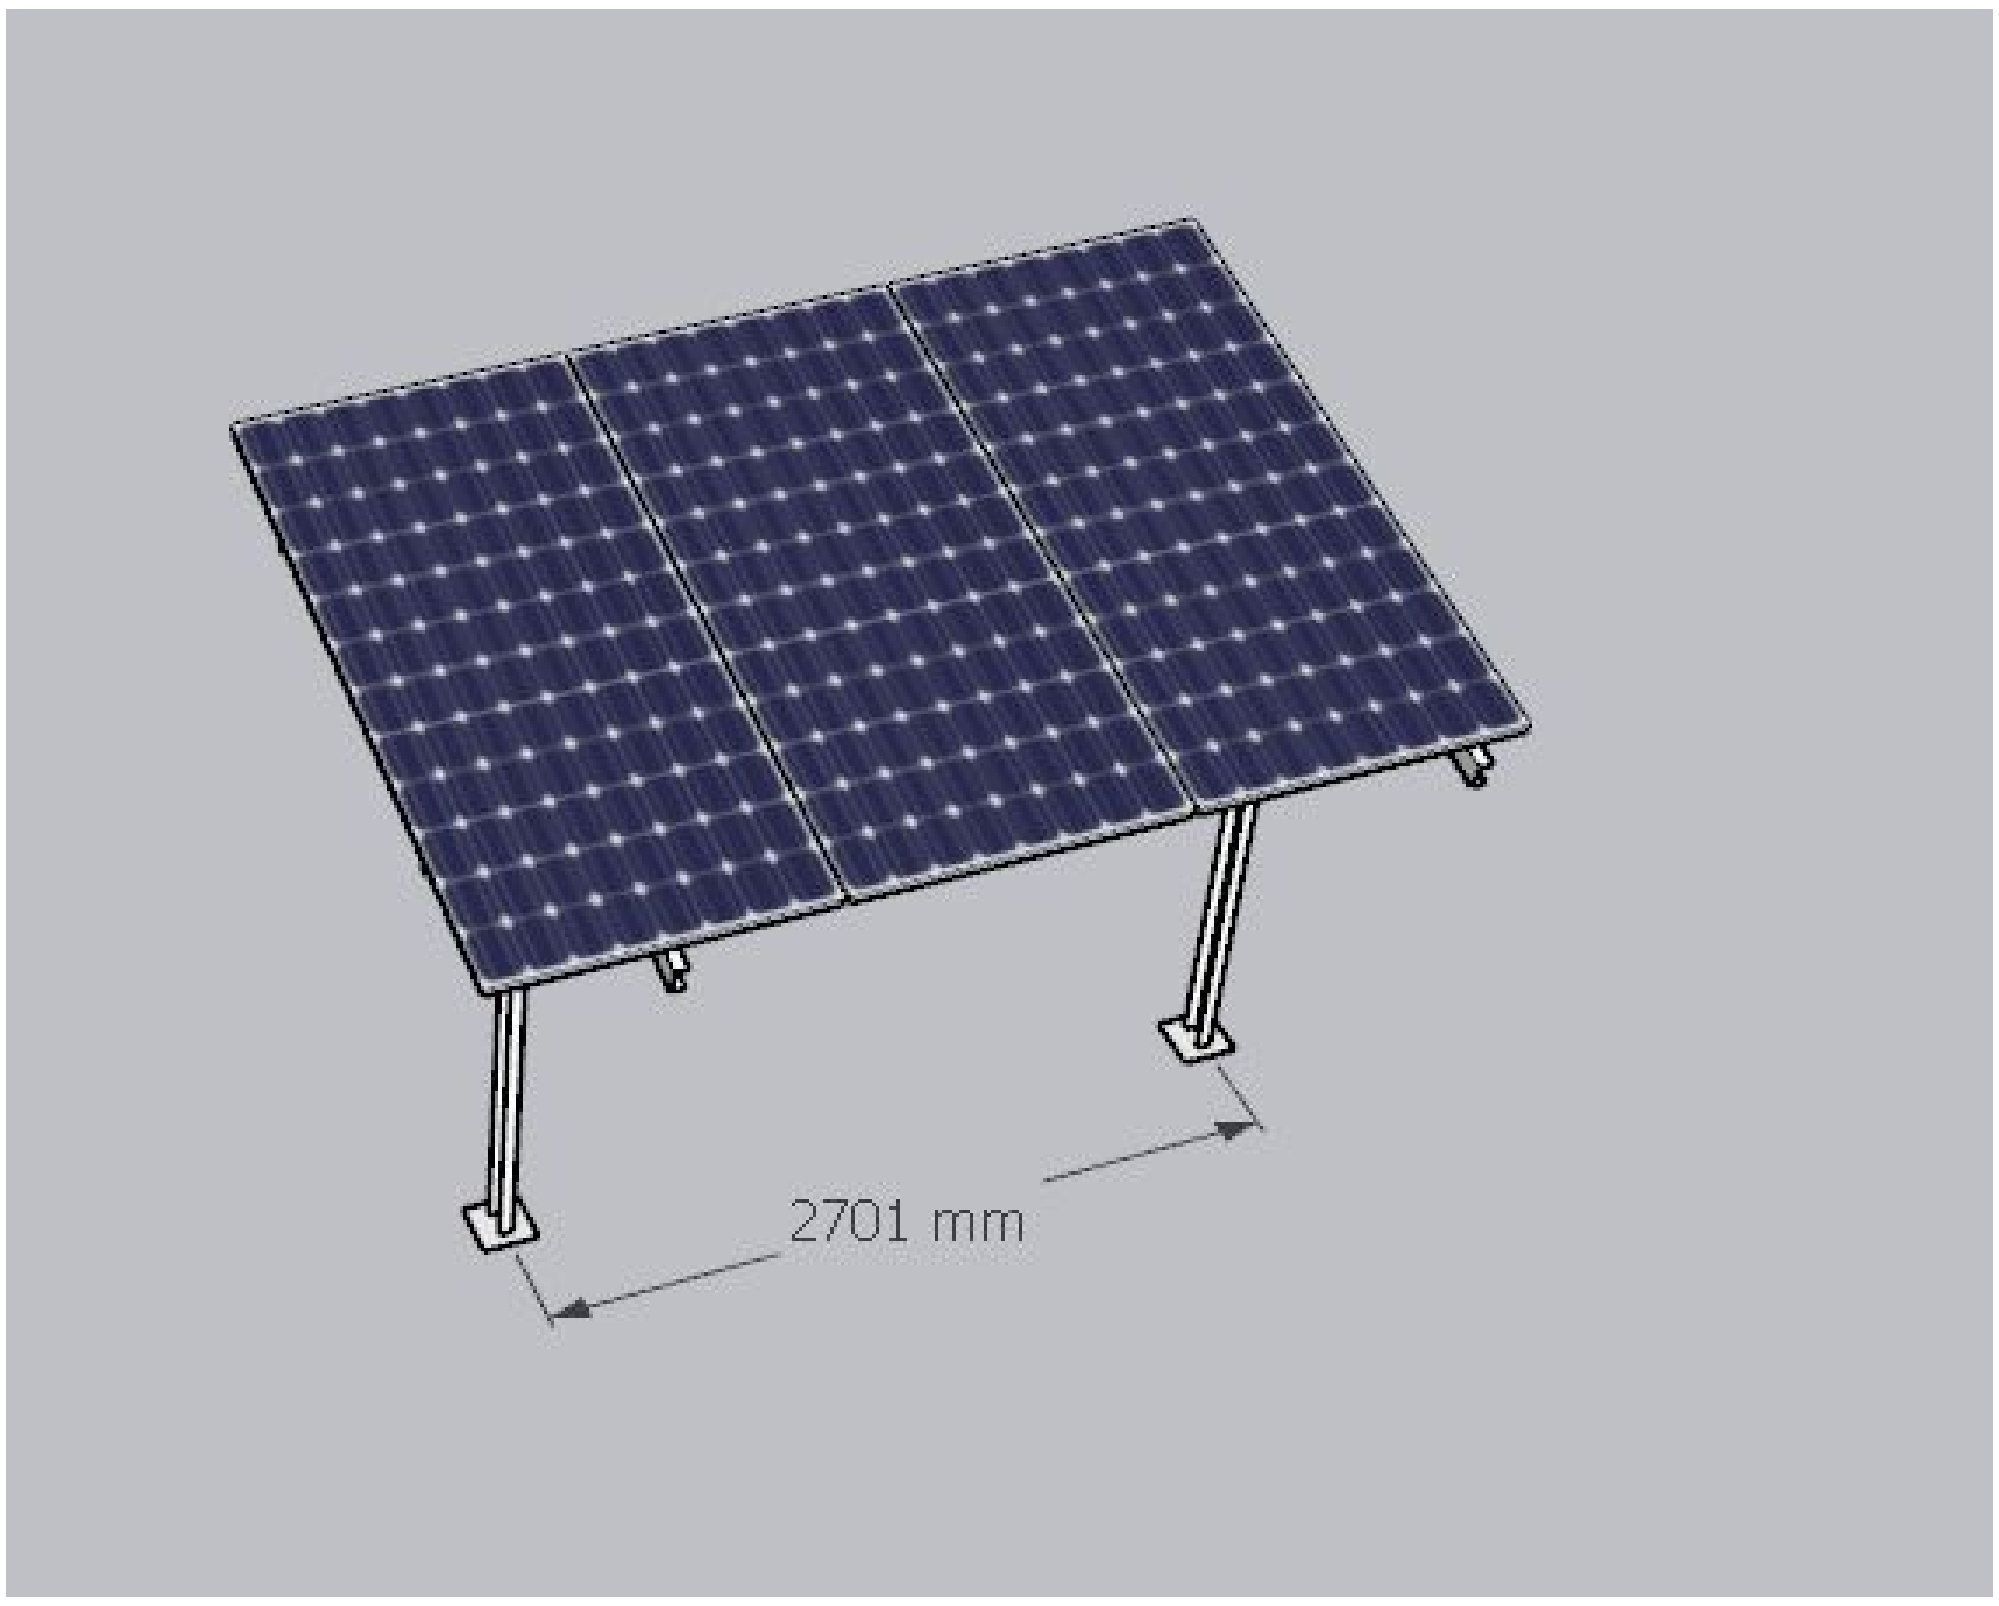

Structure details (6)

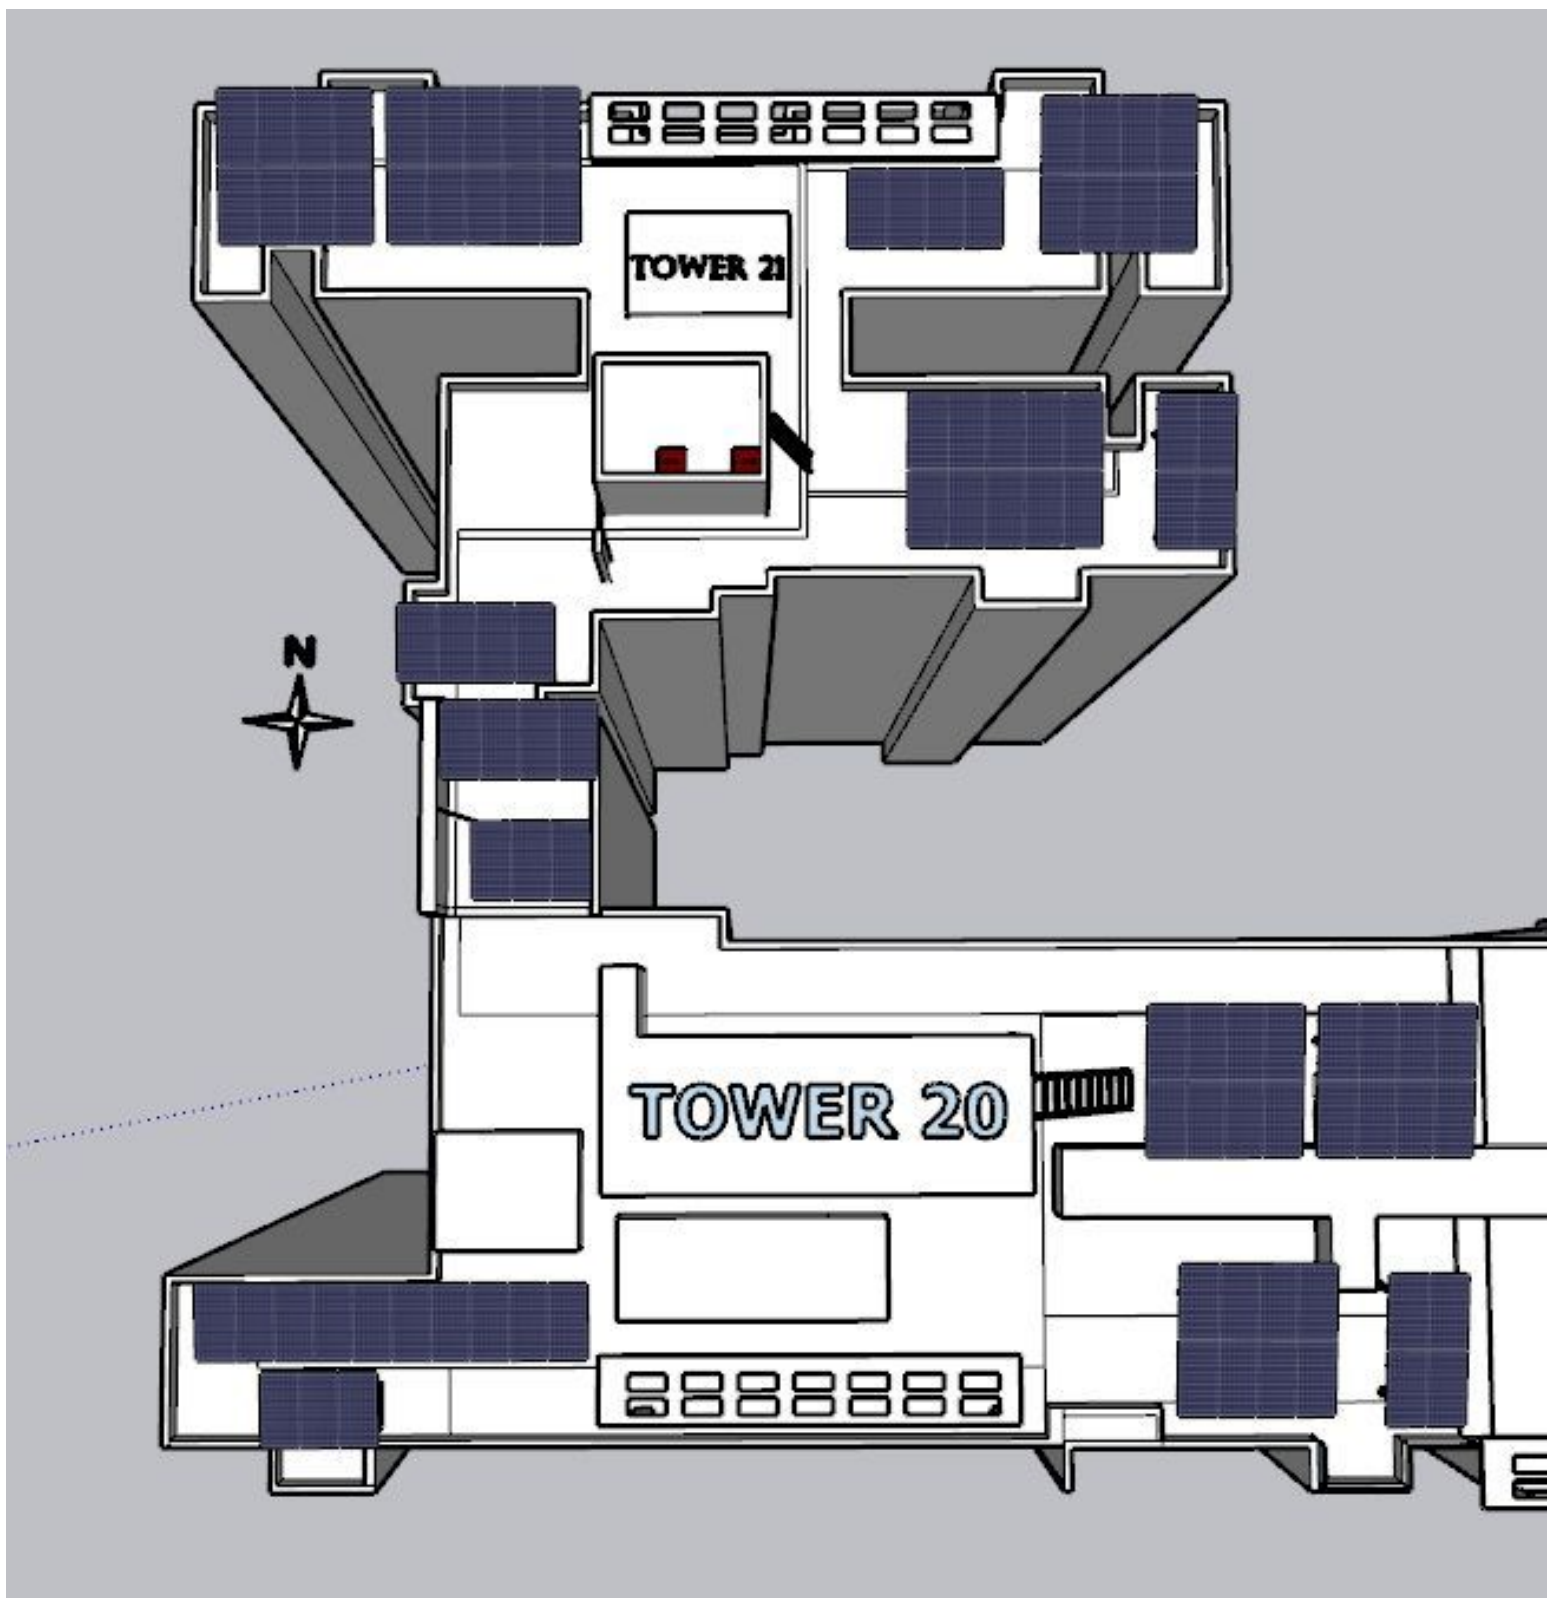

Proposed PV Area


Proposed area


Proposed area


Proposed area


airtel
airtel
Proposed area


Proposed area


proposed area

Cable Routing

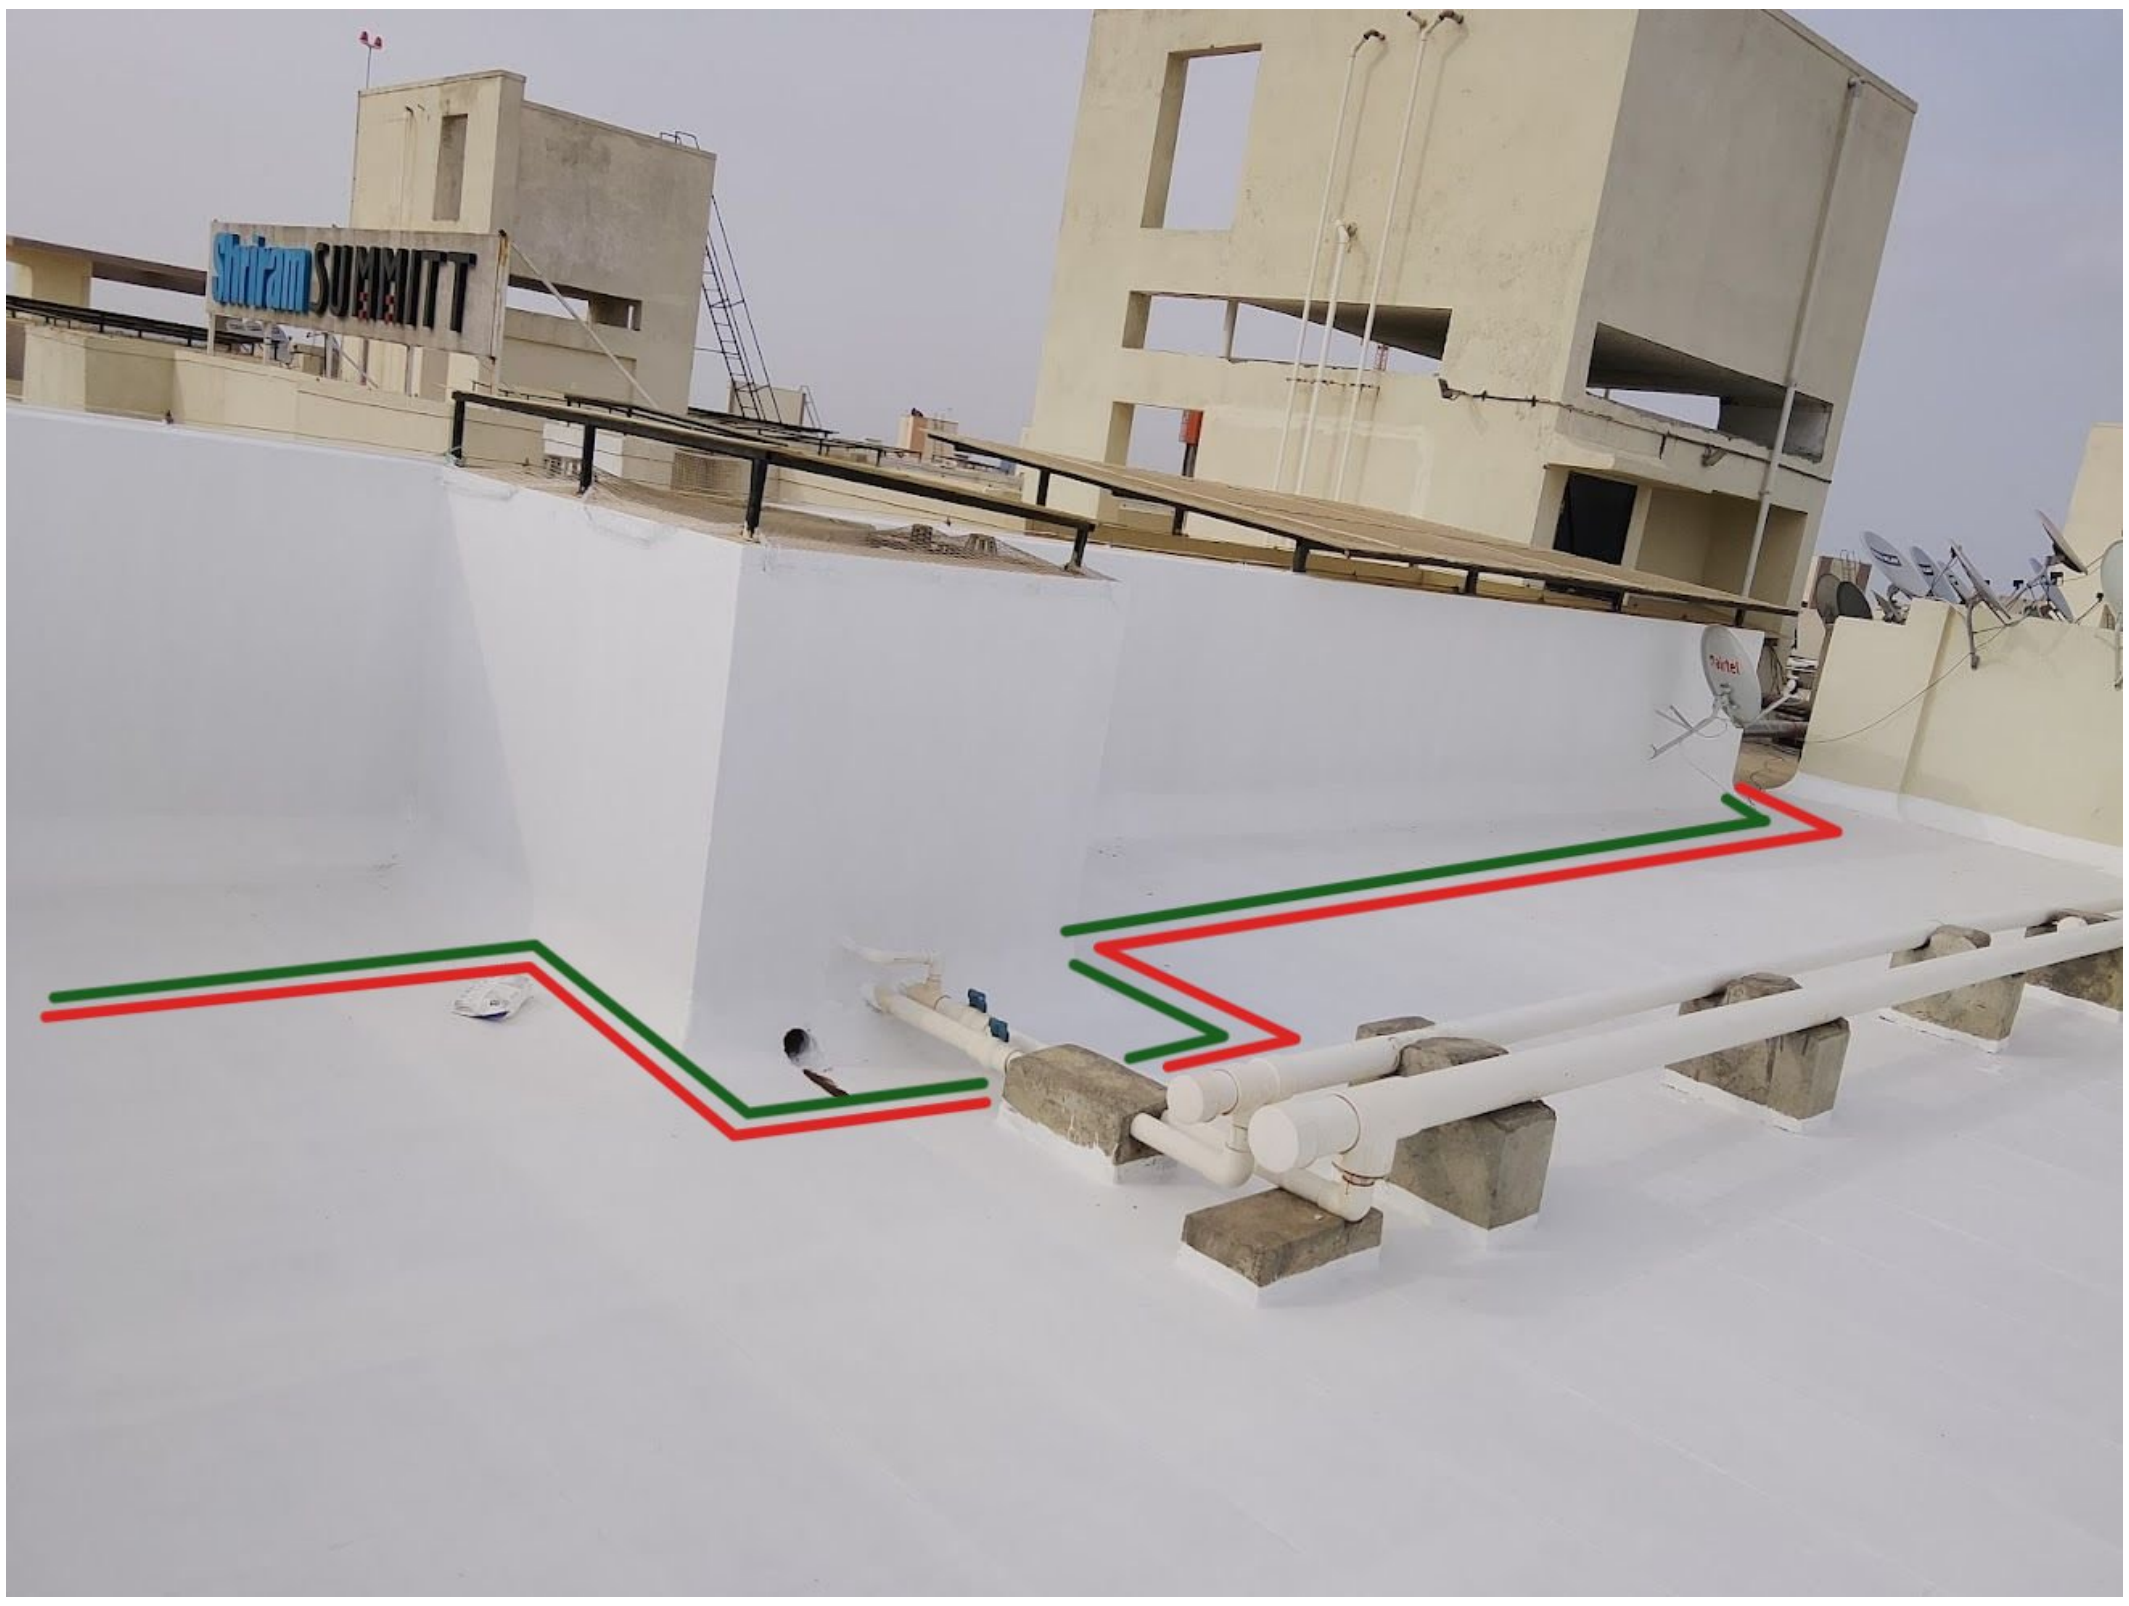
Shriram SUMMITT


ATA PLAY


airtel
airtel
airtel


TATA Sky
HD
PLAY


LA

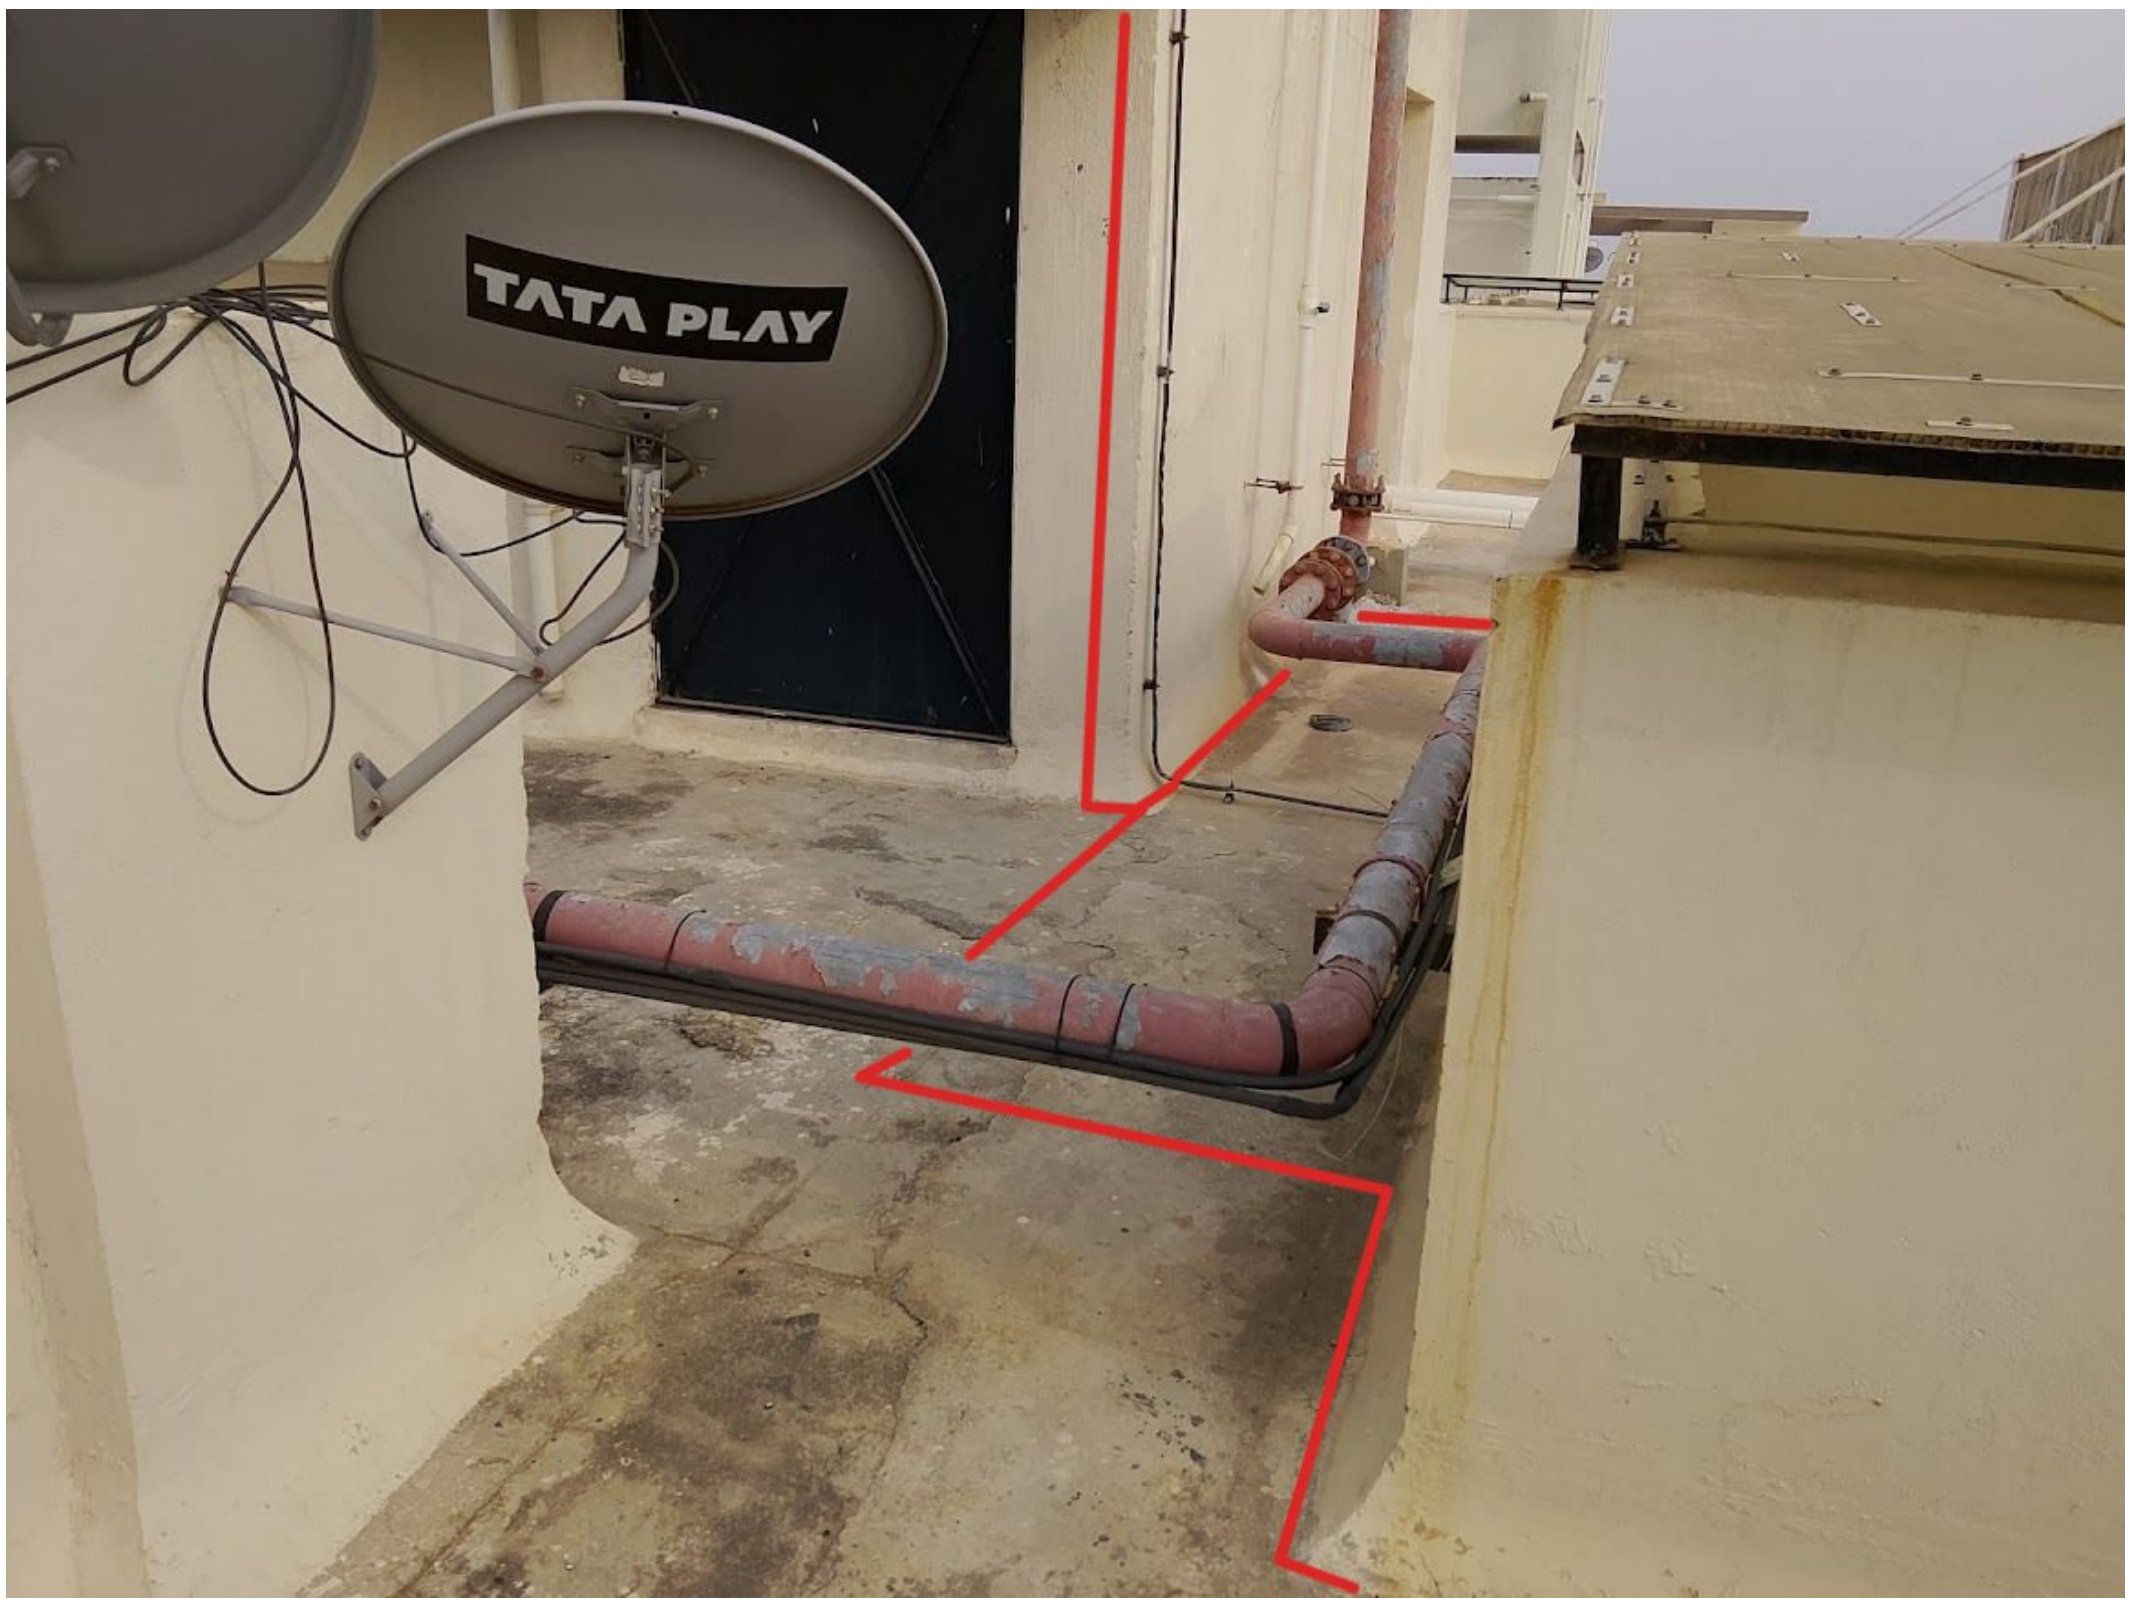
TATA PLAY


TATA PLAY

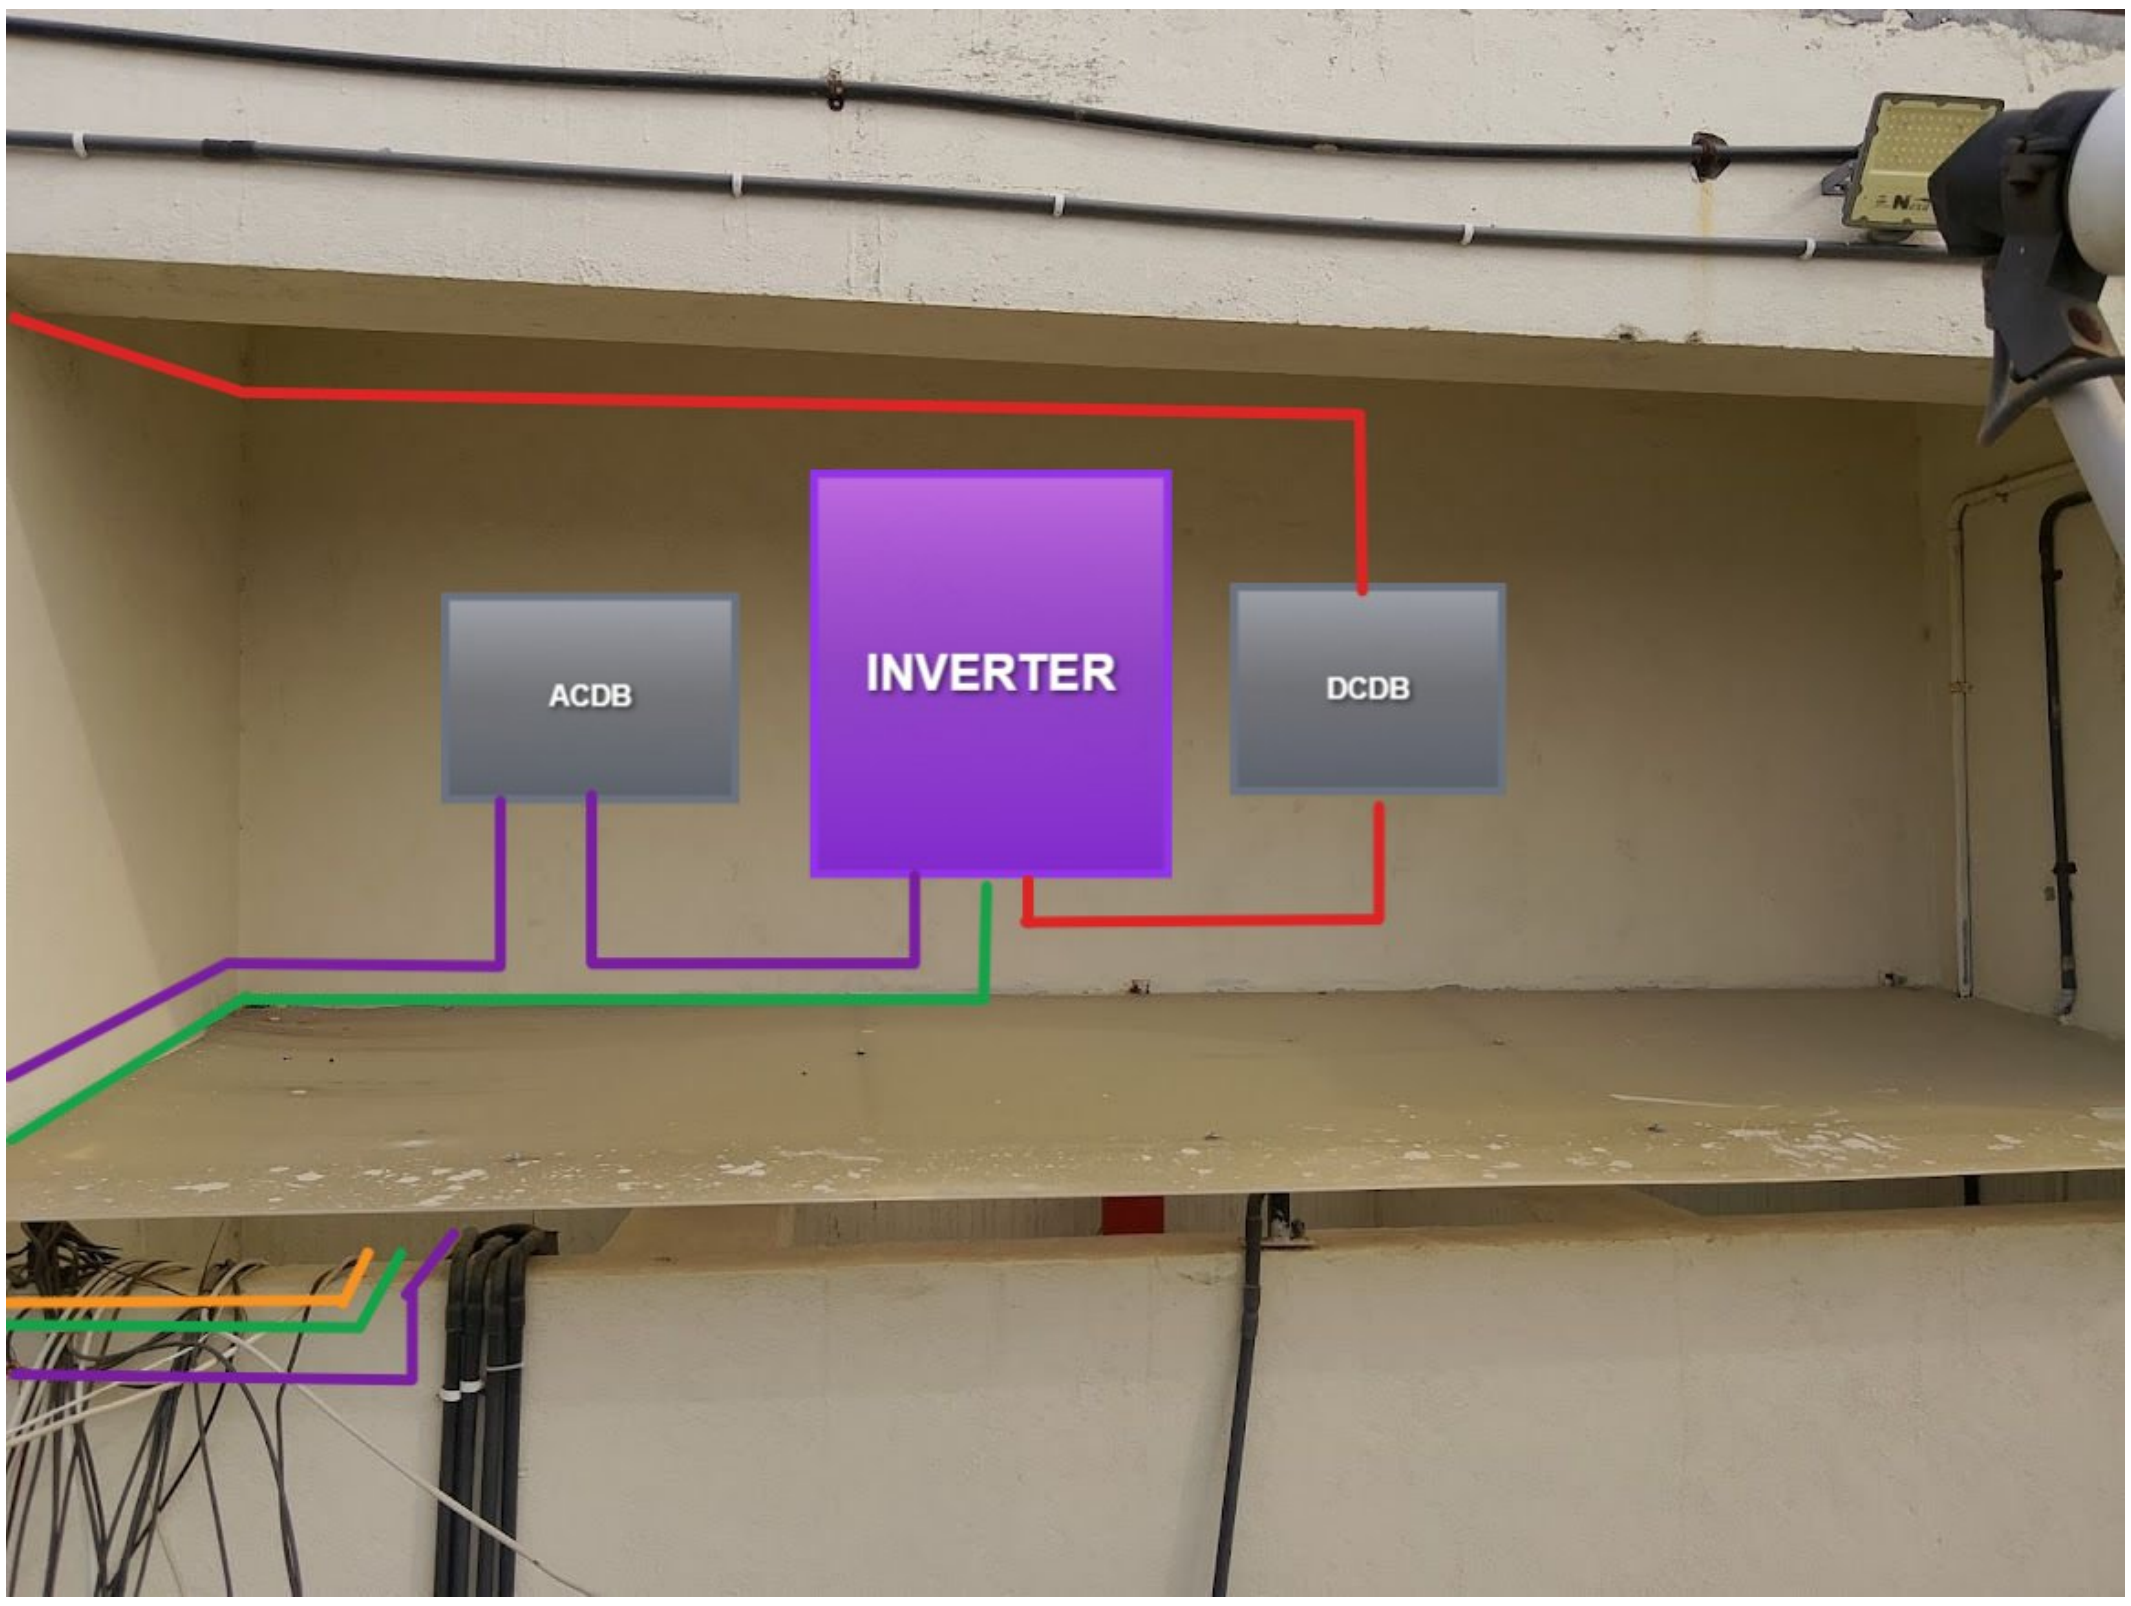
ACDB
INVERTER
DCDB


BASEMENT -

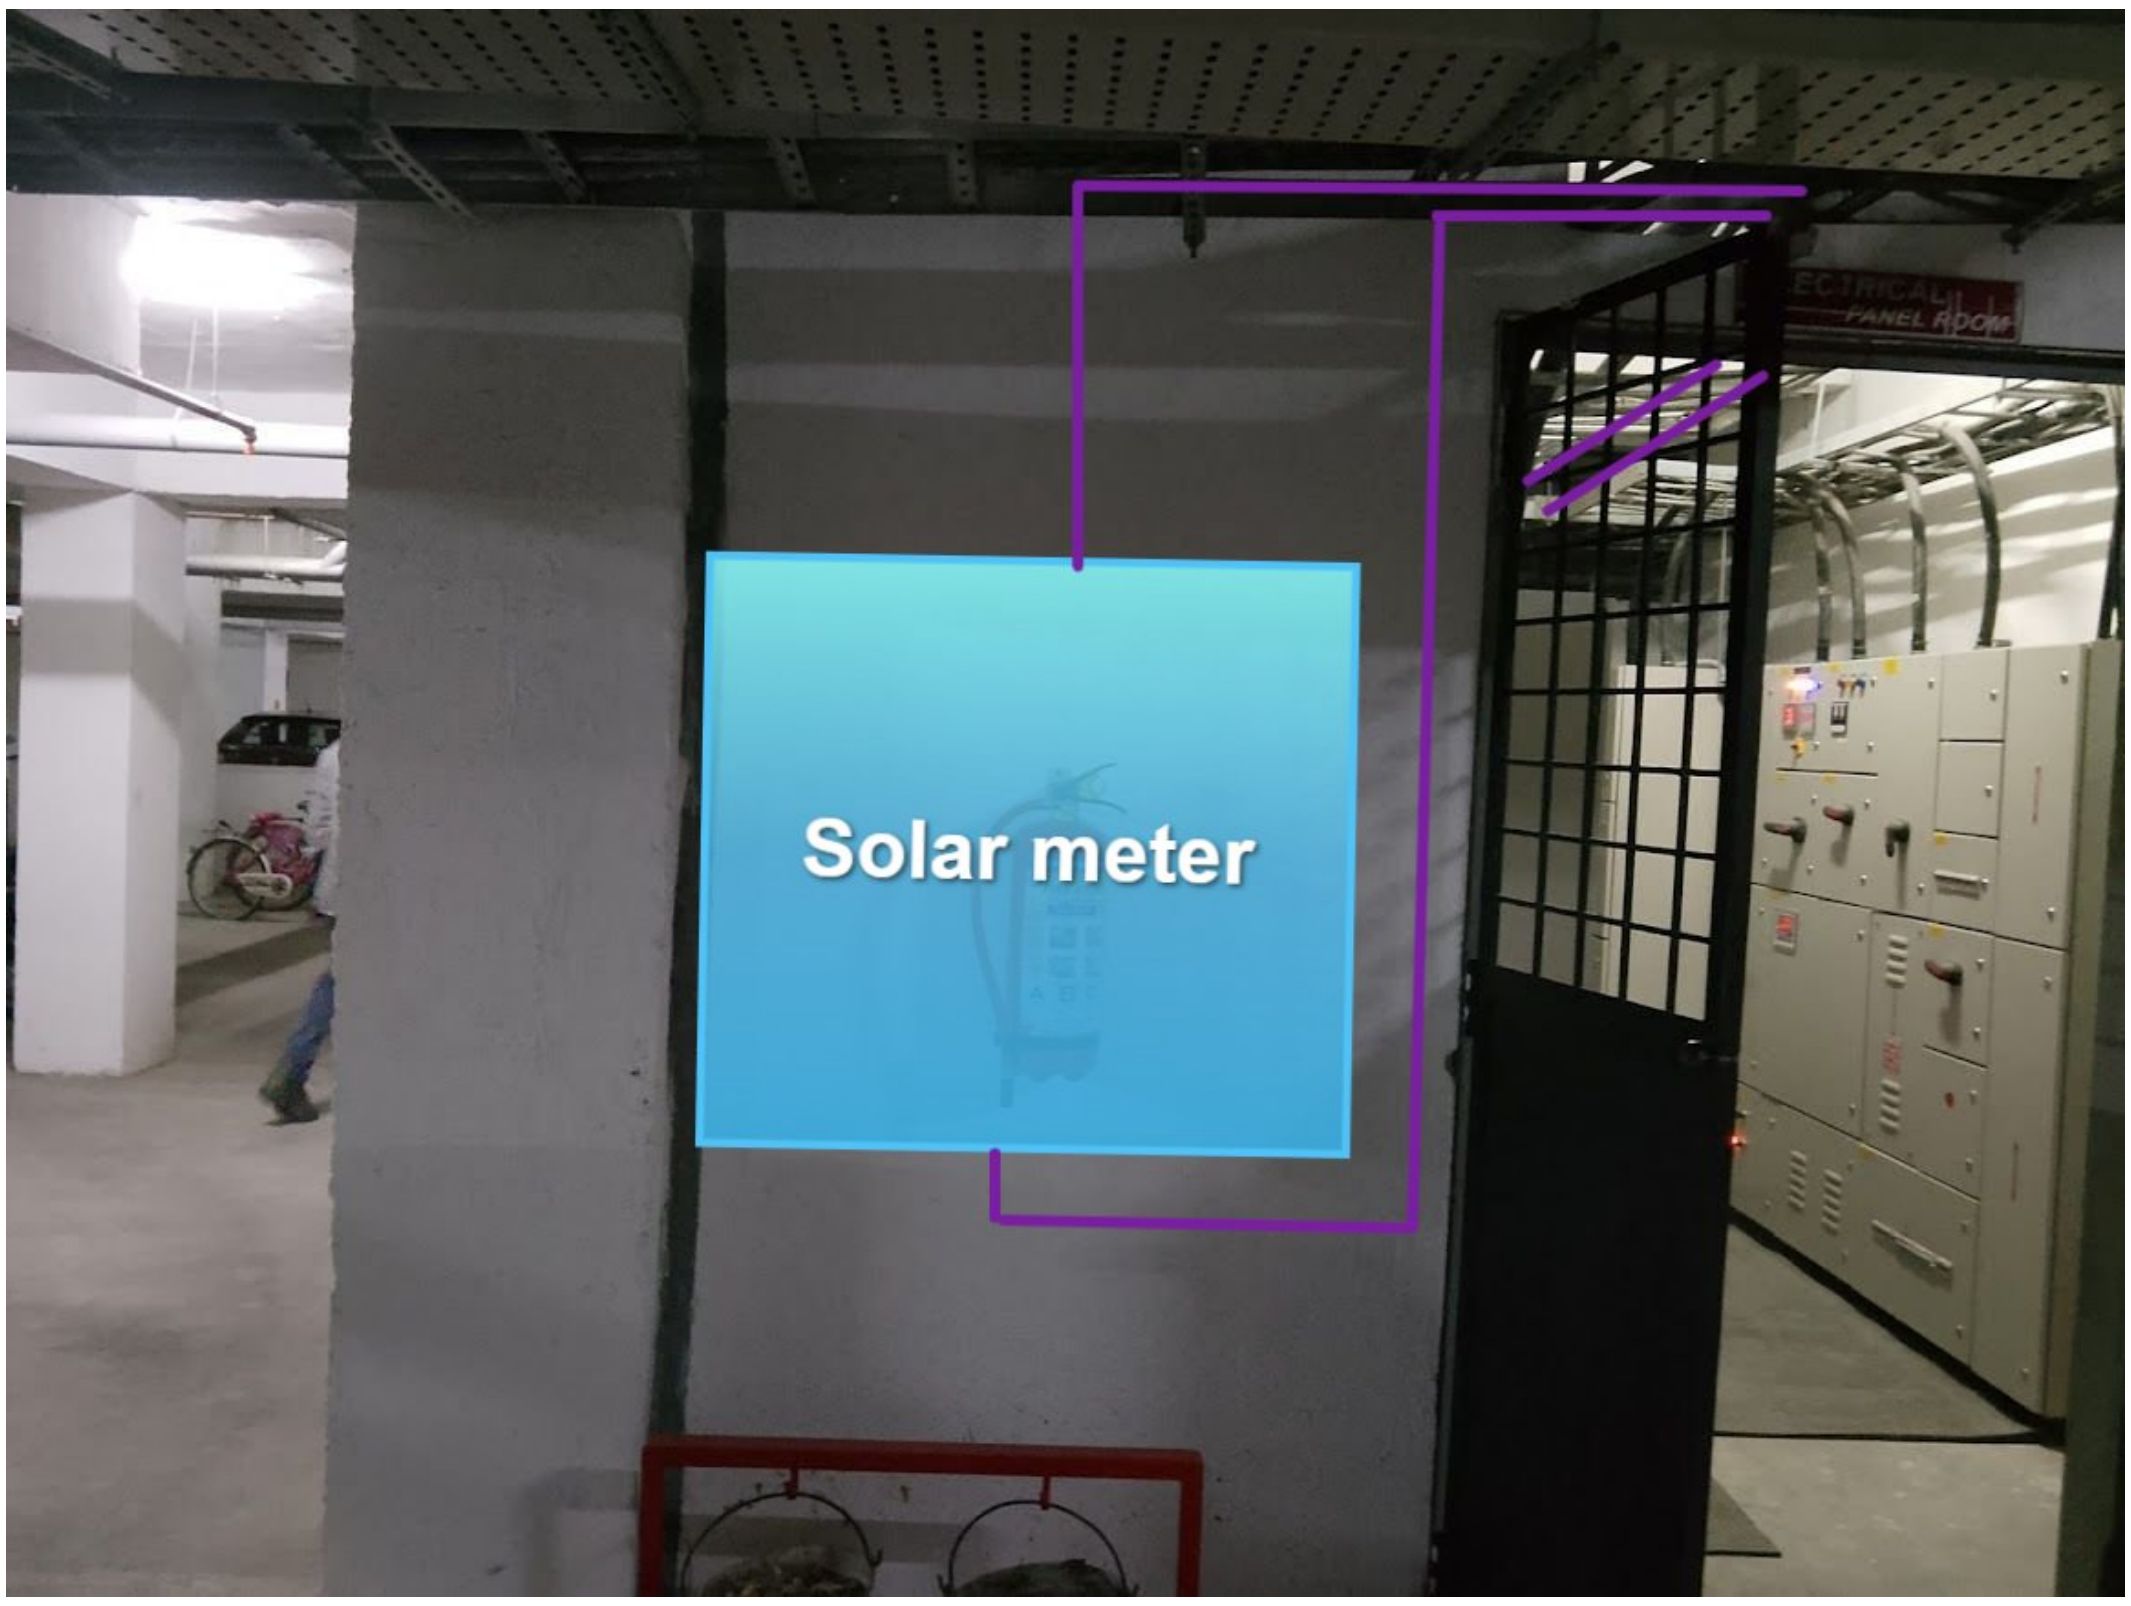

As discussed with the customer, there is no sufficient space available inside the LT panel room for installing the solar meter. Therefore, the solar meter has been proposed to be installed on the external wall of the LT panel room

Earth Pit Location

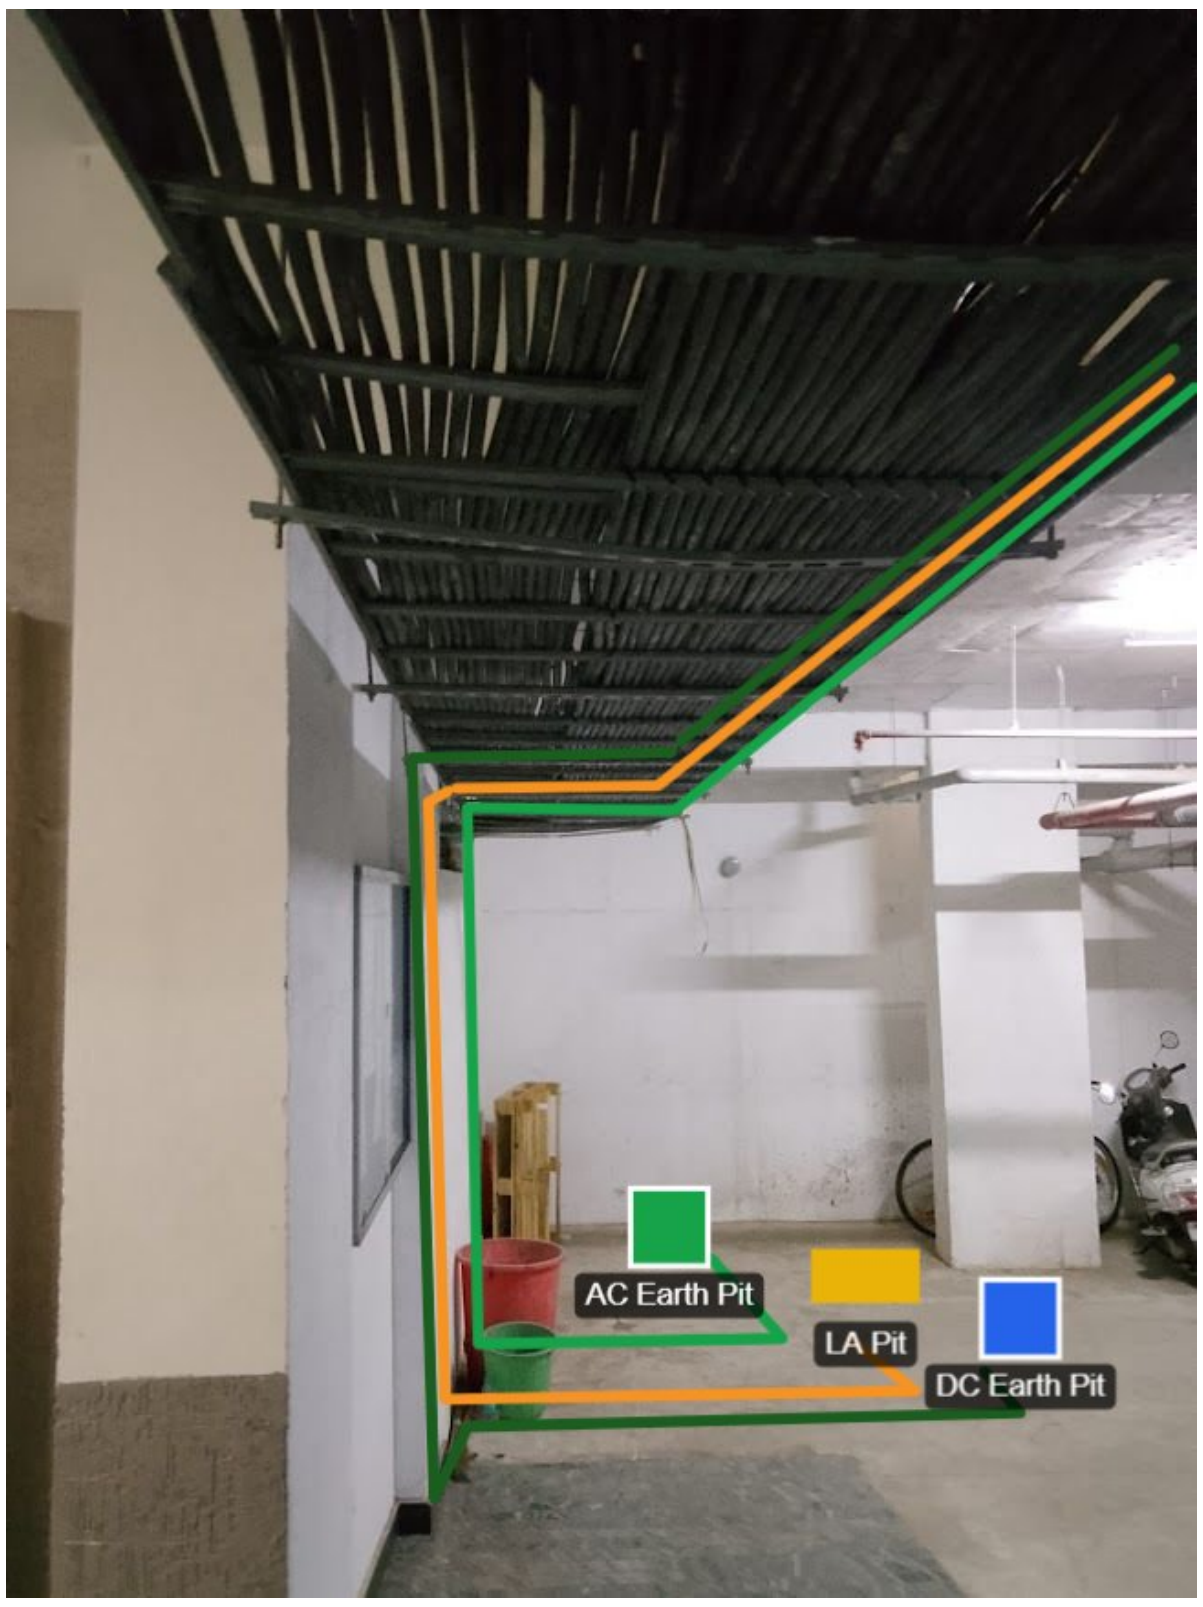

Equipment Location

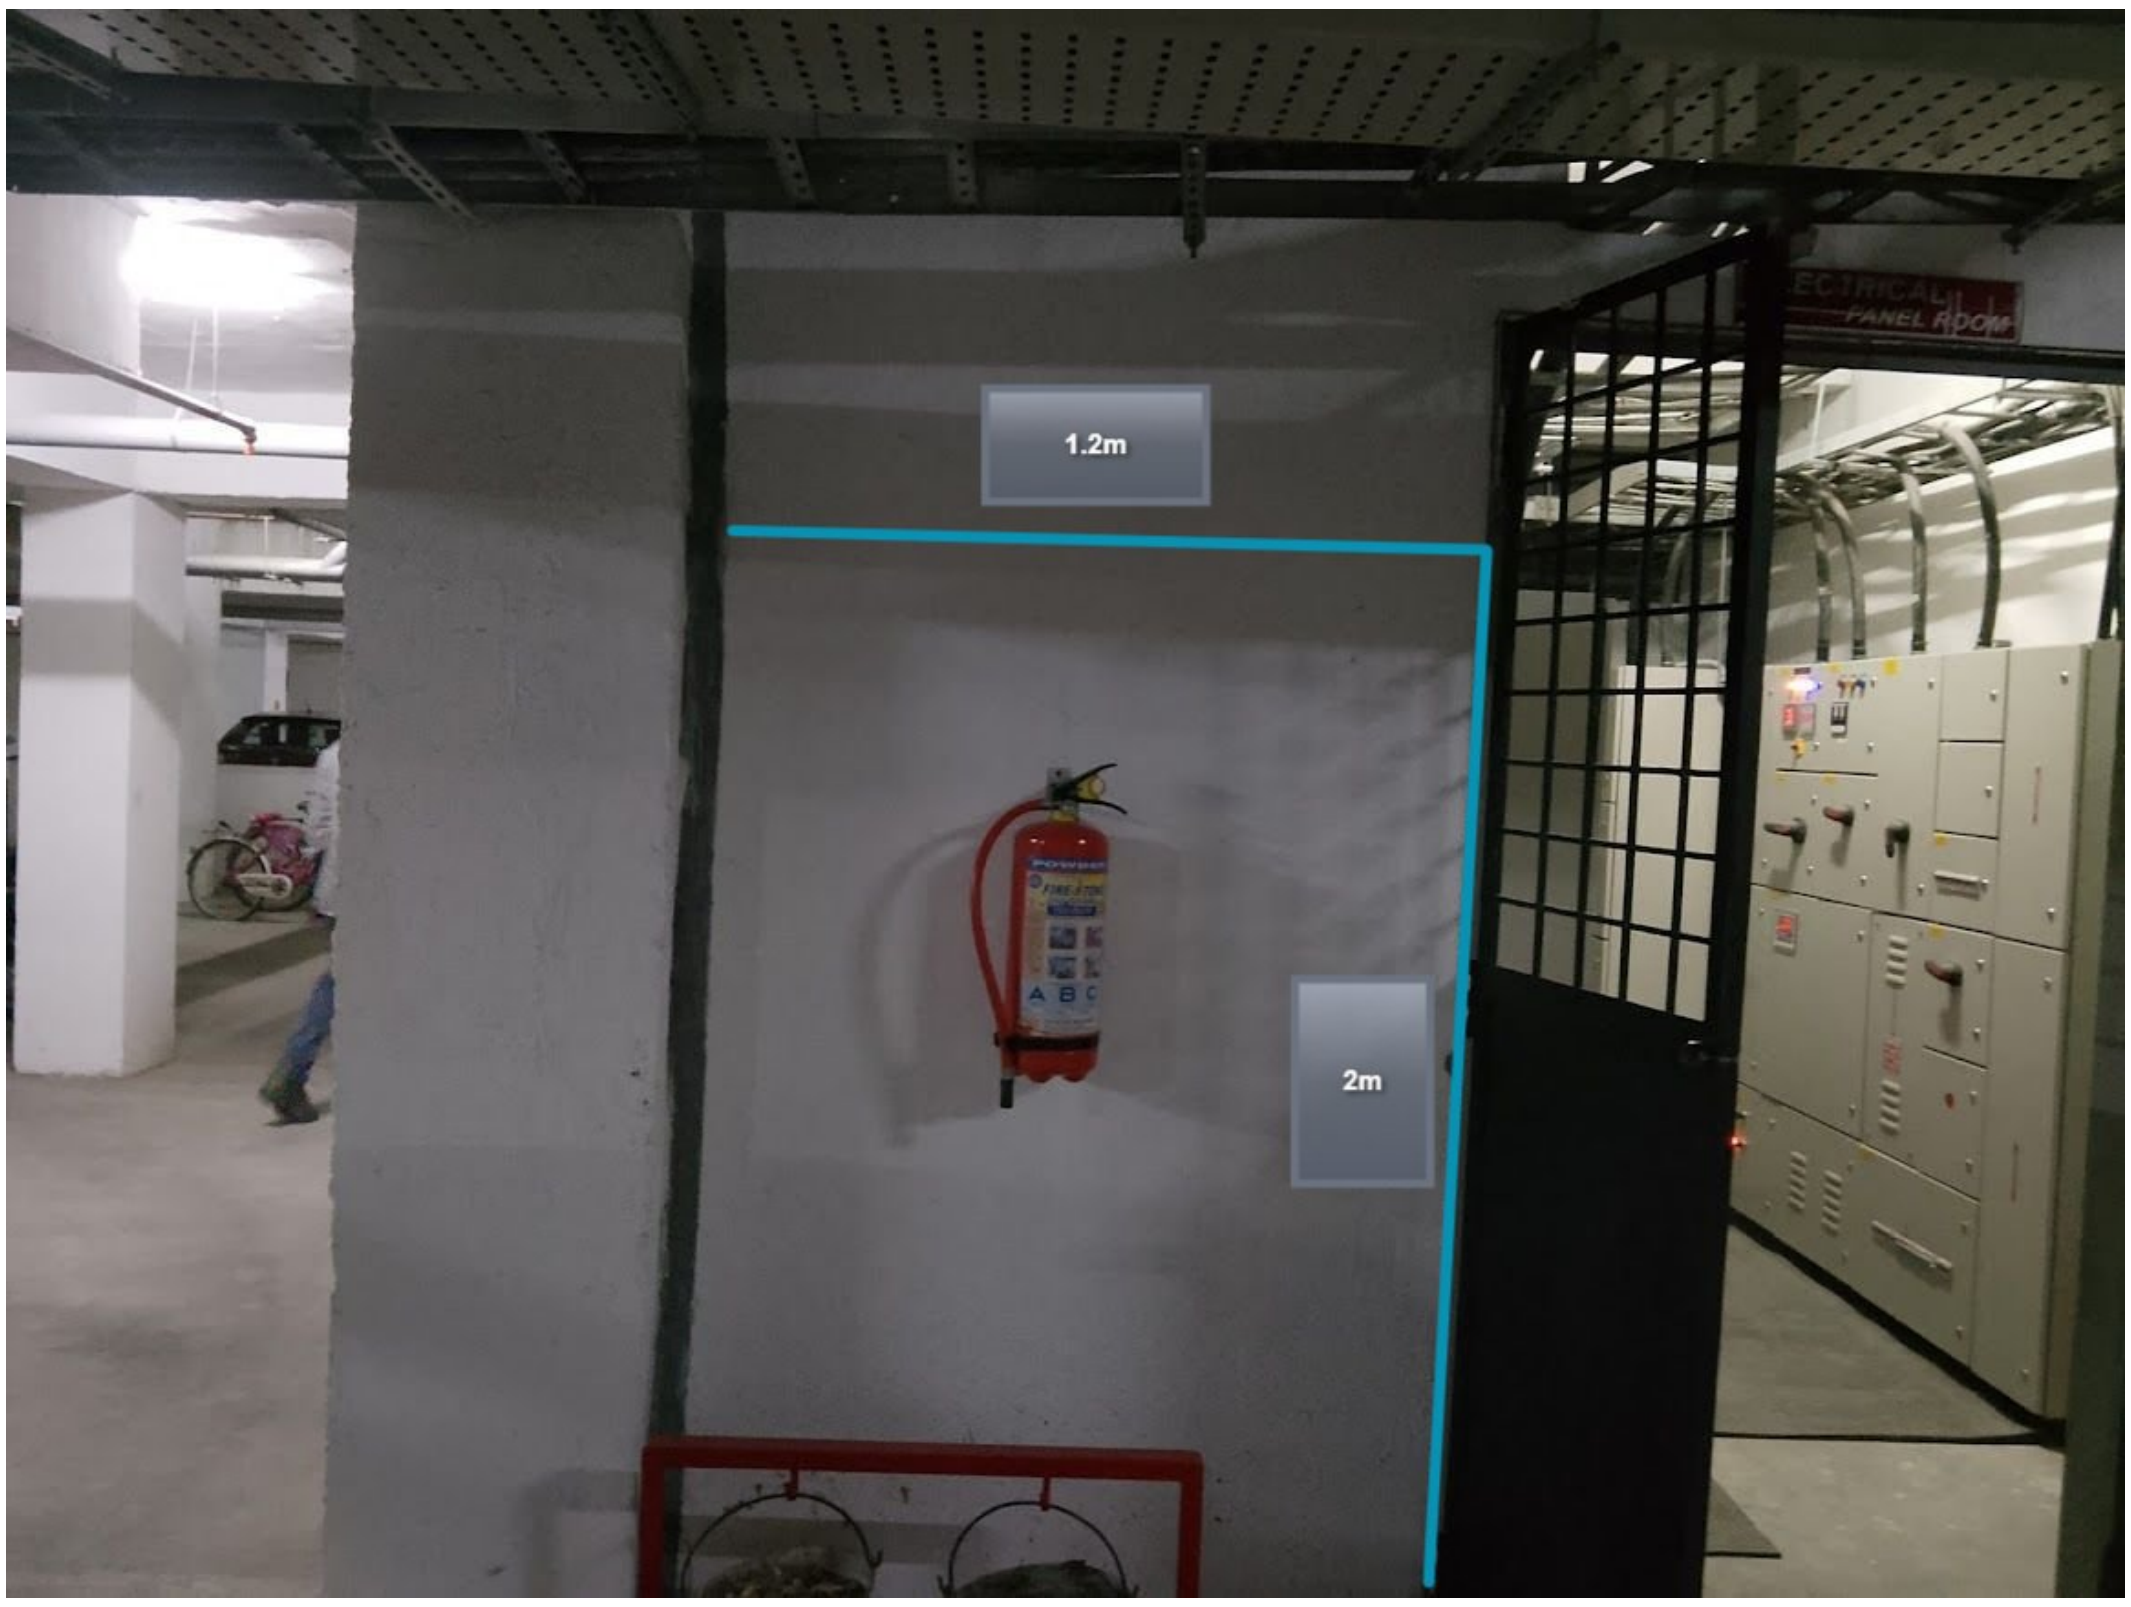

Wall dimensions for the solar meter and main meter cubical placement

OBSERVATIONS & RECOMMENDATIONS

EcoSoch Scope

#	Observation
1	As per the customer's suggestion, the routing, cable earthing, inverter location and also solar meter location have been considered.
2	As discussed with the customer, there is no sufficient space available inside the LT panel room for installing the solar meter. Therefore, the solar meter has been proposed to be installed on the external wall of the LT panel room

Customer Scope

#	Observation
1	Wi-Fi upto solar meter is under customer scope

THANK YOU

Dear Shriram Summitt,

Thank you for choosing EcoSoch Solar for your solar installation. We appreciate your trust in us and your commitment to sustainable energy. Our team is dedicated to ensuring a seamless installation experience and long-term performance of your solar system.

Should you have any questions or require further assistance, please do not hesitate to reach out to us.

Warm Regards,
Team EcoSoch

& Did You Know?

The Sun burns 600 million tonnes of hydrogen per second — and your panels get a share.

EcoSoch Solar Pvt. Ltd.
#940, Sha Arcade, 2nd Phase, NTI Layout, Kodigehalli, Bengaluru 560097
www.ecosoch.com | info@ecosoch.com