Technical Site Visit Report

Prepared for: Neeraj Menta _Skanda Spirit of One_4.92kWp_Microinverter (IQ Series)-Villa 11 - Villa 11

PROJECT INFORMATION

Report Number	ESV-2026-0171
Project ID	B0332B29
Project Name	Neeraj Menta _Skanda Spirit of One_4.92kWp_Microinverter (IQ Series)-Villa 11
Building Name	Villa 11
Project Sector	Residential
Project Type	With Subsidy
Sales Lead	Gautam
Site Address	Villa 11, Skanda Spirit of One, WPMH+563, Gunjur Palya, Bengaluru, Karnataka 560087
GPS Coordinates	12.93332, 77.727661
Google Maps	https://www.google.com/maps?q=12.93332,77.727661
Visit Date	2026-07-11
Visited By	ABILASH N K
Revision	Rev 0

CLIENT INFORMATION

Client Name	Neeraj Menta
Contact	99009 14255

PROJECT DETAILS

Solar Rooftop System Type	On-Grid
System Capacity (kWp)	4.92
Sanction Load (kW)	5
Module Make & Capacity	Adani DCR bifacial, 615 Wp
Module Length (mm)	2382

Module Width (mm)	1133
Number of Panels	8
Inverter Type	Micro
Inverter Brand	Enphase IQ8P
Number of Inverters	8
Mounting Structure Type	RCC Flat Roof

SITE INSPECTION CHECKLIST

General

#	Question	Answer	Notes
1	Can the delivery van/truck reach the material unloading point?	Yes	-
2	Are there any obstacles at the site that could hinder material lifting?	**No**	-
3	Where will the Inverter, DCDB, ACDB, Battery, etc. be located?	The Enphase accessories box inbuilt with a solar meter provision can be installed near the existing main meter box located at the car porch on the front side of the building.	-
4	Is a canopy required for protecting the Inverters/ACDB/DCDB?	**No**	-
5	Did you discuss the location of the earth pits with the customer?	Yes, discussed with the customer and finalised the location for earthing.	-
6	Where is the Internet Router located?	Ground floor	-
7	What's the Wi-Fi strength of the router near to the String inverter/Envoy?	3 bars	-
8	Did you pin the site location in your WhatsApp when you were at the site?	Yes	-

Roof Details

#	Question	Answer	Notes
1	What type of roof is present at the site?	RCC Flat Roof	-
2	Are there any obstructions on the roof that could affect the solar installation?	**No**	-
3	What is the angle of the panels? (in degrees)	10	-
4	In case of sloped roof, what is the slope angle of the roof? (in degrees)	N/A	-
5	On how many roofs at the site are we installing solar?	1	-

#	Question	Answer	Notes
6	If it is a Tiled roof, what is underneath the tiles?	N/A	-
7	If it is a Tiled roof with MS or Wooden rafters, is it Single-tiled or Double-tiled?	N/A	-
8	What type of mounting structure is planned?	Ballast	-
9	What is the orientation of the solar panels?	["South"]	-
10	How can the roof be accessed?	Staircase	*One can access the terrace floor via the inner staircase. But the roof proposed for installation can be accessed with the help of a ladder.*
11	Is the building currently under construction?	**No**	-
12	In an under-construction building, are existing conduit pipes available for AC, DC cables, and earthing?	N/A	-
13	What is the height of the building and how many floors does it have?	12 Metres. (G + 2 + headroom)	-
14	Is the site photo matching with the building description?	Yes	-
15	Is there an overhead HT line passing within a 10-meter radius of the site?	**No**	-

Residential / Electrical

#	Question	Answer	Notes
1	What type of energy meter is currently installed?	No Meter	*A metal three-phase meter cubicle is available at the site for the main meter. But the customer is awaiting the meter connection from BESCOM.*
2	Is the Meter cubicle photo matching with the previous answer?	Yes	-
3	Has the termination point in the Main meter panel been identified?	Yes	-
4	Is the Termination Point easily visible or sealed?	Visible	-
5	Is a Lightning Arrestor (LA) already available at the site?	**No**	-
6	Is space available for CT within Energy meter panel?	N/A	-
7	In case of an Enphase system, is the distance between the farthest micro-inverter and IQ Gateway > 50m?	Less than 50m	-
8	Provide details of the existing CT ratings (if applicable).	N/A	-
9	In Main meter panel, is empty space available for solar meter?	**No**	-
10	In Main meter panel, is empty space available to house the Enphase accessories or ACDB components?	**No**	*An Enphase accessories box with a built-in solar meter fixing provision has to be provided.*
11	Is there space available to dig DC, AC and LA earth pits?	Yes	*Space is available at the garden area in front of the building.*
12	In case of elevated structures, is an LA extension provided at the far end?	N/A	-
13	In case of elevated structures, is it with or without grouting?	N/A	-
14	Are there any challenges with respect to Installation and Maintenance activities?	**No**	-

#	Question	Answer	Notes
15	Are there any safety risks associated with accessing the roof for installation?	**No**	-
16	Is space present in rooftop to store the panels?	Horizontally sleeping	-
17	In case of sloped roof MS structure, provide the dimension of rafter to rafter, purlin to purlin.	N/A	-
18	Is ventilation available in the battery location?	N/A	-
19	Should the Inverters/ACDB/DCDB be installed on a metal grill or wall mount?	An Enphase accessories box with a built-in solar meter fixing provision has to be provided as wall mounted.	-
20	Provide the dimensions for solar meter cubicle placement (L x W of wall).	length: 2000, width: 2000	-
21	Provide the dimension for earth pits location (L x W of available space).	length: 3000, width: 1000	-
22	Is LAN cable under customer scope?	Yes	-
23	Is there any shadow that affects the solar installation?	**No**	-
24	Is there any trench work to be done to carry the AC cable to the meter location?	N/A	-

PHOTO DOCUMENTATION

Cable Routing Legend

Legend	Description
	Proposed PV Module Array
	Main Meter Location
	Solar Meter
	Battery
	Inverter
	Other Equipment
	DC Cable
	AC Cable
	Material Shifting
	DC Earthing Cable
	AC Earthing Cable
	LA Cable
	DC Earth Pit
	AC Earth Pit
	LA Pit
	LA

Site Layout - Top View

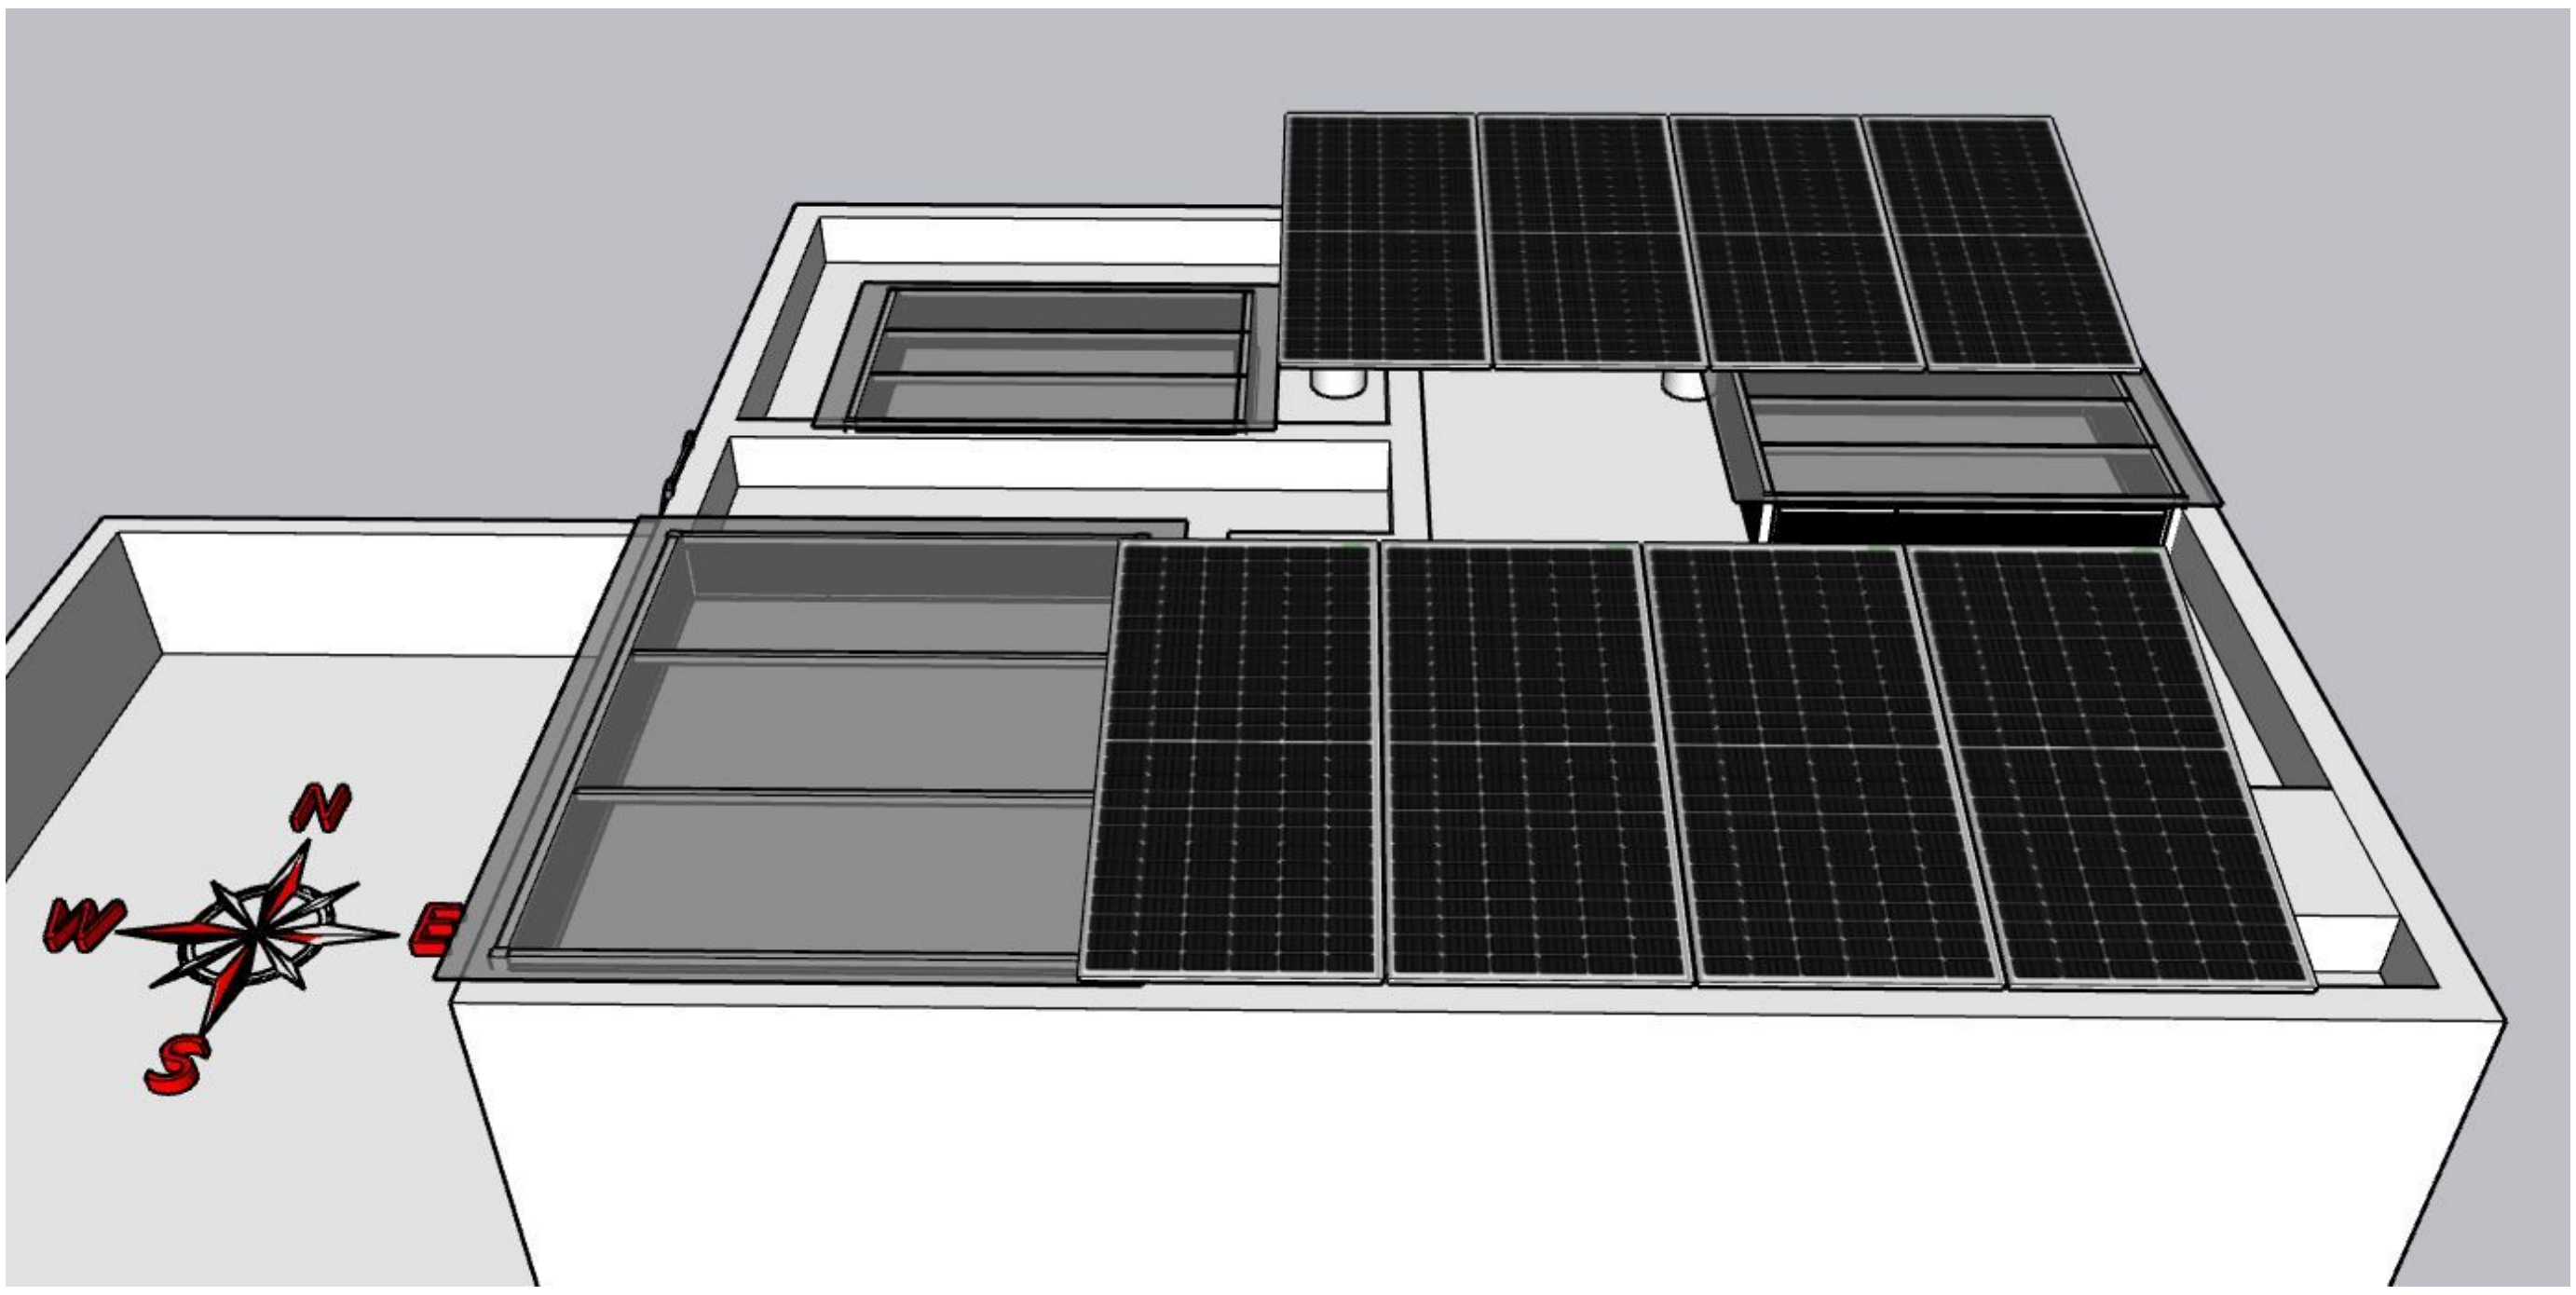

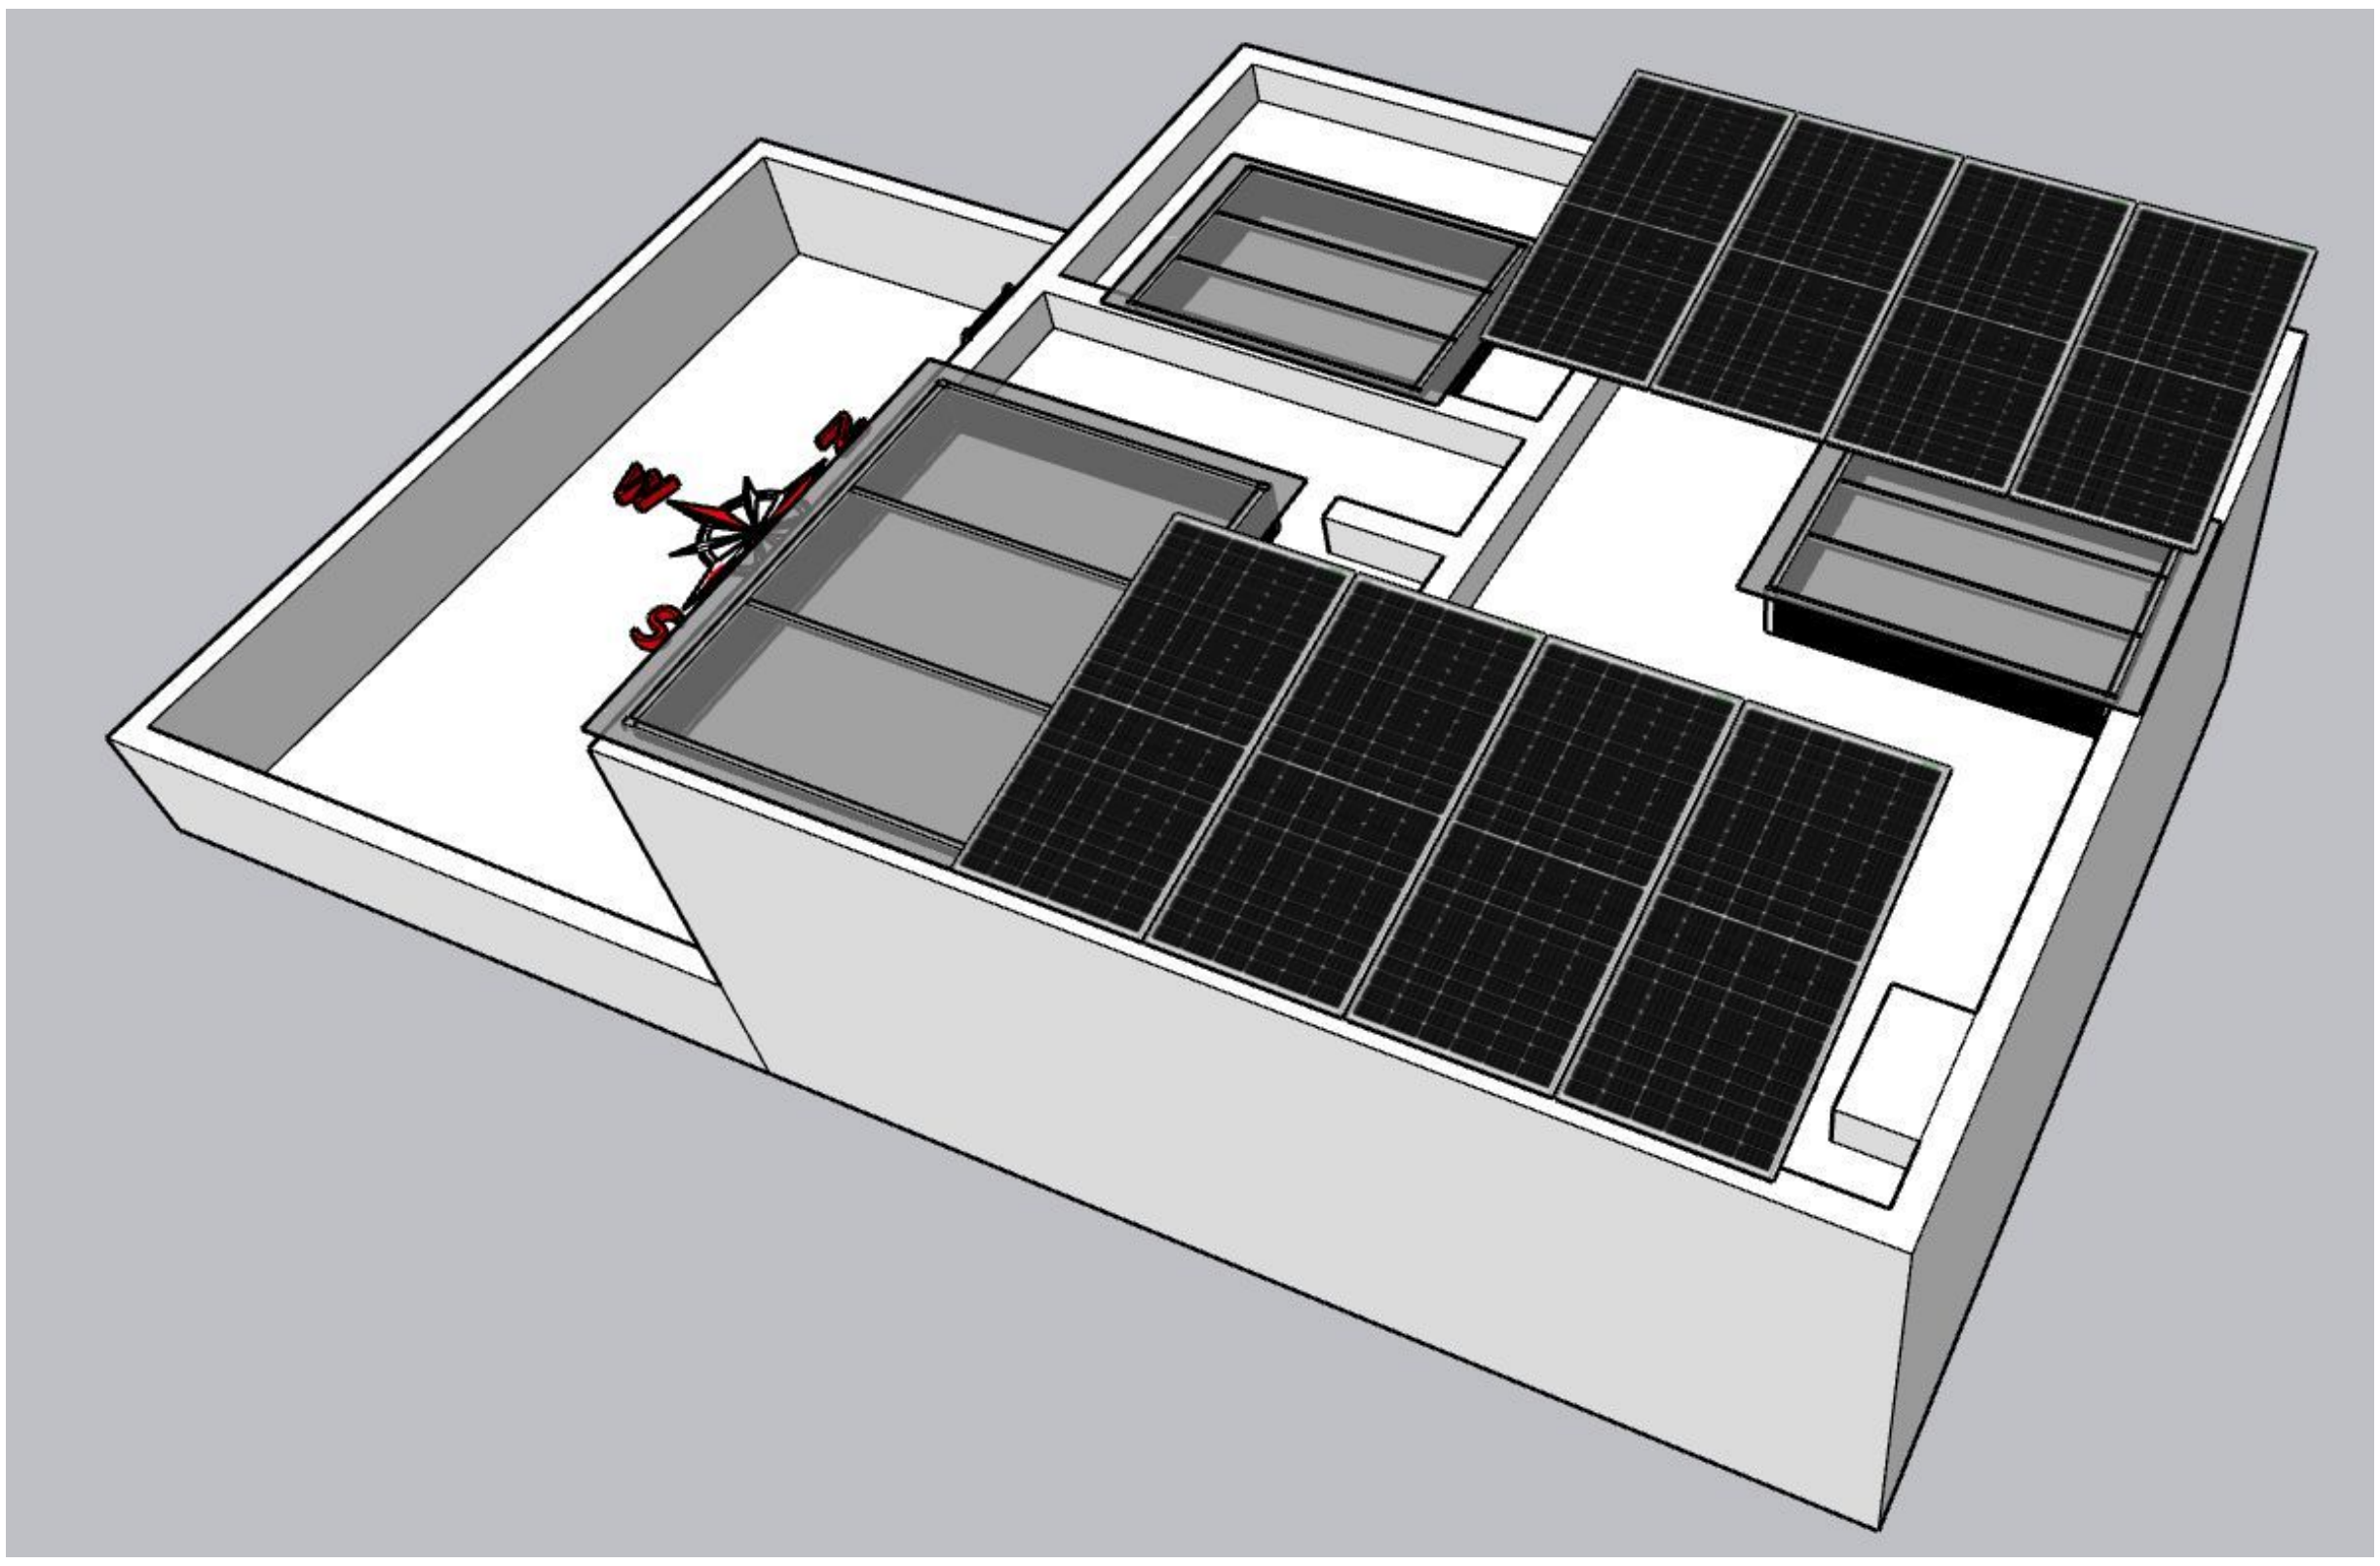

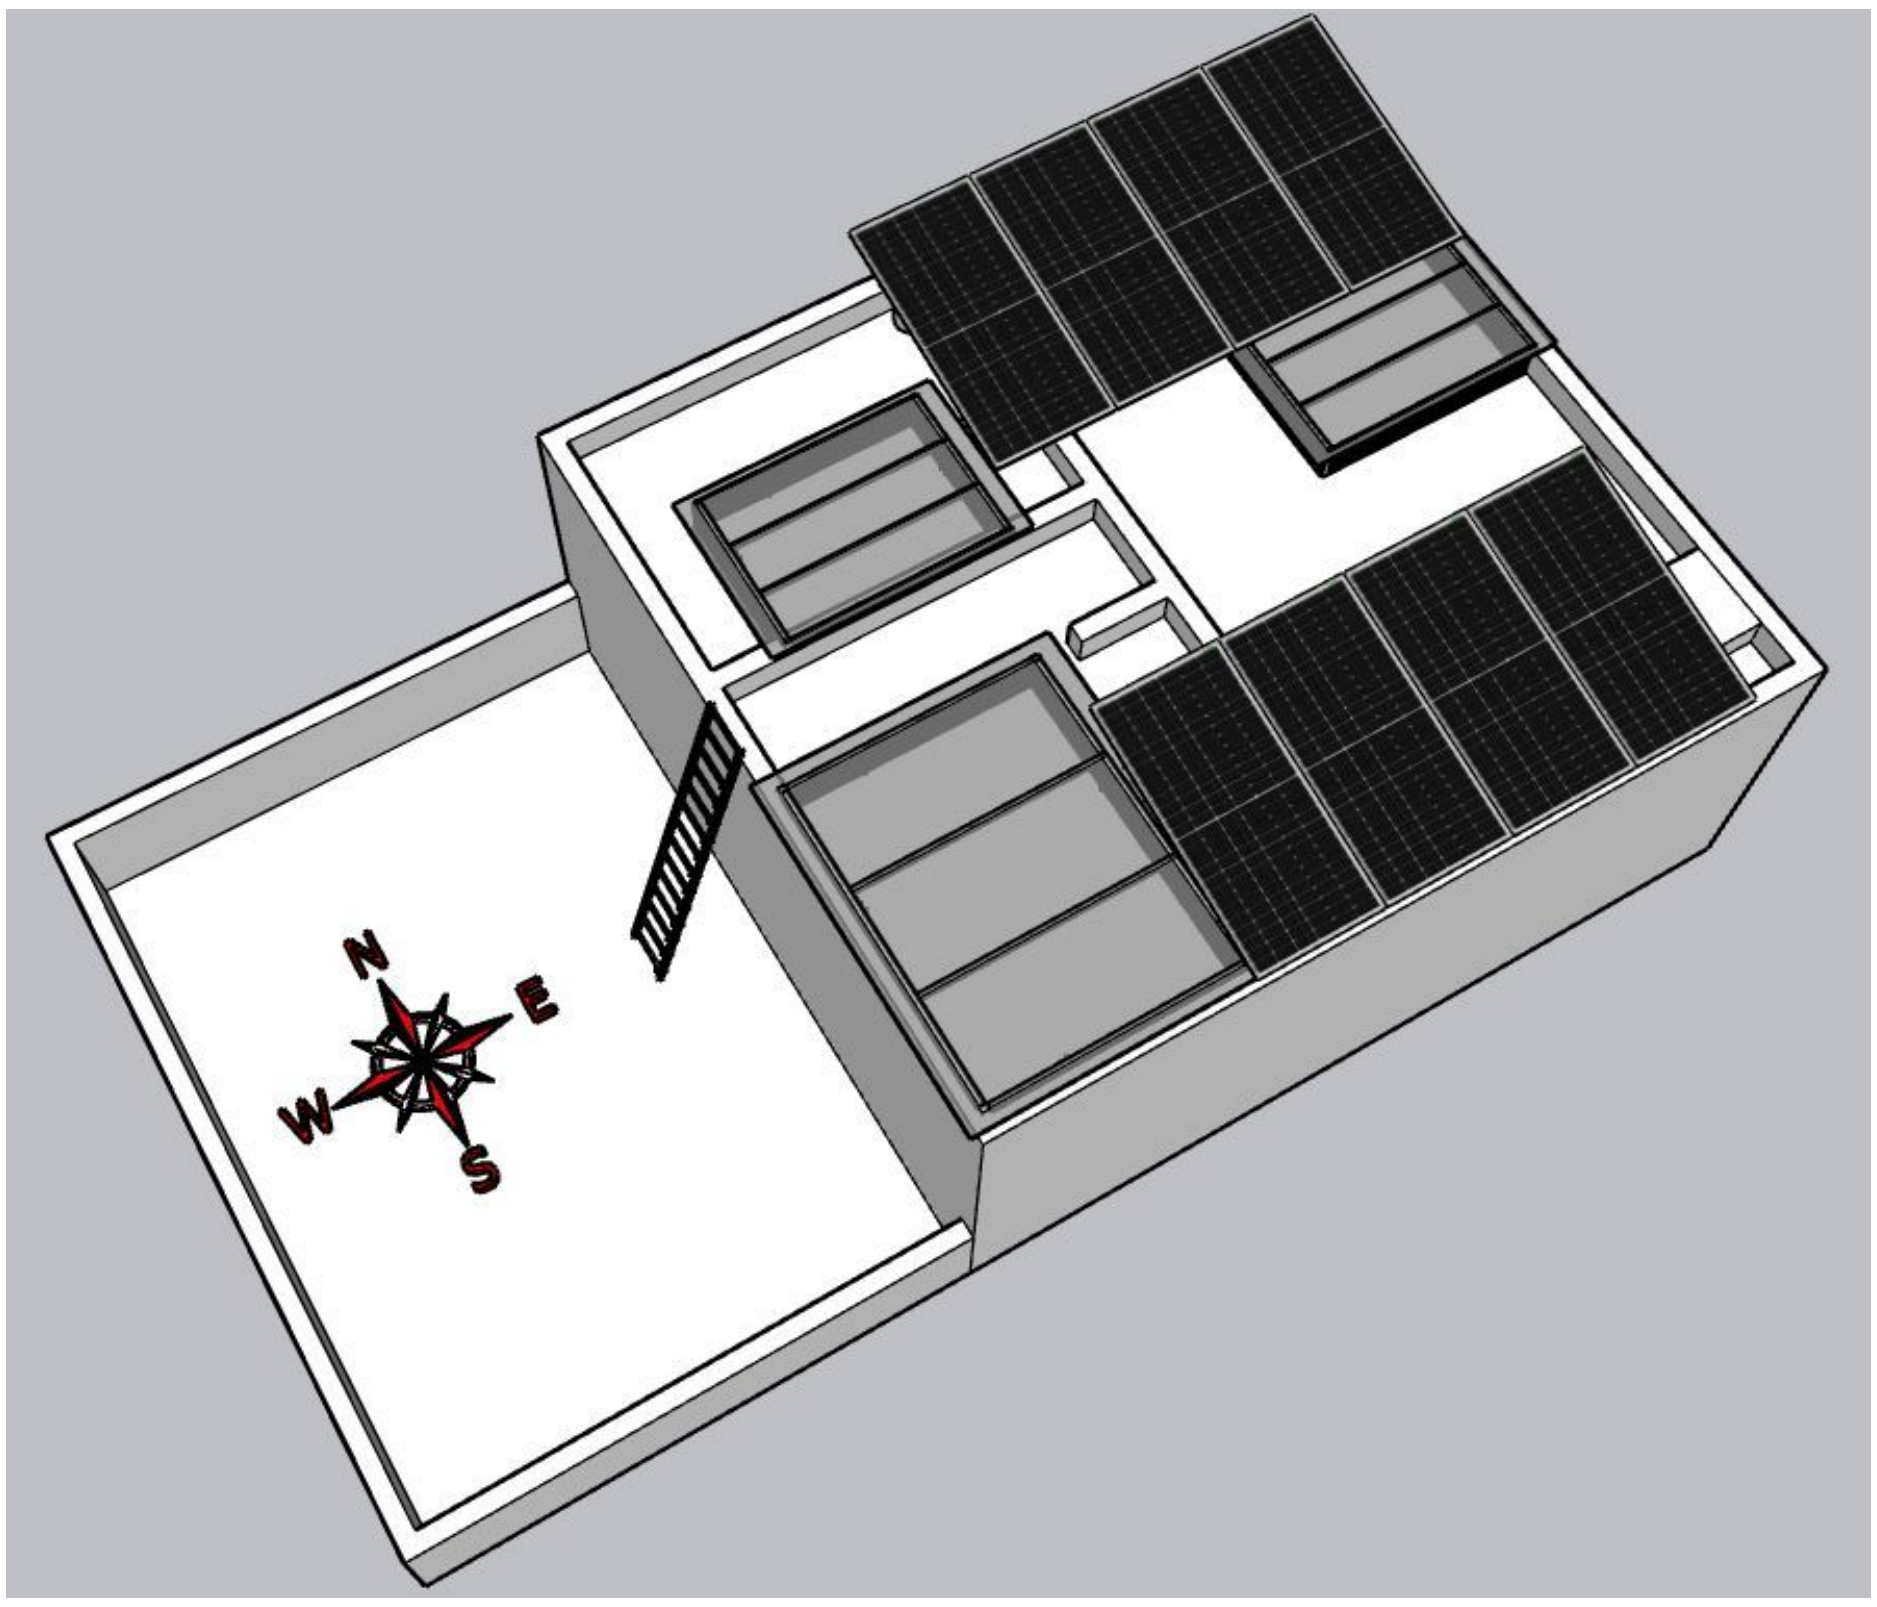
N
E
W
S

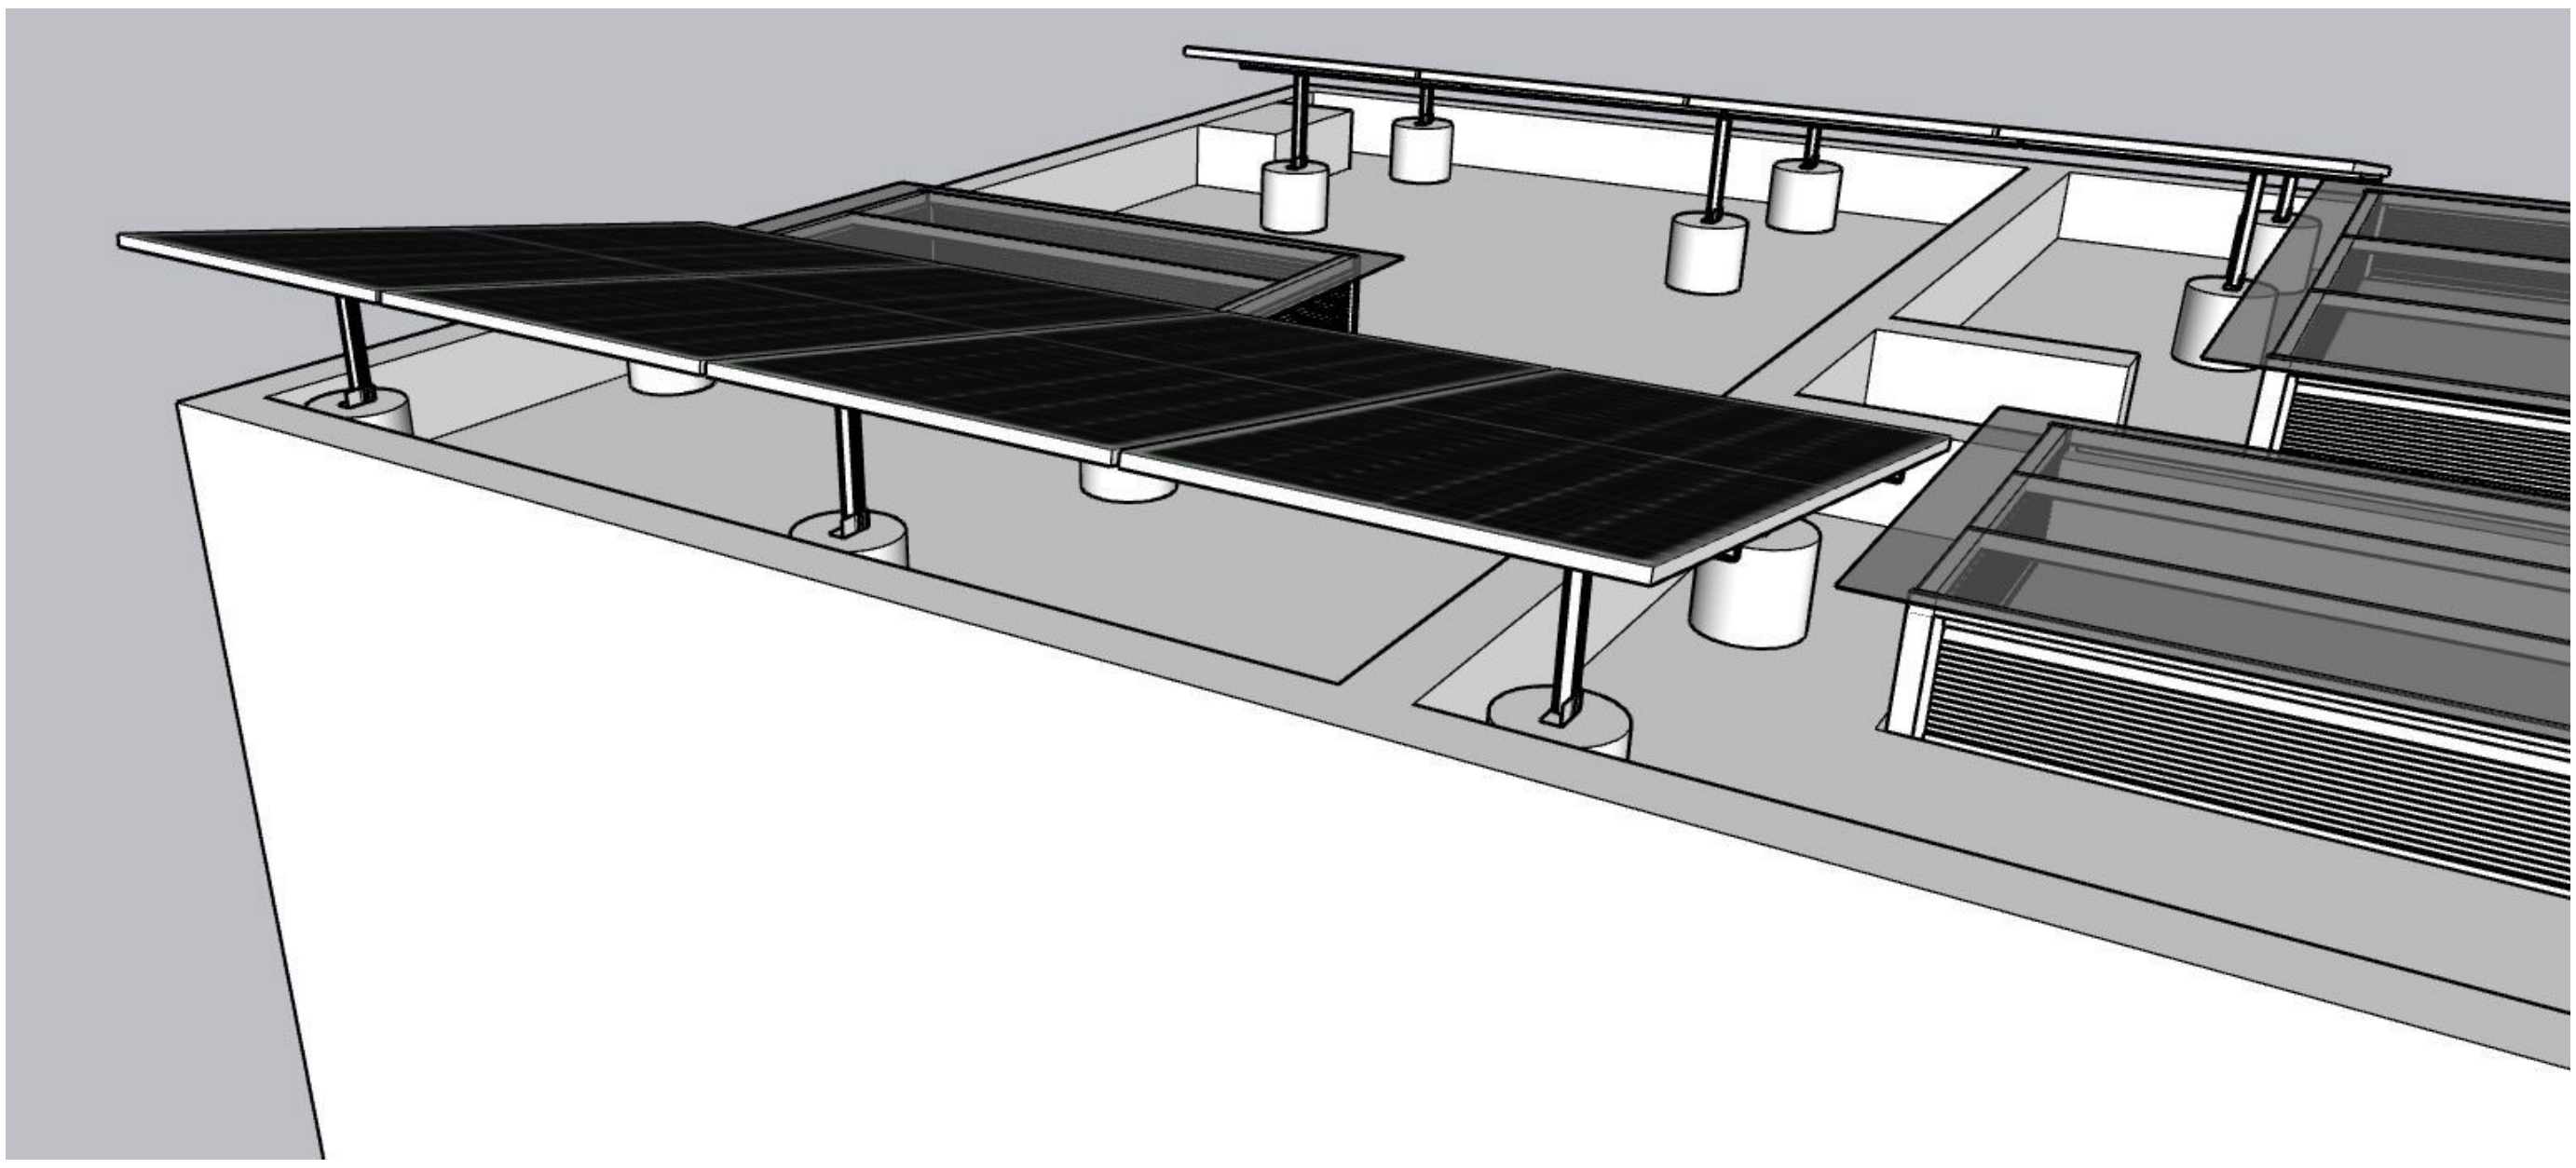

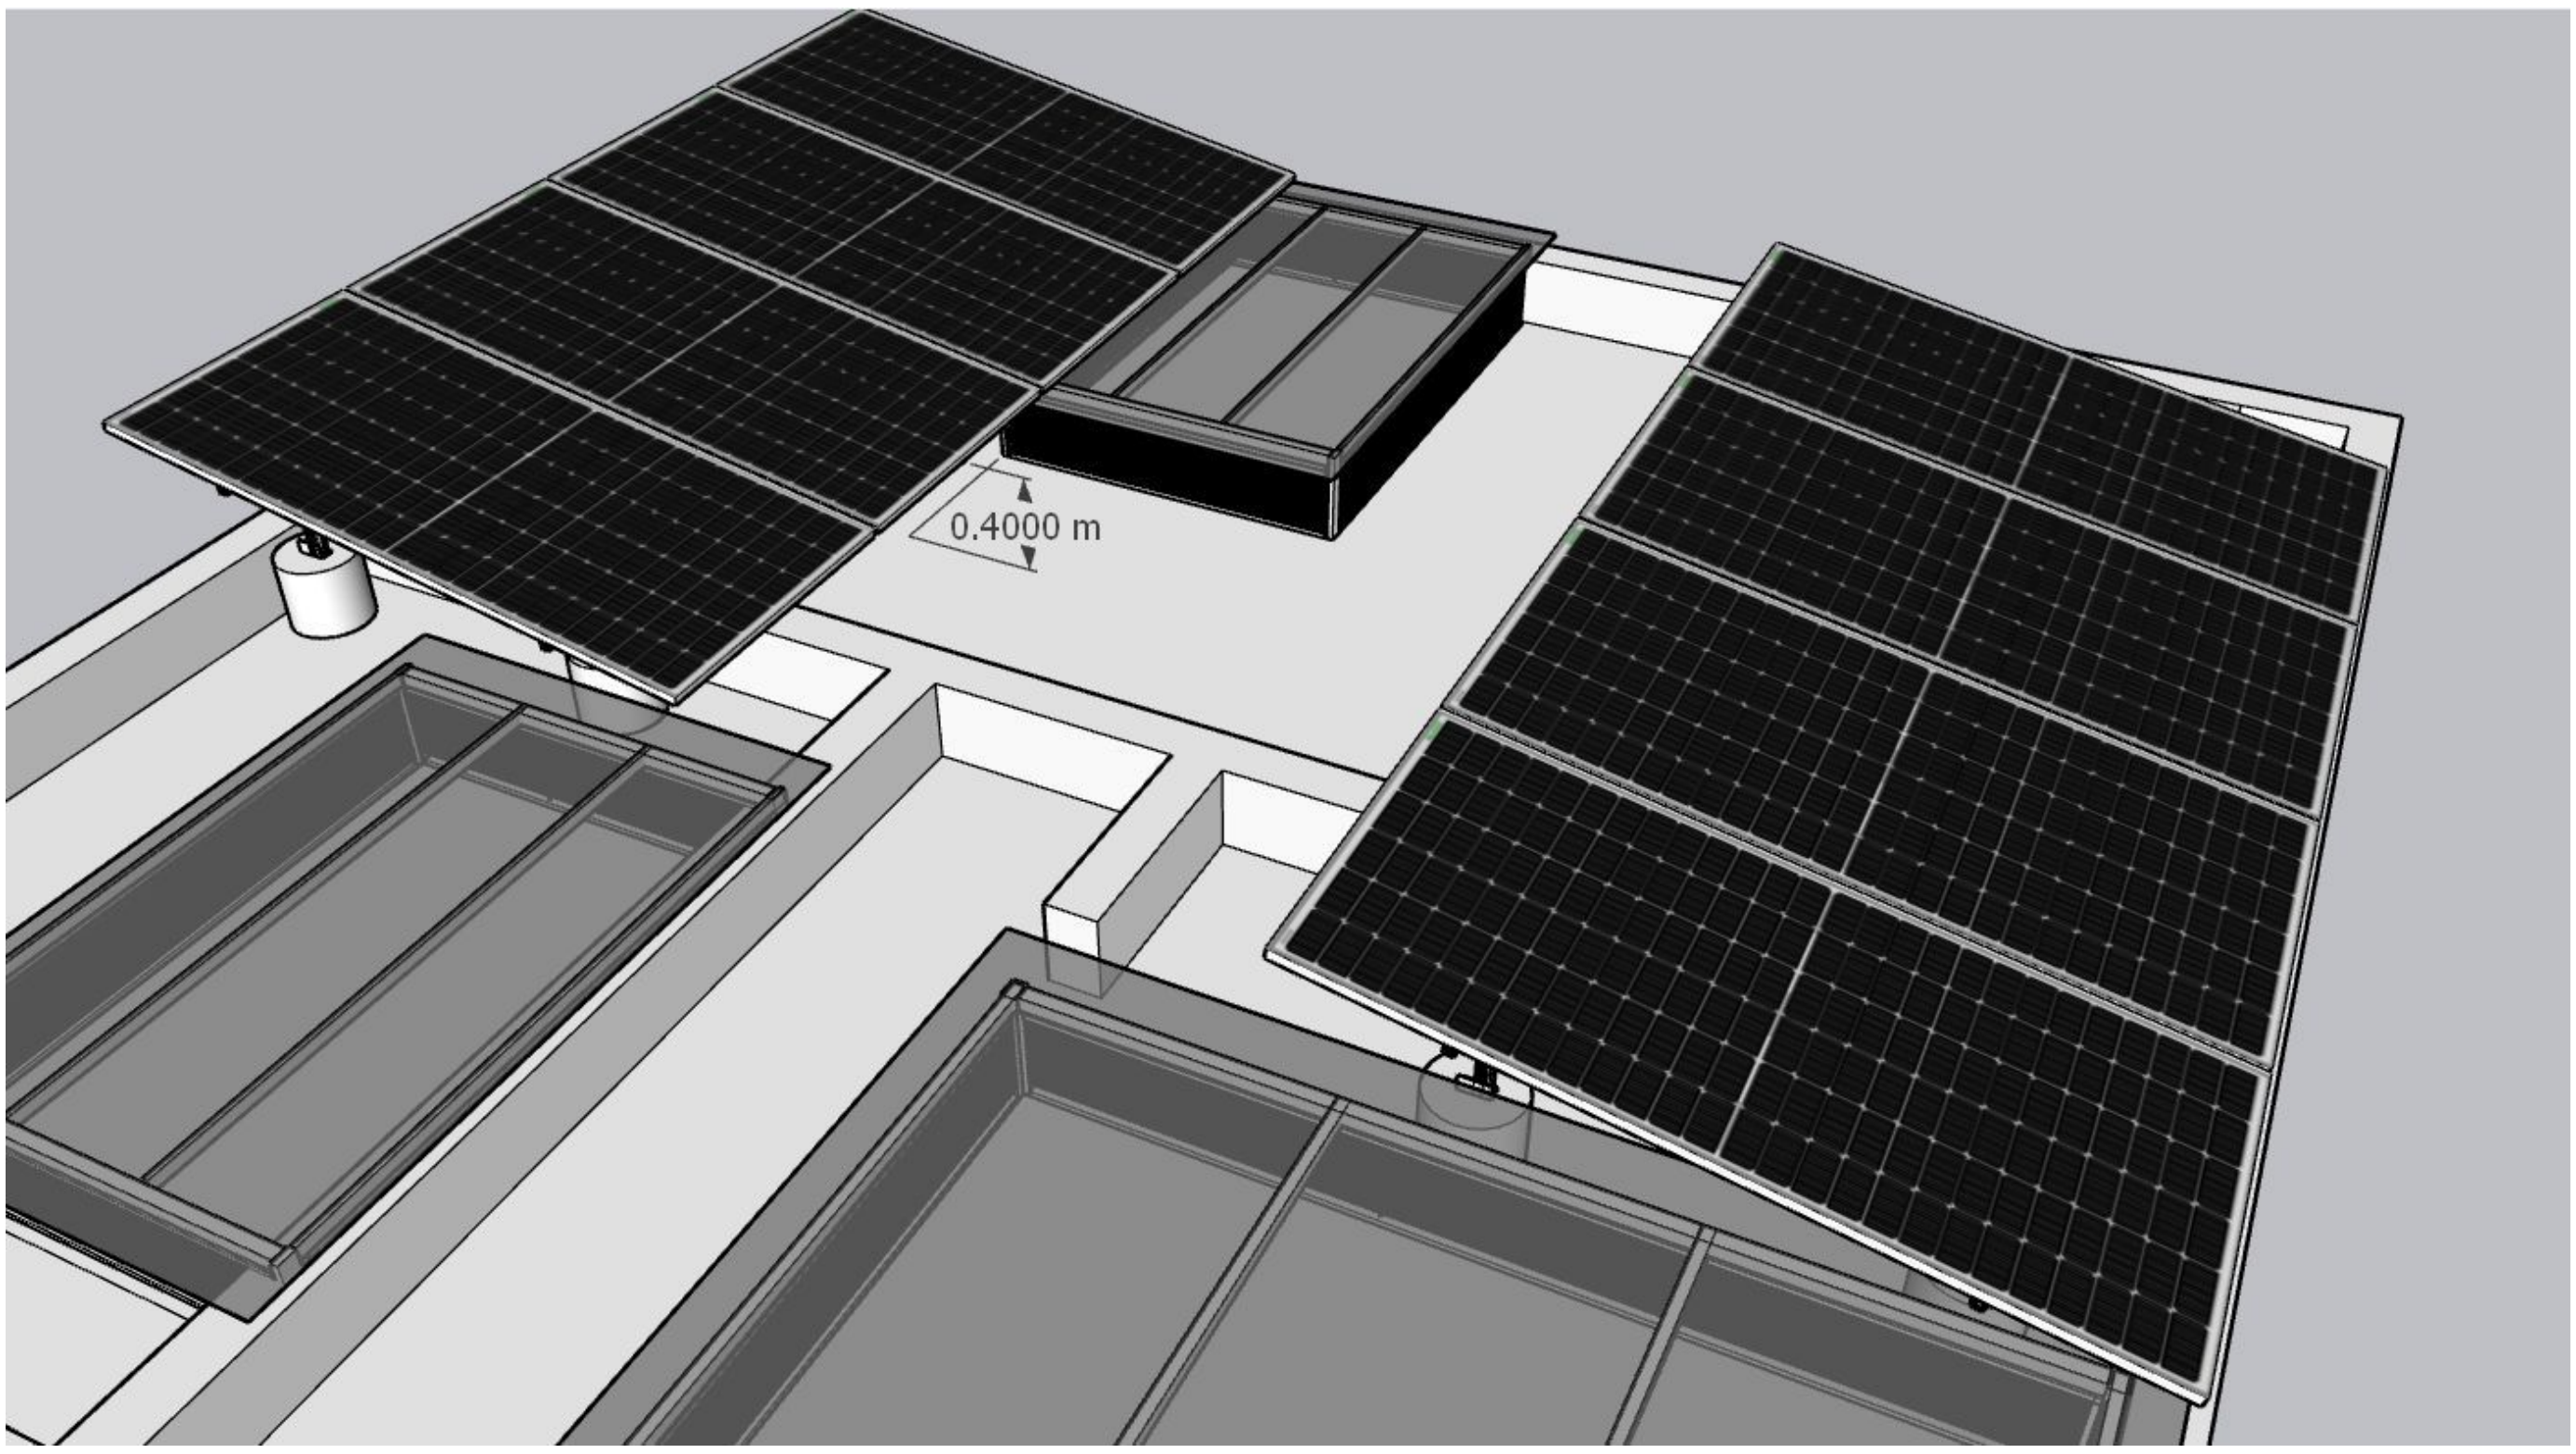
0.4000 m

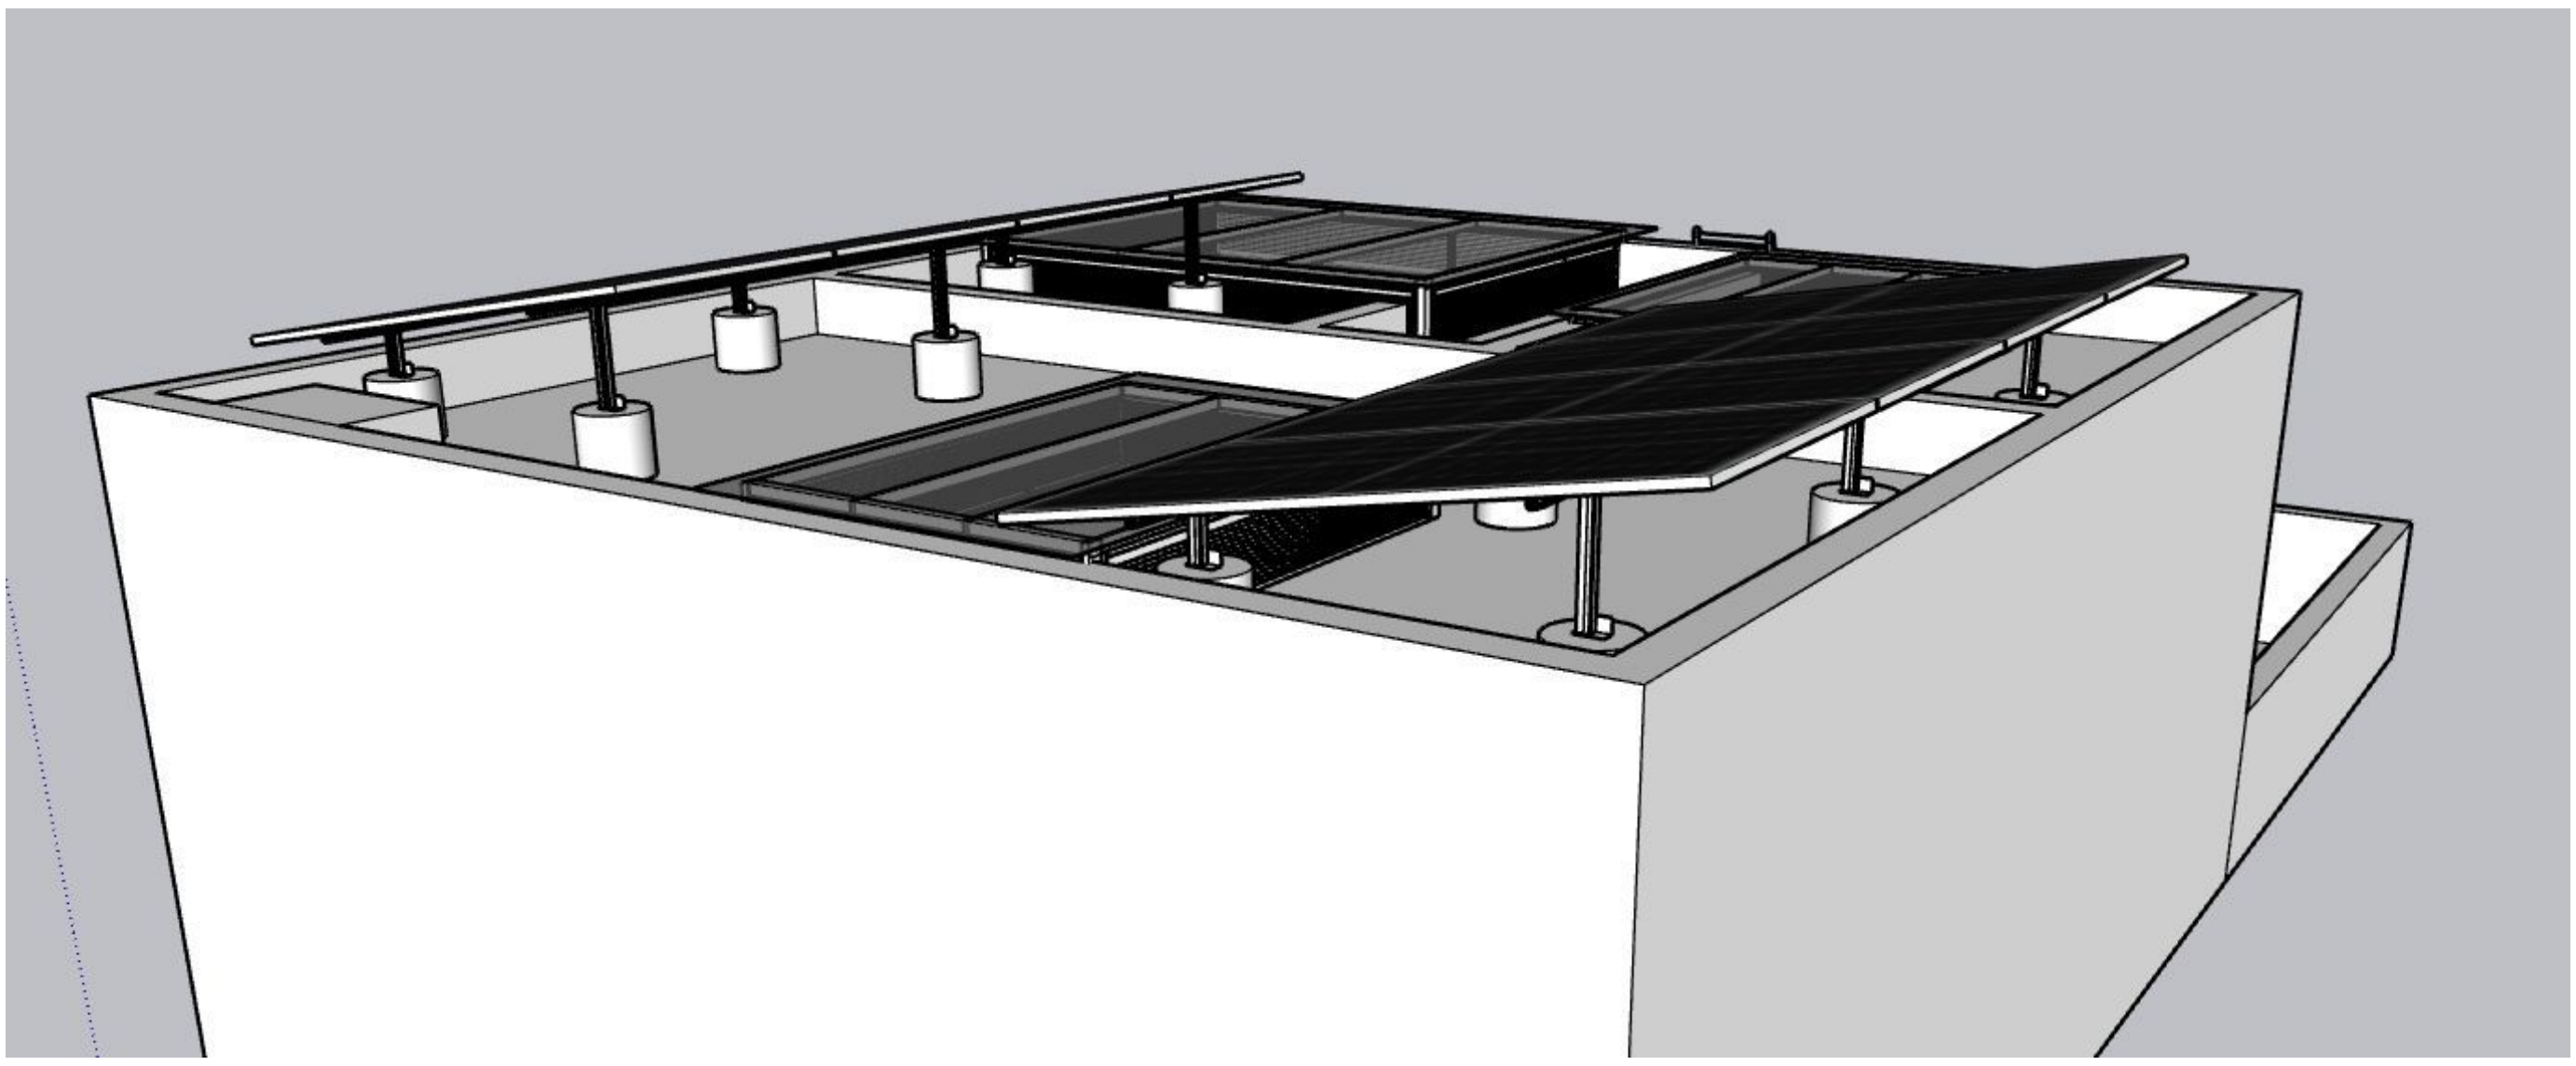

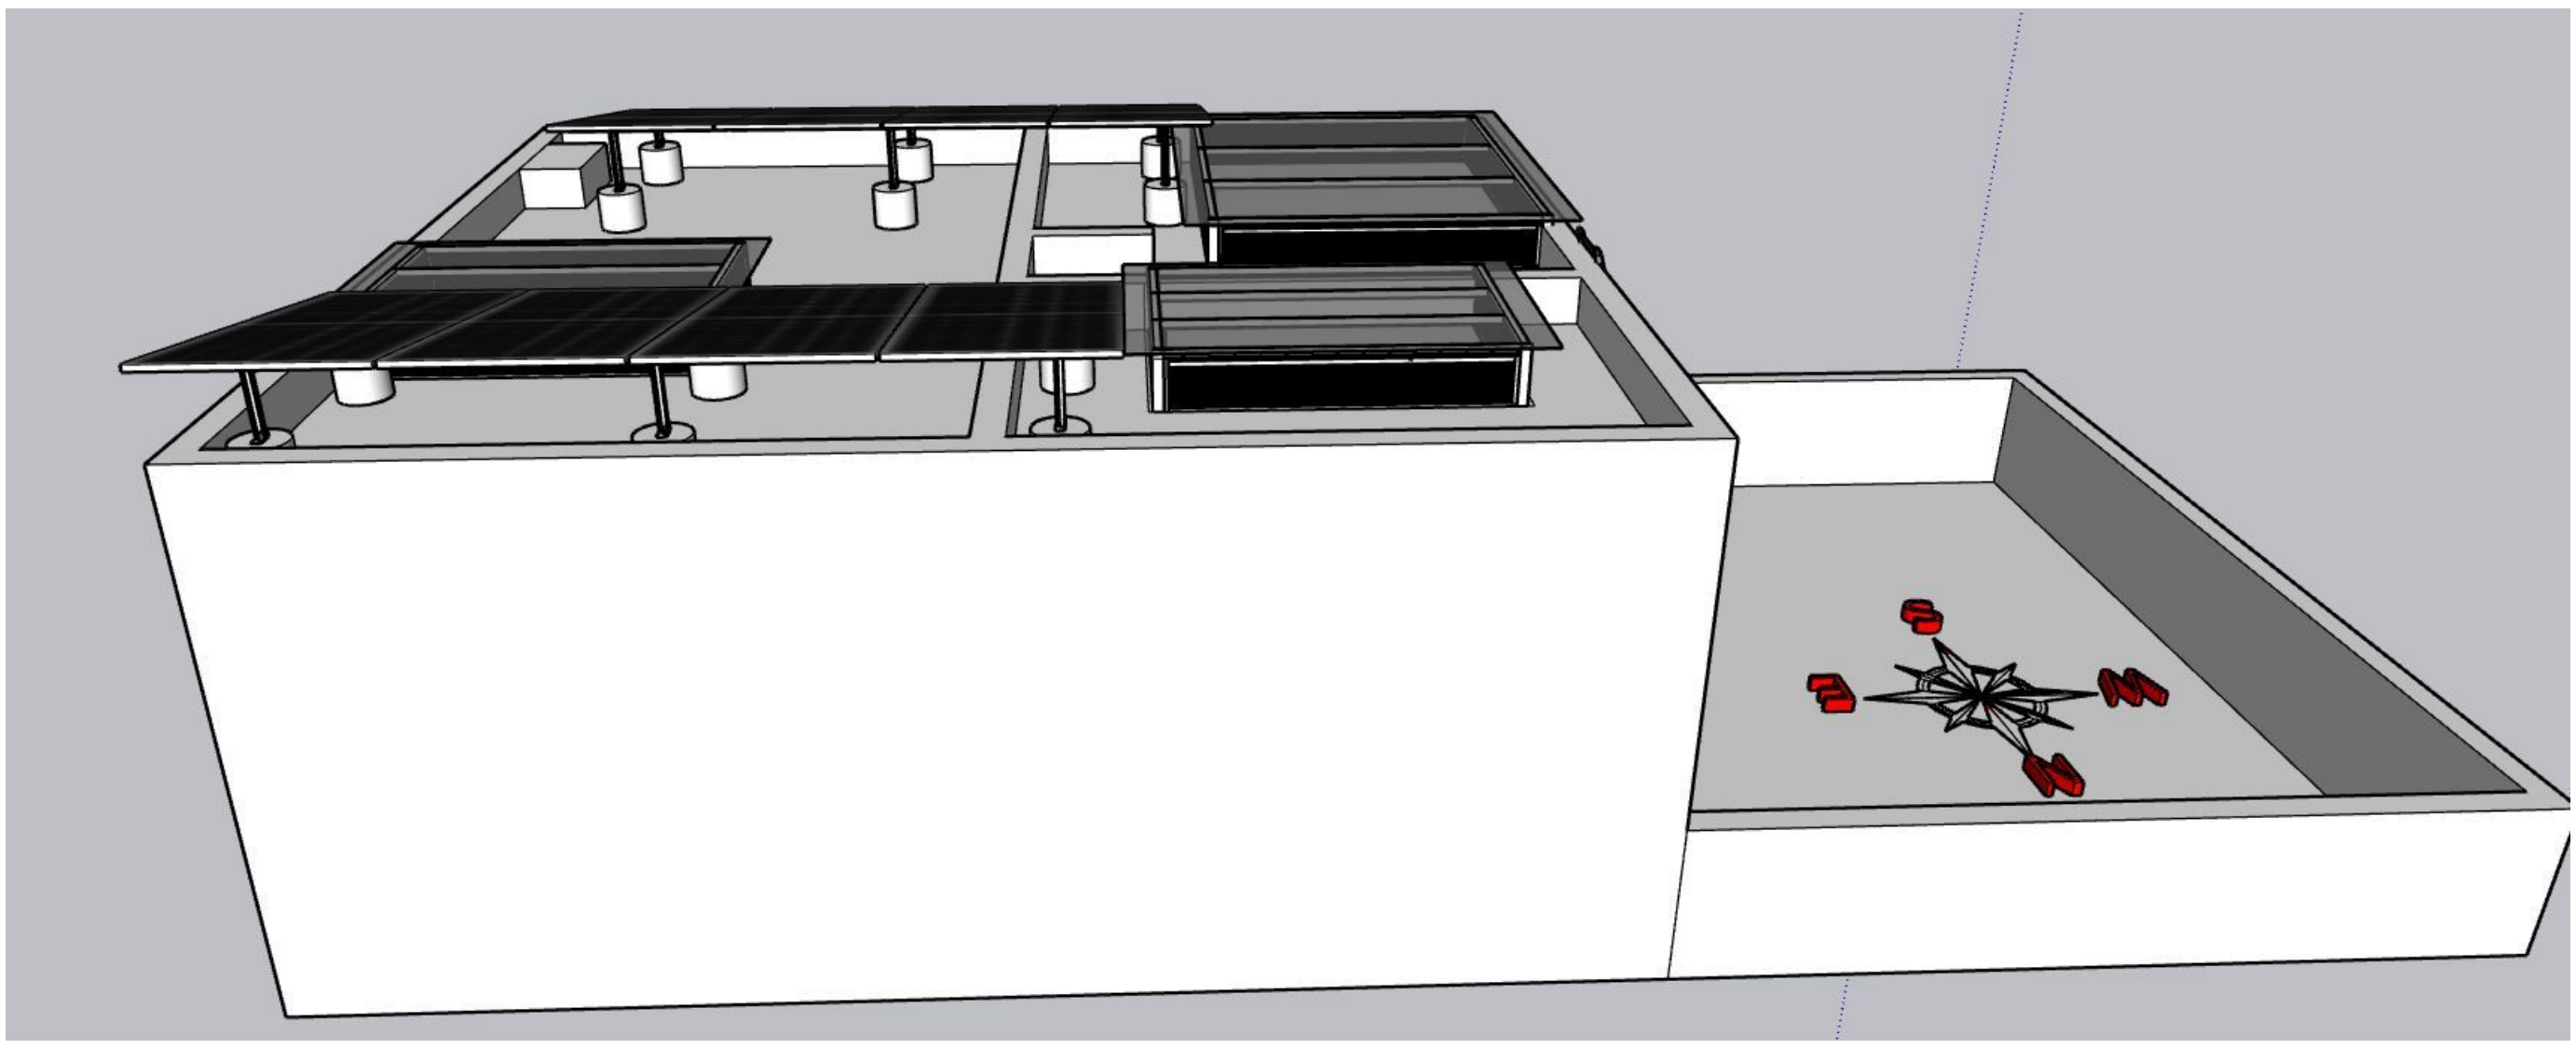

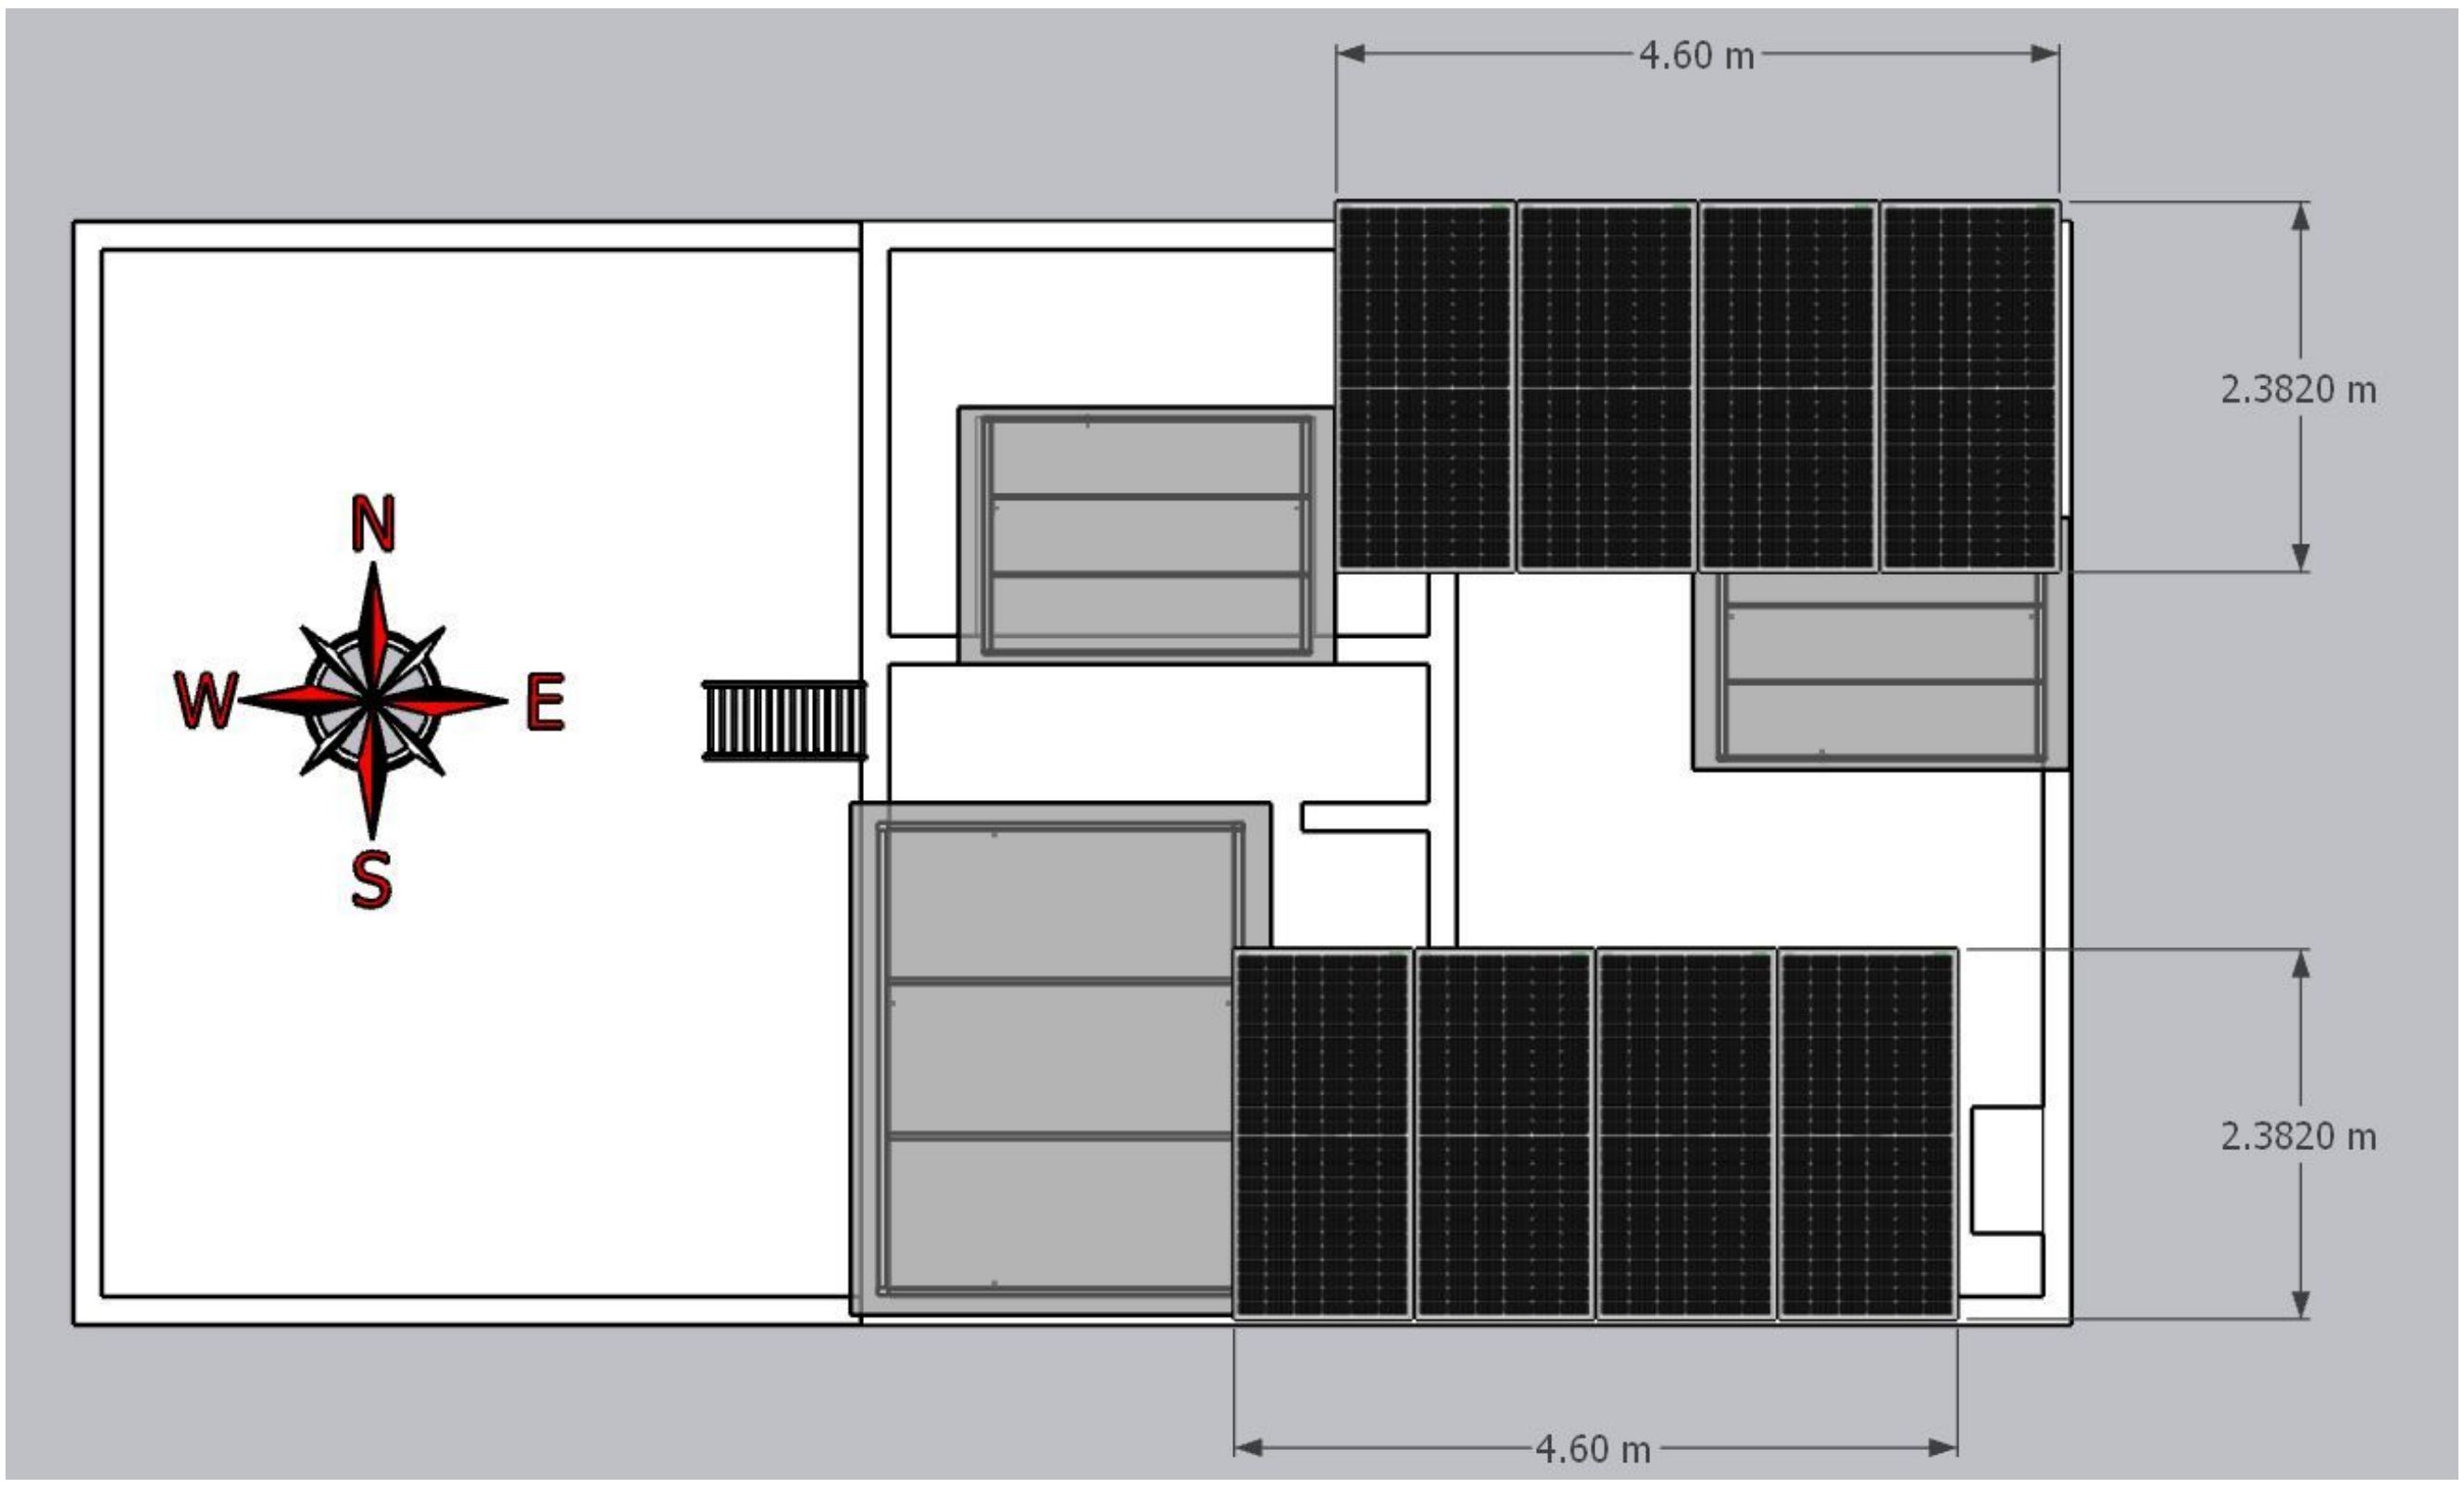

Building Exterior

Material Delivery Route

The materials can be shifted to the terrace via two options available at the site. Heavy materials such as PV modules can be shifted over the side wall of the building.

Light weight materials can be shifted to the terrace via the inner staircase.

The materials can follow the stairs until reaching the 2nd floor terrace.

The materials are shifting towards the open balcony.

Materials after reaching the 2nd floor can be stacked at the Balcony area and then shifted to the terrace roof via a ladder.

Staircase Details

Staircase width: 1000 mm

Proposed PV Area

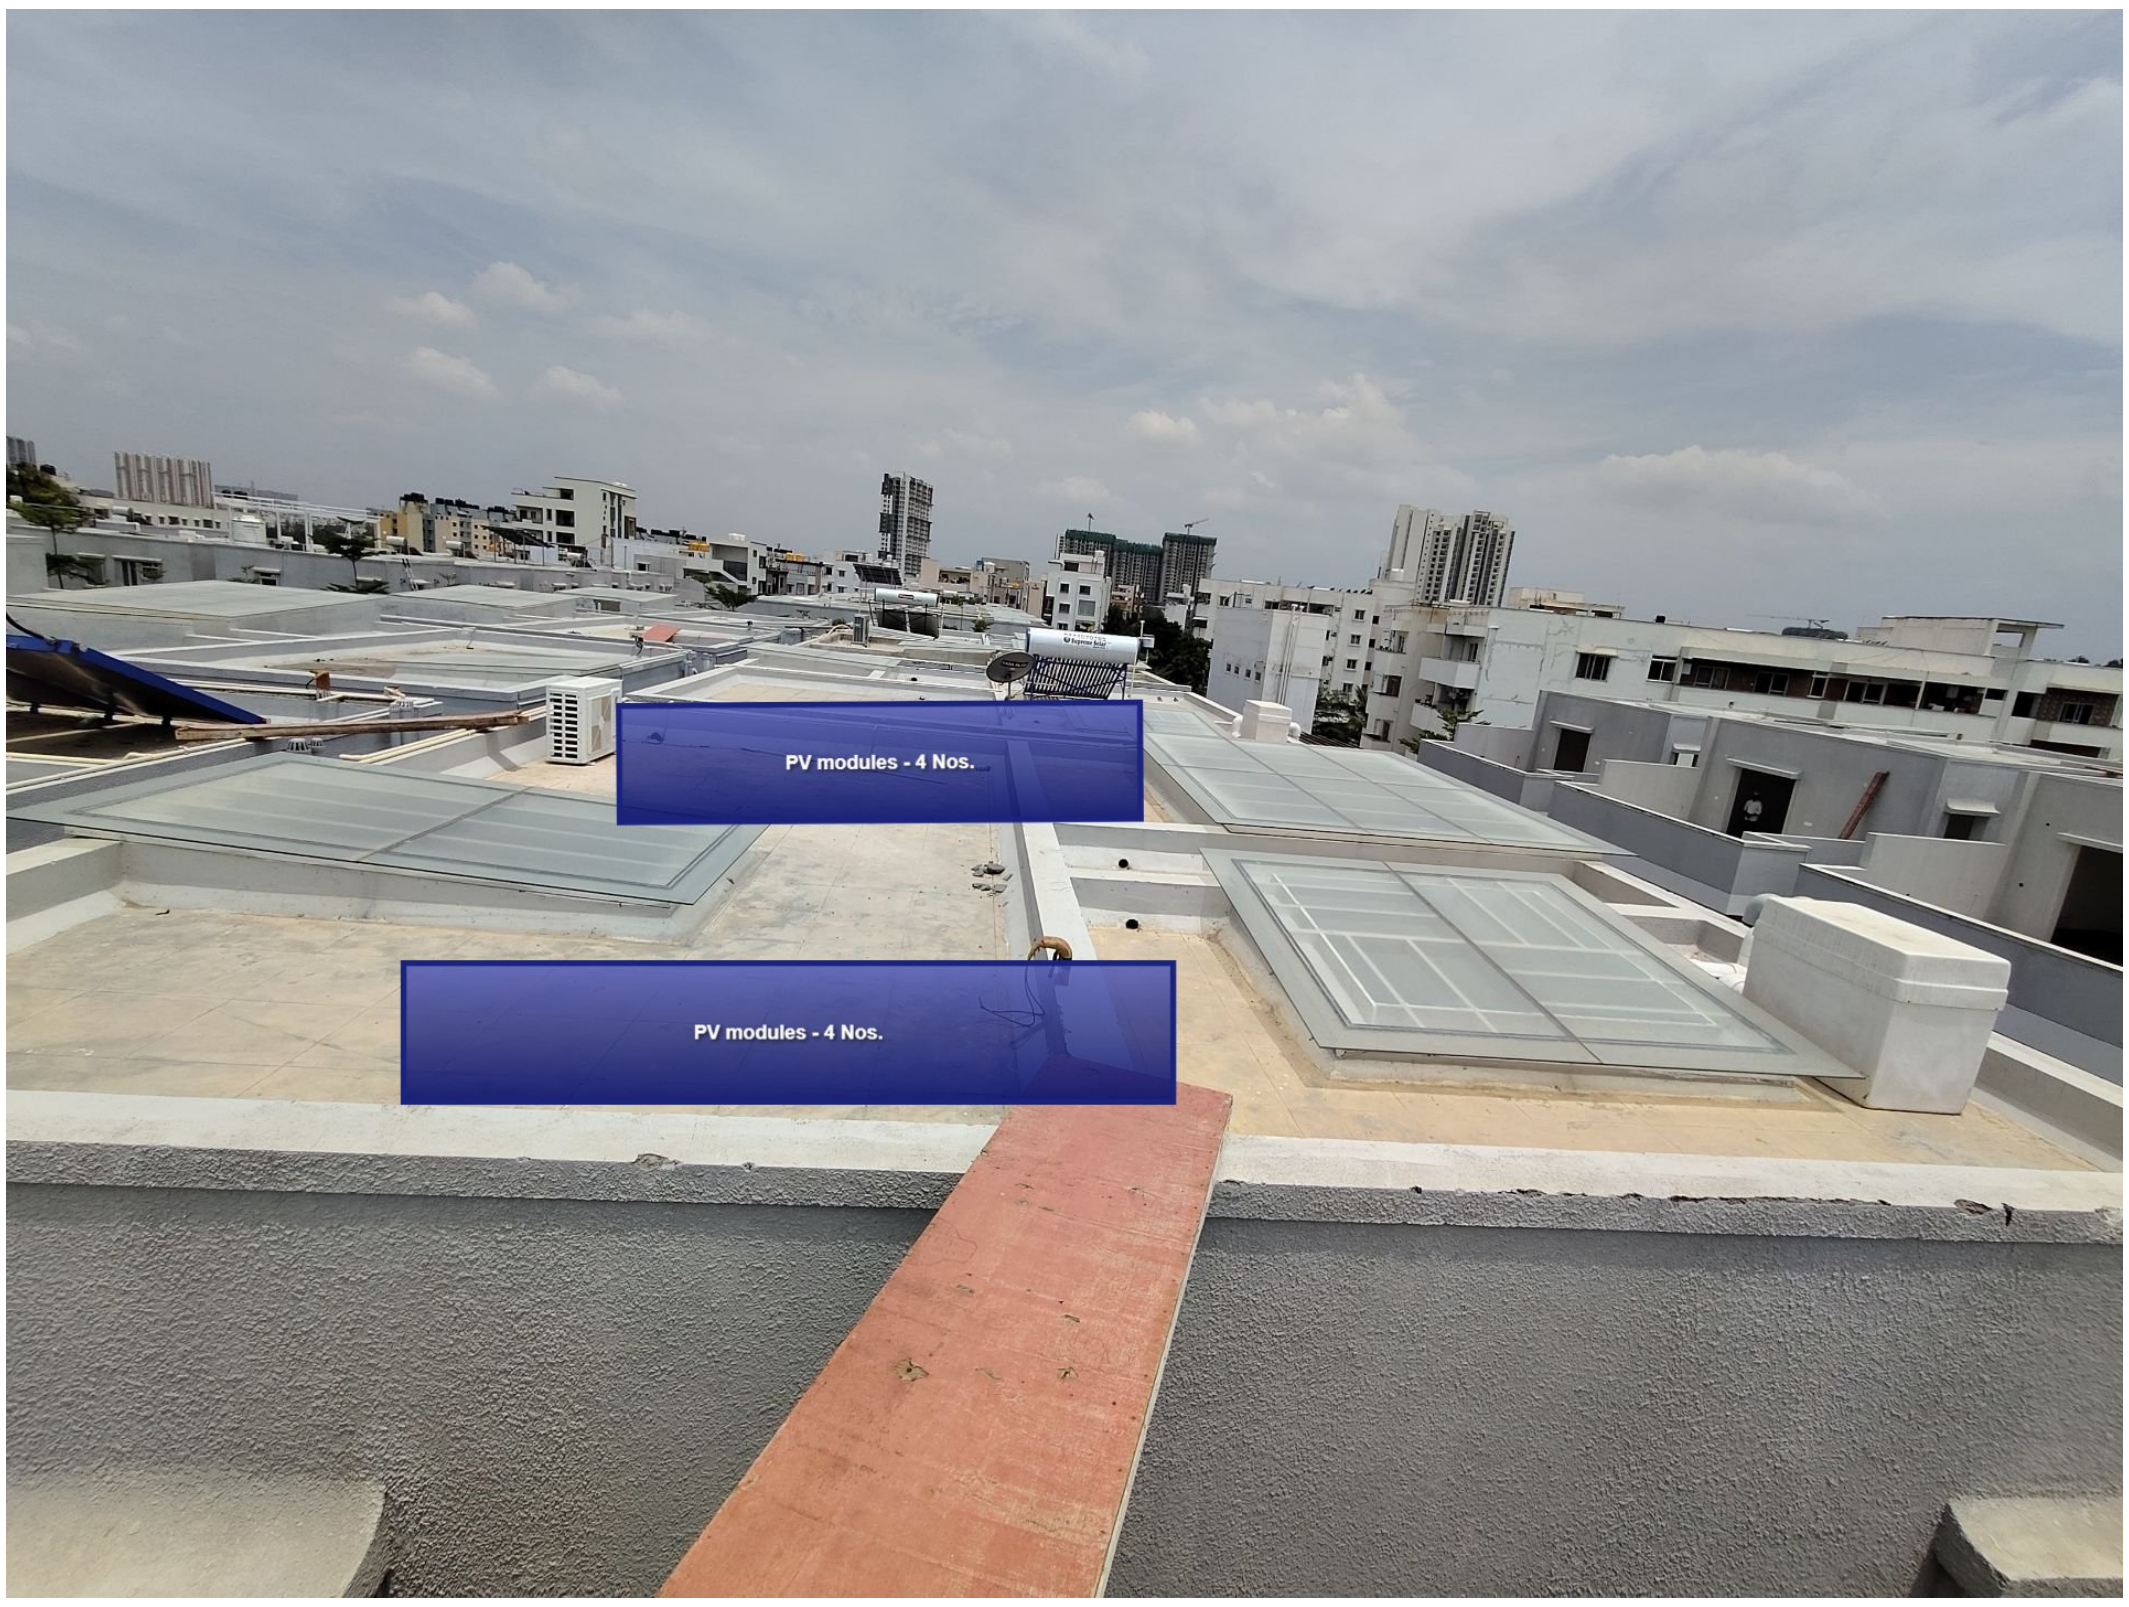

Cable Routing


AC Earth Pit
DC Earth Pit
LA Pit

Enphase accessories box with Solar meter
AC Earth Pit

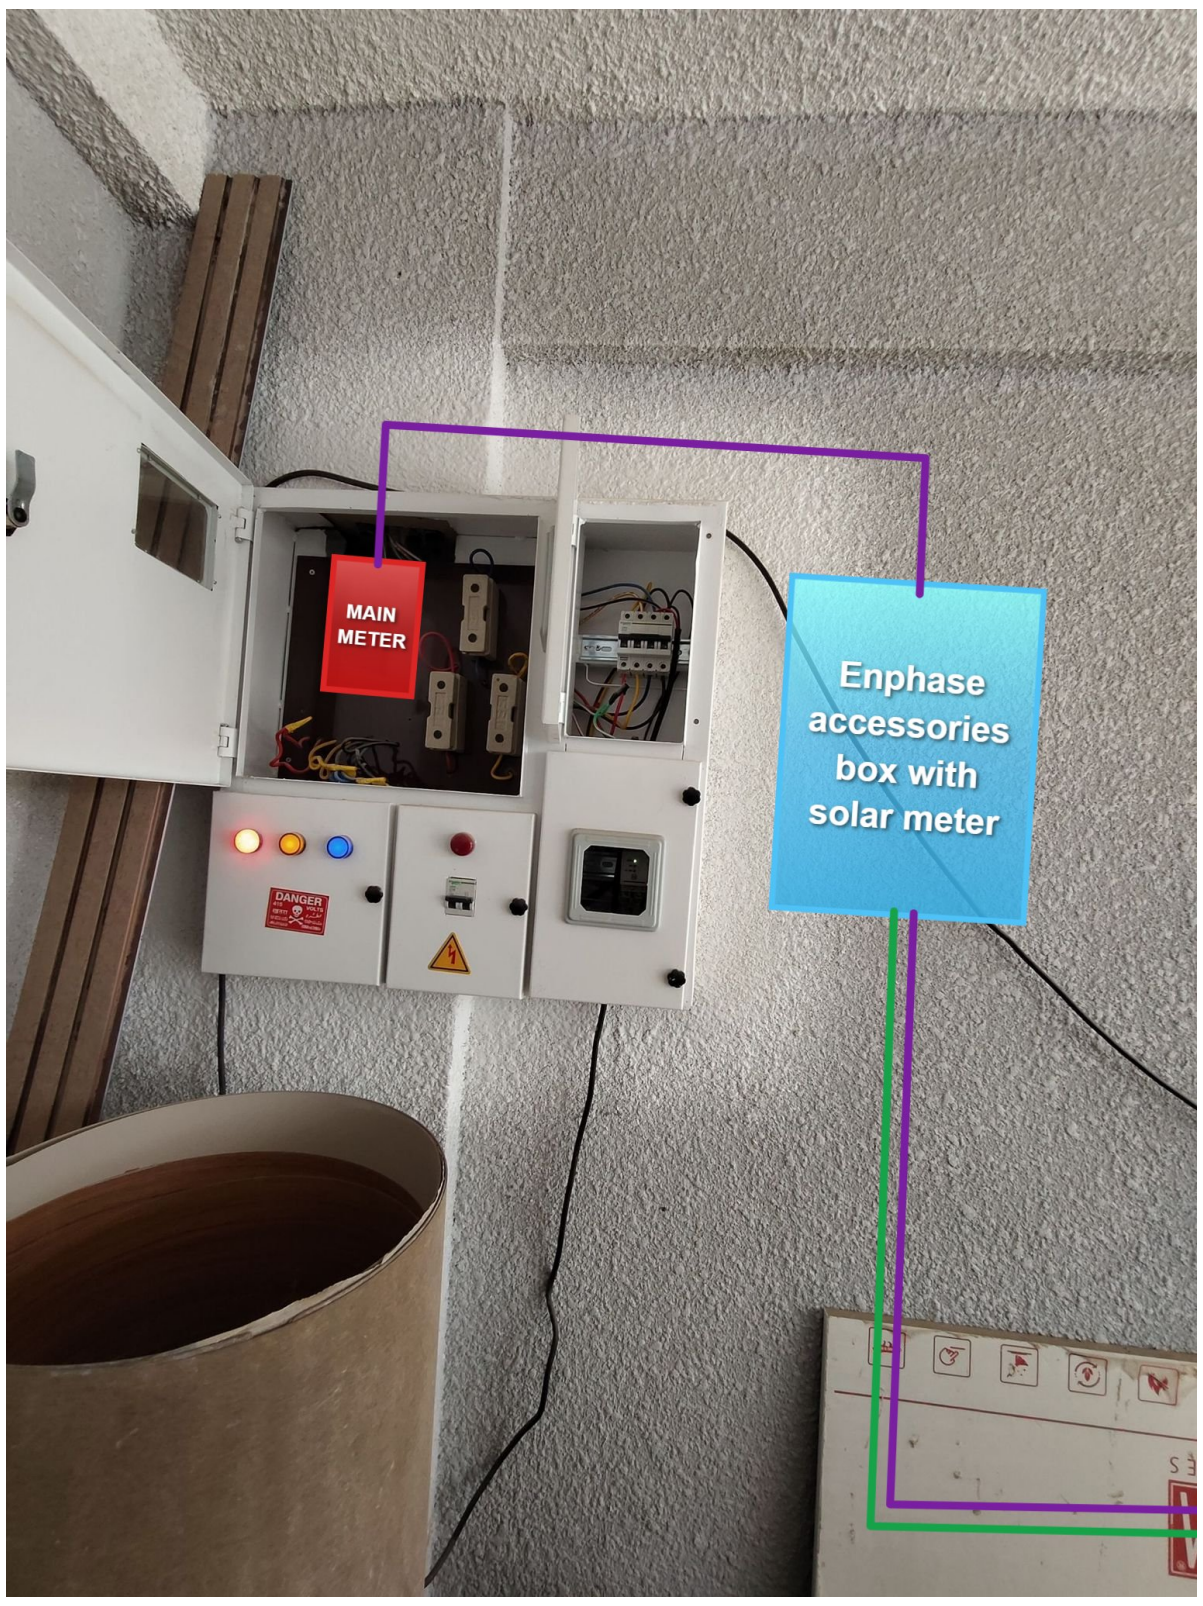

MAIN METER
Enphase accessories box with solar meter

Meter Box

Awaiting the BESCOM meter connection

OBSERVATIONS & RECOMMENDATIONS

EcoSoch Scope

#	Observation
1	Installation and commissioning of 4.92kWp On-grid solar power plant at the proposed premises.
2	The co-ordination and follow-up with BESCOM regarding solar connectivity till commissioning.
3	Providing a base support provision for Lightning arrester extension at the roof top.

Customer Scope

#	Observation
1	Providing an active Wi-Fi or LAN cable connection up to the inverter location.
2	The customer is responsible for arranging the reliable ladder provision to get access to the proposed solar panel installation area prior to the project's execution.

THANK YOU

Dear Neeraj Menta,

Thank you for choosing EcoSoch Solar for your solar installation. We appreciate your trust in us and your commitment to sustainable energy. Our team is dedicated to ensuring a seamless installation experience and long-term performance of your solar system.

Should you have any questions or require further assistance, please do not hesitate to reach out to us.

Warm Regards,
Team EcoSoch

& Did You Know?

The Sun burns 600 million tonnes of hydrogen per second — and your panels get a share.

EcoSoch Solar Pvt. Ltd.

#940, Sha Arcade, 2nd Phase, NTI Layout, Kodigehalli, Bengaluru 560097

www.ecosoch.com | info@ecosoch.com