Technical Site Visit Report

Prepared for: K. Anand and L. Mythreyi_Shriram Spandhana_4.96kWp_Microinverter (IQ Series)

PROJECT INFORMATION

Report Number	ESV-2026-0114
Project ID	91BC45EF
Project Name	K. Anand and L. Mythreyi_Shriram Spandhana_4.96kWp_Microinverter (IQ Series)
Project Sector	Residential
Project Type	With Subsidy
Sales Lead	Gautam
Site Address	NEB8-401, Shriram Spandhana, Embassy Golf Links Rd, near Embassy Golf Links Business Park, Challaghatta, Bengaluru, Karnataka 560037.
GPS Coordinates	12.944304, 77.651789
Google Maps	https://www.google.com/maps?q=12.944304,77.651789
Visit Date	2026-05-17
Visited By	ABILASH N K
Revision	Rev 0

CLIENT INFORMATION

Client Name	K. Anand and L. Mythreyi
Contact	+91 99728 65204

PROJECT DETAILS

Solar Rooftop System Type	On-Grid
System Capacity (kWp)	4.96
Sanction Load (kW)	5
Module Make & Capacity	Adani TOPCon DCR, 620 Wp
Module Length (mm)	2382

Module Width (mm)	1133
Number of Panels	8
Inverter Type	Micro
Inverter Brand	Enphase
Number of Inverters	8
Mounting Structure Type	Elevated

SITE INSPECTION CHECKLIST

General

#	Question	Answer	Notes
1	Can the delivery van/truck reach the material unloading point?	Yes	-
2	Are there any obstacles at the site that could hinder material lifting?	**No**	-
3	Where will the Inverter, DCDB, ACDB, Battery, etc. be located?	ACDB has to be located on the wall inside the room available on the terrace floor.	-
4	Is a canopy required for protecting the Inverters/ACDB/DCDB?	**No**	-
5	Did you discuss the location of the earth pits with the customer?	Yes, discussed and finalised.	-
6	Where is the Internet Router located?	3RD FLOOR	-
7	What's the Wi-Fi strength of the router near to the String inverter/Envoy?	3 bars	-
8	Did you pin the site location in your WhatsApp when you were at the site?	Yes	-

Roof Details

#	Question	Answer	Notes
1	What type of roof is present at the site?	Tiled Roof	-
2	Are there any obstructions on the roof that could affect the solar installation?	**No**	-
3	What is the angle of the panels? (in degrees)	7	-
4	In case of sloped roof, what is the slope angle of the roof? (in degrees)	N/A	-
5	On how many roofs at the site are we installing solar?	1	-
6	If it is a Tiled roof, what is underneath the tiles?	MS Rafter	-
7	If it is a Tiled roof with MS or Wooden rafters, is it Single-tiled or Double-tiled?	N/A	-
8	What type of mounting structure is planned?	Elevated	*The MS elevated structure must be built above the tile roof, using the customer's existing MS columns at the roof's four corners as base support.*

#	Question	Answer	Notes
9	What is the orientation of the solar panels?	["South"]	-
10	How can the roof be accessed?	Ladder	*The roof can be accessed from the ground floor via a stairway that leads to the terrace floor. A ladder must be set up from the terrace level to the tiled roof.*
11	Is the building currently under construction?	**No**	-
12	In an under-construction building, are existing conduit pipes available for AC, DC cables, and earthing?	N/A	-
13	What is the height of the building and how many floors does it have?	18 Metres (G + 4 + Tiled roof)	-
14	Is the site photo matching with the building description?	Yes	-
15	Is there an overhead HT line passing within a 10-meter radius of the site?	**No**	-

Residential / Electrical

#	Question	Answer	Notes
1	What type of energy meter is currently installed?	Phase: Single, Type: Digital	-
2	Is the Meter cubicle photo matching with the previous answer?	Yes	-
3	Has the termination point in the Main meter panel been identified?	Yes	-
4	Is the Termination Point easily visible or sealed?	Visible	-
5	Is a Lightning Arrestor (LA) already available at the site?	**No**	-
6	Is space available for CT within Energy meter panel?	N/A	-
7	In case of an Enphase system, is the distance between the farthest micro-inverter and IQ Gateway > 50m?	Less than 50m	-
8	Provide details of the existing CT ratings (if applicable).	N/A	-
9	In Main meter panel, is empty space available for solar meter?	**No**	-
10	In Main meter panel, is empty space available to house the Enphase accessories or ACDB components?	**No**	-
11	Is there space available to dig DC, AC and LA earth pits?	Yes	-
12	In case of elevated structures, is an LA extension provided at the far end?	N/A	-
13	In case of elevated structures, is it with or without grouting?	N/A	-
14	Are there any challenges with respect to Installation and Maintenance activities?	**No**	-
15	Are there any safety risks associated with accessing the roof for installation?	details: Proper ladder provision has to be arranged during the installation.	-
16	Is space present in rooftop to store the panels?	Vertically leaning against the wall	-
17	In case of sloped roof MS structure, provide the dimension of rafter to rafter, purlin to purlin.	N/A	-
18	Is ventilation available in the battery location?	N/A	-

#	Question	Answer	Notes
19	Should the Inverters/ACDB/DCDB be installed on a metal grill or wall mount?	The ACDB has to be mounted on the wall just beneath the tiled roof.	-
20	Provide the dimensions for solar meter cubicle placement (L x W of wall).	length: 30, width: 30	-
21	Provide the dimension for earth pits location (L x W of available space).	length: 3000, width: 2000	-
22	Is LAN cable under customer scope?	Yes	-
23	Is there any shadow that affects the solar installation?	**No**	-
24	Is there any trench work to be done to carry the AC cable to the meter location?	N/A	-

PHOTO DOCUMENTATION

Cable Routing Legend

Legend	Description
	Proposed PV Module Array
	Main Meter Location
	Solar Meter
	Battery
	Inverter
	Other Equipment
	DC Cable
	AC Cable
	Material Shifting
	DC Earthing Cable
	AC Earthing Cable
	LA Cable
	DC Earth Pit
	AC Earth Pit
	LA Pit
	LA

Site Layout - Top View

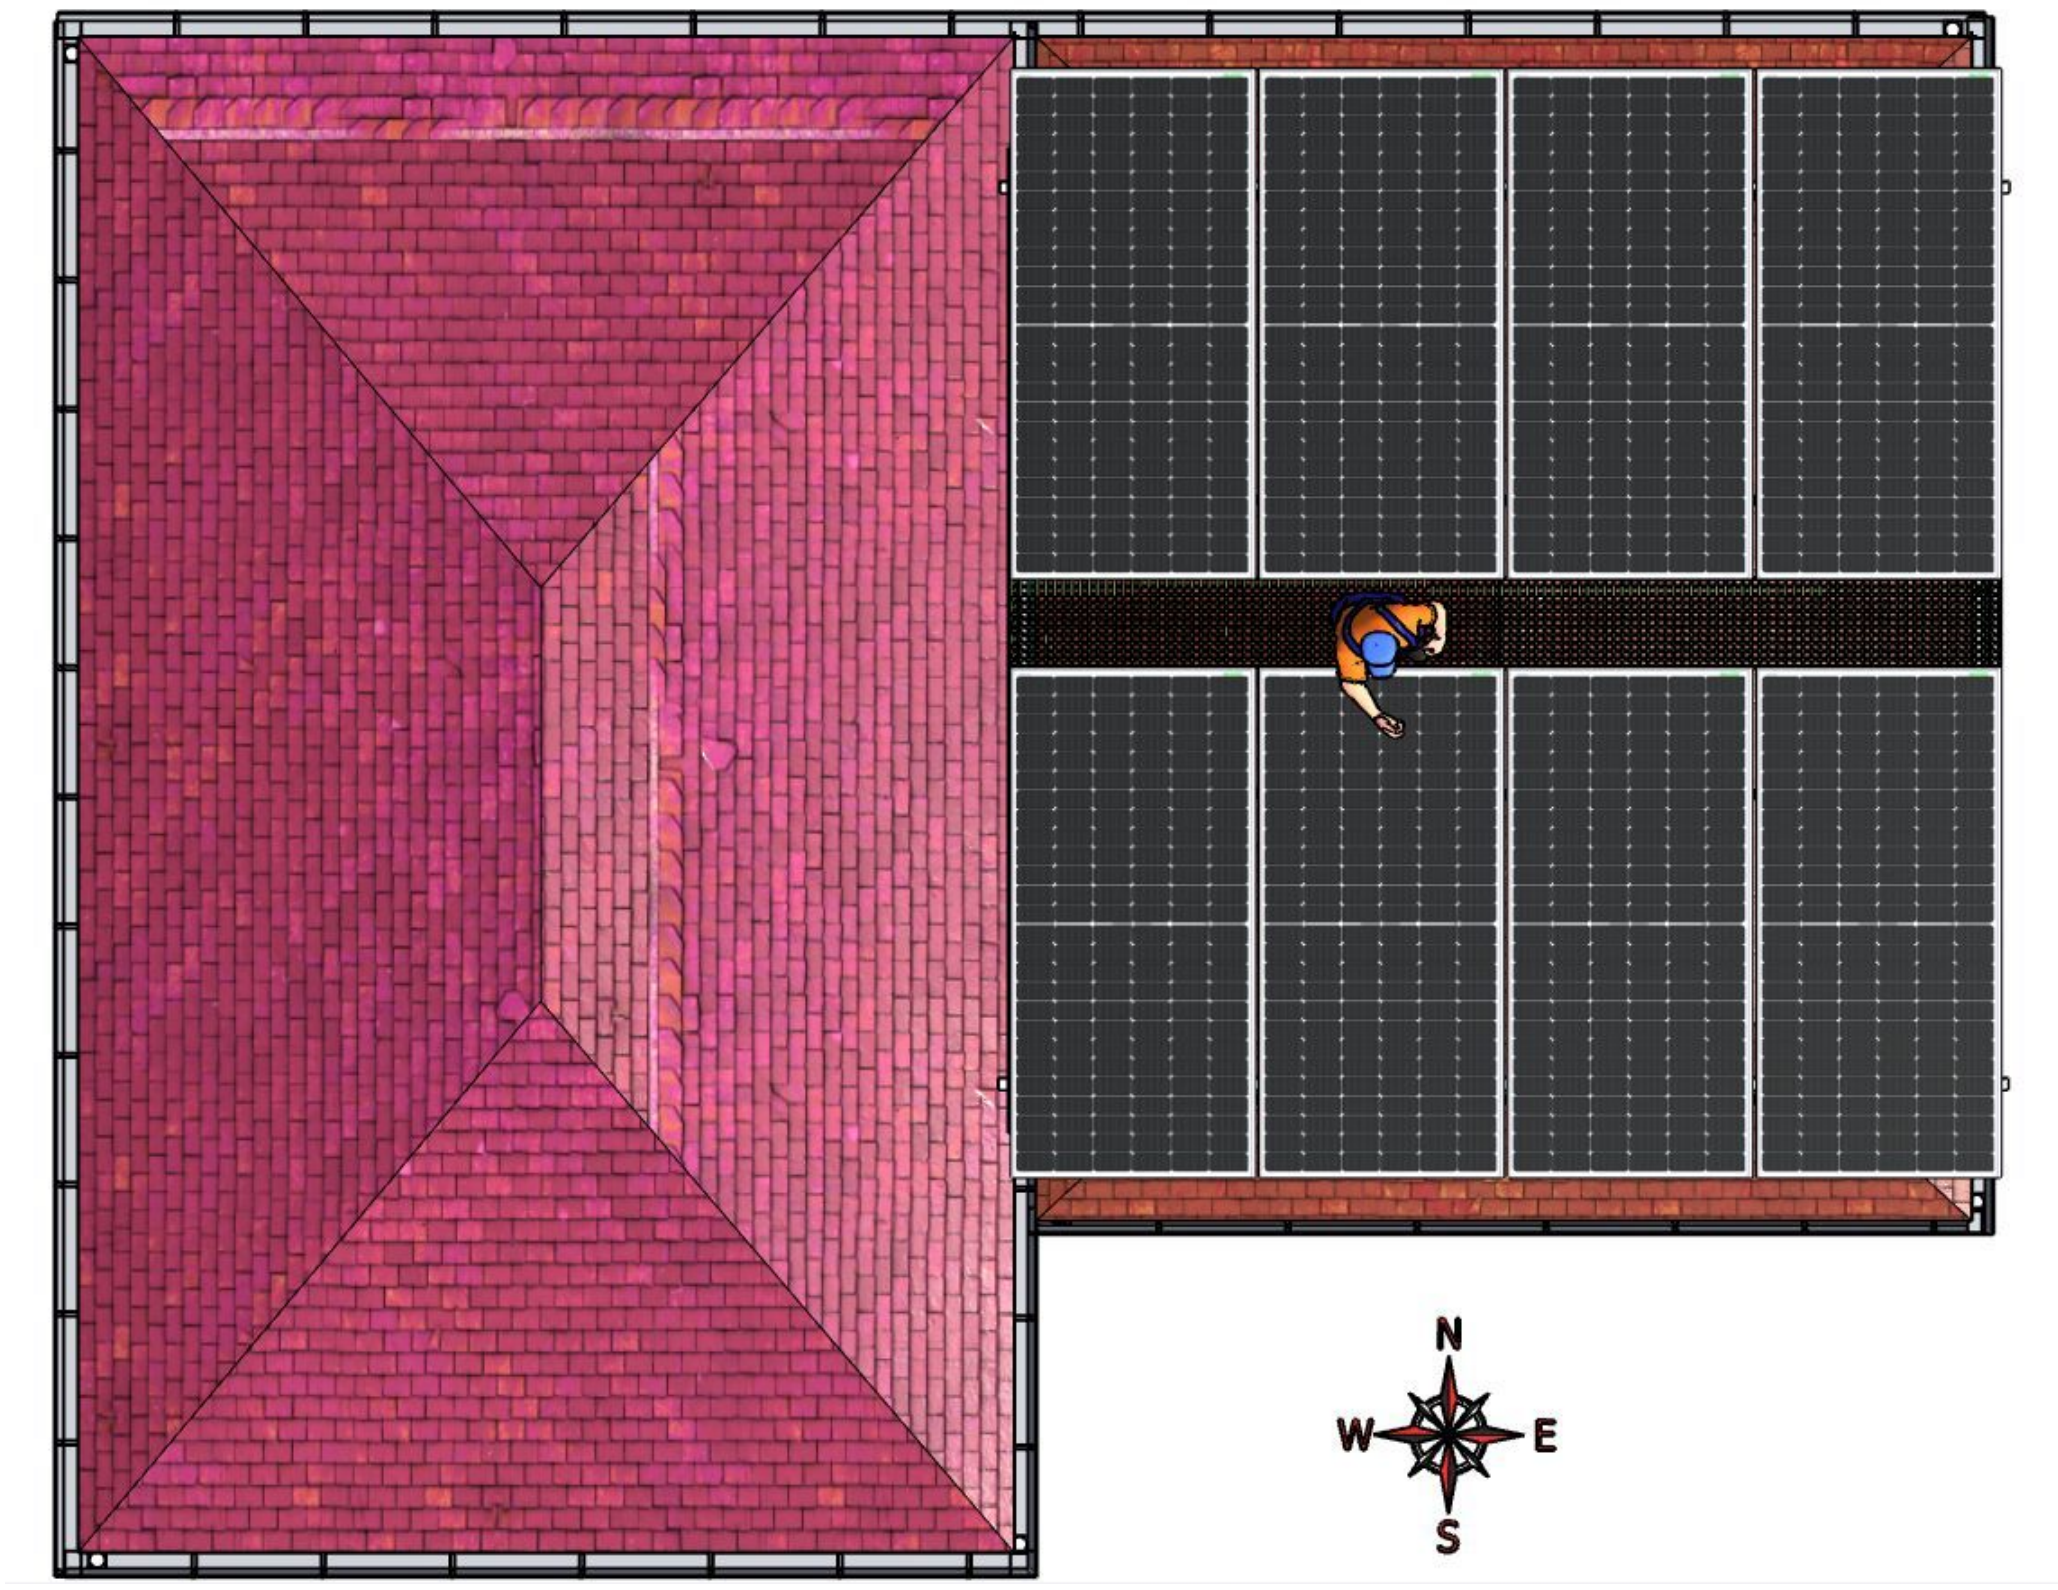
N
W
E
S

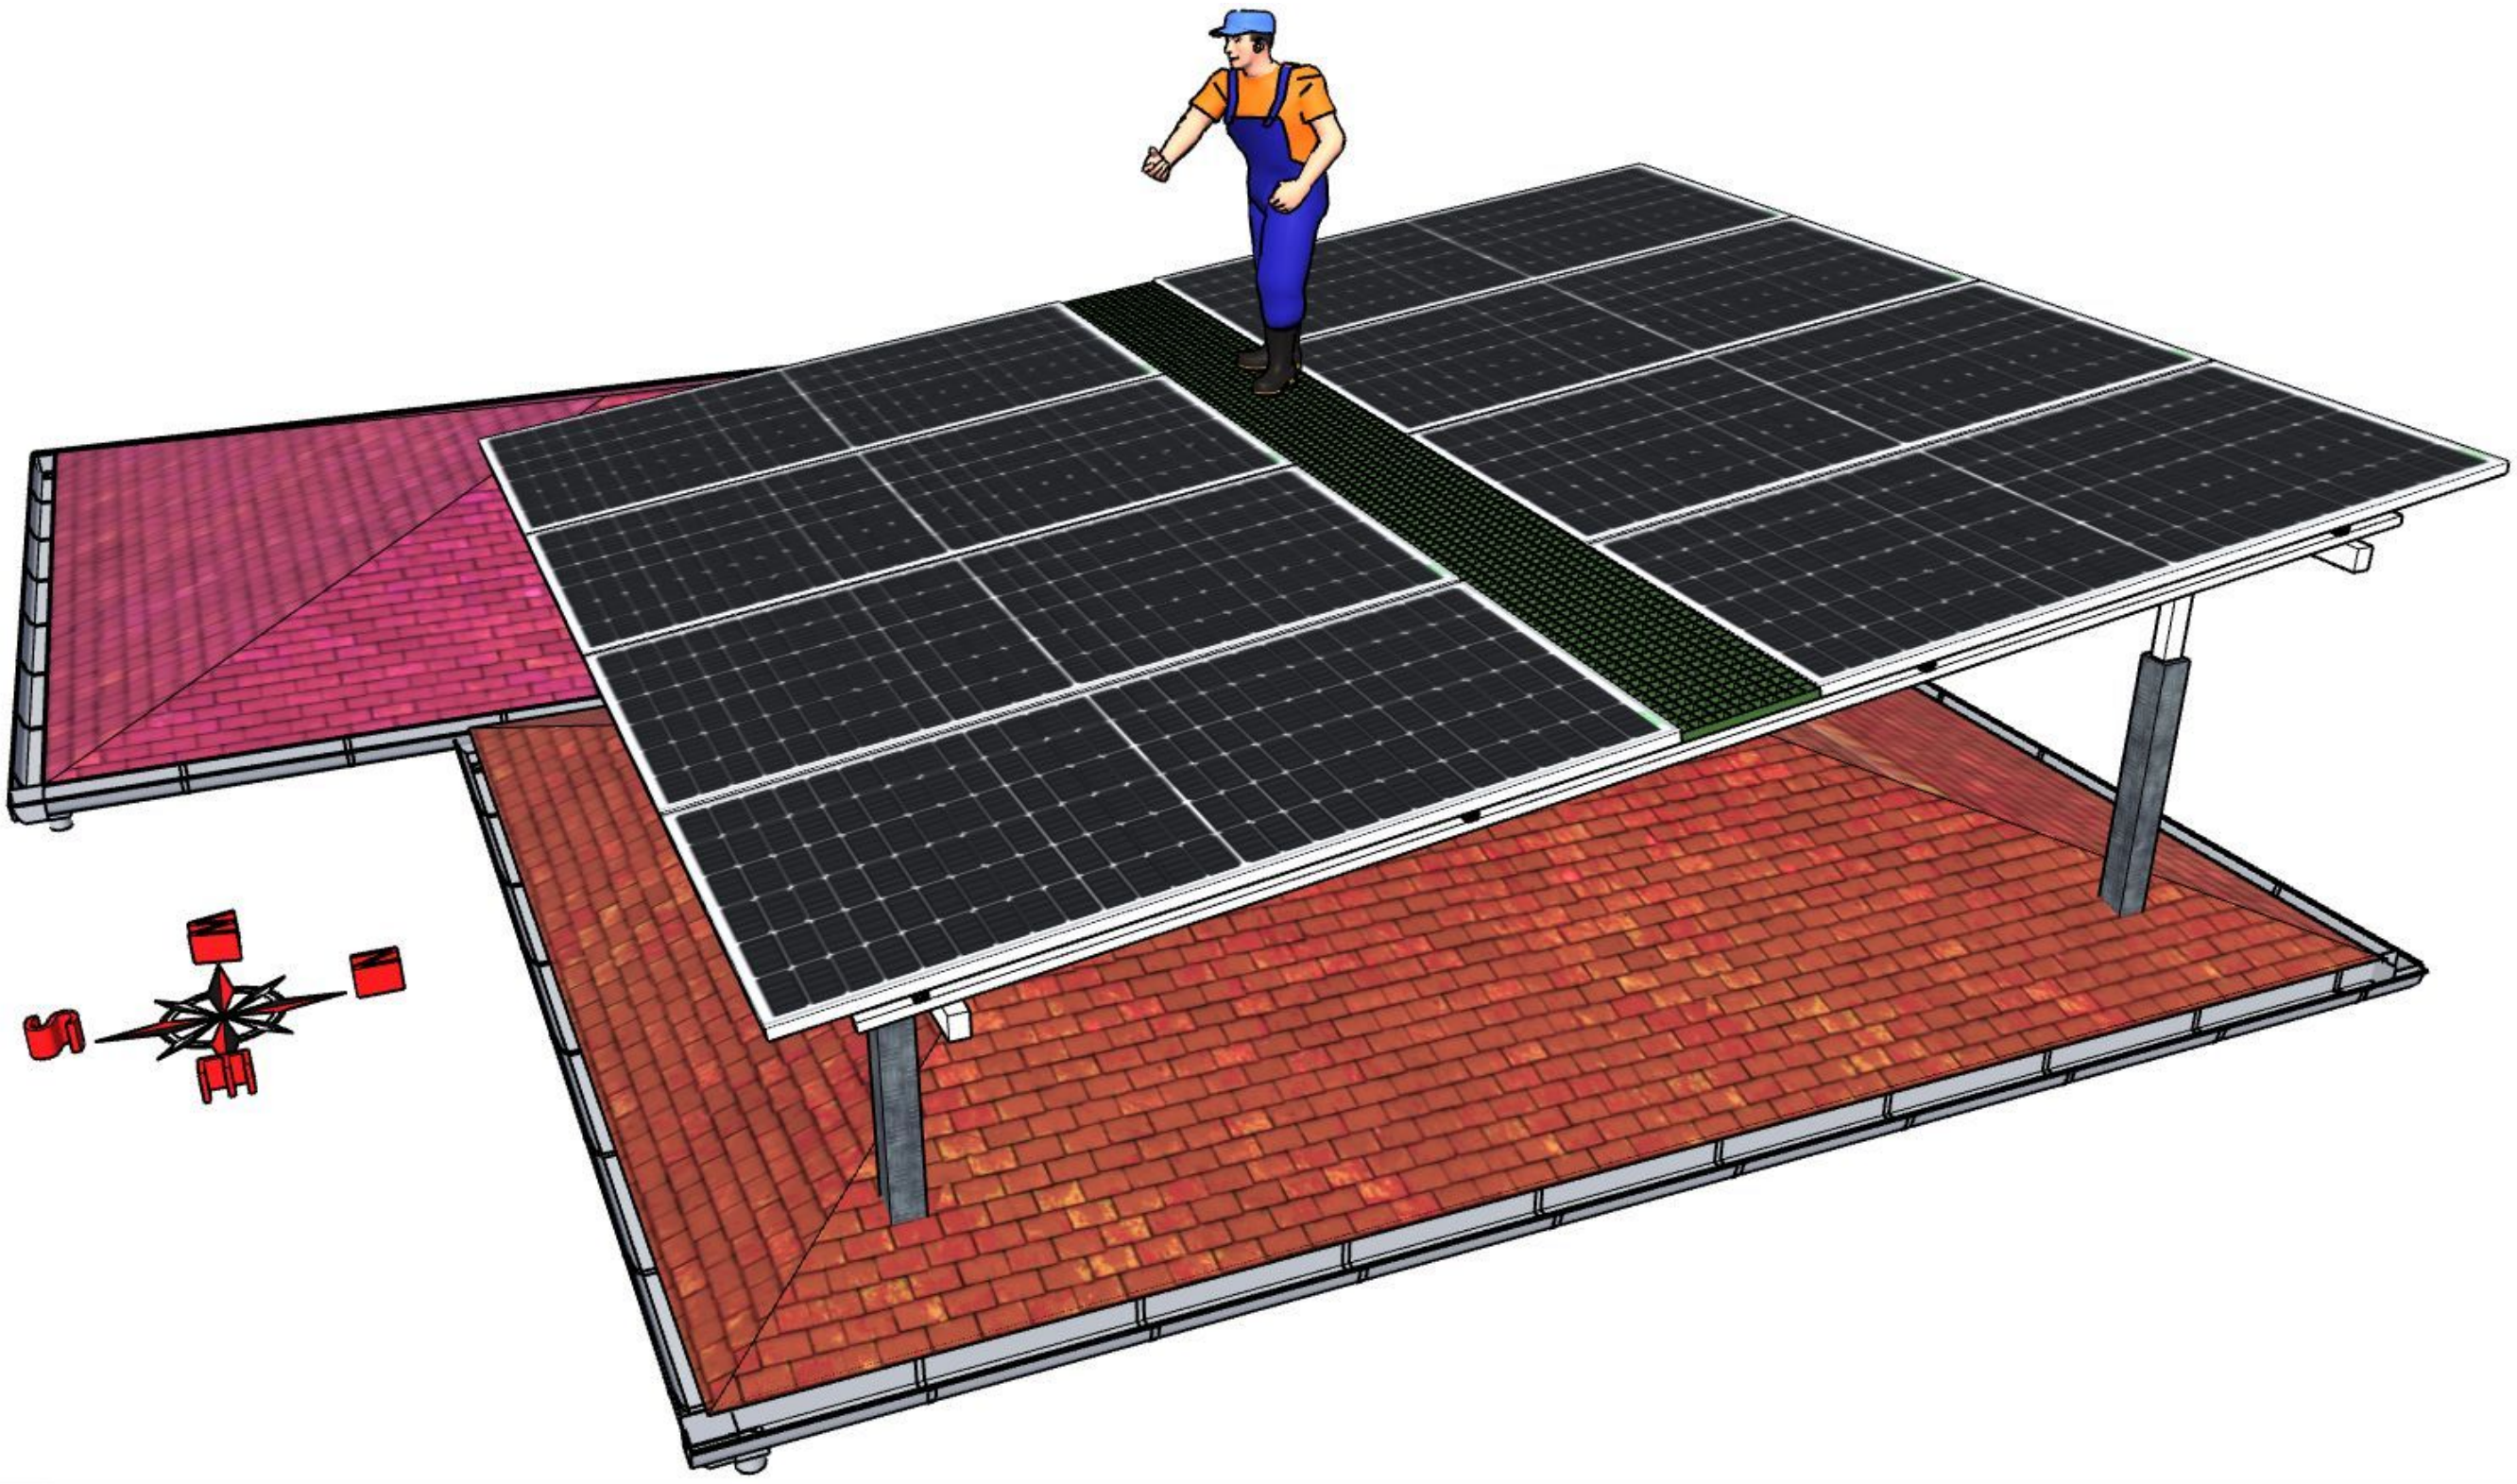

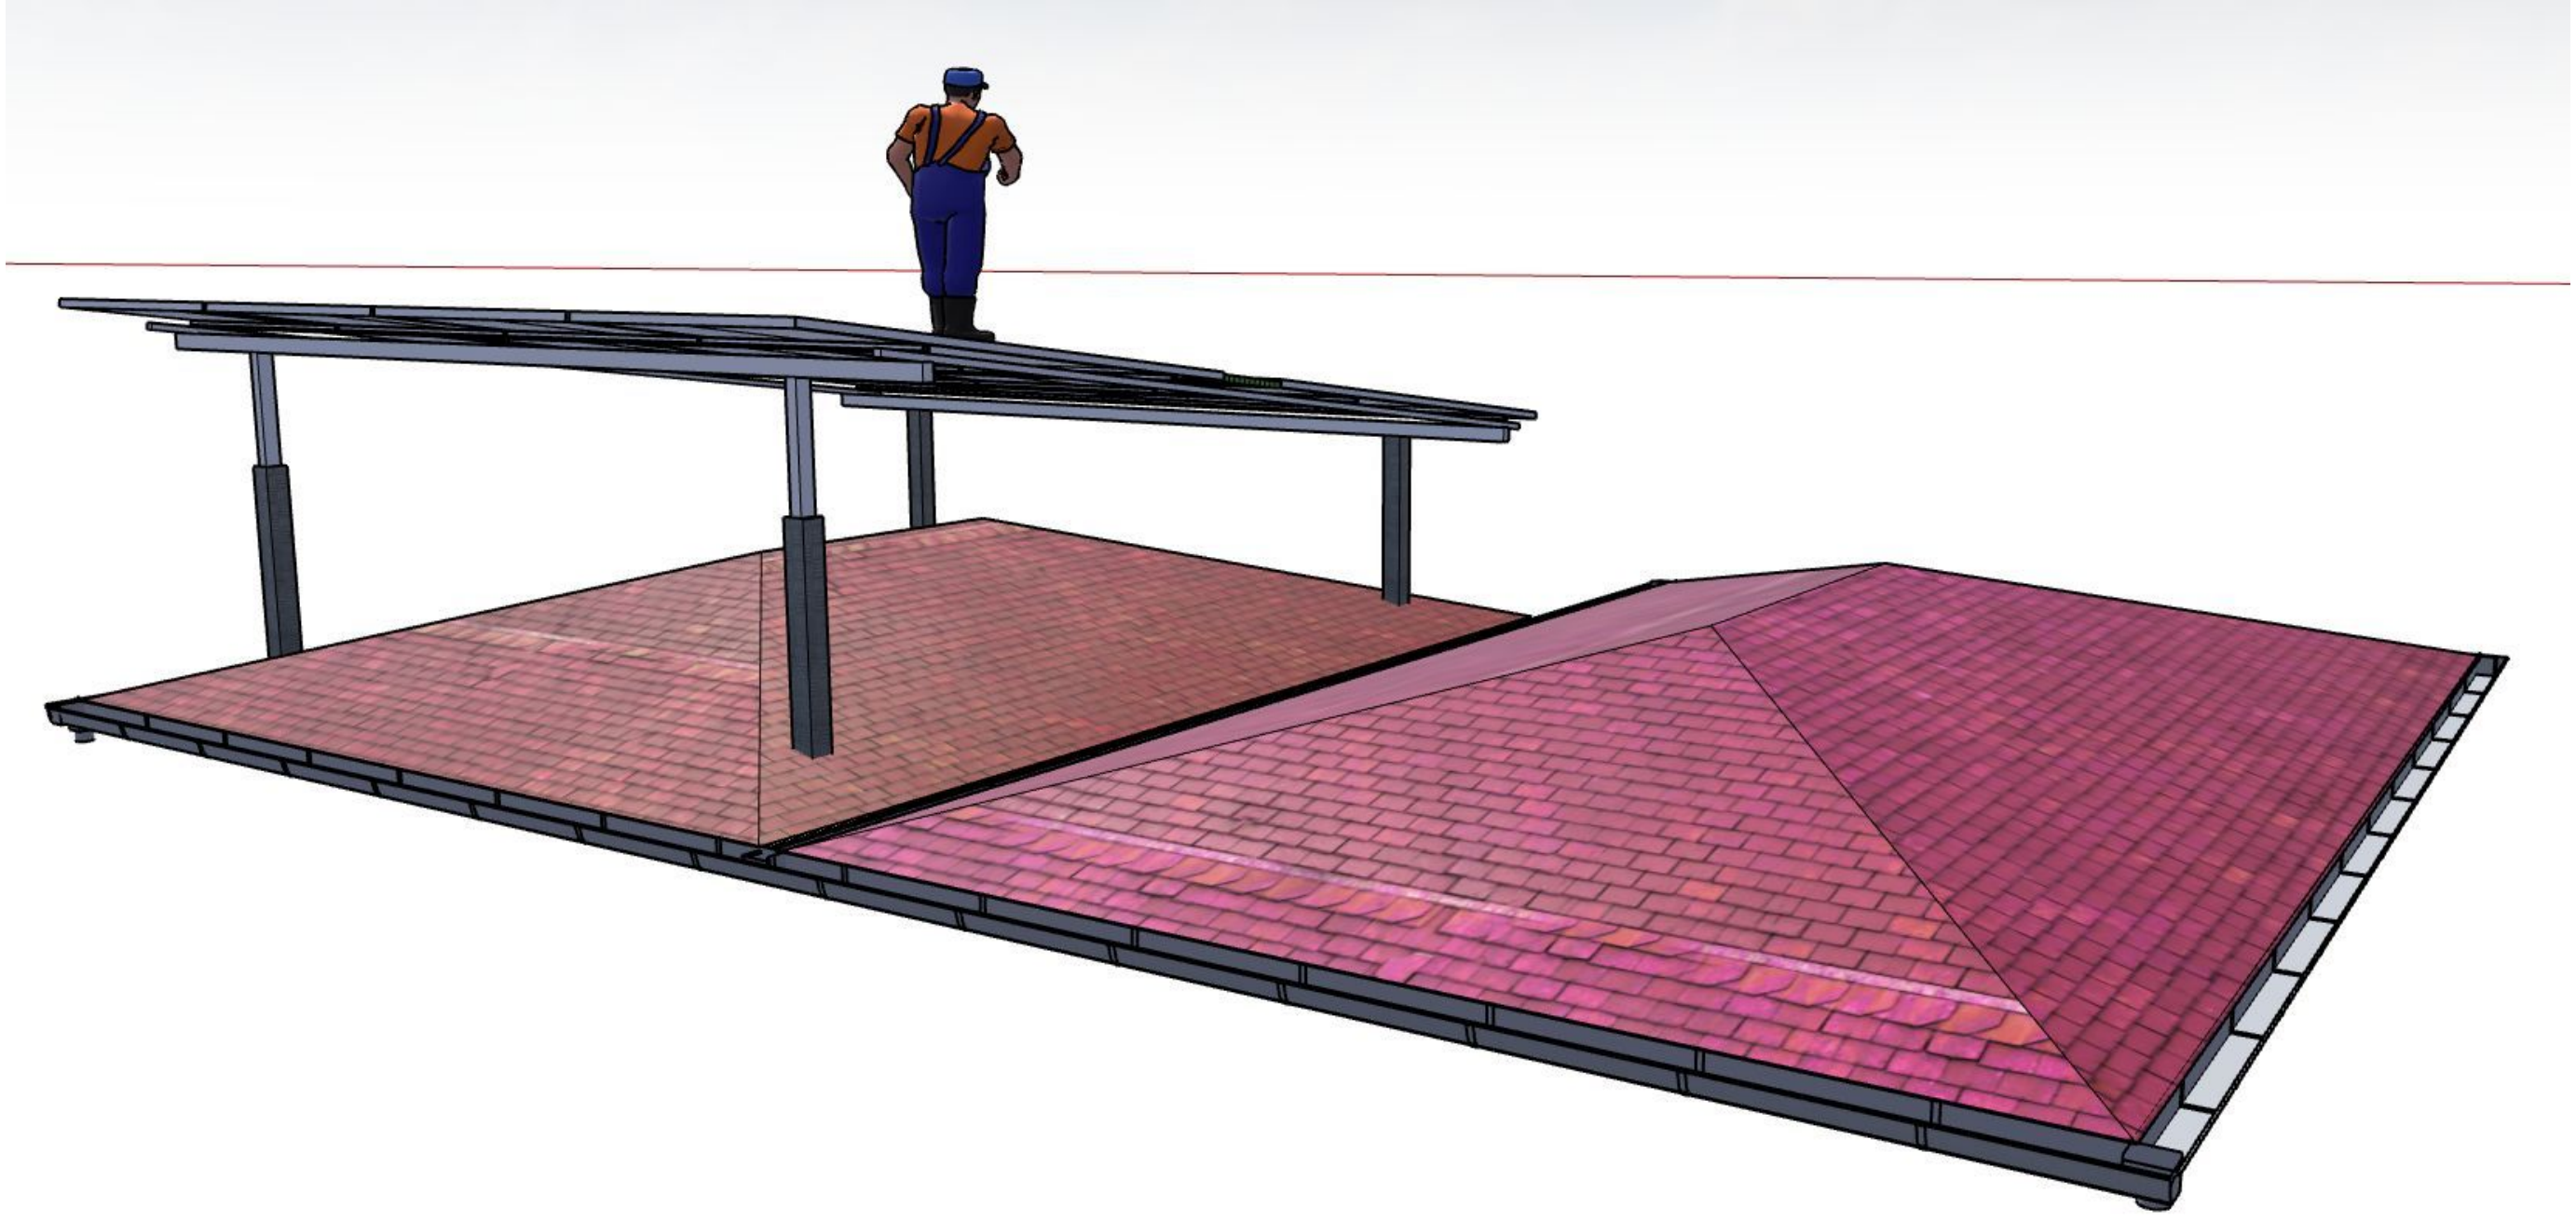

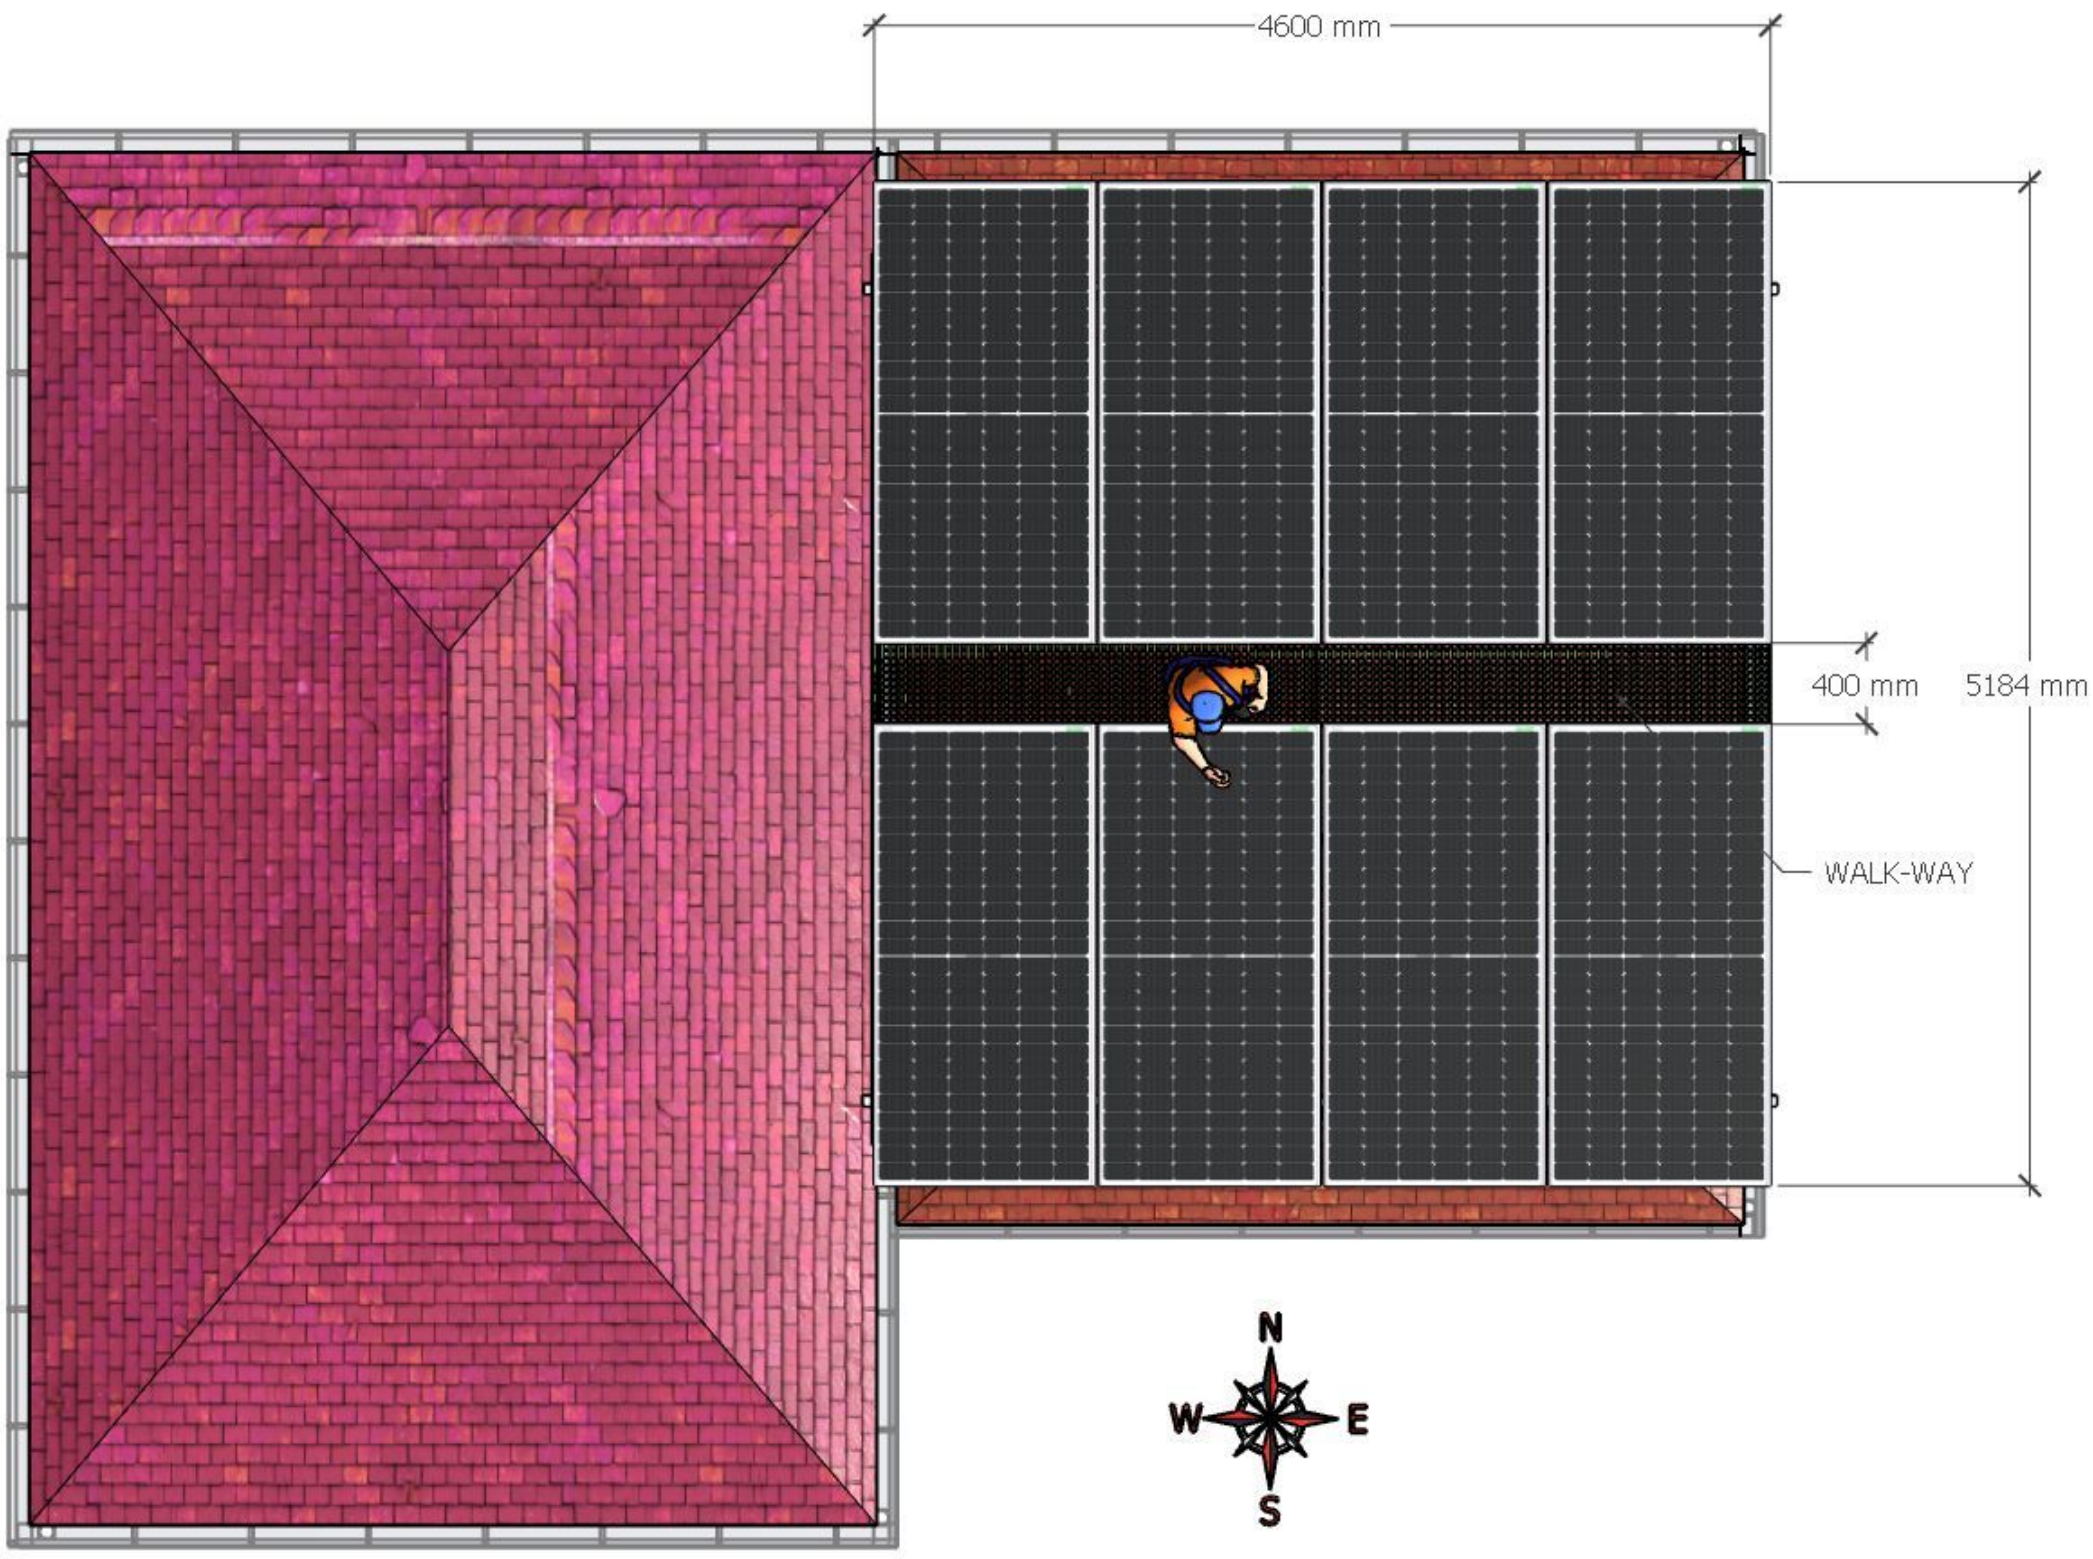

4600 mm
400 mm
5184 mm
WALK-WAY
N
W
E
S

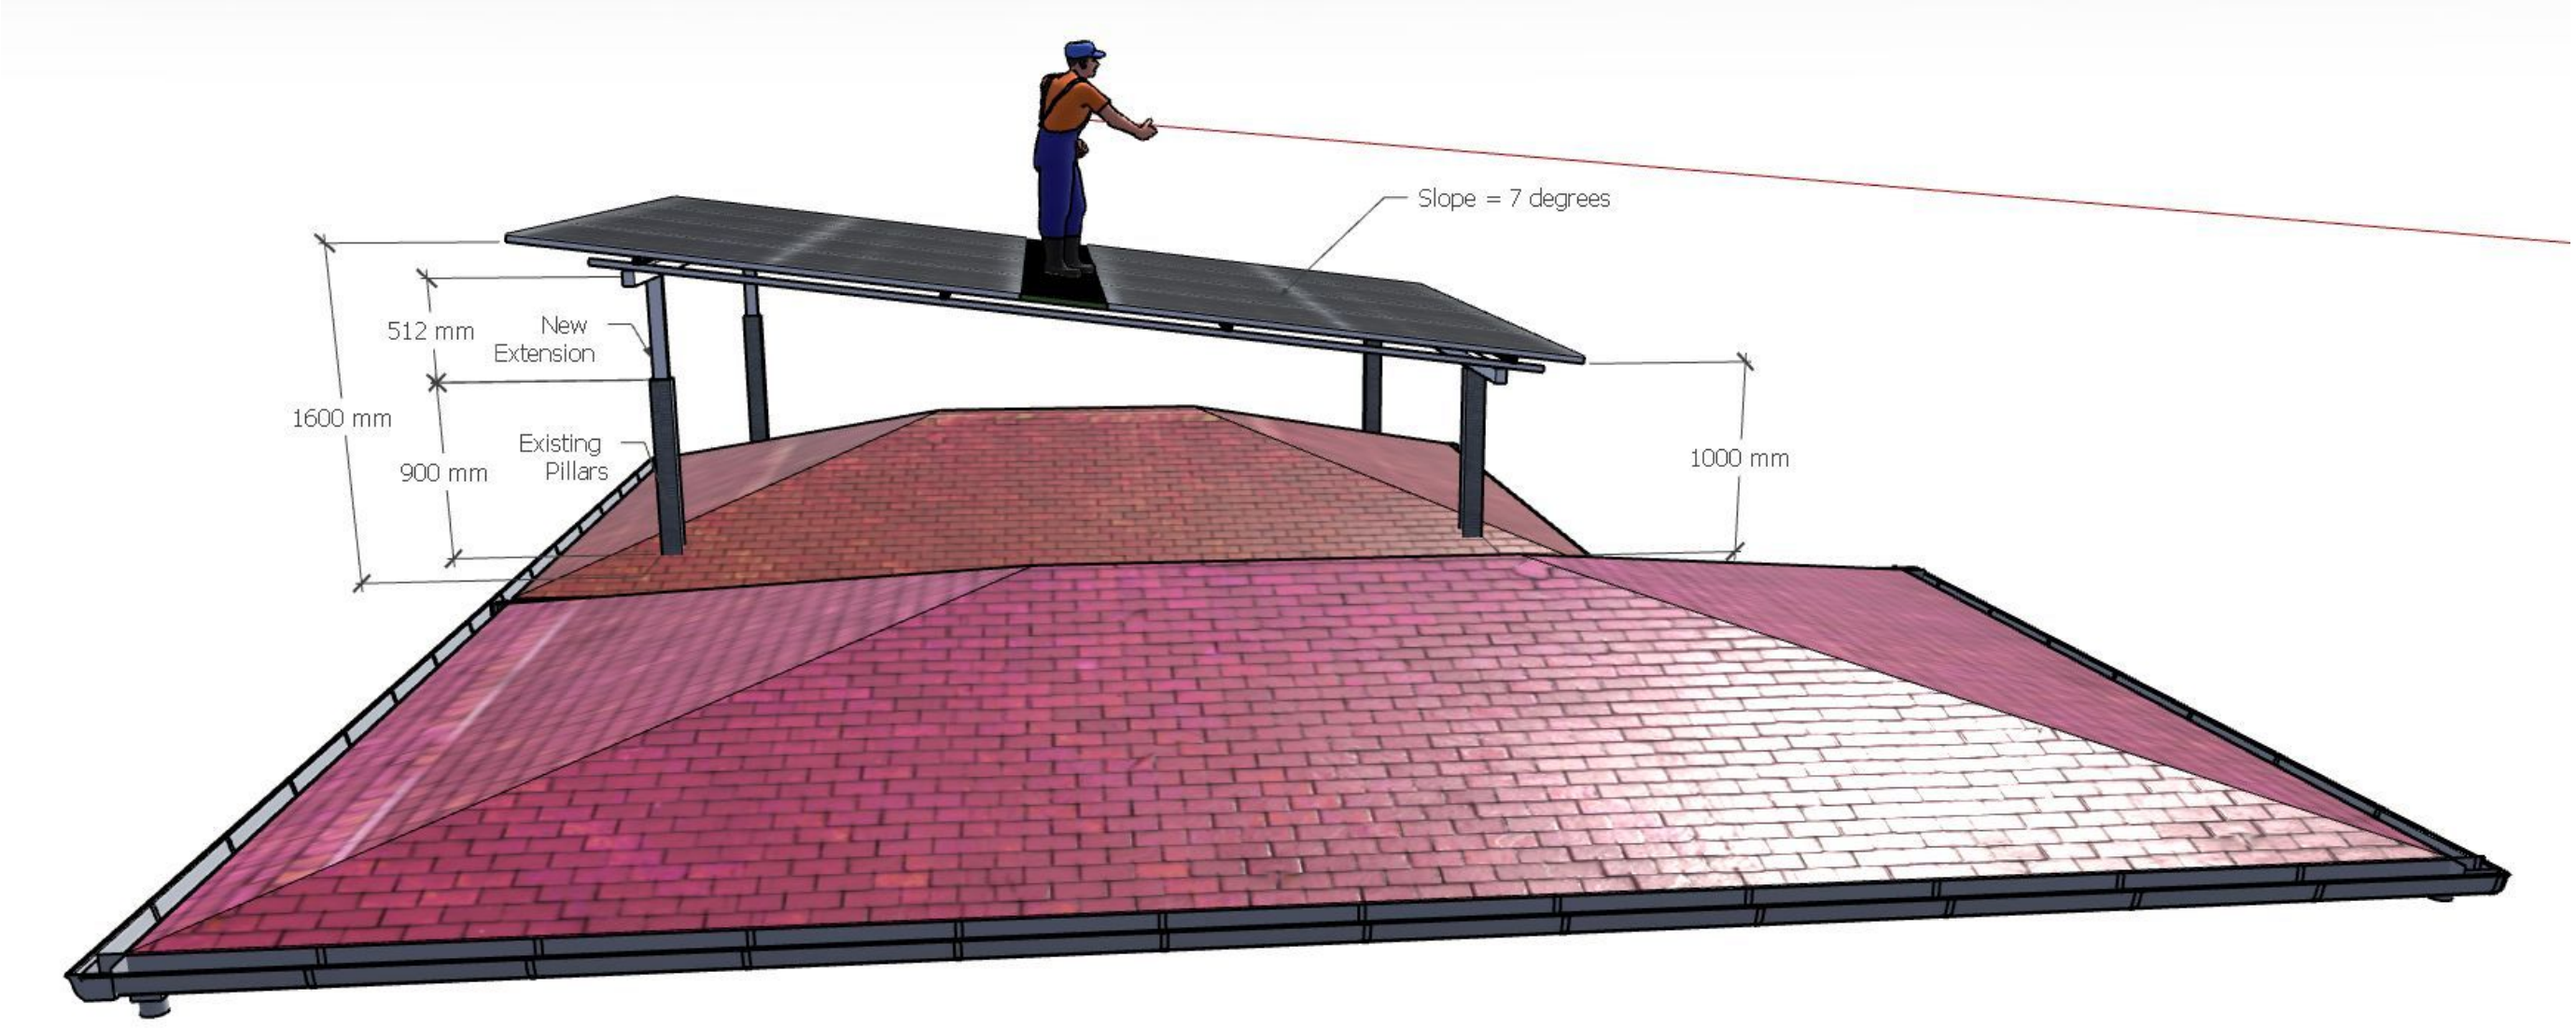

Building Exterior

Material Delivery Route

Gate No.2 entry

Take a left towards block B-8, the entrance to the basement parking lot

move toward the staircase

Staircase at the basement level, leading to the terrace level

Staircase at the 4th floor leading to the terrace level.

The materials reaching the common area terrace has to be shifted to the customer's terrace over the wall.

The materials reaching the customer's terrace has to be shifted under the roof for safety.

Staircase Details

Staircase at the basement level. Width: 850mm.

Material Storage

The PV modules and other major accessories has to be stacked under the roof safely.

Proposed PV Area

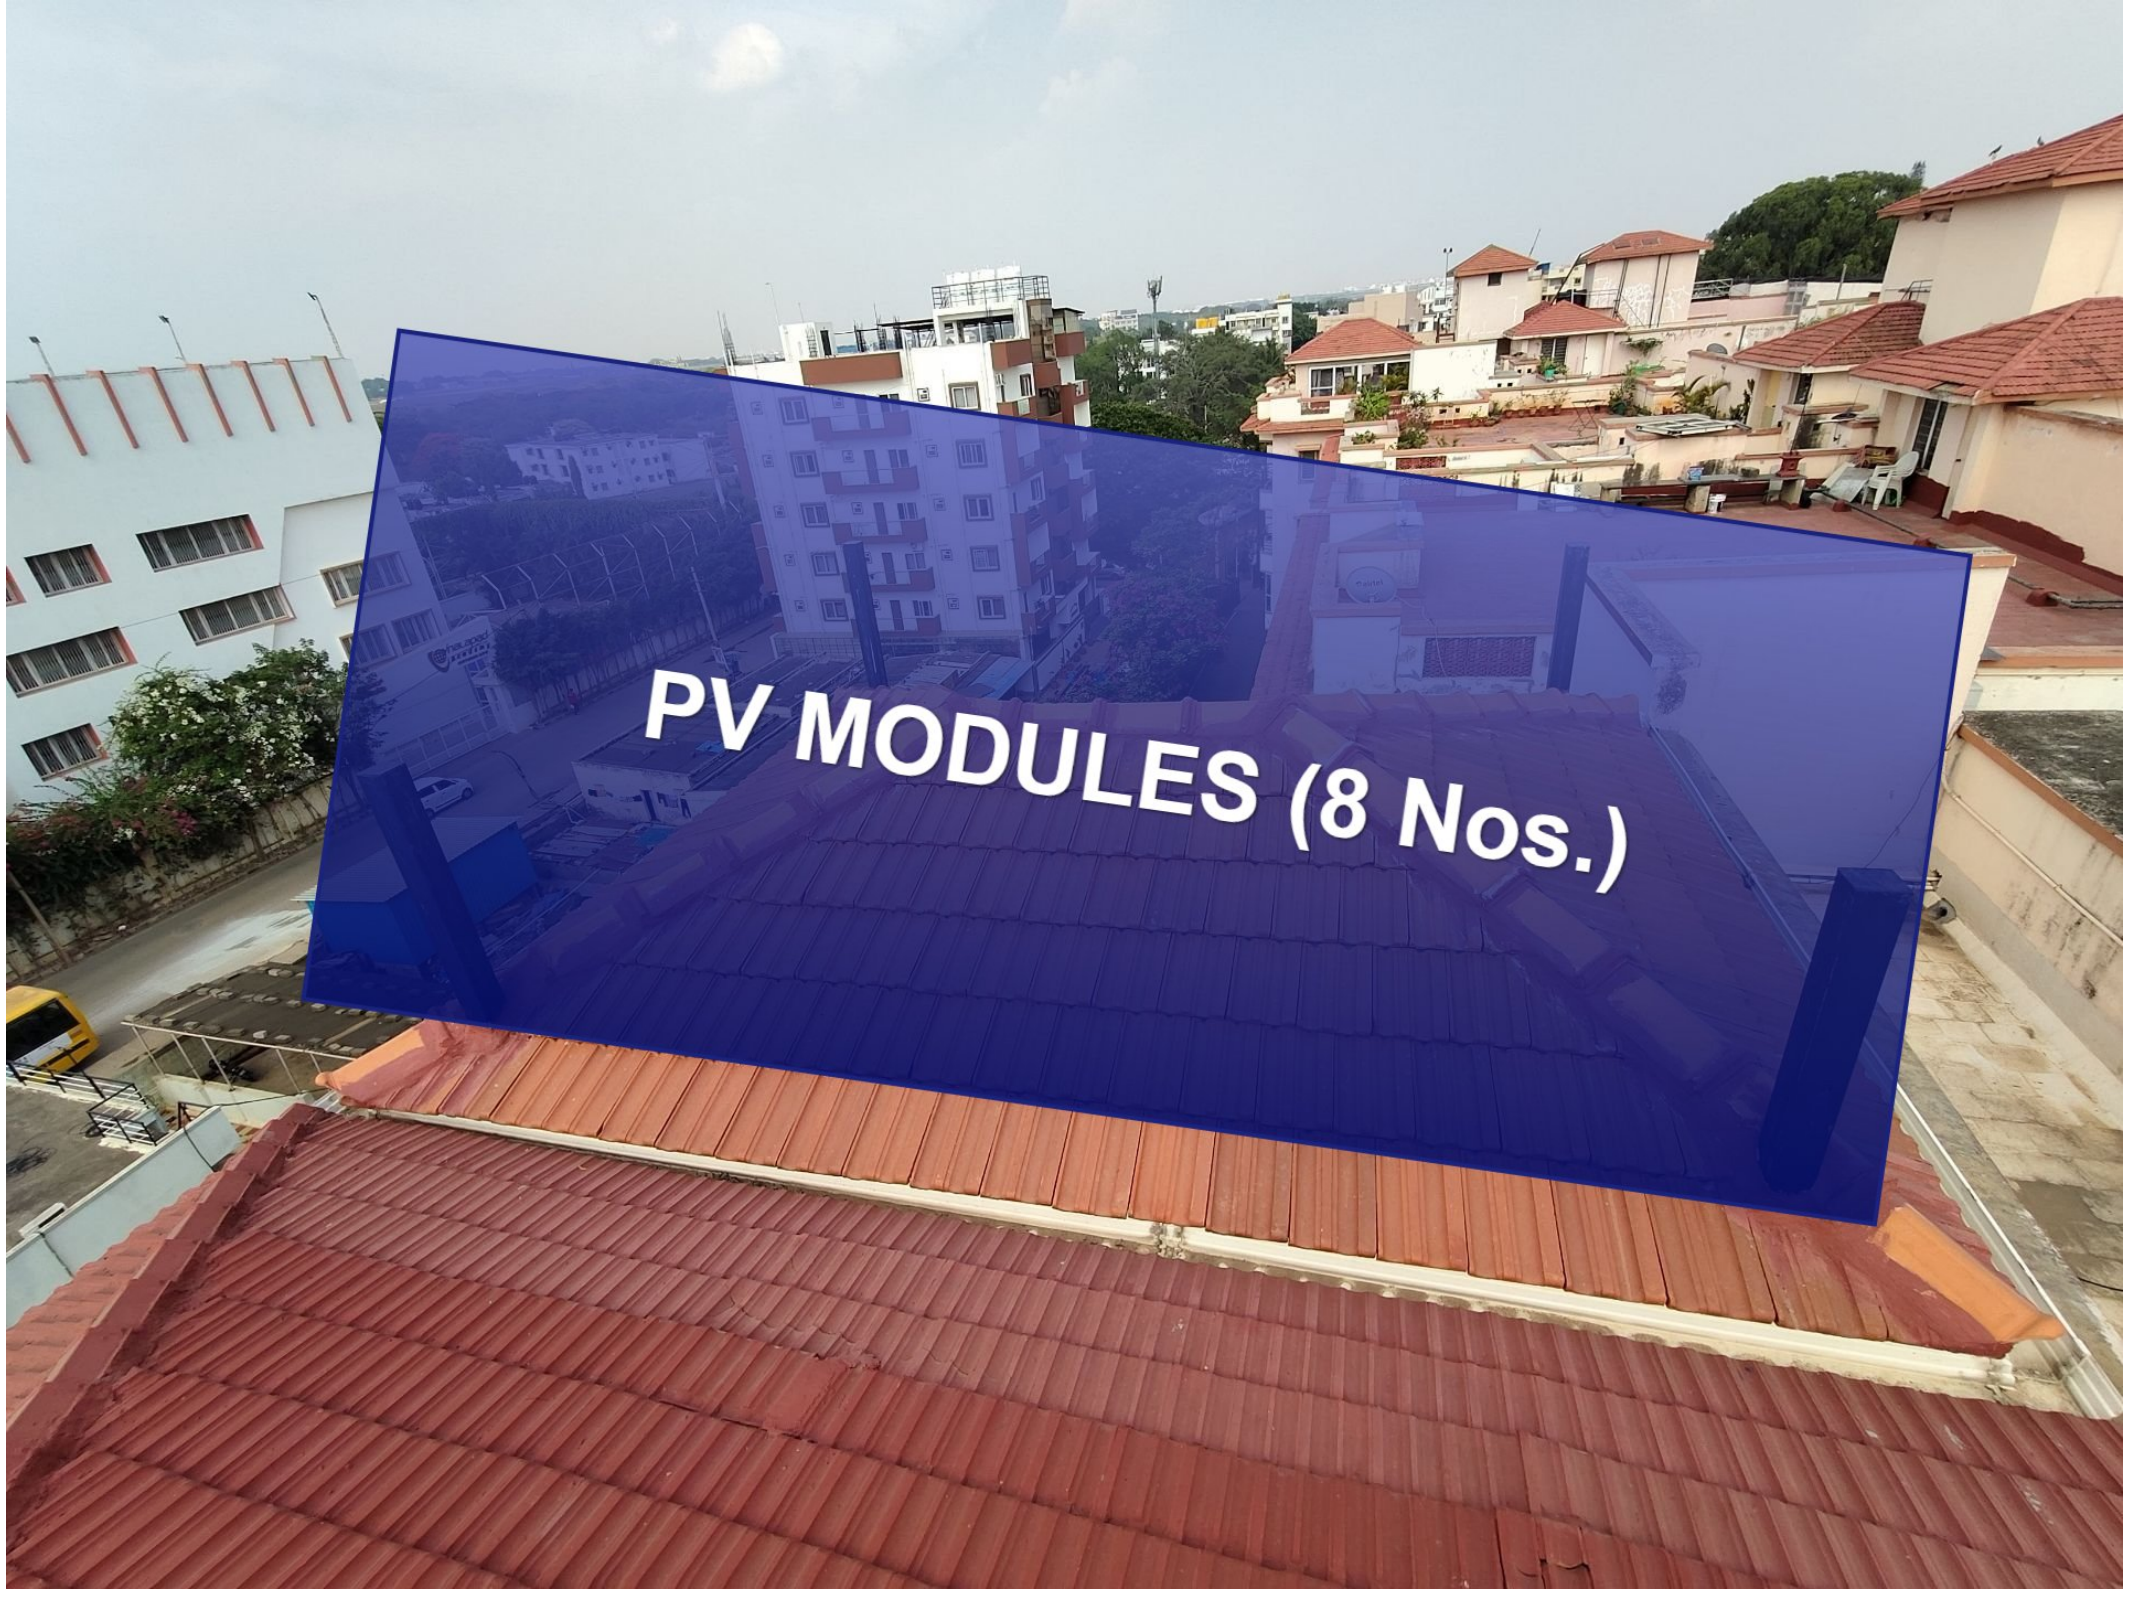

Cable Routing

All the earthing cables and the AC cable have to run from the roof and can follow the horizontal beam of the common area

The cables can run horizontally over the lower wall, just behind the AC outdoor unit until the electrical duct.

The cables has to run vertically through the duct from the terrace level to the basement level electrical room.

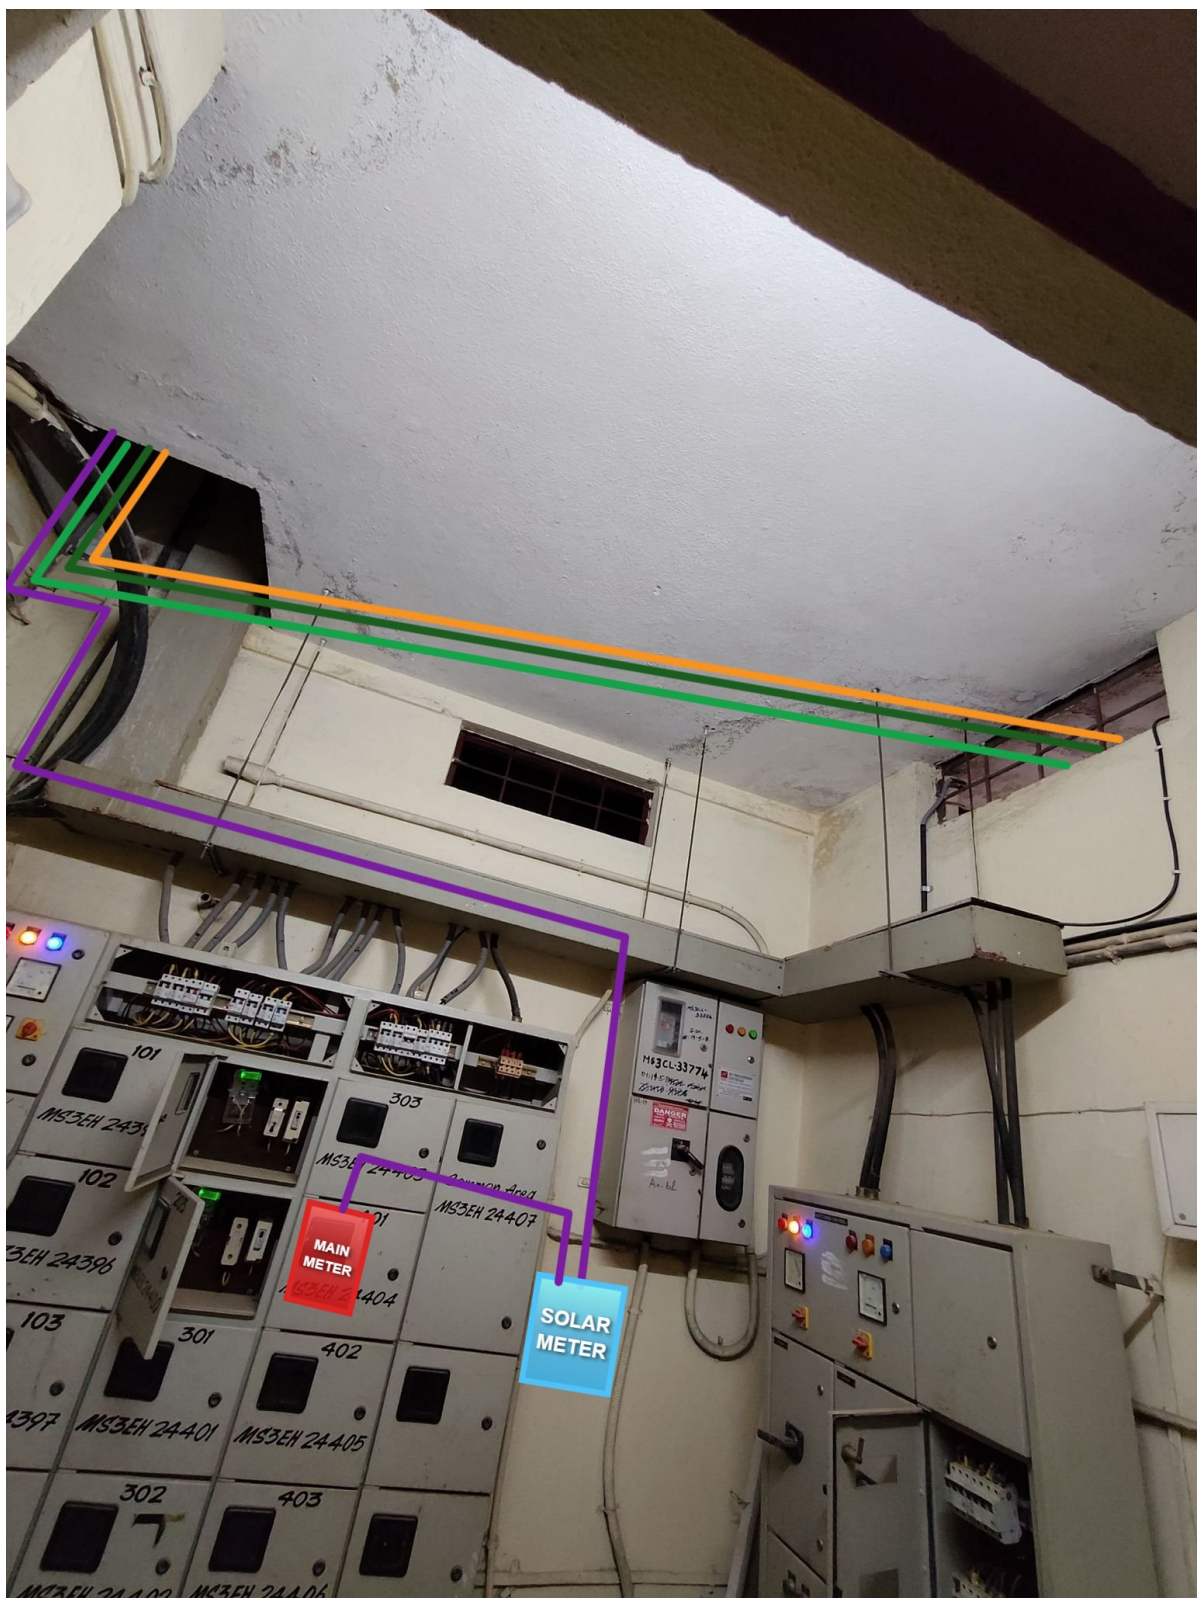

After reaching the electrical room, all the cables except the AC cable has to be redirected towards the outer wall through the upper grill window.

All the earthing cables coming out of the electrical room will run along the beams of the basement (Car parking area) and reach the customers allocated parking lot where earth pits can be dug.

Meter Box

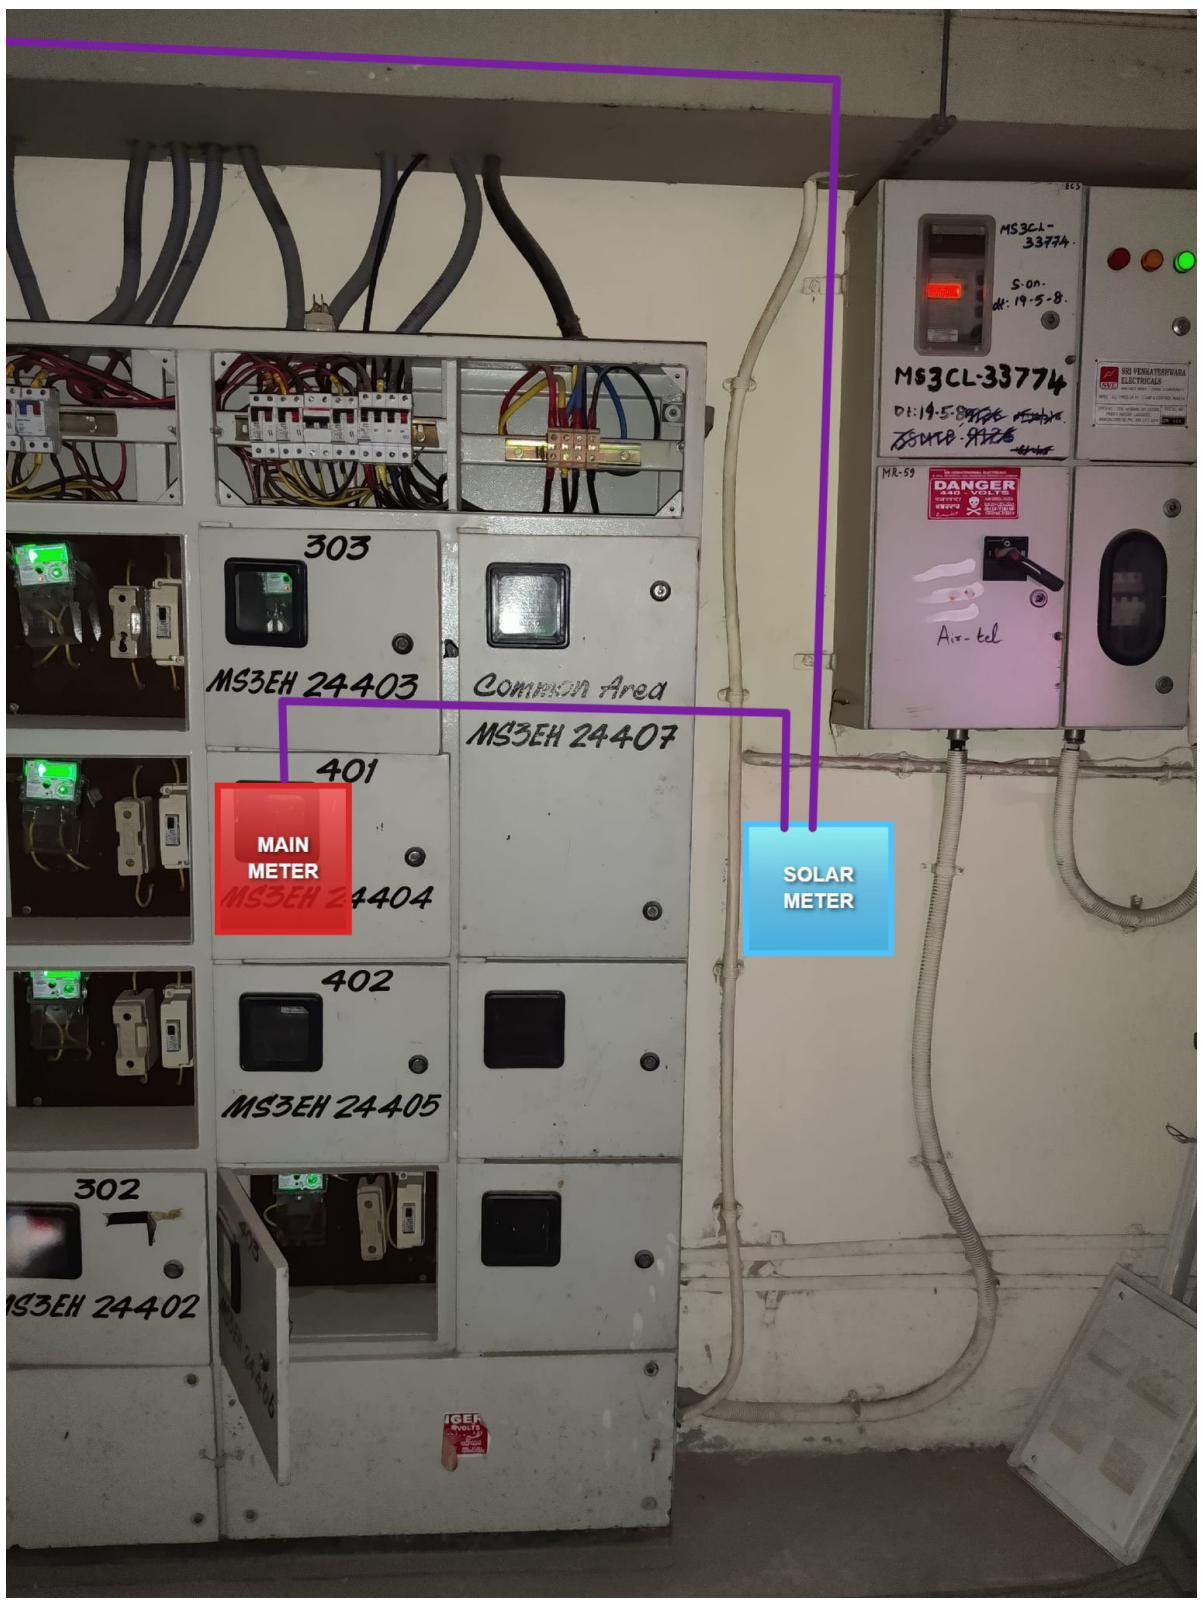
303
MS3EH 24403
Common Area
MS3EH 24407
401
MAIN METER
4404
SOLAR METER
402
MS3EH 24405
302
MS3EH 24402
MS3CL-33774
DANGER


402

OBSERVATIONS & RECOMMENDATIONS

EcoSoch Scope

#	Observation
1	Installation and commissioning of 4.96kWp On-grid solar power plant at the proposed premises.

Customer Scope

#	Observation
1	Providing an active Wi-Fi or LAN cable connection up to the inverter location.
2	The customer is responsible for arranging the ladder provision to get access to the proposed solar panel installation area prior to the project's execution.

THANK YOU

Dear K. Anand and L. Mythreyi,

Thank you for choosing EcoSoch Solar for your solar installation. We appreciate your trust in us and your commitment to sustainable energy. Our team is dedicated to ensuring a seamless installation experience and long-term performance of your solar system.

Should you have any questions or require further assistance, please do not hesitate to reach out to us.

Warm Regards,
Team EcoSoch

& Did You Know?

The Sun burns 600 million tonnes of hydrogen per second — and your panels get a share.

EcoSoch Solar Pvt. Ltd.

#940, Sha Arcade, 2nd Phase, NTI Layout, Kodigehalli, Bengaluru 560097

www.ecosoch.com | info@ecosoch.com