Technical Site Visit Report

Prepared for: Satheesh Babu_Brigade Atmosphere Subsidy_6.15kWp_Microinverter (IQ Series)

PROJECT INFORMATION

Report Number	ESV-2026-0139
Project ID	A105A3B0
Project Name	Satheesh Babu_Brigade Atmosphere Subsidy_6.15kWp_Microinverter (IQ Series)
Project Sector	Residential
Project Type	With Subsidy
Sales Lead	Govindaraju JS
Site Address	D18, Brigade Atmosphere, Devanahalli 562110, Bangalore.
GPS Coordinates	13.267269, 77.739142
Google Maps	https://www.google.com/maps?q=13.267269,77.739142
Visit Date	2026-06-09
Visited By	ABILASH N K
Revision	Rev 1

CLIENT INFORMATION

Client Name	Satheesh Babu
Contact	9003377980

PROJECT DETAILS

Solar Rooftop System Type	On-Grid
System Capacity (kWp)	6.15
Sanction Load (kW)	10
Module Make & Capacity	Adani TOPCon Bi-facial DCR, 615 Wp
Module Length (mm)	2382
Module Width (mm)	1133

Number of Panels	10
Inverter Type	Micro
Inverter Brand	Enphase IQ8P
Number of Inverters	10
Mounting Structure Type	Tiled Roof

SITE INSPECTION CHECKLIST

General

#	Question	Answer	Notes
1	Can the delivery van/truck reach the material unloading point?	Yes	-
2	Are there any obstacles at the site that could hinder material lifting?	No	-
3	Where will the Inverter, DCDB, ACDB, Battery, etc. be located?	The solar meter cubicle can be wall-mounted just above the existing LT panel of the customer. The Enphase accessories box will be wall-mounted on the first floor.	-
4	Is a canopy required for protecting the Inverters/ACDB/DCDB?	details: Fabrication of a canopy to protect the solar meter cubicle installed on the premises is under the customer's scope.	-
5	Did you discuss the location of the earth pits with the customer?	Yes, discussed with the customer and finalised the location for earthing.	-
6	Where is the Internet Router located?	First floor	-
7	What's the Wi-Fi strength of the router near to the String inverter/Envoy?	3 bars	-
8	Did you pin the site location in your WhatsApp when you were at the site?	Yes	-

Roof Details

#	Question	Answer	Notes
1	What type of roof is present at the site?	Tiled Roof	-
2	Are there any obstructions on the roof that could affect the solar installation?	No	-

#	Question	Answer	Notes
3	What is the angle of the panels? (in degrees)	20	-
4	In case of sloped roof, what is the slope angle of the roof? (in degrees)	20	-
5	On how many roofs at the site are we installing solar?	1	*Only one residential site. But they have three nearby roofs for panel installation. Roof 1: Upper terrace. Roof 2: Upper terrace. Roof 3: Lower terrace.*
6	If it is a Tiled roof, what is underneath the tiles?	RCC	-
7	If it is a Tiled roof with MS or Wooden rafters, is it Single-tiled or Double-tiled?	N/A	-
8	What type of mounting structure is planned?	Other	*Aluminium full rail structure*
9	What is the orientation of the solar panels?	-	*Roof 1: West facing (4 Nos. of PV Modules) Roof 2: West facing (4 Nos. of PV Modules) Roof 3: South facing (2 Nos. of PV Modules)*
10	How can the roof be accessed?	Staircase	-
11	Is the building currently under construction?	**No**	-
12	In an under-construction building, are existing conduit pipes available for AC, DC cables, and earthing?	N/A	-
13	What is the height of the building and how many floors does it have?	7 Meters (G + 1)	-
14	Is the site photo matching with the building description?	Yes	-
15	Is there an overhead HT line passing within a 10-meter radius of the site?	**No**	-

Residential / Electrical

#	Question	Answer	Notes
1	What type of energy meter is currently installed?	Phase: Three Phase, Type: Digital, If 3-phase: LT with CT (35 - 49.999)	-
2	Is the Meter cubicle photo matching with the previous answer?	Yes	-
3	Has the termination point in the Main meter panel been identified?	Yes	-
4	Is the Termination Point easily visible or sealed?	Visible	-
5	Is a Lightning Arrestor (LA) already available at the site?	**No**	-
6	Is space available for CT within Energy meter panel?	Yes	-
7	In case of an Enphase system, is the distance between the farthest micro-inverter and IQ Gateway > 50m?	Less than 50m	-
8	Provide details of the existing CT ratings (if applicable).	Not visible enough.	-
9	In Main meter panel, is empty space available for solar meter?	**No**	-
10	In Main meter panel, is empty space available to house the Enphase accessories or ACDB components?	**No**	-
11	Is there space available to dig DC, AC and LA earth pits?	Yes	-

#	Question	Answer	Notes
12	In case of elevated structures, is an LA extension provided at the far end?	N/A	-
13	In case of elevated structures, is it with or without grouting?	N/A	-
14	Are there any challenges with respect to Installation and Maintenance activities?	**No**	*Need to be careful with the roofing tiles, as there are chances of them breaking. Also, the inclination of the roof is about 20 degrees, so movement over the roof needs more attention.*
15	Are there any safety risks associated with accessing the roof for installation?	**No**	-
16	Is space present in rooftop to store the panels?	Vertically leaning against the wall	-
17	In case of sloped roof MS structure, provide the dimension of rafter to rafter, purlin to purlin.	N/A	-
18	Is ventilation available in the battery location?	N/A	-
19	Should the Inverters/ACDB/DCDB be installed on a metal grill or wall mount?	Enphase accessories box has to be wall mounted at the 1st floor	-
20	Provide the dimensions for solar meter cubicle placement (L x W of wall).	length: 800, width: 800	-
21	Provide the dimension for earth pits location (L x W of available space).	length: 3000, width: 600	-
22	Is LAN cable under customer scope?	Yes	-
23	Is there any shadow that affects the solar installation?	**No**	-
24	Is there any trench work to be done to carry the AC cable to the meter location?	**No**	*There exists a trench at the ground level (from the bottom chamber of the LT panel to the corner of the building). The AC output cable reaching the ground from the roof can be pulled up to the LT panel chamber via this chamber.*

PHOTO DOCUMENTATION

Cable Routing Legend

Legend	Description
	Proposed PV Module Array
	Main Meter Location
	Solar Meter
	Battery
	Inverter
	Other Equipment
	DC Cable
	AC Cable
	Material Shifting
	DC Earthing Cable
	AC Earthing Cable
	LA Cable
	DC Earth Pit

Site Layout - Top View

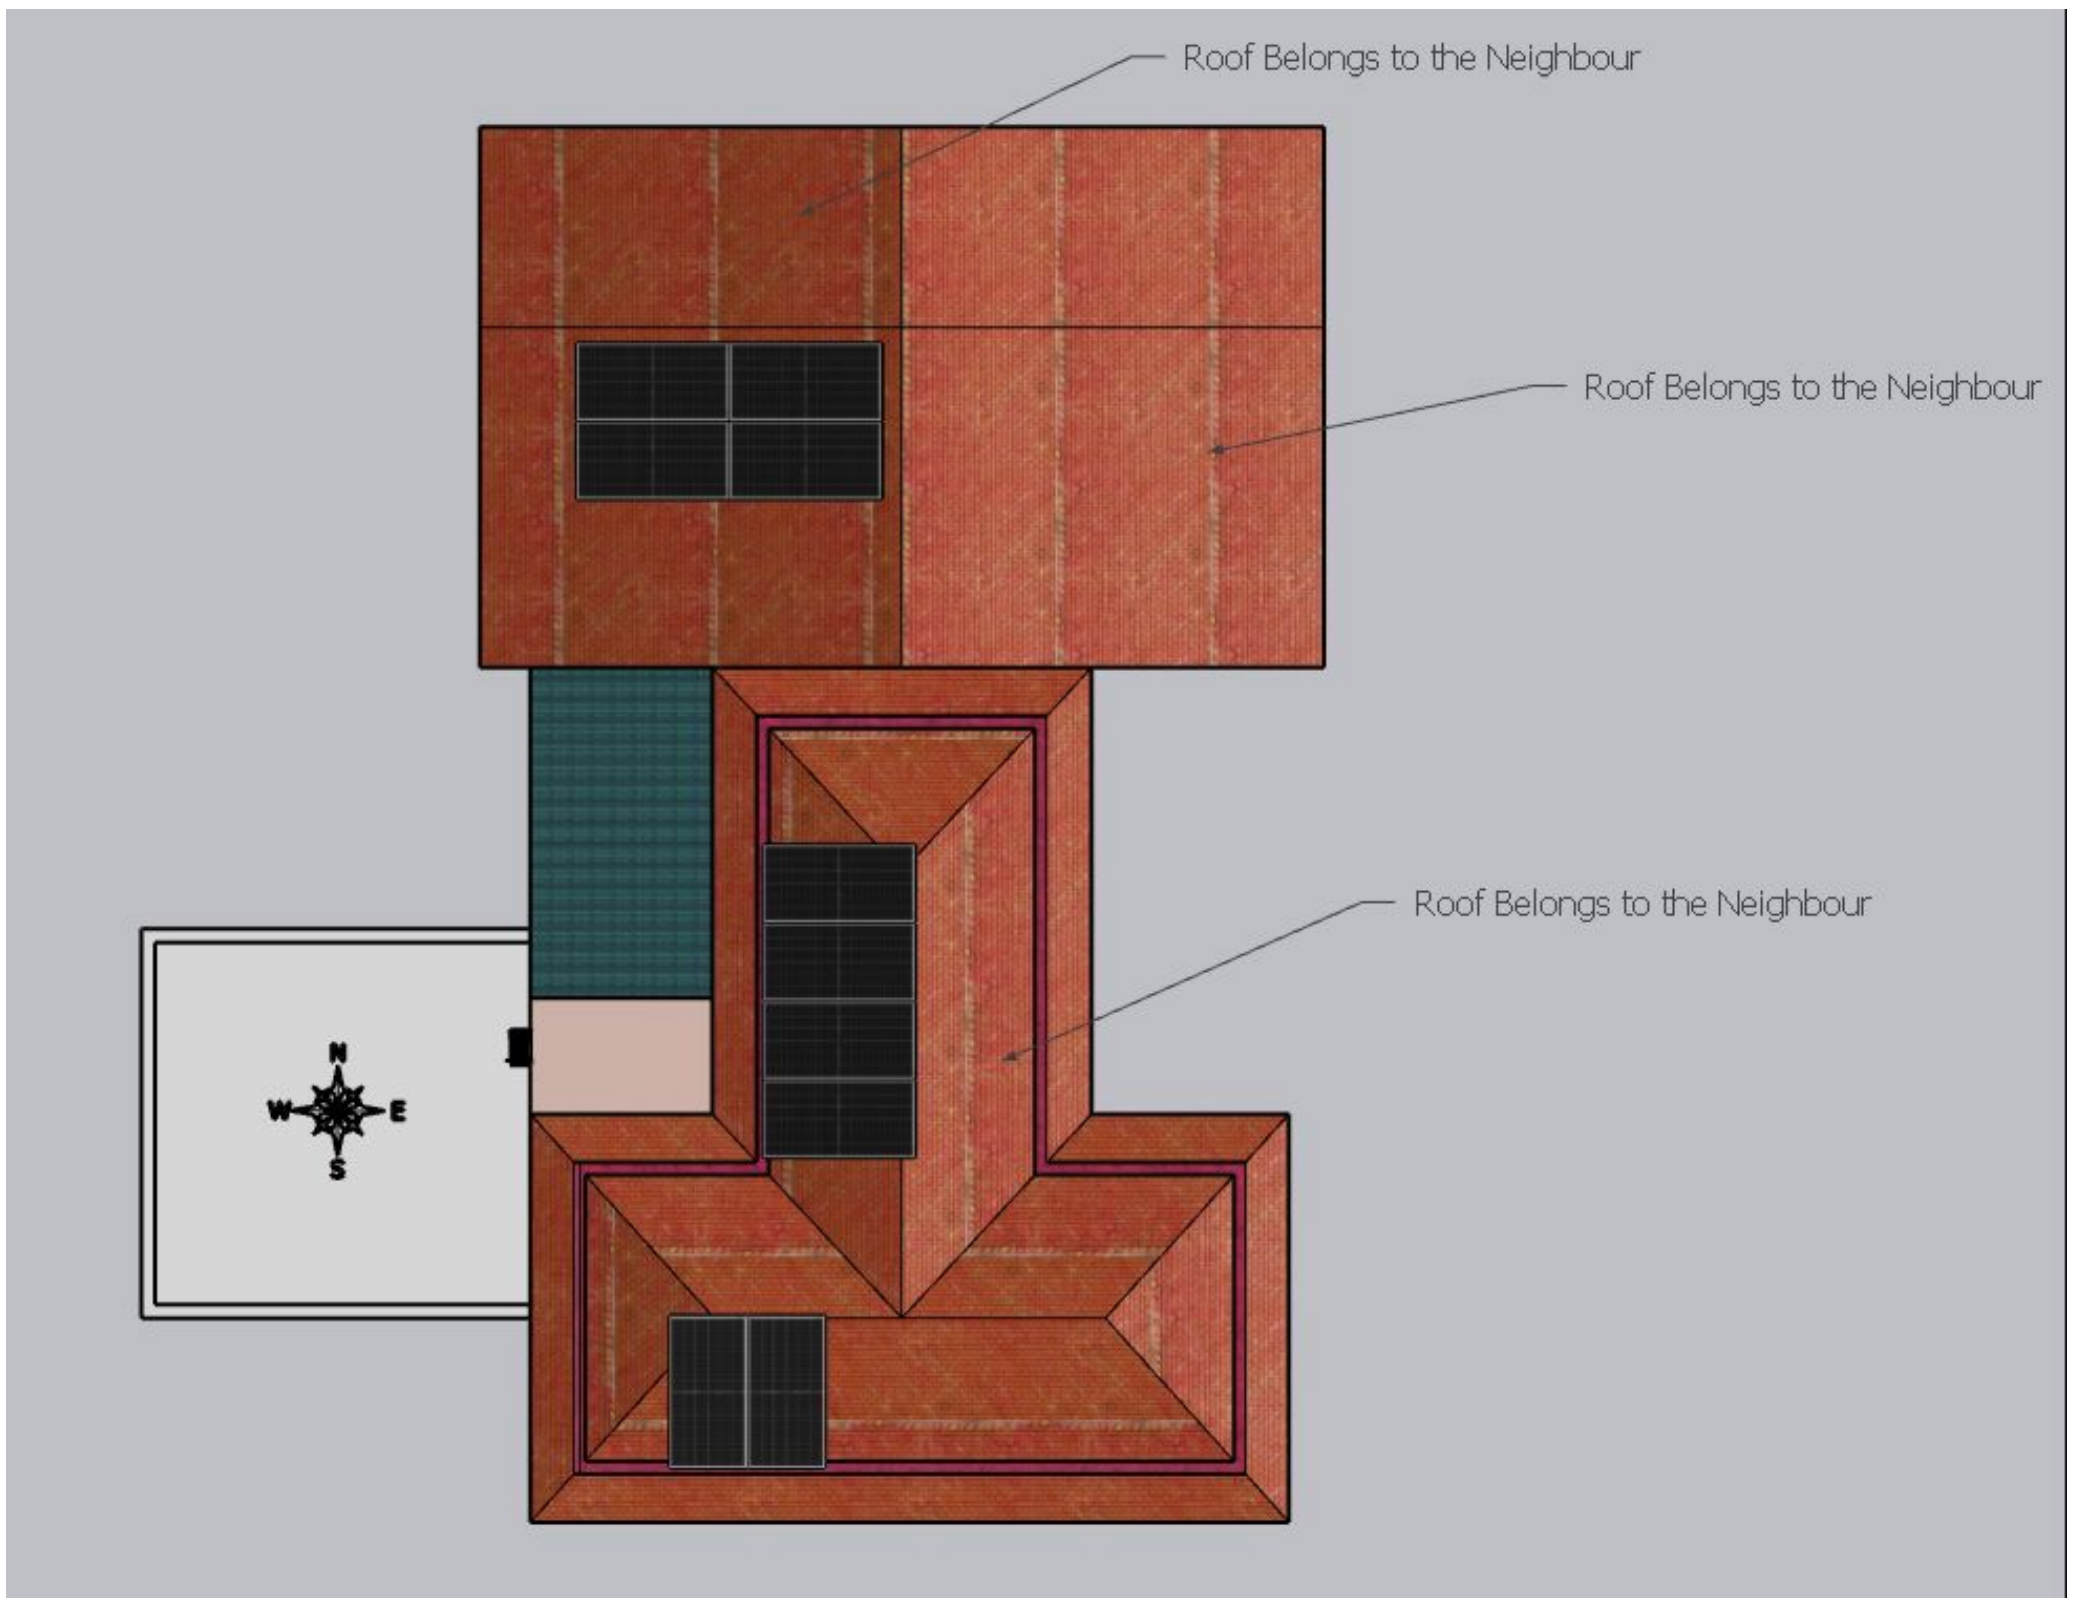

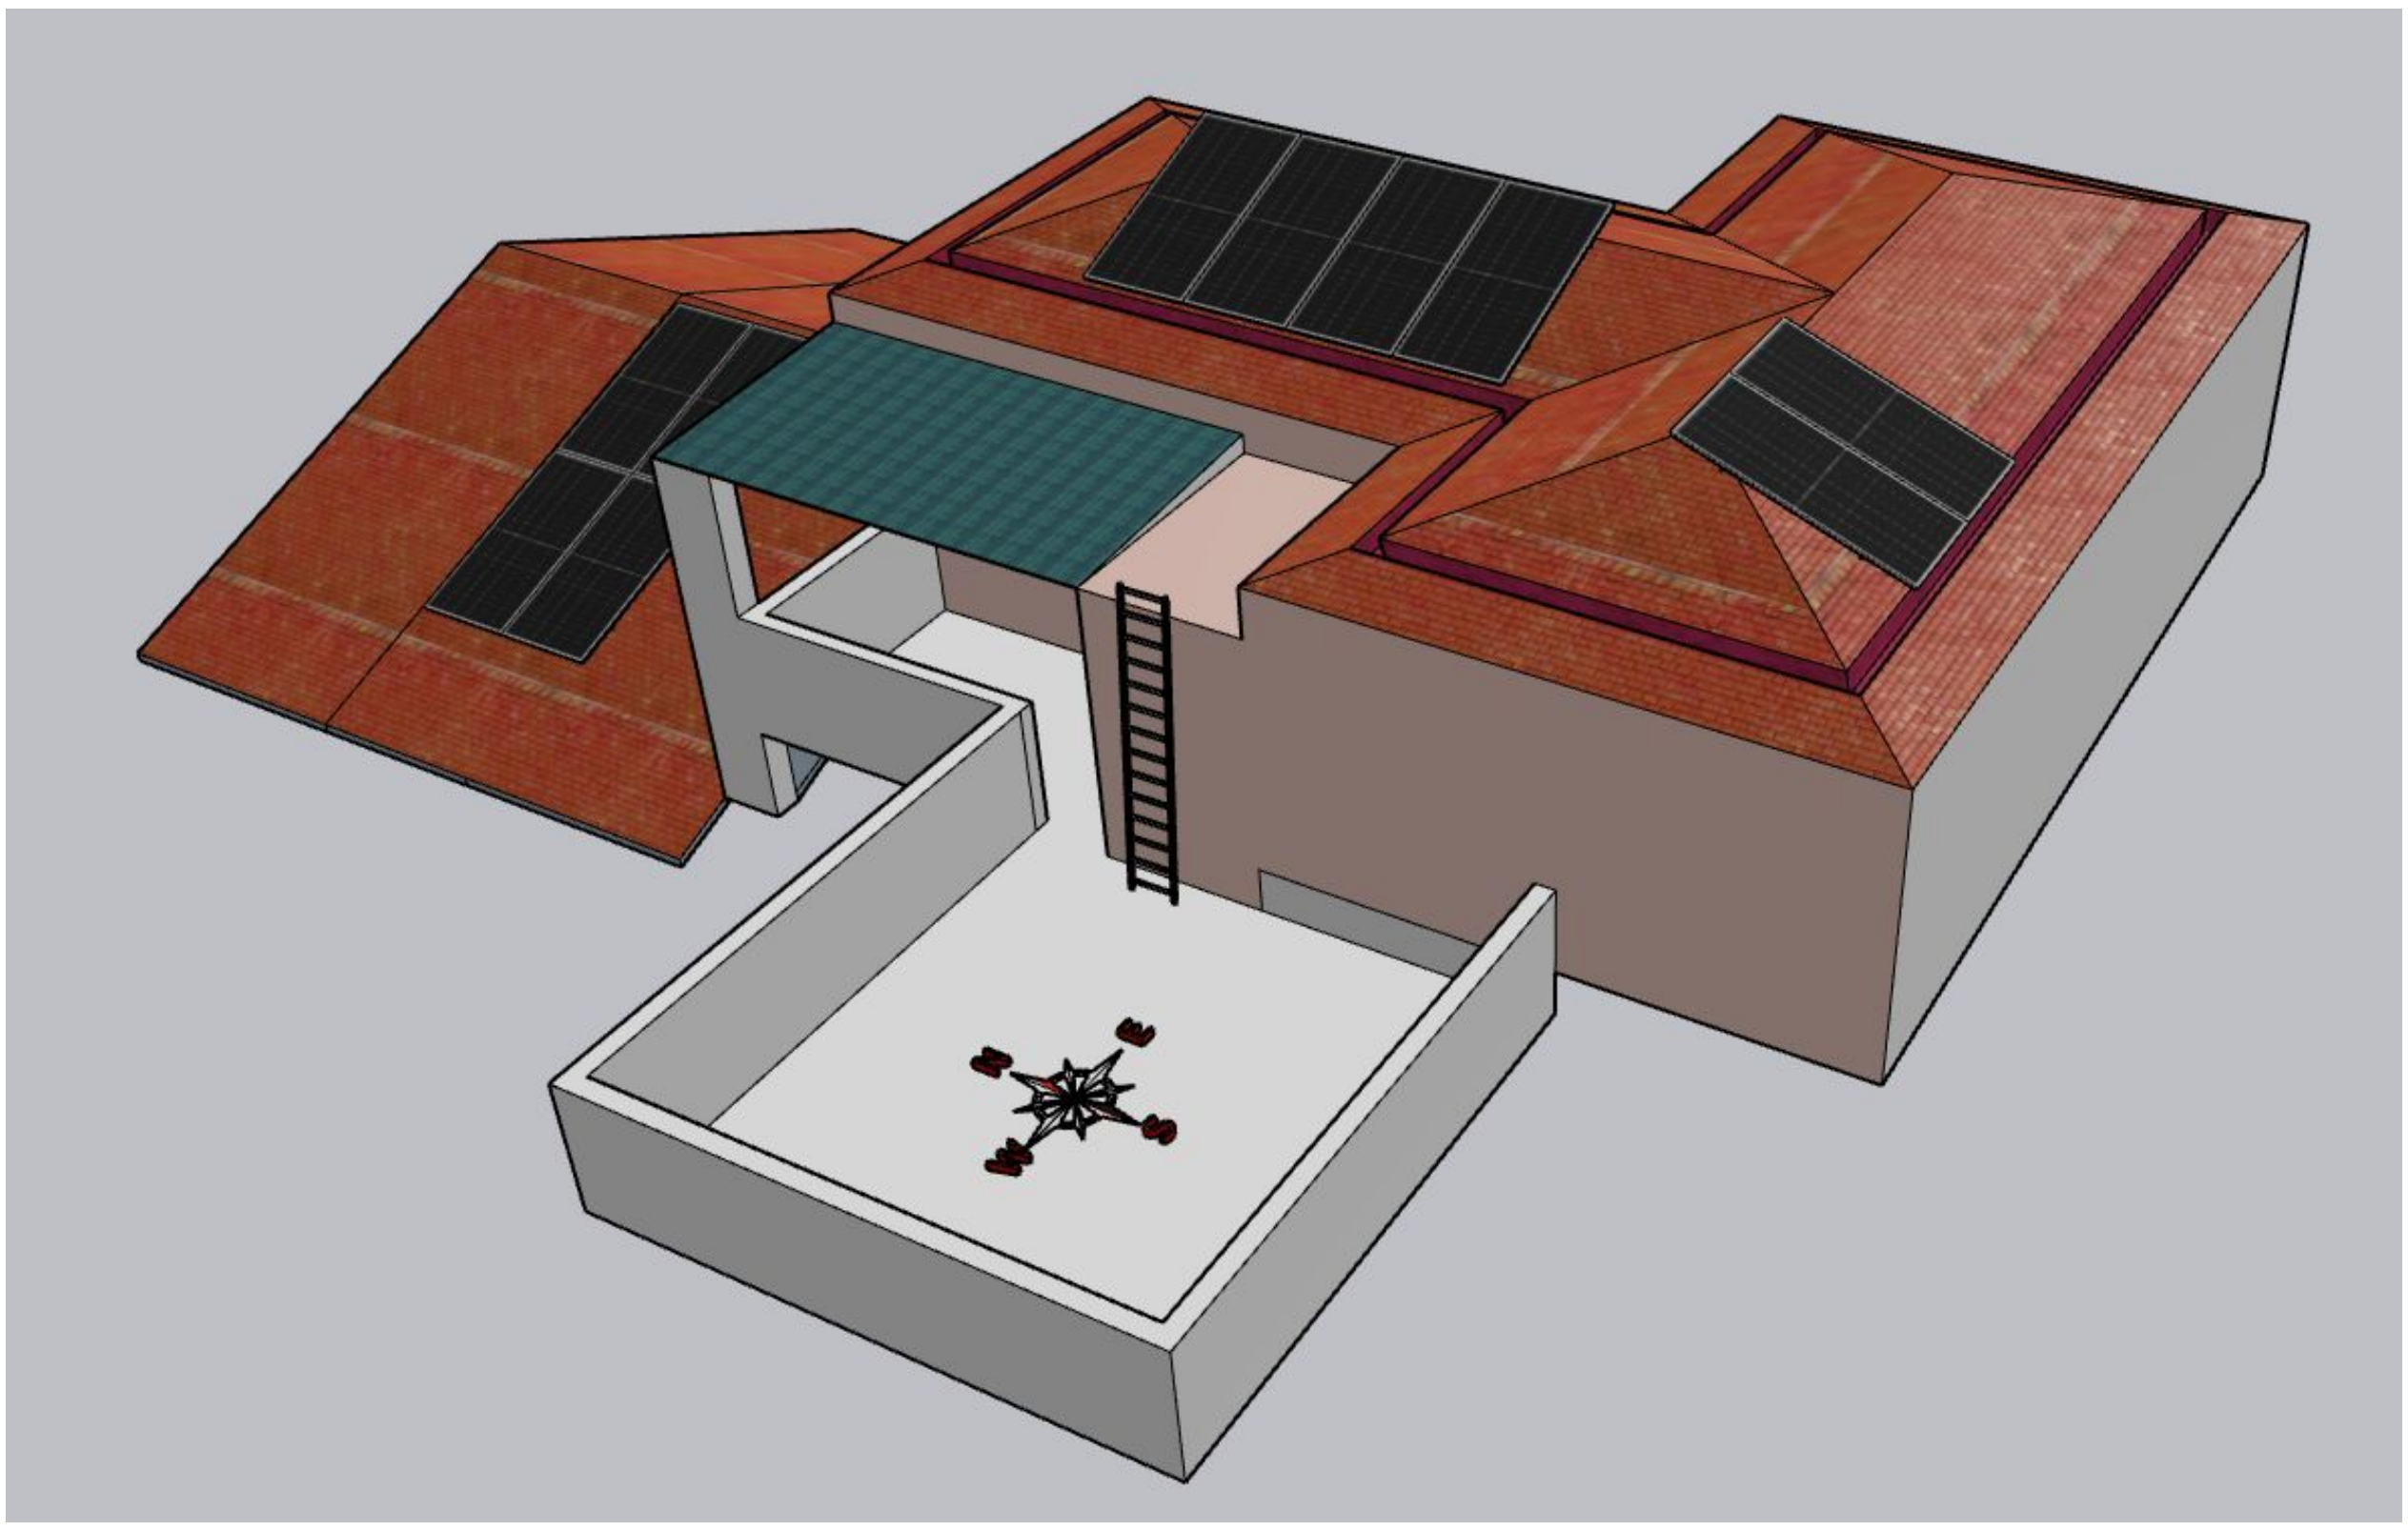

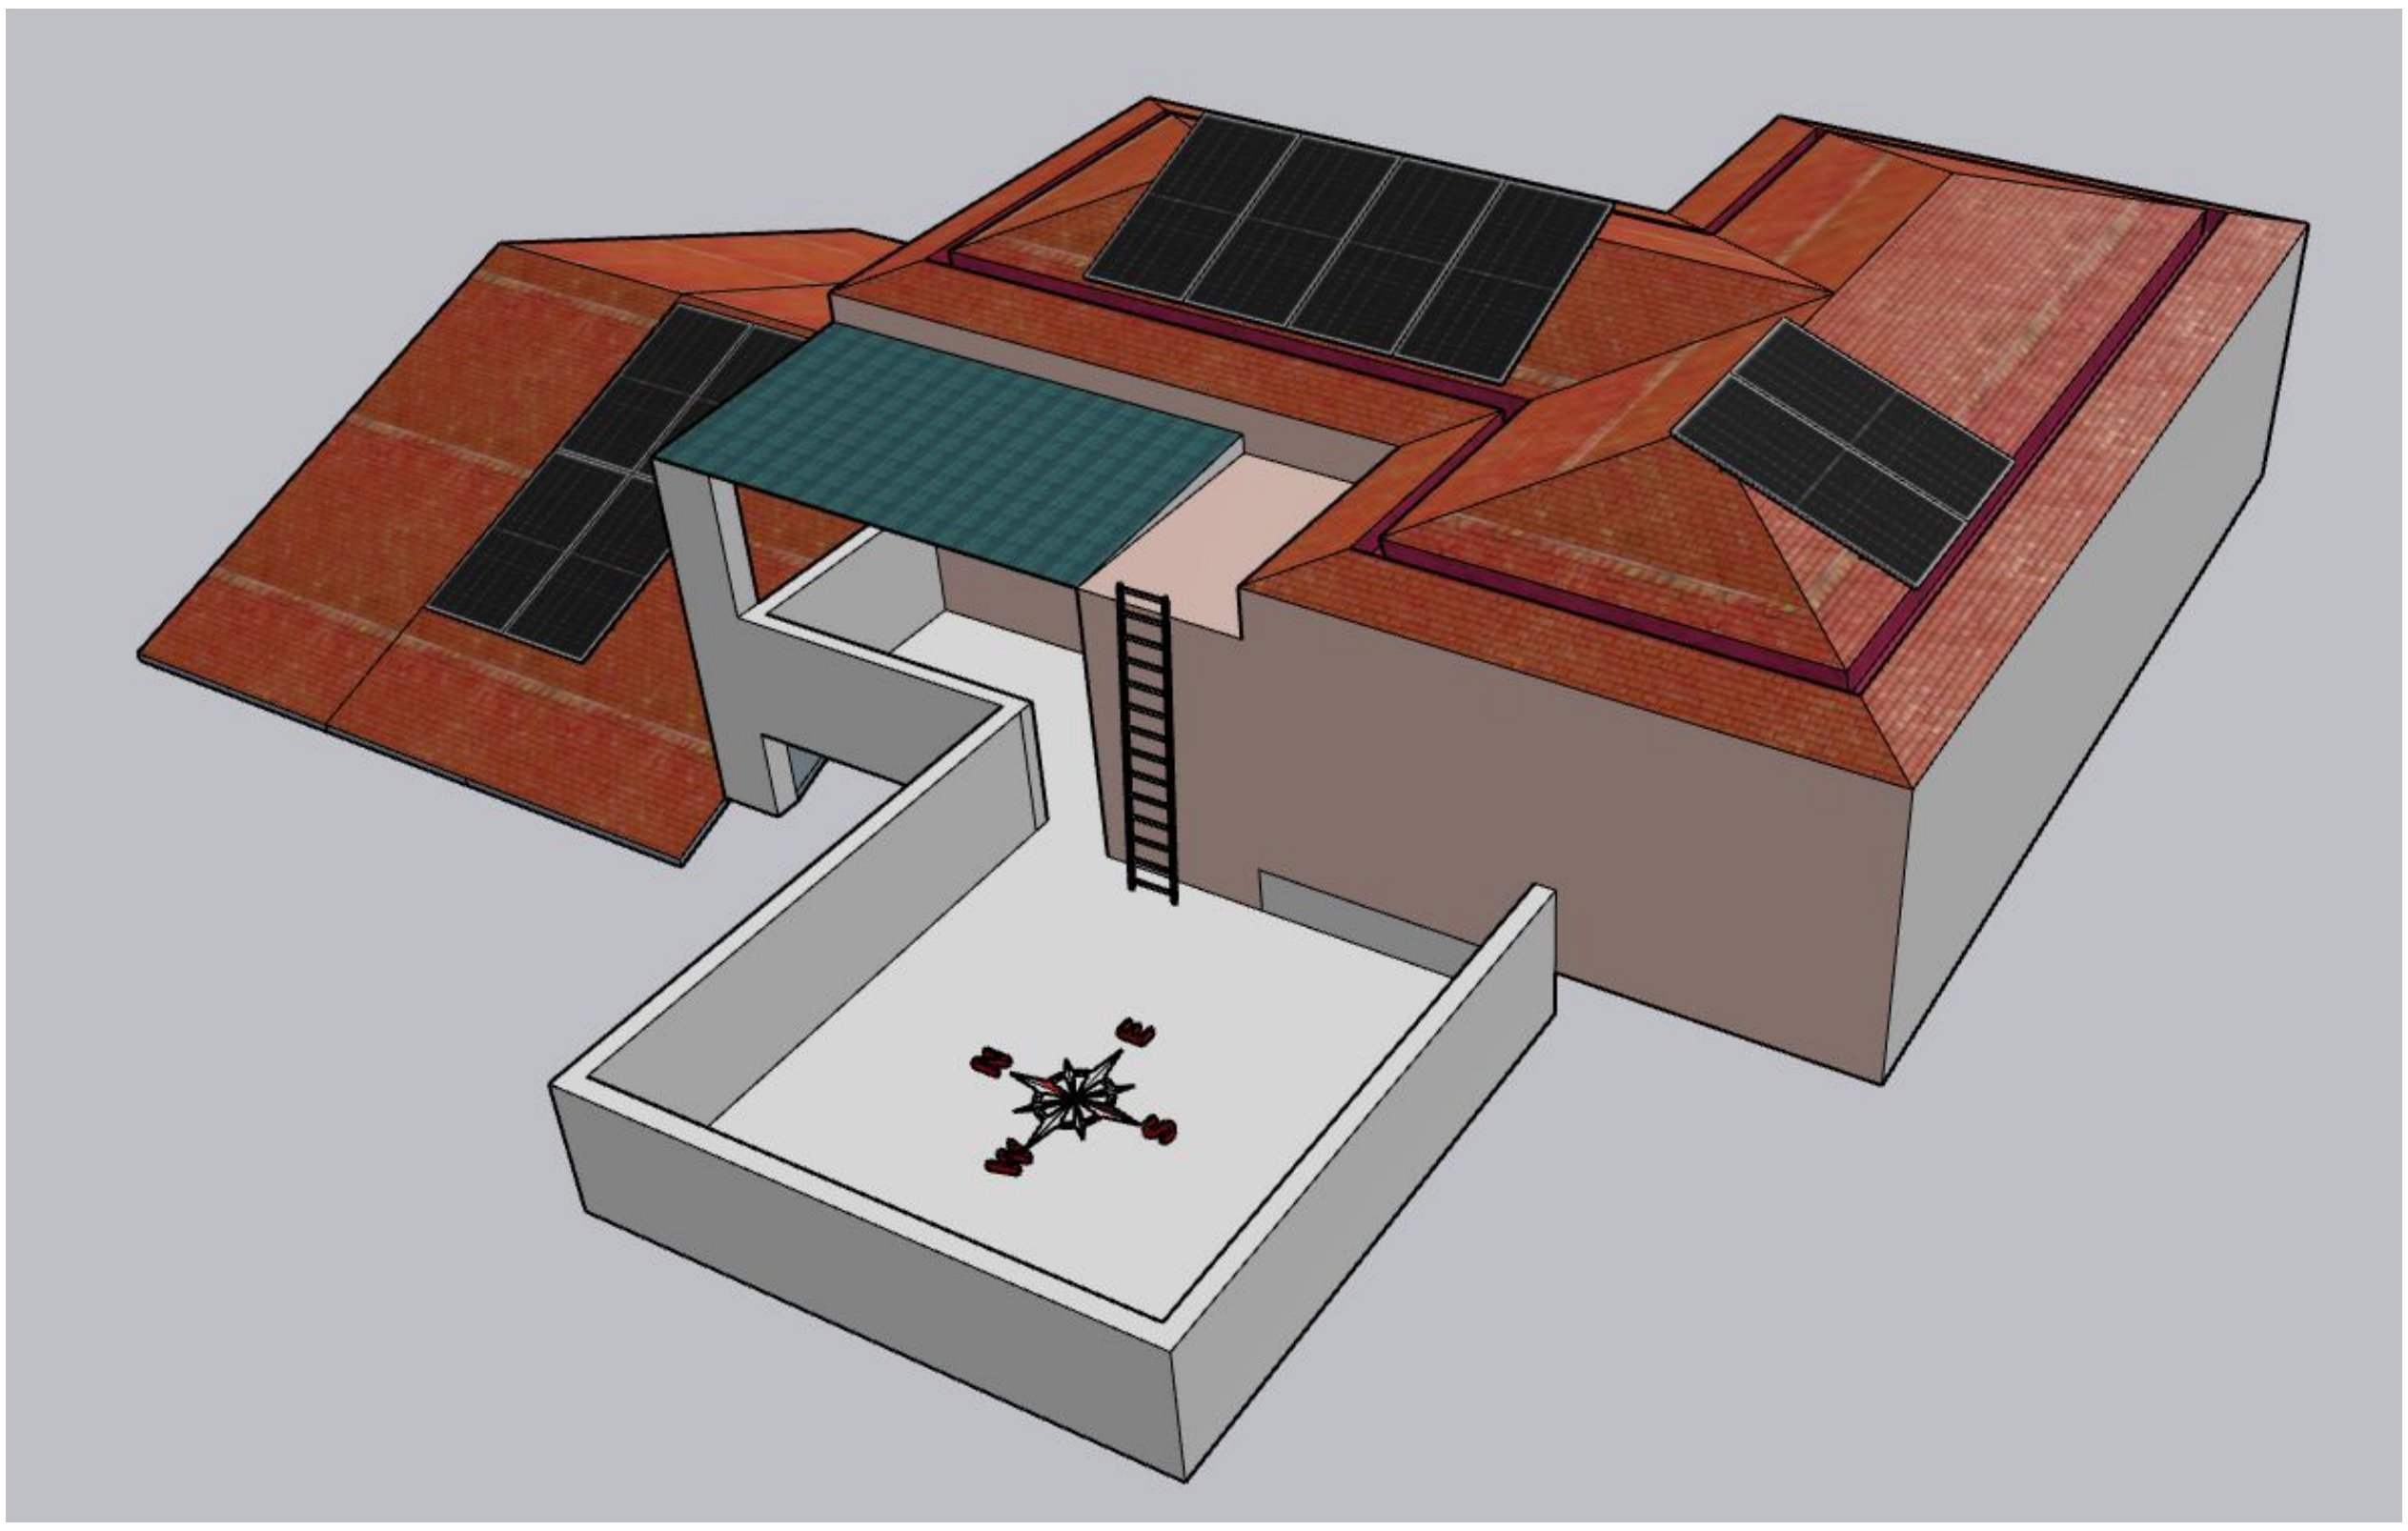

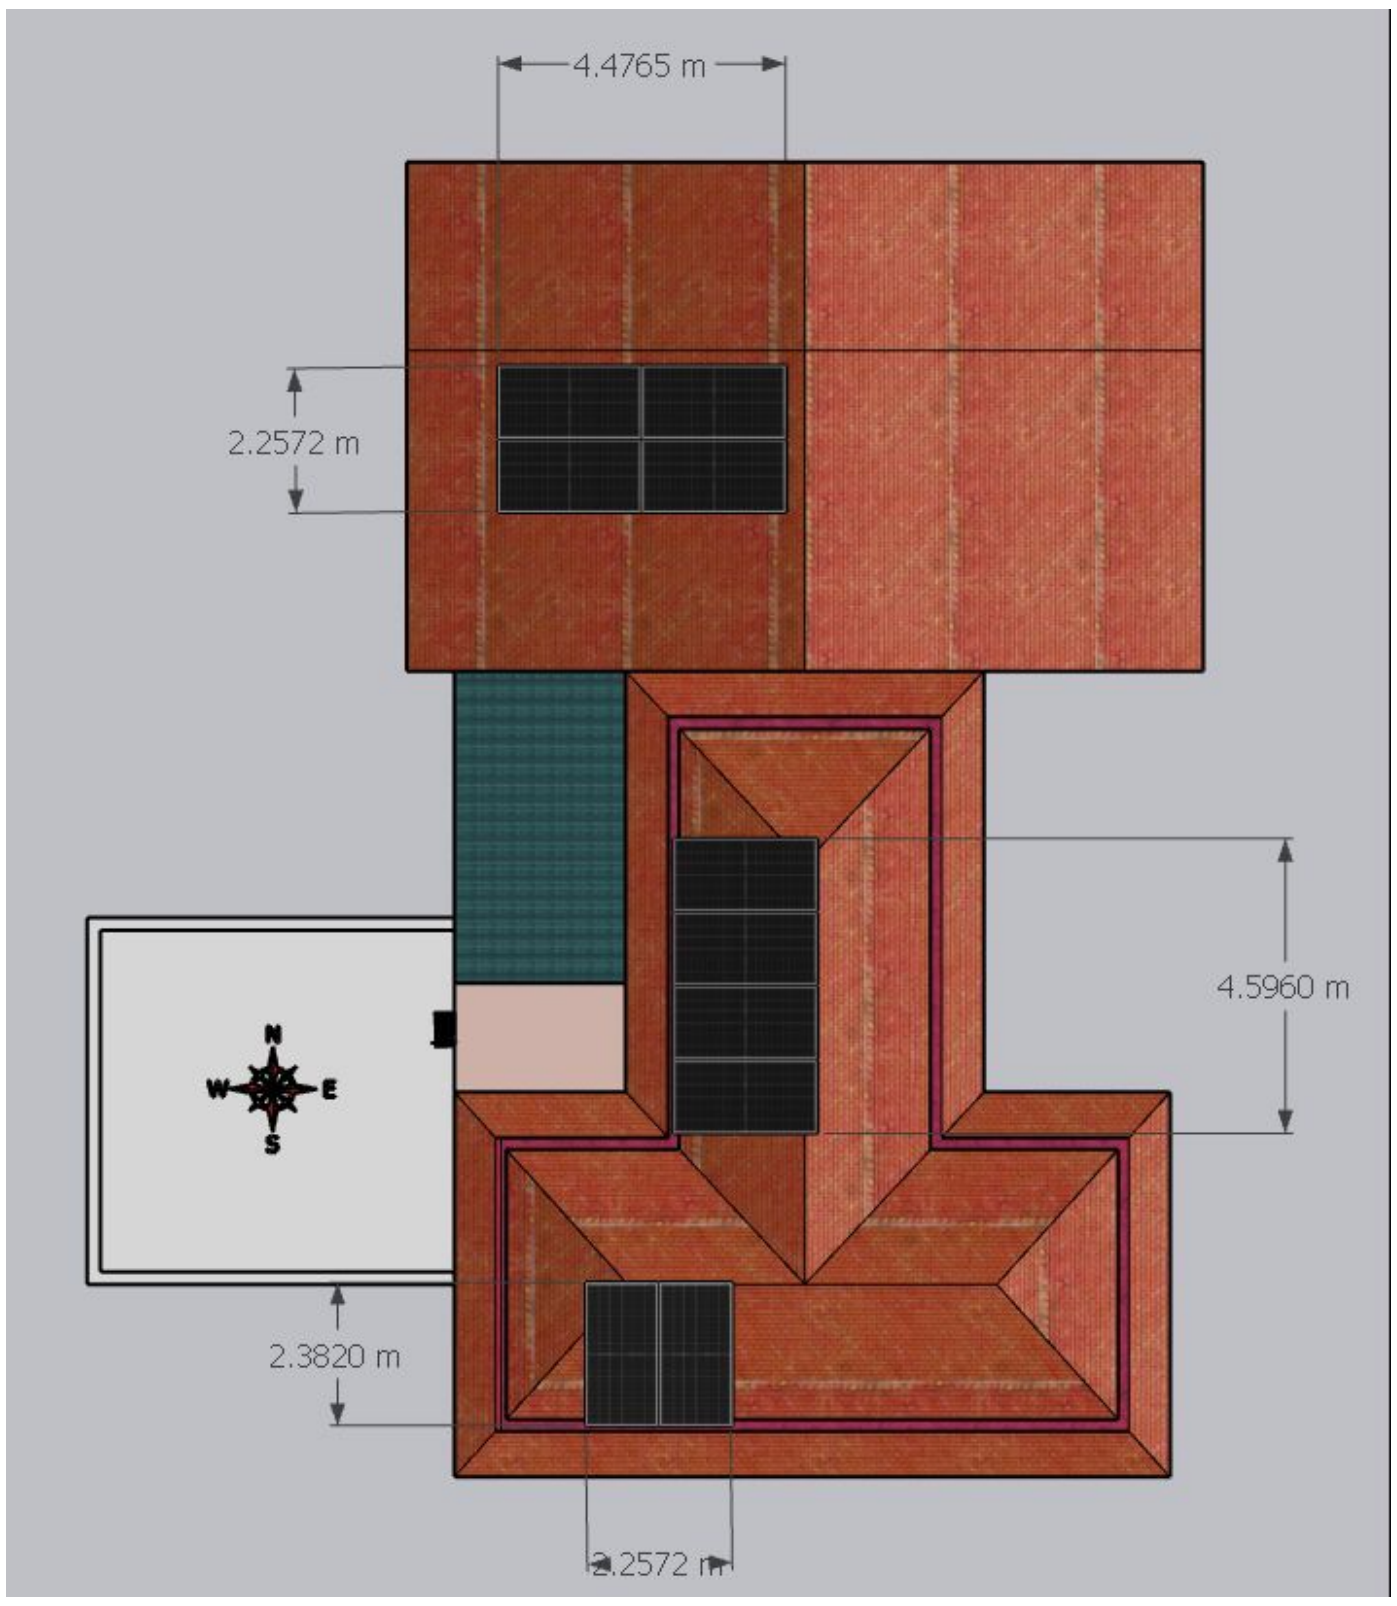
4.4765 m
2.2572 m
4.5960 m
2.3820 m
2.2572 m
N
W
E
S

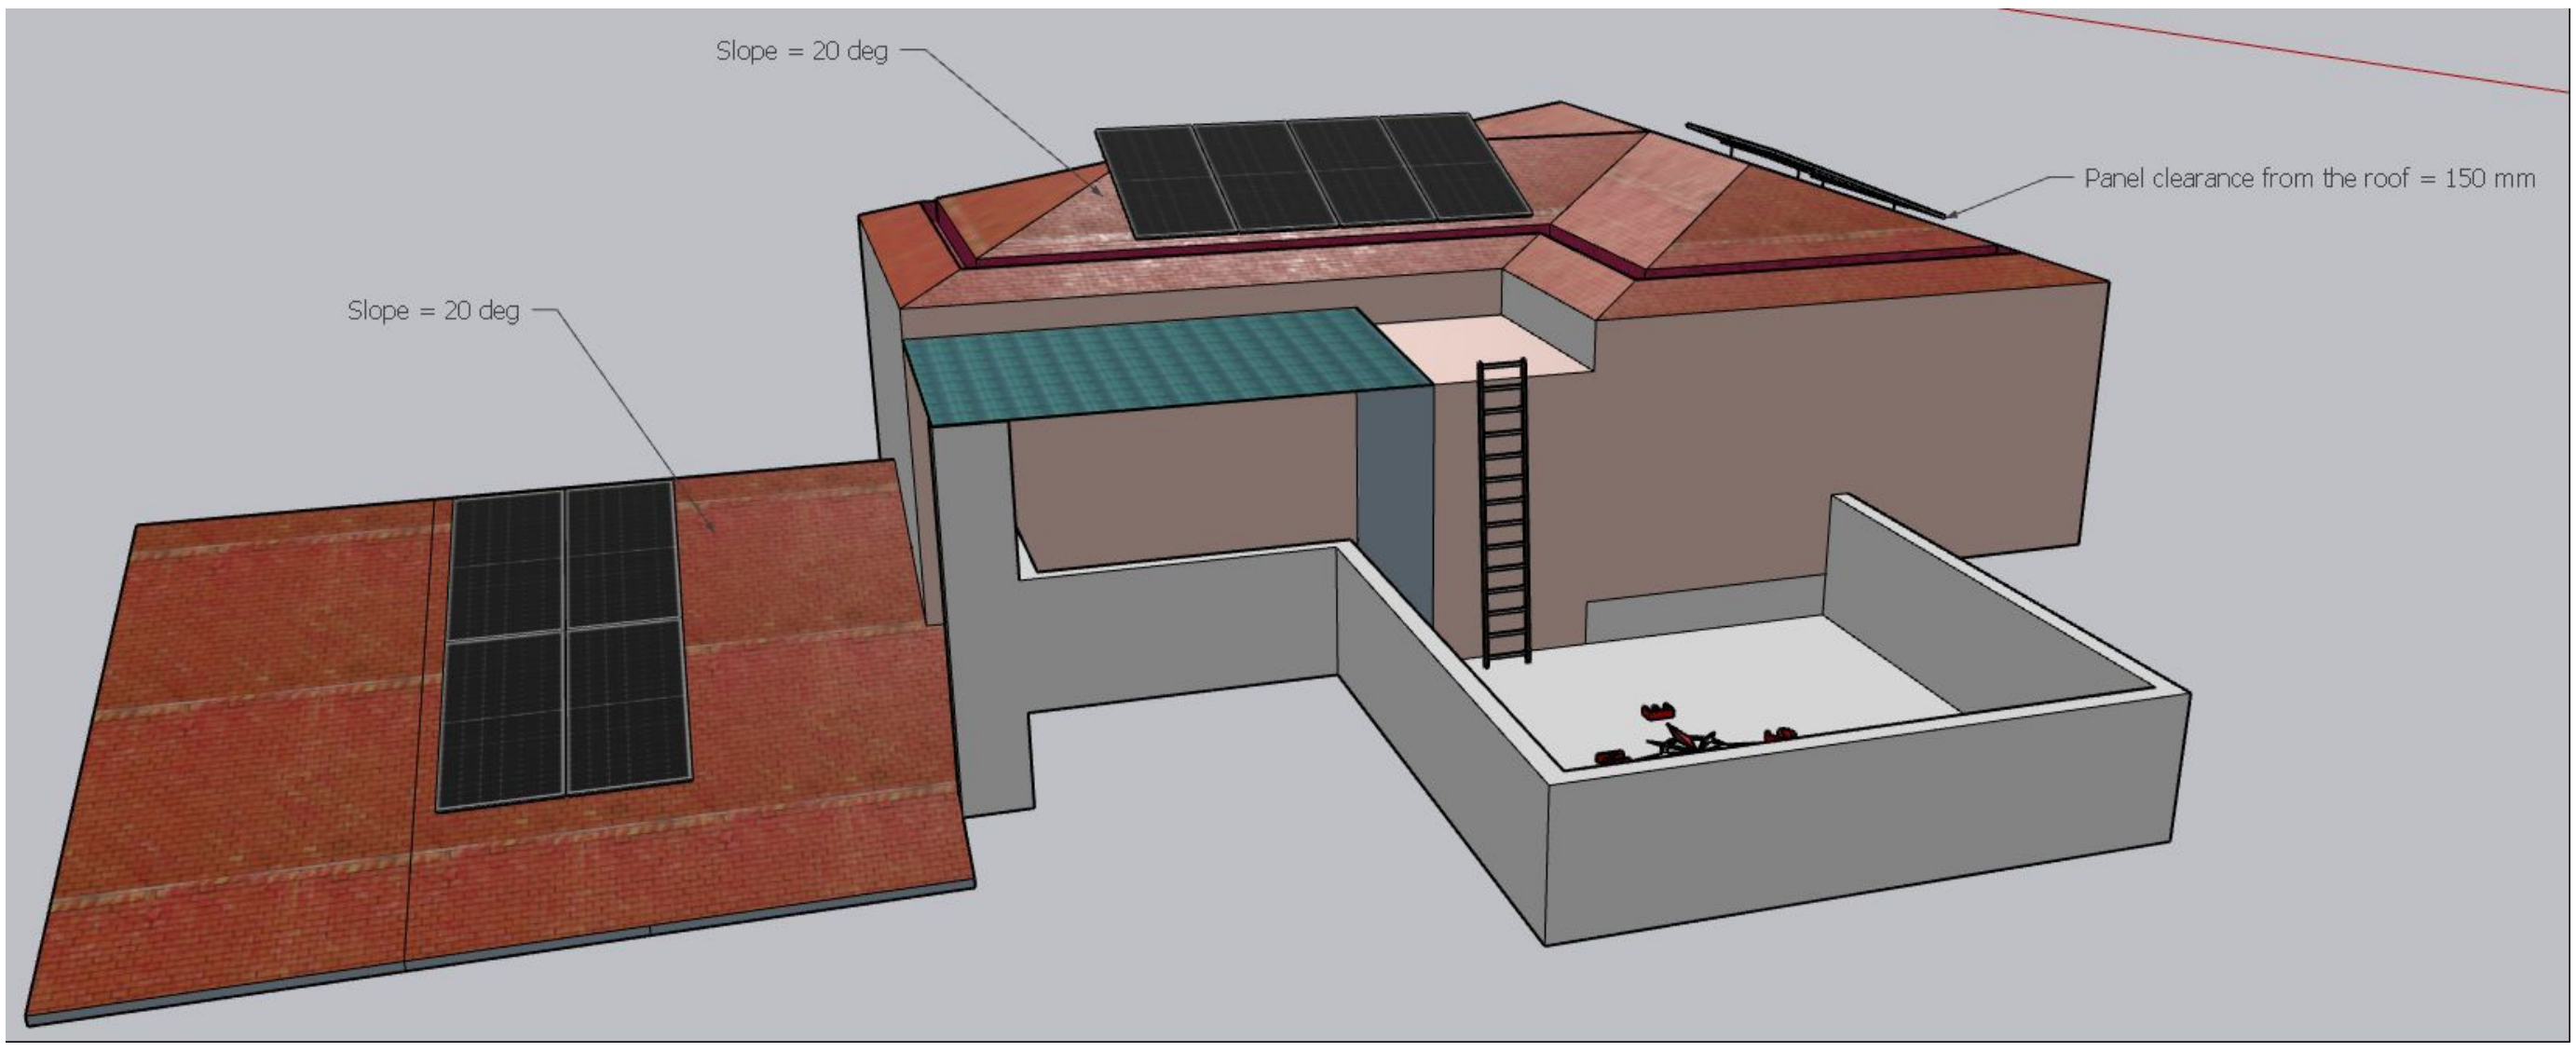

Building Exterior

Material Delivery Route

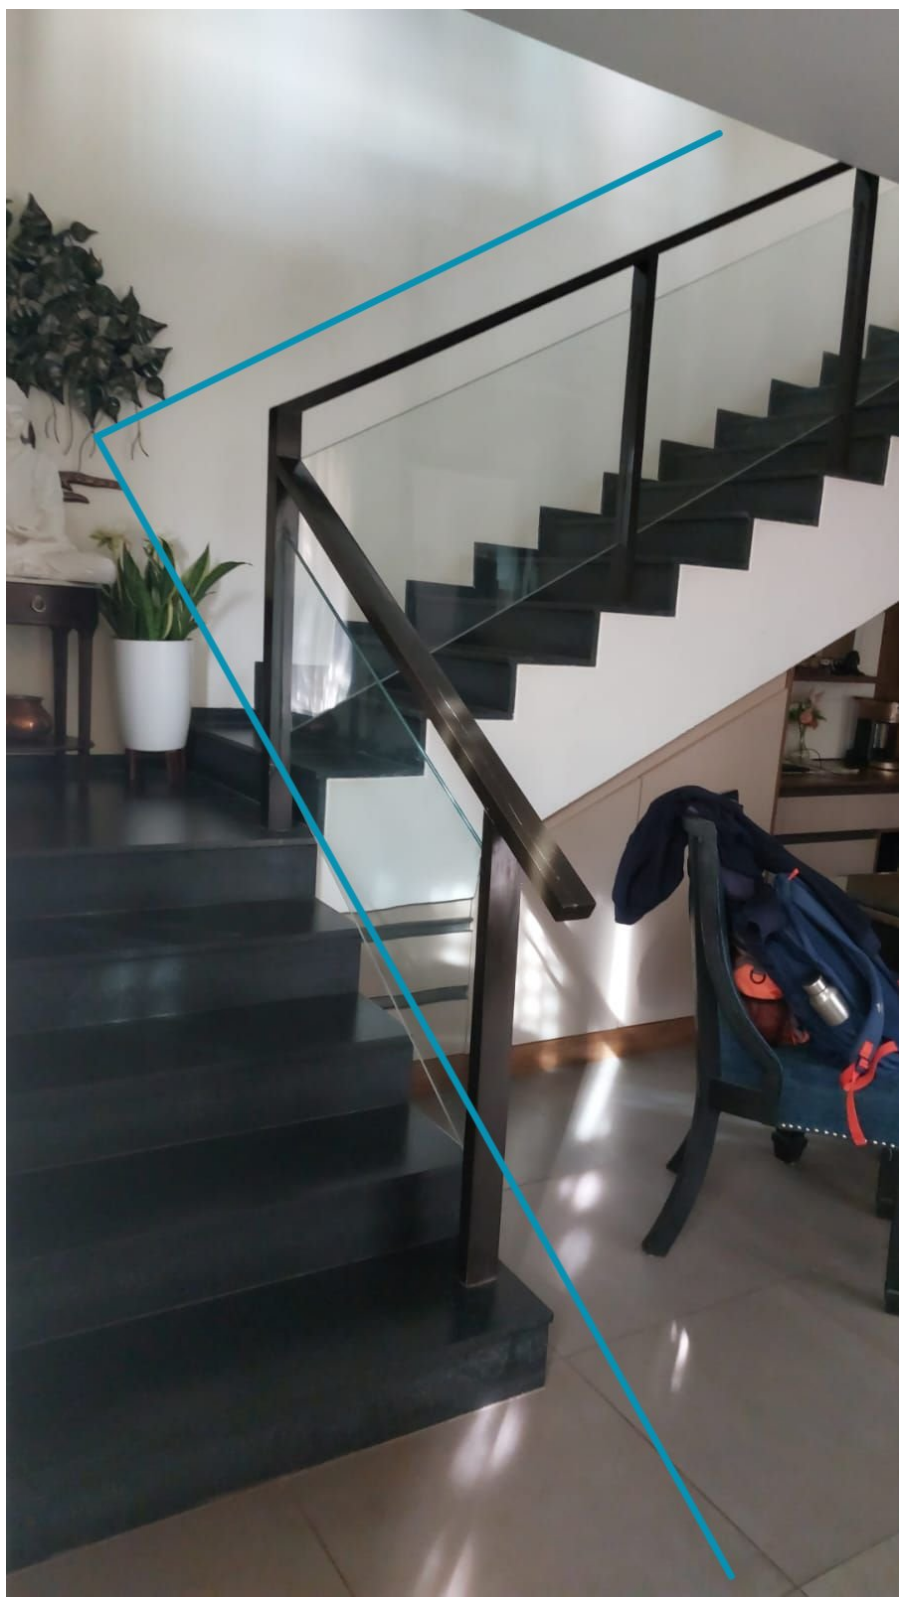

Staircase Details

Staircase width = 900 mm

Material Storage

The materials can be stacked safely at the first floor balcony terrace area.

Proposed PV Area

Roof 1 and 2 are nearby on the upper terrace level

Roof 3 is on the lower terrace level

Cable Routing

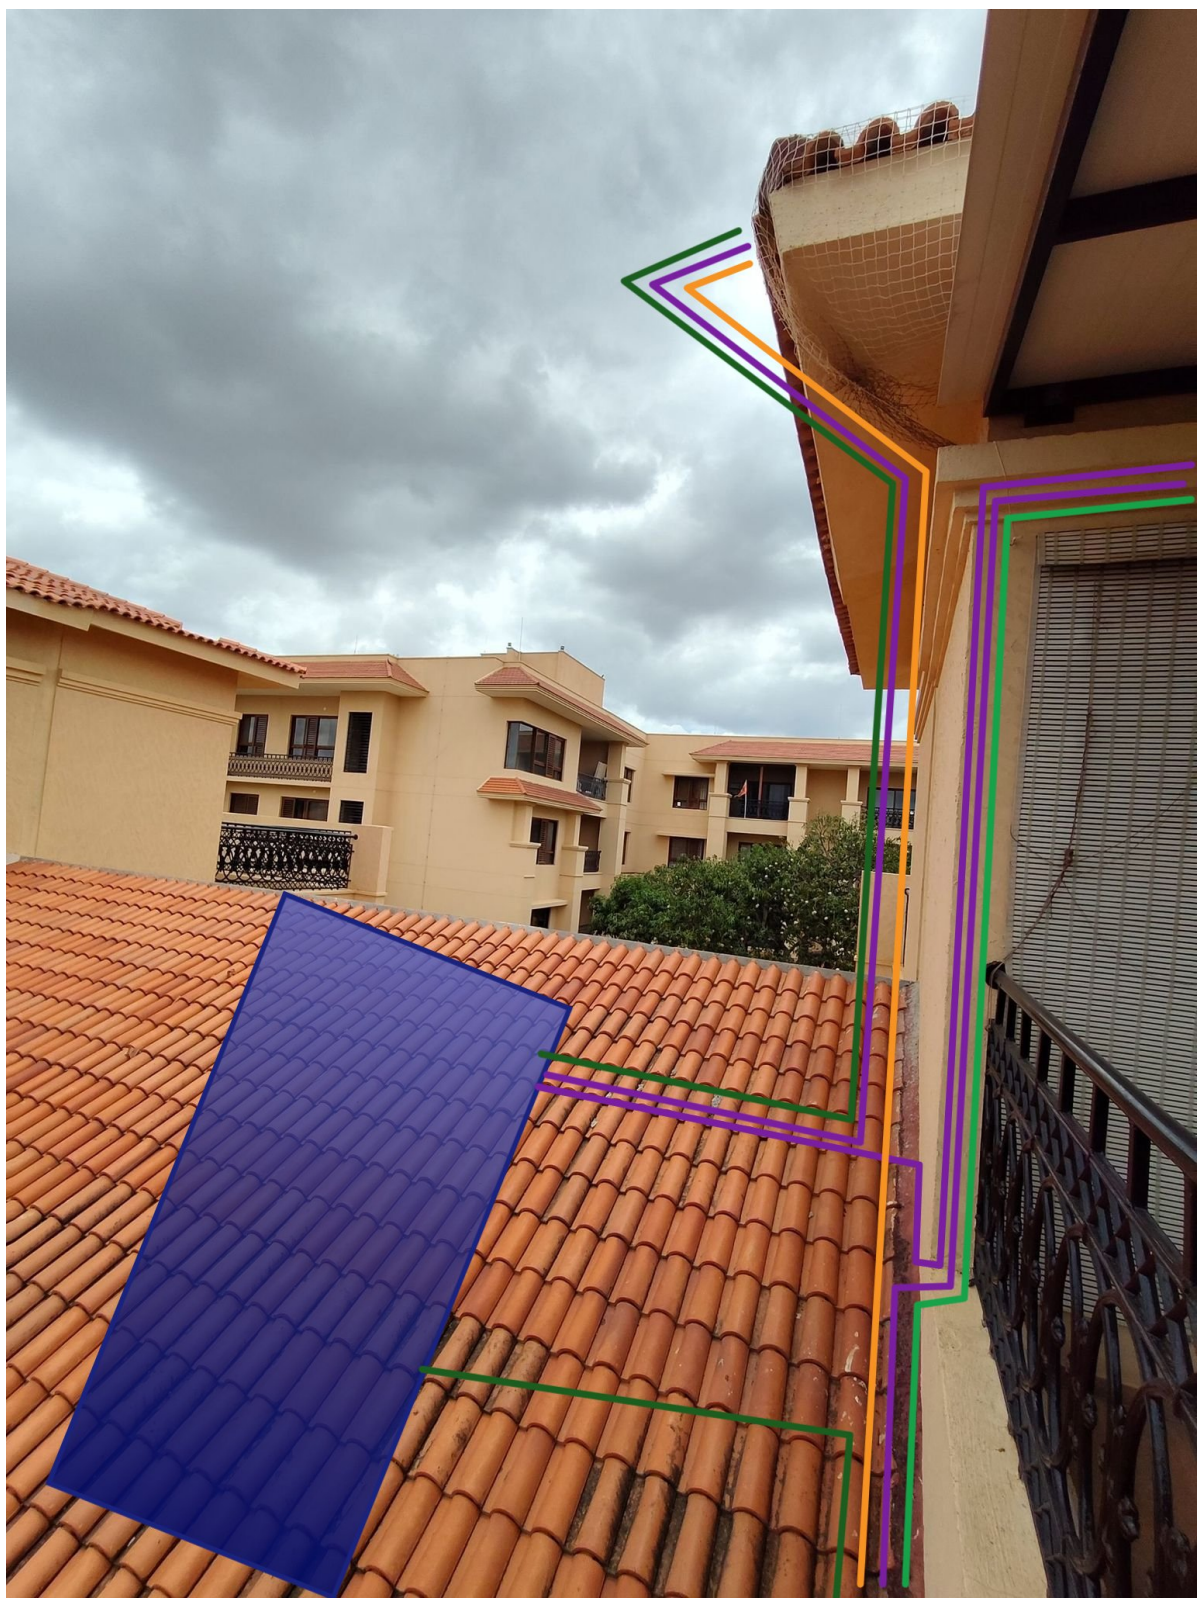


Enphase
Accessories
box

Once the AC cable (Purple line) reaches the ground, it has to follow the existing trench to reach the LT panel chamber.

Meter Box

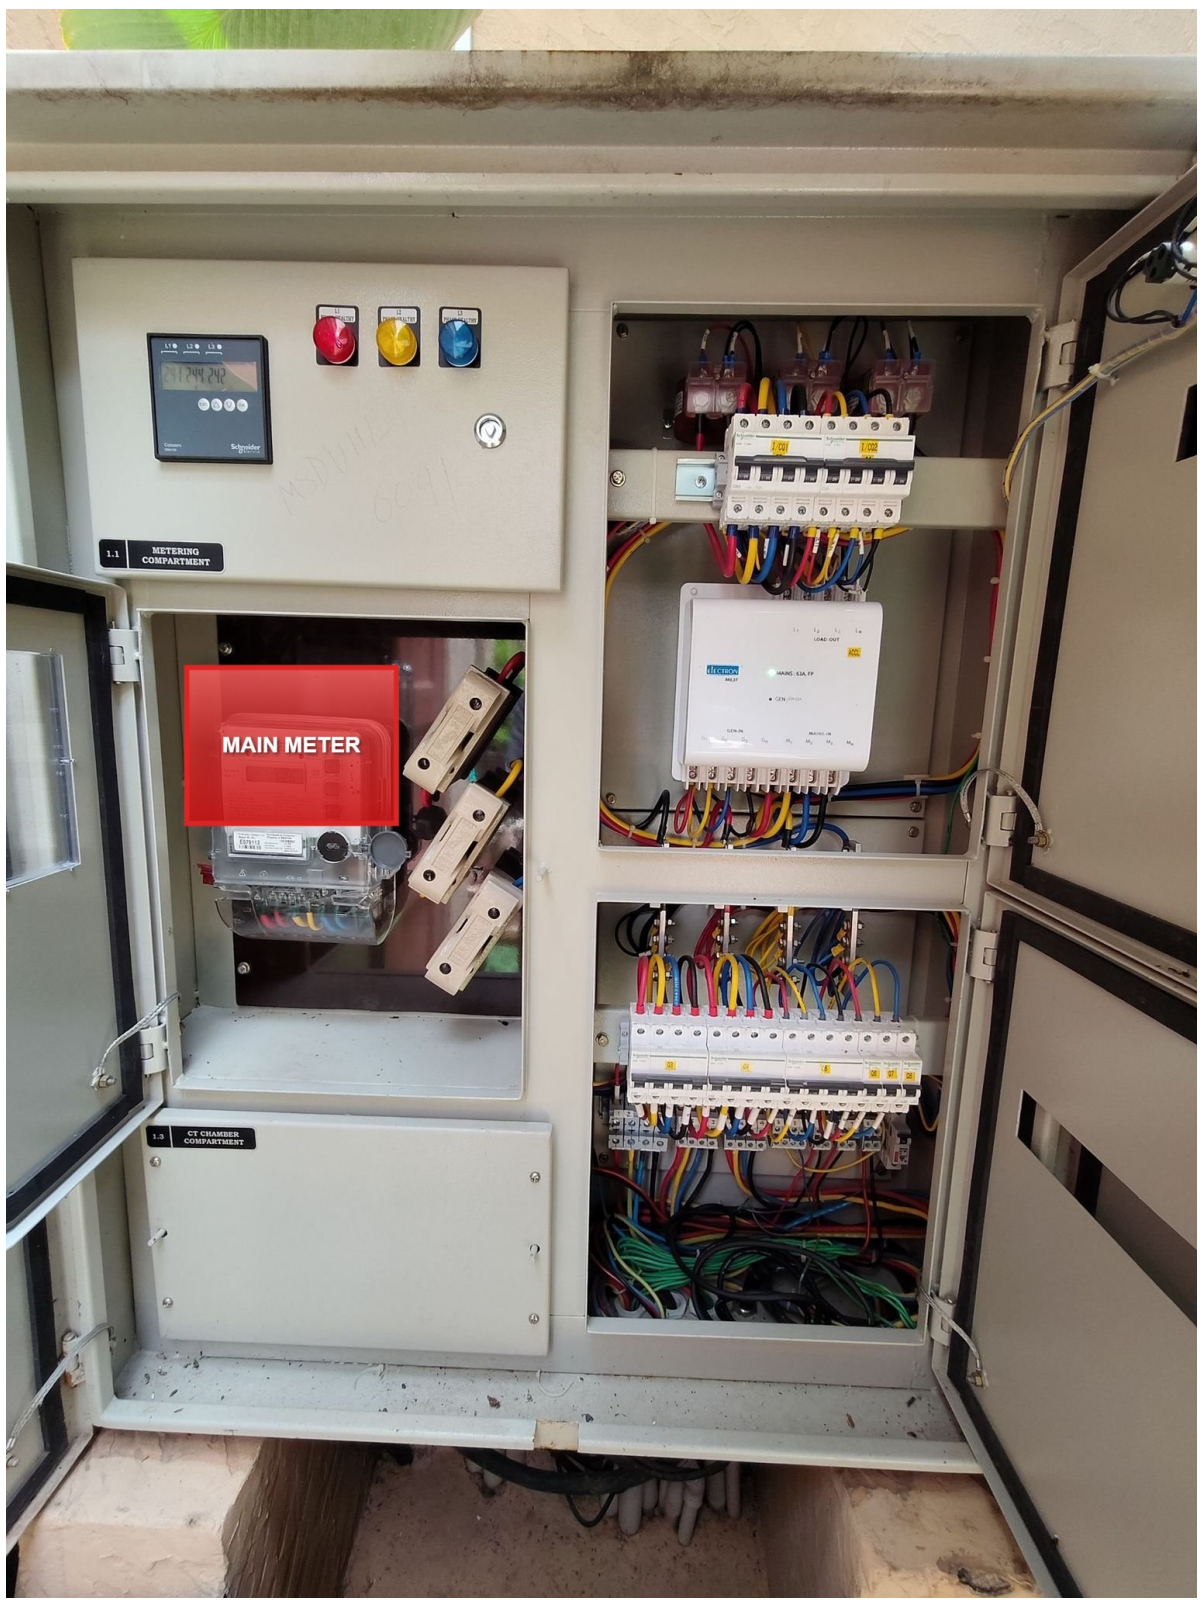

Shadow Analysis

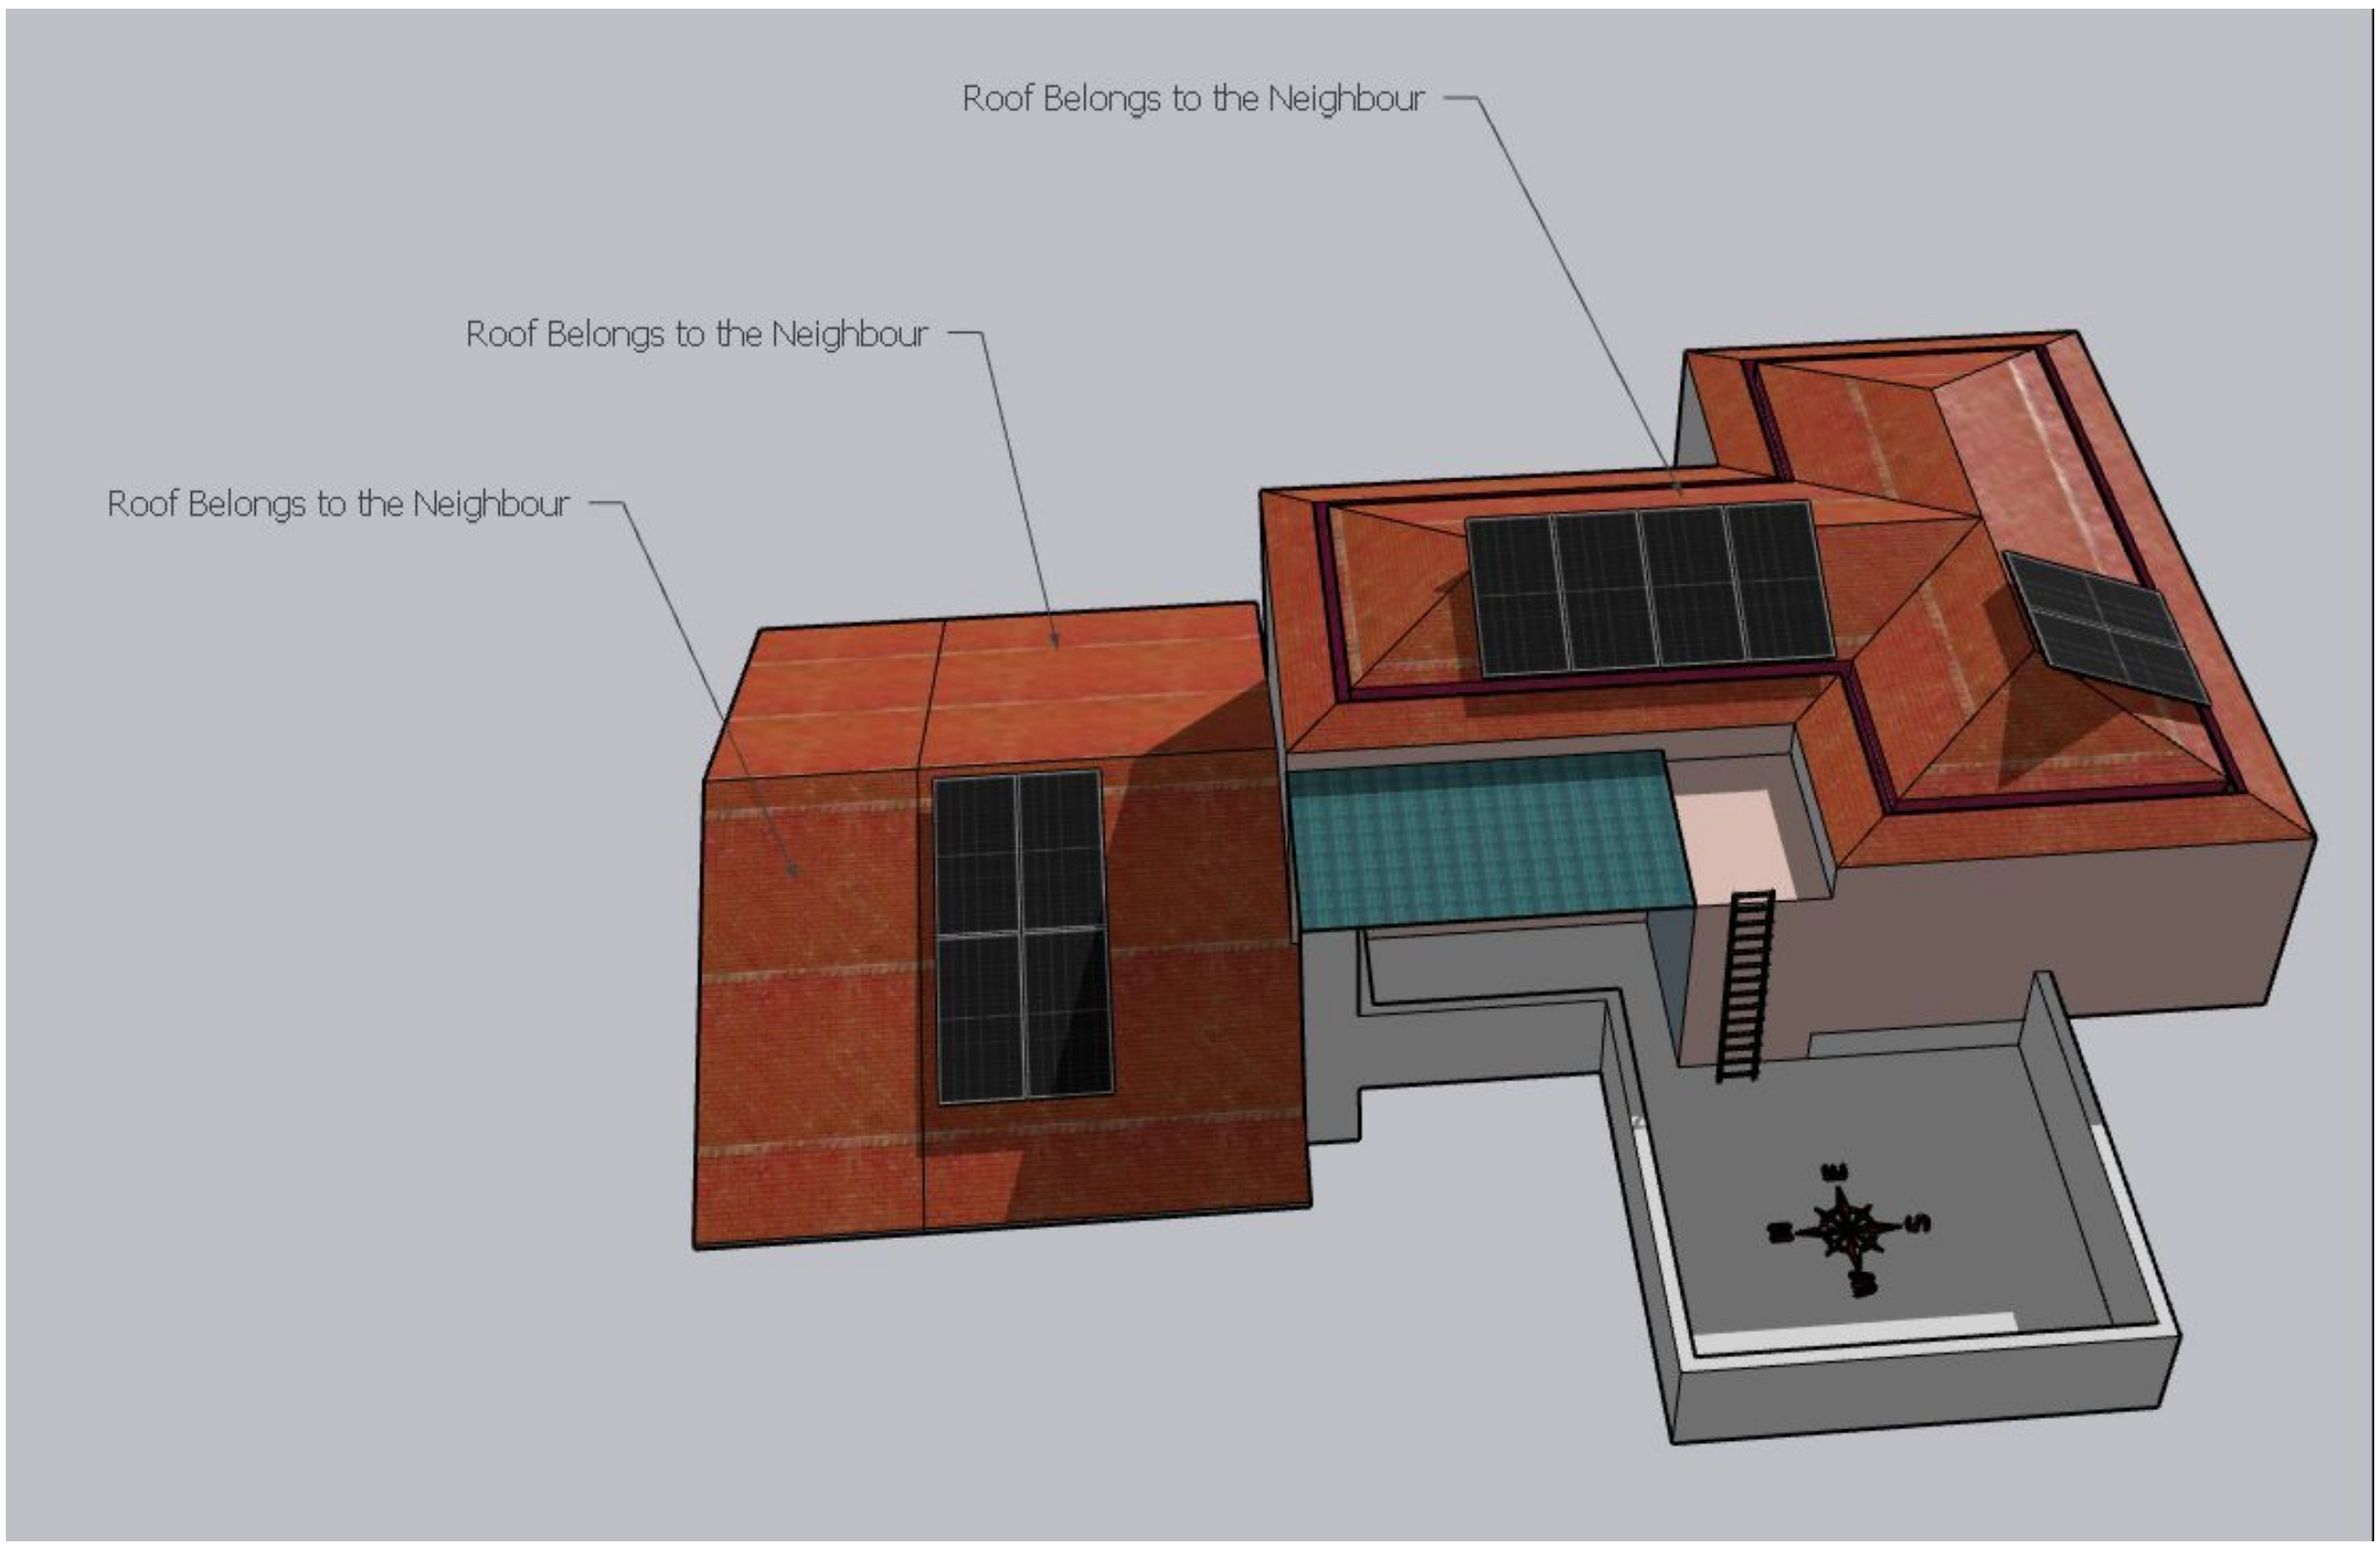

shadow_Nov 9 am

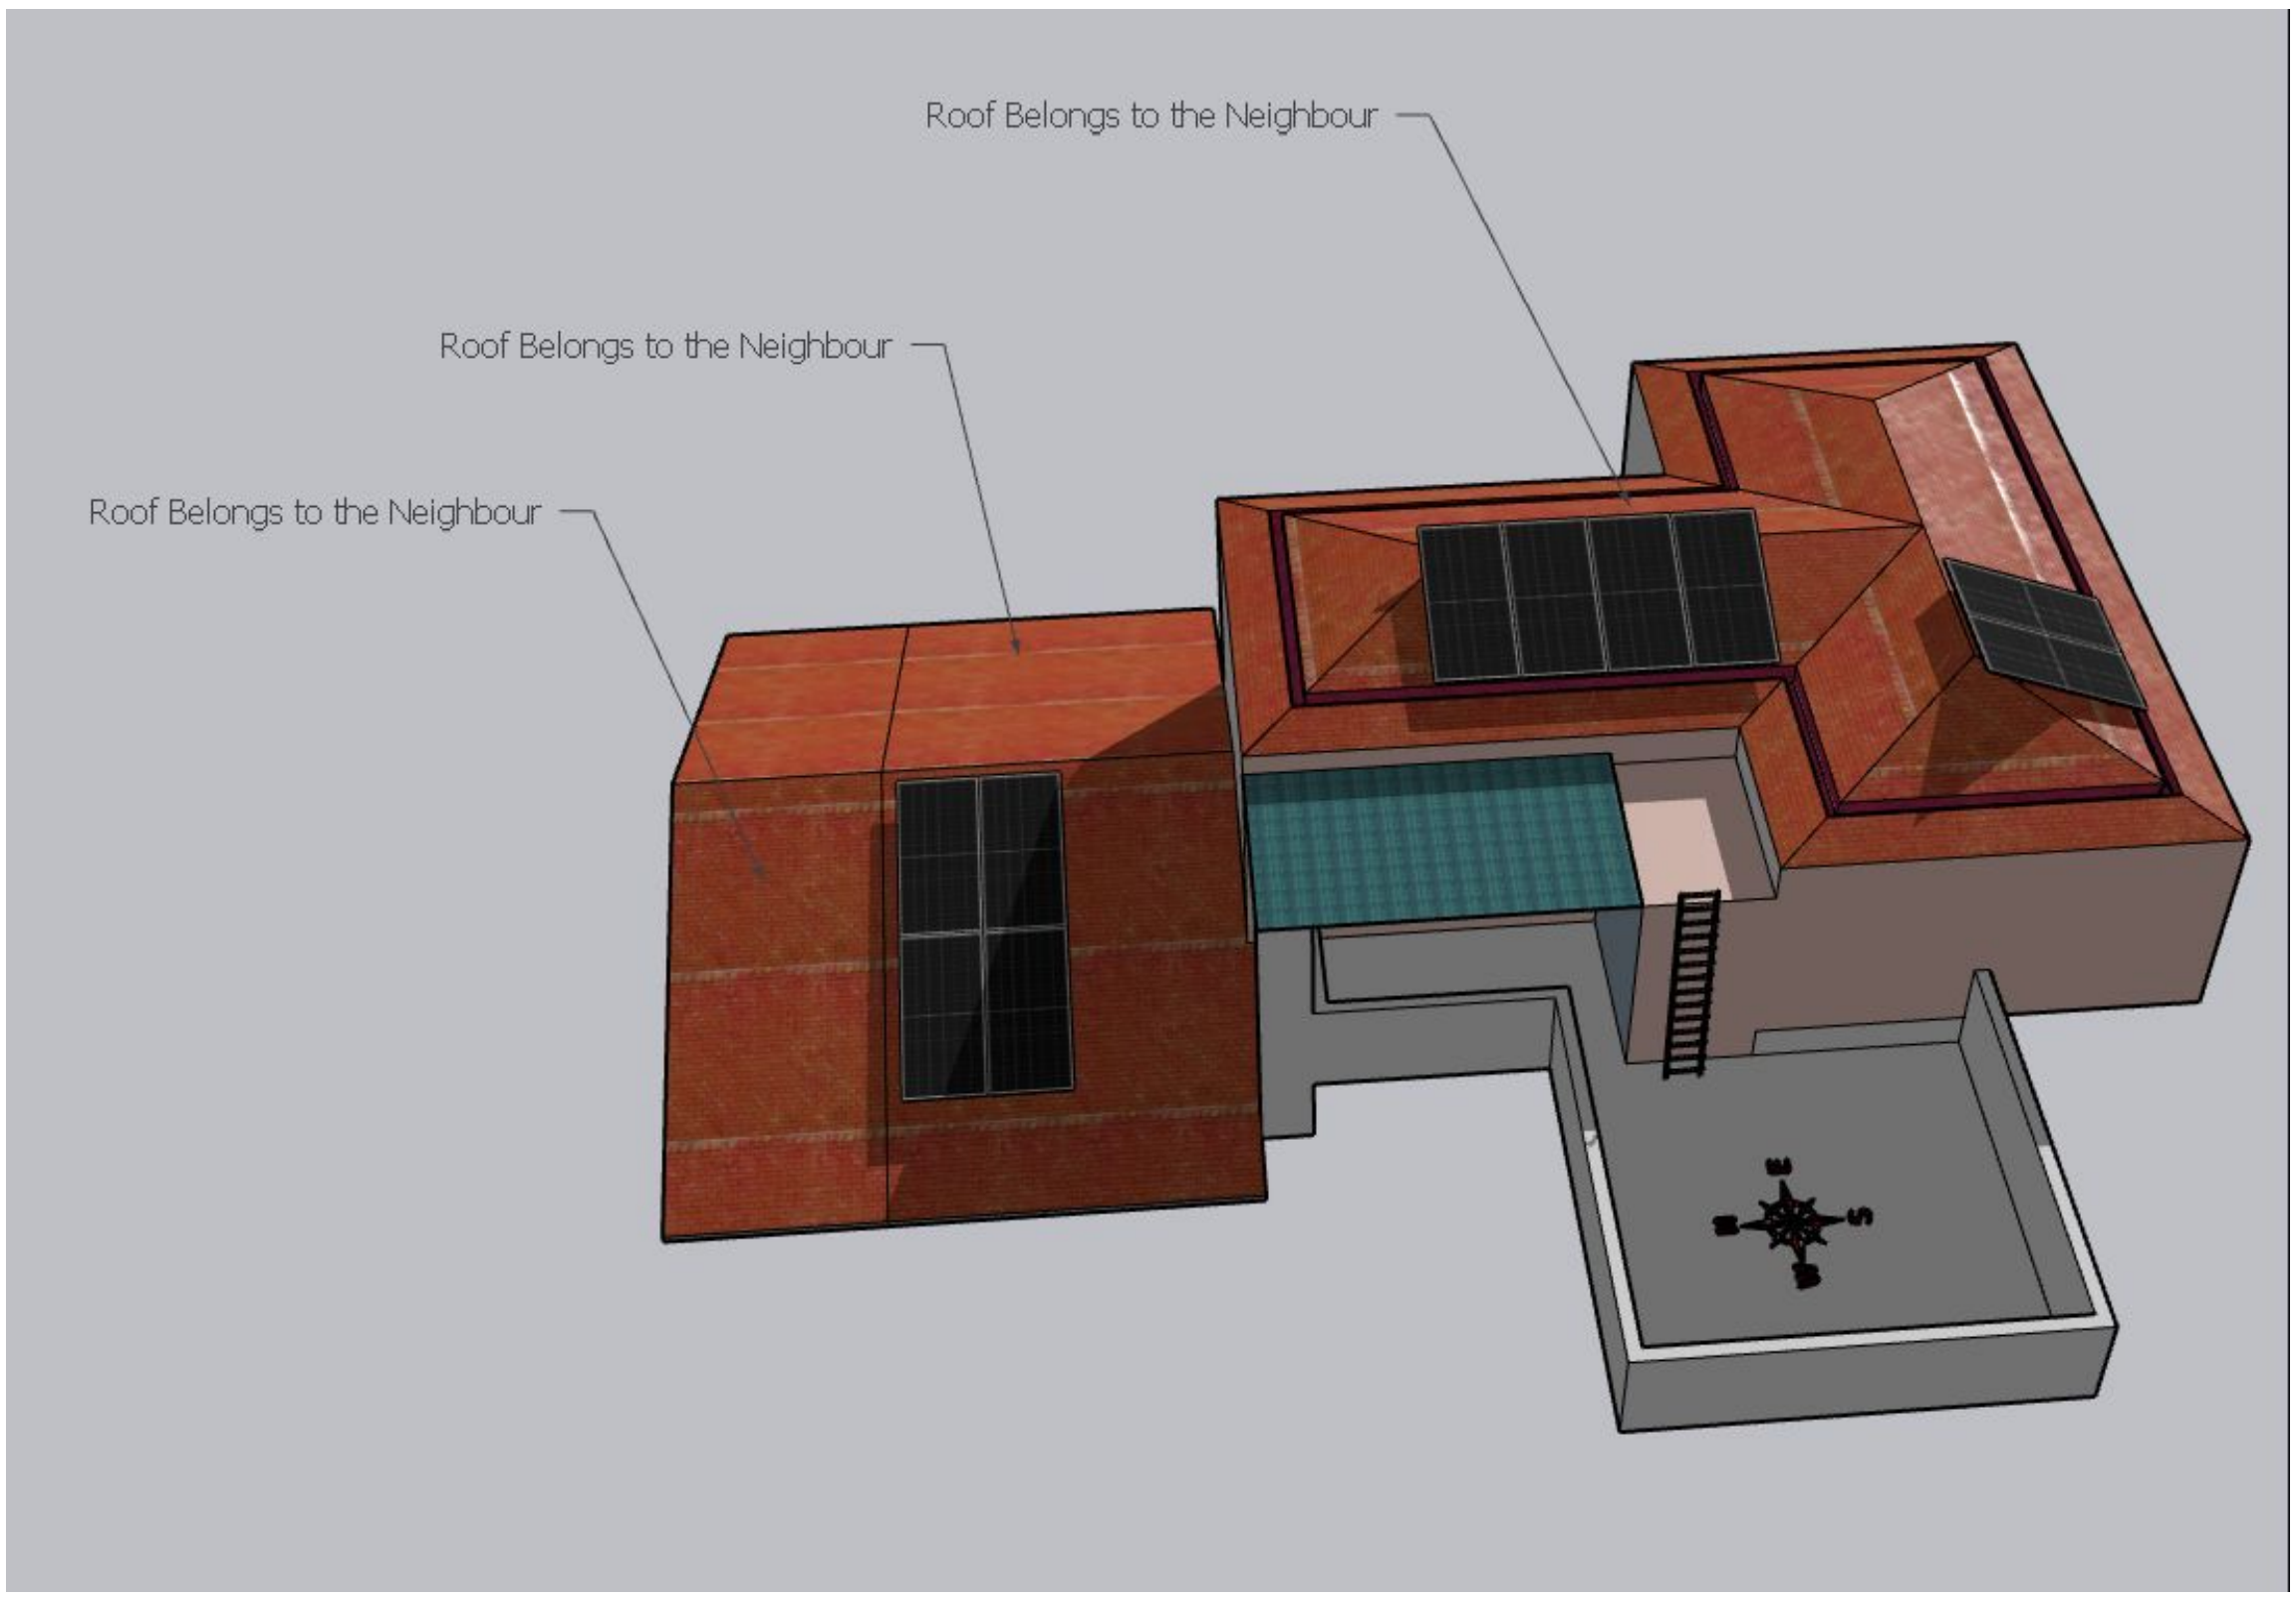

shadow_Dec 9 am

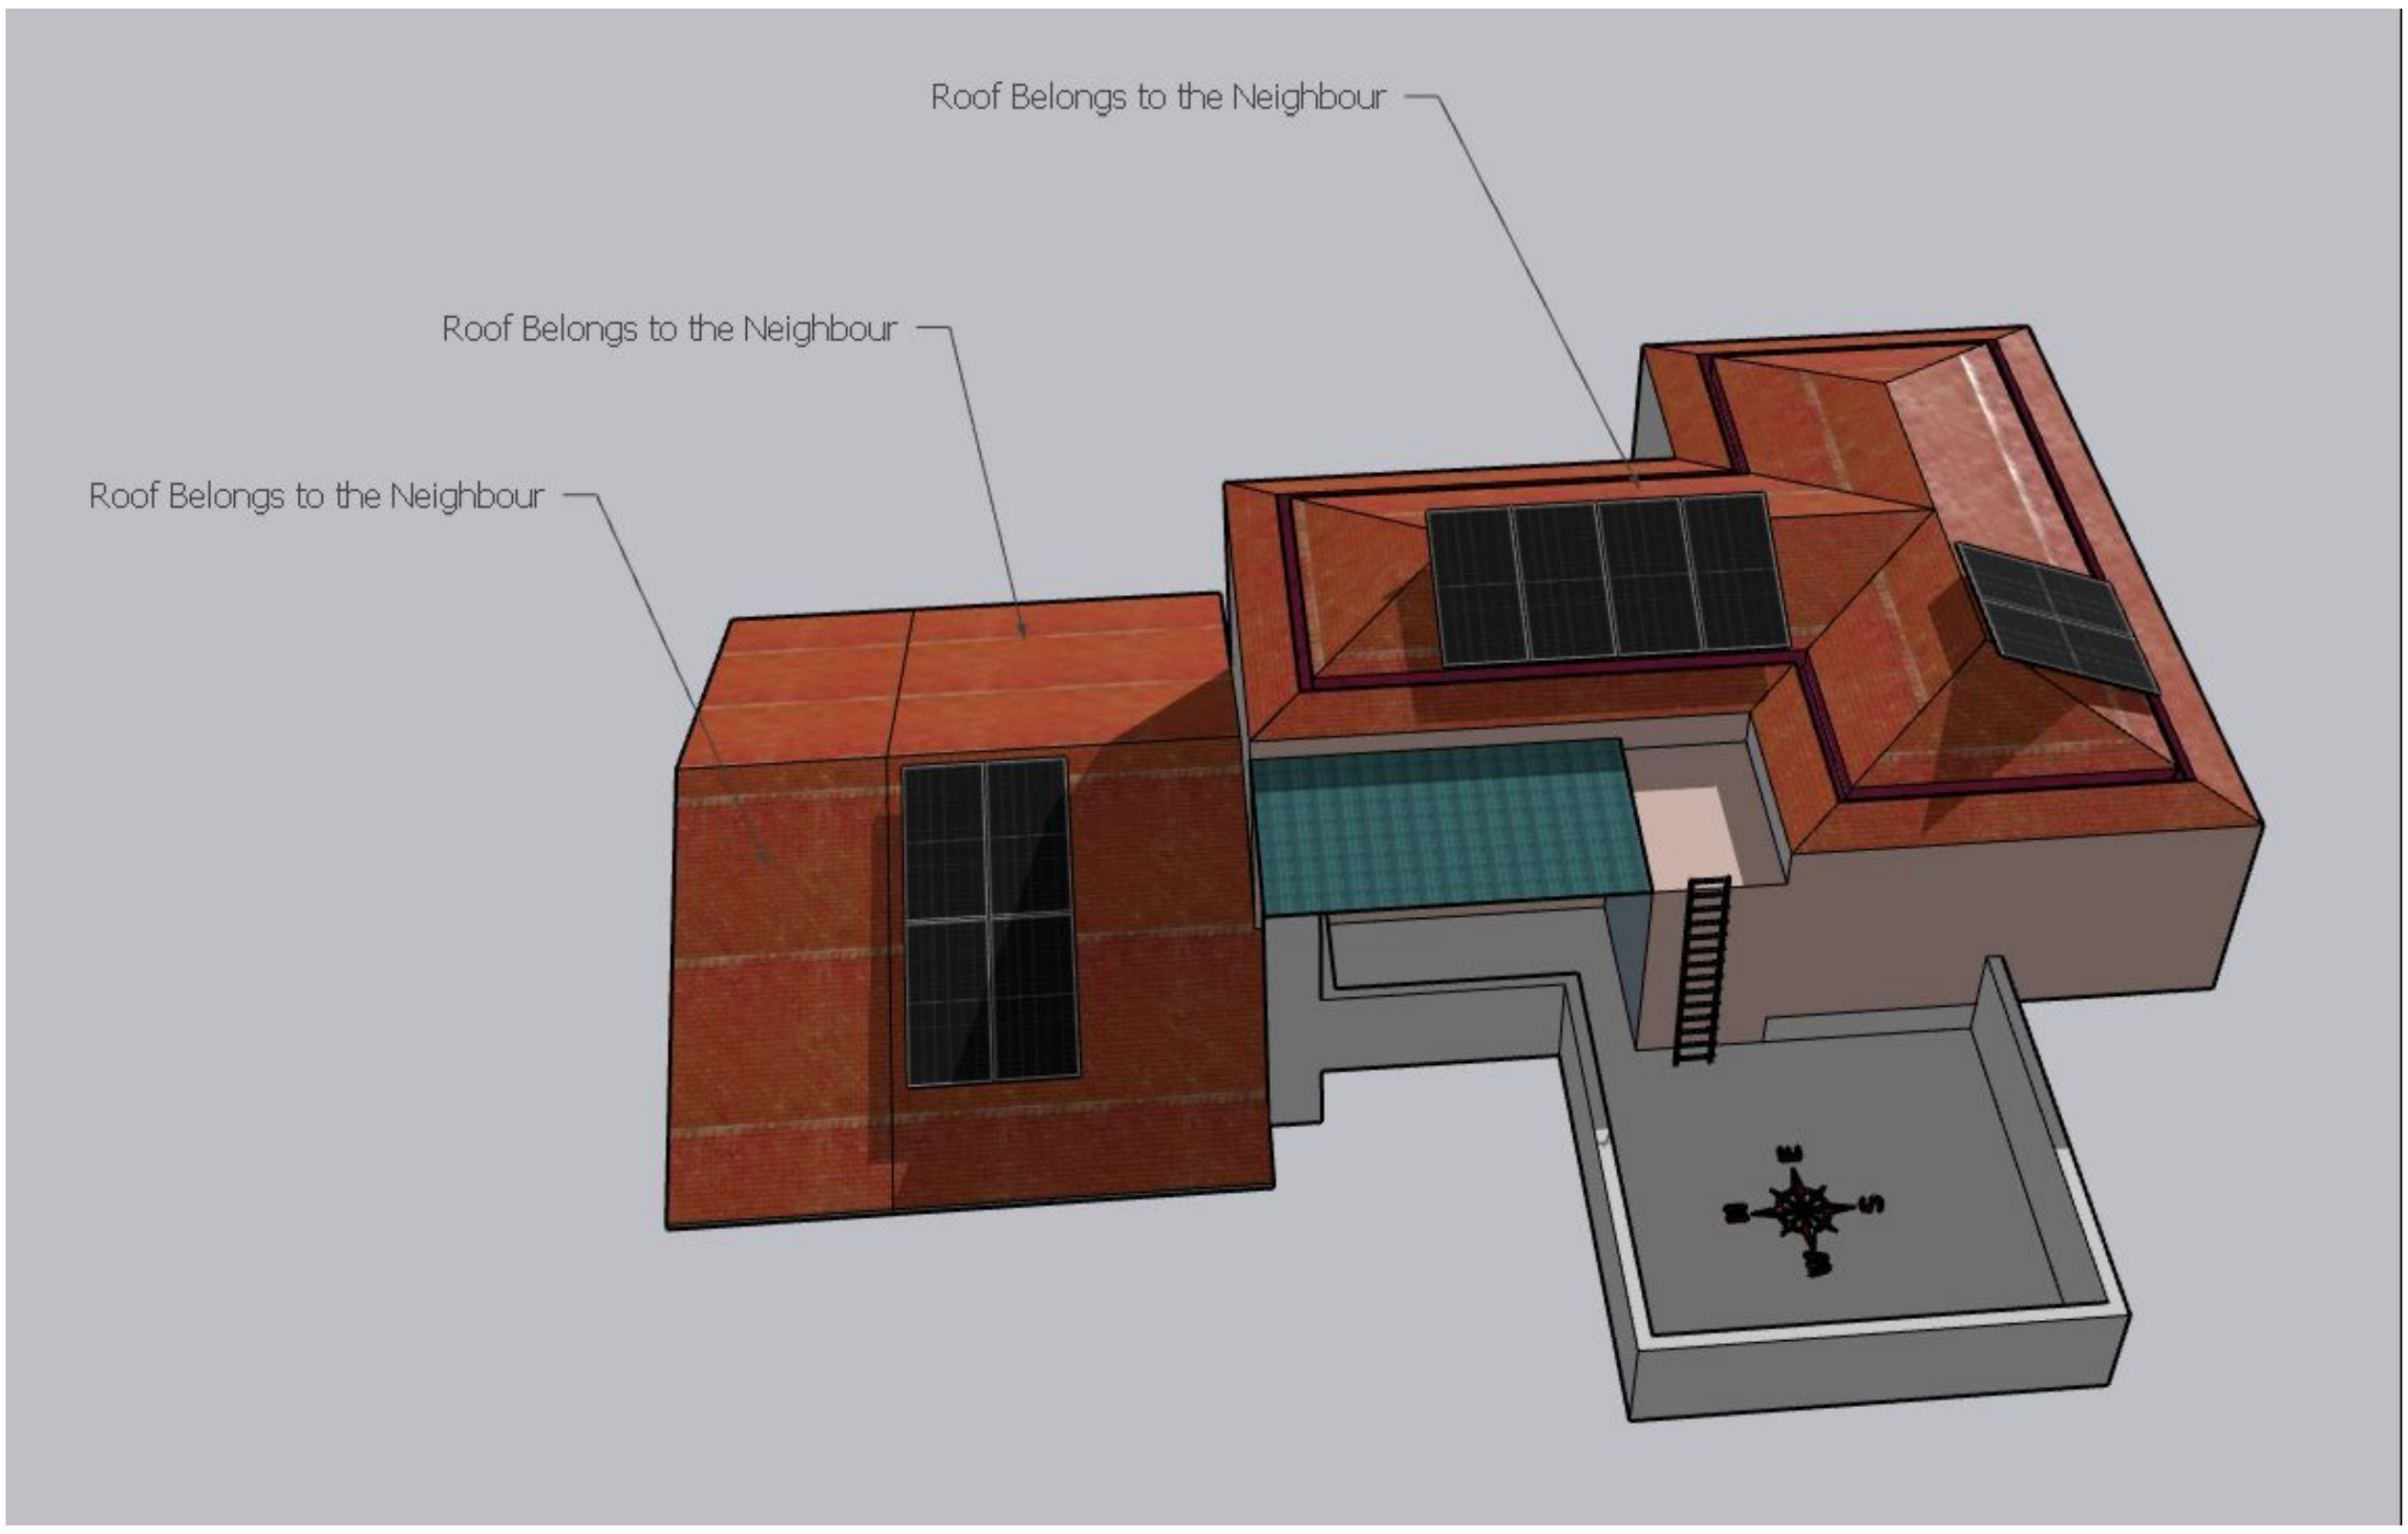

shadow_Jan 9 am

OBSERVATIONS & RECOMMENDATIONS

EcoSoch Scope

#	Observation
1	Installation and commissioning of 6.15kWp On-grid solar power plant at the proposed premises.
2	The co-ordination and follow-up with BESCOM regarding solar connectivity till commissioning.

Customer Scope

#	Observation
1	Providing an active Wi-Fi or LAN cable connection up to the inverter location.
2	The customer is responsible for arranging the reliable ladder provision to get access to the proposed solar panel installation area prior to the project's execution.
3	Fabrication of a canopy to protect the Enphase accessories box installed at the premises if necessary.
4	Ensuring easy access to the existing trench for the conduit/Cable pulling.

THANK YOU

Dear Satheesh Babu,

Thank you for choosing EcoSoch Solar for your solar installation. We appreciate your trust in us and your commitment to sustainable energy. Our team is dedicated to ensuring a seamless installation experience and long-term performance of your solar system.

Should you have any questions or require further assistance, please do not hesitate to reach out to us.

Warm Regards,
Team EcoSoch

& Did You Know?

The Sun burns 600 million tonnes of hydrogen per second — and your panels get a share.

EcoSoch Solar Pvt. Ltd.

#940, Sha Arcade, 2nd Phase, NTI Layout, Kodigehalli, Bengaluru 560097

www.ecosoch.com | info@ecosoch.com