Technical Site Visit Report

Prepared for: Naveen Mudgil_Vaishnavi Commune_Subsidy_6.82kWp_String - Villa A022

PROJECT INFORMATION

Report Number	ESV-2026-0187
Project ID	4FBA449F
Project Name	Naveen Mudgil_Vaishnavi Commune_Subsidy_6.82kWp_String
Building Name	Villa A022
Project Sector	Residential
Project Type	With Subsidy
Sales Lead	Mahantayya
Site Address	Naveen Mudgil Villa A022, Vaishnavi Commune, Sarjapur Road, Chikkakannalli, Bengaluru 560035.
GPS Coordinates	12.90221, 77.700123
Google Maps	https://www.google.com/maps?q=12.90221,77.700123
Visit Date	2026-08-12
Visited By	ABILASH N K
Revision	Rev 0

CLIENT INFORMATION

Client Name	Naveen Mudgil
Contact	8722292888

PROJECT DETAILS

Solar Rooftop System Type	On-Grid
System Capacity (kWp)	6.82
Sanction Load (kW)	7
Module Make & Capacity	Premier 620Wp Topcon Bi-Facial DCR

Module Length (mm)	2382
Module Width (mm)	1134
Number of Panels	11
Inverter Type	String
Inverter Brand	Sungrow 6kW, 3 Ph
Number of Inverters	1
Mounting Structure Type	Elevated

SITE INSPECTION CHECKLIST

General

#	Question	Answer	Notes
1	Can the delivery van/truck reach the material unloading point?	Yes	-
2	Are there any obstacles at the site that could hinder material lifting?	No	-
3	Where will the Inverter, DCDB, ACDB, Battery, etc. be located?	The inverter, DC-DB, and ACDBs can be wall-mounted next to the existing main meter box at the car porch on the ground floor.	-
4	Is a canopy required for protecting the Inverters/ACDB/DCDB?	No	-
5	Did you discuss the location of the earth pits with the customer?	Yes, discussed with the customer and finalised the location for earthing.	-
6	Where is the Internet Router located?	Ground floor.	-
7	What's the Wi-Fi strength of the router near to the String inverter/Envoy?	3 bars	-
8	Did you pin the site location in your WhatsApp when you were at the site?	Yes	-

Roof Details

#	Question	Answer	Notes
1	What type of roof is present at the site?	RCC Flat Roof	-
2	Are there any obstructions on the roof that could affect the solar installation?	details: A solar water heater exists on the terrace floor. It will be dismantled /repositioned by the customer	-

#	Question	Answer	Notes
		prior to the solar structure installation.	
3	What is the angle of the panels? (in degrees)	10	-
4	In case of sloped roof, what is the slope angle of the roof? (in degrees)	N/A	-
5	On how many roofs at the site are we installing solar?	1	-
6	If it is a Tiled roof, what is underneath the tiles?	N/A	-
7	If it is a Tiled roof with MS or Wooden rafters, is it Single-tiled or Double-tiled?	N/A	-
8	What type of mounting structure is planned?	Elevated	*Elevated HDGI - 2m Front Leg (2 Rows, Portrait) with Drilling & only Base Plate Cement Covering*
9	What is the orientation of the solar panels?	["South"]	-
10	How can the roof be accessed?	Staircase	-
11	Is the building currently under construction?	**No**	-
12	In an under-construction building, are existing conduit pipes available for AC, DC cables, and earthing?	N/A	-
13	What is the height of the building and how many floors does it have?	10 meters. (G + 1 + Headroom)	-
14	Is the site photo matching with the building description?	Yes	-
15	Is there an overhead HT line passing within a 10-meter radius of the site?	**No**	-

Residential / Electrical

#	Question	Answer	Notes
1	What type of energy meter is currently installed?	Phase: Three Phase, Type: Digital, If 3-phase: LT w/o CT (5 - 34.999)	-
2	Is the Meter cubicle photo matching with the previous answer?	Yes	-
3	Has the termination point in the Main meter panel been identified?	Yes	-
4	Is the Termination Point easily visible or sealed?	Visible	-
5	Is a Lightning Arrestor (LA) already available at the site?	**No**	-
6	Is space available for CT within Energy meter panel?	N/A	-
7	In case of an Enphase system, is the distance between the farthest micro-inverter and IQ Gateway > 50m?	N/A	-
8	Provide details of the existing CT ratings (if applicable).	N/A	-
9	In Main meter panel, is empty space available for solar meter?	**No**	-
10	In Main meter panel, is empty space available to house the Enphase accessories or ACDB components?	N/A	-
11	Is there space available to dig DC, AC and LA earth pits?	Yes	-
12	In case of elevated structures, is an LA extension provided at the far end?	Yes	-

#	Question	Answer	Notes
13	In case of elevated structures, is it with or without grouting?	With Grouting	-
14	Are there any challenges with respect to Installation and Maintenance activities?	**No**	-
15	Are there any safety risks associated with accessing the roof for installation?	**No**	-
16	Is space present in rooftop to store the panels?	Vertically leaning against the wall	-
17	In case of sloped roof MS structure, provide the dimension of rafter to rafter, purlin to purlin.	N/A	-
18	Is ventilation available in the battery location?	N/A	-
19	Should the Inverters/ACDB/DCDB be installed on a metal grill or wall mount?	Wall mounted.	-
20	Provide the dimensions for solar meter cubicle placement (L x W of wall).	length: 2000, width: 1000	-
21	Provide the dimension for earth pits location (L x W of available space).	length: 3000, width: 100	-
22	Is LAN cable under customer scope?	Yes	-
23	Is there any shadow that affects the solar installation?	**No**	-
24	Is there any trench work to be done to carry the AC cable to the meter location?	N/A	-

PHOTO DOCUMENTATION

Cable Routing Legend

Legend	Description
	Proposed PV Module Array
	Main Meter Location
	Solar Meter
	Battery
	Inverter
	Other Equipment
	DC Cable
	AC Cable
	Material Shifting
	DC Earthing Cable
	AC Earthing Cable
	LA Cable
	DC Earth Pit
	AC Earth Pit
	LA Pit
	LA

Site Layout - Top View

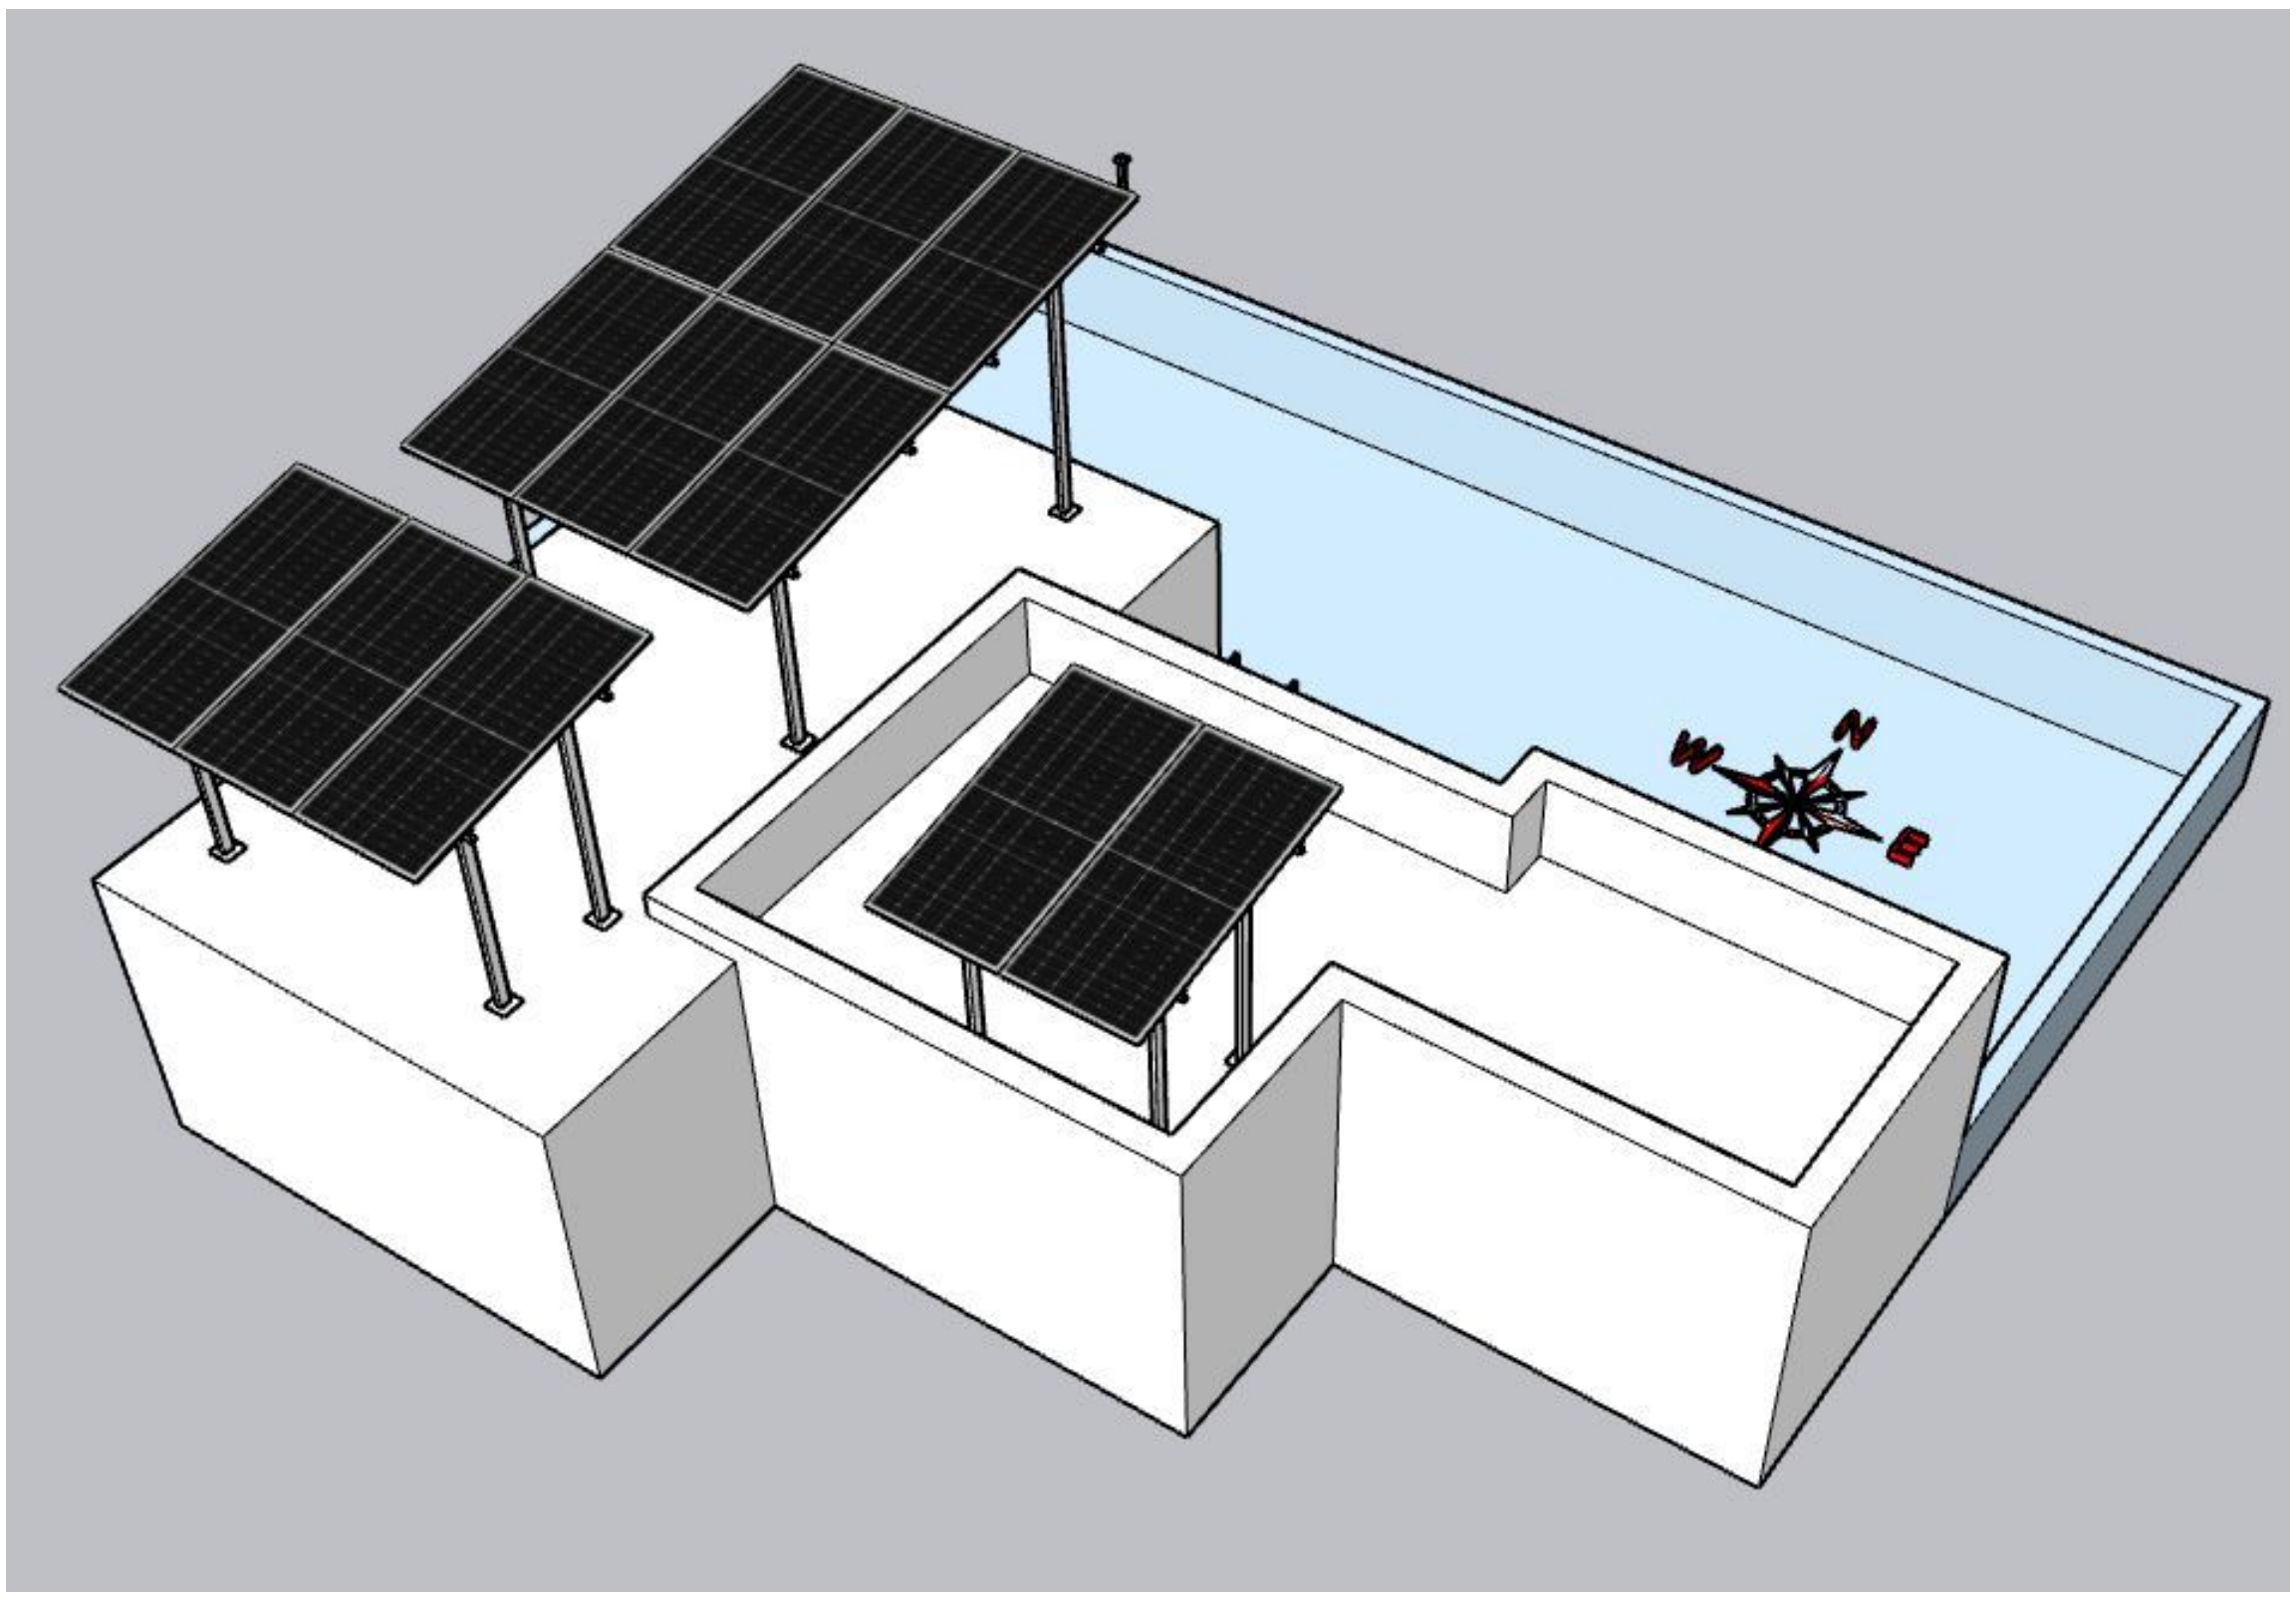

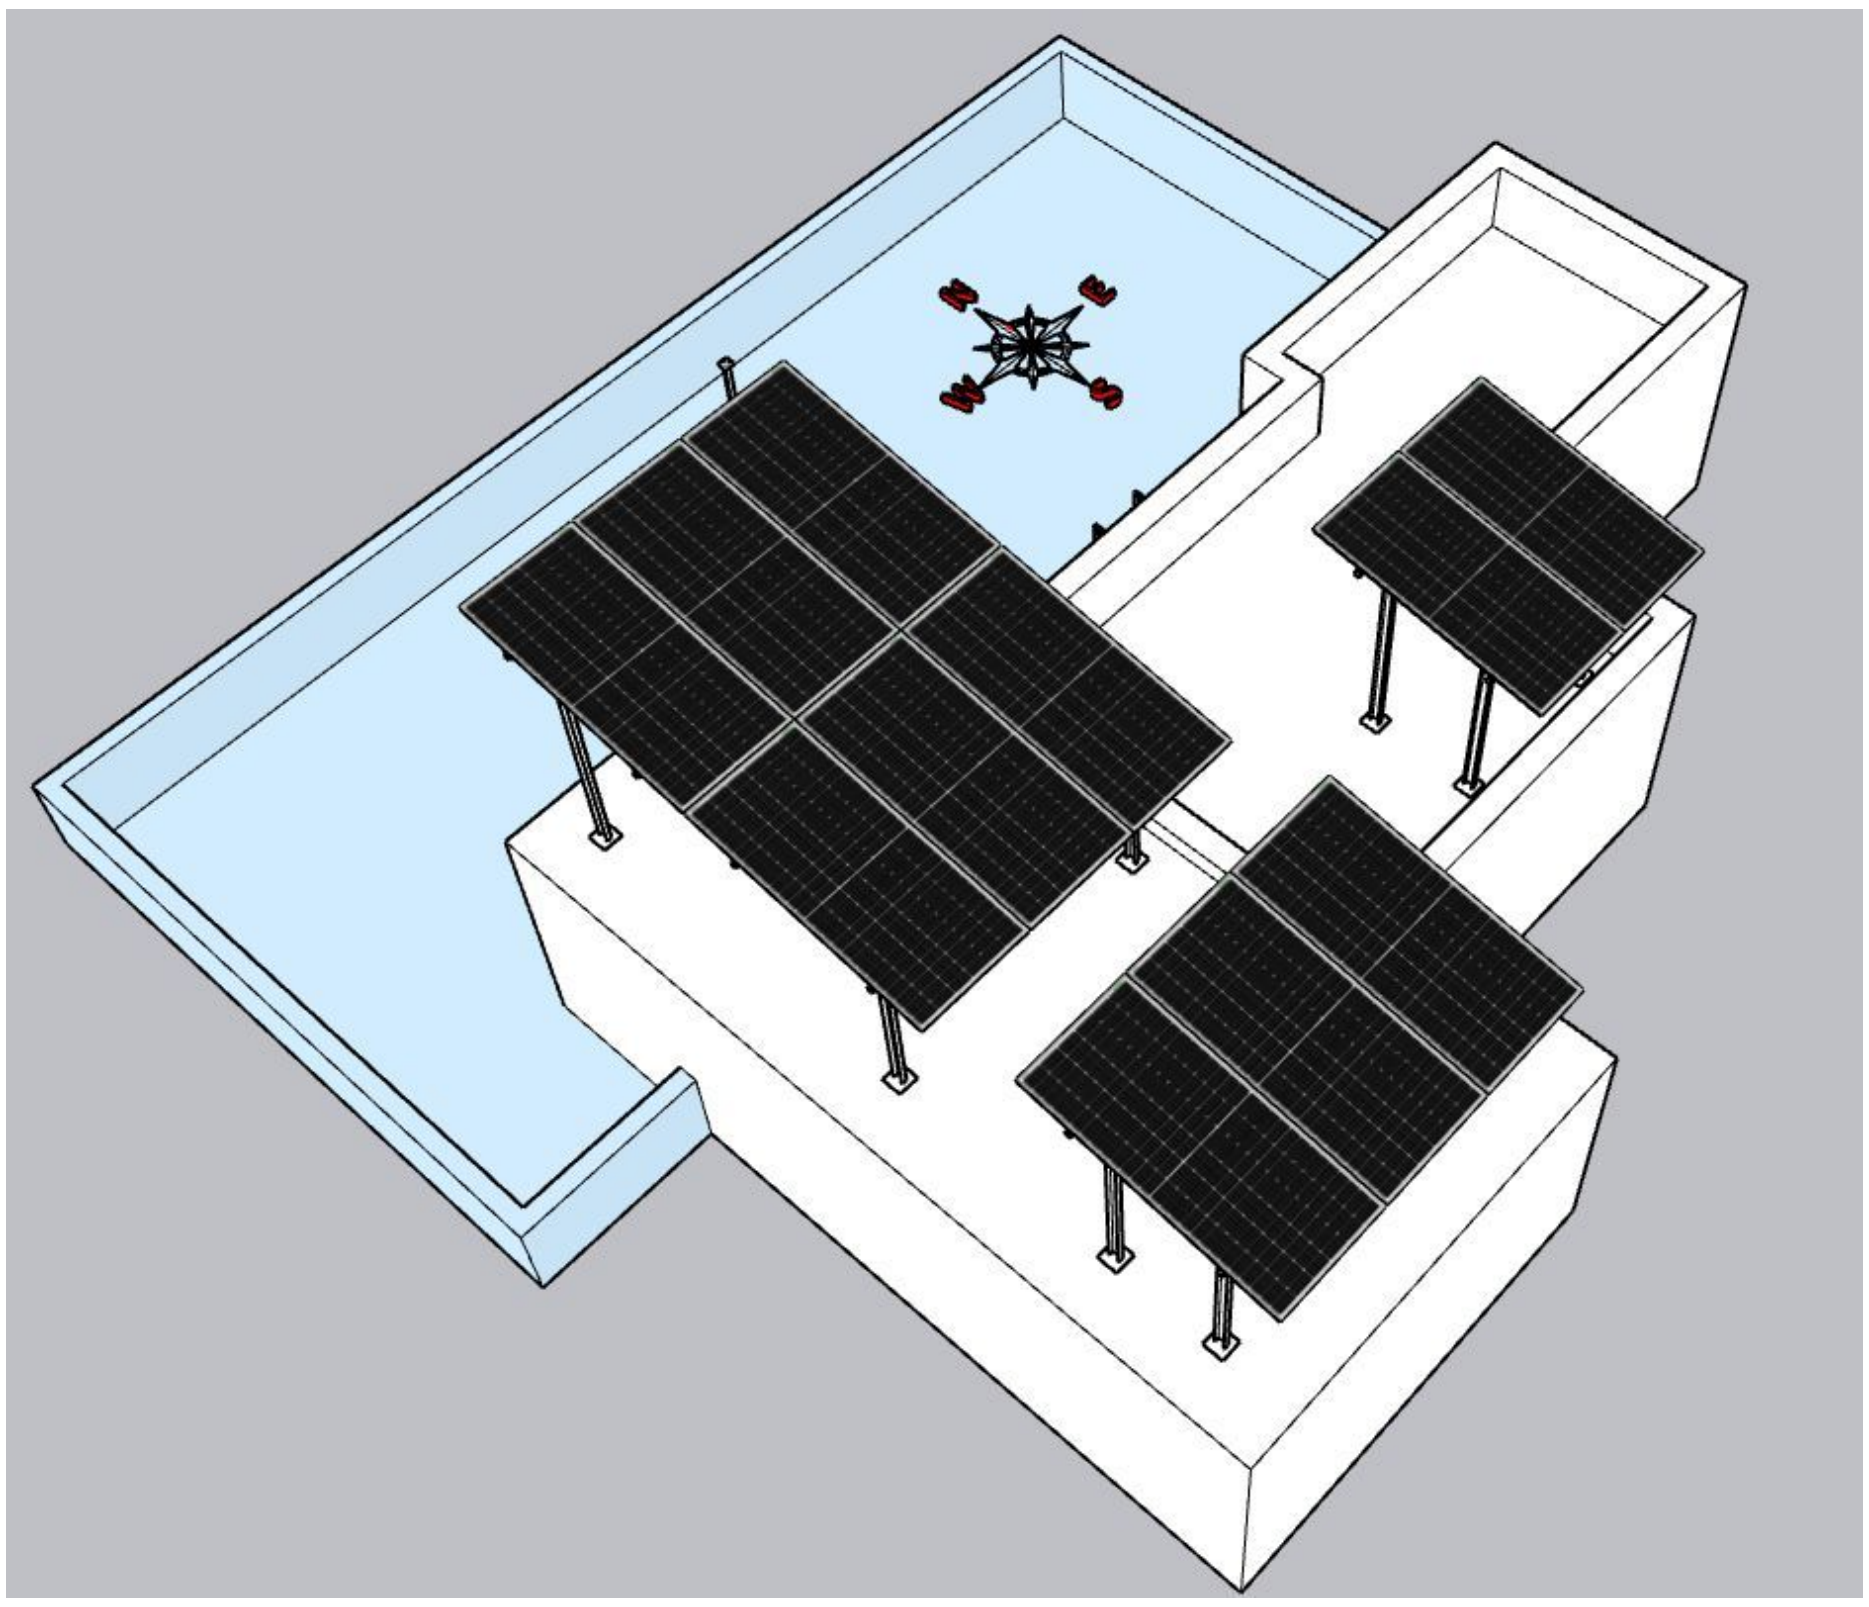

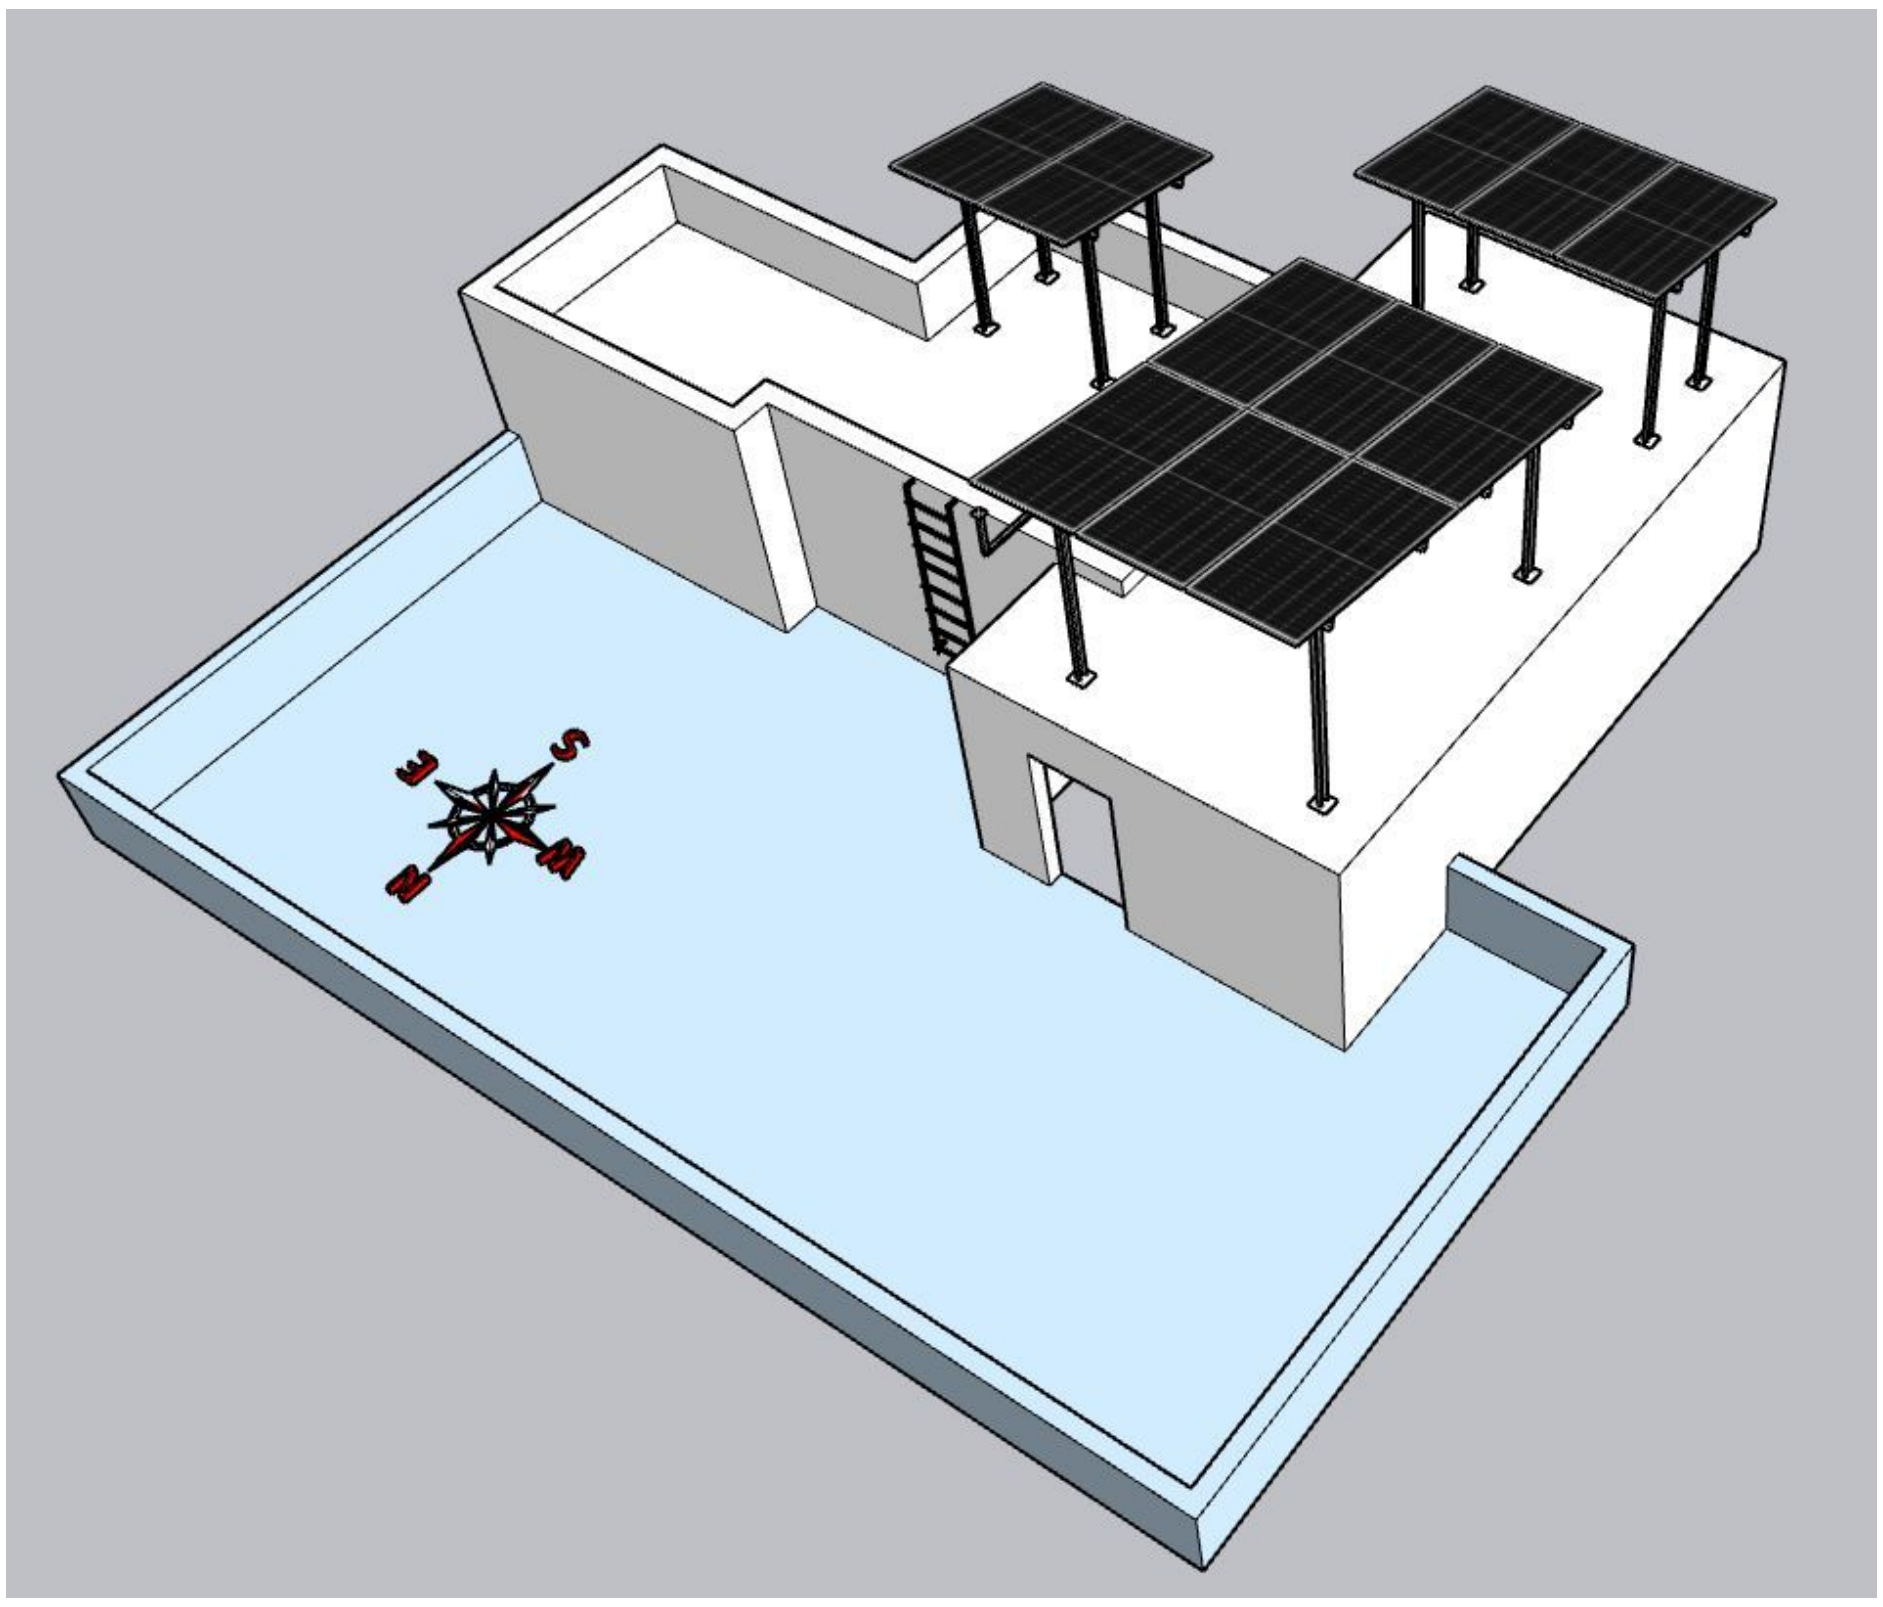

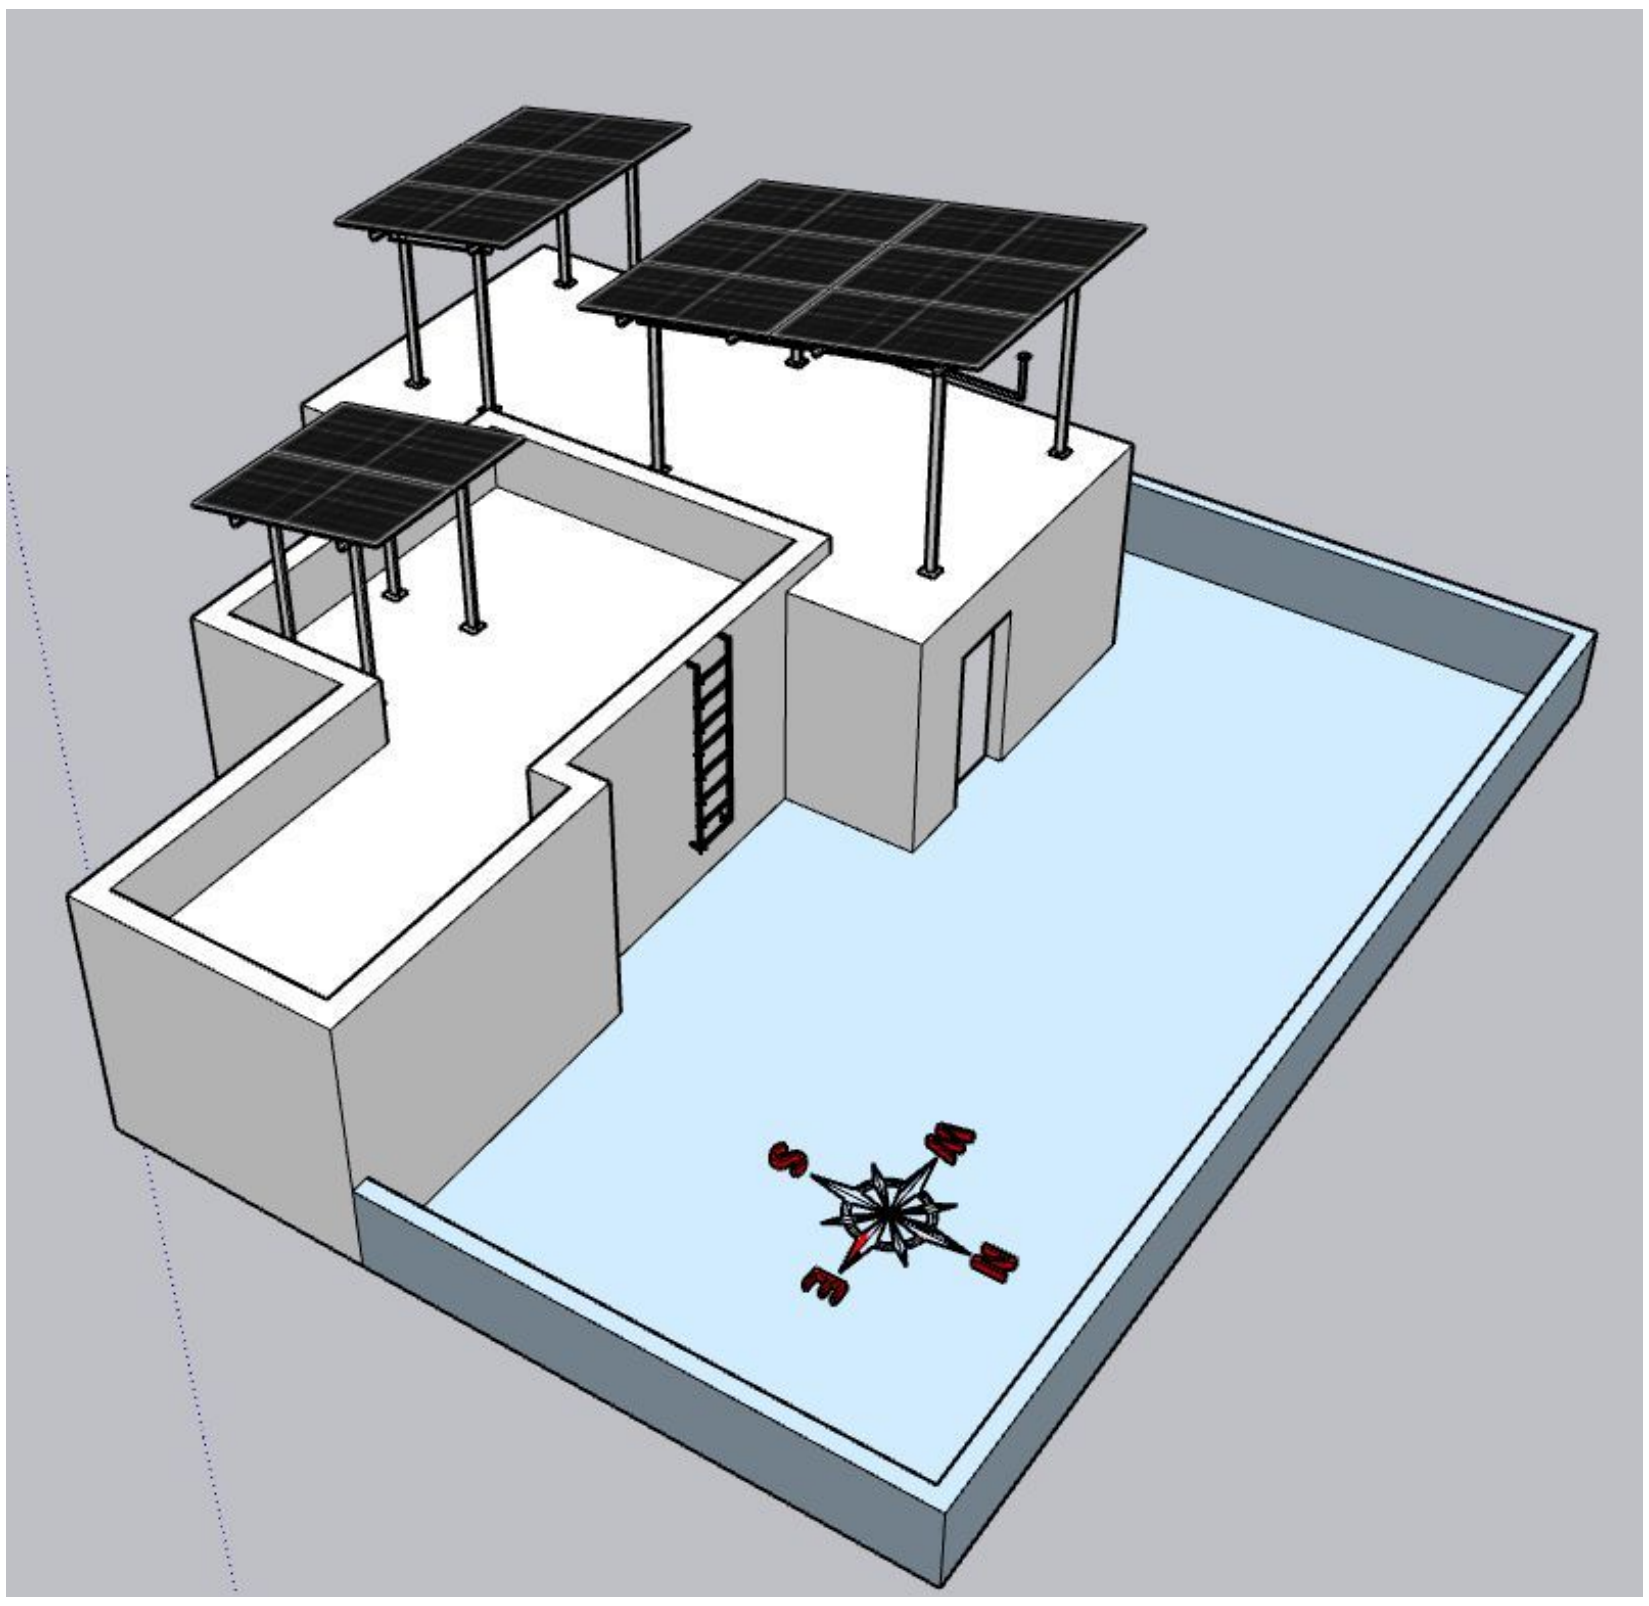

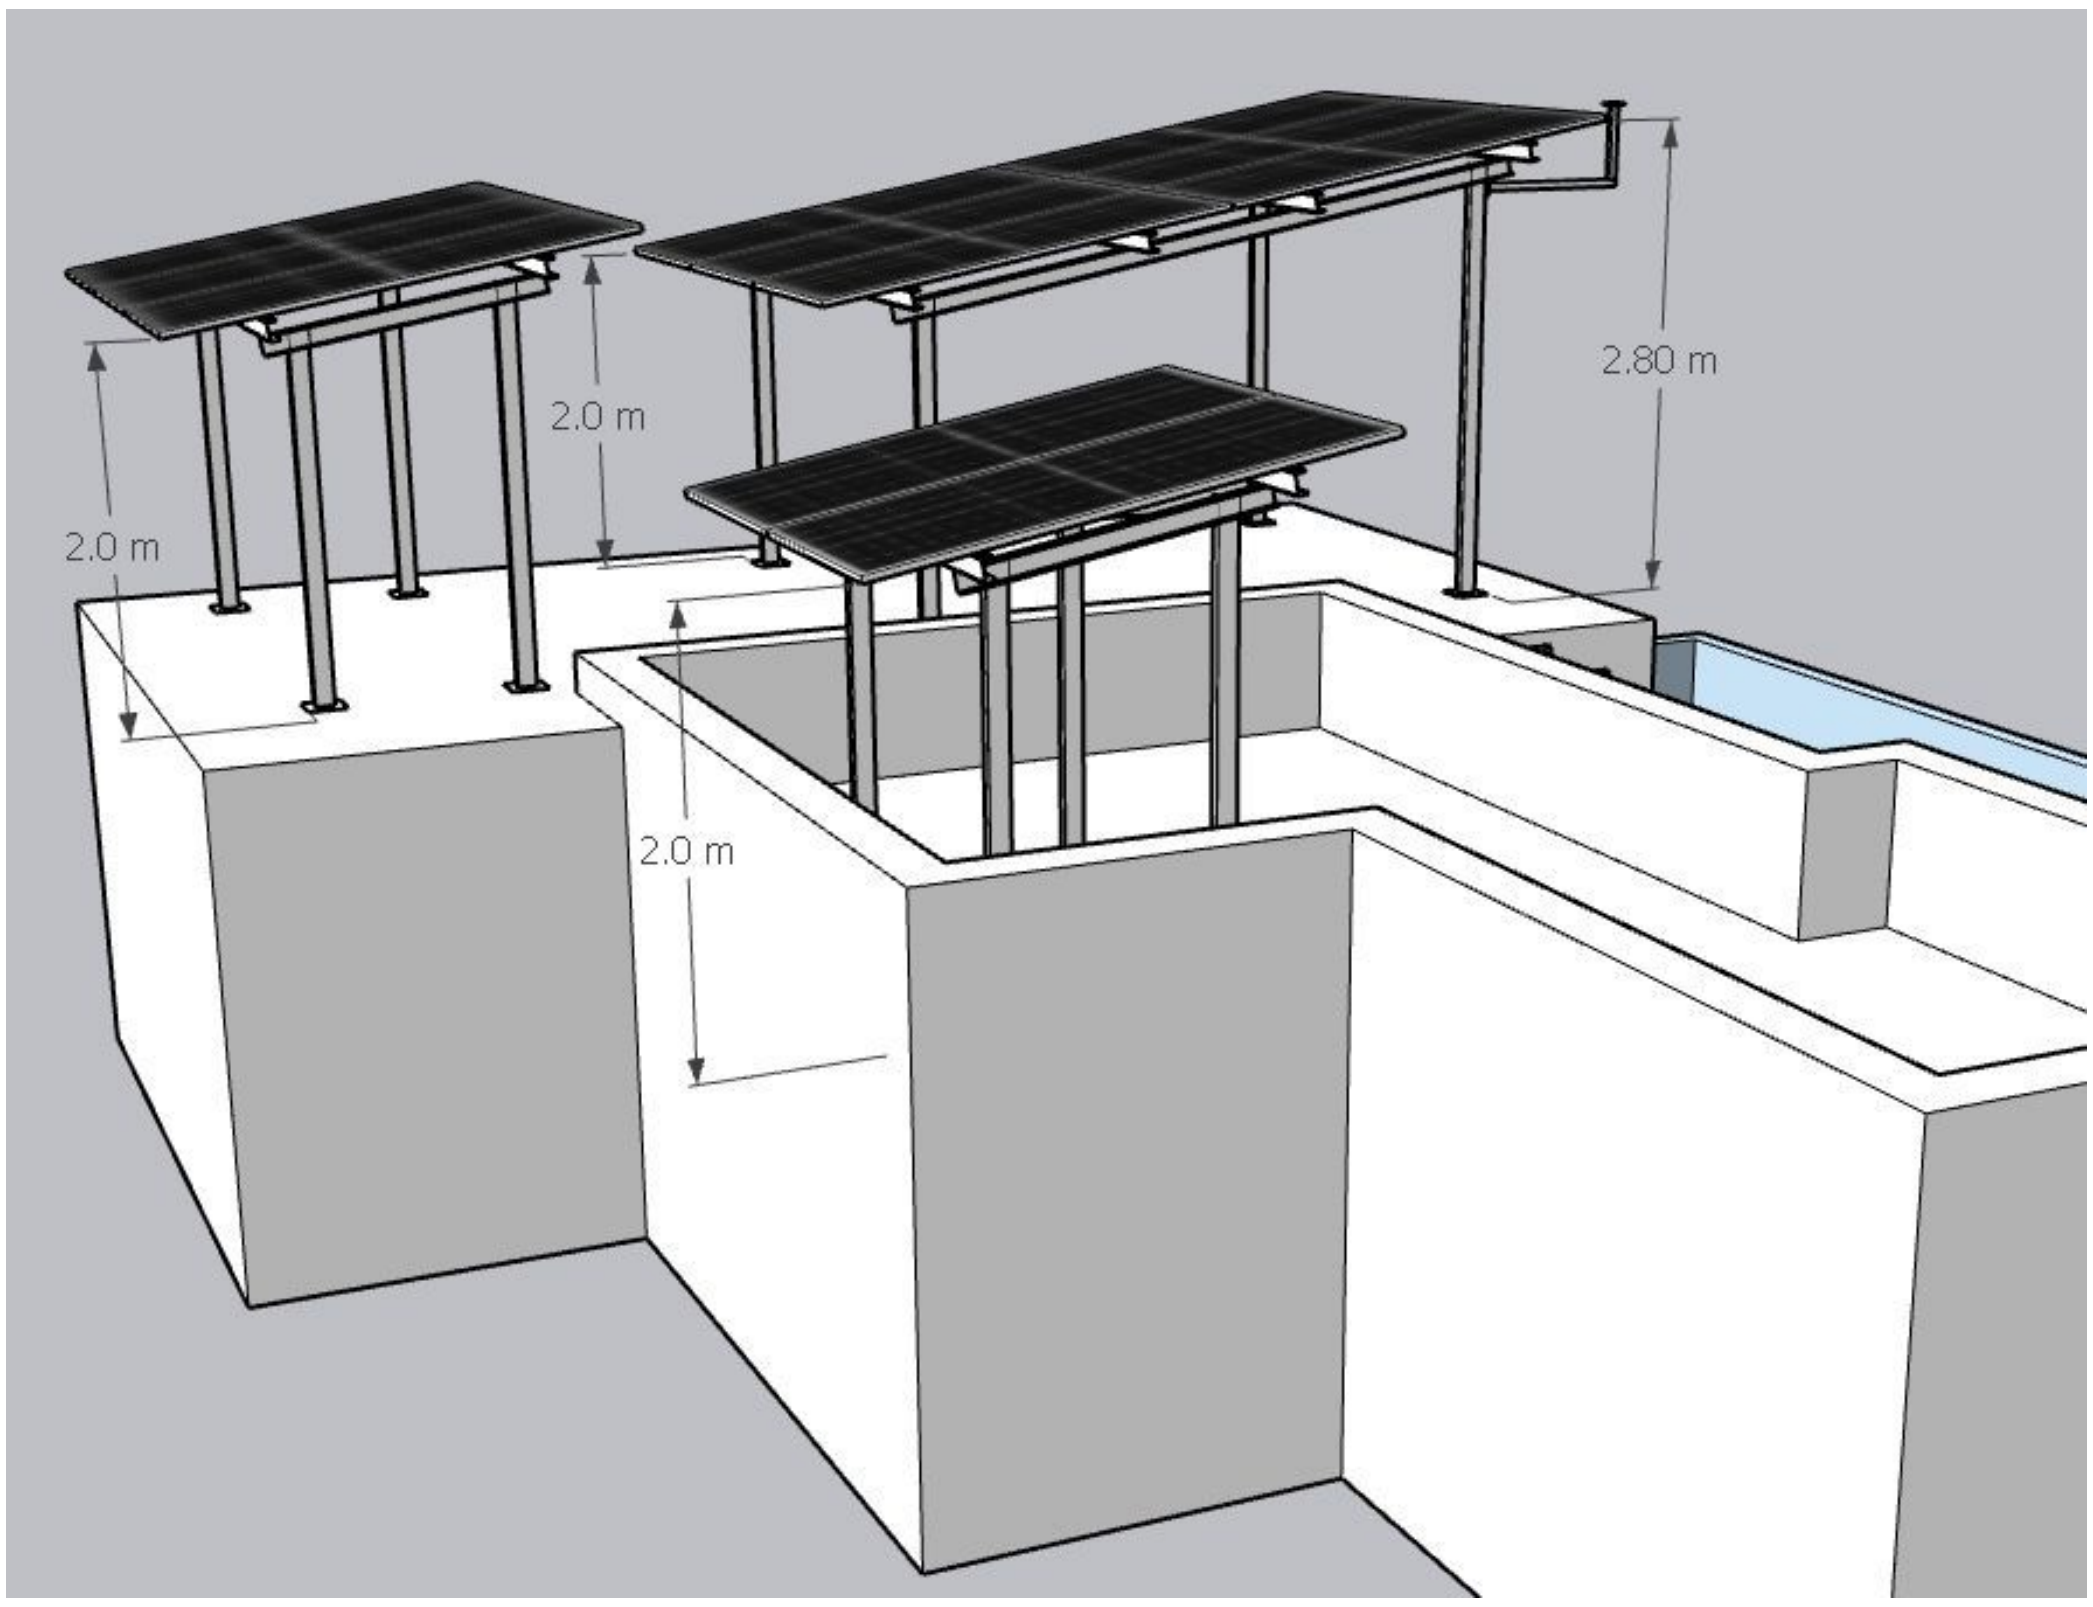
2.0 m
2.0 m
2.80 m
2.0 m

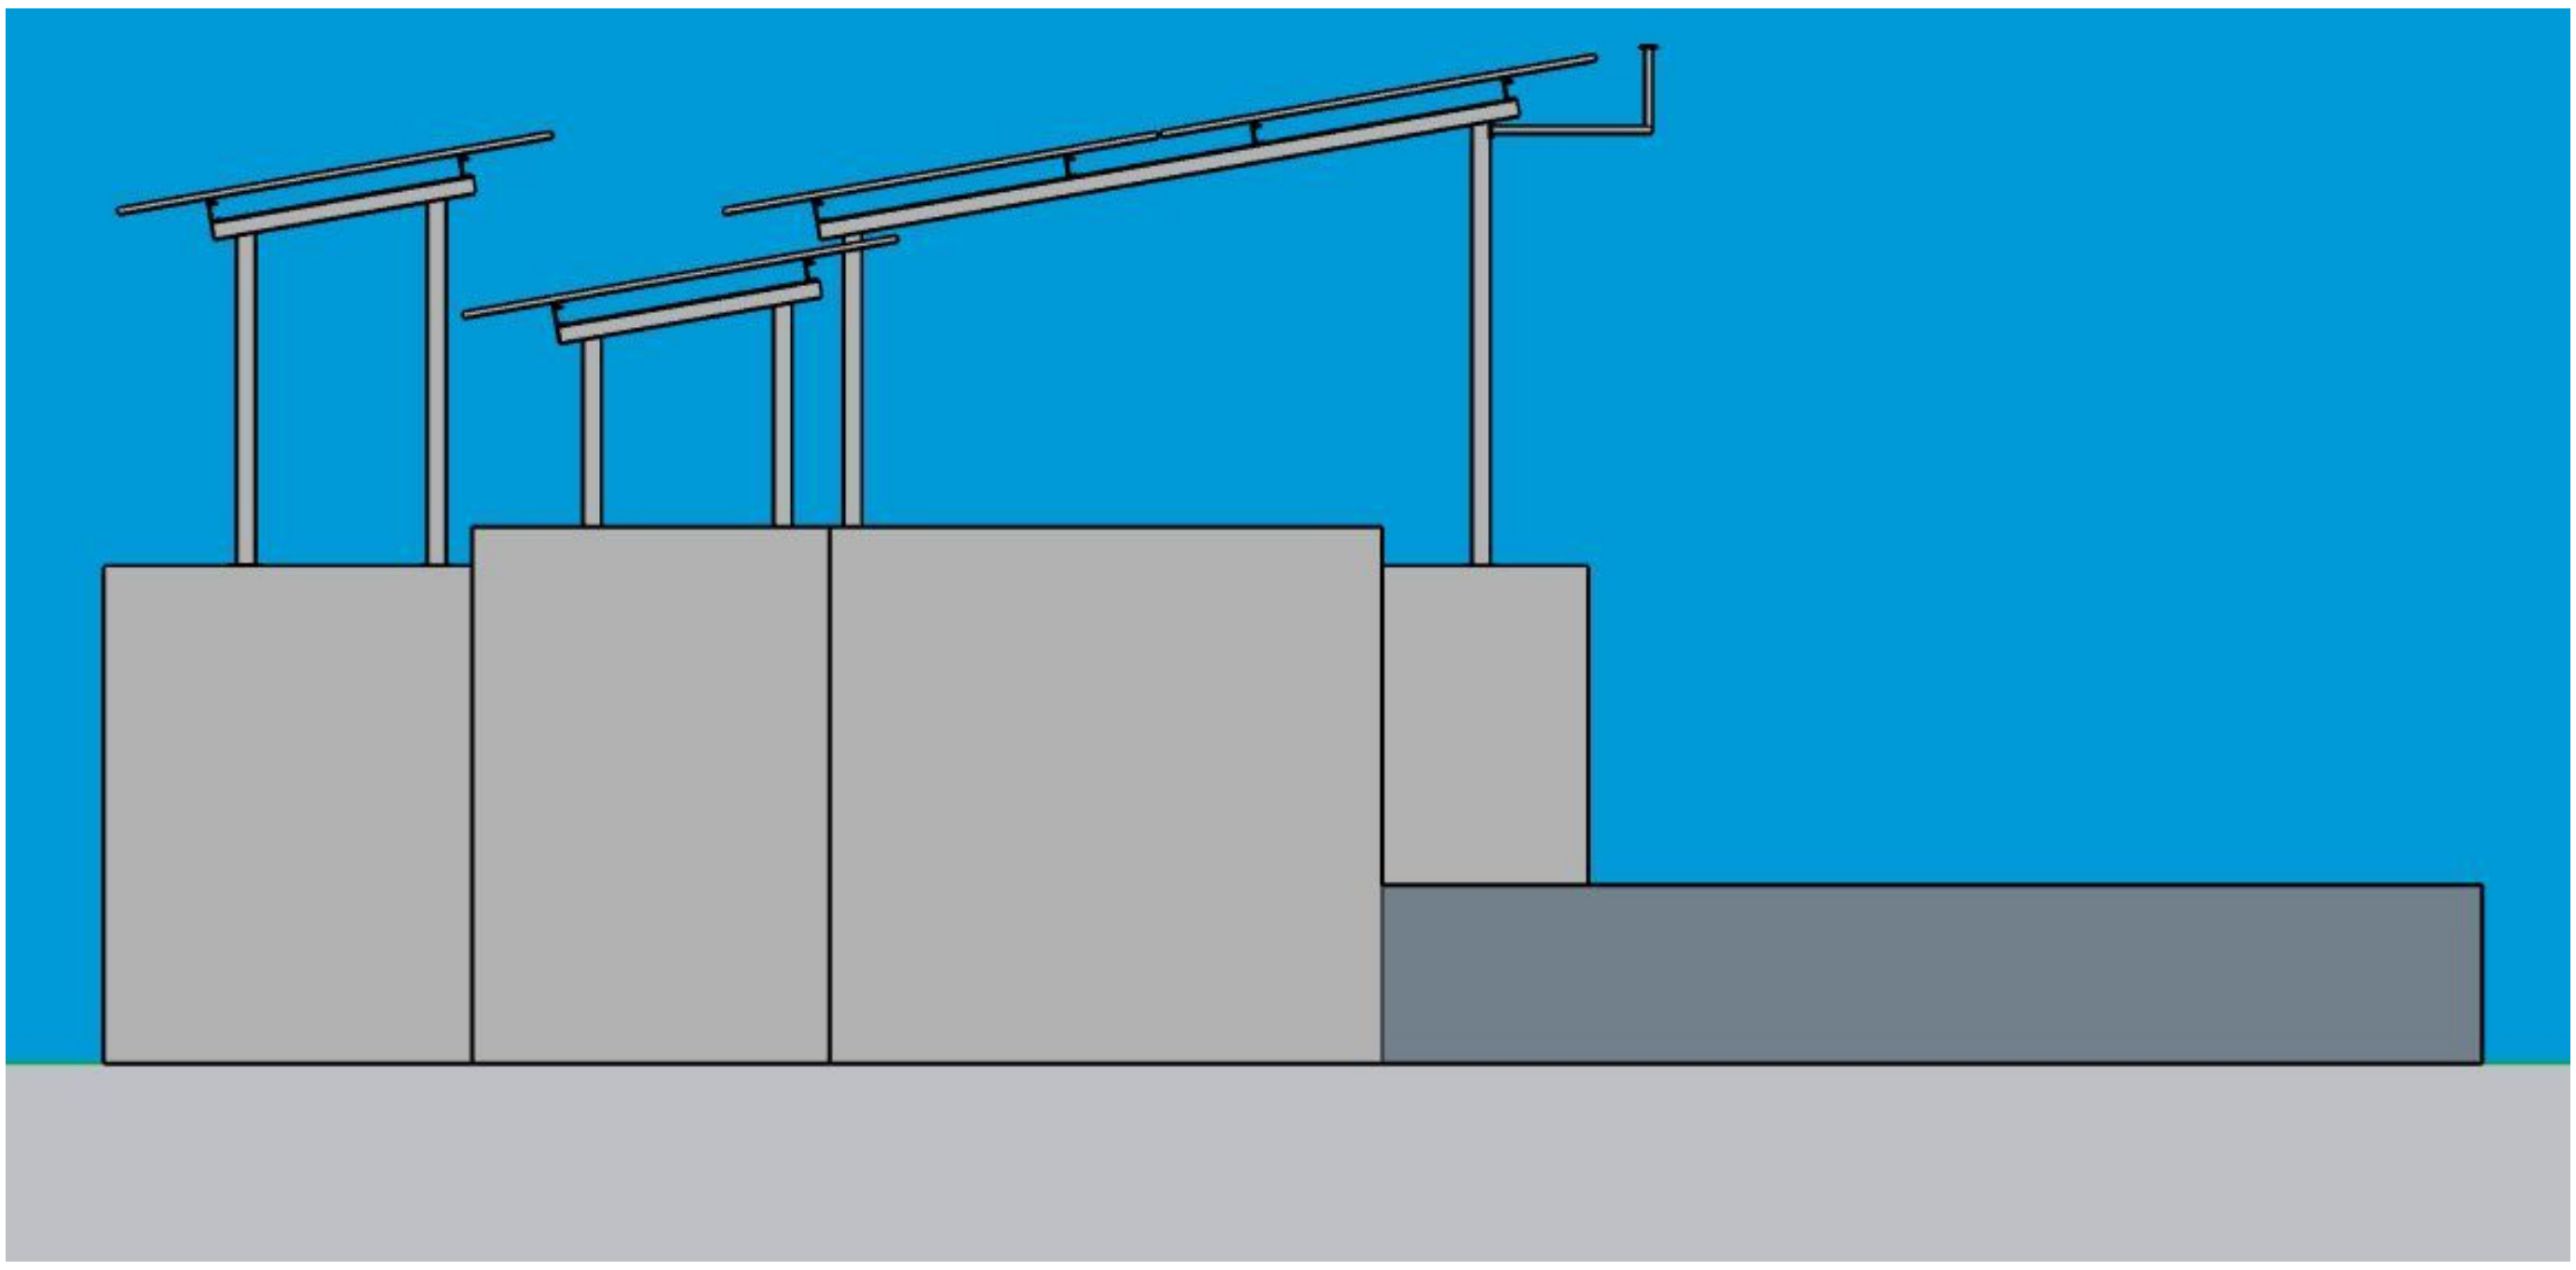

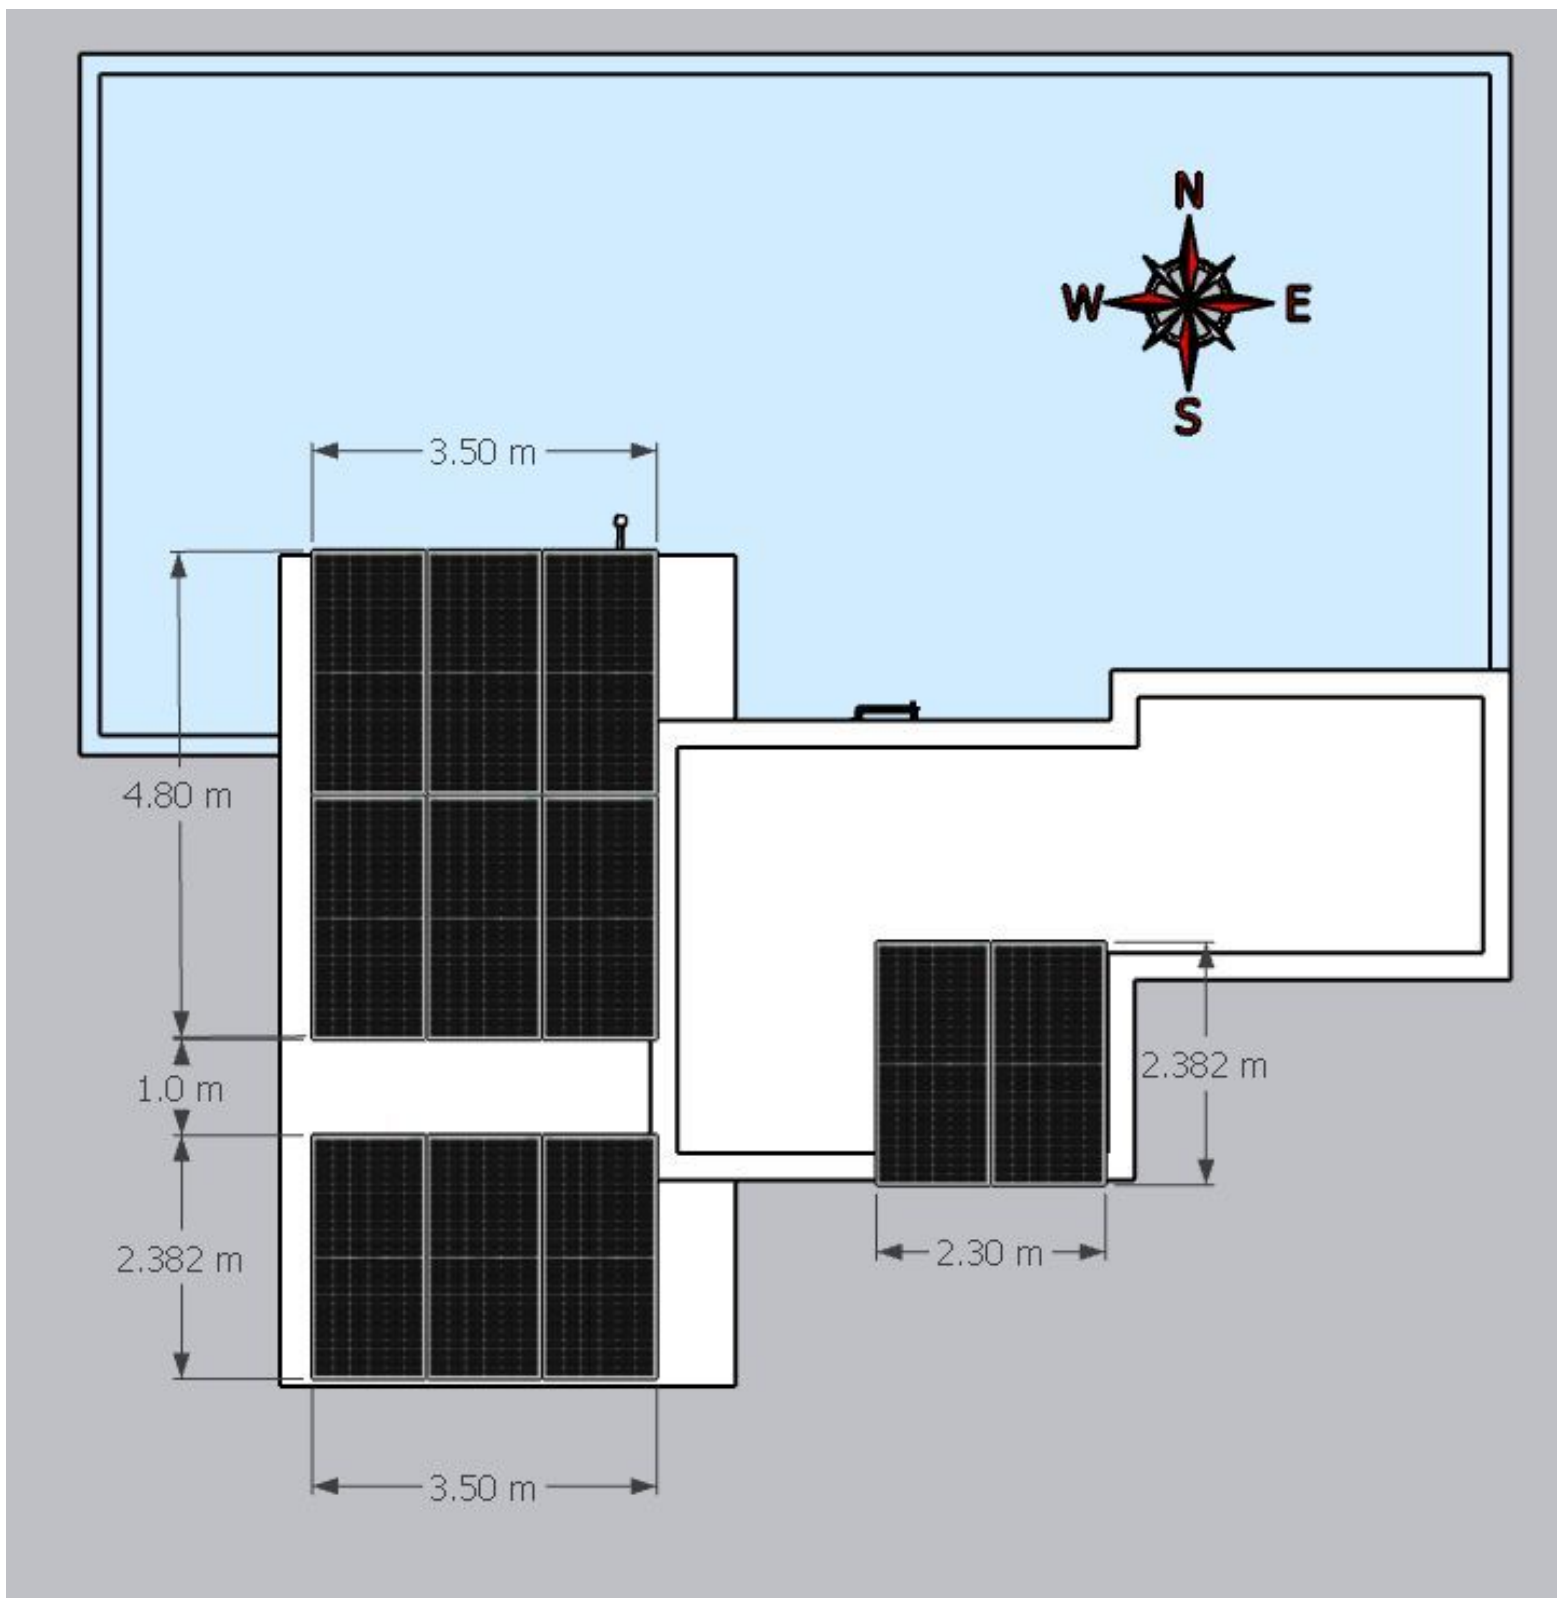

Building Exterior

Material Delivery Route

The materials can be shifted to the terrace via two options available at the site. Heavy materials such as PV modules can be shifted over the side wall of the building.

Light weight materials can be shifted to the terrace via the inner staircase.

The materials can follow the stairs until reaching the 2nd floor terrace.

The materials shifting outwards the balcony area can be stacked here before shifting to the headroom terrace.

Proposed PV Area

Cable Routing

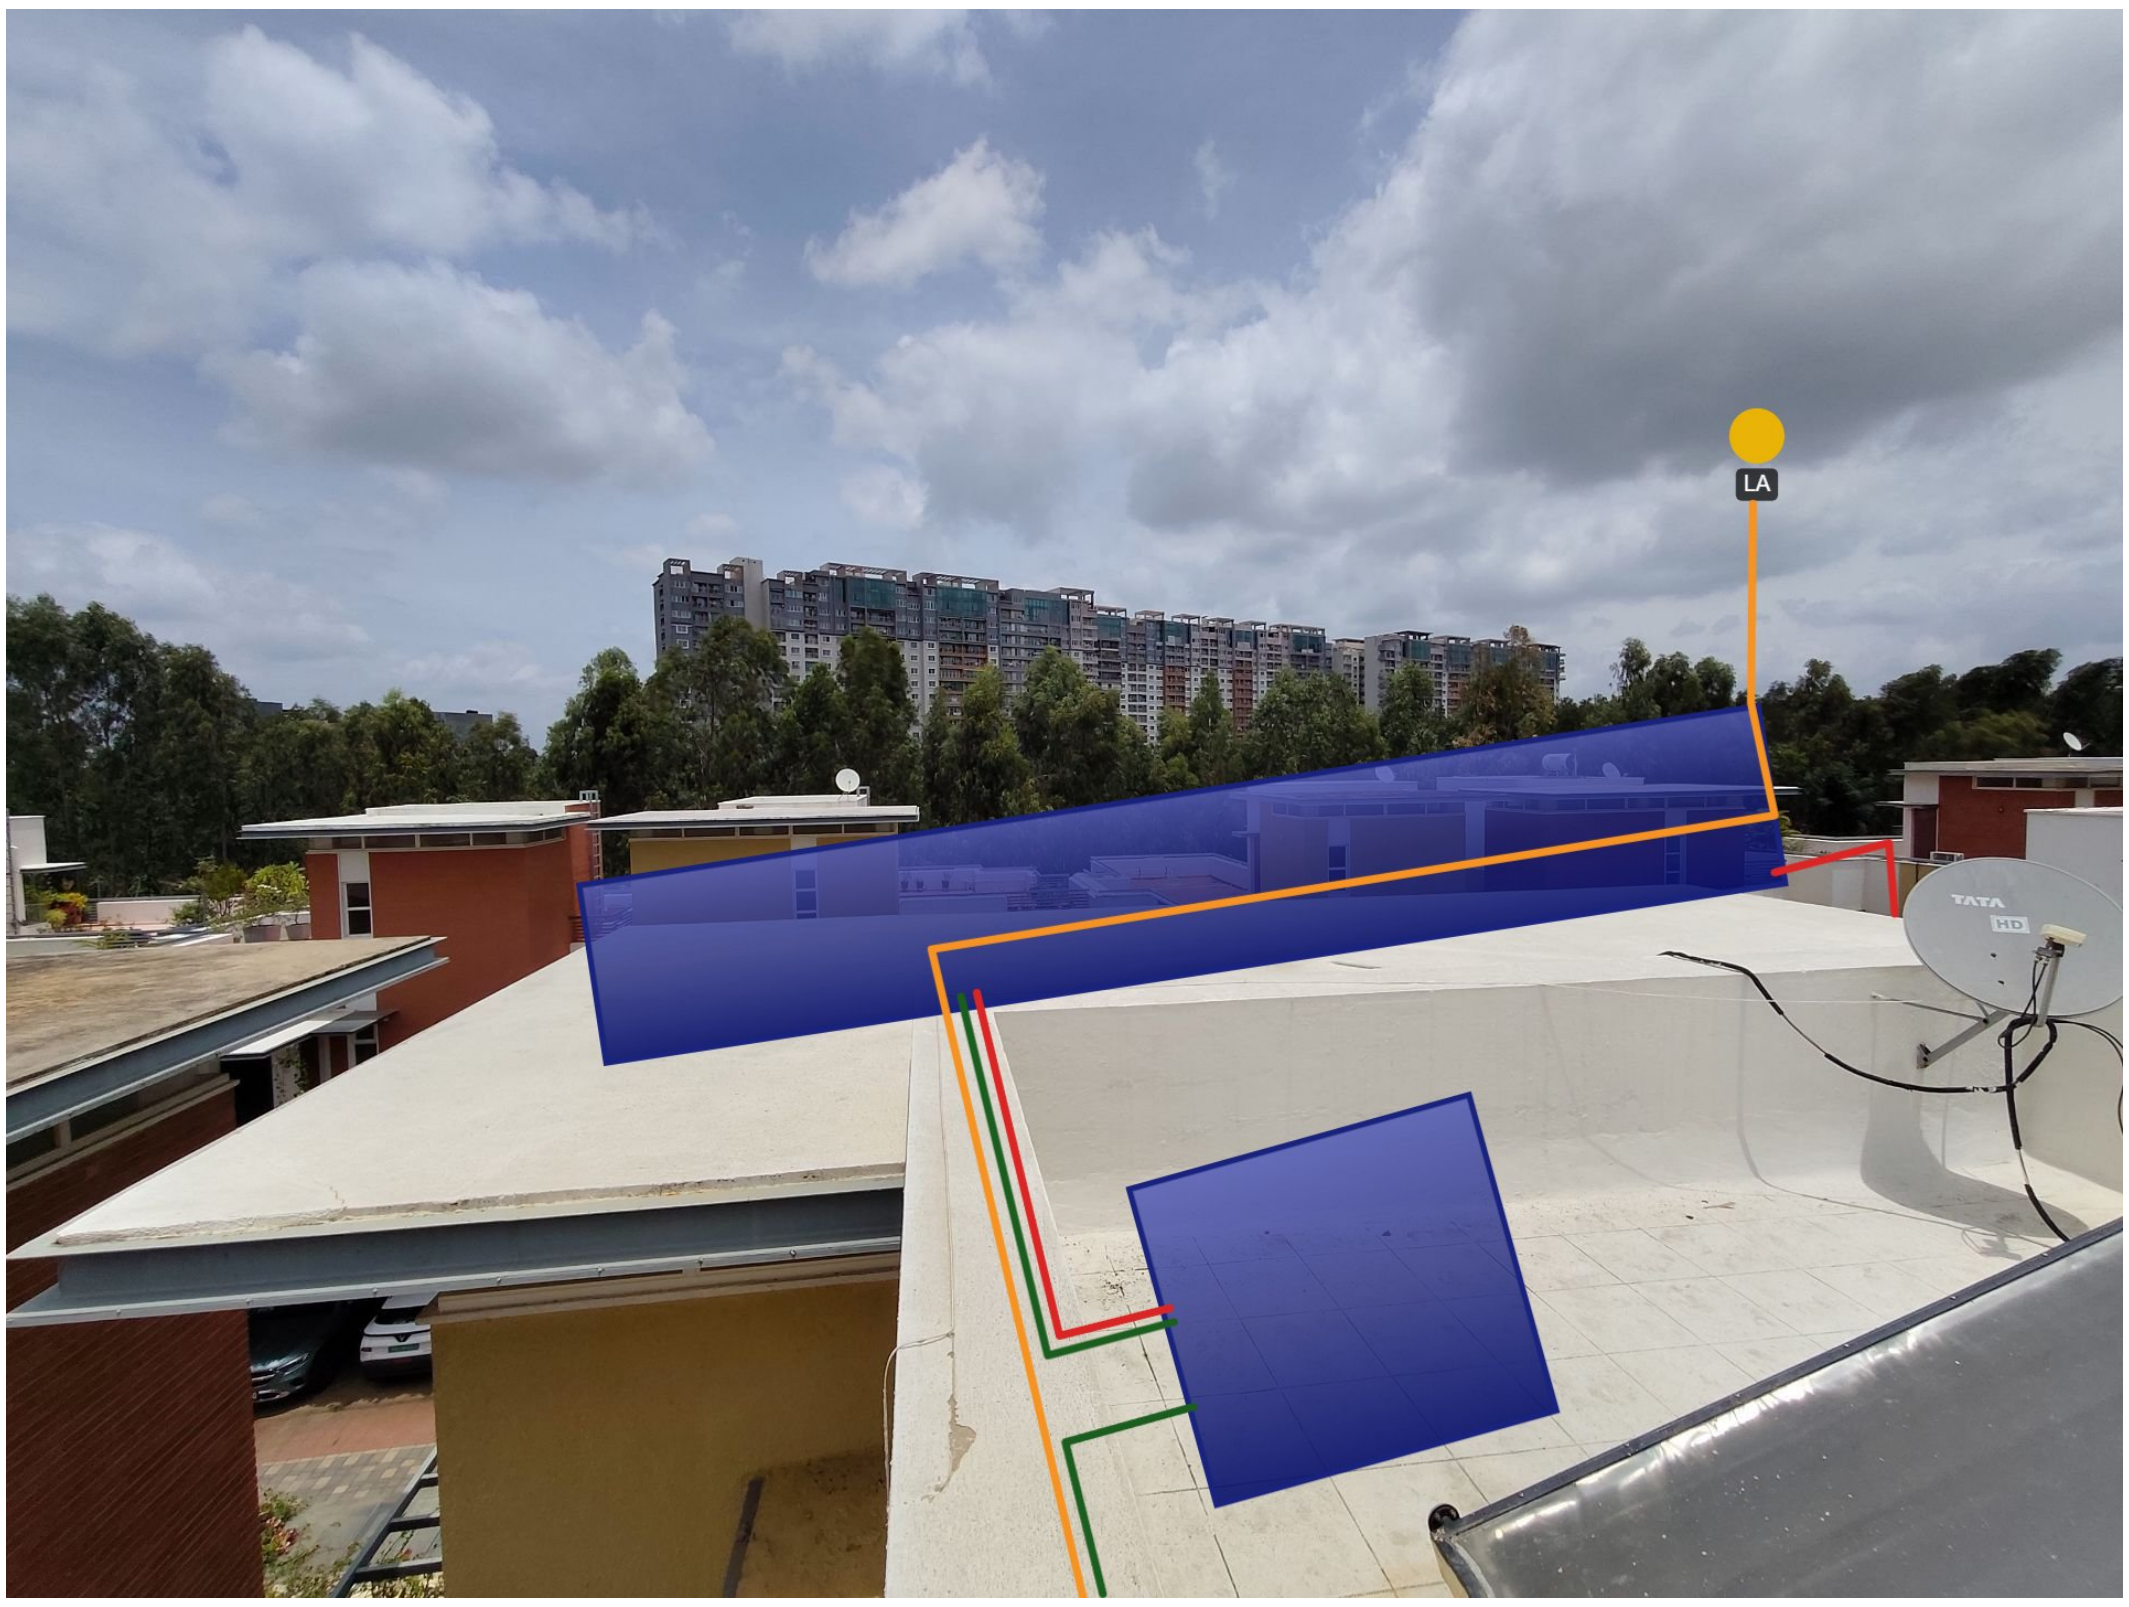

DC cable has to pull down towards the front side of the building and the DC earthing cable & LA cable has to run towards the back side of the building.

The DC cable in conduit has to keep the exact borders and edges of the wall while running, as shown above.

The DC cable in conduit has to keep the exact borders and edges of the wall while running, as shown above.

The DC cable in conduit has to keep the exact borders and edges of the wall while running, as shown above.

Here, the DC cable (RED) is moving down from terrace to the inverter location. But, the AC earthing

DC-DB, AC-DB & Inverter can be wall mounted next to the existing main meter.

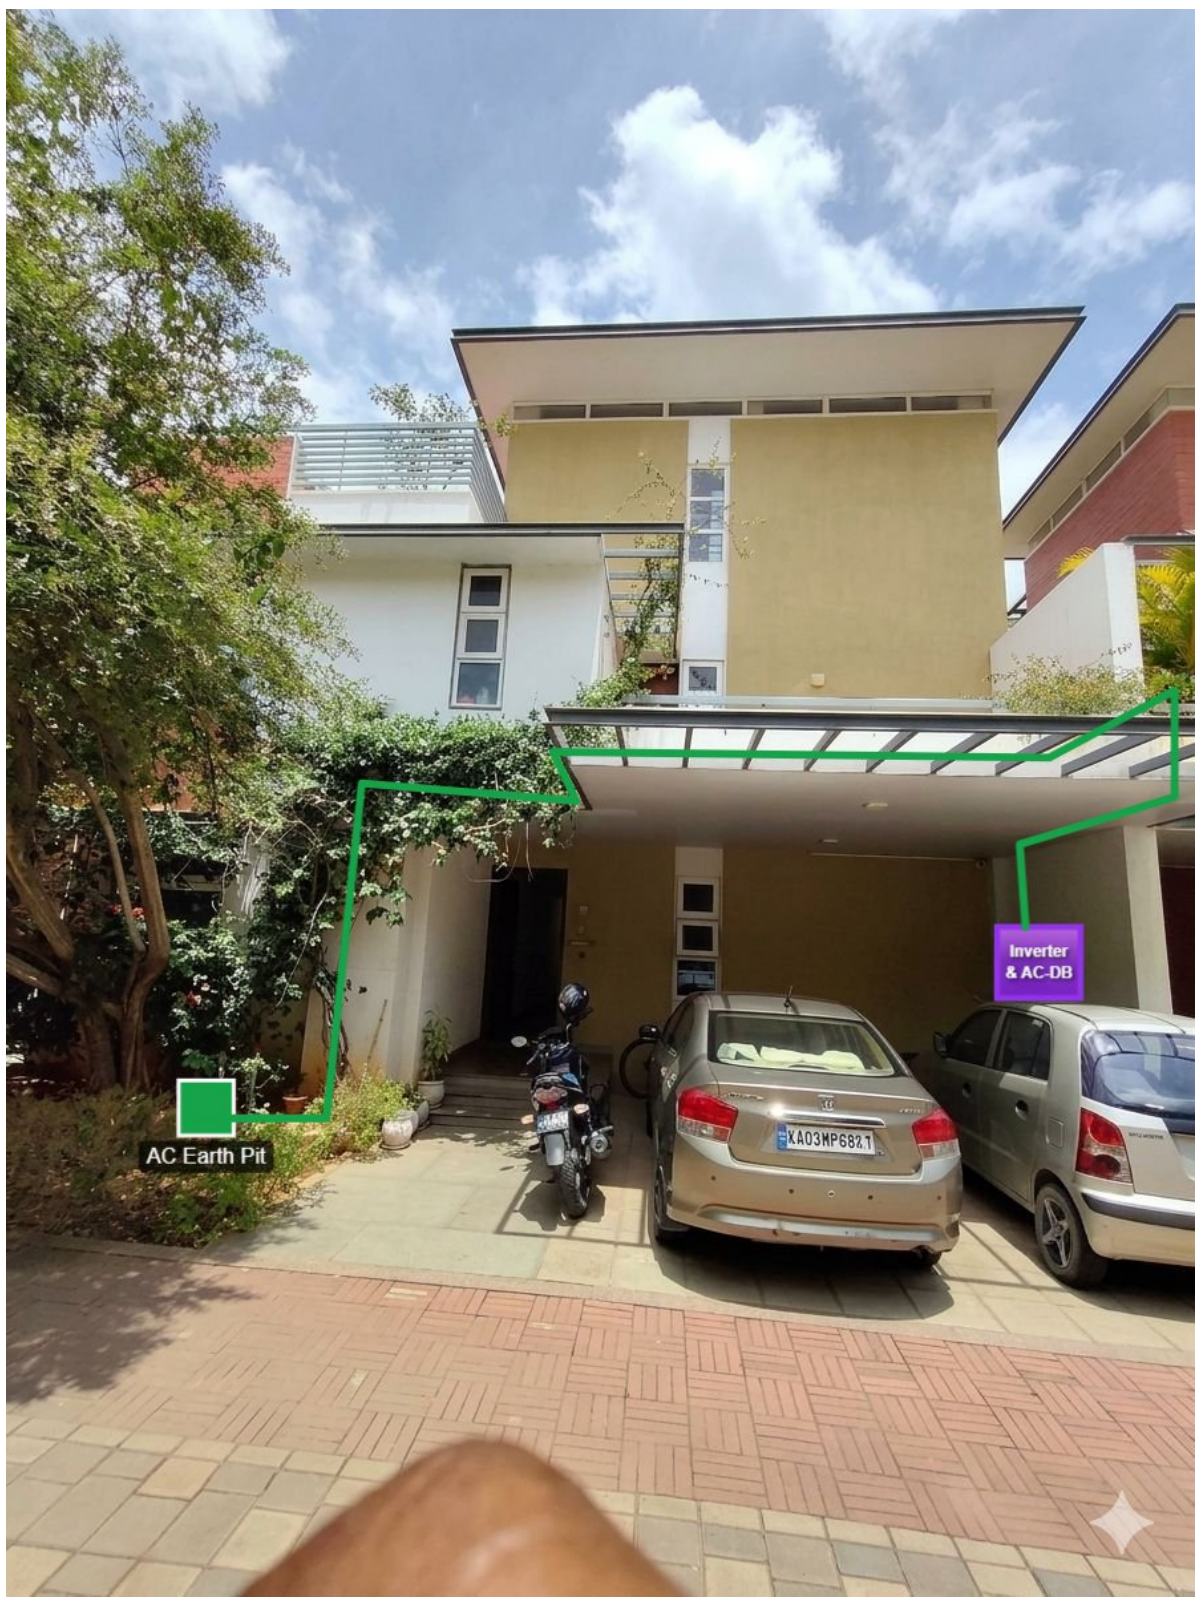

AC earth pit location: the front garden area.

The DC and LA earthing cables has to run over the parapet wall and pull vertically down through the existing plumbing duct at the back side of the building.

The DC & LA earthing cables should be pulled via the duct till reaching the ground.

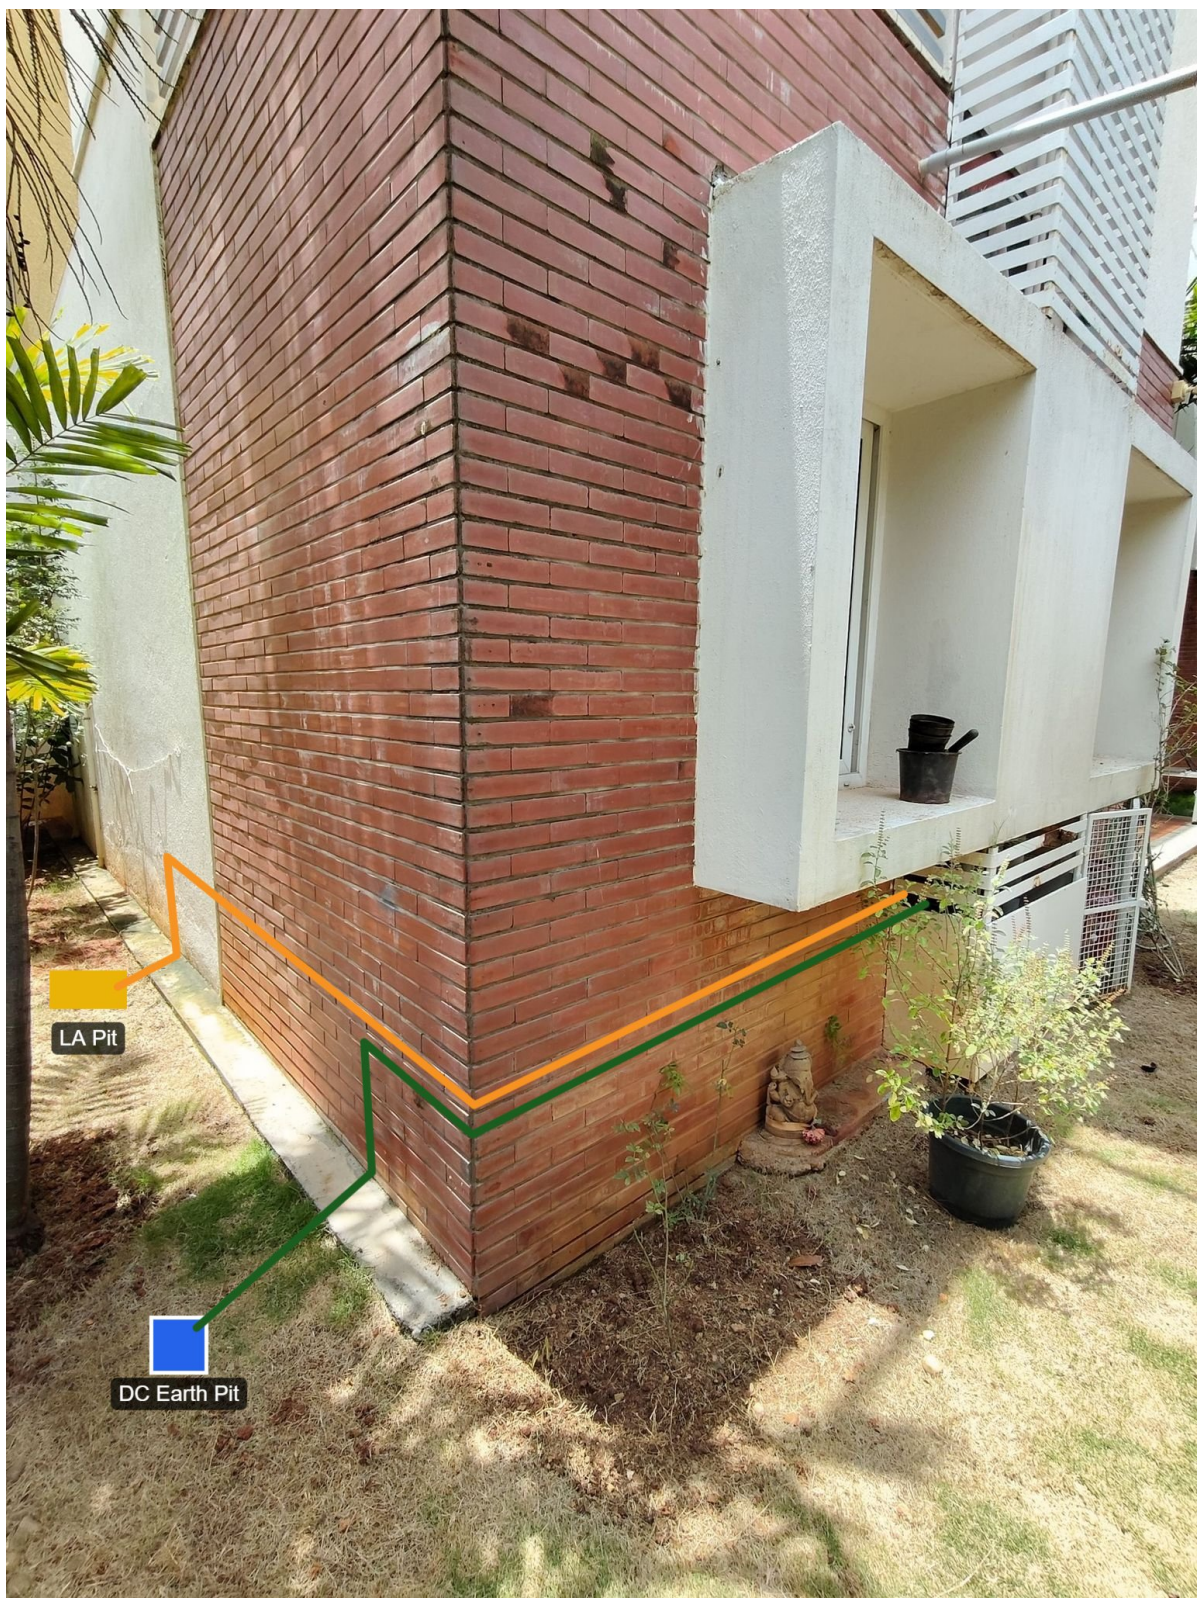

DC & LA earthing pit location: the back garden area.

Meter Box

Shadow Analysis

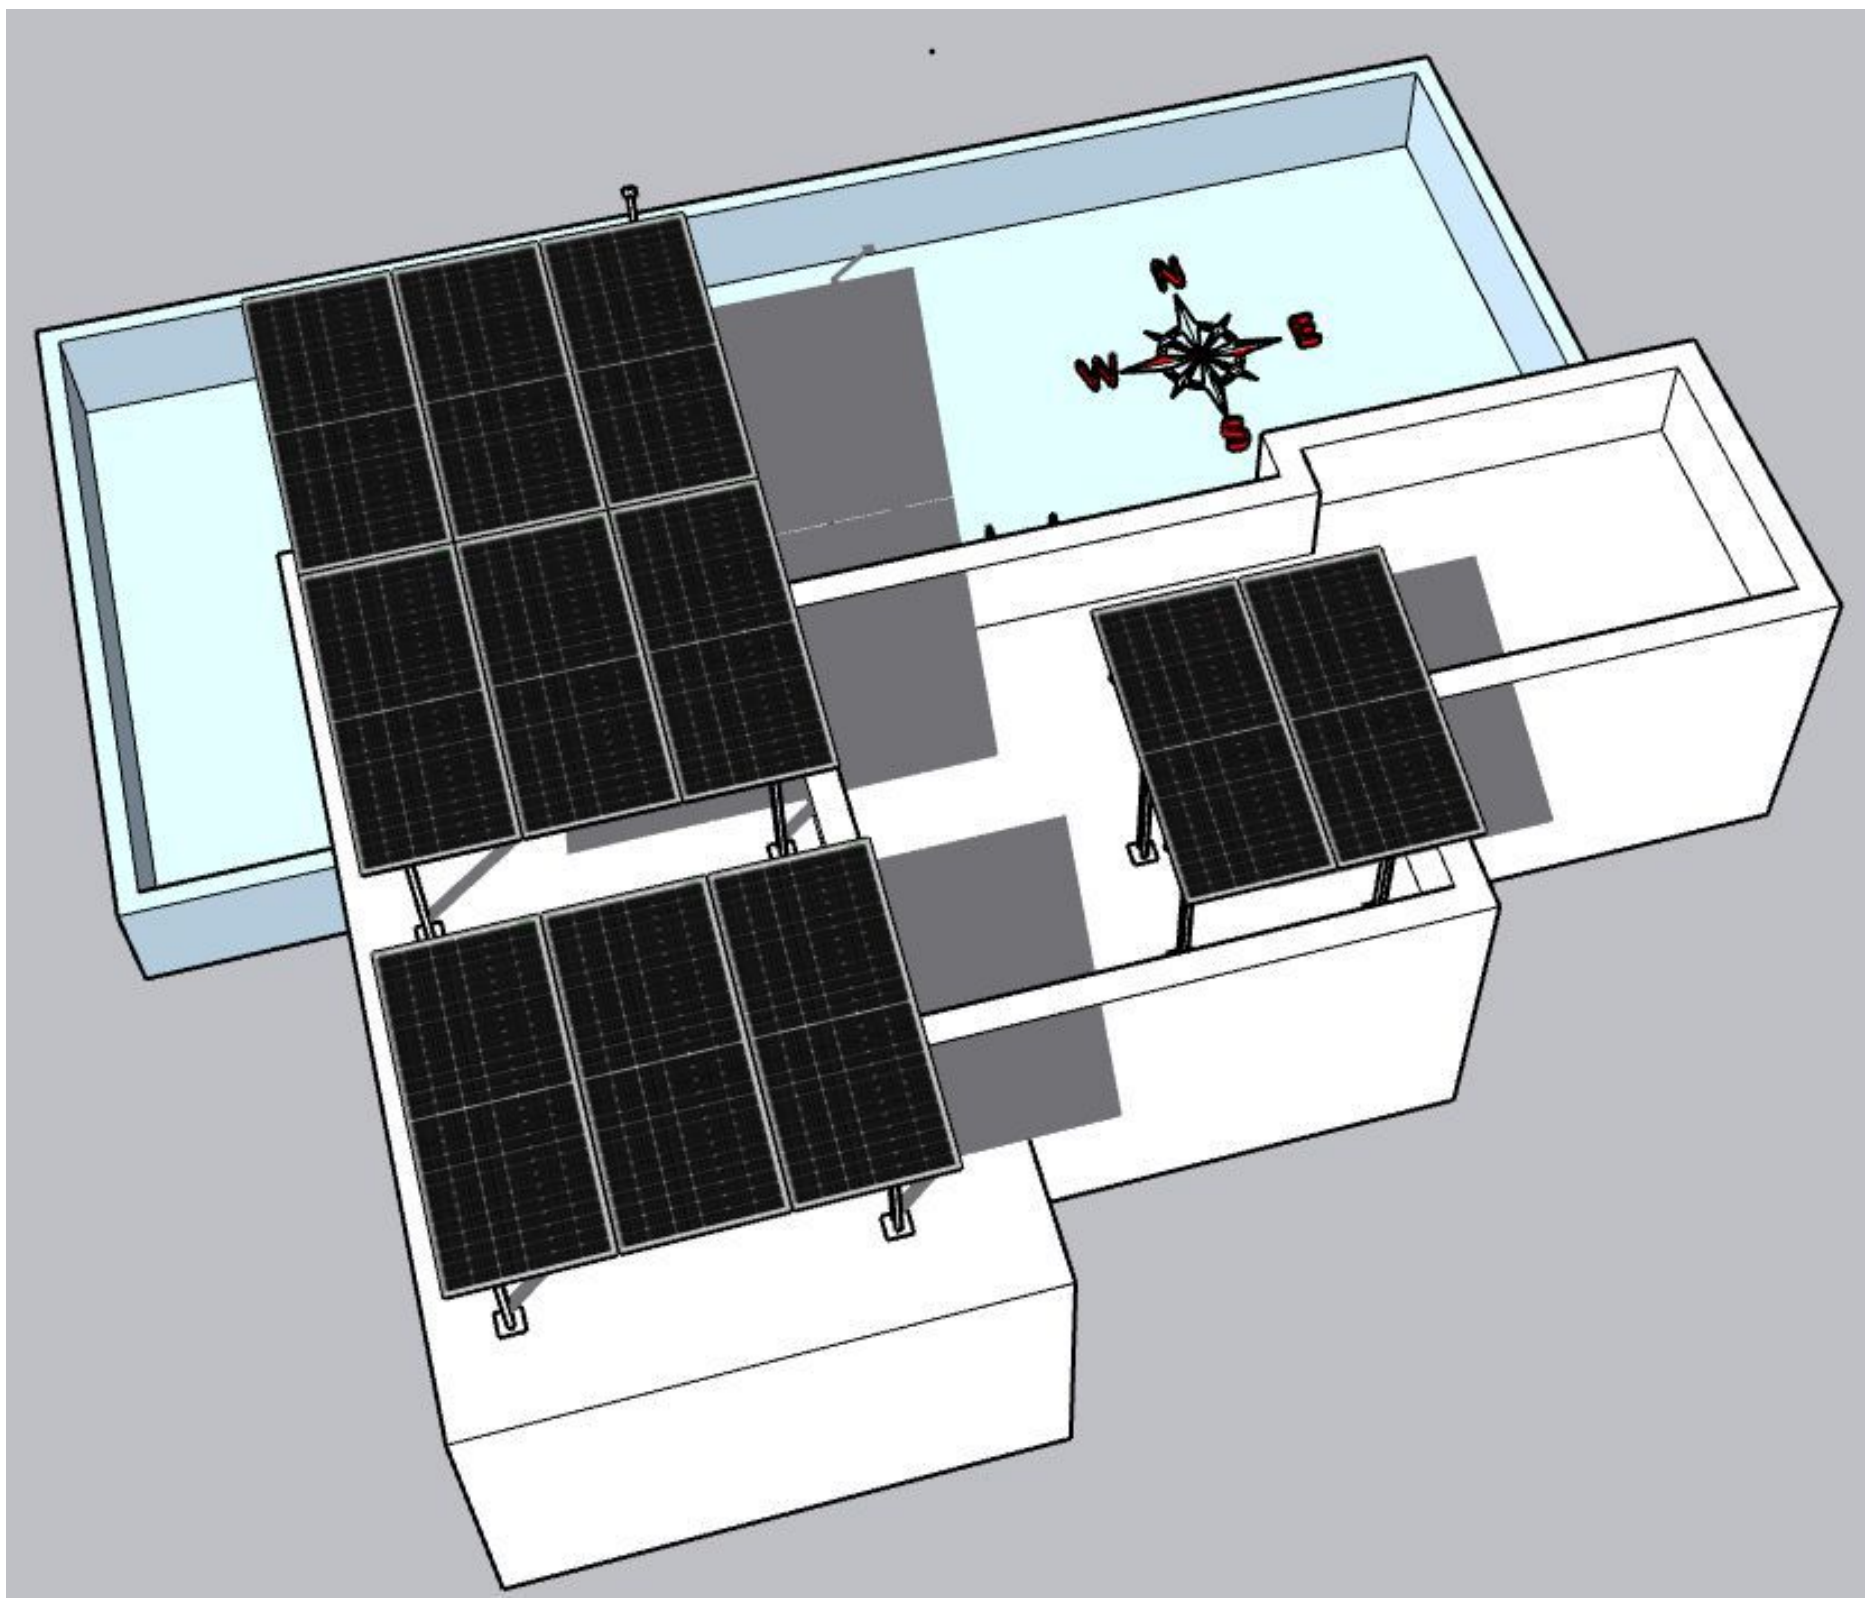

Shadow view (Feb 3pm)

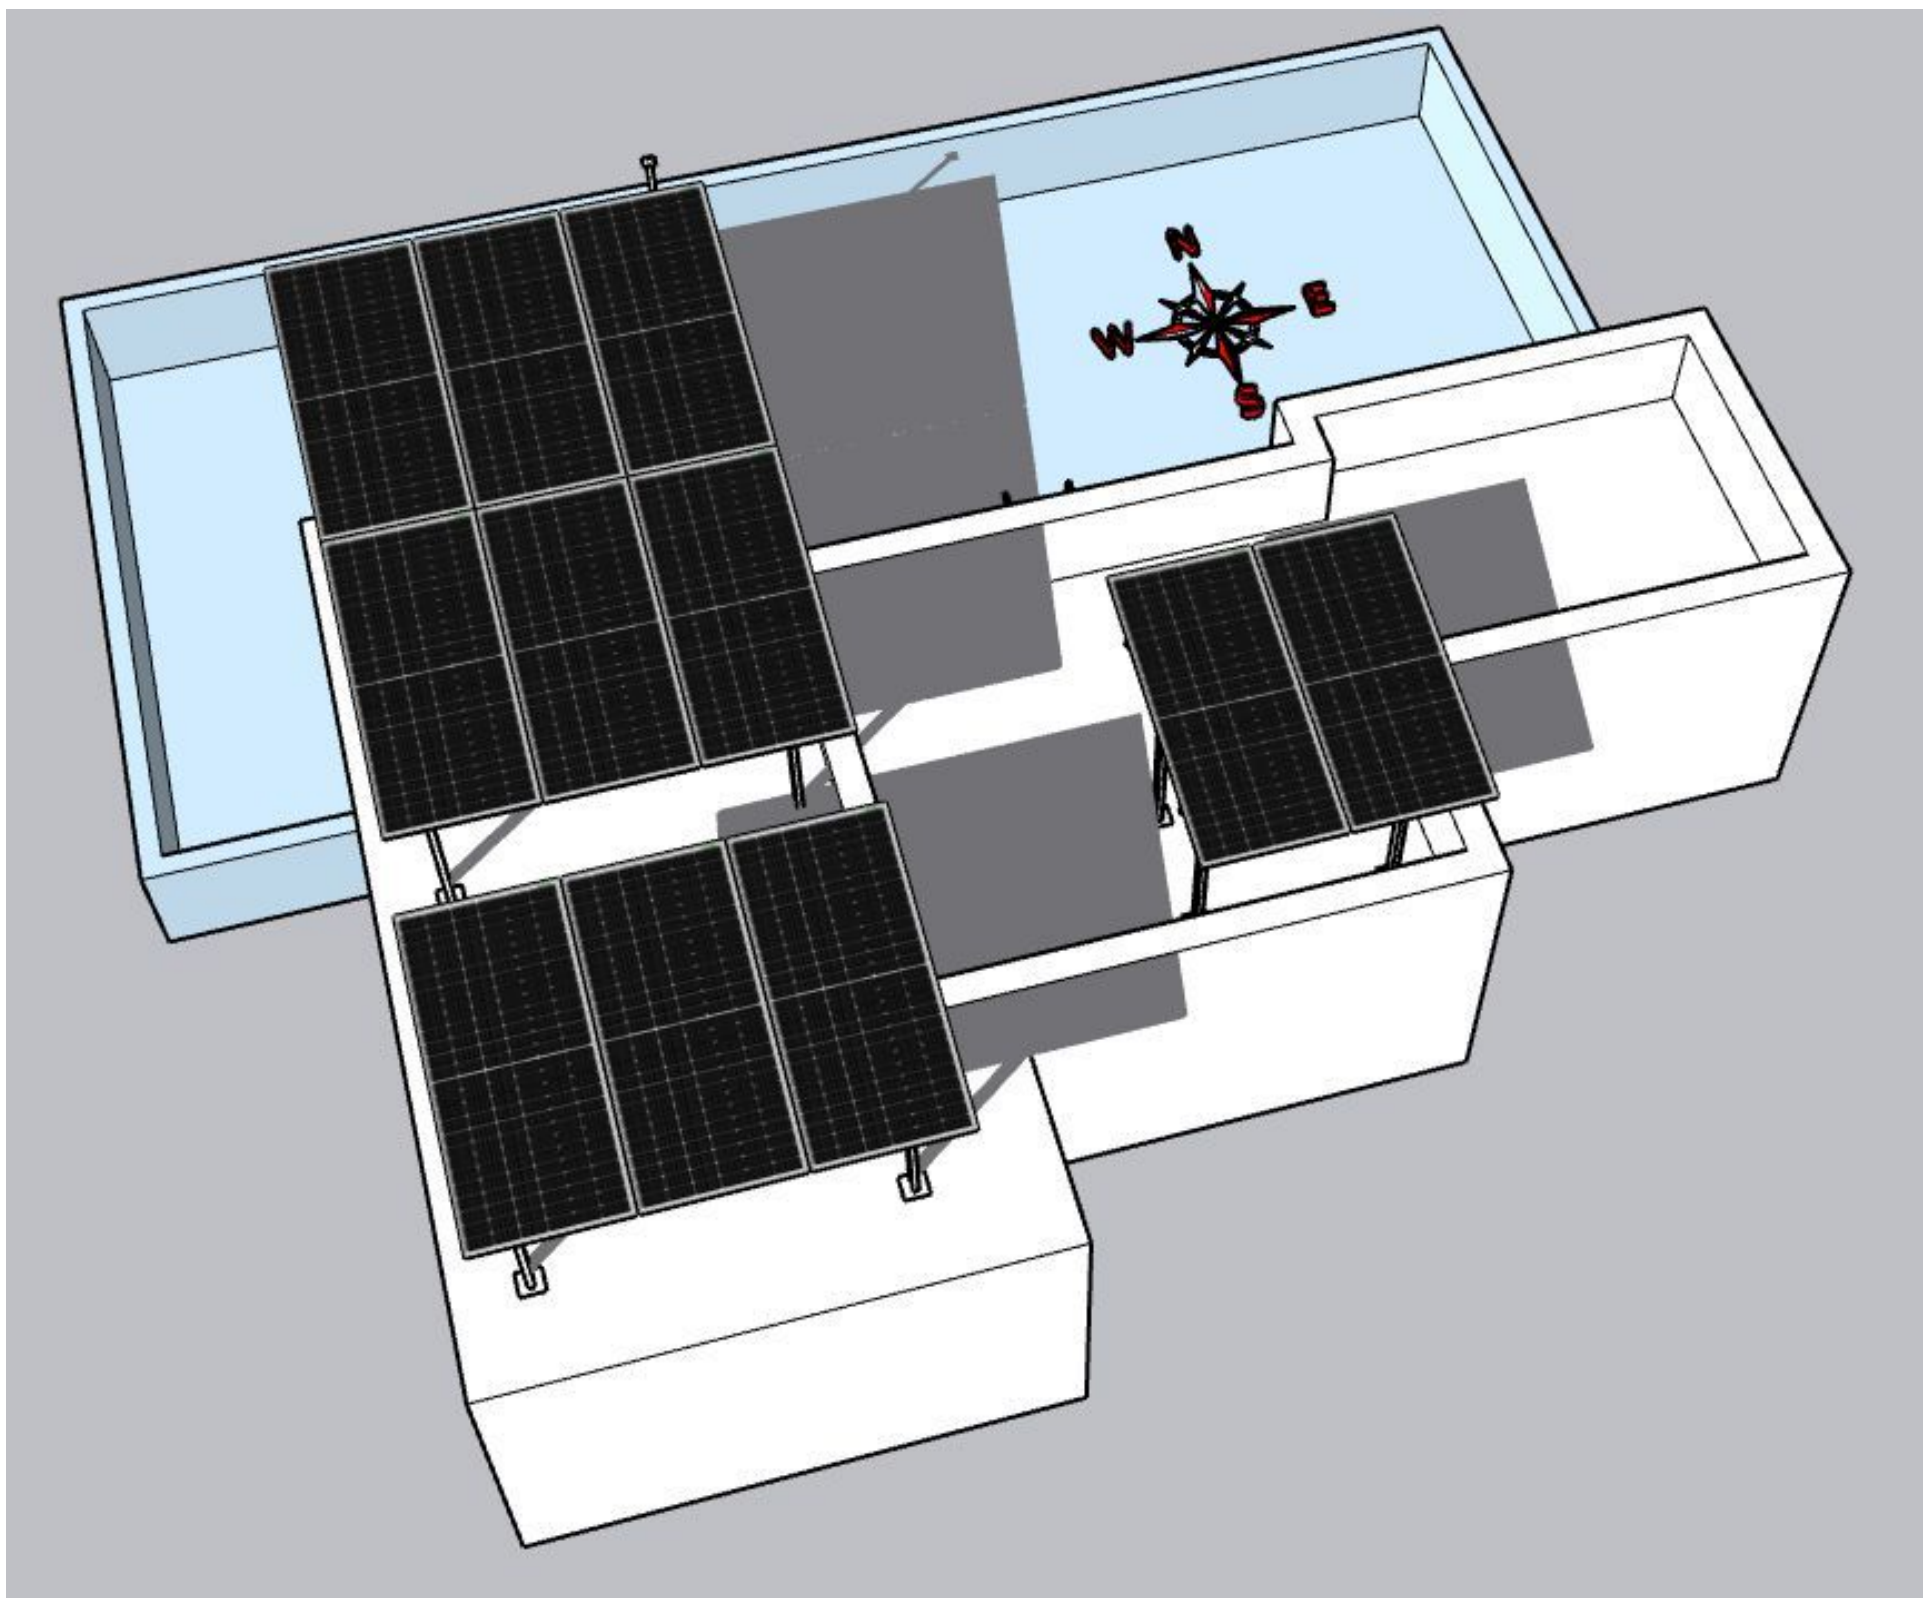

Shadow view (Nov 3pm)

OBSERVATIONS & RECOMMENDATIONS

EcoSoch Scope

#	Observation
1	Installation and commissioning of 6.82kWp On-grid solar power plant at the proposed premises.
2	The co-ordination and follow-up with BESCOM regarding solar connectivity till commissioning.
3	Providing an Elevated HDGI structure- 2m Front Leg with Drilling & only Base Plate Cement Covering.

Customer Scope

#	Observation
1	Providing an active Wi-Fi or LAN cable connection up to the inverter location.
2	The customer is responsible for arranging the reliable ladder provision to get access to the proposed solar panel installation area prior to the project's execution.
3	Relocating the solar water heater that exists at the terrace prior to the project's execution.

THANK YOU

Dear Naveen Mudgil,

Thank you for choosing EcoSoch Solar for your solar installation. We appreciate your trust in us and your commitment to sustainable energy. Our team is dedicated to ensuring a seamless installation experience and long-term performance of your solar system.

Should you have any questions or require further assistance, please do not hesitate to reach out to us.

Warm Regards,
Team EcoSoch

& Did You Know?

The Sun burns 600 million tonnes of hydrogen per second — and your panels get a share.

EcoSoch Solar Pvt. Ltd.
#940, Sha Arcade, 2nd Phase, NTI Layout, Kodigehalli, Bengaluru 560097
www.ecosoch.com | info@ecosoch.com