

Technical Site Visit Report

Prepared for: Madhan Thollabandi_Radiance Gardenia C108 Subsidy_4.88kWp_Optimizer - C-108, Radiance Gardenia,

PROJECT INFORMATION

Report Number	ESV-2026-0202
Project ID	90EFAD99
Project Name	Madhan Thollabandi_Radiance Gardenia C108 Subsidy_4.88kWp_Optimizer
Building Name	C-108, Radiance Gardenia,
Billing Name	Madhan Thollabandi_Radiance Gardenia C108 Subsidy_4.88kWp_Optimizer
Project Sector	Residential
Project Type	With Subsidy
Sales Lead	Govindaraju
Site Address	C-108, Radiance Gardenia, Chikkagubbi, Hennur, Bengaluru- 560077
GPS Coordinates	13.07879516860604, 77.6600472785681
Google Maps	https://www.google.com/maps?q=13.078795168606044,77.6600472785681
Visit Date	2026-09-02
Visited By	Sai
Revision	Rev 1

CLIENT INFORMATION

Client Name	Madhan Thollabandi
Contact	8007774039

PROJECT DETAILS

Solar Rooftop System Type	On-Grid
System Capacity (kWp)	4.88
Sanction Load (kW)	5
Module Make & Capacity	Premier DCR bifacial 610 Wp

Module Length (mm)	2382
Module Width (mm)	1134
Number of Panels	8
Inverter Type	SolarEdge
Inverter Brand	Solaredge 5kW 1 phase optimizer
Number of Inverters	1
Number of Optimizers	8
Mounting Structure Type	RCC Flat Roof

SITE INSPECTION CHECKLIST

General

#	Question	Answer	Notes
1	Can the delivery van/truck reach the material unloading point?	Yes	-
2	Are there any obstacles at the site that could hinder material lifting?	No	-
3	Where will the Inverter, DCDB, ACDB, Battery, etc. be located?	Inverter, DCDB, ACDB located near the Basement area	-
4	Is a canopy required for protecting the Inverters/ACDB/DCDB?	No	-
5	Did you discuss the location of the earth pits with the customer?	Earth pits are located near the garden area.	-
6	Where is the Internet Router located?	Customer scope	-
7	What's the Wi-Fi strength of the router near to the String inverter/Envoy?	N/A	-
8	Did you pin the site location in your WhatsApp when you were at the site?	Yes	-

Roof Details

#	Question	Answer	Notes
1	What type of roof is present at the site?	RCC Flat Roof	-
2	Are there any obstructions on the roof that could affect the solar installation?	No	-
3	What is the angle of the panels? (in degrees)	10	-
4	In case of sloped roof, what is the slope angle of the roof? (in degrees)	N/A	-
5	On how many roofs at the site are we installing solar?	2	-
6	If it is a Tiled roof, what is underneath the tiles?	N/A	-
7	If it is a Tiled roof with MS or Wooden rafters, is it Single-tiled or Double-tiled?	N/A	-

#	Question	Answer	Notes
8	What type of mounting structure is planned?	Elevated	4 panels of HDGI with 1.5m front leg and remaining 4 Panels on the existing MS fabrication structure.
9	What is the orientation of the solar panels?	["South"]	-
10	How can the roof be accessed?	Staircase	-
11	Is the building currently under construction?	No	-
12	In an under-construction building, are existing conduit pipes available for AC, DC cables, and earthing?	N/A	-
13	What is the height of the building and how many floors does it have?	Height of the building is 14m; G+2+Headroom.	-
14	Is the site photo matching with the building description?	Yes	-
15	Is there an overhead HT line passing within a 10-meter radius of the site?	No	-

Residential / Electrical

#	Question	Answer	Notes
1	What type of energy meter is currently installed?	Phase: Three Phase, Type: Digital	-
2	Is the Meter cubicle photo matching with the previous answer?	Yes	-
3	Has the termination point in the Main meter panel been identified?	Yes	-
4	Is the Termination Point easily visible or sealed?	Visible	-
5	Is a Lightning Arrestor (LA) already available at the site?	No	-
6	Is space available for CT within Energy meter panel?	N/A	-
7	In case of an Enphase system, is the distance between the farthest micro-inverter and IQ Gateway > 50m?	N/A	-
8	Provide details of the existing CT ratings (if applicable).	N/A	-
9	In Main meter panel, is empty space available for solar meter?	No	-
10	In Main meter panel, is empty space available to house the Enphase accessories or ACDB components?	N/A	-
11	Is there space available to dig DC, AC and LA earth pits?	Yes	-
12	In case of elevated structures, is an LA extension provided at the far end?	Yes	-
13	In case of elevated structures, is it with or without grouting?	With Grouting	-
14	Are there any challenges with respect to Installation and Maintenance activities?	No	-
15	Are there any safety risks associated with accessing the roof for installation?	No	-
16	Is space present in rooftop to store the panels?	Horizontally sleeping	-
17	In case of sloped roof MS structure, provide the dimension of rafter to rafter, purlin to purlin.	N/A	-
18	Is ventilation available in the battery location?	N/A	-
19	Should the Inverters/ACDB/DCDB be installed on a metal grill or wall mount?	Inverters/ACDB/	-

#	Question	Answer	Notes
		DCDB be installed on a wall mount	
20	Provide the dimensions for solar meter cubicle placement (L x W of wall).	length: 1000, width: 1000	-
21	Provide the dimension for earth pits location (L x W of available space).	length: 1000, width: 1000	-
22	Is LAN cable under customer scope?	No	-
23	Is there any shadow that affects the solar installation?	No	-
24	Is there any trench work to be done to carry the AC cable to the meter location?	No	-

PHOTO DOCUMENTATION


Cable Routing Legend

Legend	Description
	Proposed PV Module Array
	Main Meter Location
	Solar Meter
	Battery
	Inverter
	Other Equipment
	DC Cable
	AC Cable
	Material Shifting
	DC Earthing Cable
	AC Earthing Cable
	LA Cable
	DC Earth Pit
	AC Earth Pit
	LA Pit
	LA

Building Exterior



Material Delivery Route

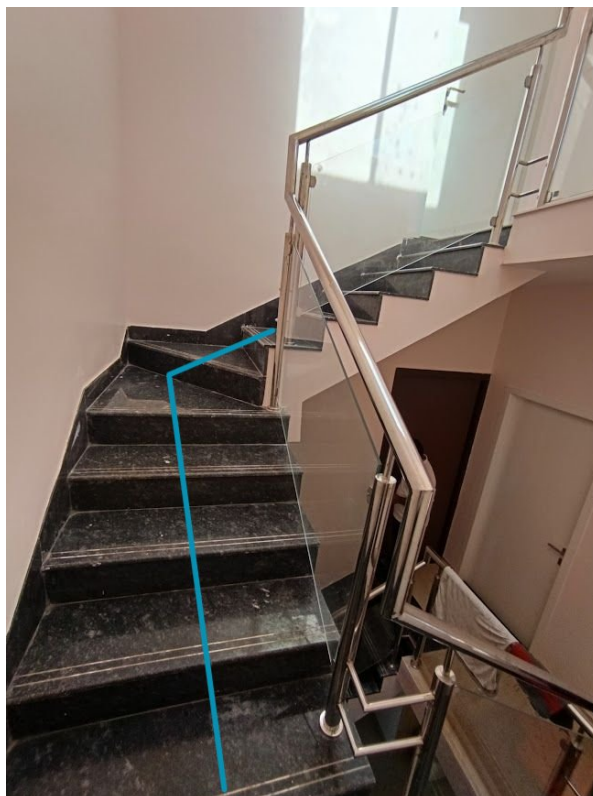


This route will carry the small items



This route will carry the large items (like panels)

Staircase Details

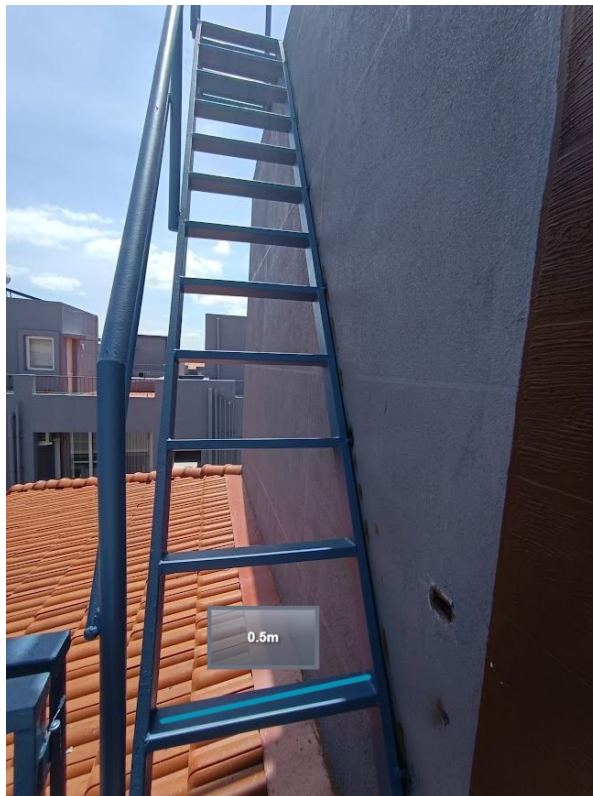


Meter Box




Material Storage




Site Layout - Top View

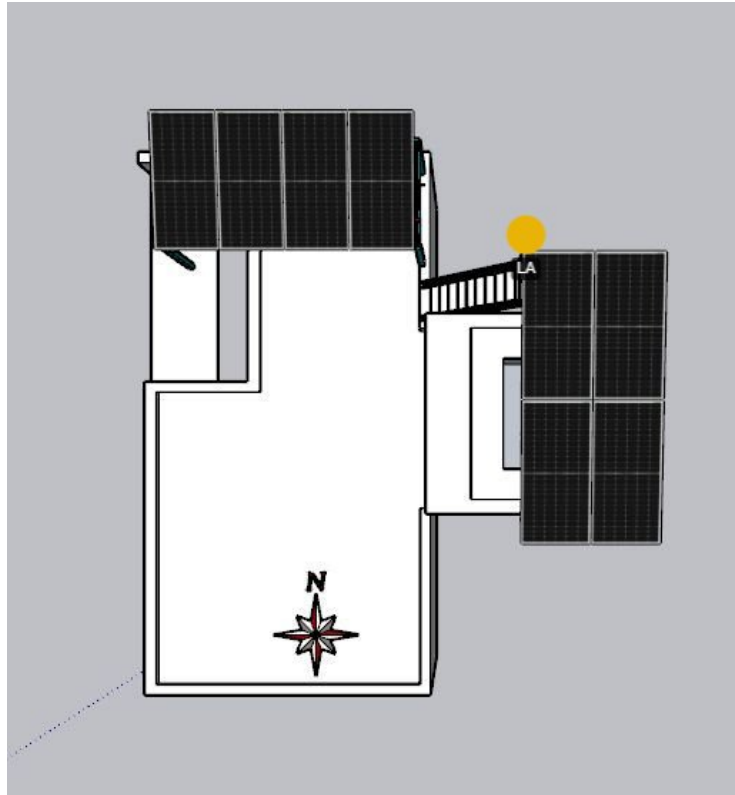


Top view

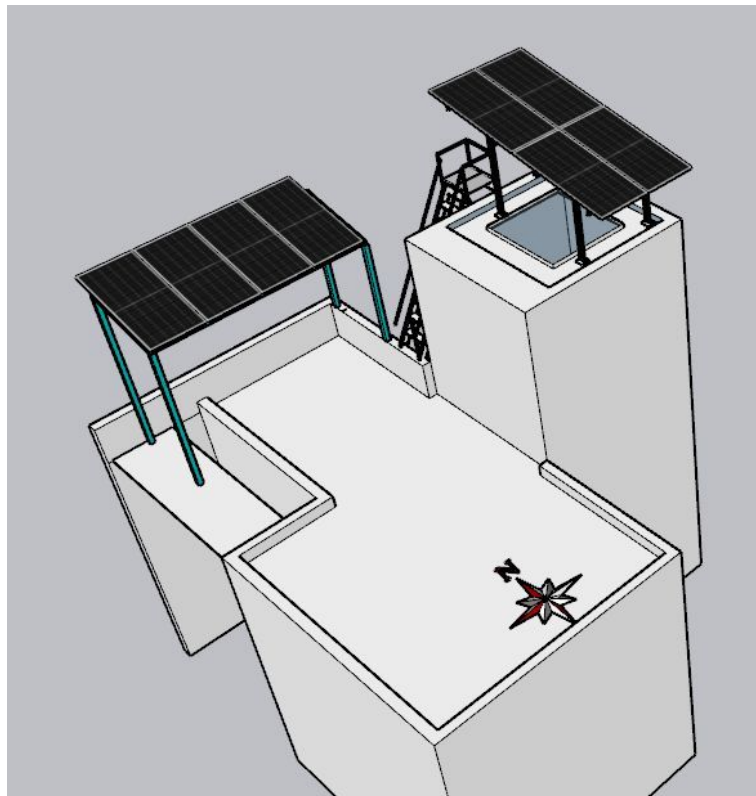


Side view (1)

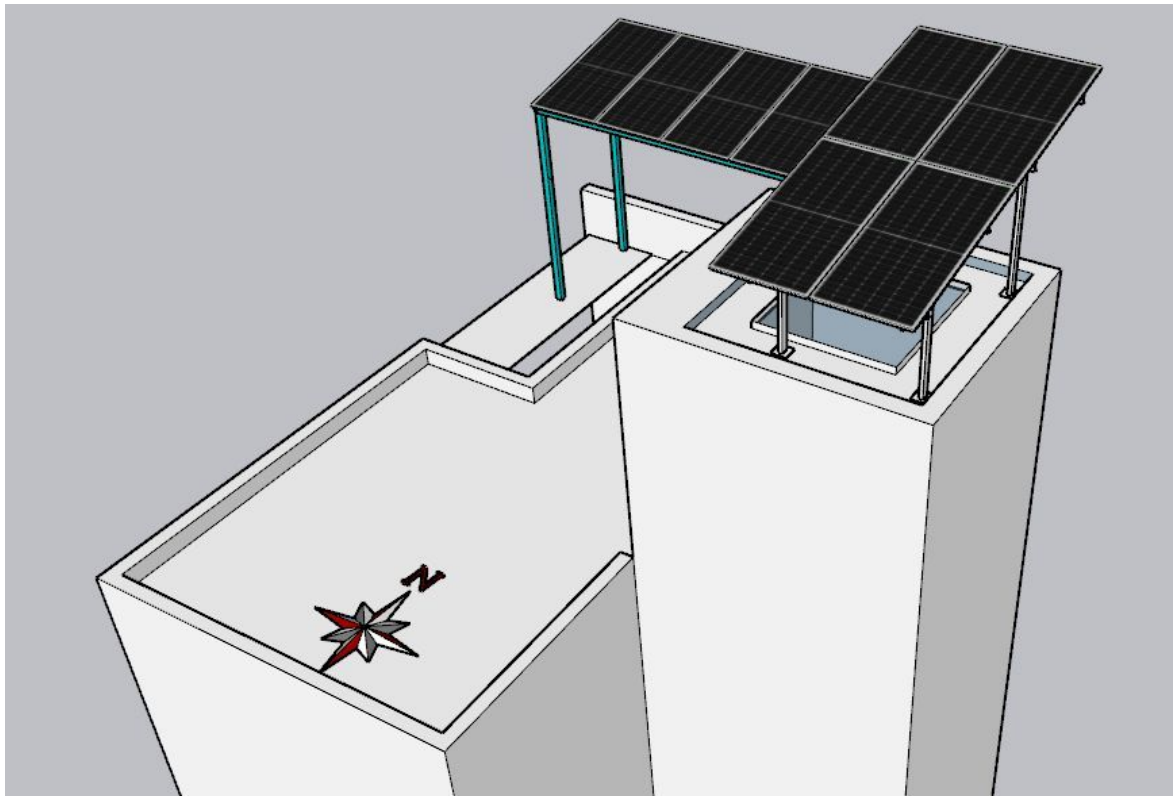


Side view (2)

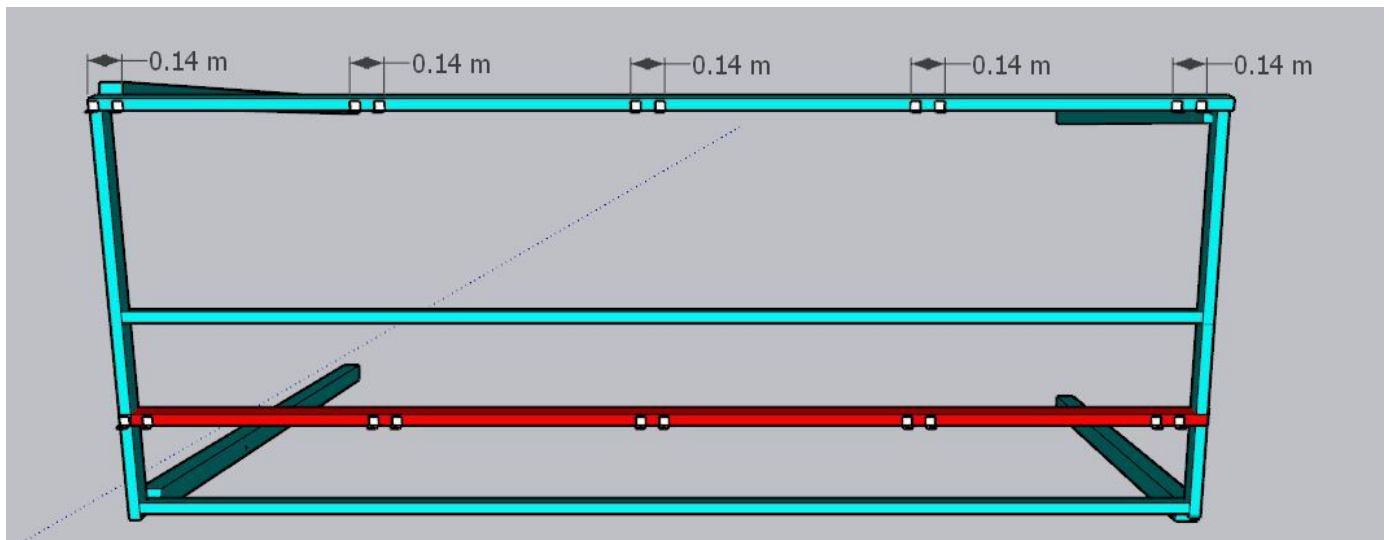


Structure details (1)

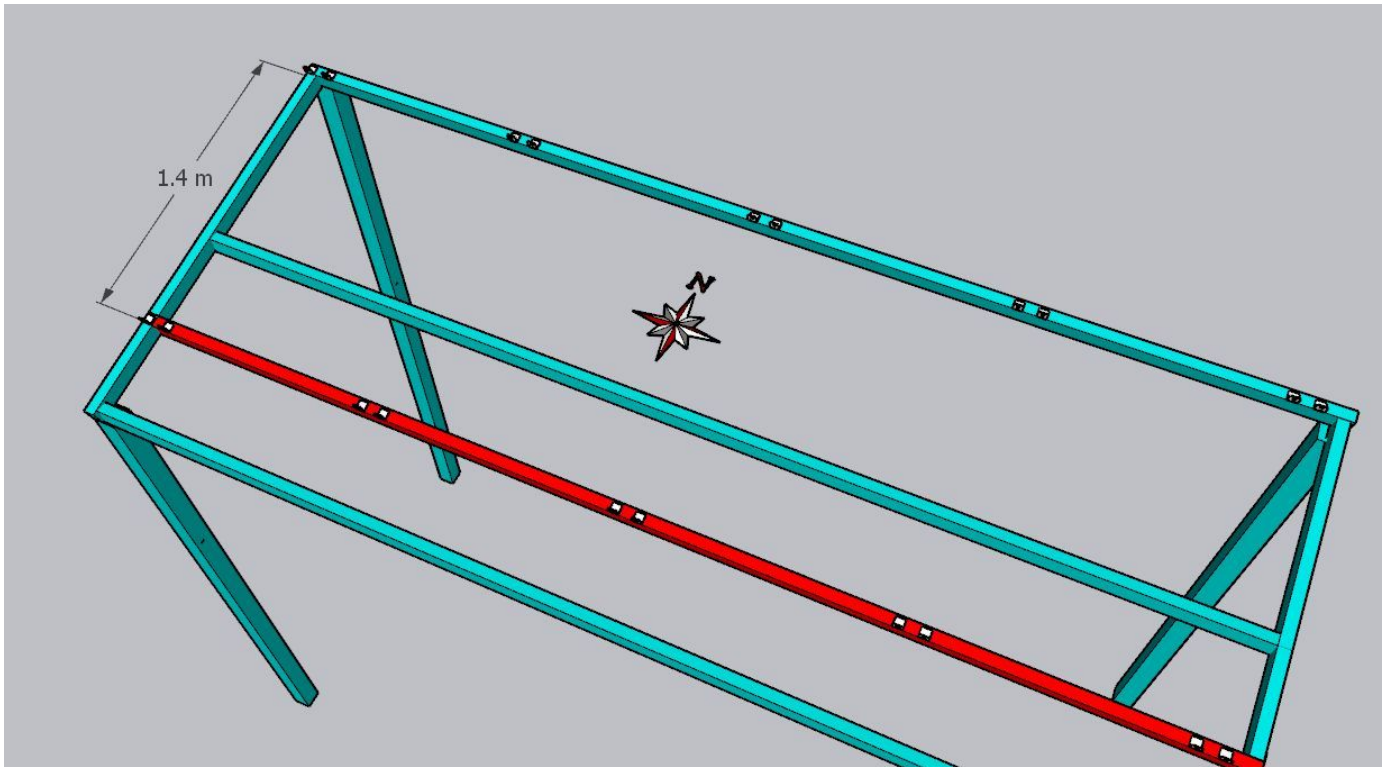


Structure details (3)

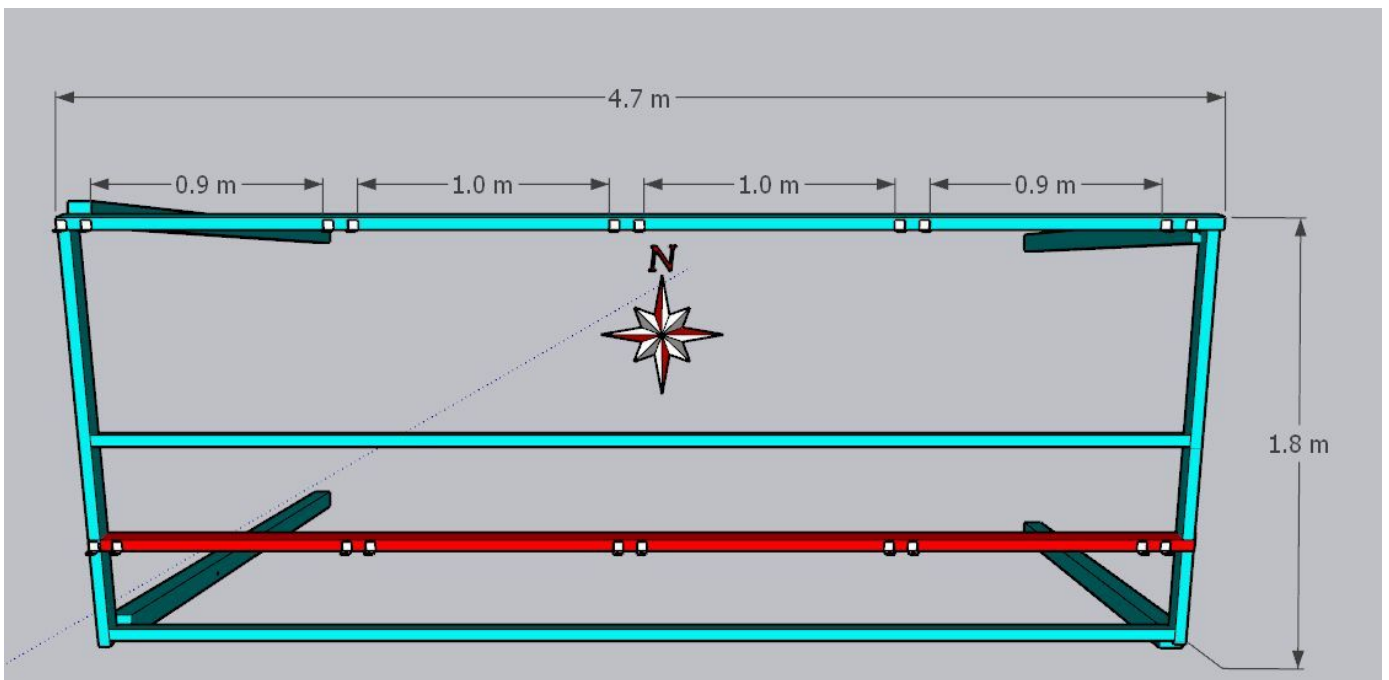


Structure details (4)

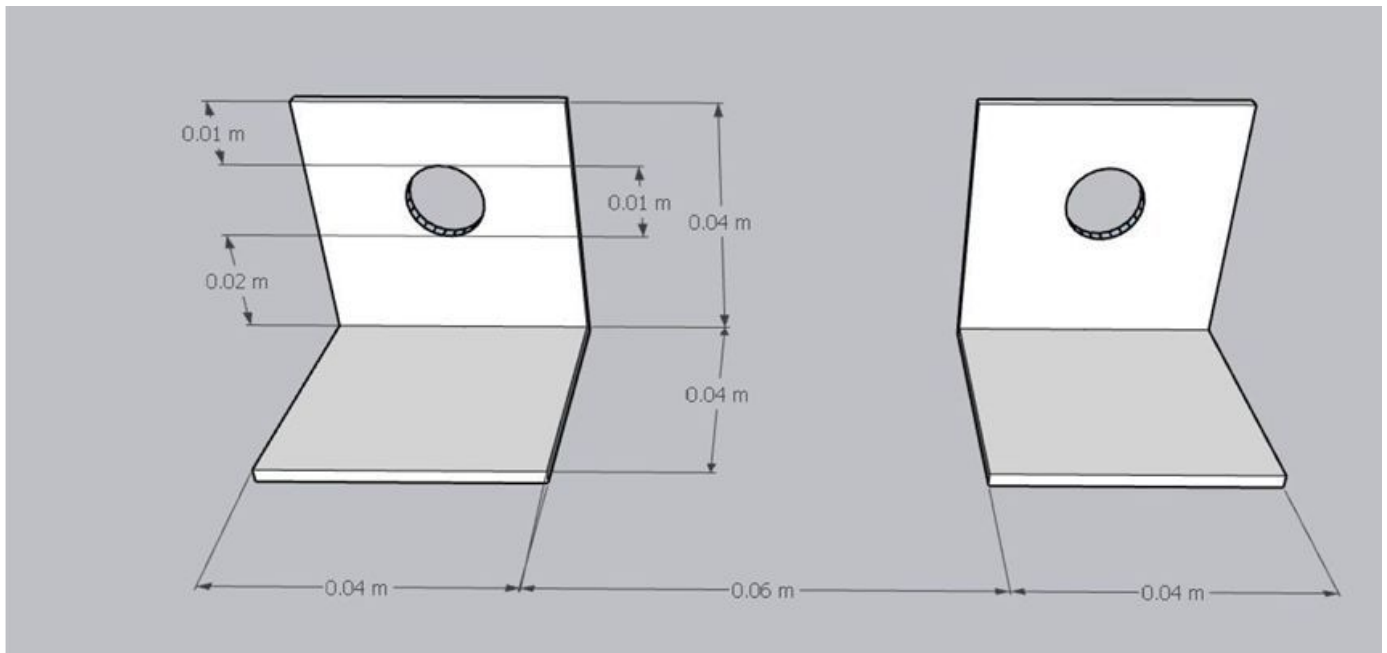

Structure details (2)

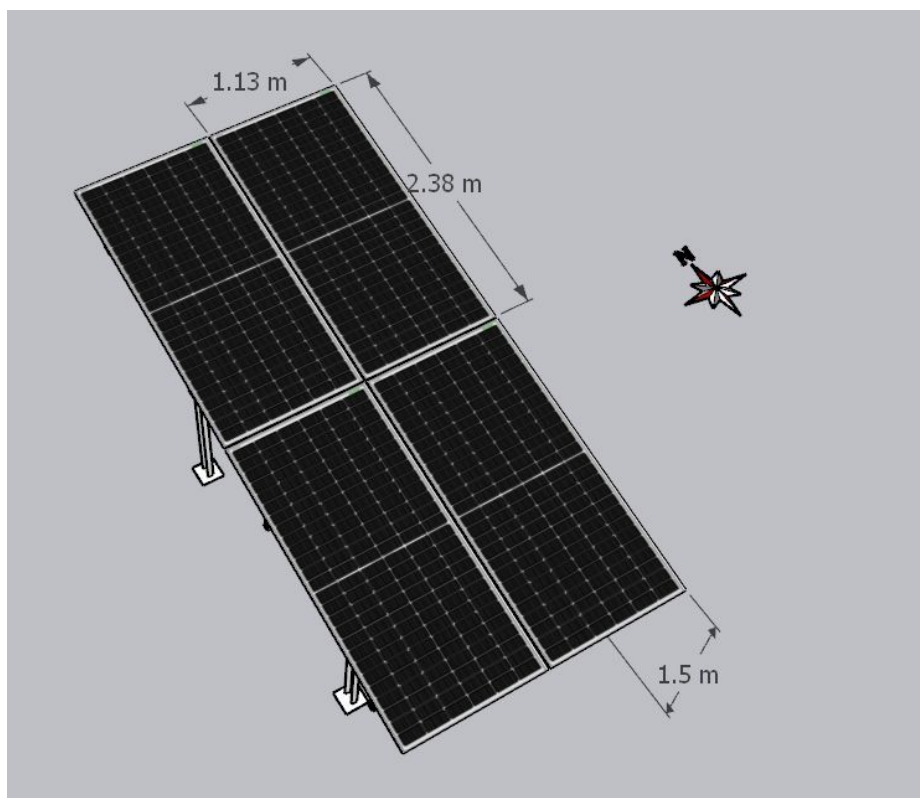

Panel dimensions

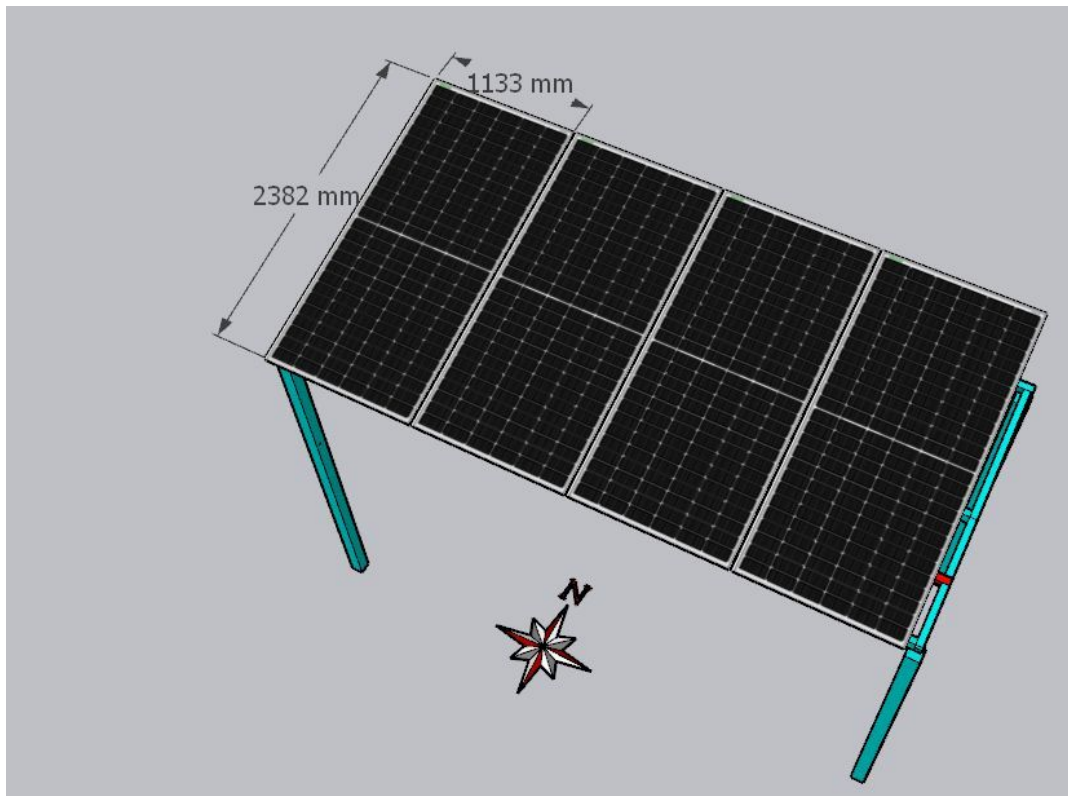

Panel dimensions

Proposed PV Area







Cable Routing




One hole has to be made to run the DC cables till the inverter location

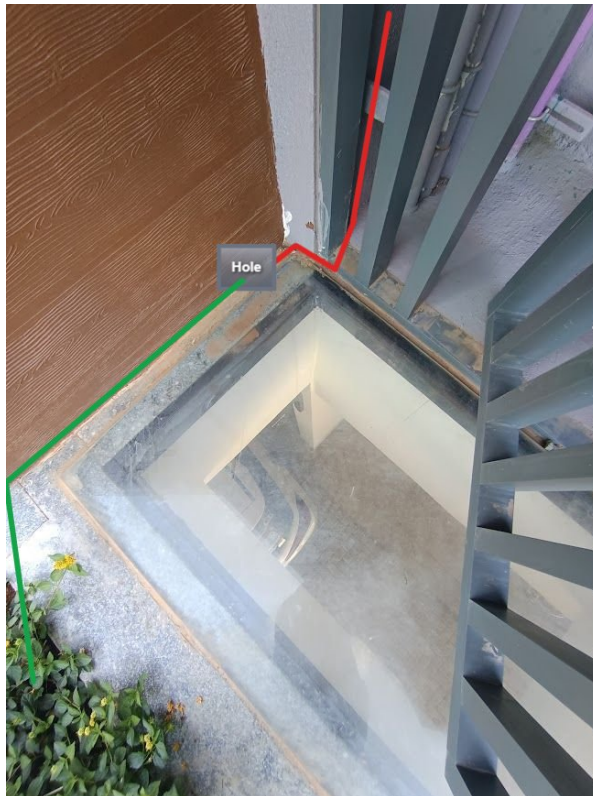

One hole has to be made to run the DC and AC cables

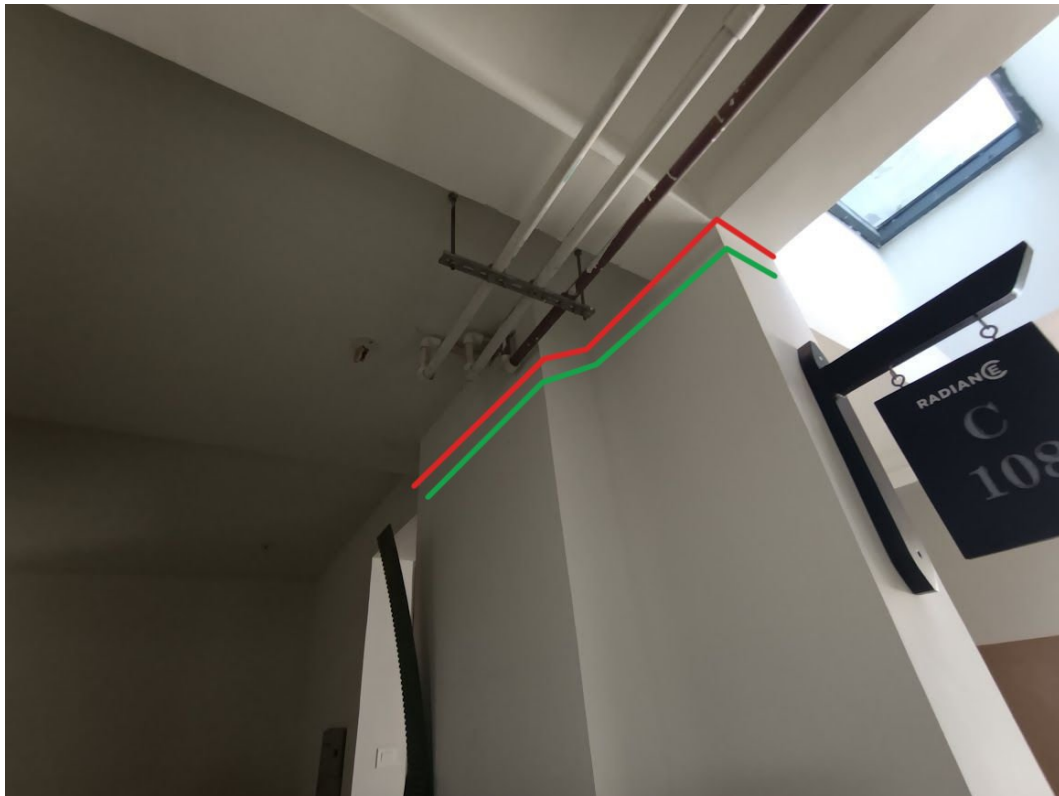

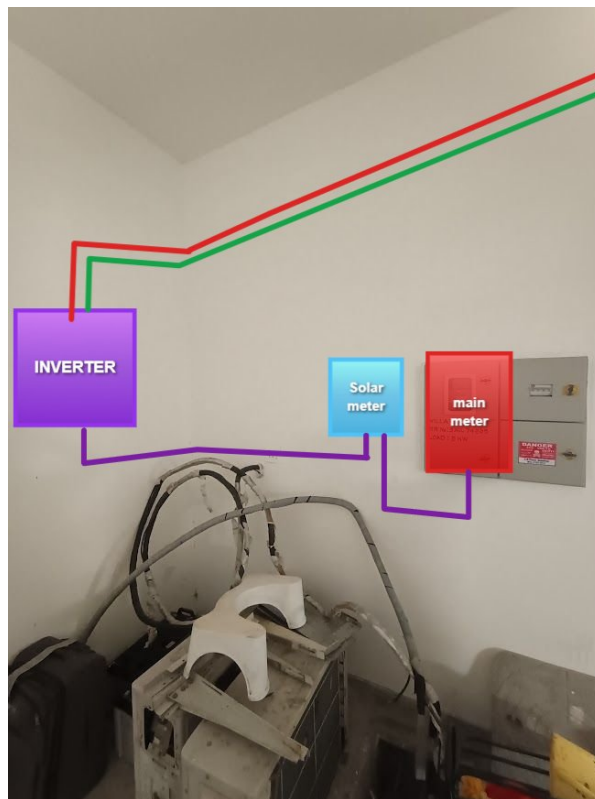



Earth Pit Location





OBSERVATIONS & RECOMMENDATIONS

EcoSoch Scope

#	Observation
1	As per the customer's suggestion, the routing, cable earthing, inverter location and also solar meter location have been considered.

Customer Scope

#	Observation
1	Wi-Fi is upto solar meter is under customer scope
2	MS fabrication under customer scope

THANK YOU

Dear Madhan Thollabandi,

Thank you for choosing EcoSoch Solar for your solar installation. We appreciate your trust in us and your commitment to sustainable energy. Our team is dedicated to ensuring a seamless installation experience and long-term performance of your solar system.

Should you have any questions or require further assistance, please do not hesitate to reach out to us.

Warm Regards,
Team EcoSoch

& Did You Know?

The Sun burns 600 million tonnes of hydrogen per second — and your panels get a share.

EcoSoch Solar Pvt. Ltd.

#940, Sha Arcade, 2nd Phase, NTI Layout, Kodigehalli, Bengaluru 560097

www.ecosoch.com | info@ecosoch.com