

Technical Site Visit Report

Prepared for: Vivek Gubbi Ajithkumar_HSR Layout_Non Subsidy_9.8kWp_String

PROJECT INFORMATION

Report Number	ESV-2026-0147
Project ID	7DB6ED5A
Project Name	Vivek Gubbi Ajithkumar_HSR Layout_Non Subsidy_9.8kWp_String
Project Sector	Residential
Project Type	Without Subsidy
Sales Lead	Mahantayya
Site Address	#53, Rathnathraya, 18th cross 31st main road, 2 sector HSR Layout Bengaluru - 560102.
GPS Coordinates	12.910136, 77.653442
Google Maps	https://www.google.com/maps?q=12.910136,77.653442
Visit Date	2026-06-15
Visited By	ABILASH N K
Revision	Rev 0

CLIENT INFORMATION

Client Name	Vivek Gubbi Ajithkumar
Contact	9480141232

PROJECT DETAILS

Solar Rooftop System Type	On-Grid
System Capacity (kWp)	9.80
Sanction Load (kW)	10
Module Make & Capacity	Waaree Bi-facial Non DCR Topcon, 700 Wp
Module Length (mm)	2384
Module Width (mm)	1303

Number of Panels	14
Inverter Type	String
Inverter Brand	Deye (SUN-10K-G05-P) 10kW 3 Ph
Number of Inverters	1
Mounting Structure Type	Sheet Roof

SITE INSPECTION CHECKLIST

General

#	Question	Answer	Notes
1	Can the delivery van/truck reach the material unloading point?	Yes	-
2	Are there any obstacles at the site that could hinder material lifting?	No	-
3	Where will the Inverter, DCDB, ACDB, Battery, etc. be located?	Inverter, DCDB and ACDB can be mounted on the wall at the 4th floor open room available at the terrace area.	-
4	Is a canopy required for protecting the Inverters/ACDB/DCDB?	No	-
5	Did you discuss the location of the earth pits with the customer?	Yes, Discussed with the customer and finalised the location for earthing.	-
6	Where is the Internet Router located?	4th floor	-
7	What's the Wi-Fi strength of the router near to the String inverter/Envoy?	3 bars	-
8	Did you pin the site location in your WhatsApp when you were at the site?	Yes	-

Roof Details

#	Question	Answer	Notes
1	What type of roof is present at the site?	RCC Flat Roof	Presently, the roof is RCC. But the customer is planning to fabricate an MS structure with a corrugated sheet roof. (The 10 nos. of PV modules will be flush-mounted on the sheet roof). The remaining 4 nos. of PV modules have to be installed on the MS structure to be fabricated on the existing water tank area.
2	Are there any obstructions on the roof that could affect the solar installation?	details: At the water tank area where the 4 PV modules are	-

#	Question	Answer	Notes
		planned to be installed, water tanks might have to be repositioned at the time of MS structure fabrication.	
3	What is the angle of the panels? (in degrees)	7	-
4	In case of sloped roof, what is the slope angle of the roof? (in degrees)	7	-
5	On how many roofs at the site are we installing solar?	1	Same terrace floor, but 2 installation roofs.
6	If it is a Tiled roof, what is underneath the tiles?	N/A	-
7	If it is a Tiled roof with MS or Wooden rafters, is it Single-tiled or Double-tiled?	N/A	-
8	What type of mounting structure is planned?	Elevated	The two installation roofs which are under the customer's scope: 1) Roof 1: MS structure with corrugated roof – 10 Nos. of PV modules. 2) Roof 2: MS structure with aluminium mini rail – 4 Nos. of PV modules.
9	What is the orientation of the solar panels?	["South"]	-
10	How can the roof be accessed?	Staircase	-
11	Is the building currently under construction?	No	-
12	In an under-construction building, are existing conduit pipes available for AC, DC cables, and earthing?	N/A	-
13	What is the height of the building and how many floors does it have?	20 Metres. (G + 4 + head room)	-
14	Is the site photo matching with the building description?	Yes	-
15	Is there an overhead HT line passing within a 10-meter radius of the site?	No	-

Residential / Electrical

#	Question	Answer	Notes
1	What type of energy meter is currently installed?	Phase: Three Phase, Type: Digital, If 3-phase: LT w/o CT (5 - 34.999)	-
2	Is the Meter cubicle photo matching with the previous answer?	Yes	-
3	Has the termination point in the Main meter panel been identified?	Yes	-
4	Is the Termination Point easily visible or sealed?	Visible	-
5	Is a Lightning Arrestor (LA) already available at the site?	Yes	One set of conventional LAs is available on the same terrace, which belongs to the ENPHASE solar plant installed by EcoSoch.
6	Is space available for CT within Energy meter panel?	N/A	-
7	In case of an Enphase system, is the distance between the farthest micro-inverter	N/A	-

#	Question	Answer	Notes
	and IQ Gateway > 50m?		
8	Provide details of the existing CT ratings (if applicable).	N/A	-
9	In Main meter panel, is empty space available for solar meter?	No	A separate meter cubicle has to be provided for the solar meter.
10	In Main meter panel, is empty space available to house the Enphase accessories or ACDB components?	N/A	-
11	Is there space available to dig DC, AC and LA earth pits?	Yes	-
12	In case of elevated structures, is an LA extension provided at the far end?	No	-
13	In case of elevated structures, is it with or without grouting?	Not Applicable	The elevated MS structure is under the customer's scope.
14	Are there any challenges with respect to Installation and Maintenance activities?	No	-
15	Are there any safety risks associated with accessing the roof for installation?	No	-
16	Is space present in rooftop to store the panels?	Vertically leaning against the wall	-
17	In case of sloped roof MS structure, provide the dimension of rafter to rafter, purlin to purlin.	N/A	-
18	Is ventilation available in the battery location?	N/A	-
19	Should the Inverters/ACDB/DCDB be installed on a metal grill or wall mount?	The solar meter cubicle has to be grill-mounted at the ground floor, near the existing LT panel (Very next to the existing solar meter cubicle of the existing solar system)	-
20	Provide the dimensions for solar meter cubicle placement (L x W of wall).	length: 600, width: 400	The solar meter cubicle has to be grill-mounted at the ground floor, near the existing LT panel (Very next to the existing solar meter cubicle of the existing solar system)
21	Provide the dimension for earth pits location (L x W of available space).	length: 3000, width: 2000	-
22	Is LAN cable under customer scope?	Yes	-
23	Is there any shadow that affects the solar installation?	No	-
24	Is there any trench work to be done to carry the AC cable to the meter location?	N/A	-



PHOTO DOCUMENTATION



Cable Routing Legend

Legend	Description
	Proposed PV Module Array
	Main Meter Location
	Solar Meter
	Battery
	Inverter
	Other Equipment
	DC Cable
	AC Cable
	Material Shifting
	DC Earthing Cable
	AC Earthing Cable
	LA Cable
	DC Earth Pit
	AC Earth Pit
	LA Pit
	LA

Site Layout - Top View



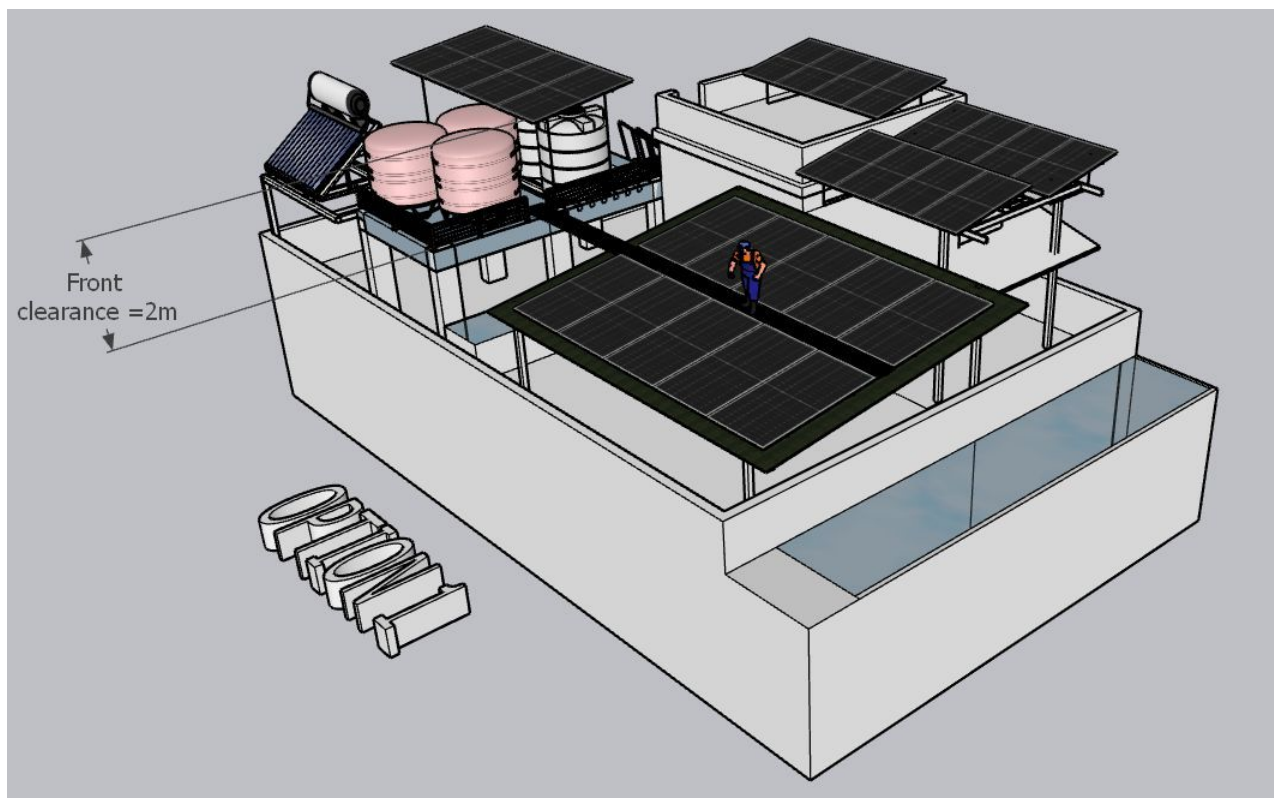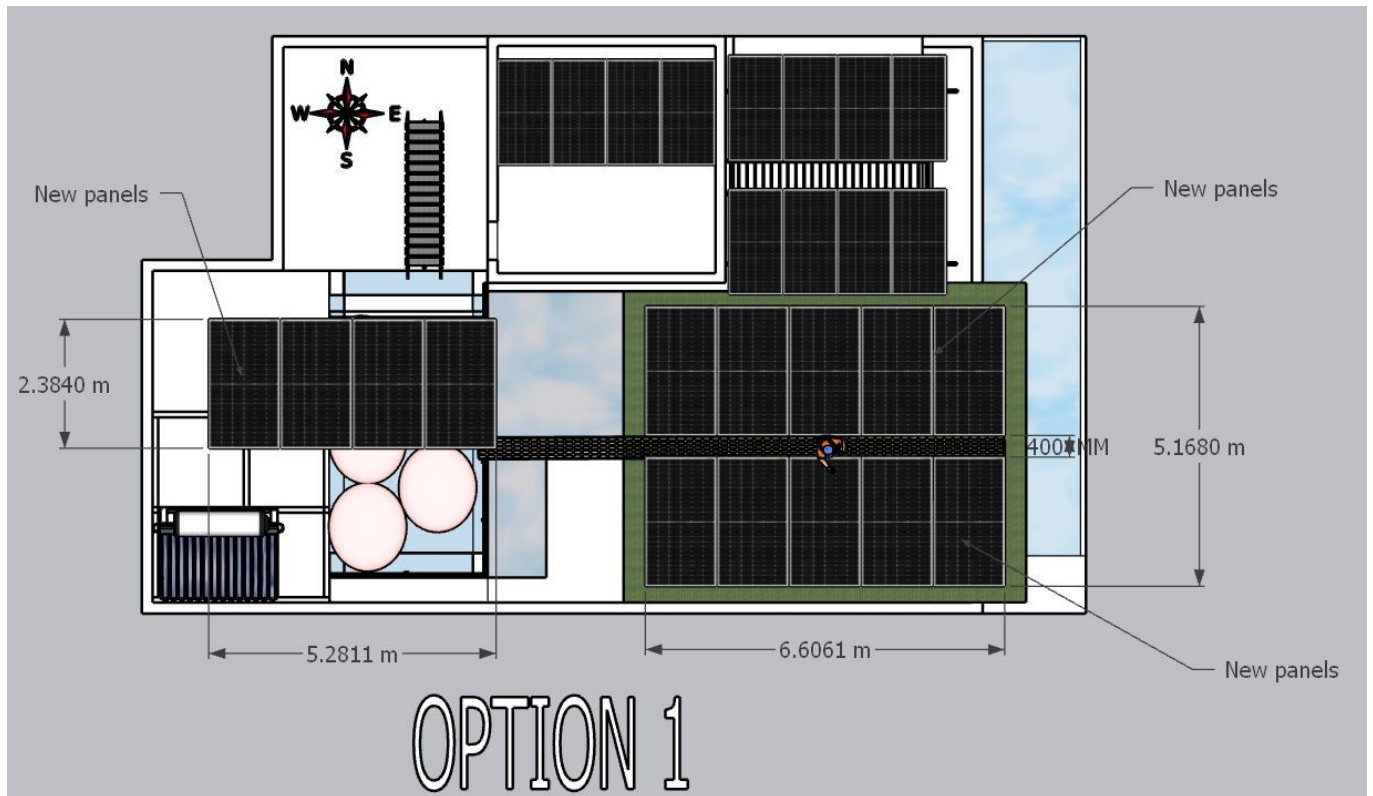

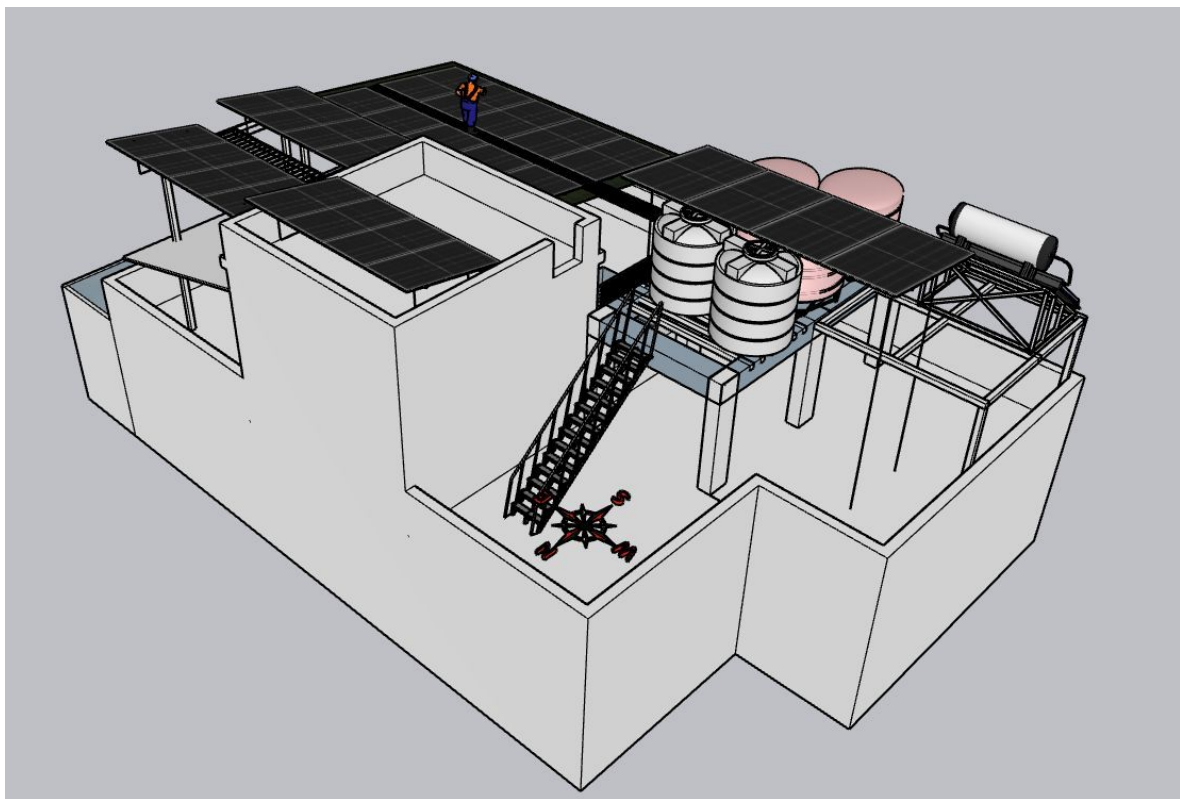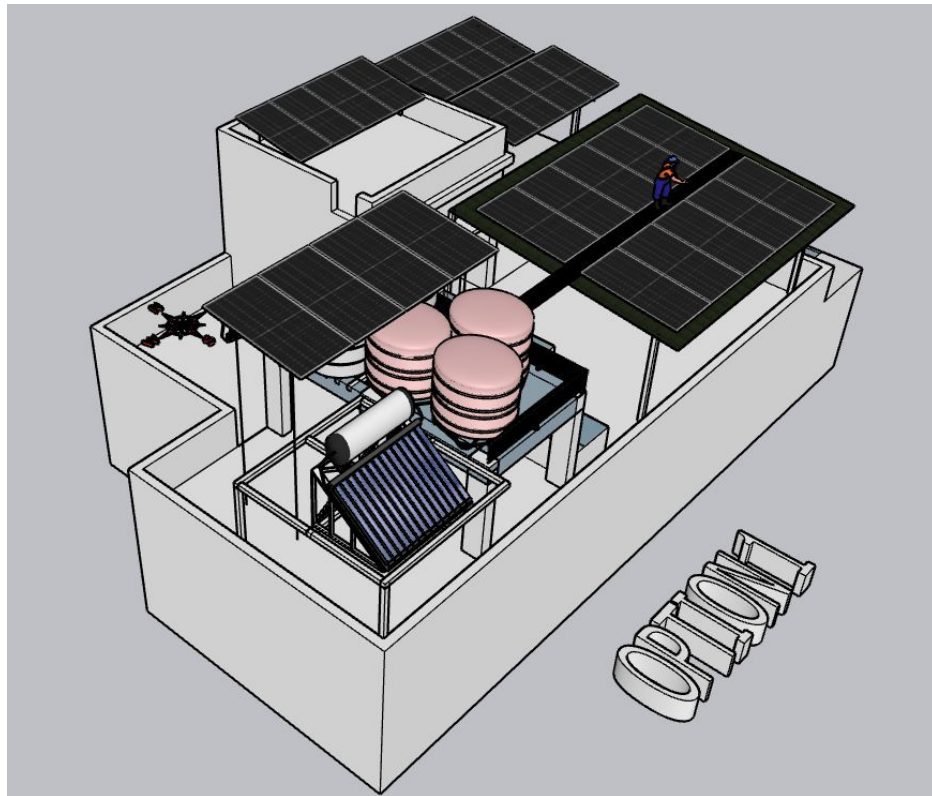

Building Exterior



Material Delivery Route



Heavy materials such as PV modules can be shifted over the side wall of the building.



Light weight materials can be shifted to the terrace via the inner staircase.



Moving towards the inner staircase entry point.



Staircase begins here.



Follow the staircase way until reaching the 4th floor



Reaching the 4th floor and move towards the terrace




The materials reaching the terrace can be shifted to the shelter under the tiled roof as shown.


Staircase Details



Staircase width: 900 mm


Proposed PV Area

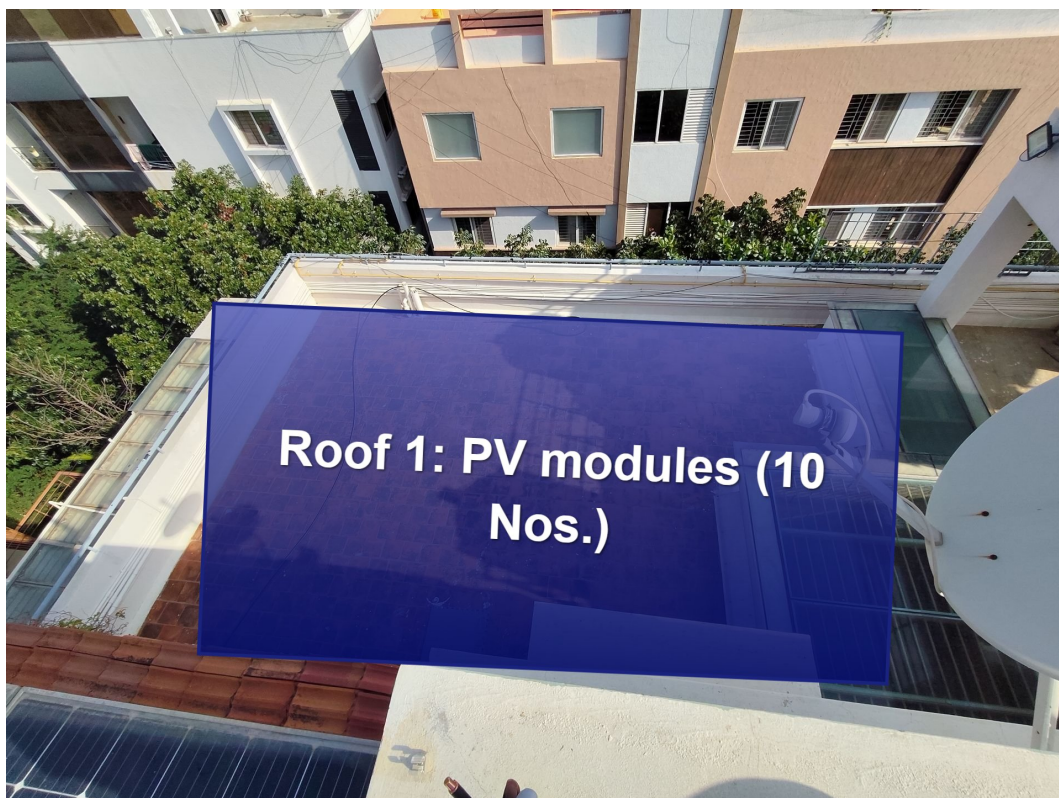

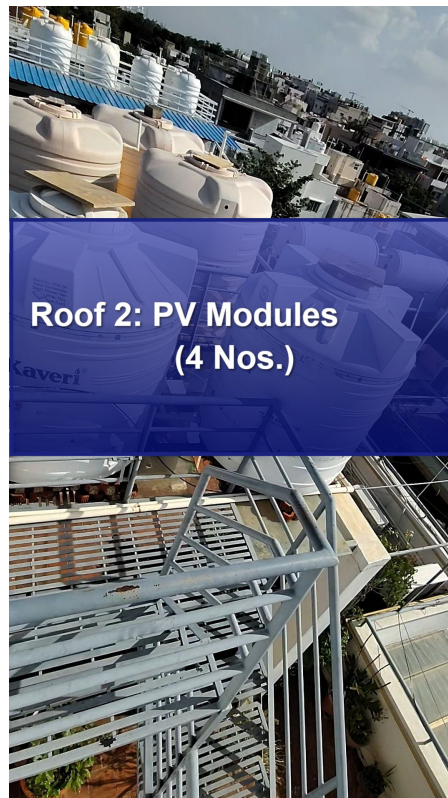


Cable Routing



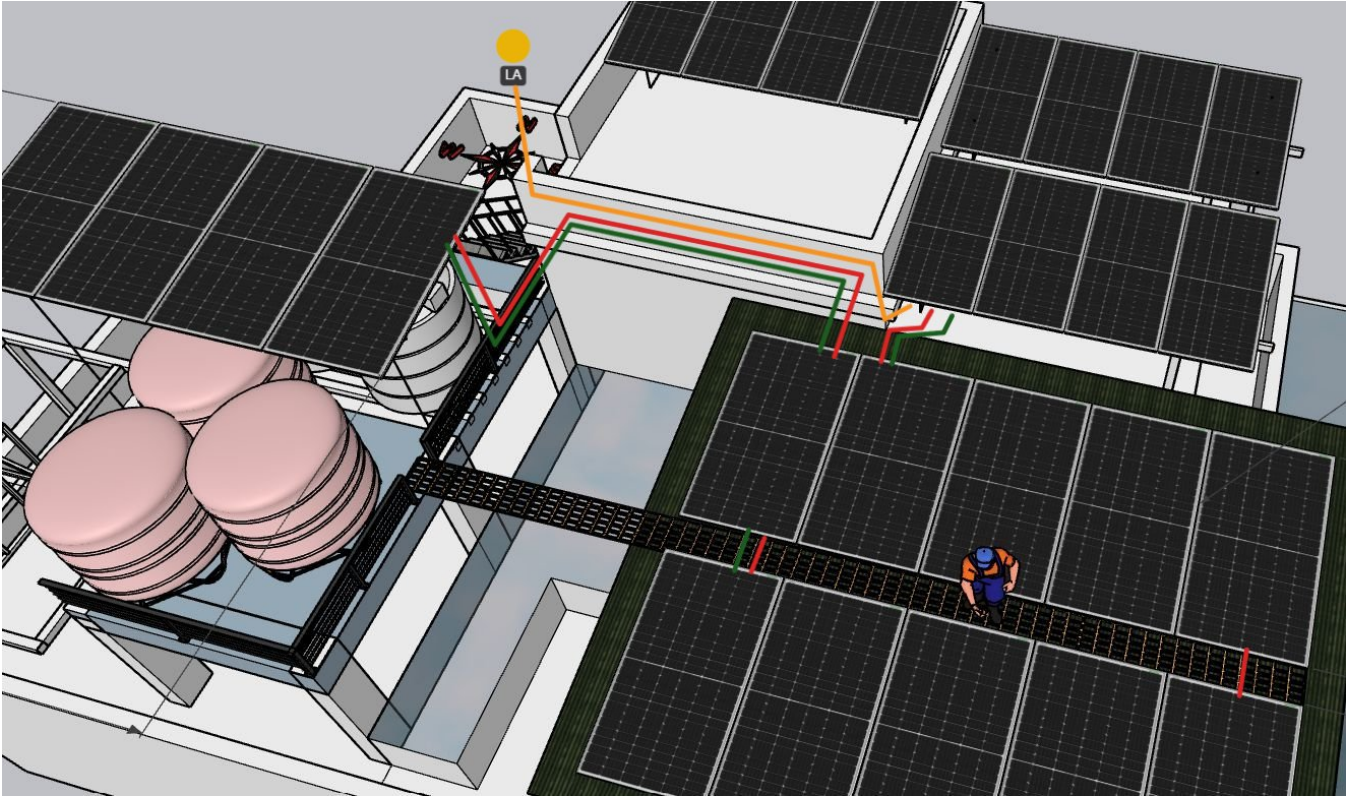



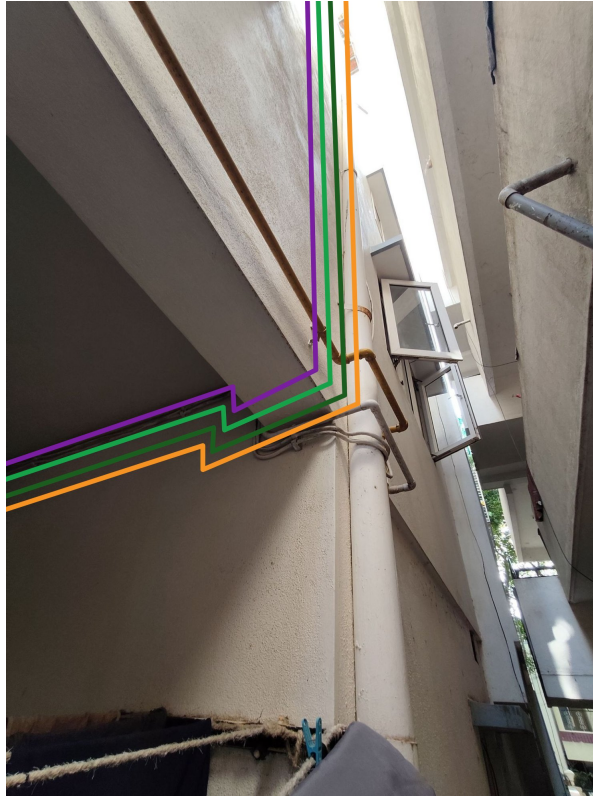



Meter Box





OBSERVATIONS & RECOMMENDATIONS

EcoSoch Scope

#	Observation
1	Installation and commissioning of 9.8kWp, On-grid solar power plant at the proposed premises.
2	The co-ordination and follow-up with BESCOM regarding solar connectivity till commissioning.

Customer Scope

#	Observation
1	Providing an active Wi-Fi or LAN cable connection up to the inverter location.
2	Fabrication of MS structure for the installation as per the design document provided.

THANK YOU

Dear Vivek Gubbi Ajithkumar,

Thank you for choosing EcoSoch Solar for your solar installation. We appreciate your trust in us and your commitment to sustainable energy. Our team is dedicated to ensuring a seamless installation experience and long-term performance of your solar system.

Should you have any questions or require further assistance, please do not hesitate to reach out to us.

Warm Regards,
Team EcoSoch

& Did You Know?

The Sun burns 600 million tonnes of hydrogen per second — and your panels get a share.

EcoSoch Solar Pvt. Ltd.

#940, Sha Arcade, 2nd Phase, NTI Layout, Kodigehalli, Bengaluru 560097

www.ecosoch.com | info@ecosoch.com