

Technical Site Visit Report

Prepared for: Saqeeb Ulla Shariff_Jayanagara Subsidy_3.07kWp_Microinverter (IQ Series) - #25/5 DAR-US- SALAM HABIB

PROJECT INFORMATION

Report Number	ESV-2026-0173
Project ID	81D1EE3E
Project Name	Saqeeb Ulla Shariff_Jayanagara Subsidy_3.07kWp_Microinverter (IQ Series)
Building Name	#25/5 DAR-US- SALAM HABIB
Billing Name	Saqeeb Ulla Shariff
Project Sector	Residential
Project Type	With Subsidy
Sales Lead	Govindaraju
Site Address	#25/5,4th cross, LIC Colony, 3rd block East , Jayanagar, Bengaluru 560011
GPS Coordinates	12.9299534, 77.5911299
Google Maps	https://www.google.com/maps?q=12.9299534,77.5911299
Visit Date	2026-07-18
Visited By	K Naveen
Revision	Rev 0

CLIENT INFORMATION

Client Name	Saqeeb Ulla Shariff
Contact	9845478886

PROJECT DETAILS

Solar Rooftop System Type	On-Grid
System Capacity (kWp)	3.07
Sanction Load (kW)	4
Module Make & Capacity	Adani DCR bifacial 615 Wp

Module Length (mm)	2382
Module Width (mm)	1133
Number of Panels	5
Inverter Type	Micro
Inverter Brand	Enphase IQ8P
Number of Inverters	5
Mounting Structure Type	RCC Flat Roof

SITE INSPECTION CHECKLIST

General

#	Question	Answer	Notes
1	Can the delivery van/truck reach the material unloading point?	Yes	-
2	Are there any obstacles at the site that could hinder material lifting?	No	-
3	Where will the Inverter, DCDB, ACDB, Battery, etc. be located?	N/A	-
4	Is a canopy required for protecting the Inverters/ACDB/DCDB?	N/A	-
5	Did you discuss the location of the earth pits with the customer?	The earth pits are located in the corridor which is near to the main meter location.	-
6	Where is the Internet Router located?	First Floor	-
7	What's the Wi-Fi strength of the router near to the String inverter/Envoy?	3 bars	-
8	Did you pin the site location in your WhatsApp when you were at the site?	Yes	-

Roof Details

#	Question	Answer	Notes
1	What type of roof is present at the site?	RCC Flat Roof	RCC Flat roof with laid of Tiles
2	Are there any obstructions on the roof that could affect the solar installation?	details: Solar water heater are the obstructions that could affect the solar installation.	-
3	What is the angle of the panels? (in degrees)	10	-
4	In case of sloped roof, what is the slope angle of the roof? (in degrees)	N/A	-
5	On how many roofs at the site are we installing solar?	1	-
6	If it is a Tiled roof, what is underneath the tiles?	N/A	-

#	Question	Answer	Notes
7	If it is a Tiled roof with MS or Wooden rafters, is it Single-tiled or Double-tiled?	N/A	-
8	What type of mounting structure is planned?	Elevated	<i>HDGI Elevated</i>
9	What is the orientation of the solar panels?	["South"]	-
10	How can the roof be accessed?	Staircase	-
11	Is the building currently under construction?	N/A	-
12	In an under-construction building, are existing conduit pipes available for AC, DC cables, and earthing?	N/A	-
13	What is the height of the building and how many floors does it have?	The height of the building is G+2+headroom is approximately 12 meters	-
14	Is the site photo matching with the building description?	Yes	-
15	Is there an overhead HT line passing within a 10-meter radius of the site?	N/A	-

Residential / Electrical

#	Question	Answer	Notes
1	What type of energy meter is currently installed?	Phase: Single, Type: Digital	-
2	Is the Meter cubicle photo matching with the previous answer?	Yes	-
3	Has the termination point in the Main meter panel been identified?	Yes	-
4	Is the Termination Point easily visible or sealed?	Visible	-
5	Is a Lightning Arrestor (LA) already available at the site?	Yes	-
6	Is space available for CT within Energy meter panel?	N/A	-
7	In case of an Enphase system, is the distance between the farthest micro-inverter and IQ Gateway > 50m?	Less than 50m	-
8	Provide details of the existing CT ratings (if applicable).	N/A	-
9	In Main meter panel, is empty space available for solar meter?	No	<i>Not Available</i>
10	In Main meter panel, is empty space available to house the Enphase accessories or ACDB components?	No	<i>Not Available</i>
11	Is there space available to dig DC, AC and LA earth pits?	Yes	-
12	In case of elevated structures, is an LA extension provided at the far end?	Yes	-
13	In case of elevated structures, is it with or without grouting?	With Grouting	-
14	Are there any challenges with respect to Installation and Maintenance activities?	No	-
15	Are there any safety risks associated with accessing the roof for installation?	No	-
16	Is space present in rooftop to store the panels?	Horizontally sleeping	-
17	In case of sloped roof MS structure, provide the dimension of rafter to rafter, purlin to purlin.	N/A	-
18	Is ventilation available in the battery location?	N/A	-
19	Should the Inverters/ACDB/DCDB be installed on a metal grill or wall mount?	N/A	-

#	Question	Answer	Notes
20	Provide the dimensions for solar meter cubicle placement (L x W of wall).	length: 550, width: 1000	-
21	Provide the dimension for earth pits location (L x W of available space).	length: 500, width: 1500	-
22	Is LAN cable under customer scope?	No	-
23	Is there any shadow that affects the solar installation?	No	-
24	Is there any trench work to be done to carry the AC cable to the meter location?	No	-

PHOTO DOCUMENTATION

Cable Routing Legend


Legend	Description
	Proposed PV Module Array
	Main Meter Location
	Solar Meter
	Battery
	Inverter
	Other Equipment
	DC Cable
	AC Cable
	Material Shifting
	DC Earthing Cable
	AC Earthing Cable
	LA Cable
	DC Earth Pit
	AC Earth Pit
	LA Pit
	LA

Material Delivery Route



This route (using lifting) will be followed to carry large items (like Panels).



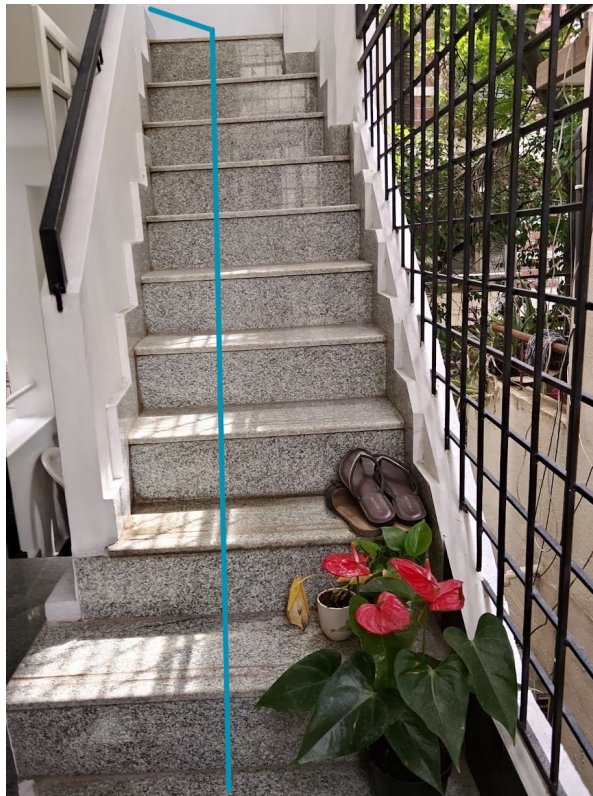

This route (using Staircase) will be followed to carry Small items.

Staircase Details



Meter Box




Material Storage



Proposed PV Area




Cable Routing

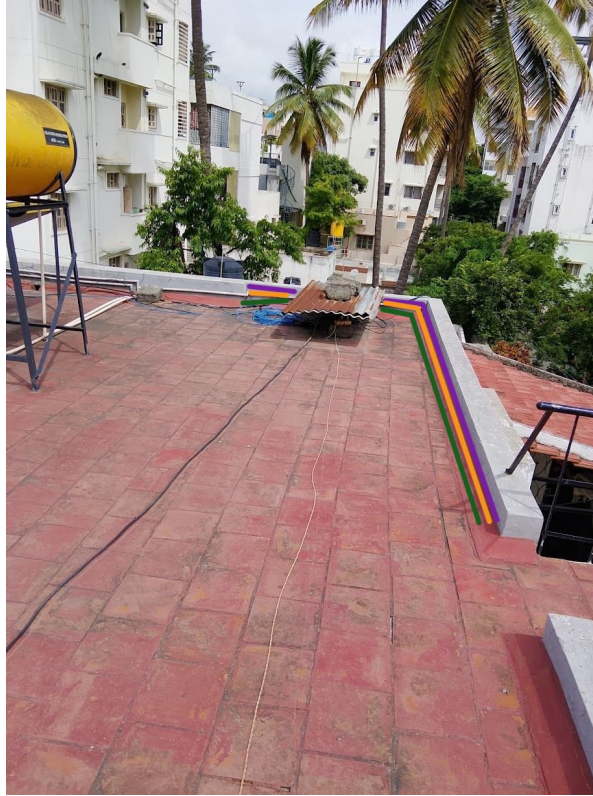




Make a hole to the chajja to run the AC cable till the solar meter location

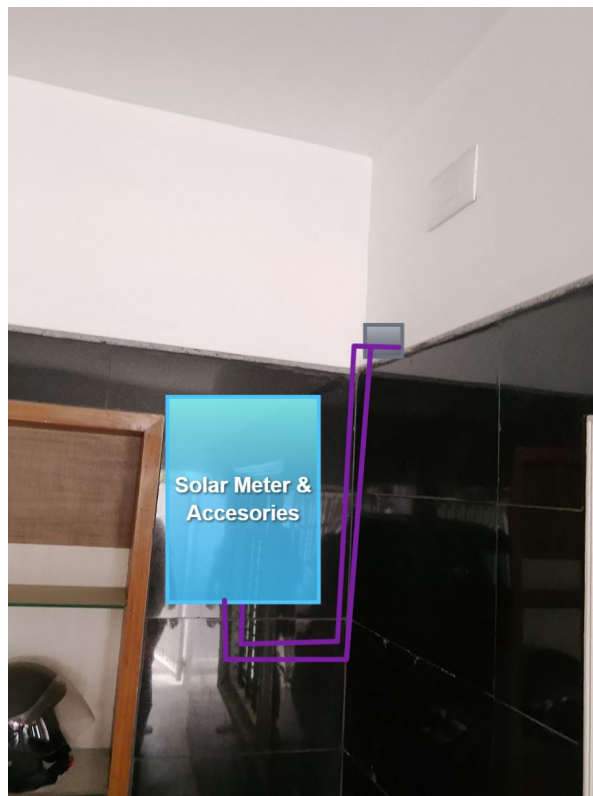


In the same hole only the AC out put cable run till the main meter location

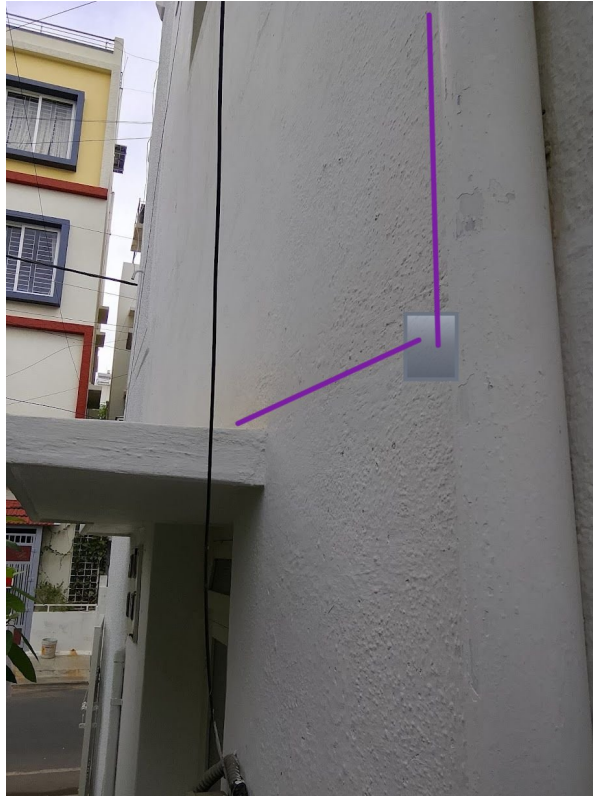





Equipment Location

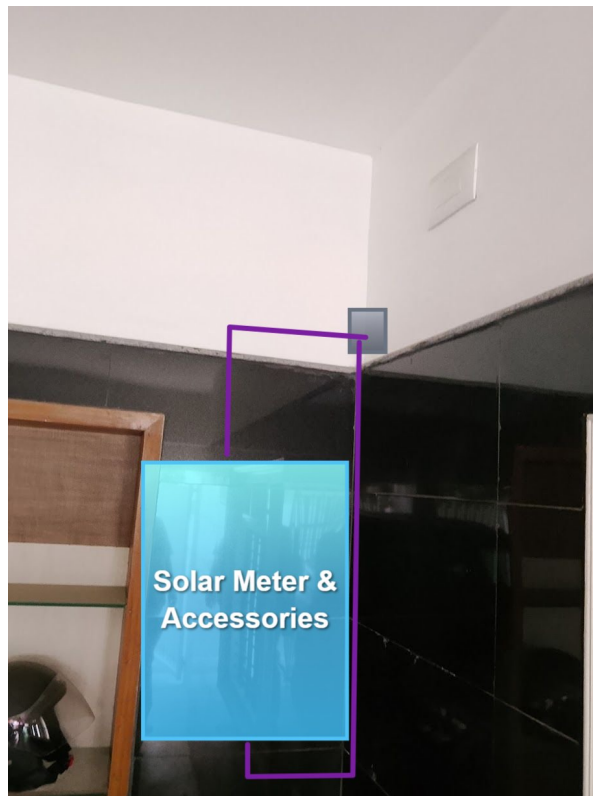


based on the client suggstions only the Solar meter location has been considered


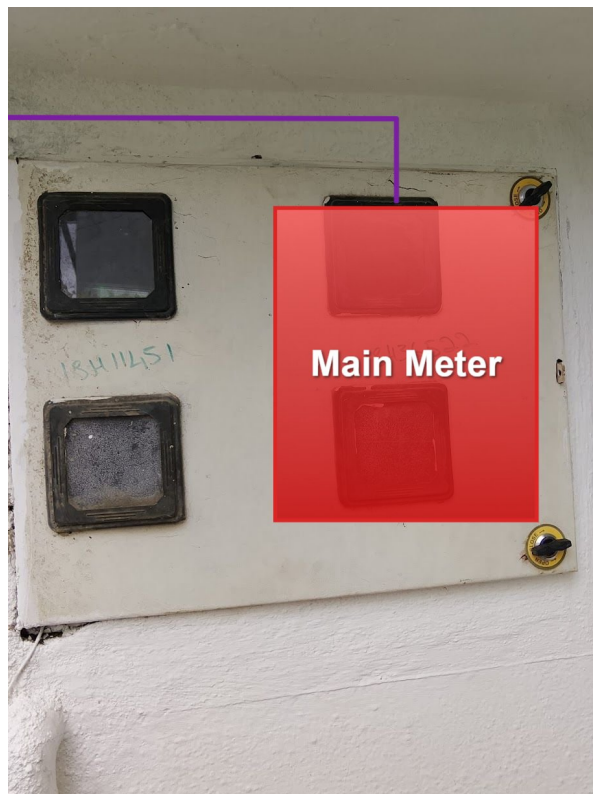




Earth Pit Location

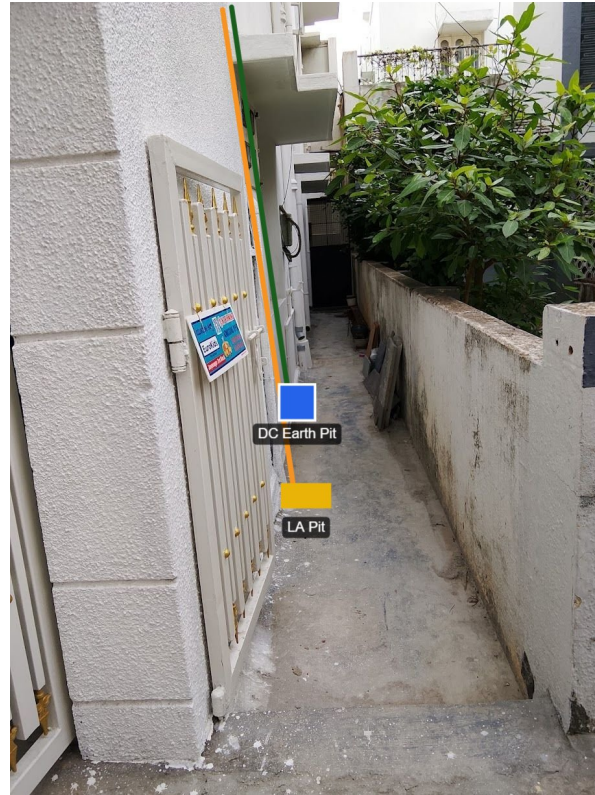

Site Layout - Top View

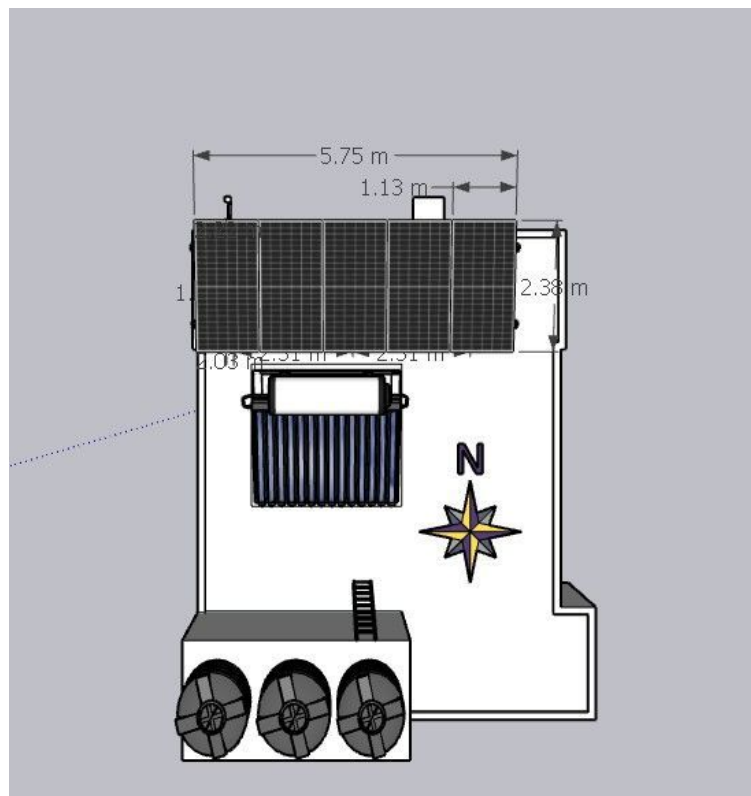

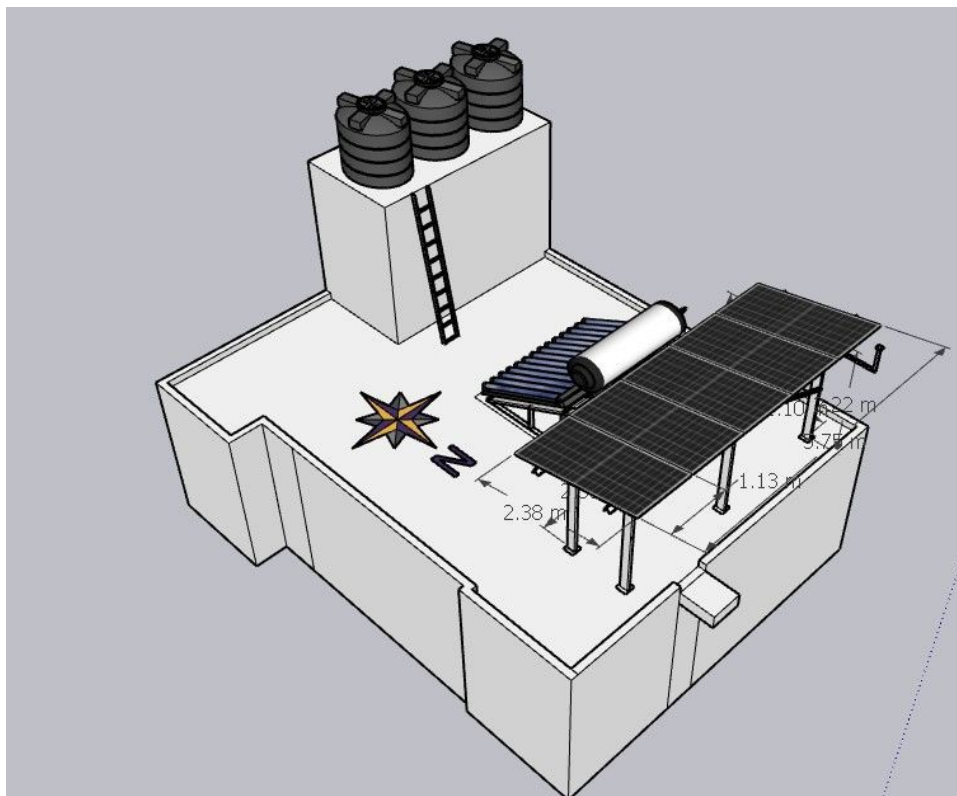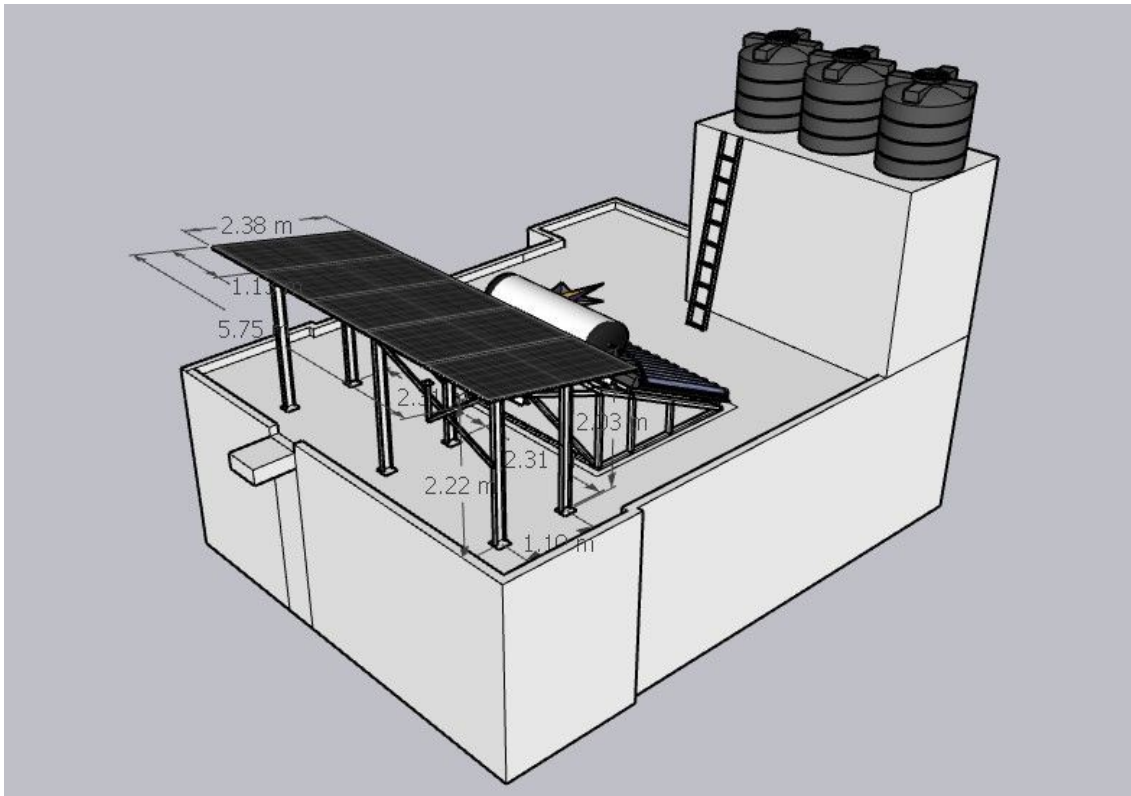

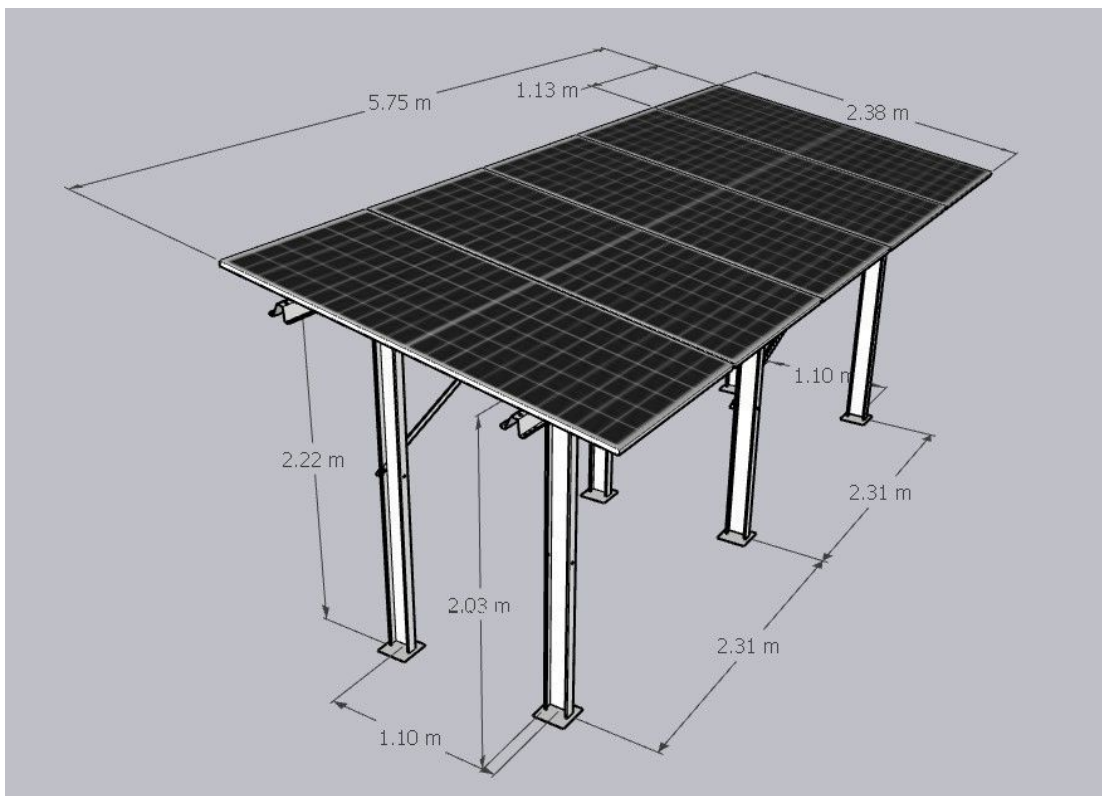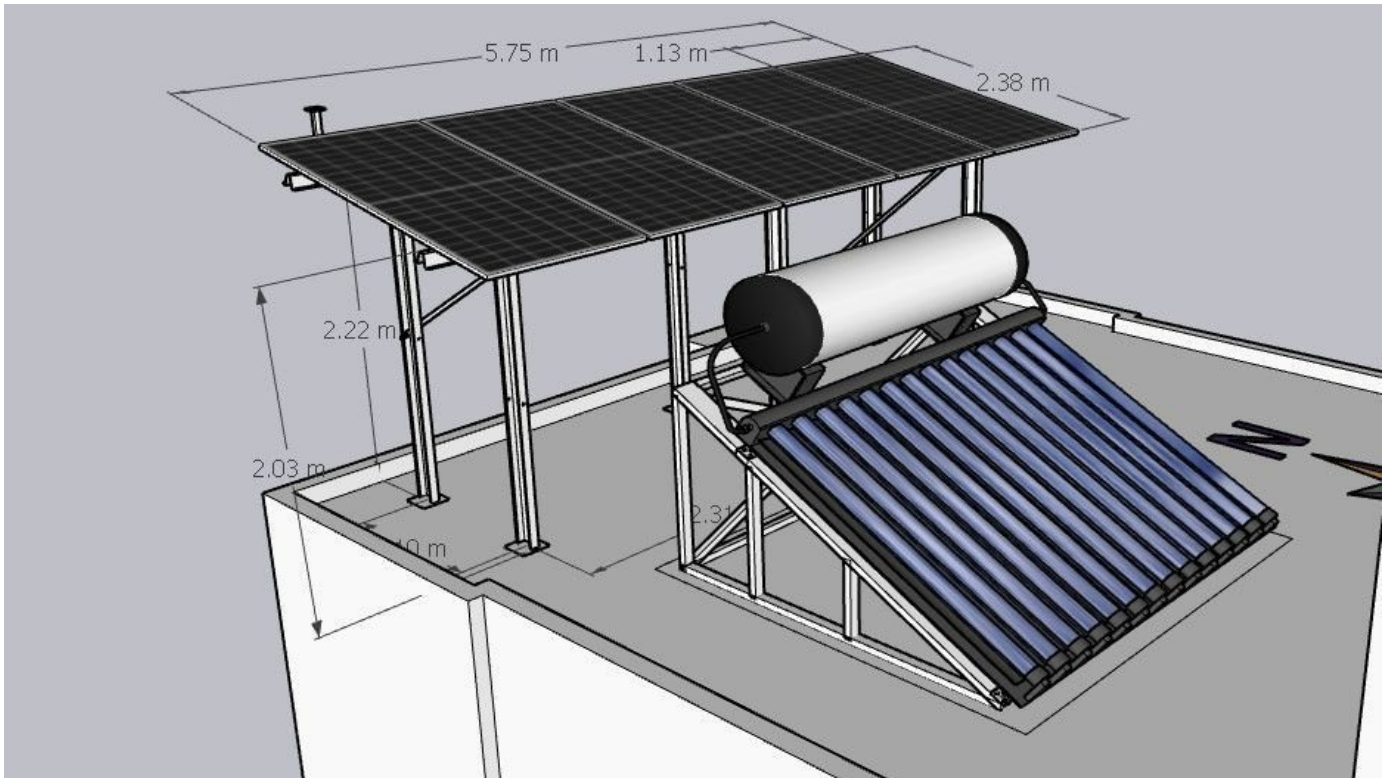

Building Exterior



OBSERVATIONS & RECOMMENDATIONS

EcoSoch Scope

#	Observation
1	While doing the earthpits make sure to install near by the parapet wall to avoid the plumbing disturbances

Customer Scope

#	Observation
1	Wi-Fi up to the solar meter location is under customer scope.
2	As per the customer suggestions only the panel layout, earthing, cable routing has been considered.
3	At the time of installation to avoid the obstructions on the roof is under customer scope

THANK YOU

Dear Saqeeb Ulla Shariff,

Thank you for choosing EcoSoch Solar for your solar installation. We appreciate your trust in us and your commitment to sustainable energy. Our team is dedicated to ensuring a seamless installation experience and long-term performance of your solar system.

Should you have any questions or require further assistance, please do not hesitate to reach out to us.

Warm Regards,
Team EcoSoch

& Did You Know?

The Sun burns 600 million tonnes of hydrogen per second — and your panels get a share.

EcoSoch Solar Pvt. Ltd.

#940, Sha Arcade, 2nd Phase, NTI Layout, Kodigehalli, Bengaluru 560097

www.ecosoch.com | info@ecosoch.com