ECO SOCH® Sunny Living

Technical Site Visit Report

PROJECT INFORMATION

Report Number	ESV-2026-0238
Project ID	7TIJB5LE
Project Name	Binod Kumar Suman AND Madhu Priya_Villa D122 Renaissance Nature Walk Non Subsidy_6.25kWp_Microinverter (IQ Series)
Building Name	Villa D122
Project Sector	Residential
Project Type	Without Subsidy
Sales Lead	Govindaraju J S
Site Address	Villa number D-122, Renaissance Nature Walk, Kodigehalli main road, ayappanagar, K R Puram, Bangalore 560036.
GPS Coordinates	13.007321, 77.718897
Google Maps	https://www.google.com/maps?q=13.007321,77.718897
Visit Date	2026-10-16
Visited By	ABILASH N K
Revision	Rev 1

CLIENT INFORMATION

Client Name	Binod Kumar Suman AND Madhu Priya
Contact	+91 9900159257

PROJECT DETAILS

Solar Rooftop System Type	On-Grid
System Capacity (kWp)	6.25
Sanction Load (kW)	6
Module Make & Capacity	Adani Topcon Non-DCR Bi-facial, 625 Wp

Module Length (mm)	2382
Module Width (mm)	1133
Number of Panels	10
Inverter Type	Micro
Inverter Brand	Enphase IQ8P
Number of Inverters	10
Mounting Structure Type	RCC Flat Roof

SITE INSPECTION CHECKLIST

General

#	Question	Answer	Notes
1	Can the delivery van/truck reach the material unloading point?	Yes	-
2	Are there any obstacles at the site that could hinder material lifting?	**No**	-
3	Where will the Inverter, DCDB, ACDB, Battery, etc. be located?	The inverter, DCDB and ACDB can be mounted on the wall, near to the existing meter box in the ground-floor car porch.	-
4	Is a canopy required for protecting the Inverters/ACDB/DCDB?	**No**	-
5	Did you discuss the location of the earth pits with the customer?	Yes. Earth pits can be dug in the front side garden area.	-
6	Where is the Internet Router located?	1st floor.	-
7	What's the Wi-Fi strength of the router near to the String inverter/Envoy?	3 bars	-
8	Did you pin the site location in your WhatsApp when you were at the site?	Yes	-

Roof Details

#	Question	Answer	Notes
1	What type of roof is present at the site?	RCC Flat Roof	*RCC but with a tilted (slope) roof facing south.*
2	Are there any obstructions on the roof that could affect the solar installation?	**No**	-
3	What is the angle of the panels? (in degrees)	7	-
4	In case of sloped roof, what is the slope angle of the roof? (in degrees)	3	-
5	On how many roofs at the site are we installing solar?	1	-
6	If it is a Tiled roof, what is underneath the tiles?	N/A	-

#	Question	Answer	Notes
7	If it is a Tiled roof with MS or Wooden rafters, is it Single-tiled or Double-tiled?	N/A	-
8	What type of mounting structure is planned?	Long rails with L clamps	-
9	What is the orientation of the solar panels?	["South"]	-
10	How can the roof be accessed?	Staircase	*The headroom can be accessed with the help of a ladder.*
11	Is the building currently under construction?	**No**	-
12	In an under-construction building, are existing conduit pipes available for AC, DC cables, and earthing?	N/A	-
13	What is the height of the building and how many floors does it have?	10m (G + 1 + Headroom)	-
14	Is the site photo matching with the building description?	Yes	-
15	Is there an overhead HT line passing within a 10-meter radius of the site?	**No**	-

Residential / Electrical

#	Question	Answer	Notes
1	What type of energy meter is currently installed?	Phase: Three Phase, Type: Digital, If 3-phase: LT w/o CT (5 - 34.999)	-
2	Is the Meter cubicle photo matching with the previous answer?	Yes	-
3	Has the termination point in the Main meter panel been identified?	Yes	-
4	Is the Termination Point easily visible or sealed?	Visible	-
5	Is a Lightning Arrestor (LA) already available at the site?	**No**	-
6	Is space available for CT within Energy meter panel?	N/A	-
7	In case of an Enphase system, is the distance between the farthest micro-inverter and IQ Gateway > 50m?	Less than 50m	-
8	Provide details of the existing CT ratings (if applicable).	N/A	-
9	In Main meter panel, is empty space available for solar meter?	**No**	-
10	In Main meter panel, is empty space available to house the Enphase accessories or ACDB components?	**No**	*A separate Enphase accessories box with solar meter provision has to be supplied.*
11	Is there space available to dig DC, AC and LA earth pits?	Yes	*Earth pits can be dug in the front side garden area.*
12	What type of Earthing chamber needs to be installed at site? Is it Cement chamber or PVC chamber?	PVC chamber	-
13	In case of elevated structures, is an LA extension provided at the far end?	N/A	-
14	In case of elevated structures, is it with or without grouting?	N/A	-
15	Are there any challenges with respect to Installation and Maintenance activities?	**No**	-
16	Are there any safety risks associated with accessing the roof for installation?	**No**	-
17	Is space present in rooftop to store the panels?	Vertically leaning	-


#	Question	Answer	Notes
		against the wall	
18	In case of sloped roof MS structure, provide the dimension of rafter to rafter, purlin to purlin.	N/A	-
19	Is ventilation available in the battery location?	N/A	-
20	Is Battery wall mounted or stand mounted?	N/A	-
21	Should the Inverters/ACDB/DCDB be installed on a metal grill or wall mount?	All accessories can be wall mounted.	-
22	Provide the dimensions for solar meter cubicle placement (L x W of wall).	length: 1000, width: 1000	-
23	Provide the dimension for earth pits location (L x W of available space).	width: 1000, length: 2000	-
24	Is LAN cable under customer scope?	Yes	-
25	Is there any shadow that affects the solar installation?	No	-
26	Is there any trench work to be done to carry the AC cable to the meter location?	N/A	-


PHOTO DOCUMENTATION


Cable Routing Legend


Legend	Description
	Proposed PV Module Array
	Main Meter Location
	Solar Meter
	Battery
	Inverter
	Other Equipment
	DC Cable
	AC Cable
	Material Shifting
	DC Earthing Cable
	AC Earthing Cable
	LA Cable
	DC Earth Pit
	AC Earth Pit
	LA Pit
	LA


Site Layout - Top View

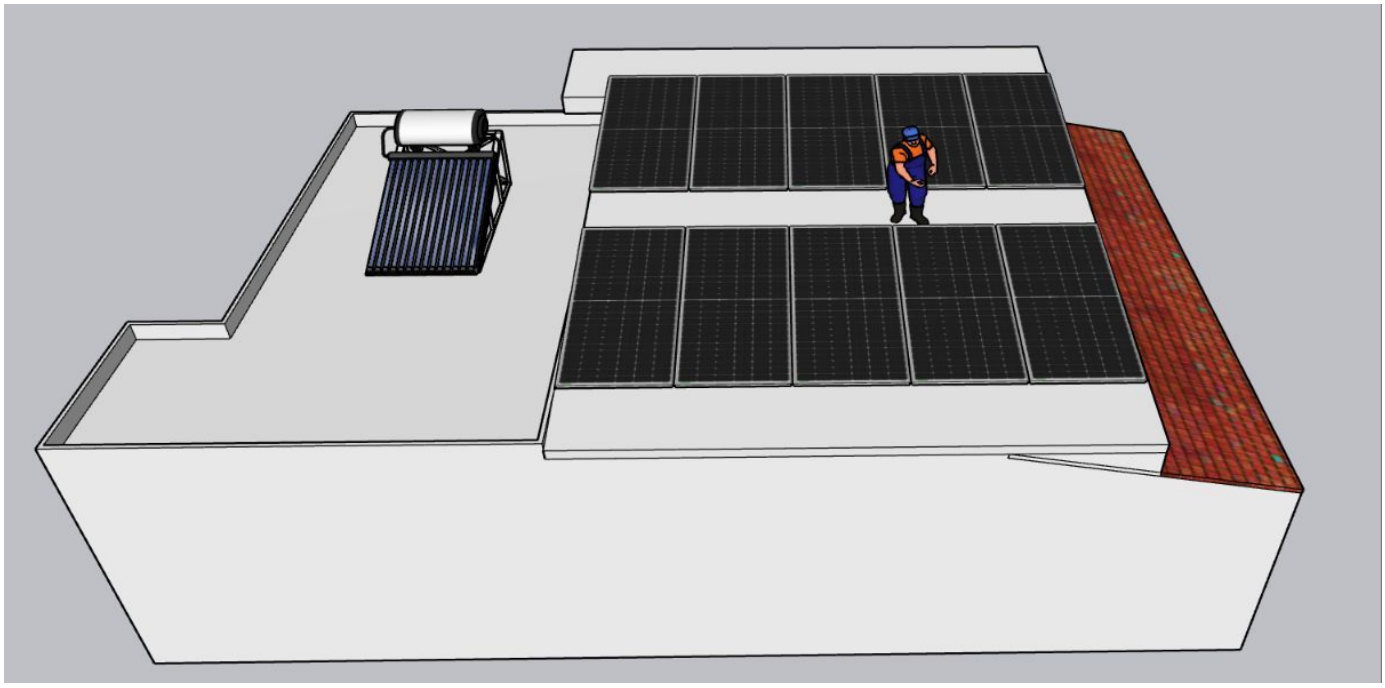


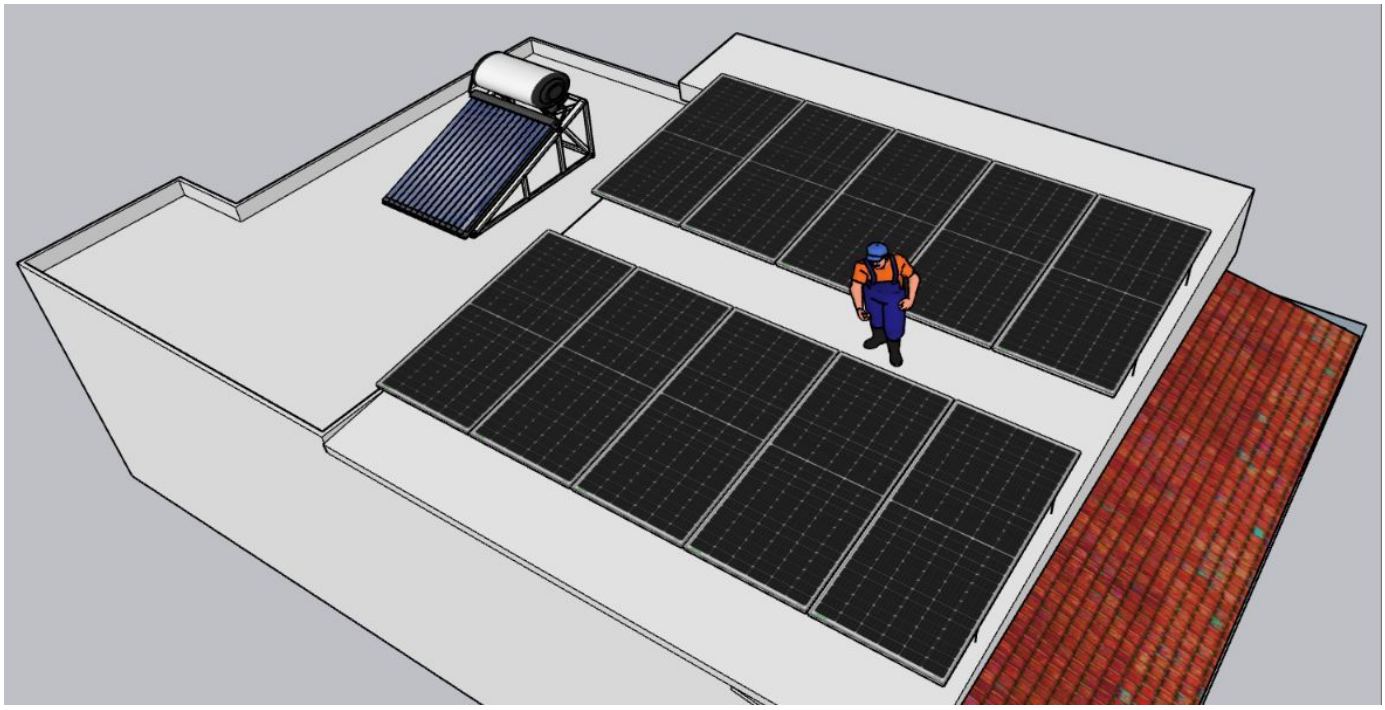


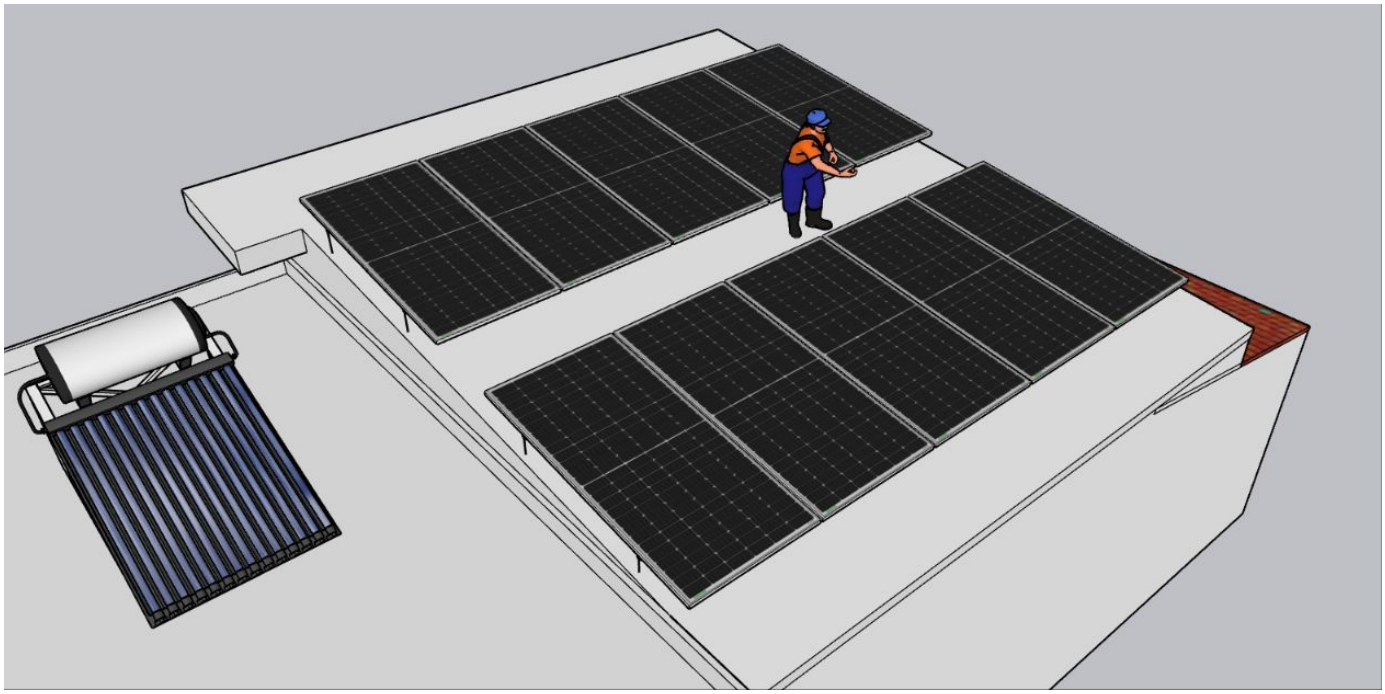


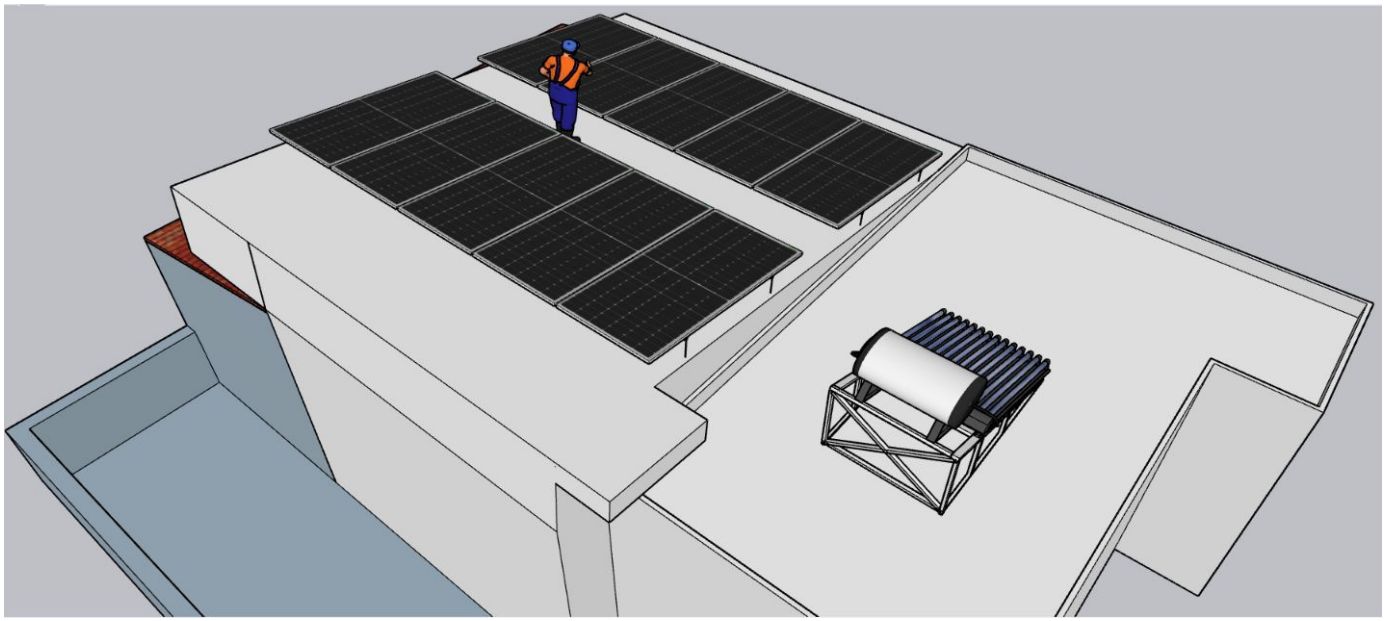

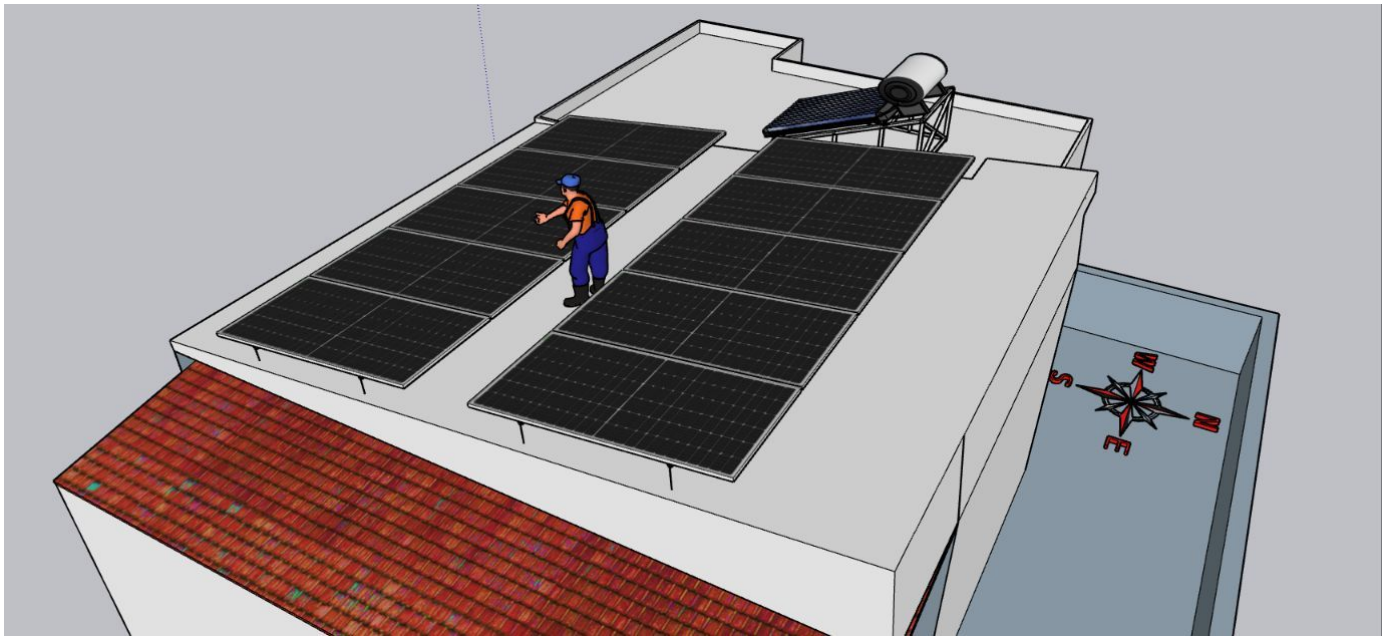
S
W
N
E

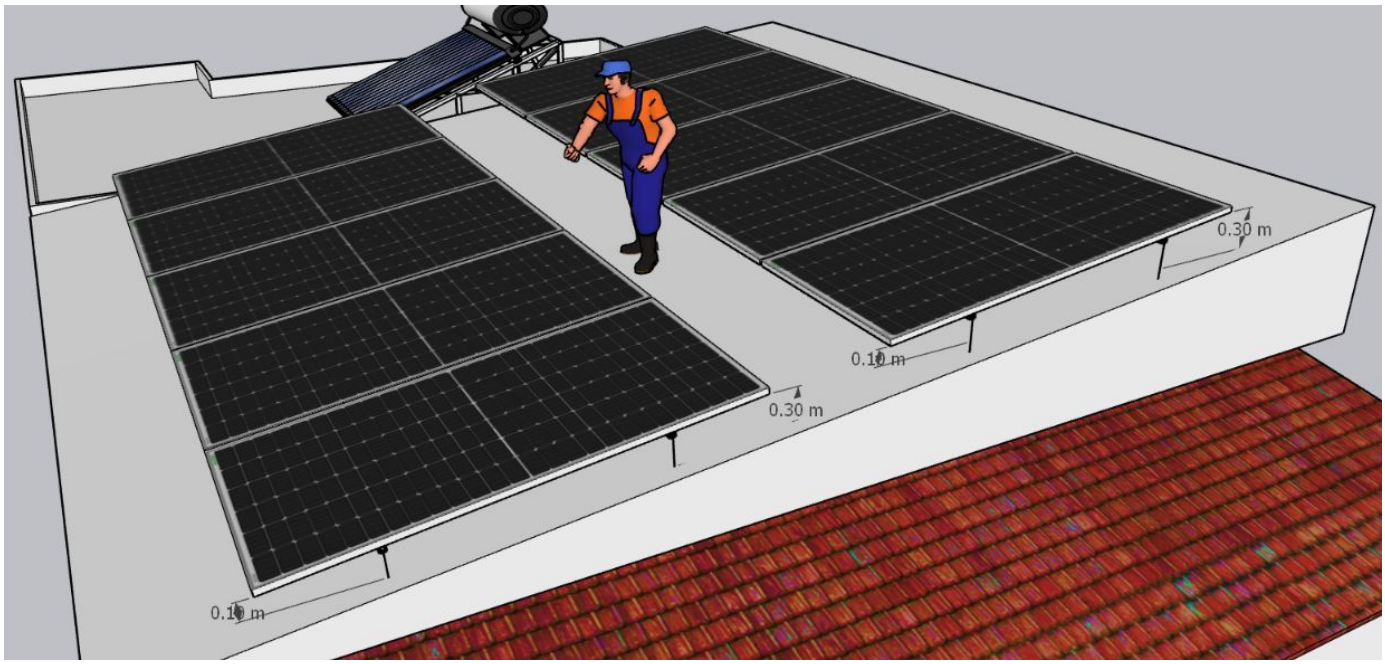
0.30 m
0.10 m
0.30 m
0.10 m

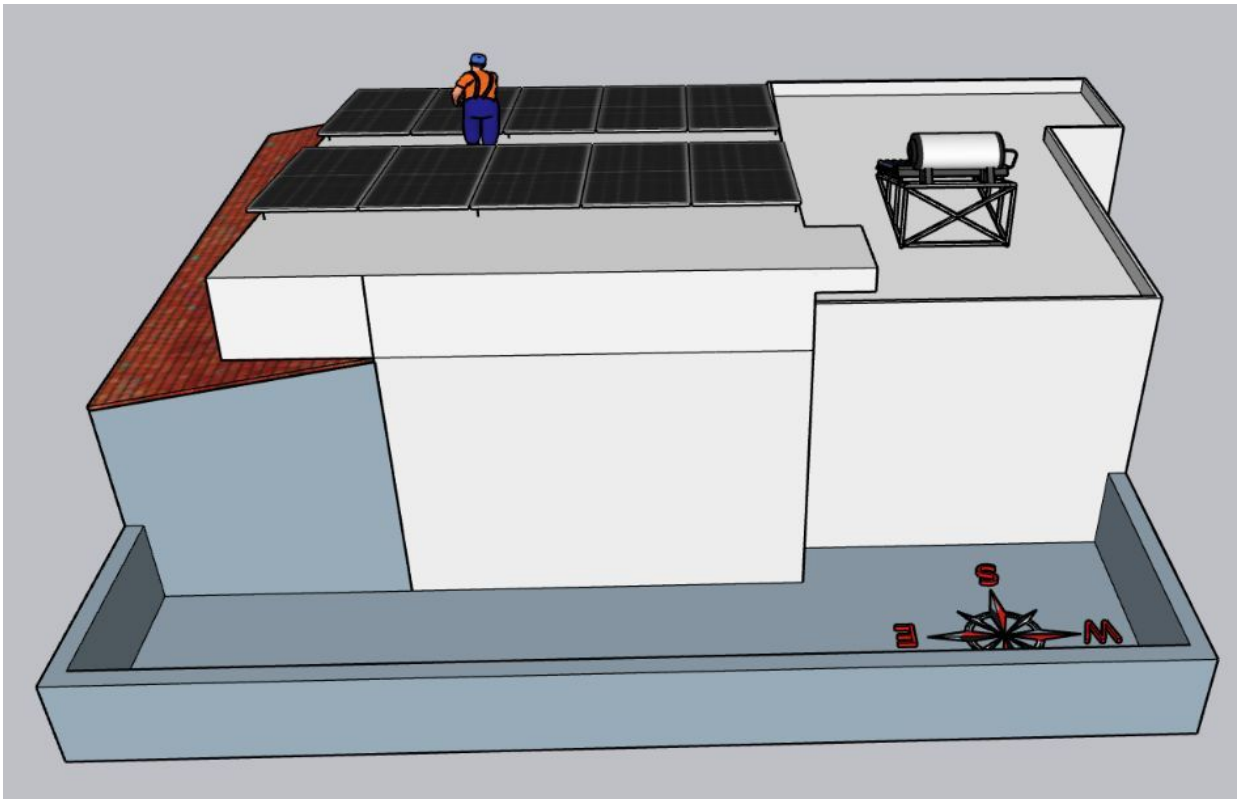

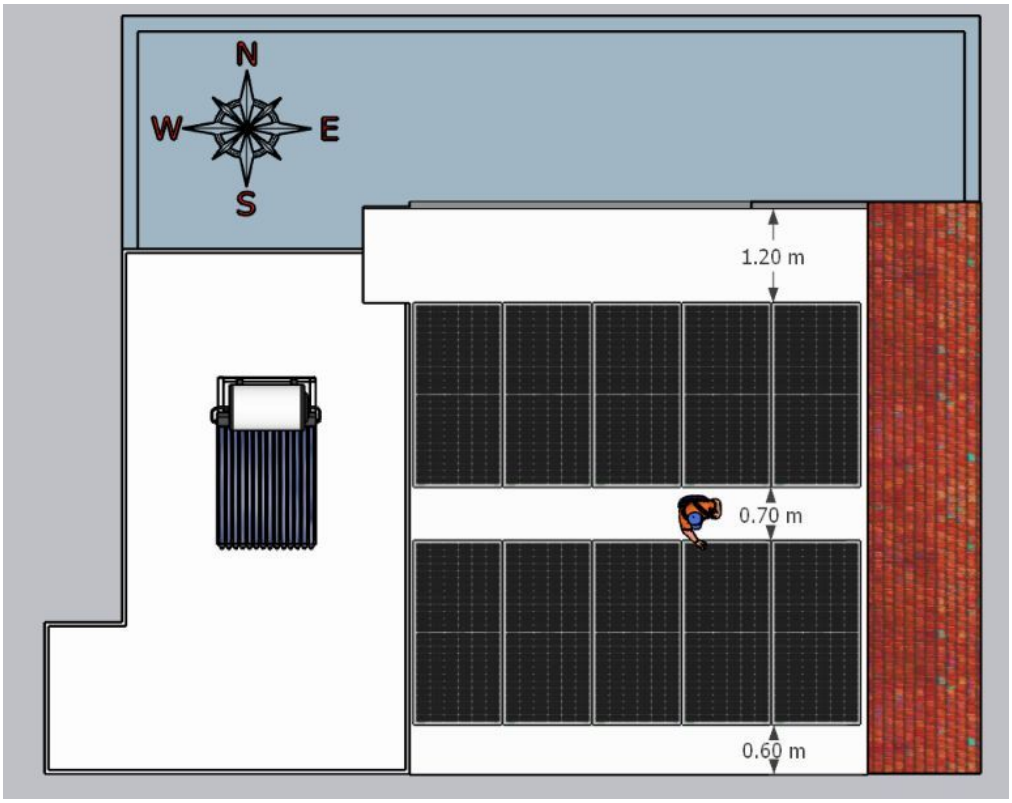

Building Exterior



Material Delivery Route



Heavy materials such as PV modules can be shifted over the side wall of the building.



Light weight materials can be shifted to the terrace via the inner staircase.



The materials can follow the stairs.




The materials can follow the stairs and reaching the balcony terrace.




The materials can be stored here until shifting to the upper terrace.

Staircase Details

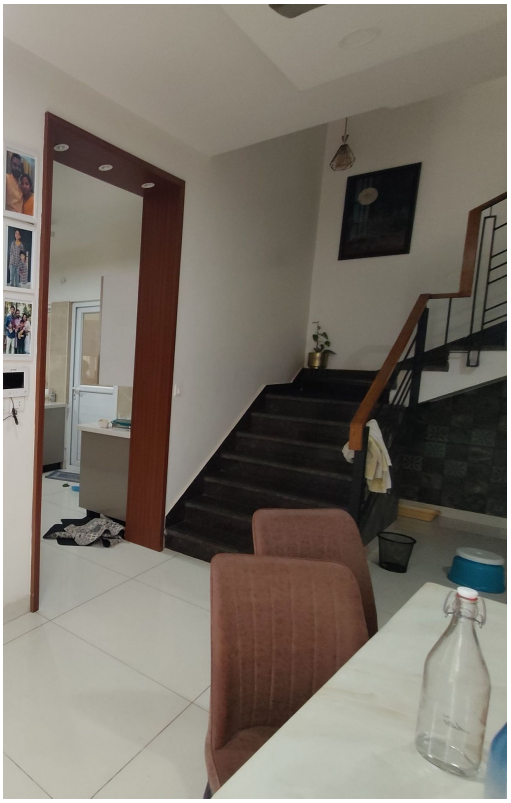


Inner staircase width: 1000 mm

Proposed PV Area

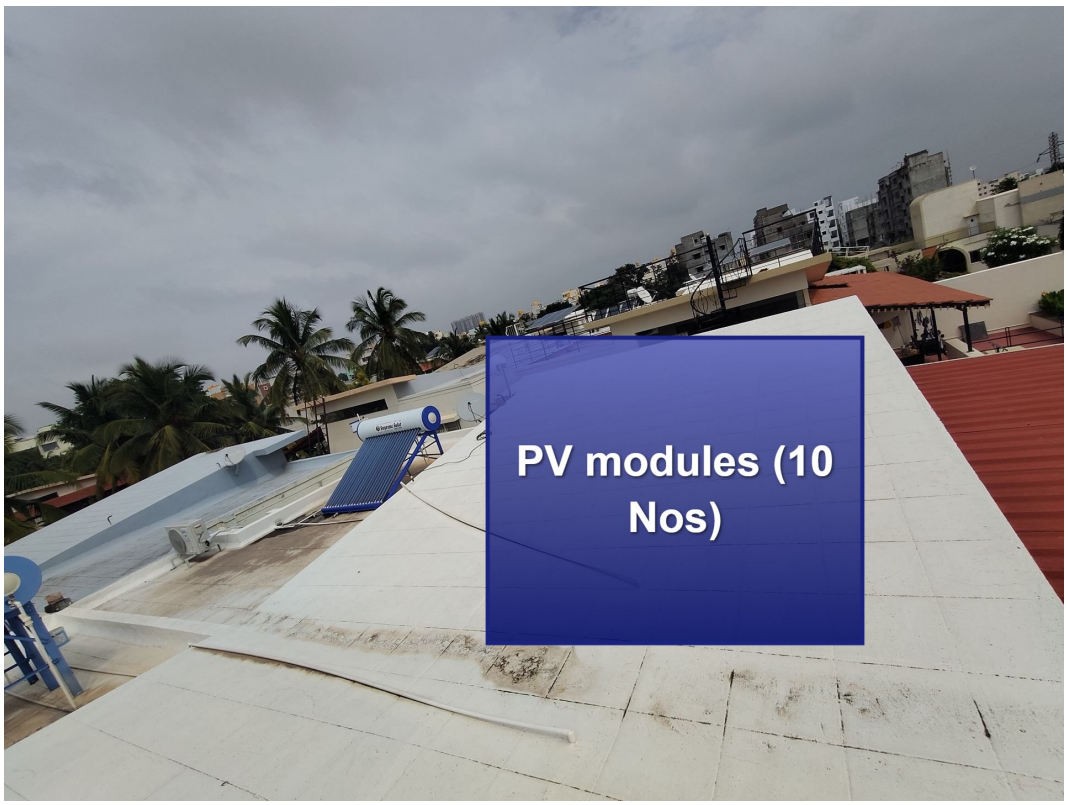

Cable Routing



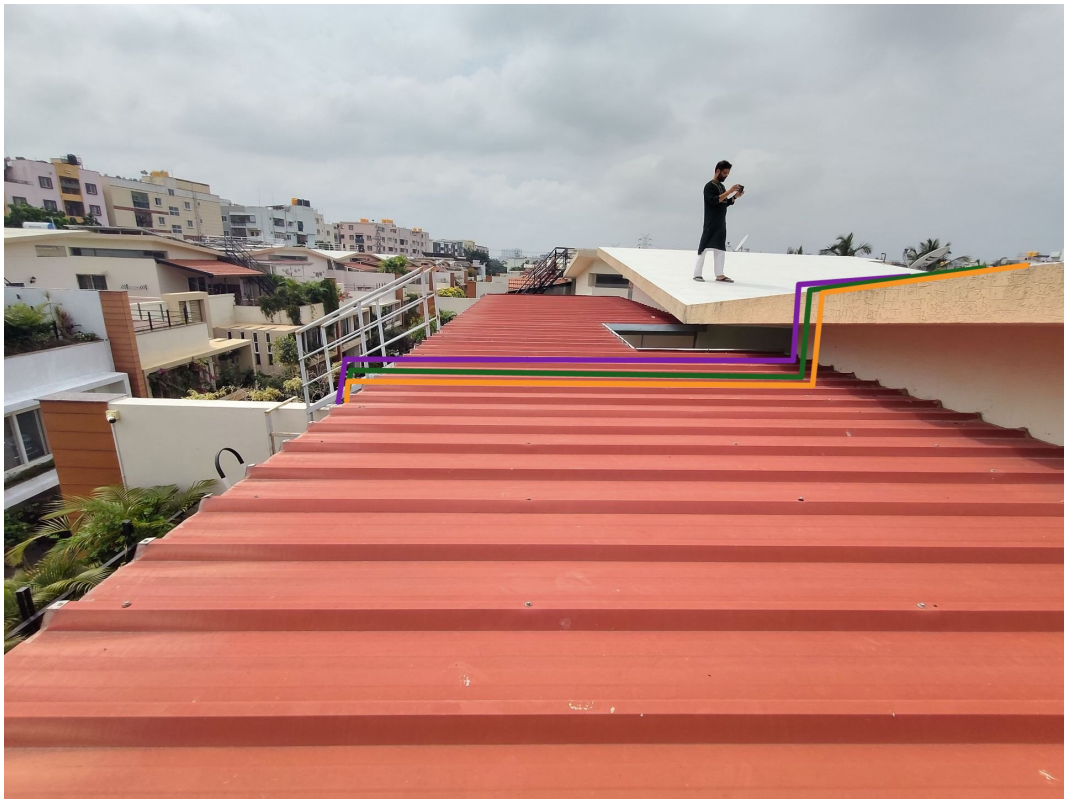







122
LA Pit
DC Earth Pit



Meter Box

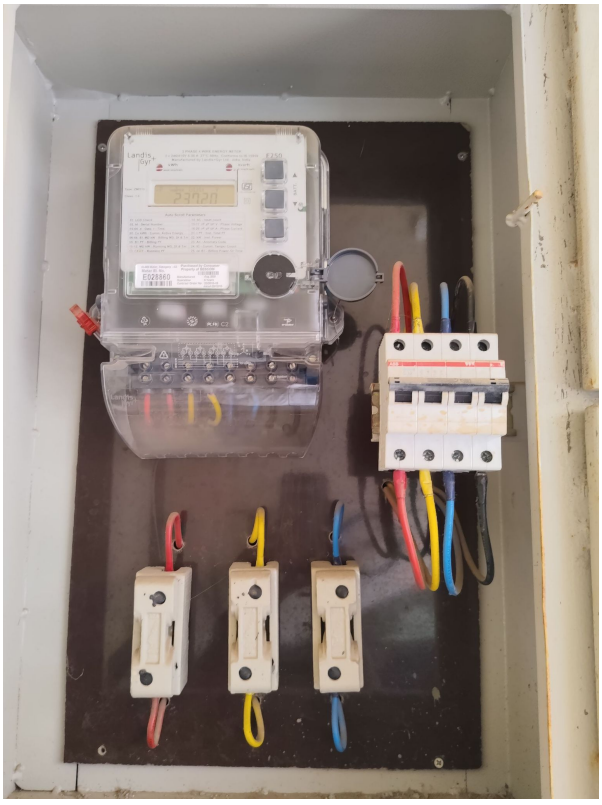



OBSERVATIONS & RECOMMENDATIONS

EcoSoch Scope

#	Observation
1	Installation and commissioning of 6.25 kWp On-grid solar power plant at the proposed premises.
2	The co-ordination and follow-up with BESCOM regarding solar connectivity till commissioning.

Customer Scope

#	Observation
1	Providing an active Wi-Fi or LAN cable connection up to the Enphase Accessories box location.
2	The customer is responsible for arranging the reliable ladder provision to get access to the proposed solar panel installation area prior to the project's execution.

THANK YOU

Dear Binod Kumar Suman AND Madhu Priya,

Thank you for choosing EcoSoch Solar for your solar installation. We appreciate your trust in us and your commitment to sustainable energy. Our team is dedicated to ensuring a seamless installation experience and long-term performance of your solar system.

Should you have any questions or require further assistance, please do not hesitate to reach out to us.

Warm Regards,
Team EcoSoch

& Did You Know?

The Sun burns 600 million tonnes of hydrogen per second — and your panels get a share.

EcoSoch Solar Pvt. Ltd.
#940, Sha Arcade, 2nd Phase, NTI Layout, Kodigehalli, Bengaluru 560097
www.ecosoch.com | info@ecosoch.com