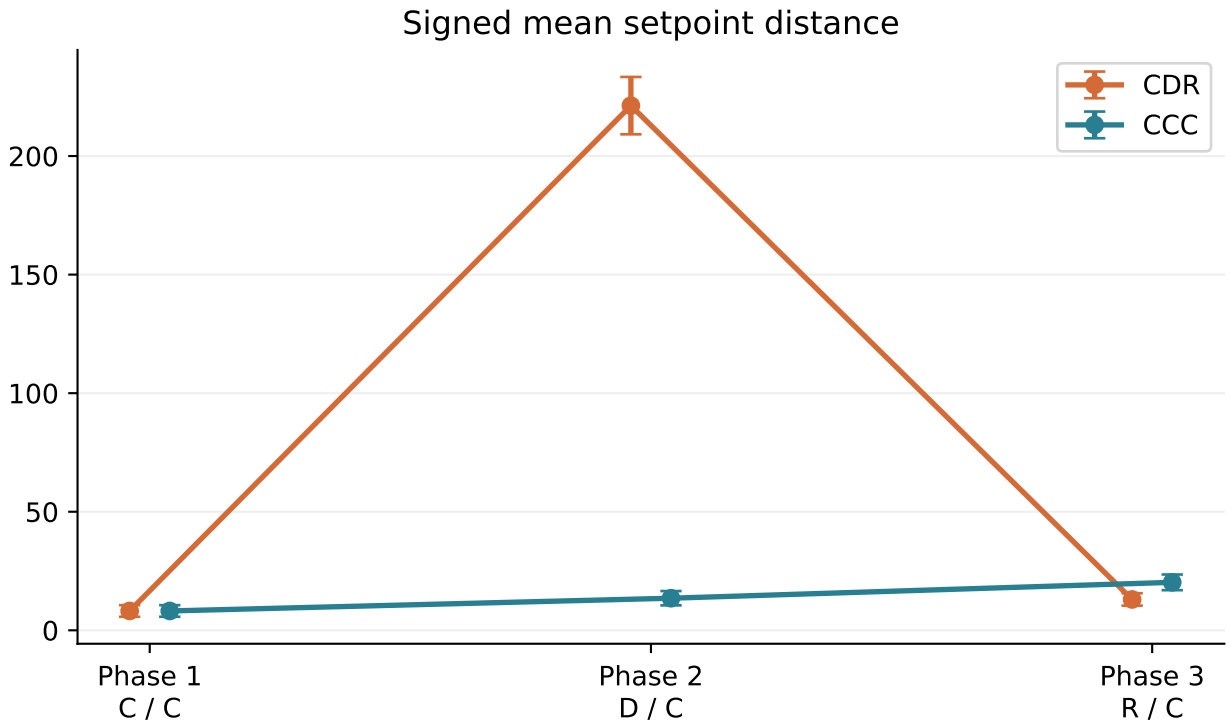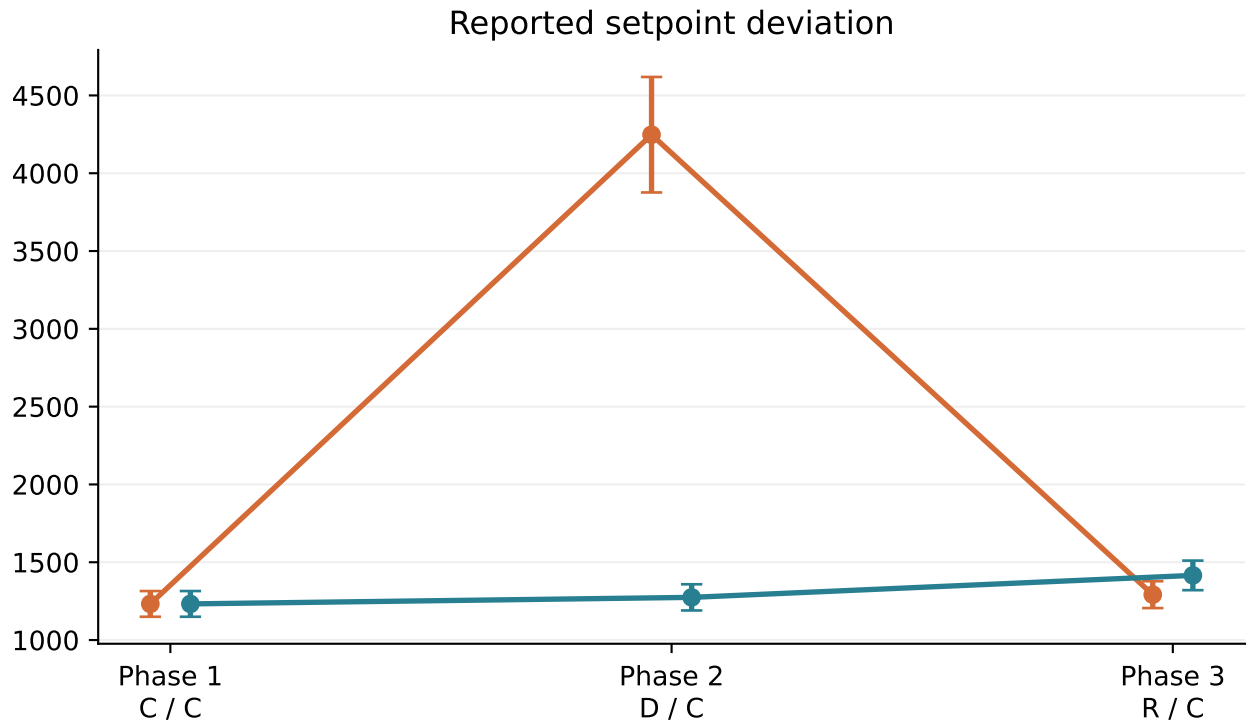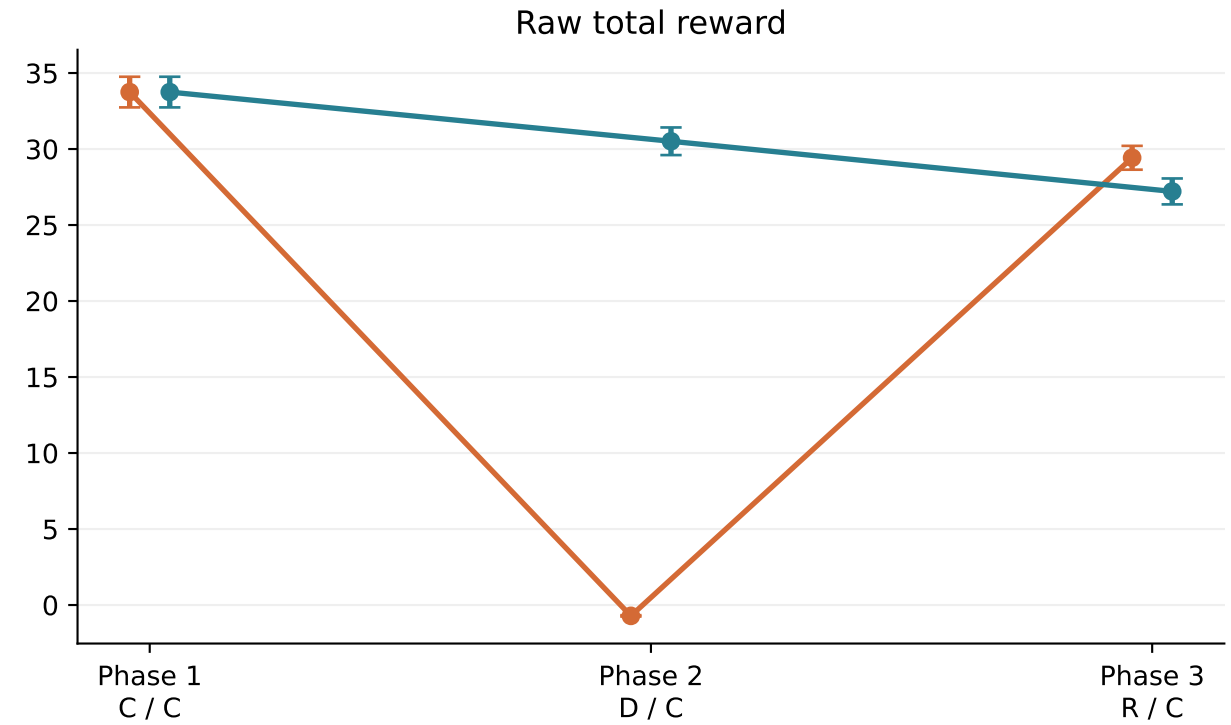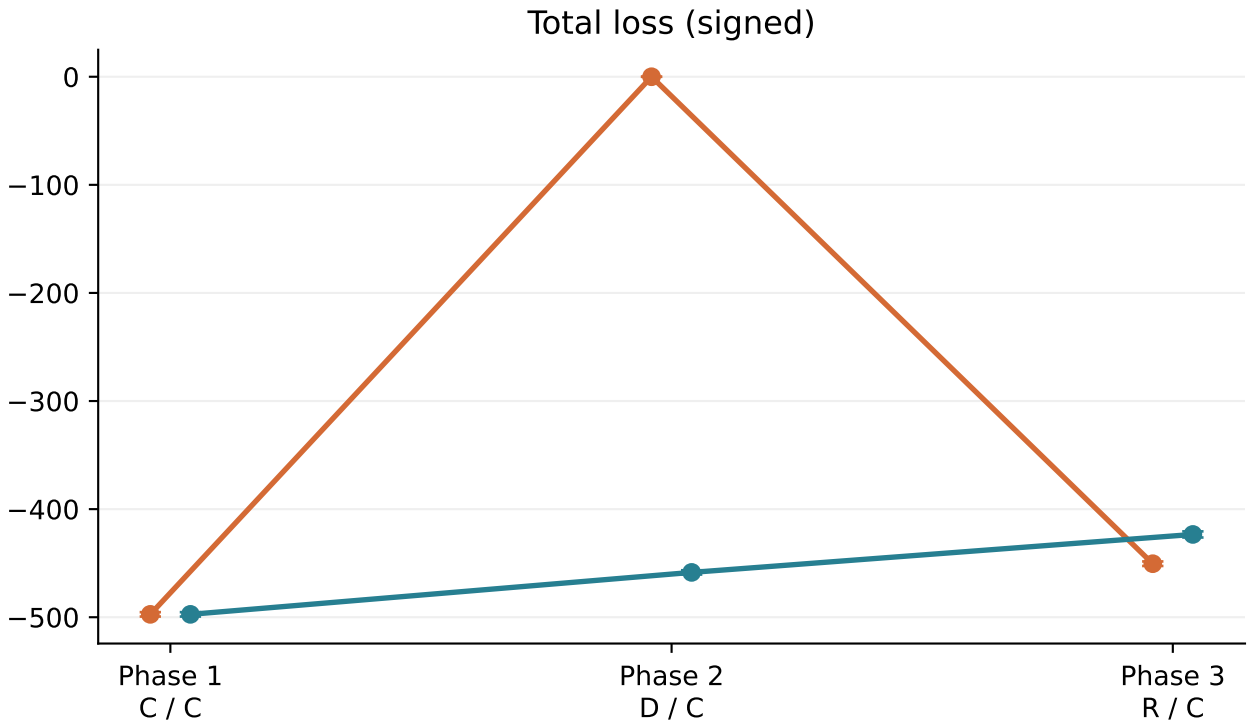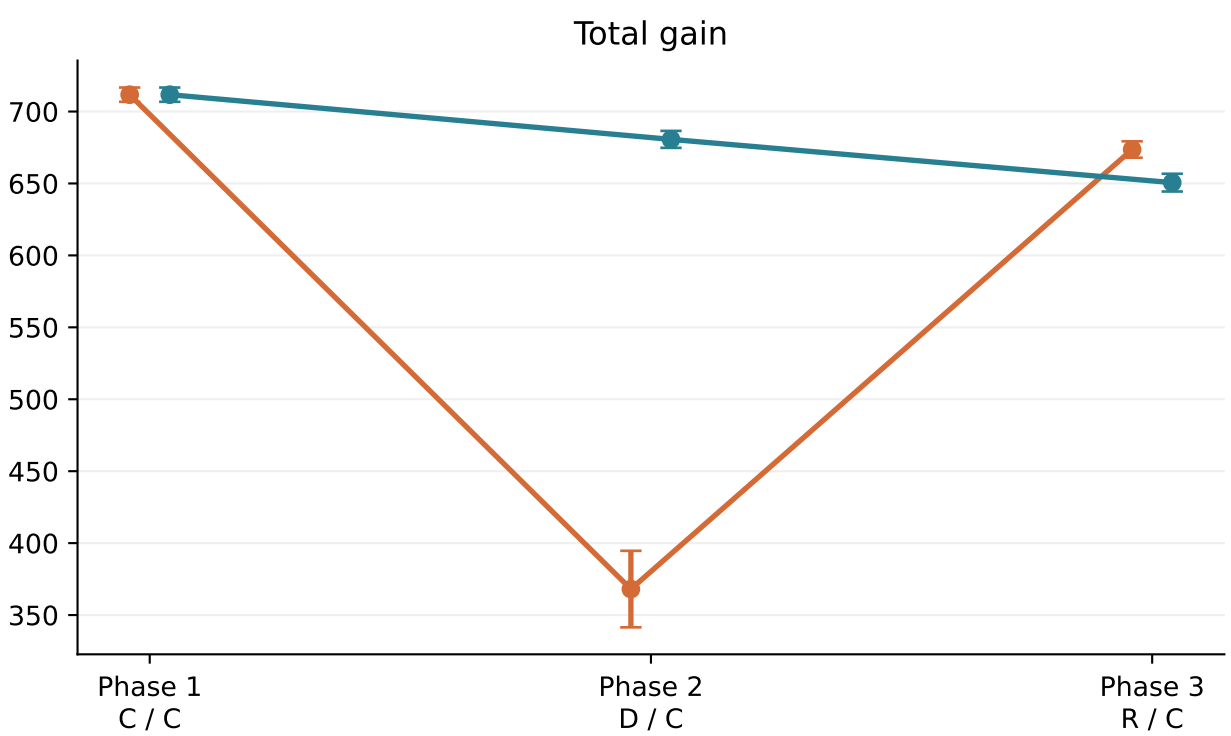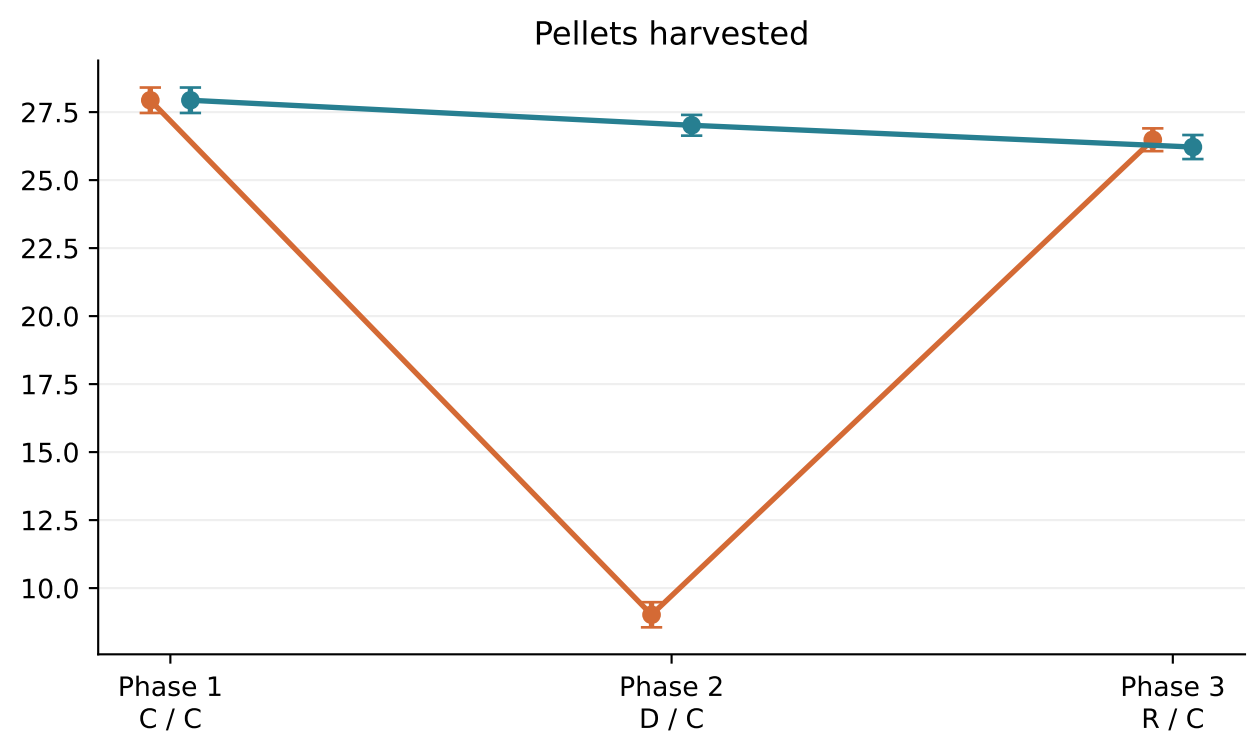Current HRL-CDR vs HRL-CCC: 250 / 250 trials
Means and 95% confidence intervals; equal 1000-unit phases