


Tall Tech II Final Review & Visual Representation

IIT MTBVU / Spring 2025



Site and prevailing wind direction

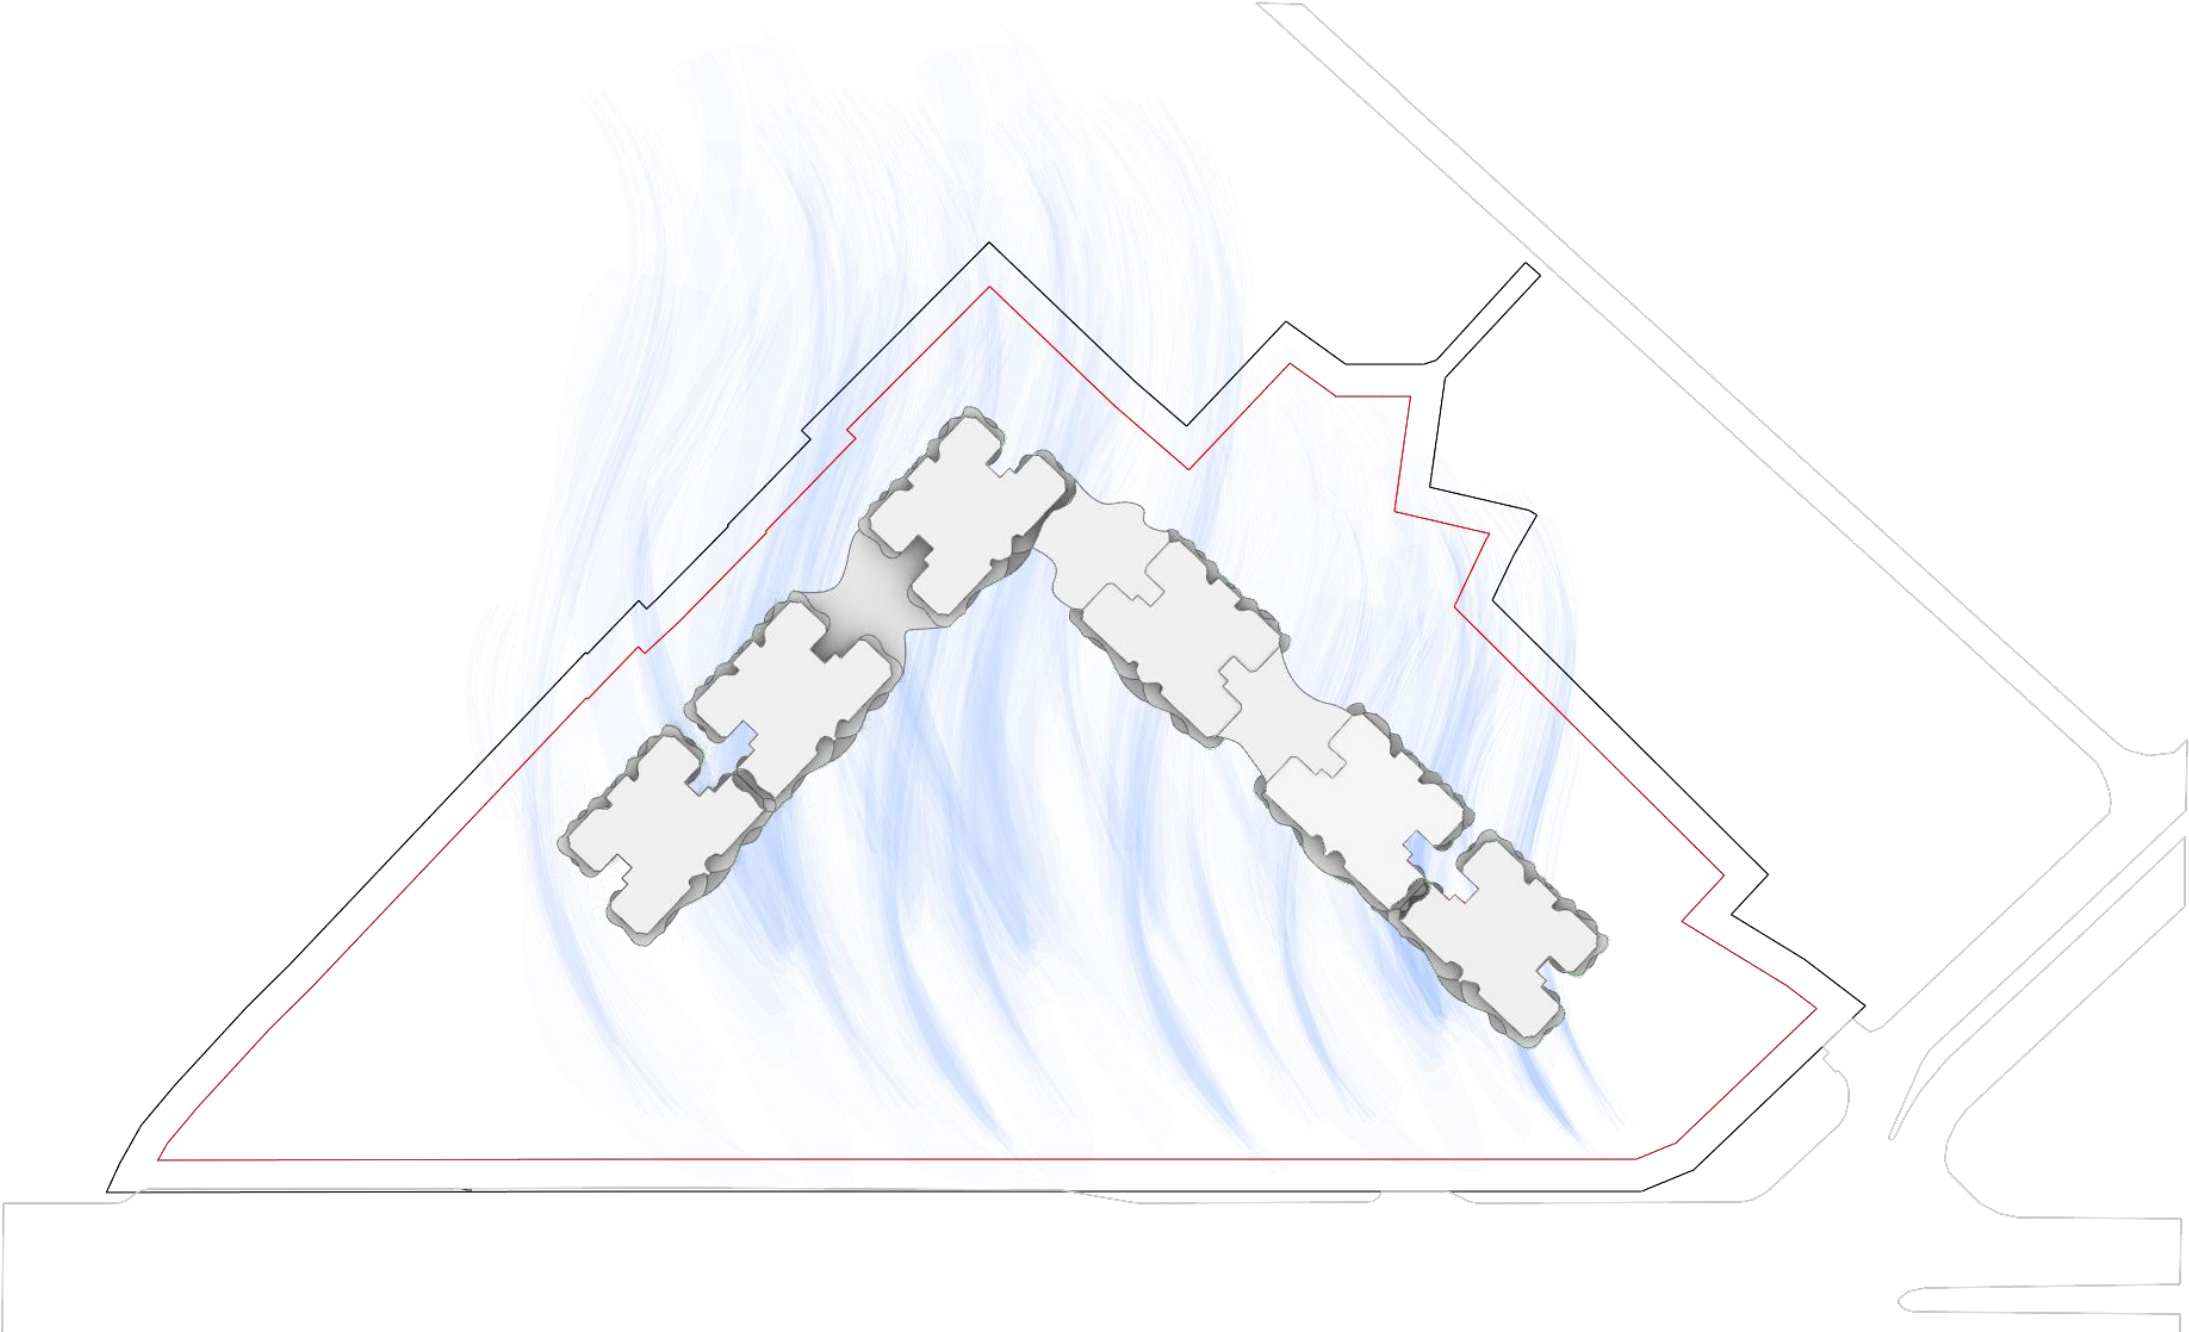

External Environment Simulations



SITTING LONG

0.0 - 2.5 m/s

5%

SITTING SHORT

2.5 - 4.0 m/s

5%

**WALKING
LEISURELY**

4.0 - 6.0 m/s

5%

WALKING FAST

6.0 - 8.0 m/s


5%


UNCOMFORTABLE

> 10 m/s

5%

Result Interpretation at 1.5M+ (Pedestrian Zone)

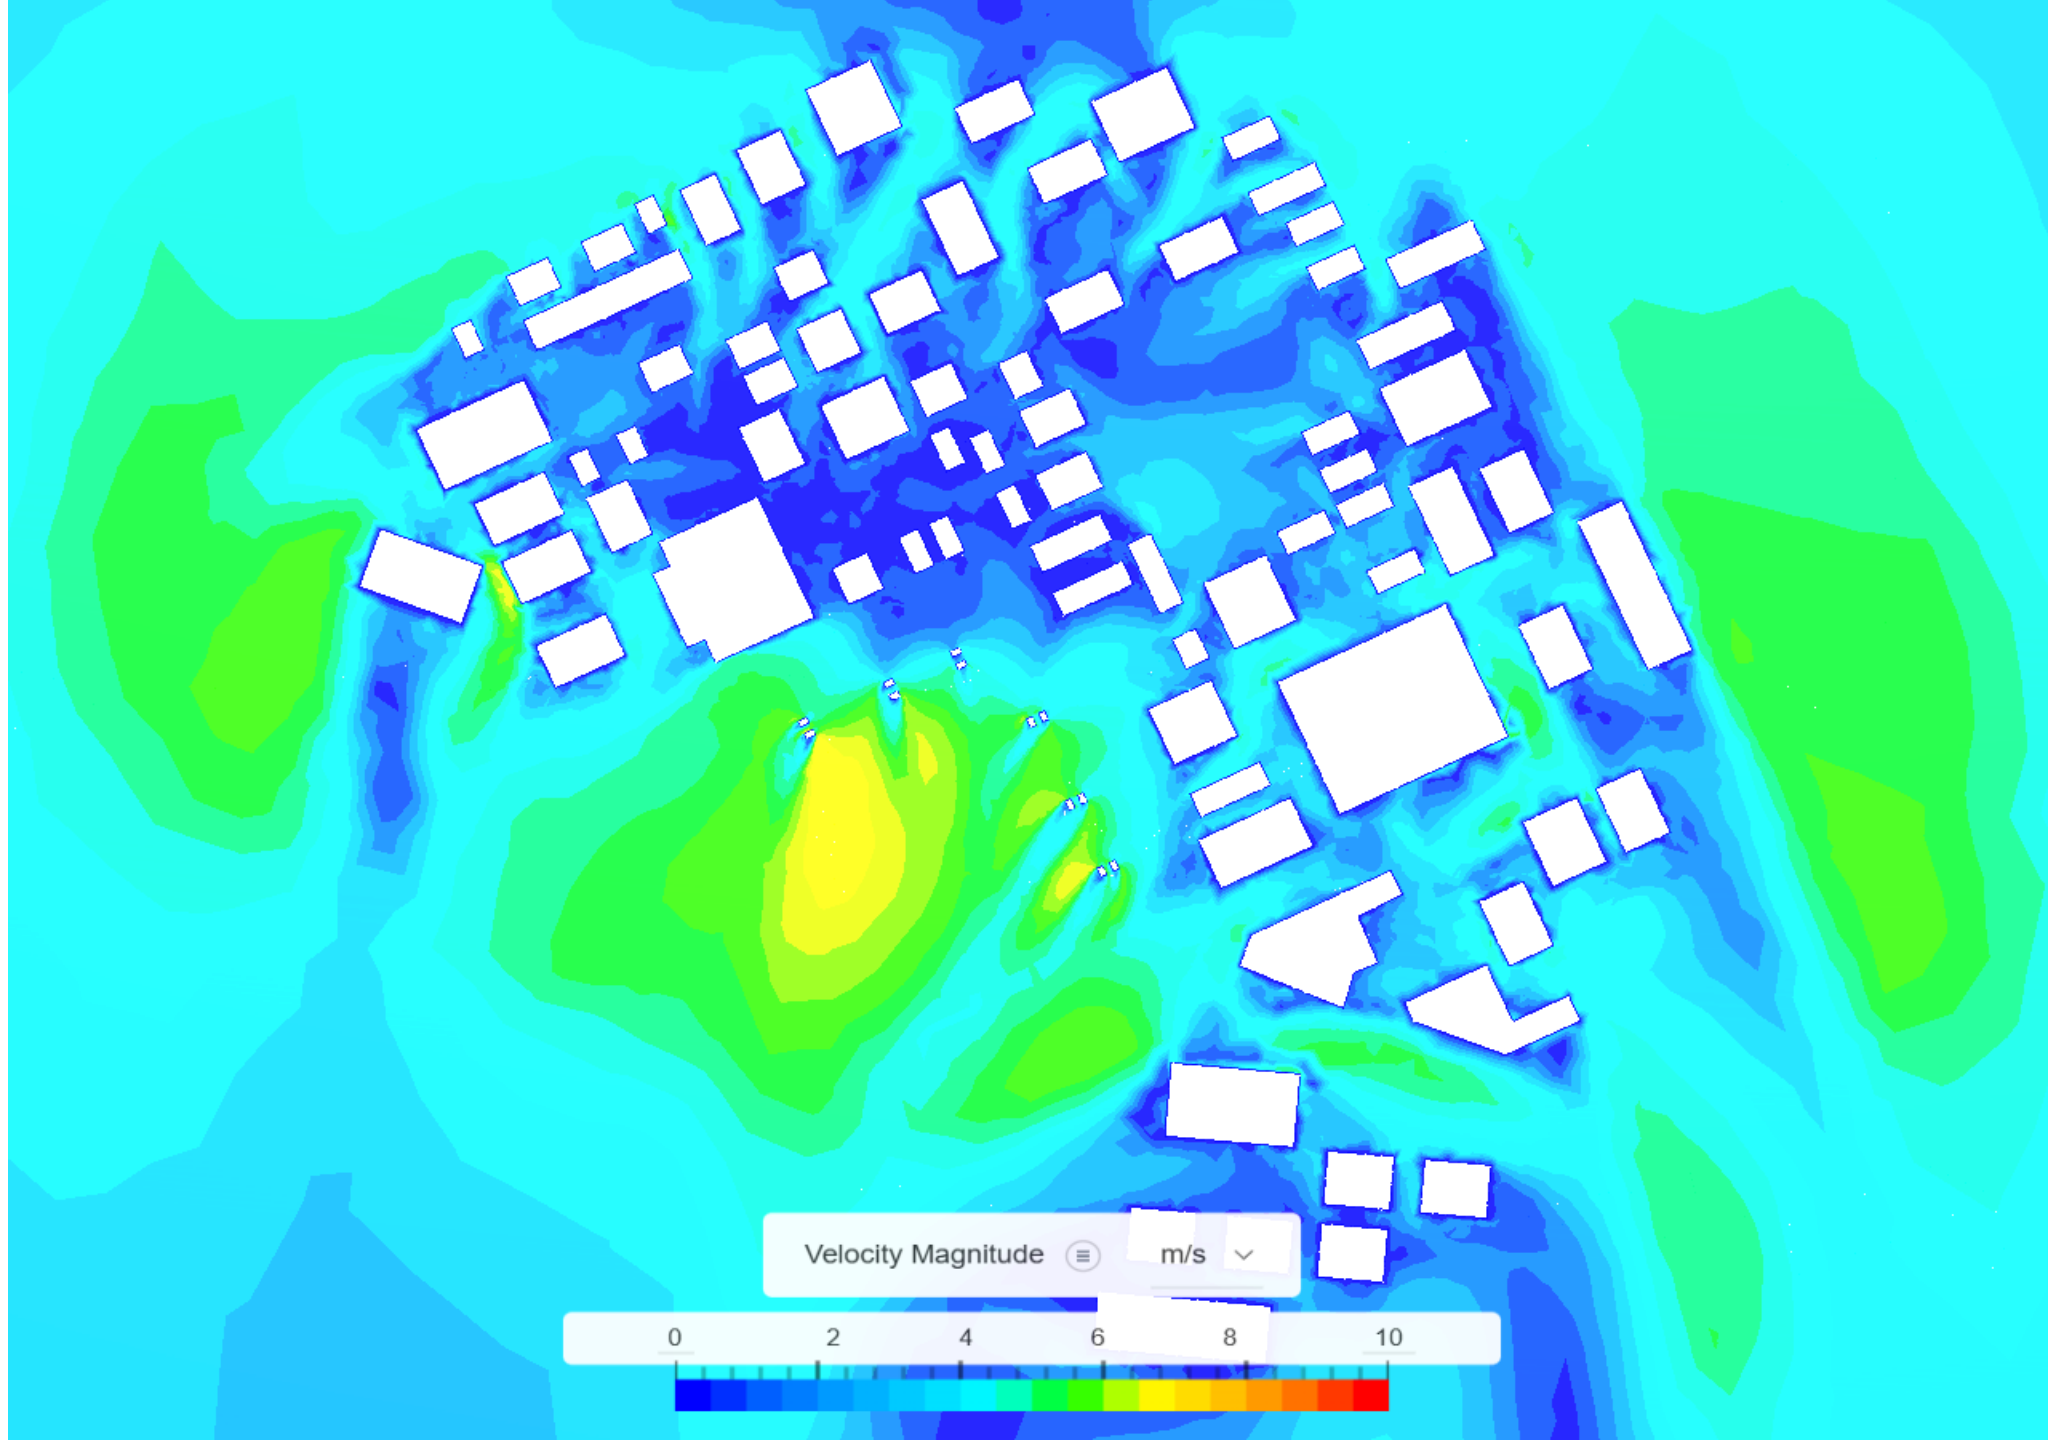


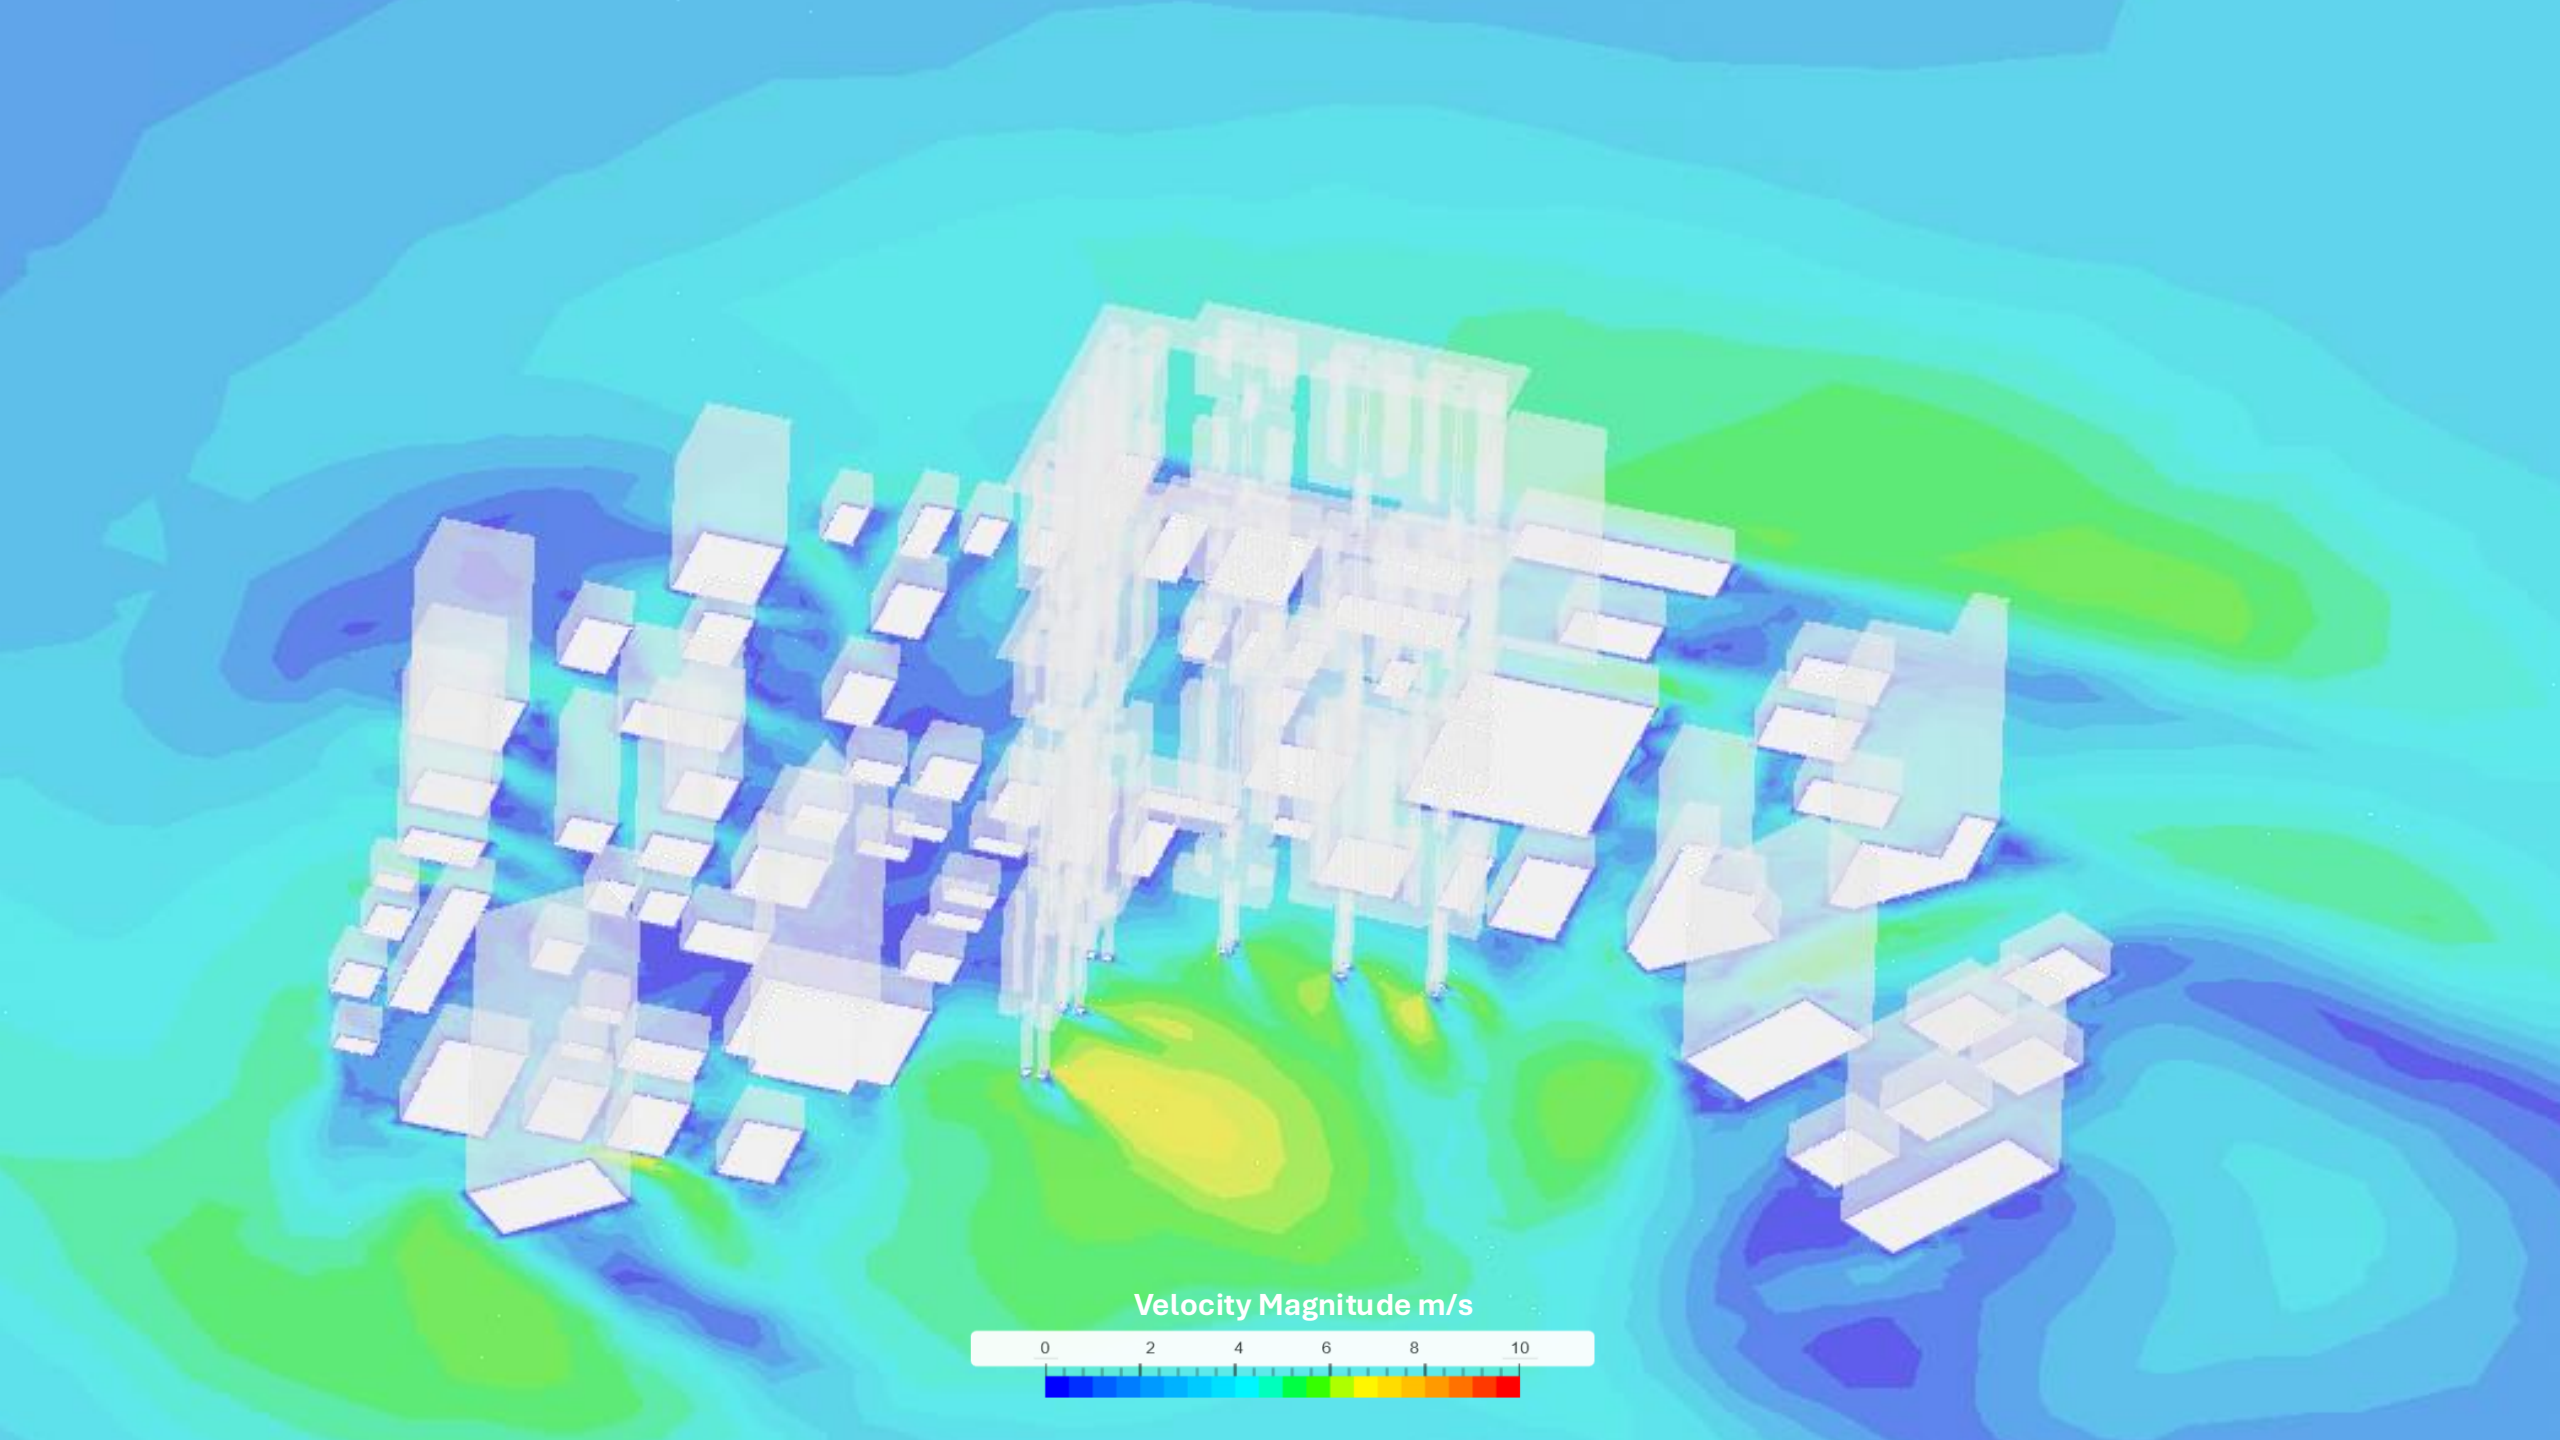


Velocity Magnitude m/s




Result Interpretation at 130M+ (Residential Zone)

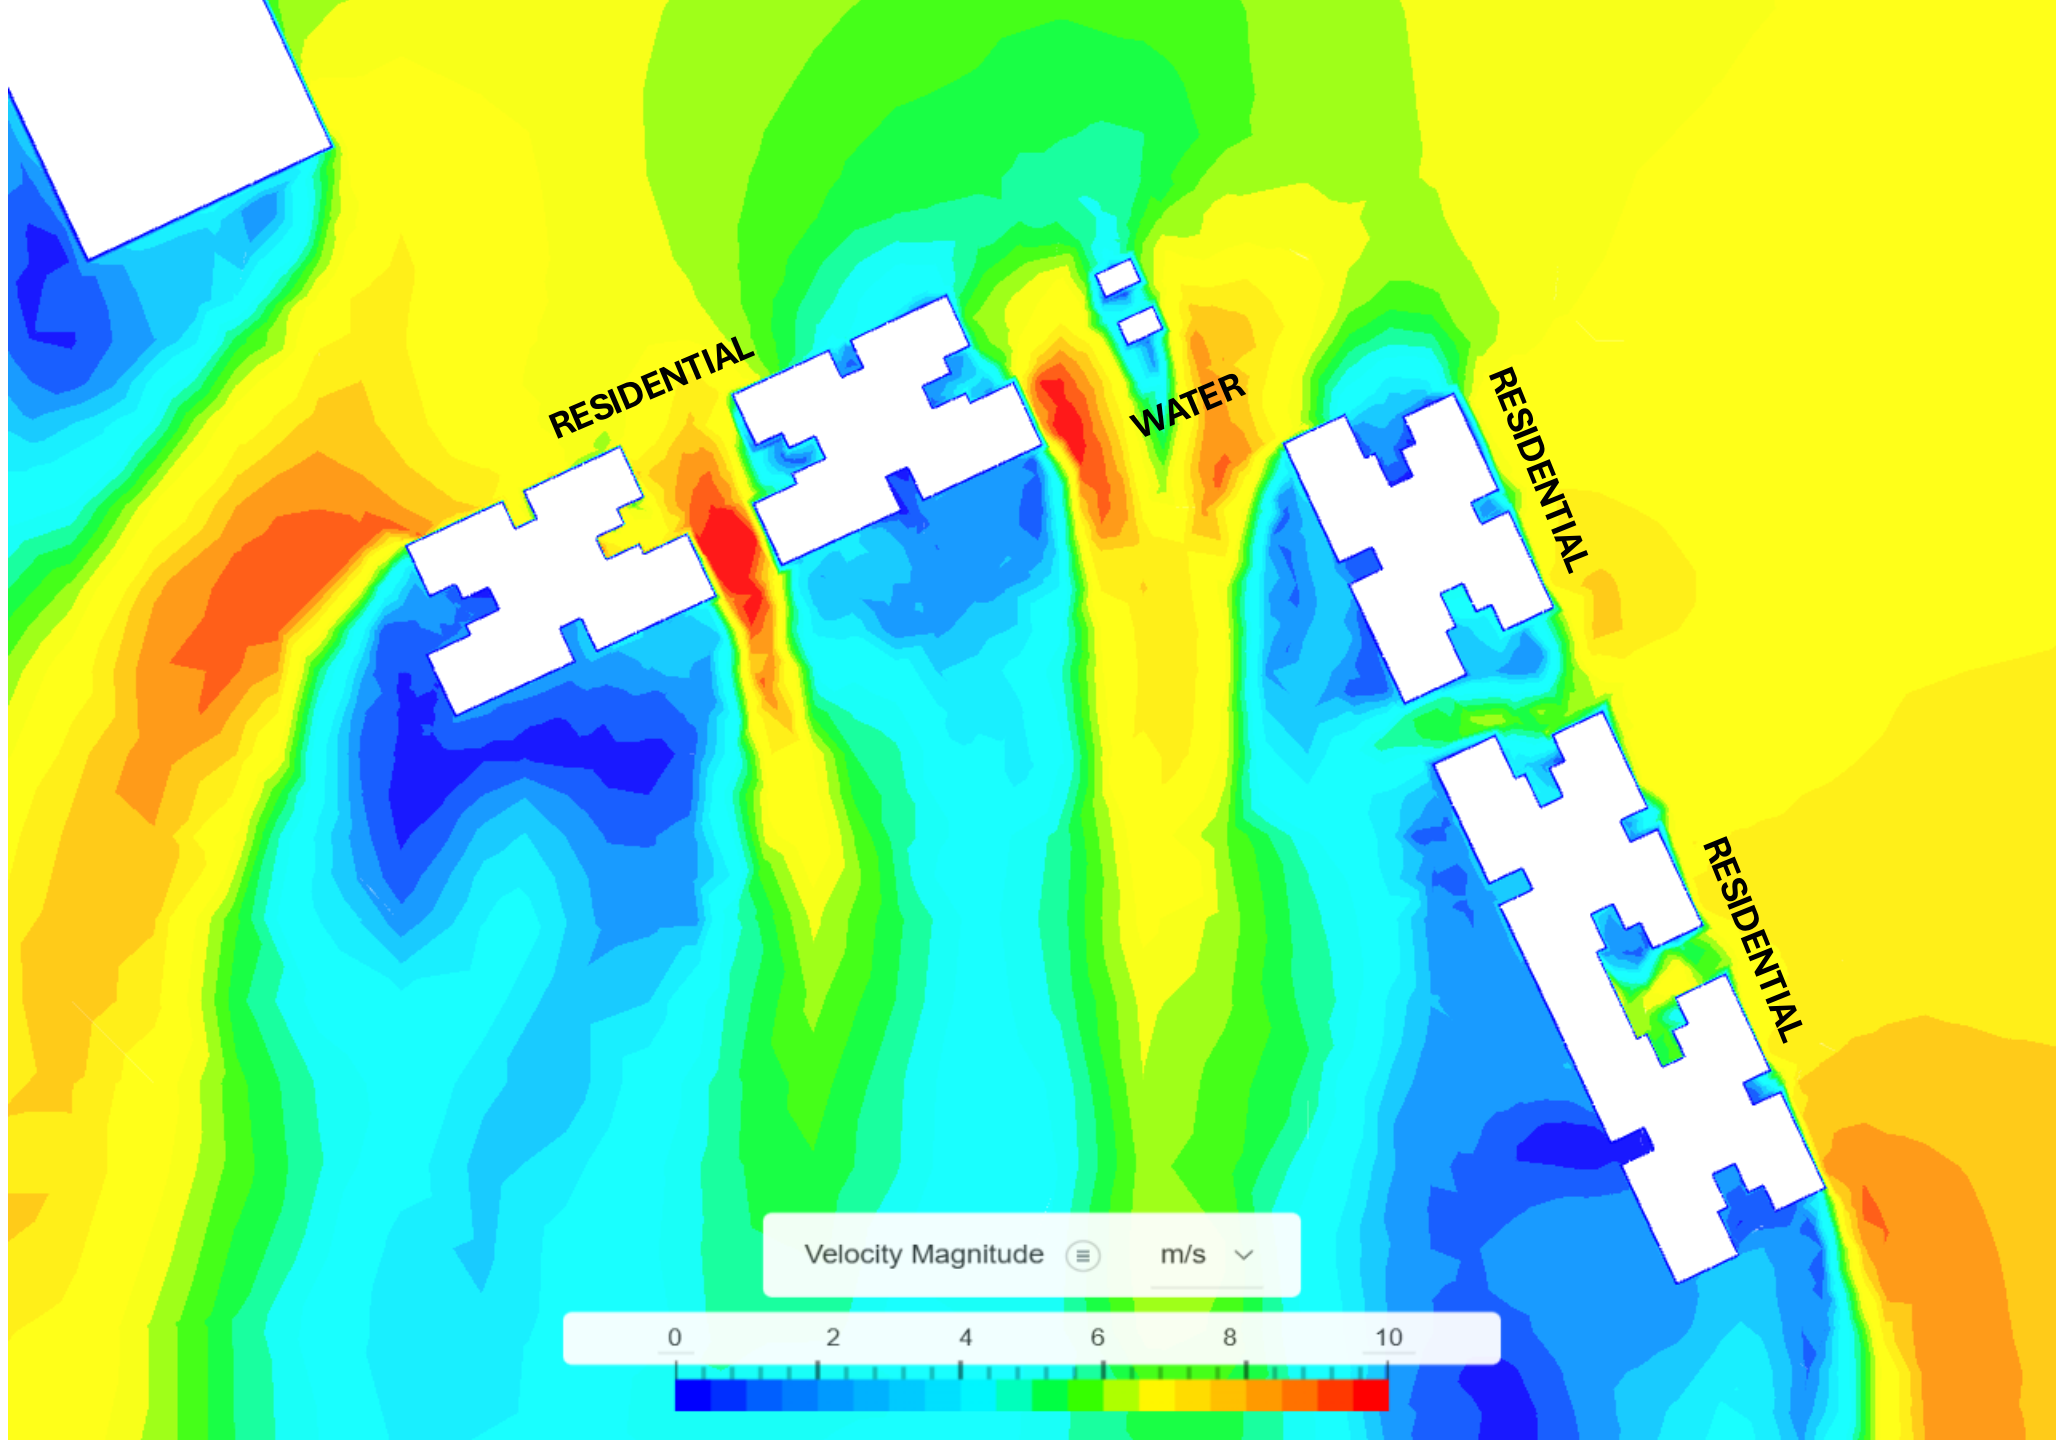


Result Interpretation at 300M+ (Water Reservoir)

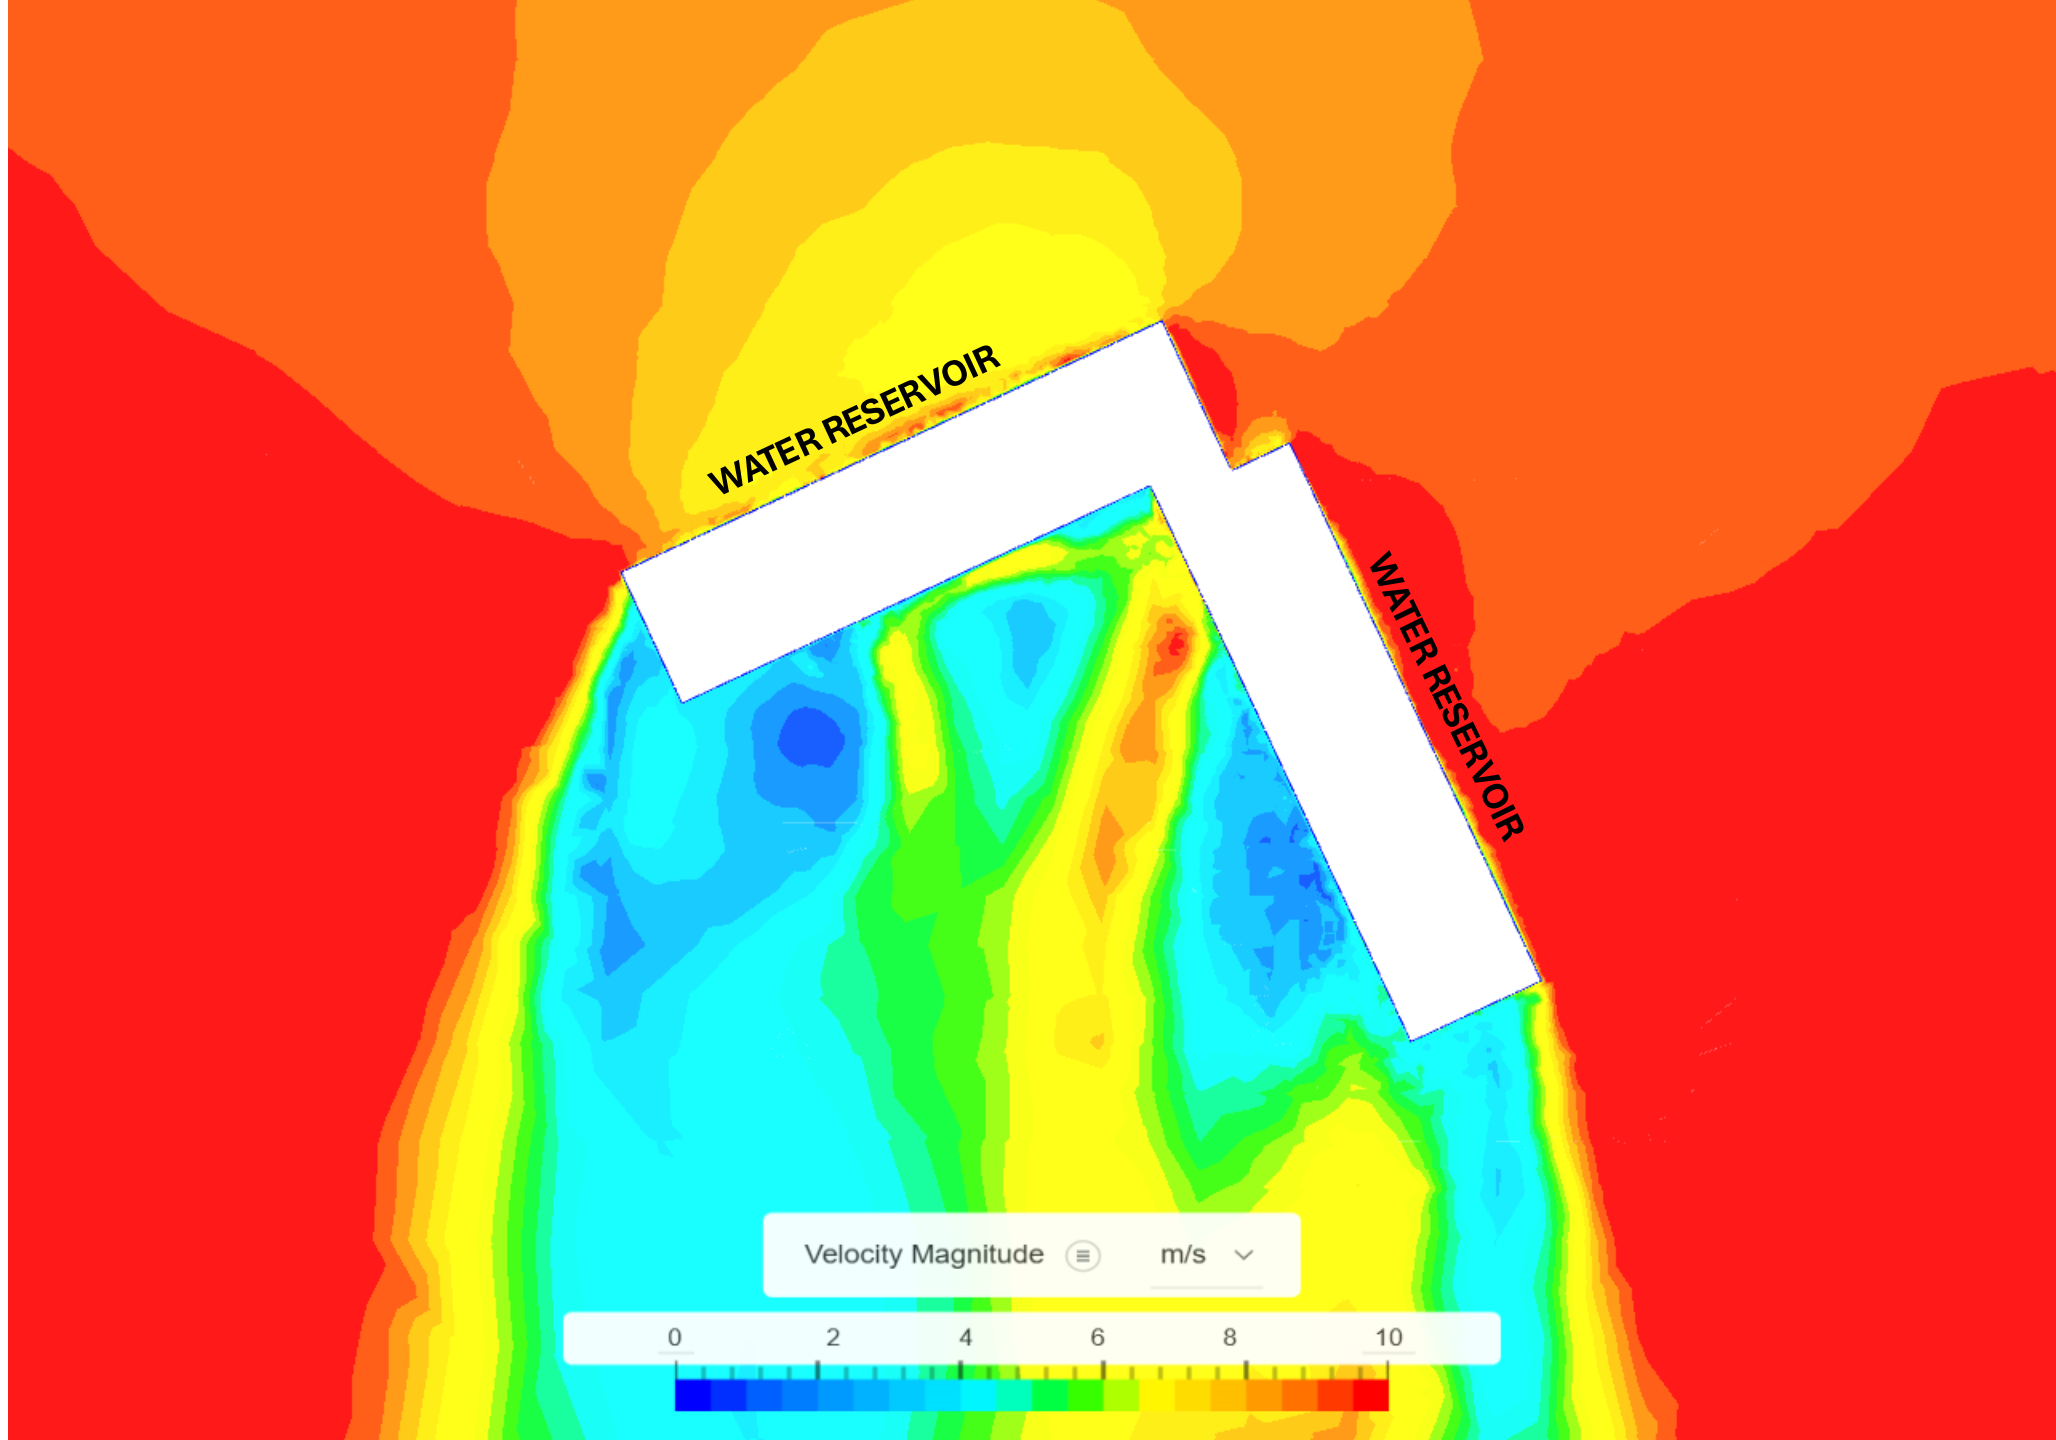

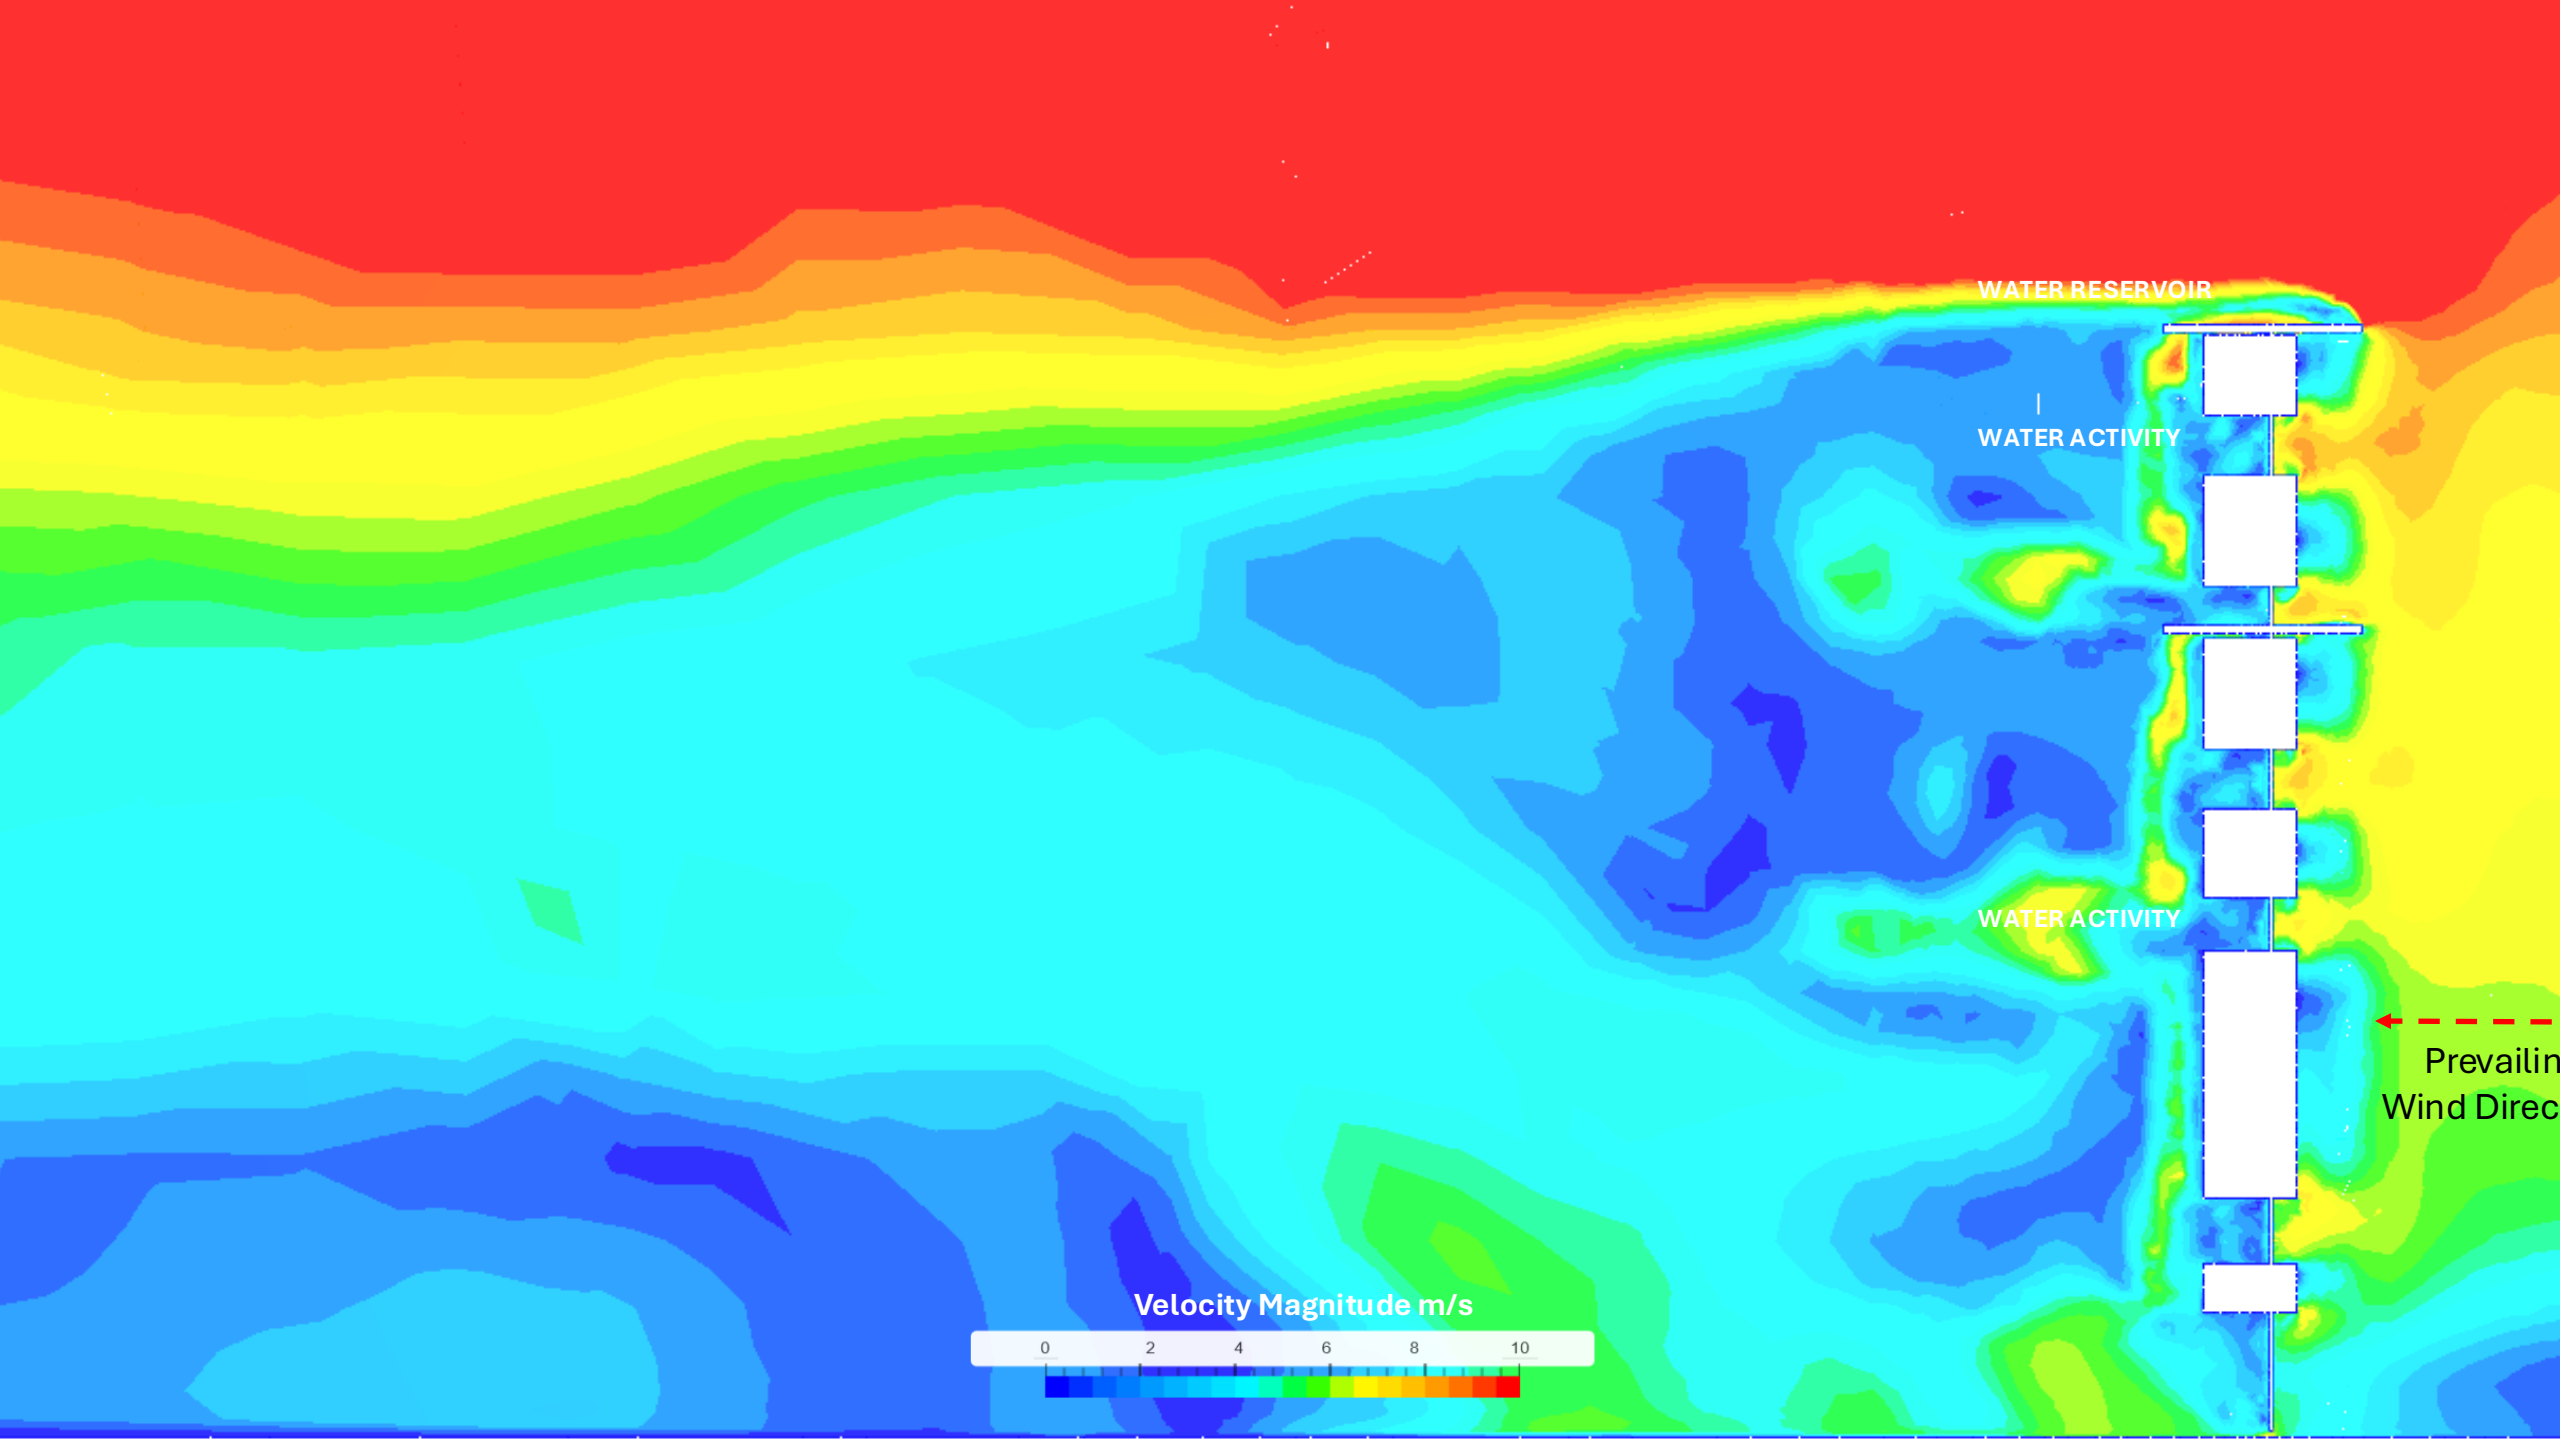


Internal Simulations


Indoor thermal comfort

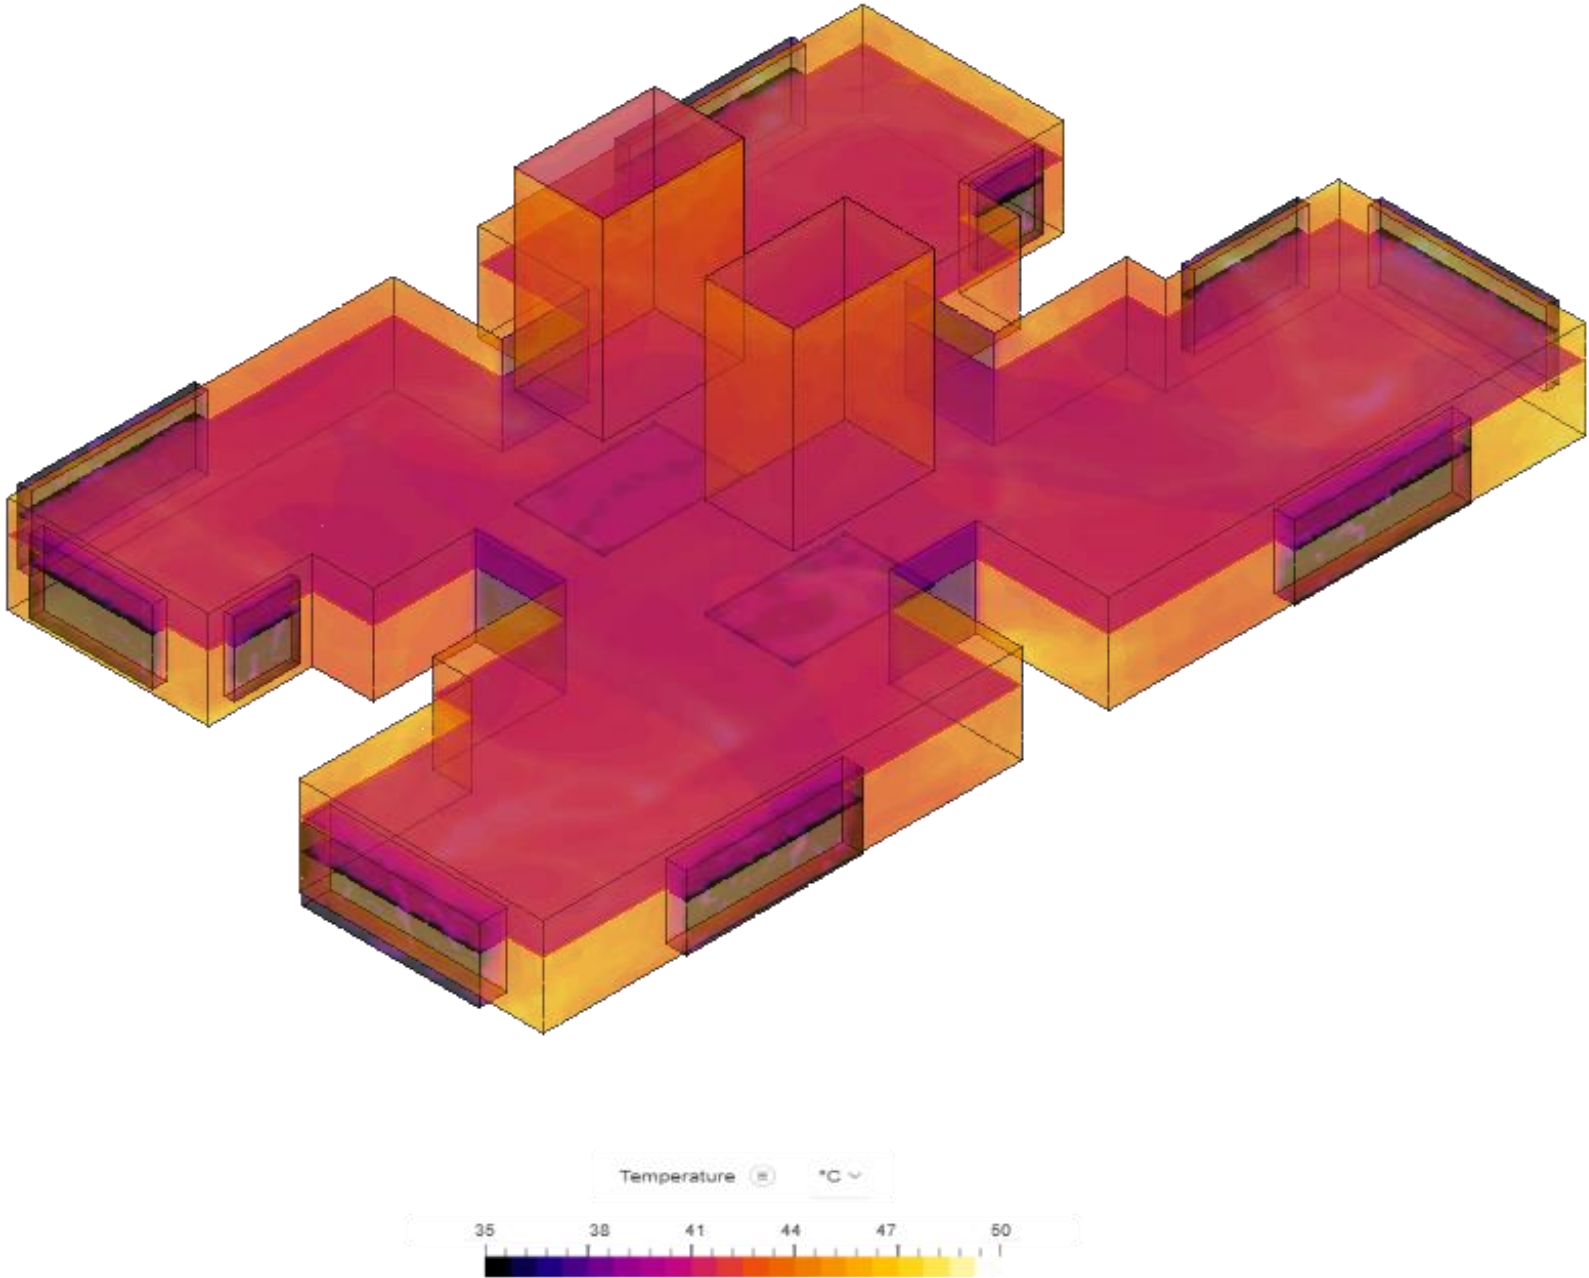


Indoor thermal comfort

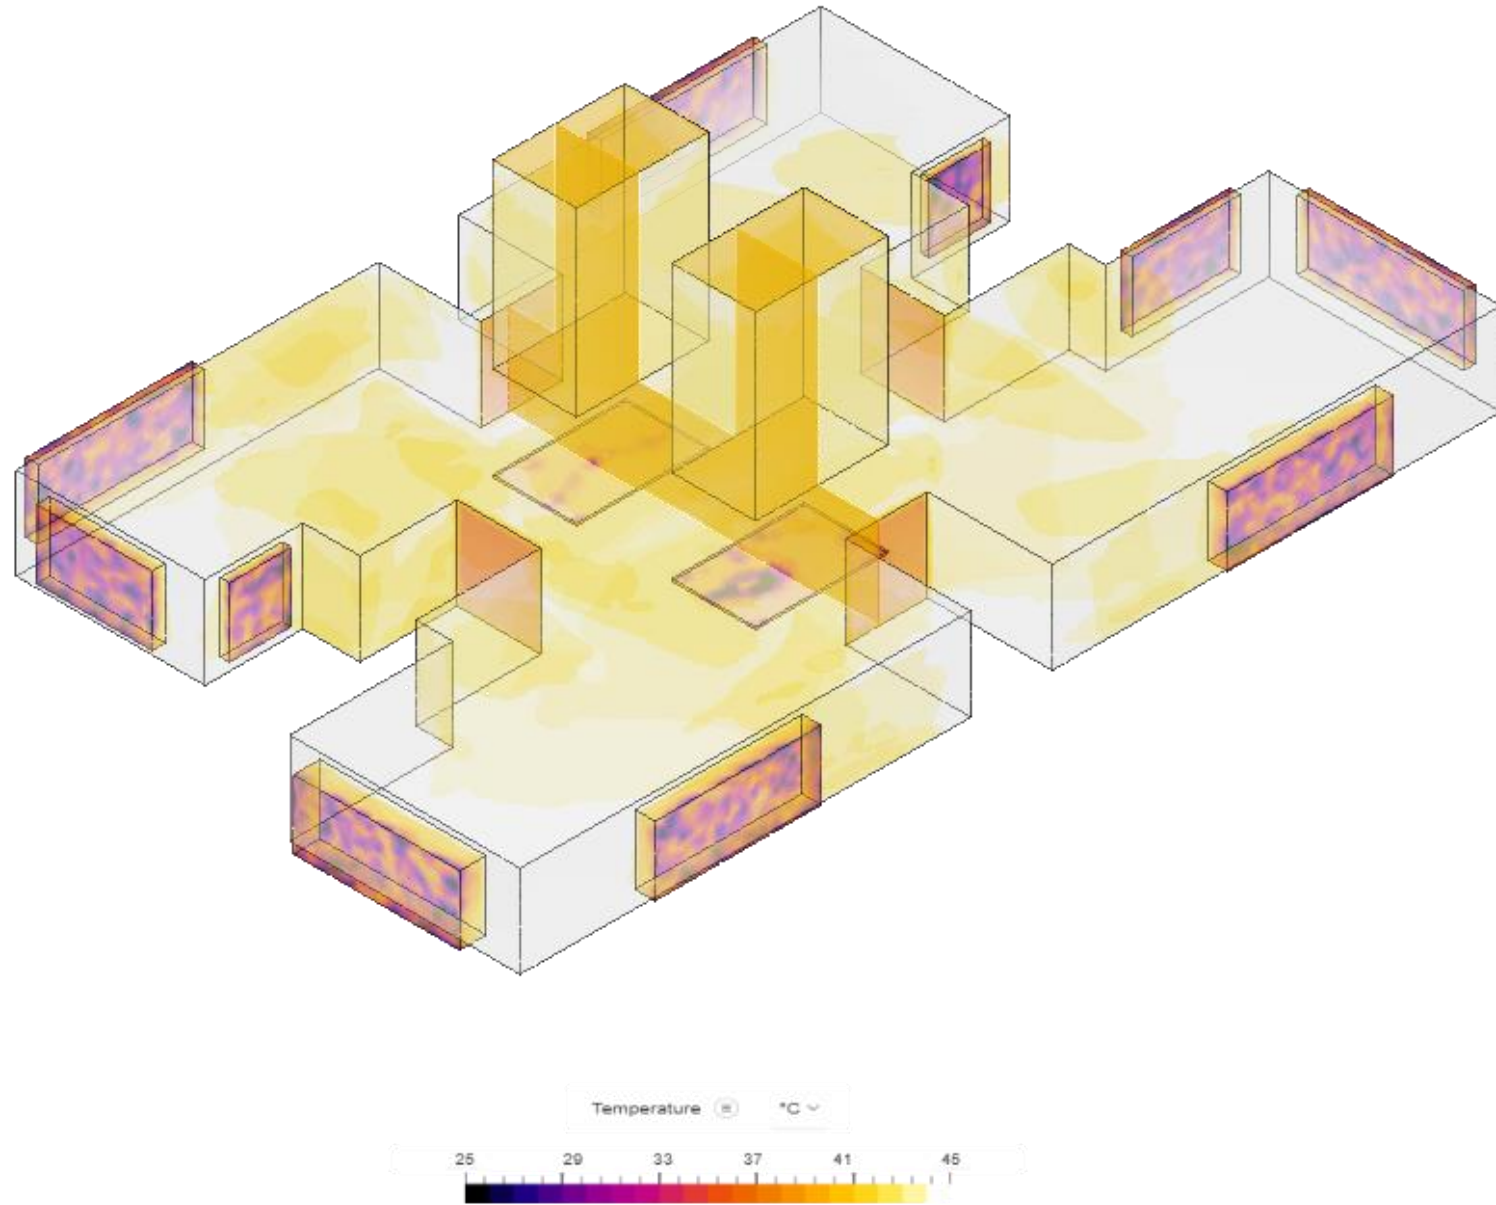



Air velocity and indoor patterns

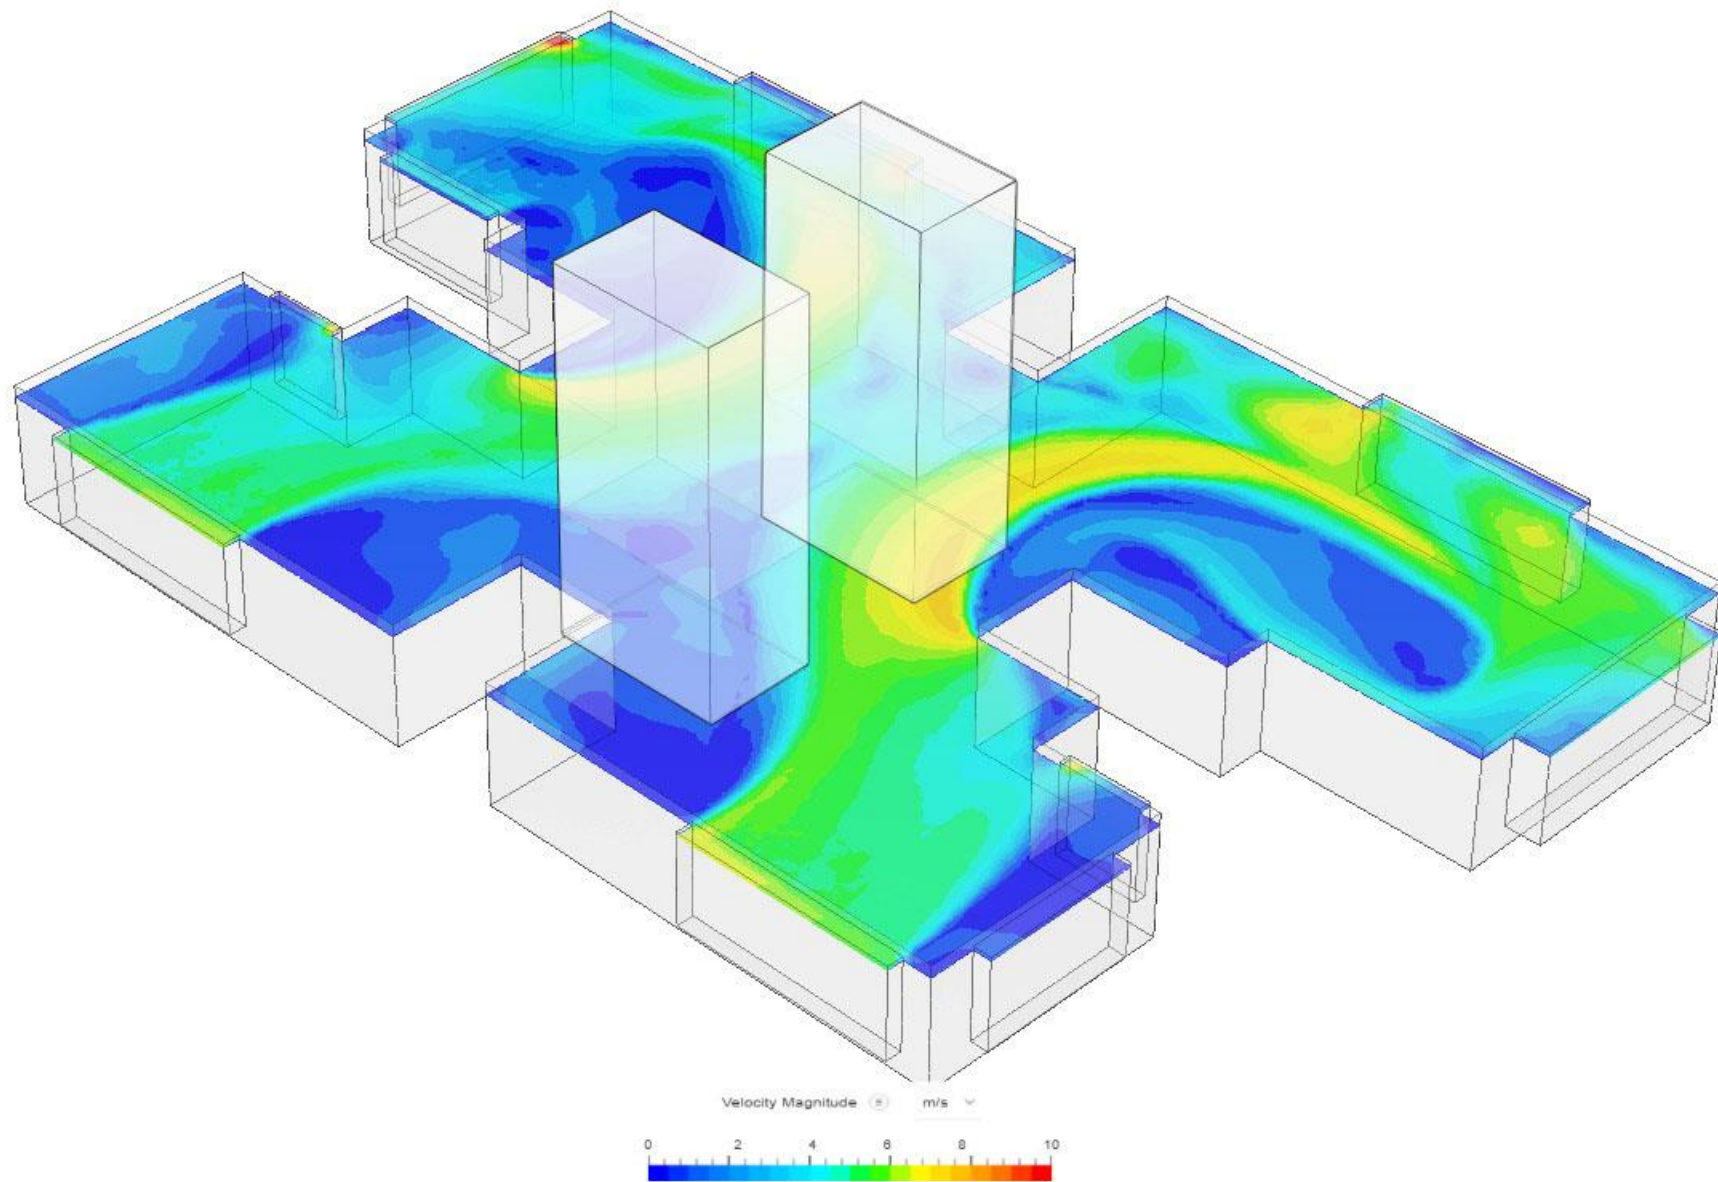

Air velocity and indoor patterns

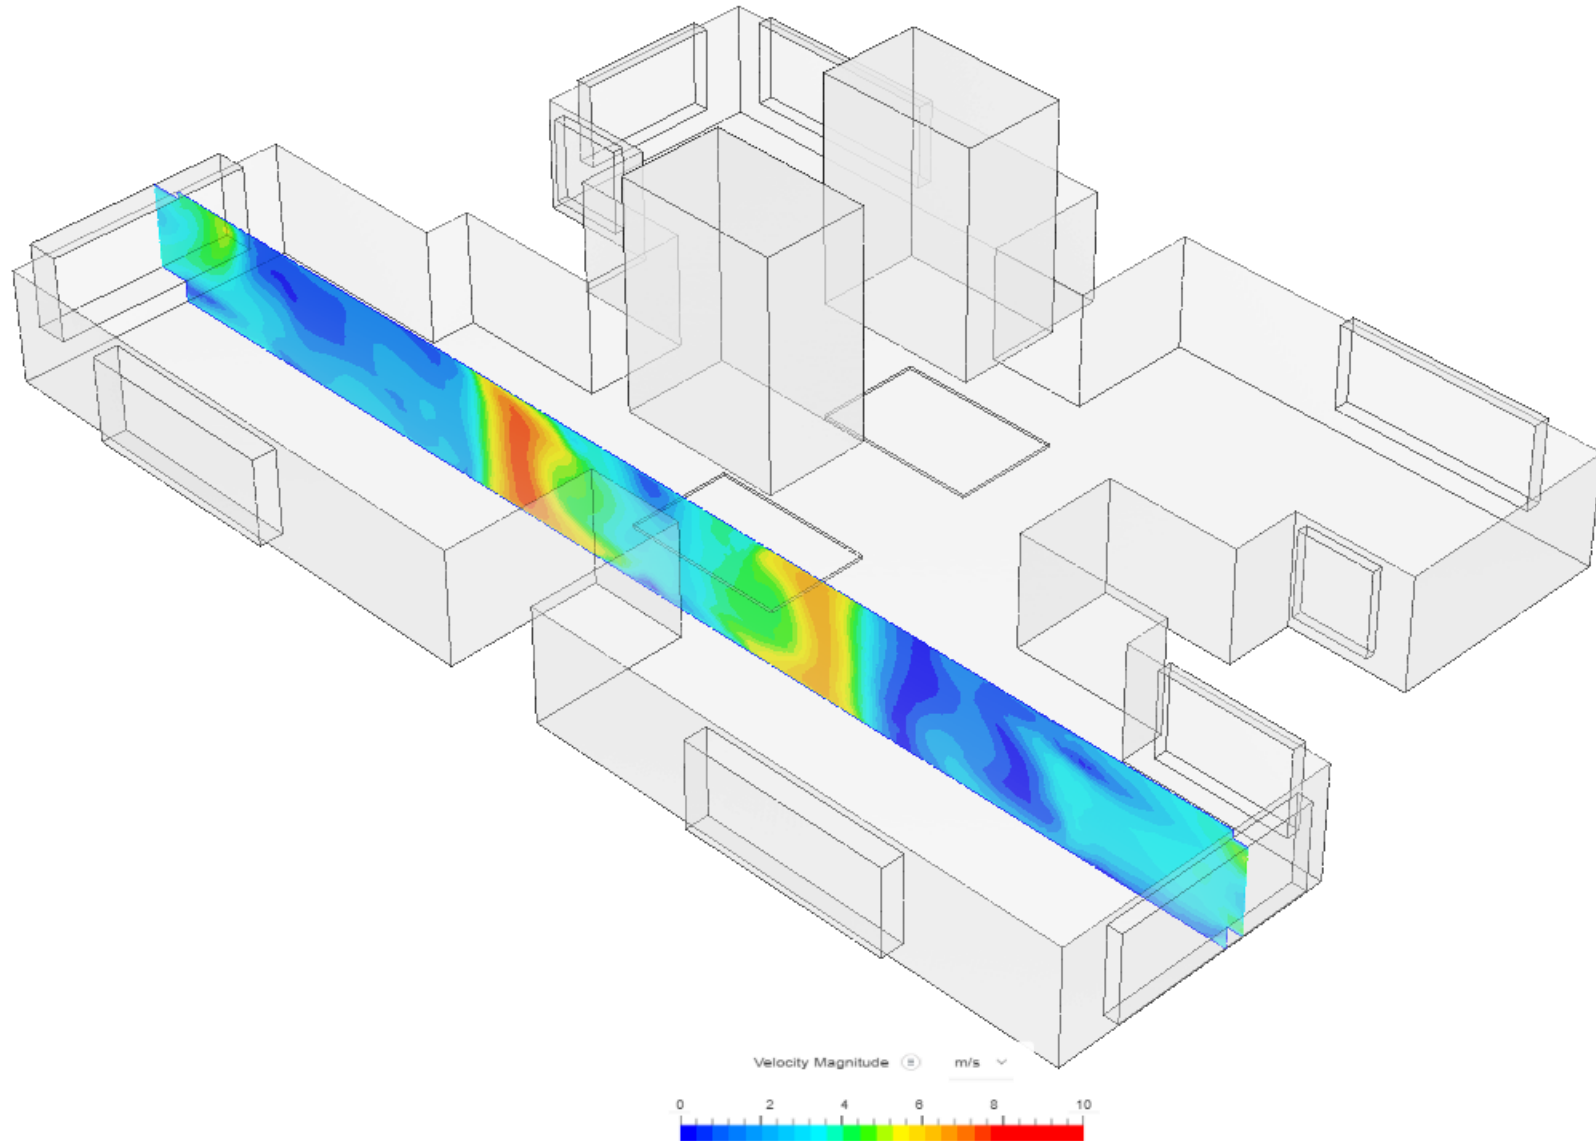

Air velocity and indoor patterns

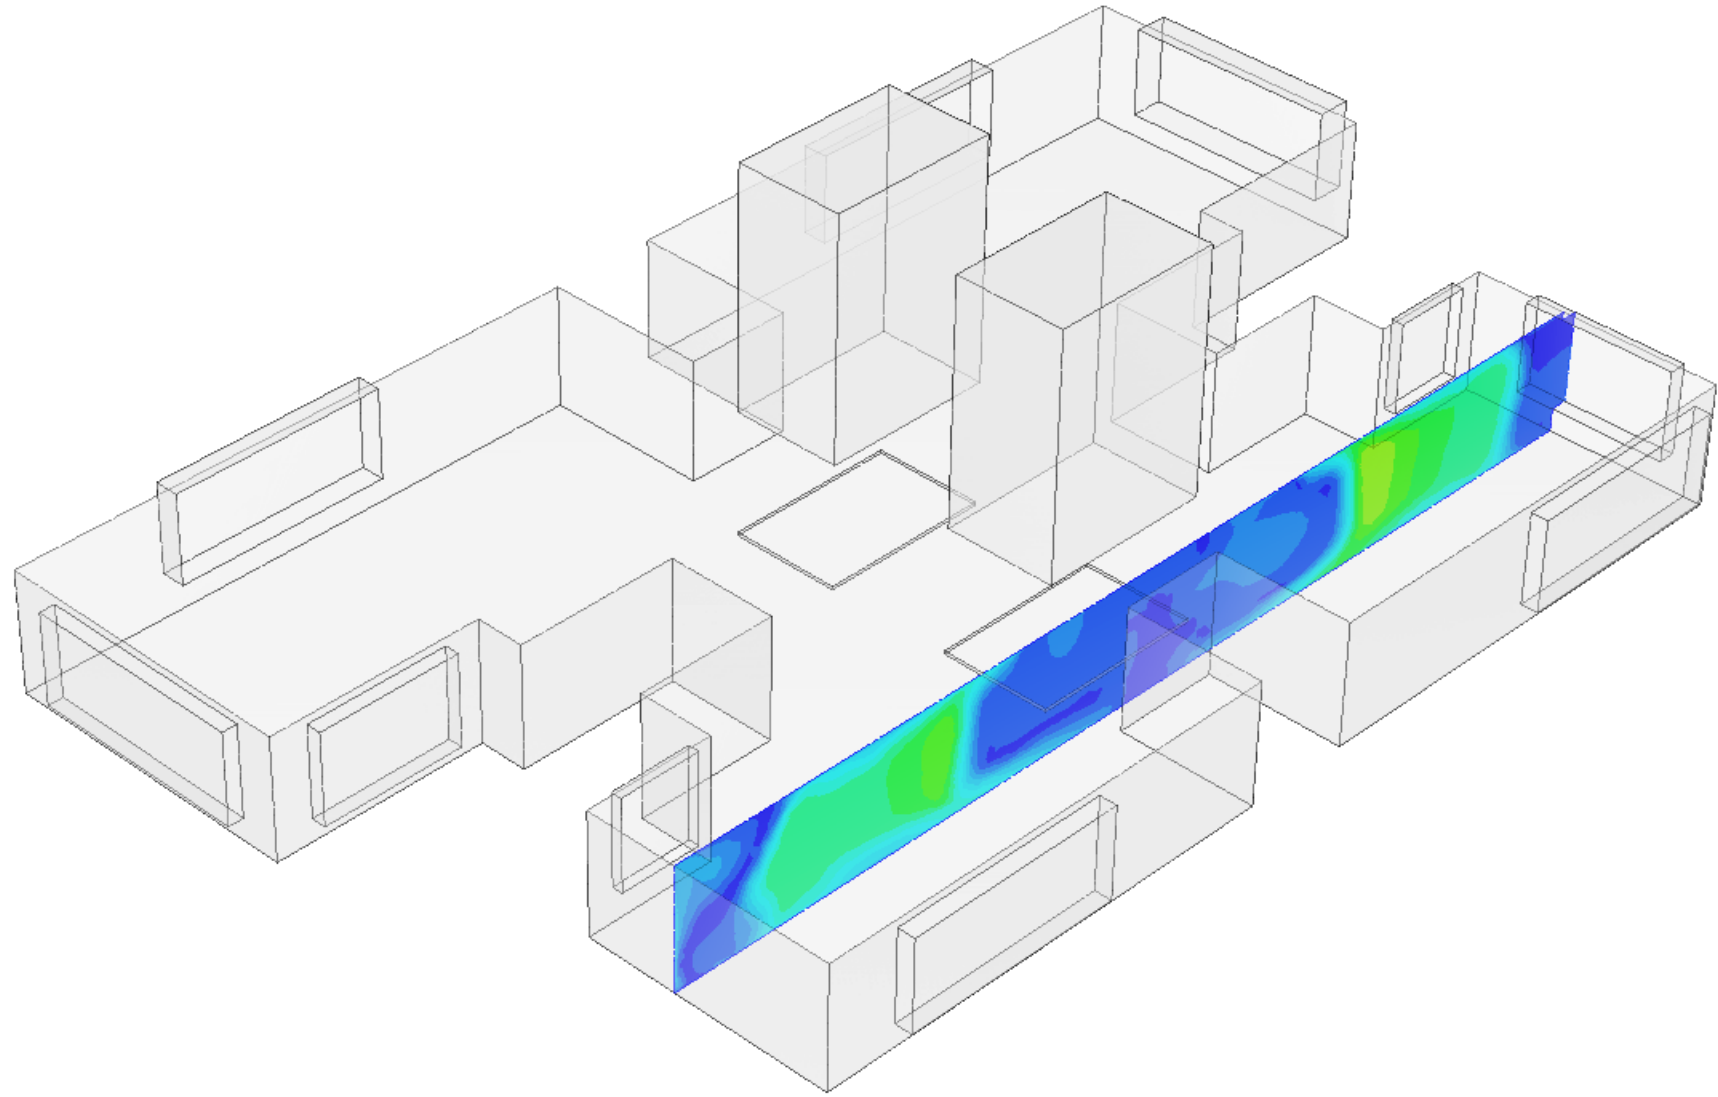


Design Strategies


Overall design strategies




Ground floor
Ventilation strategies

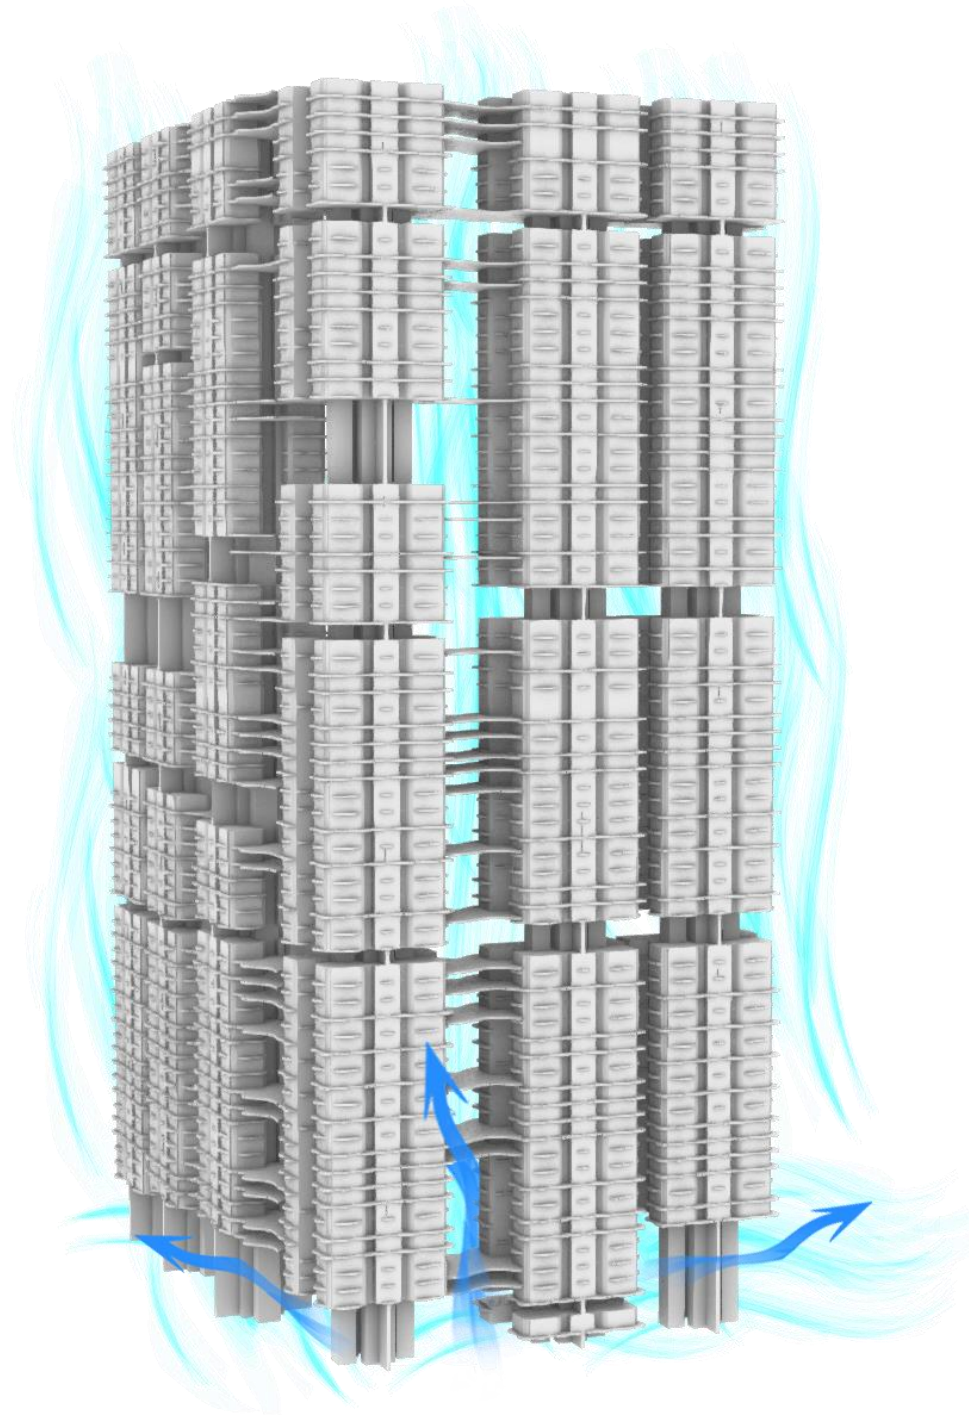

Ground floor
Ventilation strategies

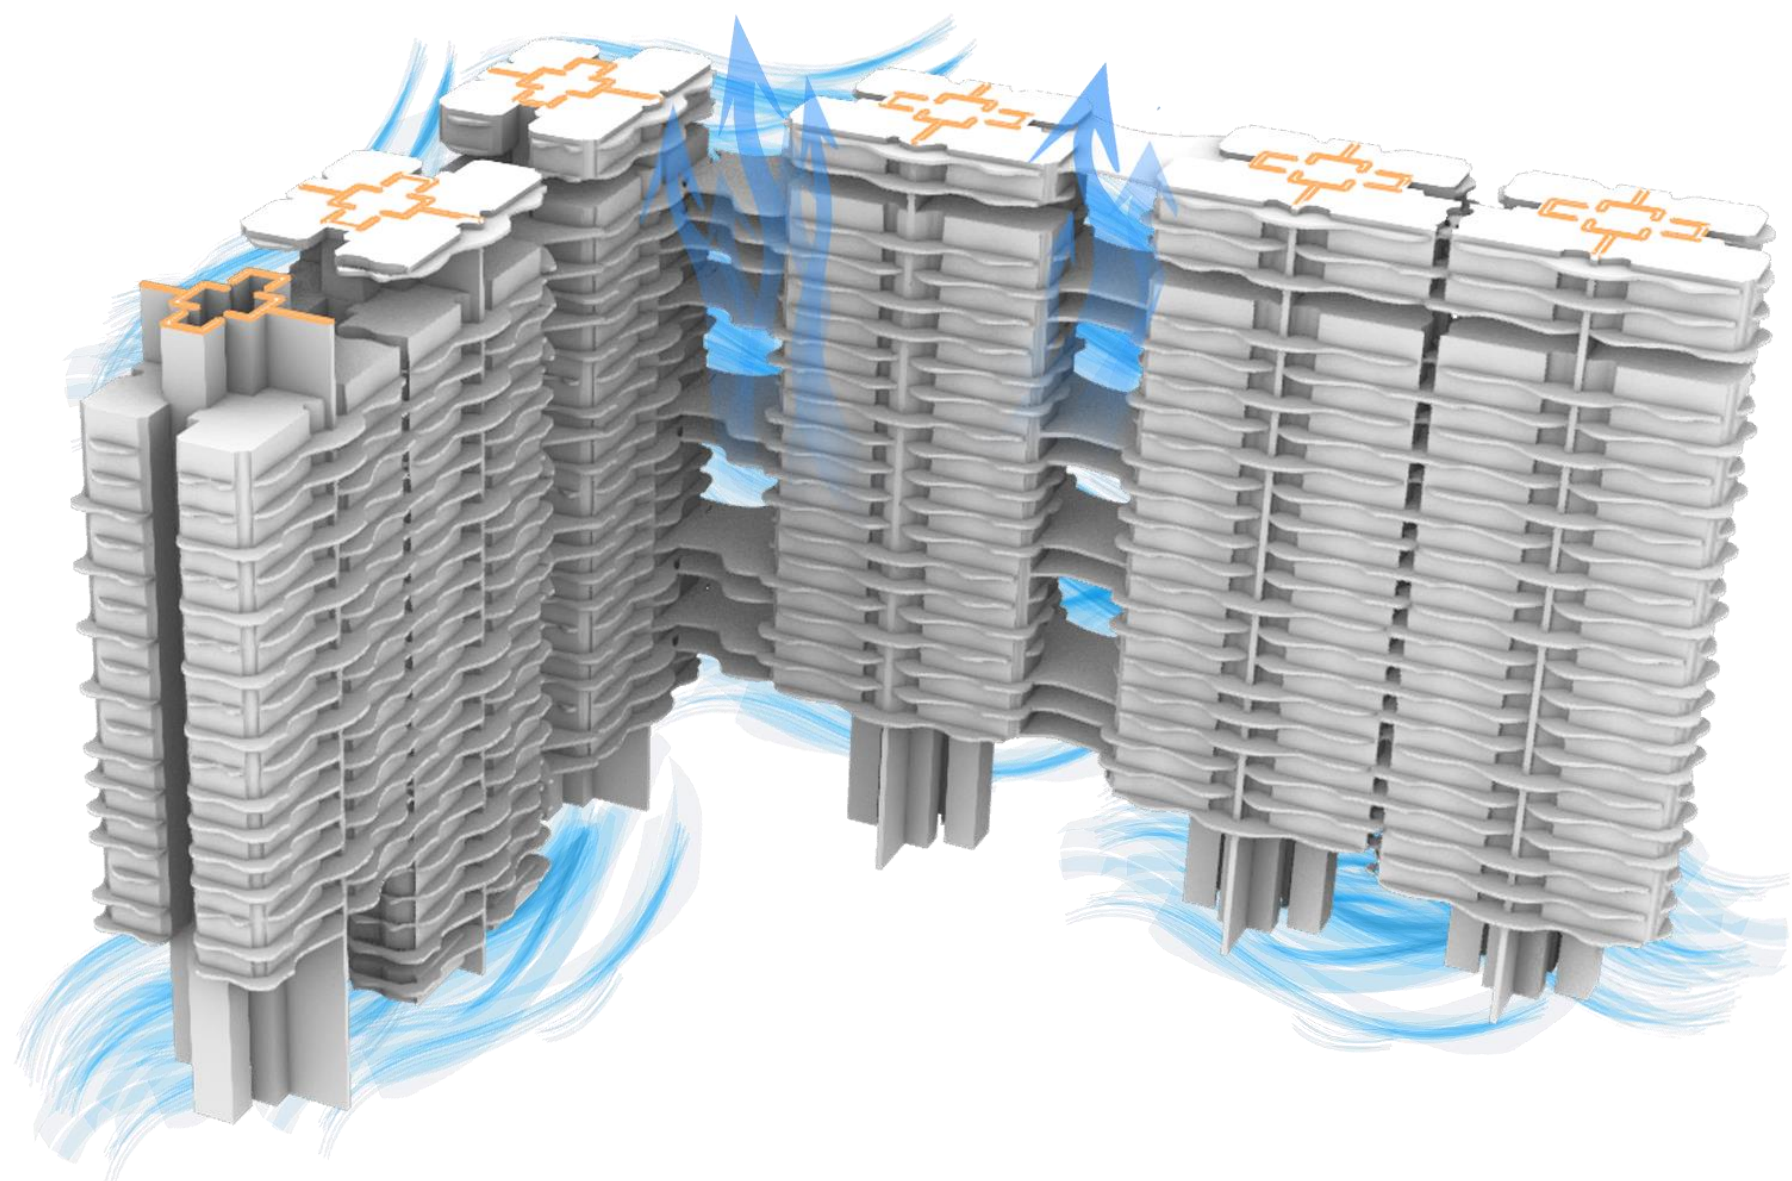

Residential Units
Ventilation Strategies

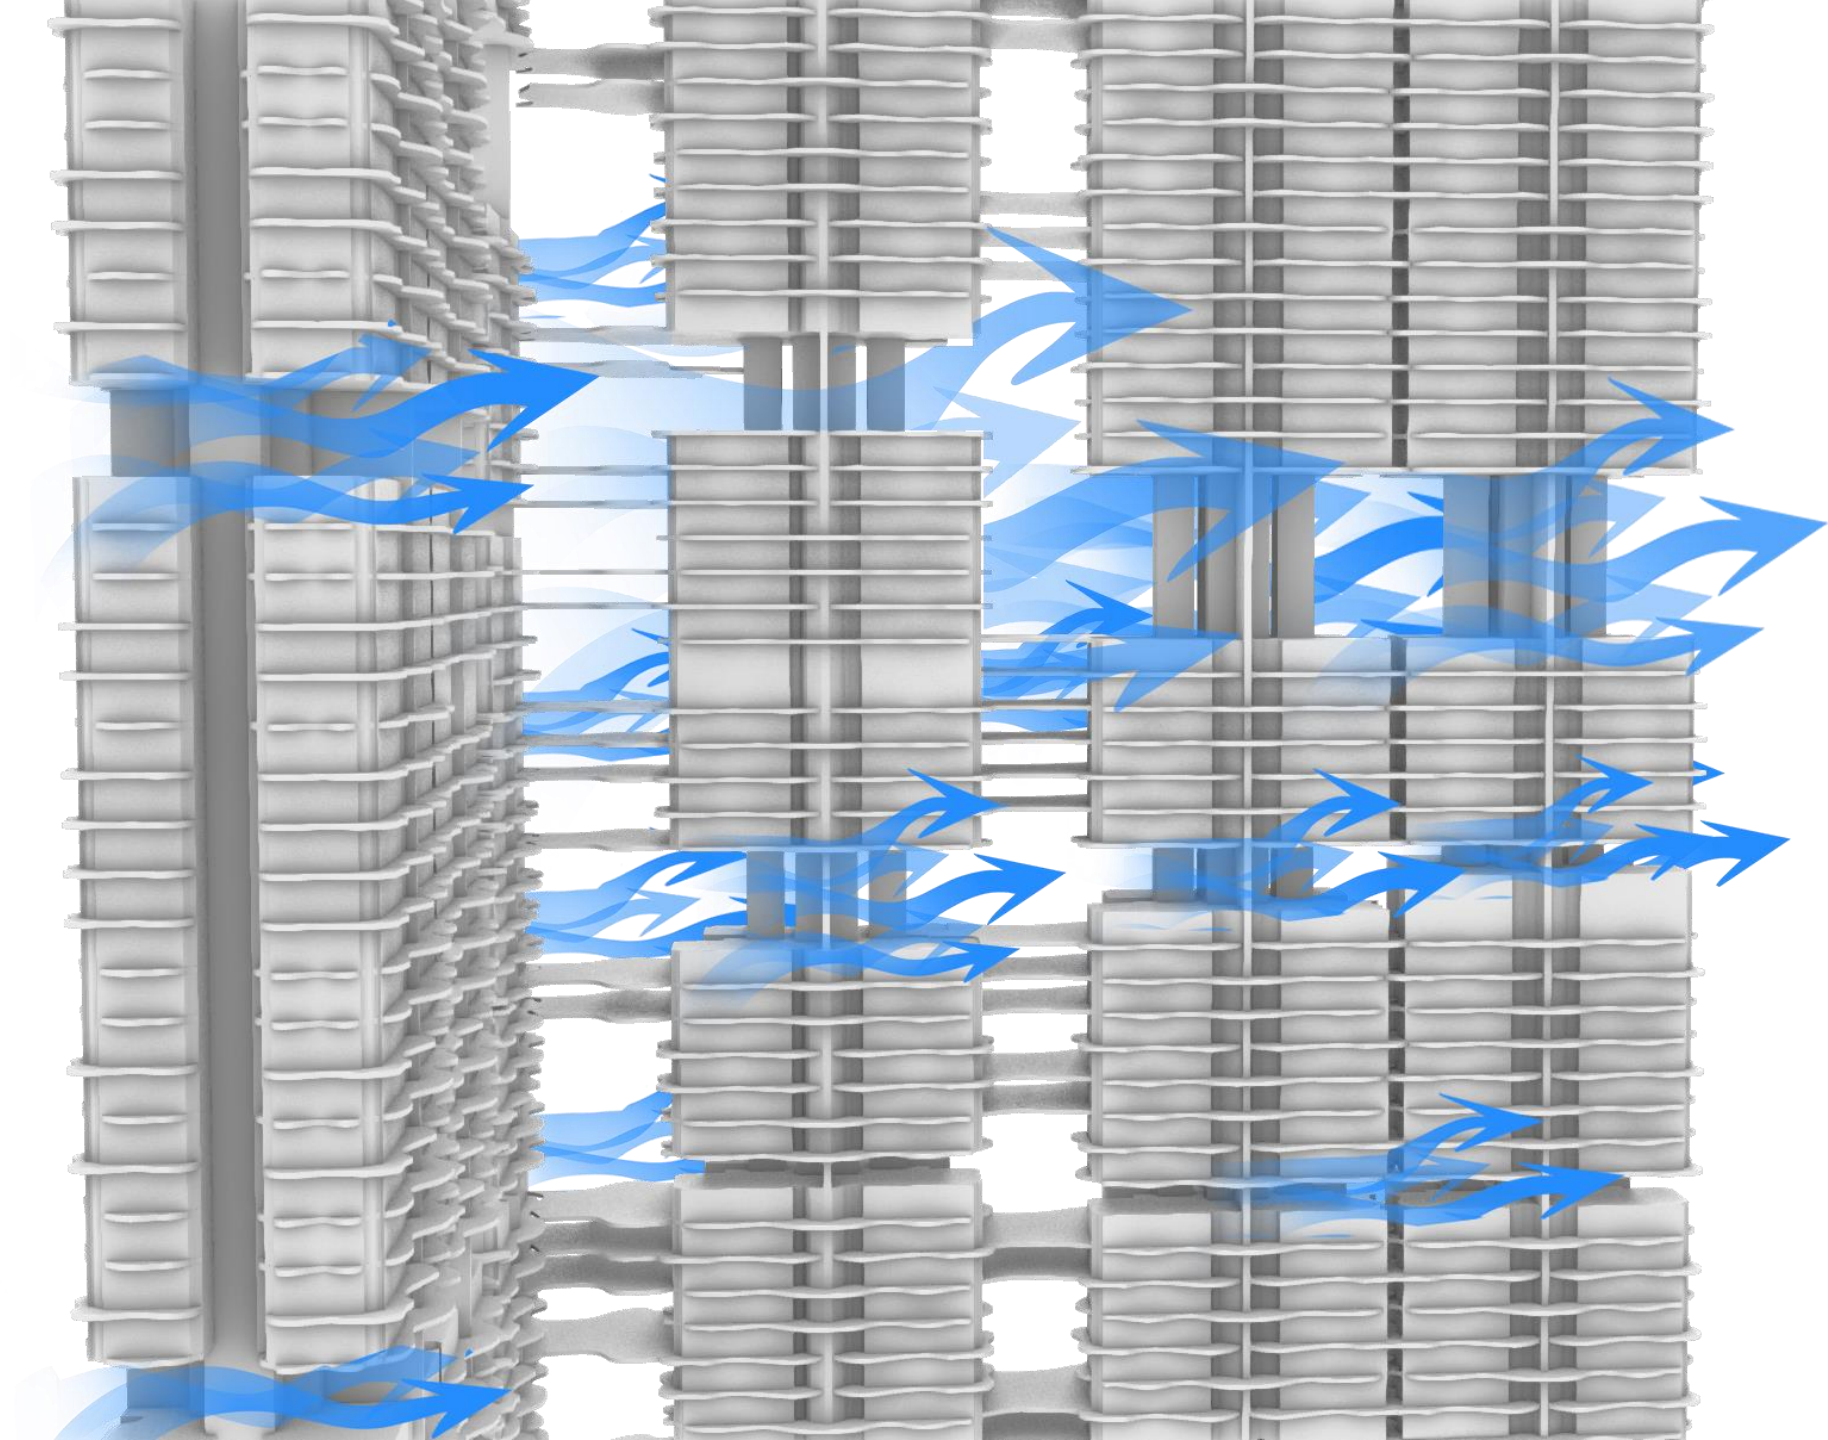

Design strategy:
Balconies

