


Component ablation under both training protocols (matched seeds, matched in-run baseline); the variant ranking differs by protocol and must not be pooled

24 → 1 — component ablation (test split, seeds 2024-2026)



168 → 6 — component ablation (test split, seeds 2024-2026)

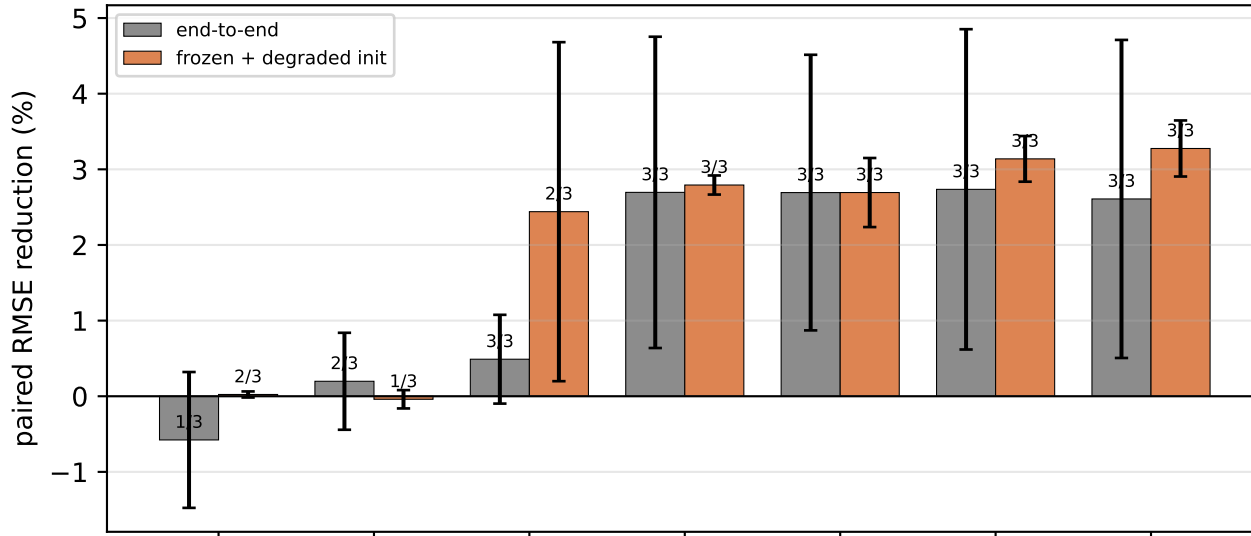