


QfO SwissTrees: limited parameter sensitivity

Six one-at-a-time changes of 20% | 18 reference families | development-exposed

6/6 contrasts estimated; unavailable arms are not zero. No default selection.

Configuration	F1 (%)	Precision (%)	Recall (%)
Frozen control	83.351	95.518	73.934
CPM = 0.08	79.101	92.771	68.943
CPM = 0.12	83.253	95.461	73.813
Min. norm = 0.024	83.351	95.518	73.934
Min. norm = 0.036	83.351	95.518	73.934
Min. margin = 1.2	82.839	95.569	73.102
Min. margin = 1.8	83.565	95.603	74.219

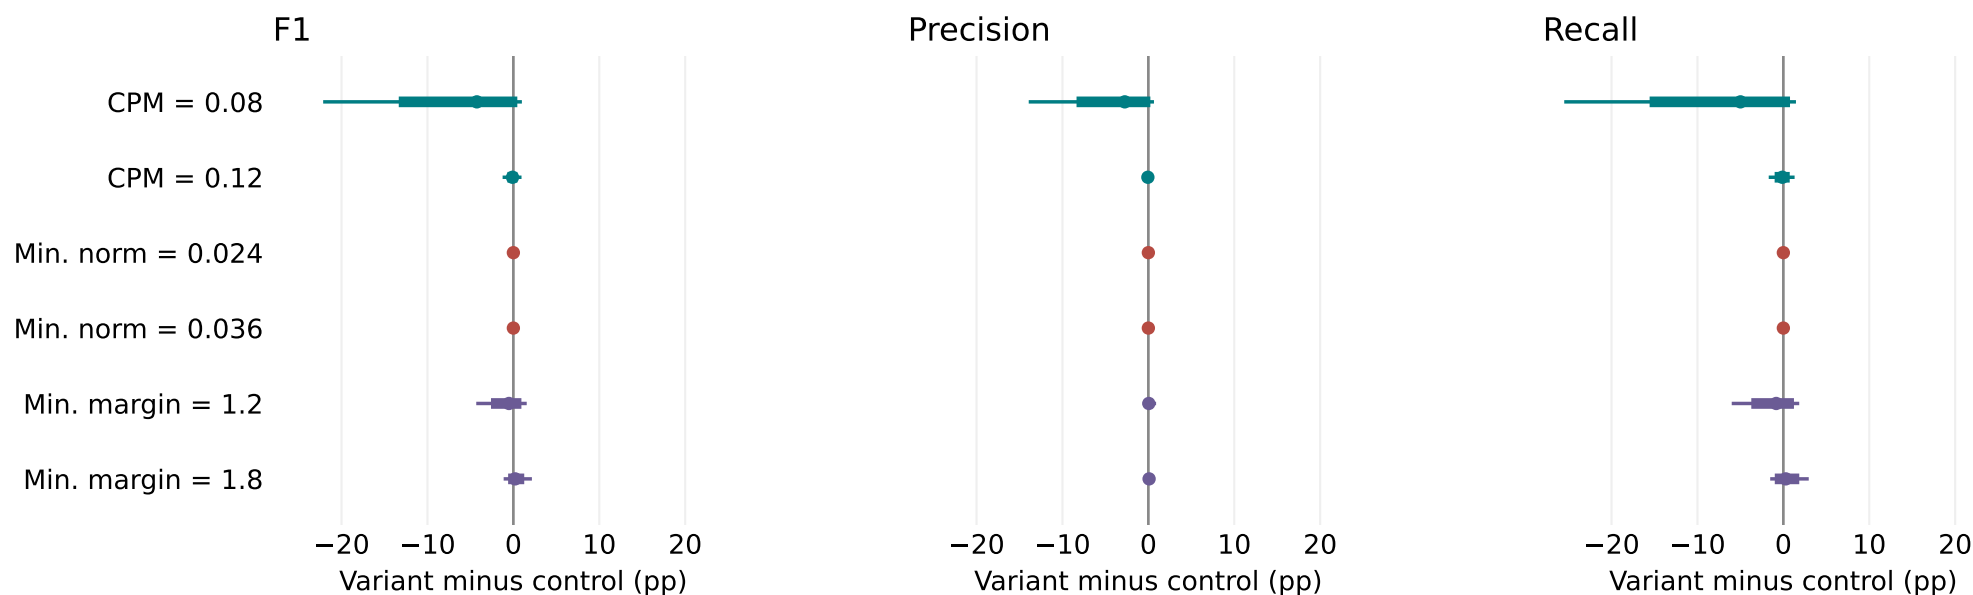

Thick: paired 95% CI. Thin: Bonferroni CI over all 18 planned endpoints; 100,000 draws, seed 20260925.

F1 is recomputed from macro precision and recall per draw; missing contrasts retain their places.

No independent confirmation, selection adjustment, OrthoFinder superiority test or controlled timing is shown.

Intervals including zero do not establish equivalence. No other-endpoint or secondary-mean uncertainty is shown.