


Random-circuit null (50 circuits, mean ablation)

Accuracy (pct 6.0, p 0.941)



Logit Diff (pct 96.0, p 0.059)

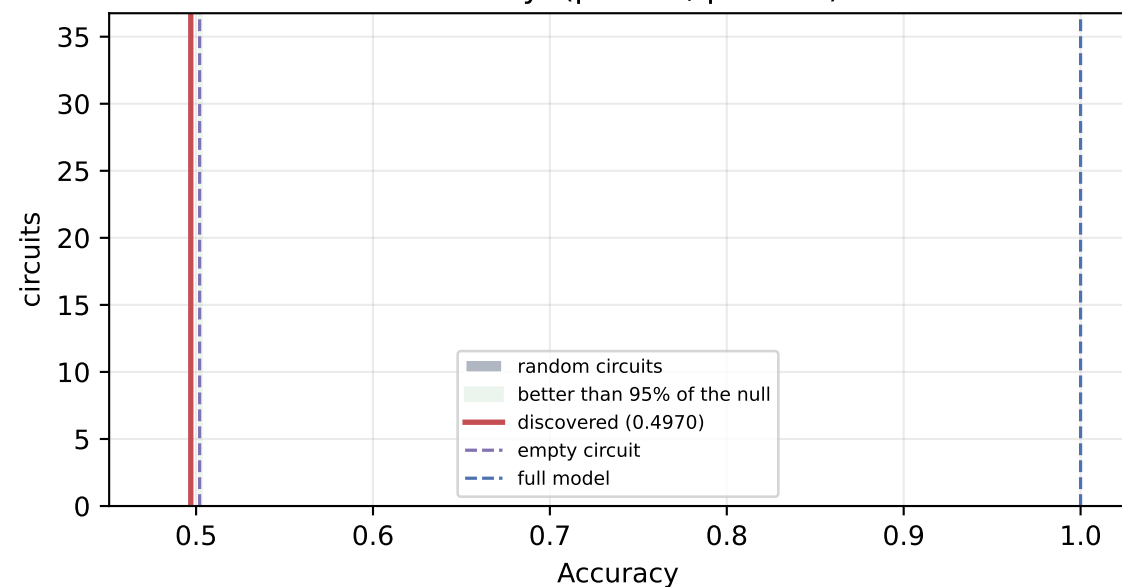