



Random-circuit null (50 circuits, mean ablation)


Accuracy (pct 76.0, p 0.255)

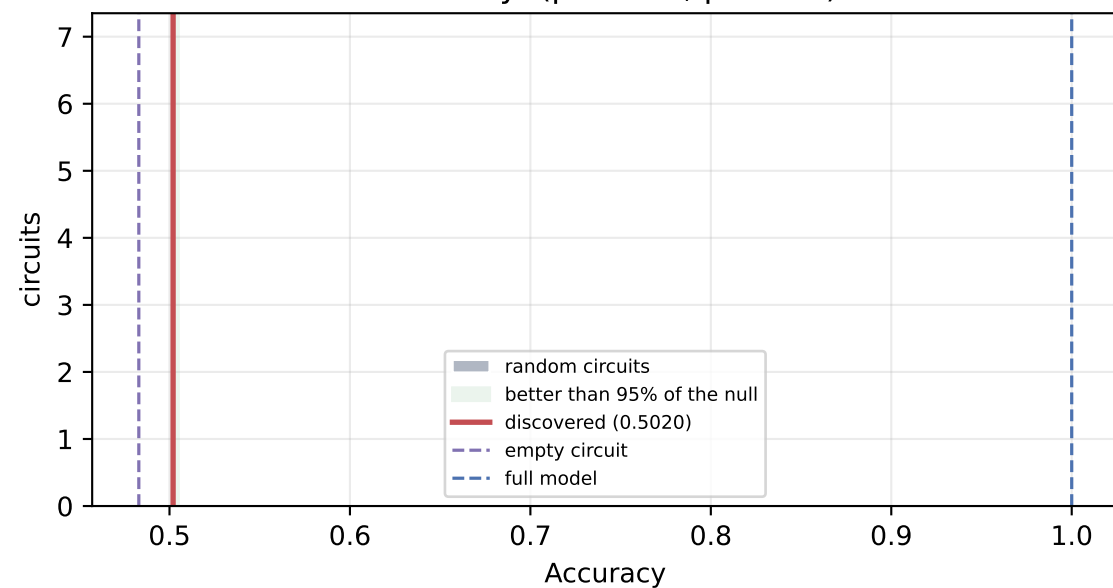

Logit Diff (pct 54.0, p 0.471)

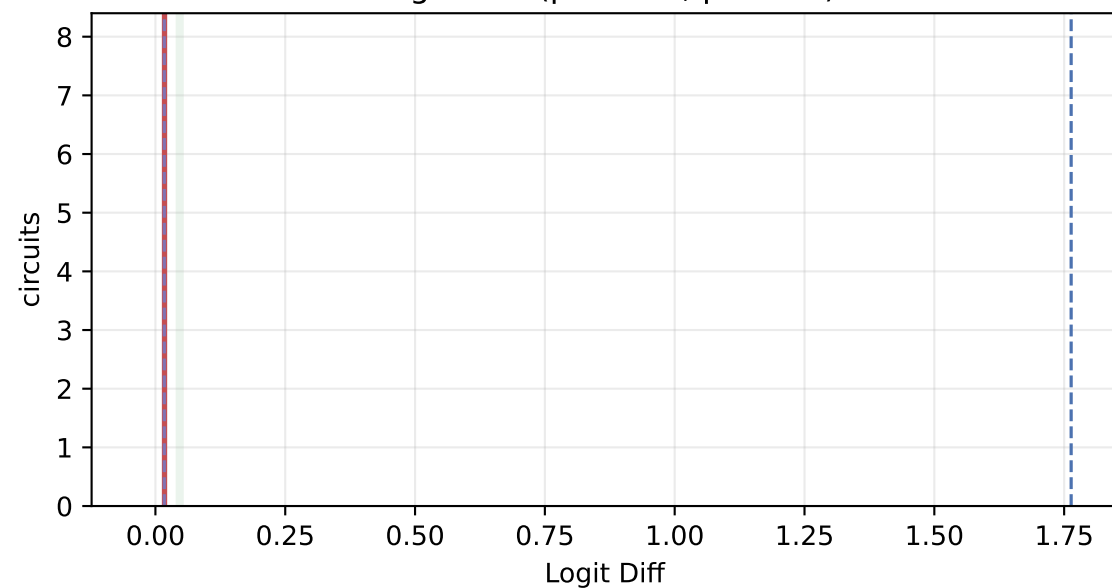

KL Div (pct 94.0, p 0.078)

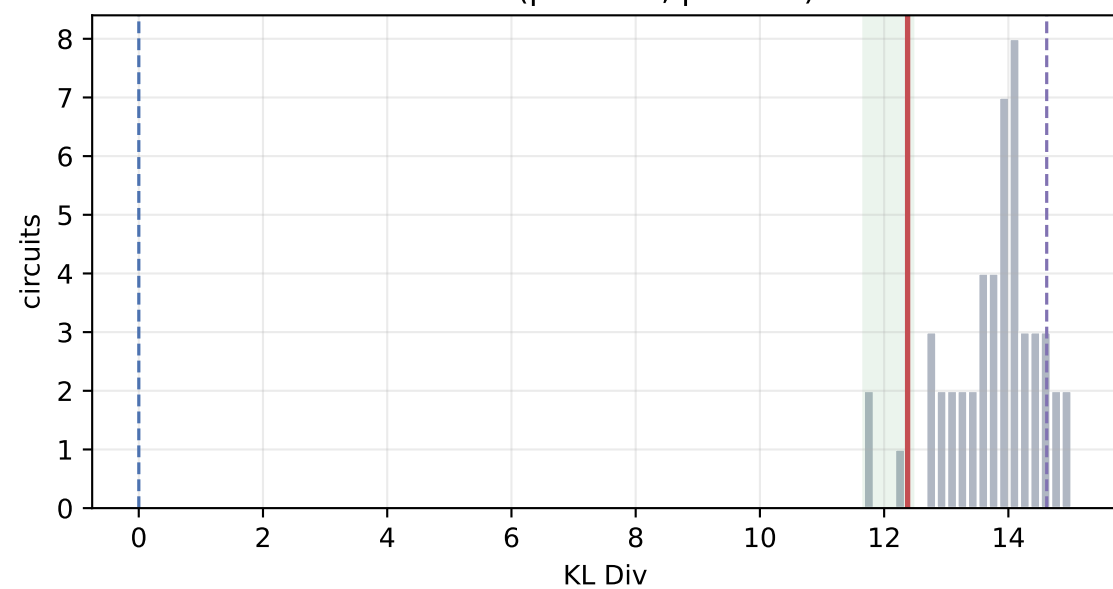

Exact Match (pct 0.0, p 1.000)

