



Random-circuit null (50 circuits, mean ablation)


Accuracy (pct 0.0, p 1.000)

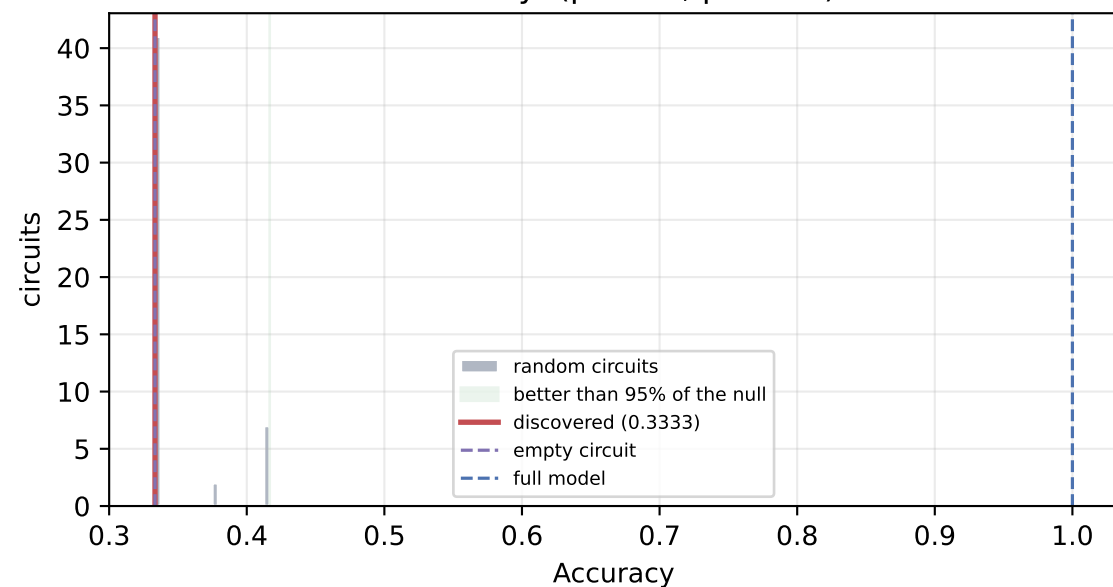

Logit Diff (pct 8.0, p 0.922)

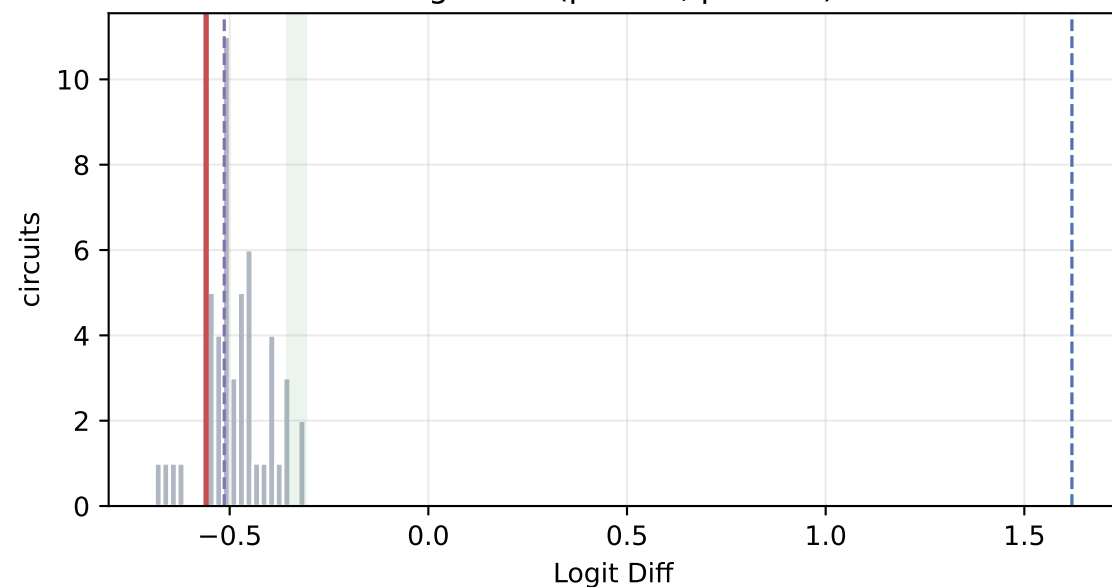

KL Div (pct 86.0, p 0.157)

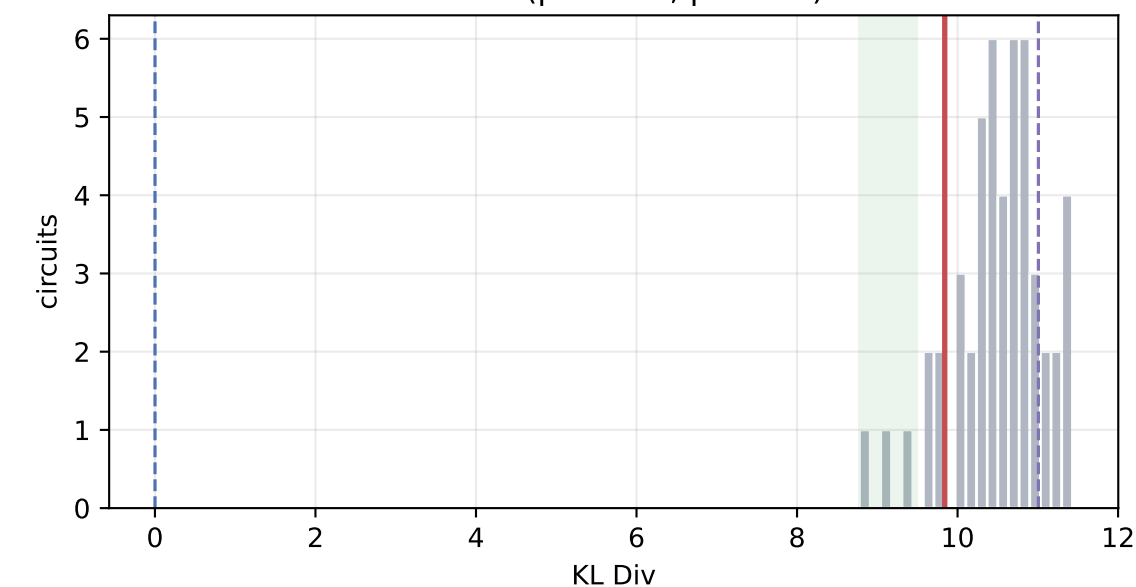

Exact Match (pct 0.0, p 1.000)

