



Random-circuit null (50 circuits, zero ablation)


Accuracy (pct 24.0, p 0.765)

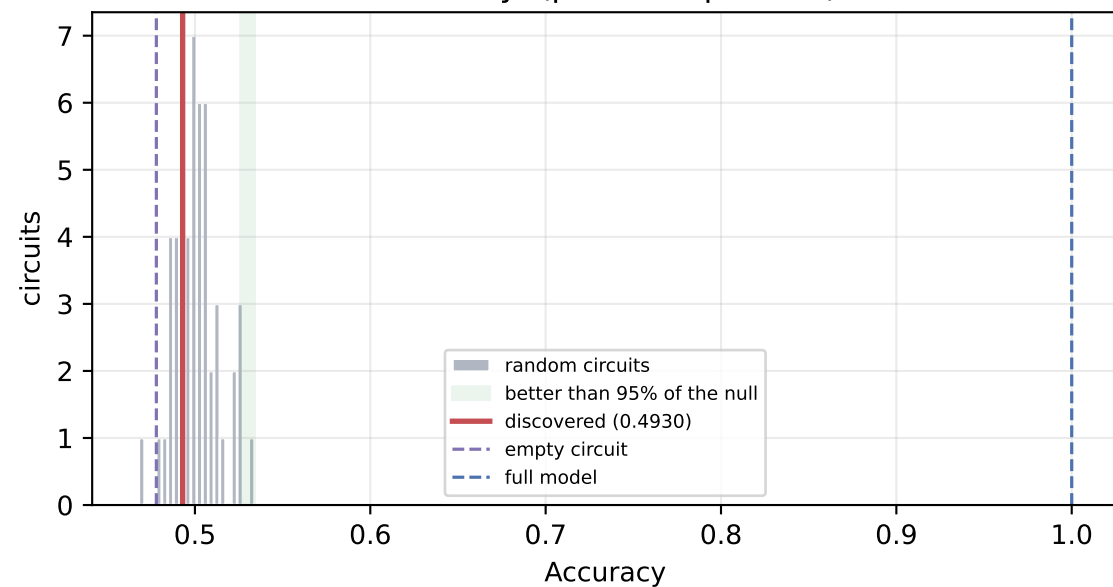

Logit Diff (pct 4.0, p 0.961)

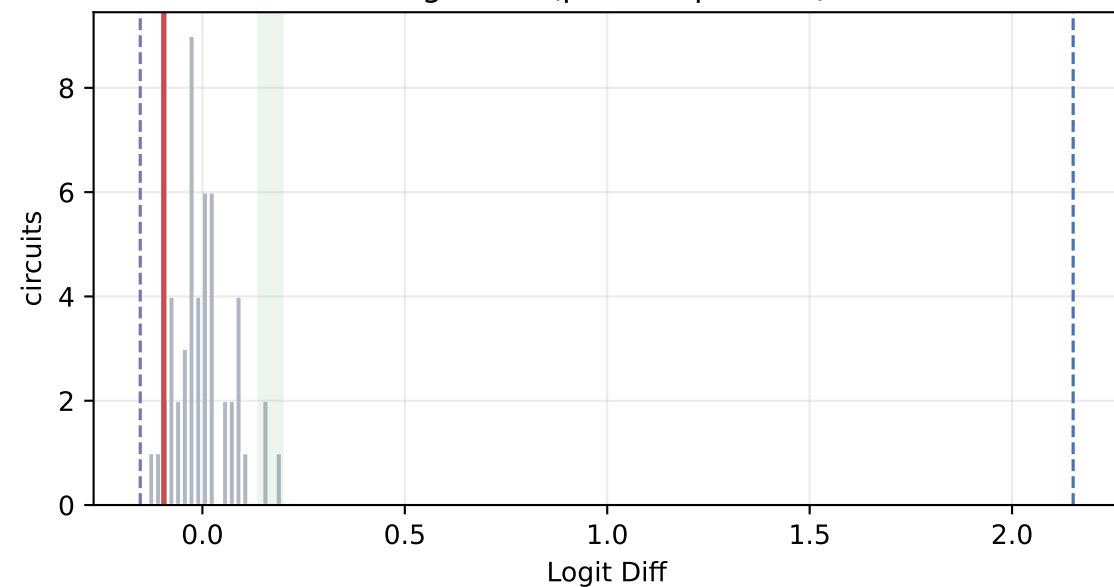

KL Div (pct 44.0, p 0.569)

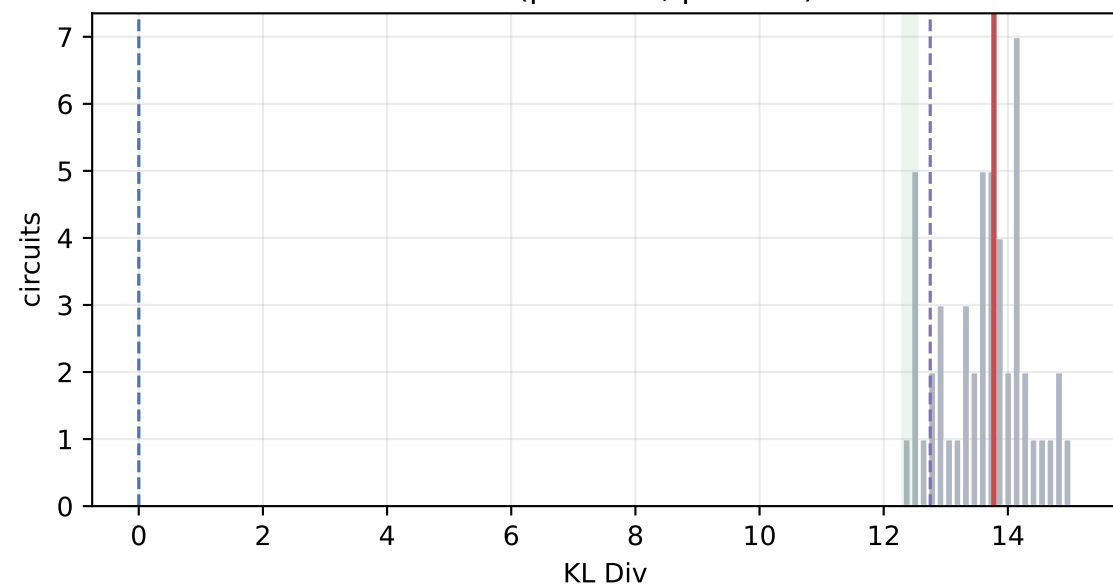

Exact Match (pct 0.0, p 1.000)

