



Random-circuit null (50 circuits, zero ablation)


Accuracy (pct 52.0, p 0.490)

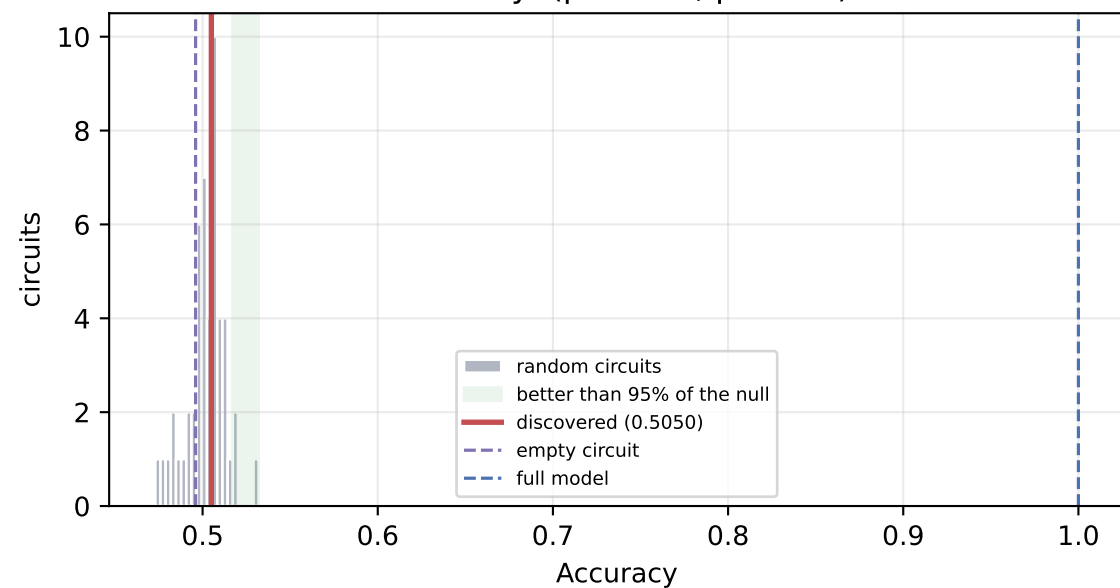

Logit Diff (pct 22.0, p 0.784)

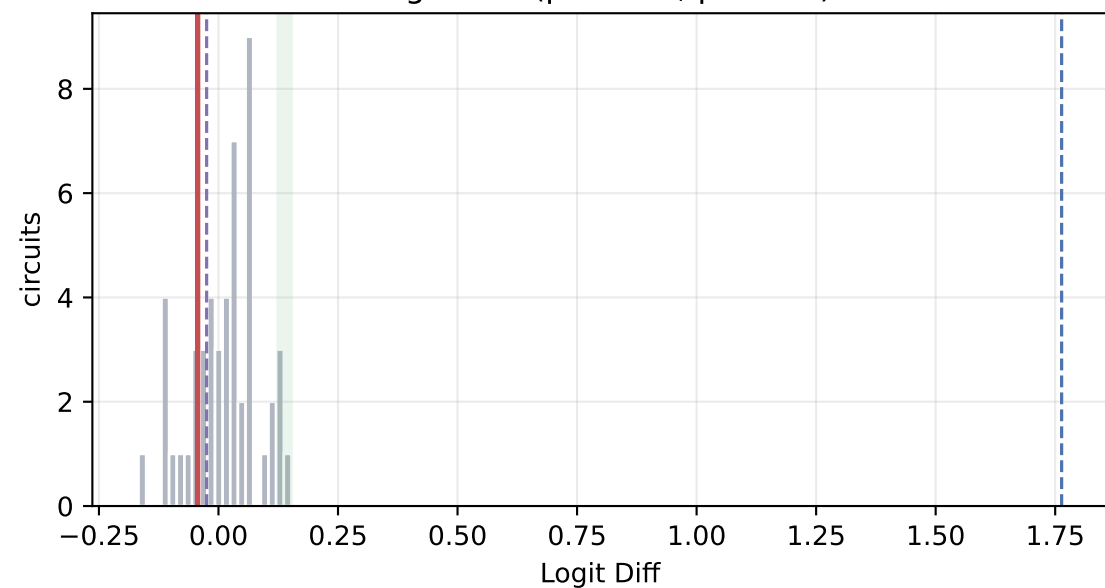

KL Div (pct 22.0, p 0.784)

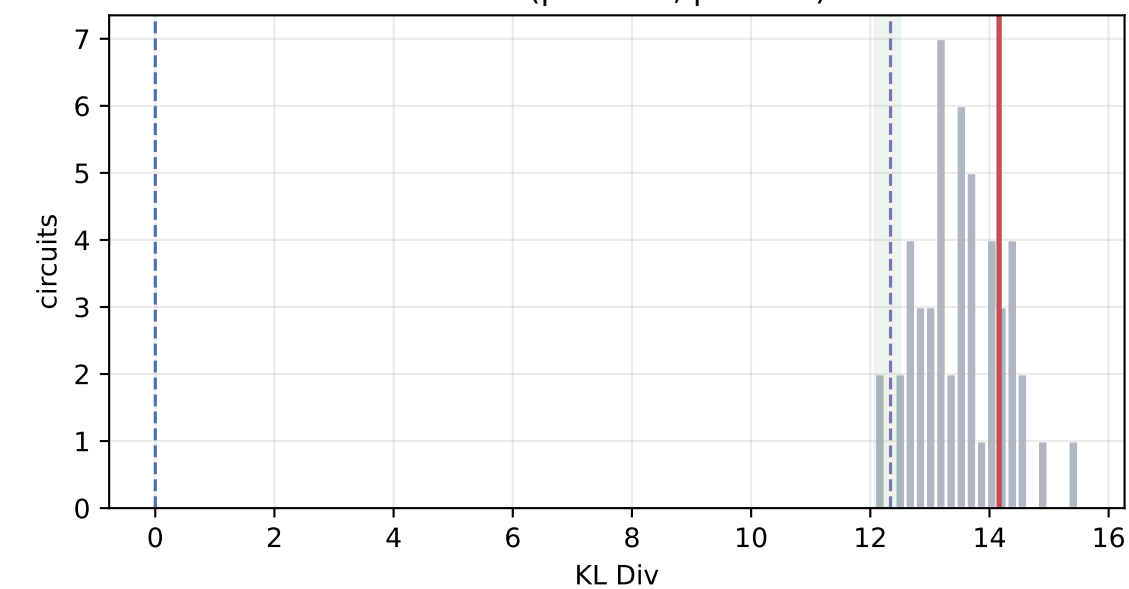

Exact Match (pct 0.0, p 1.000)

