



Random-circuit null (50 circuits, interchange ablation)


Accuracy (pct 0.0, p 1.000)

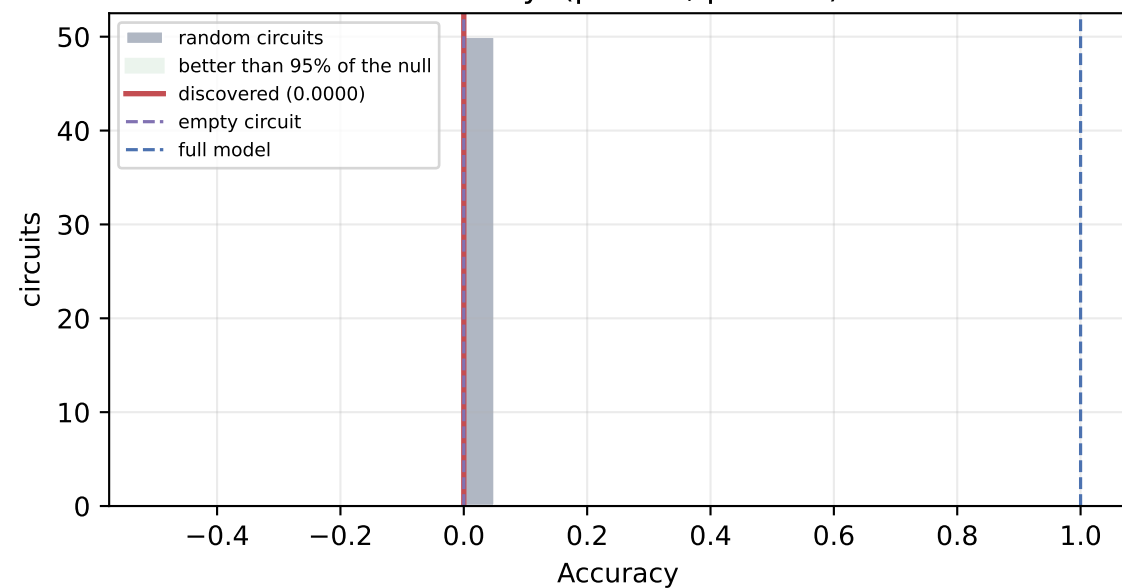

Logit Diff (pct 90.0, p 0.118)

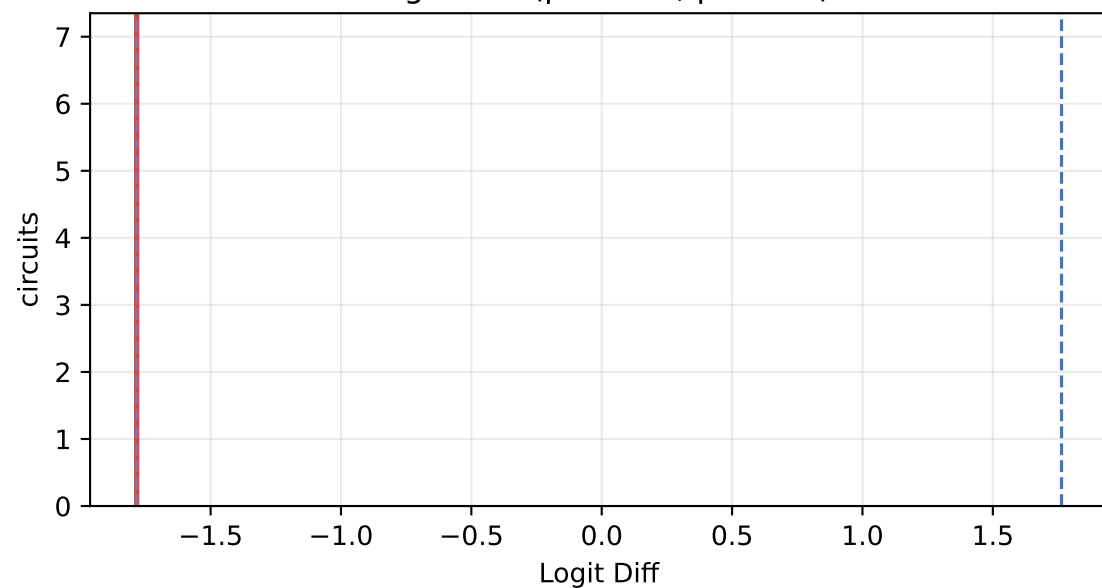

KL Div (pct 72.0, p 0.294)

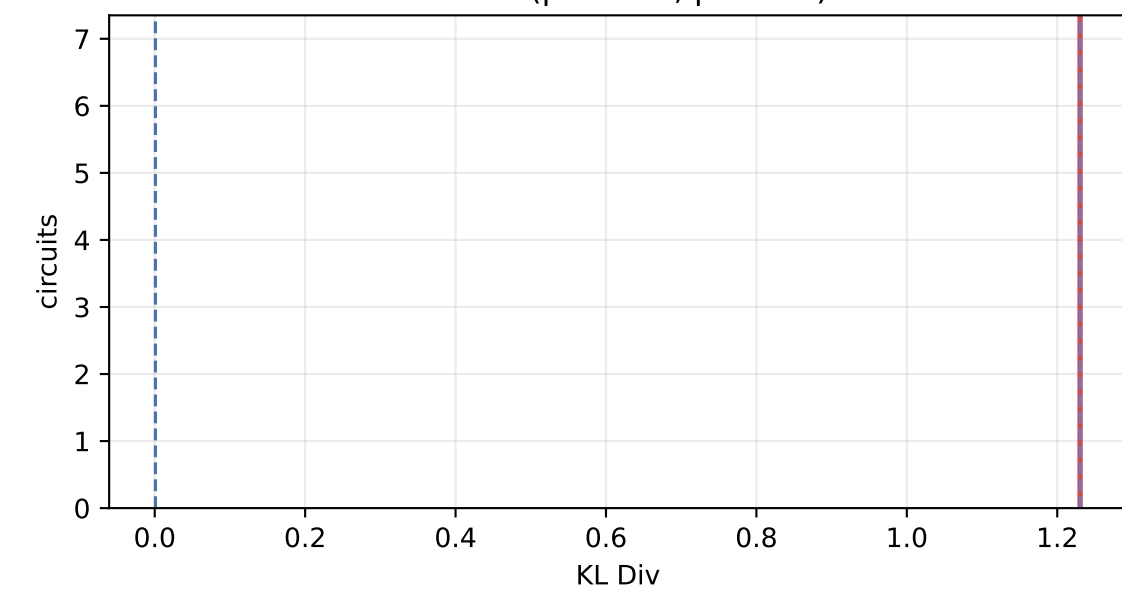

Exact Match (pct 0.0, p 1.000)

