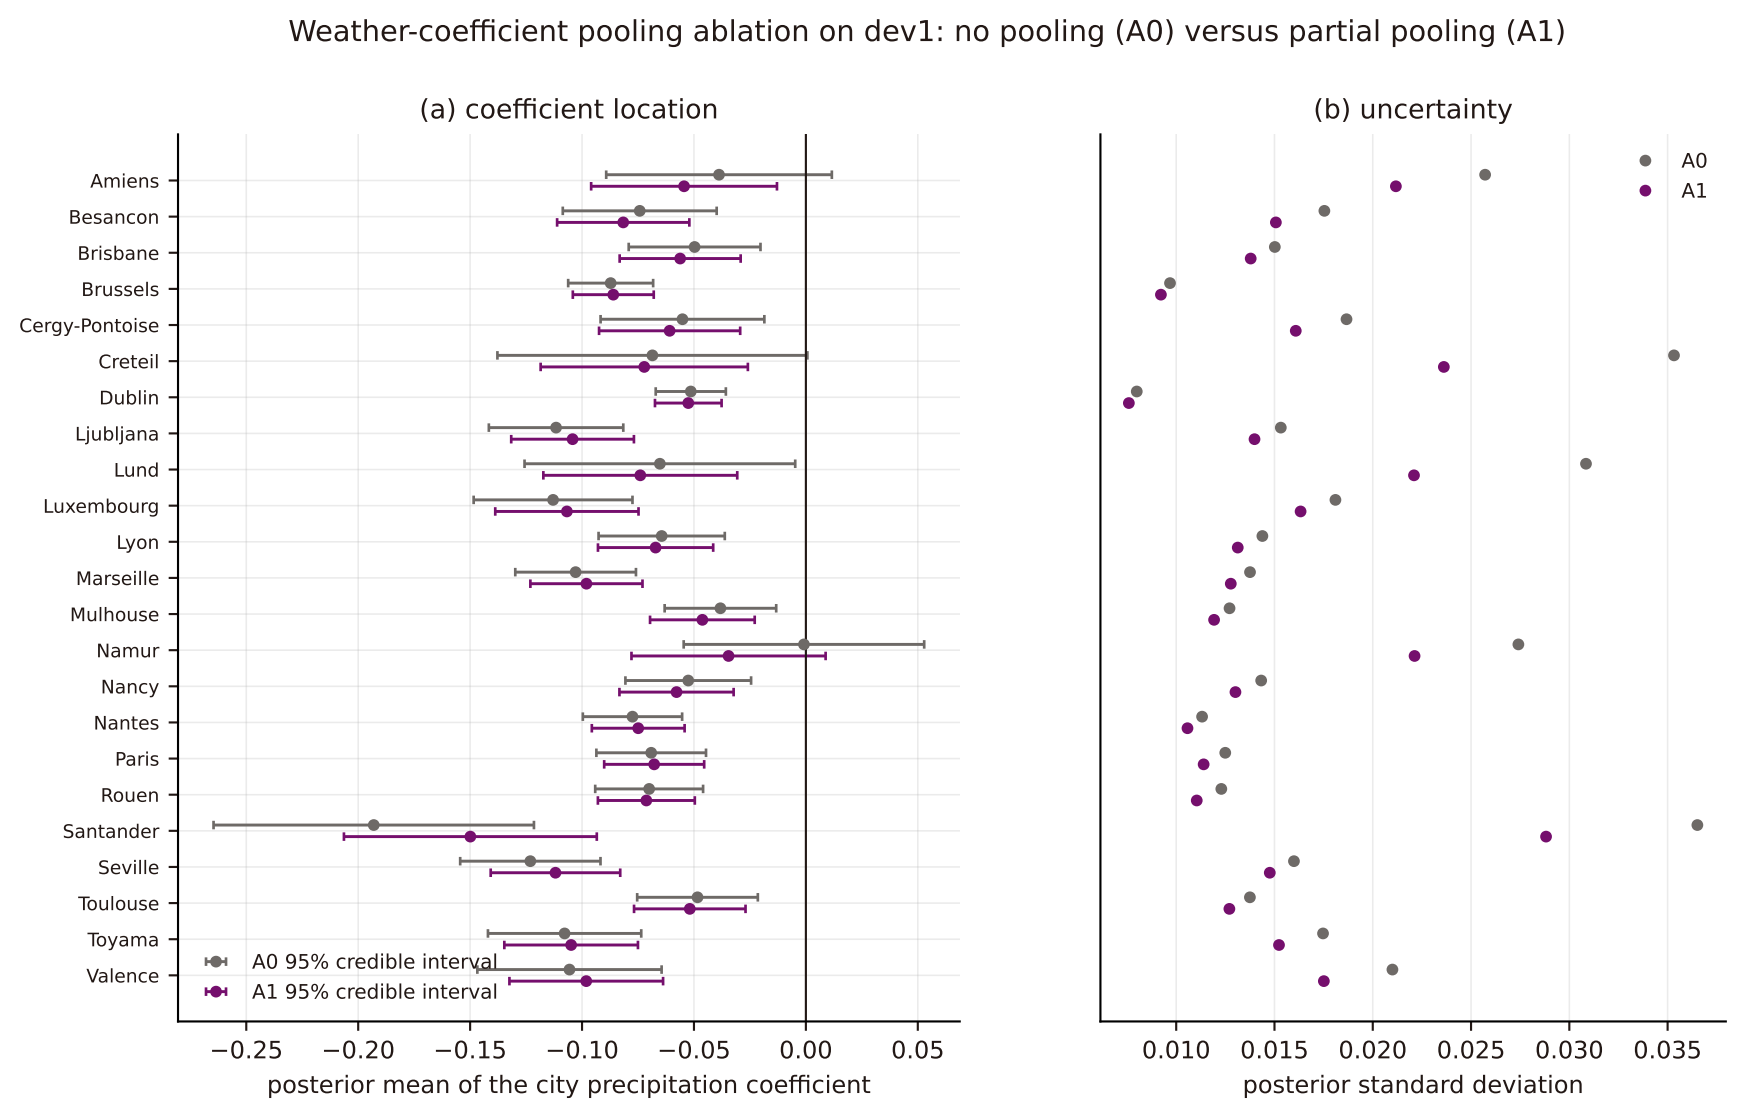
Weather-coefficient pooling ablation on dev1: no pooling (A0) versus partial pooling (A1)
(a) coefficient location
(b) uncertainty
Amiens
Besancon
Brisbane
Brussels
Cergy-Pontoise
Creteil
Dublin
Ljubljana
Lund
Luxembourg
Lyon
Marseille
Mulhouse
Namur
Nancy
Nantes
Paris
Rouen
Santander
Seville
Toulouse
Toyama
Valence
A0 95% credible interval
A1 95% credible interval
−0.25
−0.20
−0.15
−0.10
−0.05
0.00
0.05
posterior mean of the city precipitation coefficient
A0
A1
0.010
0.015
0.020
0.025
0.030
0.035
posterior standard deviation